



**COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM**

STATE ONLY OPERATING PERMIT

Issue Date: June 11, 2020

Effective Date: July 1, 2020

Expiration Date: June 30, 2025

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 21-03006

Federal Tax Id - Plant Code: 43-0470580-1

Owner Information

Name: NESTLE PURINA PETCARE CO
Mailing Address: 6509 BRANDY LN
MECHANICSBURG, PA 17050-2817

Plant Information

Plant: NESTLE PURINA PETCARE CO/MECHANICSBURG
Location: 21 Cumberland County 21910 Hampden Township
SIC Code: 2047 Manufacturing - Dog And Cat Food

Responsible Official

Name: MIKE O'BRIEN
Title: PLANT MGR
Phone: (717) 795 - 5454

Permit Contact Person

Name: JASON CHAMBERLIN
Title: FACILITY/ENVIRONMENTAL SP
Phone: (717) 795 - 5454

[Signature] _____
WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

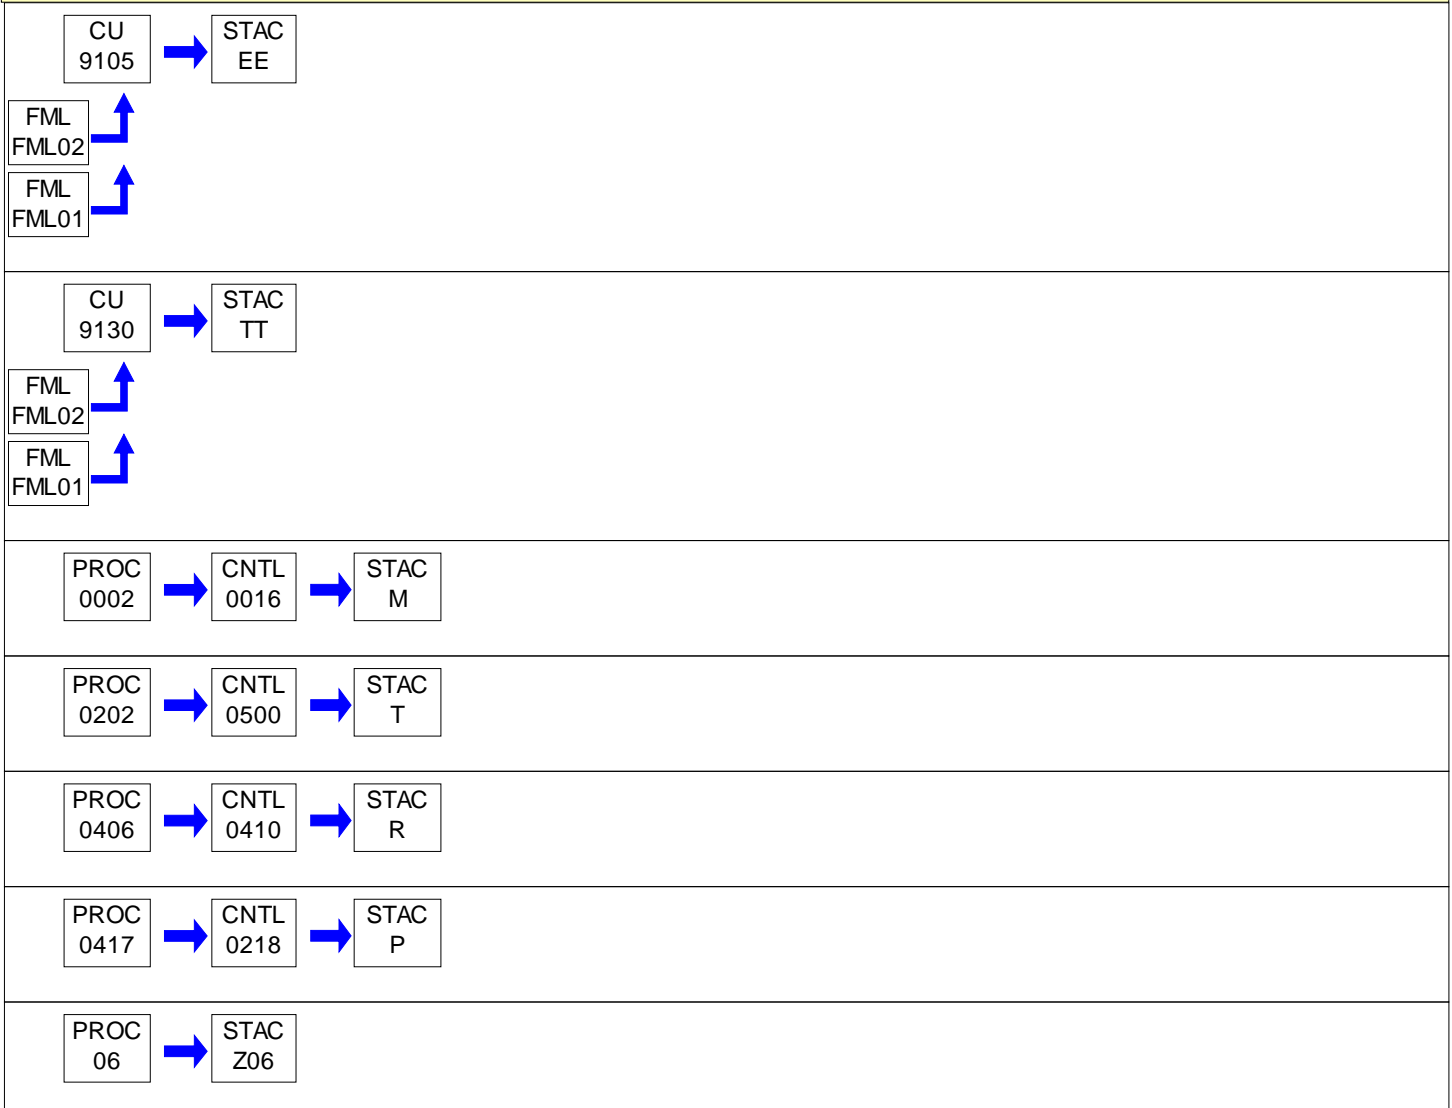
Section H. Miscellaneous

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
9105	BOILER #2 (2002)	29.400 MMBTU/HR	
		28.800 MCF/HR	NG / PROPANE
9130	MIURA BOILERS	23.640 MMBTU/HR	
		23.180 MCF/HR	NG/PROPANE
0002	RAIL & TRUCK UNLOADING		
0202	ODD POUND BINS		
0406	WHOLE GRAIN HAMMERMILLS		
0417	WHOLE GRAIN & SOFT SCALPER		
06	COLD CLEANING STATIONS (DEGREASERS)		
07	DATE CODERS		
0822	SUPER SACK CONVEYING SYSTEM		
101	EMERGENCY FIRE PUMP (166 HP)		
1102	WHOLE STREAM HAMMERMILL BANKS		
1151	EXTRUDER BANK CONVEYORS		
1573A	CONTROLLED CONVEYORS		
2106	DRYER EXHAUSTS		
2163	BANK FP COOLERS		
2176	BULK BAG UNLOADING & CONVEYING SYSTEMS		
2910A	BY-PRODUCT CONVEYING		
2920A	BY-PRODUCT & FP DUST ASPIRATION		
0016	RAIL & TRUCK UNLOADING FILTER		
0218	SCALPER FABRIC COLLECTORS		
0410	WHOLE GRAIN HAMMERMILL FILTERS		
0500	ODD POUND BINS DUST COLLECTION		
0821	FLEXICON FILTER RECEIVER		
1105	WHOLE STREAM HAMMERMILL FILTERS		
1574	CONVEYOR FABRIC FILTERS		
2110	DRYER CYCLONIC SEPARATORS		
2164	FP COOLER CYCLONIC SEPARATORS		
2173	BULK BAG UNLOADING FILTER RECEIVERS		
2910	BY-PRODUCT RECEIVER		
2920	BY-PRODUCT DUST COLLECTION FILTERS		
FML01	NATURAL GAS PIPELINE		
FML02	PROPANE		
FML03	DIESEL FUEL		
A	EXTRUDER BANK CONVEYOR STACKS		
AA	CONTROLLED CONVEYOR STACKS		
BB	BY-PRODUCT CONVEYING STACK		
CC	BY-PRODUCT & FP ASPIRATION STACKS		
E	DRYER SEPARATOR STACKS		

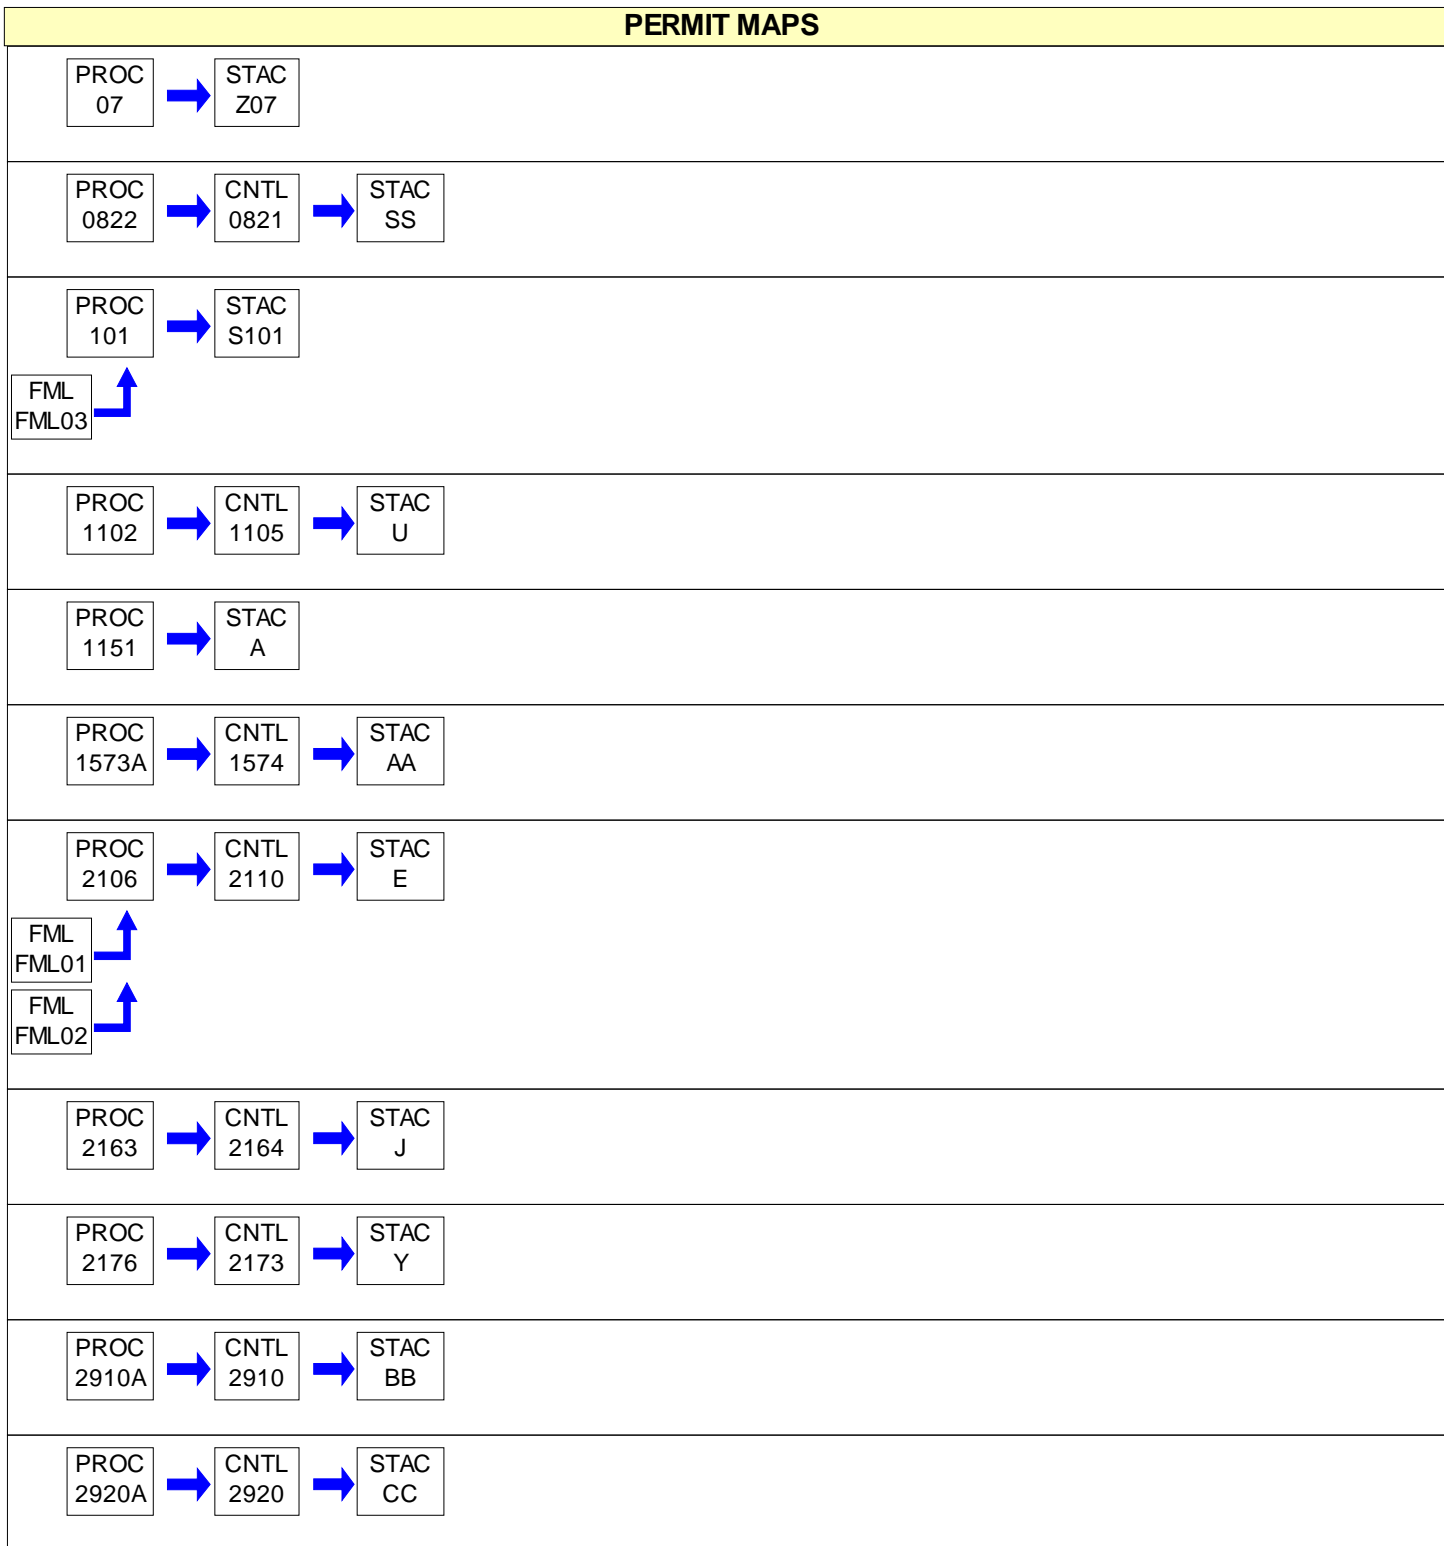
**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
EE	BOILER #2 STACK		
J	FP COOLER STACKS		
M	RAIL & TRUCK UNLOADING STACK		
P	WHOLE GRAIN SCALPER STACKS		
R	WHOLE GRAIN HAMMERMILL STACKS		
S101	EMERGENCY FIRE PUMP STACK		
SS	SUPER SACK CONVEYING STACK		
T	ODD POUND BINS DUST COLLECTION STACK		
TT	MIURA BOILER STACKS		
U	WHOLE STREAM HAMMERMILL STACKS		
Y	BULK BAG UNLOADING STACKS		
Z06	FUGITIVE EMISSIONS FROM DEGREASERS		
Z07	DATE CODER FUGITIVE EMISSIONS		

PERMIT MAPS



PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

(a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.

(b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)&(c)]**Permit Renewal.**

(a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.

(b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.

(c) The permittee shall submit with the renewal application a fee for the processing of the application and an additional annual administrative fee as specified in 25 Pa. Code § 127.703(b) and (c). The fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund" and shall be for the amount specified in the following schedule specified in 25 Pa. Code § 127.703(b) and (c).

(1) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

(d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.

(e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).

(f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

(a) The permittee shall pay fees according to the following schedule specified in 25 Pa. Code § 127.703(b):

(1) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

This fee schedule shall apply to the processing of an application for an operating permit as well as the extension,

**SECTION B. General State Only Requirements**

modification, revision, renewal, and re-issuance of each operating permit or part thereof.

(b) The permittee shall pay an annual operating permit administrative fee according to the fee schedule established in 25 Pa. Code § 127.703(c).

(1) Two hundred fifty dollars for applications filed during the 1995-1999 calendar years.

(2) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(3) Three hundred seventy-five dollars for applications filed during the years beginning in 2005.

(c) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund".

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes

**SECTION B. General State Only Requirements**

a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450 & 127.462]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and

**SECTION B. General State Only Requirements**

significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall make administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall make minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Permit modifications which do not qualify as minor permit modifications under 25 Pa. Code § 127.541 will be treated as a significant operating permit revision subject to the public notification procedures in §§ 127.424 and 127.425.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11]**Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

(a) The permittee may not allow the emission into the outdoor atmosphere of a fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving, and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars, and other vehicular equipment are not considered as emissions from the use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) Sources and classes of sources other than those identified in (a)(1)-(a)(6), above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (i) The emissions are of minor significance with respect to causing air pollution; and
 - (ii) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

The permittee may not allow the emission of fugitive particulate matter into the outdoor atmosphere from a source specified in Section C, Condition #001, if the emissions are visible at the point the emissions pass outside the permittee's property.

003 [25 Pa. Code §123.31]**Limitations**

The permittee may not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

004 [25 Pa. Code §123.41]**Limitations**

The permittee may not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three (3) minutes in any one hour.
- (2) Equal to or greater than 60% at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The emission limitation of 25 Pa. Code Section 123.41, shall not apply when:

- (1) The presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) The emission results from sources specified in Section C, Condition #001, subsections (a)(1)-(a)(7).

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §129.14]****Open burning operations**

(a) The permittee may not allow open burning of materials in such a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the permittee's property.
- (2) Malodorous air contaminants from the open burning are detectable outside the permittee's property.
- (3) The emissions interfere with the reasonable enjoyment of life and property.
- (4) The emissions cause damage to vegetation or property.
- (5) The emissions are or may be deleterious to human or animal health.

(b) Exceptions. The requirements of Subsection (a) do not apply where the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public official.
- (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(c) This permit does not constitute authorization to burn solid waste pursuant to section 610 (3) of the Solid Waste Management Act. 35 PS Section 6018.610 (3) or any other provision of the Solid Waste Management Act.

II. TESTING REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of the sources & control devices referenced in this permit to measure emissions for purposes including verification of permit condition compliance and estimation of annual air emissions.

008 [25 Pa. Code §139.1]**Sampling facilities.**

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such sources. In the request, the Department will set forth the time period in which the facilities shall be provided as well as the specifications for such facilities.

009 [25 Pa. Code §139.11]**General requirements.**

(a) As specified in 25 Pa. Code Section 139.11(1), performance tests shall be conducted while the source is operating at maximum routine operating conditions or under such other conditions, within the capacity of the equipment, as may be requested by the Department.

(b) As specified in 25 Pa. Code Section 139.11(2), the Department will consider test results for approval where sufficient information is provided to verify the source conditions existing at the time of the test and where adequate data is available to show the manner in which the test was conducted. Information submitted to the Department shall include, at a minimum, all of the following:

- (1) A thorough source description, including a description of any air cleaning devices and the flue.

**SECTION C. Site Level Requirements**

- (2) Process conditions, for example, the throughput rate of feed, and other conditions which may affect emissions from the process.
- (3) The location of the sampling ports.
- (4) Effluent characteristics, including velocity, temperature, moisture content, gas density (percentage CO, CO₂, O₂, and N₂), static and barometric pressures.
- (5) Sample collection techniques employed, including procedures used, equipment descriptions, and data to verify that isokinetic sampling for particulate matter collection occurred and that acceptable test conditions were met.
- (6) Laboratory procedures and results.
- (7) Calculated results.

III. MONITORING REQUIREMENTS.**# 010 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and certified in EPA Method 9 to measure plume opacity with the naked eye or with the aid of any device(s) approved by the Department.

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall conduct a monthly inspection around the facility periphery during daylight hours when the sources are in operation, to detect visible emissions, fugitive emissions, and malodorous air contaminants. Monthly inspections are necessary to determine:

- (a) The presence of visible emissions. Visible emissions may be measured according to the methods specified in Section C, Condition #011. Alternately, personnel who observe visible emissions may report the incident to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions.
- (b) The presence of fugitive emissions beyond the property boundaries, as stated in Section C, Condition #002.
- (c) The presence of odorous air contaminants beyond the property boundaries, as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

All records required by this operating permit and subsequent issuances shall be maintained for the most recent five-year period and made available to the Department upon request.

013 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain records of monthly inspections referenced in Section C, Condition #012. The records shall include, at minimum, the following information:

1. The name of the company representative monitoring these instances.
2. The date and time of the observation.
3. The wind direction during each observation.
4. A description of any emissions and/or malodors observed and actions taken to mitigate them. If none, record "NONE."

**SECTION C. Site Level Requirements****# 014 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this permit condition is also derived from Operating Permit No. 21-03006.]

The permittee shall maintain records of fuel usage at this facility.

015 [25 Pa. Code §135.5]**Recordkeeping**

The permittee shall maintain and make available upon request by the Department, records including computerized records that may be necessary to comply with 25 Pa. Code Sections 135.3, and 135.21 (relating to reporting, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions). If direct recordkeeping is not possible or practical, sufficient records shall be kept to provide the needed information by indirect means.

V. REPORTING REQUIREMENTS.**# 016 [25 Pa. Code §127.442]****Reporting requirements.**

The permittee shall report malfunctions which occur at the facility to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner that may result in an increase in air emissions above minor significance. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

(a) When the malfunction poses an imminent and substantial danger to the public health and safety or harm to the environment, the notification shall be reported immediately to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after the incident.

(1) The notice shall describe the:

- (i) name and location of the facility;
- (ii) nature and cause of the malfunction or breakdown;
- (iii) time when the malfunction or breakdown was first observed;
- (iv) expected duration of excess emissions; and
- (v) estimated rate of emissions.

(2) The owner or operator shall notify the Department immediately when corrective measures have been accomplished.

(3) The permittee shall submit a written report of instances of such malfunctions to the department, in writing, within three (3) days of the of the telephone report.

(4) The owner or operator shall submit reports on the operation and maintenance of the source to the Regional Air Program Manager at such intervals and in such form and detail as may be required by the Department. Information required in the reports may include, but is not limited to, process weight rates, firing rates, hours of operation, and maintenance schedules.

(b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirements of (a) above, shall be reported to the Department, in writing, within five (5) days of discovery of the malfunction.

(c) Malfunctions shall be reported to the Department at the following address:

PADEP
Air Quality District Supervisor
909 Elmerton Avenue
Harrisburg, PA 17110

Telephone reports can be made to the Air Quality Program at (717) 705-4702 during normal business hours or to the

**SECTION C. Site Level Requirements**

Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>."

VI. WORK PRACTICE REQUIREMENTS.**# 017 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne from any source specified in Section C, Condition #001(a)(1)-(a)(7). These actions shall include, but are not limited to the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water, or suitable chemicals on dirt roads, material stockpiles, and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

018 [25 Pa. Code §127.444]**Compliance requirements.**

The permittee shall operate and maintain all sources and any air cleaning devices identified in this operating permit in accordance with the manufacturer's recommendations/specifications, as well as in a manner consistent with good air pollution control practices.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

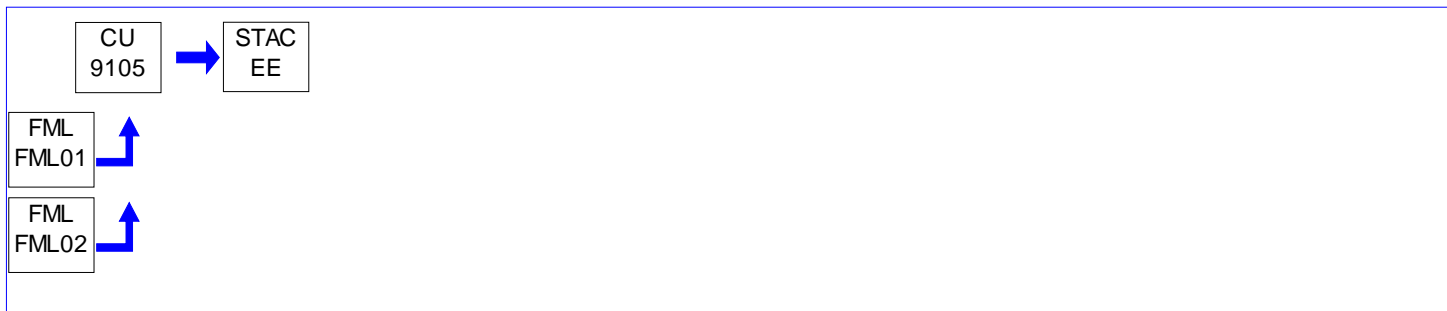
**SECTION D. Source Level Requirements**

Source ID: 9105

Source Name: BOILER #2 (2002)

Source Capacity/Throughput: 29.400 MMBTU/HR
28.800 MCF/HR NG / PROPANE

Conditions for this source occur in the following groups: 003
004

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

The permittee shall limit the emissions of particulate matter from this combustion unit to 0.3 pounds per million BTU of heat input.

002 [25 Pa. Code §123.22]**Combustion units**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

The permittee may not allow the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from this combustion unit in excess of the rate of 0.6 pounds per million BTU of heat input over any one-hour period.

003 [25 Pa. Code §123.41]**Limitations**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

The operation of this combustion unit shall not, at any time, result in the emission of visible emissions, except during periods of startup and shutdown.

004 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

This combustion unit shall maintain nitrogen oxide (NO_x) and carbon monoxide (CO) emissions at or below:

- 30 ppm dv NO_x at three percent oxygen (O₂)
- 50 ppm dv CO at three percent oxygen (O₂)

Fuel Restriction(s).**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

This combustion unit shall only operate on natural gas or propane.



SECTION D. Source Level Requirements

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

All records required by this operating permit and subsequent issuances shall be maintained for the most recent five-year period and made available to the Department upon request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

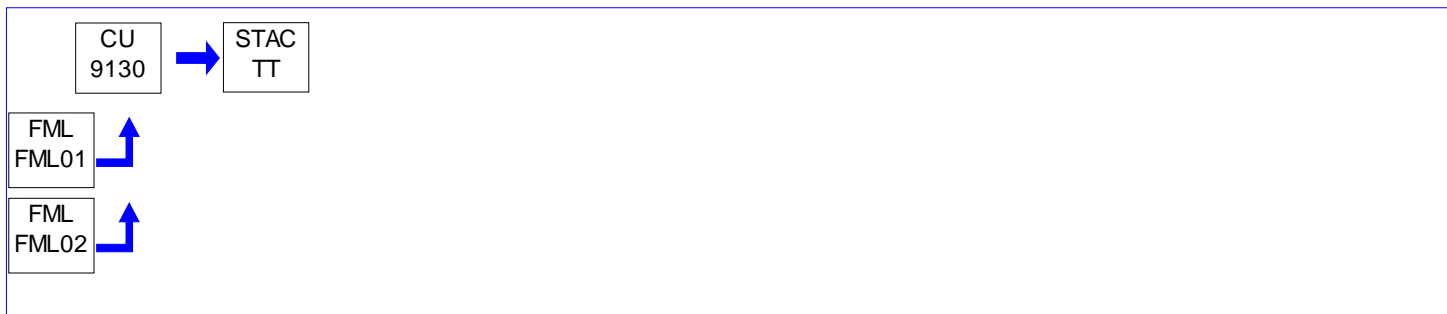
No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 9130

Source Name: MIURA BOILERS

Source Capacity/Throughput: 23.640 MMBTU/HR
23.180 MCF/HR NG/PROPANE

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.11]

Combustion units

A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of 0.4 pound per million Btu of heat input.

002 [25 Pa. Code §123.22]

Combustion units

A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The boilers shall only operate on natural gas or propane.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



SECTION D. Source Level Requirements

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).


**SECTION D. Source Level Requirements**

Source ID: 0002

Source Name: RAIL & TRUCK UNLOADING

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**


Source ID: 0202

Source Name: ODD POUND BINS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001

003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 0406

Source Name: WHOLE GRAIN HAMMERMILLS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 0417

Source Name: WHOLE GRAIN & SOFT SCALPER

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 06

Source Name: COLD CLEANING STATIONS (DEGREASERS)

Source Capacity/Throughput:

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §129.63]****Degreasing operations**

The permittee may not use, sell or offer for sale for use in a cold cleaning machine any solvent with a vapor pressure of 1.0 millimeter of mercury (mm Hg) or greater and containing greater than 5% VOC by weight, measured at 20°C (68°F) containing VOCs.

The above requirement does not apply:

- (i) To cold cleaning machines used in extreme cleaning service.
- (ii) If the owner or operator of the cold cleaning machine demonstrates, and the Department approves in writing, that compliance with this condition will result in unsafe operating conditions.
- (iii) To immersion cold cleaning machines with a freeboard ratio equal to or greater than 0.75.

Throughput Restriction(s).**# 002 [25 Pa. Code §129.63]****Degreasing operations**

Immersion cold cleaning machines shall have a freeboard ratio of 0.50 or greater.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 003 [25 Pa. Code §129.63]****Degreasing operations**

The permittee shall maintain for at least two (2) years and shall provide to the Department, on request, the following information:

- (i) The name and address of the solvent supplier.
- (ii) The type of solvent including the product or vendor identification number.
- (iii) The vapor pressure of the solvent measured in mm Hg at 20°C (68°F).

An invoice, bill of sale, certificate that corresponds to a number of sales, Material Safety Data Sheet (MSDS), or other appropriate documentation acceptable to the Department may be used to comply with this section.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.****# 004 [25 Pa. Code §129.63]****Degreasing operations**

Immersion cold cleaning machines shall be equipped with a cover that shall be closed at all times except during cleaning of parts or the addition or removal of solvent. For remote reservoir cold cleaning machines which drain directly into the solvent storage reservoir, a perforated drain with a diameter of not more than six (6) inches shall constitute an acceptable cover.

005 [25 Pa. Code §129.63]**Degreasing operations**

The permittee shall operate the cold cleaning machines in accordance with the following procedures:

(i) Waste solvent shall be collected and stored in closed containers. The closed containers may contain a device that allows pressure relief, but does not allow liquid solvent to drain from the container.

(ii) Flushing of parts using a flexible hose or other flushing device shall be performed only within the cold cleaning machine. The solvent spray shall be a solid fluid stream, not an atomized or shower spray.

(iii) Sponges, fabric, wood, leather, paper products and other absorbent materials may not be cleaned in the cold cleaning machine.

(iv) Air agitated solvent baths may not be used.

(v) Spills during solvent transfer and use of the cold cleaning machine shall be cleaned up immediately.

006 [25 Pa. Code §129.63]**Degreasing operations**

For immersion cold cleaning machines and remote reservoir cold cleaning machines, the permittee shall:

Have a permanent, conspicuous label summarizing the operating requirements in Source ID 06, Condition #005. In addition, the label shall include the following discretionary good operating practices:

(A) Cleaned parts should be drained at least 15 seconds or until dripping ceases, whichever is longer. Parts having cavities or blind holes shall be tipped or rotated while the part is draining. During the draining, tipping or rotating, the parts should be positioned so that solvent drains directly back to the cold cleaning machine.

(B) When a pump-agitated solvent bath is used, the agitator should be operated to produce a rolling motion of the solvent with no observable splashing of the solvent against the tank walls or the parts being cleaned.

(C) Work area fans should be located and positioned so that they do not blow across the opening of the degreaser unit.

VII. ADDITIONAL REQUIREMENTS.**# 007 [25 Pa. Code §129.63]****Degreasing operations**


The permittee that operates a parts washer or cold cleaning machines that use 2 gallons or more of solvents containing greater than 5% VOC content by weight for the cleaning of metal parts shall comply with the requirements listed in this section.

**SECTION D. Source Level Requirements**

Source ID: 07

Source Name: DATE CODERS

Source Capacity/Throughput:

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §129.63a]****Control of VOC emissions from industrial cleaning solvents.**

§ 129.63a. Control of VOC emissions from industrial cleaning solvents.

(a) Applicability. This section applies to the owner and the operator of a facility at which an industrial cleaning solvent is used or applied in a cleaning activity at a cleaning unit operation, a work production-related work area or a part, product, tool, machinery, equipment, vessel, floor or wall.

(b) [DEFINITIONS INCORPORATED BY REFERENCE]

(c) Exceptions and exemptions.

(1) This section does not apply to all of the following: [NONE OF THE LISTED EXEMPTIONS APPLY]

(2) The VOC emission limitations in subsection (e) do not apply to the use or application of a noncomplying industrial cleaning solvent by the owner or operator of a cleaning unit operation at a facility subject to subsection (a) under either of the

**SECTION D. Source Level Requirements**

following circumstances:

(i) [NA – DEFENSE EXEMPTION NOT CLAIMED]

(ii) [NA – NO SCREEN PRINTING]

(3) The VOC emission limitations in subsection (e) and the work practice requirements in subsection (f) do not apply to the owner or operator of a facility subject to subsection (a) if the total combined actual VOC emissions from all subject cleaning unit operations at the facility are less than 2.7 tons (2,455 kilograms) per 12-month rolling period, before consideration of controls. An owner or operator claiming this exemption shall maintain records in accordance with subsection (h)(4).

(d) [NA – NO EXISTING RACT PERMIT]

(e) [NA-PTE <2.7 tpy]

(f) [NA-NOT SUBJECT TO SECTION (e)]

(g) Compliance demonstration. The owner or operator of a cleaning unit operation subject to this section shall demonstrate compliance as follows:

(1) [NA- emissions less than 2.7 tpy]

(2) The owner or operator of a cleaning unit operation subject to this section claiming exemption under:

(i) [NA-NOT EXEMPT BY SUBSECTION (c)(2)(i)]

(ii) [NA-NOT EXEMPT BY SUBSECTION (c)(2)(ii)]

(iii) Subsection (c)(3) shall maintain records in accordance with subsection (h)(4).

(3) The owner or operator of a cleaning unit operation subject to this section shall determine the VOC content of the industrial cleaning solvent as applied by conducting sampling and testing of the industrial cleaning solvent in accordance with the procedures and test methods specified in subsections (i) and (j) and Chapter 139.

(4) The owner or operator of a cleaning unit operation subject to paragraph (3) may use other test methods or documentation to demonstrate compliance with this section if approved in advance in writing by the Department and the EPA.

(h) Recordkeeping and reporting requirements. The owner or operator of a cleaning unit operation subject to this section shall comply with all of the following applicable recordkeeping and reporting requirements:

(1) [NA- VOC EMISSIONS LESS THAN 2.7 TPY]

(2) [NA- NOT CLAIMING EXEMPTION UNDER (c)(2)(i)]

(3) [NA – NO SCREEN PRINTING]

(4) The owner or operator of a facility claiming exemption under subsection (c)(3) shall maintain monthly records of the industrial cleaning solvents used or applied at the subject cleaning unit operations sufficient to demonstrate that the total combined actual VOC emissions from all subject cleaning unit operations at the facility are less than 2.7 tons (2,455 kilograms) per 12-month rolling period, before consideration of controls.

(5) Records shall be maintained onsite for 2 years, unless a longer period is required under Chapter 127 (relating to construction, modification, reactivation and operation of sources) or a plan approval, operating permit, consent decree or order issued by the Department.

**SECTION D. Source Level Requirements**

(6) Records shall be submitted to the Department in an acceptable format upon receipt of a written request from the Department.

(i) Composite vapor pressure. The composite vapor pressure of organic compounds in cleaning unit operation industrial cleaning solvents shall be determined by one or more of the following procedures:

(1) Quantifying the amount of each compound in the blend using gas chromatographic analysis, using one or more of the following methods:

(i) An appropriate and current ASTM test method with prior written approval from the Department and the EPA.

(ii) Another test method demonstrated to provide results that are acceptable for purposes of determining compliance with this section if prior approval is obtained in writing from the Department and the EPA.

(2) Calculating the composite vapor pressure using the following equation: [SEE REGULATION FOR EQUATION]

(3) Providing documentation from the manufacturer of the industrial cleaning solvent that indicates the composite vapor pressure. The documentation may include an MSDS, CPDS or other data certified by the manufacturer.

(j) Vapor pressure of single component compound. The vapor pressure of each single component compound in a cleaning unit operation industrial cleaning solvent shall be determined from one or more of the following: [SEE REGULATION FOR REFERENCES]

(k) ASTM method references. [SEE REGULATION FOR REFERENCES]

**SECTION D. Source Level Requirements**


Source ID: 0822

Source Name: SUPER SACK CONVEYING SYSTEM

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001

003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

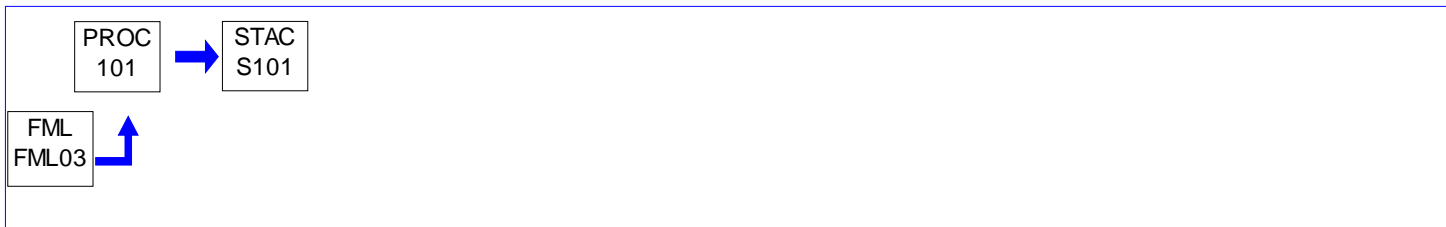
**SECTION D. Source Level Requirements**

Source ID: 101

Source Name: EMERGENCY FIRE PUMP (166 HP)

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 005

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from the emergency fire pump engine in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]**General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from the emergency fire pump engine in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate the emergency fire pump engine using diesel fuel only.

Operation Hours Restriction(s).**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the operation of the emergency fire pump engine to 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**


Source ID: 1102

Source Name: WHOLE STREAM HAMMERMILL BANKS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001

003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**


Source ID: 1151

Source Name: EXTRUDER BANK CONVEYORS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 002

003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 1573A

Source Name: CONTROLLED CONVEYORS

Source Capacity/Throughput:

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

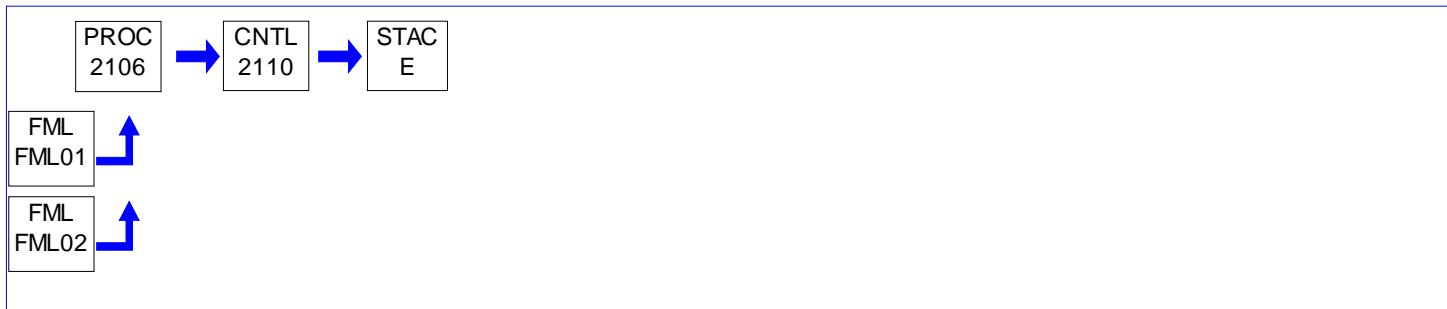
**SECTION D. Source Level Requirements**

Source ID: 2106

Source Name: DRYER EXHAUSTS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 002
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 2163

Source Name: BANK FP COOLERS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 002
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**


Source ID: 2176

Source Name: BULK BAG UNLOADING & CONVEYING SYSTEMS

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001

003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 2910A

Source Name: BY-PRODUCT CONVEYING

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 2920A

Source Name: BY-PRODUCT & FP DUST ASPIRATION

Source Capacity/Throughput:

Conditions for this source occur in the following groups: 001
003

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION E. Source Group Restrictions.**

Group Name: 001

Group Description: Baghouse Particulate Sources

Sources included in this group

ID	Name
0002	RAIL & TRUCK UNLOADING
0202	ODD POUND BINS
0406	WHOLE GRAIN HAMMERMILLS
0417	WHOLE GRAIN & SOFT SCALPER
0822	SUPER SACK CONVEYING SYSTEM
1102	WHOLE STREAM HAMMERMILL BANKS
2176	BULK BAG UNLOADING & CONVEYING SYSTEMS
2910A	BY-PRODUCT CONVEYING
2920A	BY-PRODUCT & FP DUST ASPIRATION

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

No person shall permit the emission into the outdoor atmosphere of particulate matter from a process in excess of 0.02 grain per dry standard cubic foot of effluent gas.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

002 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall maintain instrumentation (differential manometer or equivalent, as approved by the Department) to measure and display the pressure differential across each fabric collector.

IV. RECORDKEEPING REQUIREMENTS.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall monitor and record the pressure differential across each fabric collector. The pressure differential shall be recorded a minimum of once per week while a source and its fabric collector are operating. The permittee shall retain these records for a minimum of five (5) years and shall make them available to the Department upon its request.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall maintain detailed records of all maintenance performed on each fabric collector. The permittee shall retain these records for a minimum of five (5) years and shall make them available to the department upon its request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

**SECTION E. Source Group Restrictions.**

The permittee shall operate a collector at all times that its source is operating.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall operate each collector with its source in accordance with manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: 002

Group Description: Cyclone Particulate Sources

Sources included in this group

ID	Name
1151	EXTRUDER BANK CONVEYORS
2106	DRYER EXHAUSTS
2163	BANK FP COOLERS

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

No person shall permit the emission into the outdoor atmosphere of particulate matter from a process in excess of 0.02 grain per dry standard cubic foot of effluent gas.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

002 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall operate a collector at all times that its source is operating.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall operate each collector with its source in accordance with manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: 003

Group Description: New Equipment

Sources included in this group

ID	Name
0002	RAIL & TRUCK UNLOADING
0202	ODD POUND BINS
0406	WHOLE GRAIN HAMMERMILLS
0417	WHOLE GRAIN & SOFT SCALPER
0822	SUPER SACK CONVEYING SYSTEM
1102	WHOLE STREAM HAMMERMILL BANKS
1151	EXTRUDER BANK CONVEYORS
2106	DRYER EXHAUSTS
2163	BANK FP COOLERS
2176	BULK BAG UNLOADING & CONVEYING SYSTEMS
2910A	BY-PRODUCT CONVEYING
2920A	BY-PRODUCT & FP DUST ASPIRATION
9105	BOILER #2 (2002)

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Plan Approval No. 21-3006.]

The permittee may not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 10% for a period or periods aggregating more than three (3) minutes in any one hour.
- (2) Equal to or greater than 30% at any time.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: 004

Group Description: 40 CFR Part 60, Subpart Dc Requirements

Sources included in this group

ID	Name
9105	BOILER #2 (2002)

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) [NA - NOT SUBJECT TO PM OR SO2 STANDARDS]

(c) [NA - NOT SUBJECT TO PM OR SO2 STANDARDS]

(d) Any temporary change to an existing steam generating unit for the purpose of conducting combustion research is not considered a modification under § 60.14.

(e) [NA - SOURCES NOT ASSOCIATED WITH TURBINES]

(f) [NA - 4A AND 4C NOT APPLICABLE]

**SECTION E. Source Group Restrictions.**

(g) [NA - 4B NOT APPLICABLE]

(h) [NA - J AND Ja NOT APPLICABLE]

(i) [NA - UNIT(S) NOT TEMPORARY]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO₂).

(a) - (j) [NA - UNIT(S) DO NOT BURN COAL OR OIL]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) - (e) [NA - UNIT(S) DO NOT BURN COAL, OIL OR WOOD]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

[NA - NOT SUBJECT TO SO₂ STANDARD]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

[NA - NOT SUBJECT TO PM STANDARD]

§ 60.46c Emission monitoring for sulfur dioxide.

[NA - NOT SUBJECT TO SO₂ STANDARD]

§ 60.47c Emission monitoring for particulate matter.

[NA - NOT SUBJECT TO PM STANDARD]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA - REQUIREMENT IS IN THE PAST]

(b) - (f) [NA - NOT SUBJECT TO PM OR SO₂ STANDARDS]

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the SO₂ standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO₂ standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

**SECTION E. Source Group Restrictions.**

(h) [NA – NO CAPACITY FACTOR REQUIREMENT]

(i) All records required under this section shall be maintained by the owner or operator of the affected facility for a period of two years following the date of such record.

(j) [NA – NO REPORTS REQUIRED]

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. 40 CFR 60.8 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director
Air Protection Division (3AP00)
U.S. EPA Region III
1650 Arch Street
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager
PA Department of Environmental Protection
909 Elmerton Avenue
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**# 002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Applicability and delegation of authority.**

[Additional authority for this permit condition is also derived from Plan Approval No. 21-03006A.]

This boiler is subject to Subpart Dc of the Standards of Performance for New Stationary Sources and shall comply with all applicable requirements of Subpart Dc. 40 CFR Section 60.4 requires submission of copies of all requests, reports, applications, submittals, and other communications to both EPA and the Department.

EPA copies shall be forwarded to:

Director
Air Protection Division (3AP00)
U.S. EPA Region III
1650 Arch Street
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager
PA Department of Environmental Protection
909 Elmerton Avenue
Harrisburg, PA 17110-8200

**SECTION E. Source Group Restrictions.**

Group Name: 005

Group Description: 40 CFR Part 60, Subpart IIII Requirements

Sources included in this group

ID	Name
101	EMERGENCY FIRE PUMP (166 HP)

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200]
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
Am I subject to this subpart?**

§ 60.4200 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [NA – NOT AN ENGINE MANUFACTURER]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

(i) [NA – ENGINE(S) IS/ARE FIRE PUMP ENGINE(S)]

(ii) Manufactured as a certified National Fire Protection Association (NFPA) fire pump engine after July 1, 2006.

(3) [NA – ENGINE(S) NOT MODIFIED/RECONSTRUCTED]

**SECTION E. Source Group Restrictions.**

(4) The provisions of § 60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

(b) [NA – TEST CELL NOT INVOLVED]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) Stationary CI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C (or the exemptions described in 40 CFR part 89, subpart J and 40 CFR part 94, subpart J, for engines that would need to be certified to standards in those parts), except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

(e) [NA – NOT TEMPORARY REPLACEMENT UNIT(S)]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011]

Emission Standards for Owners and Operators

§ 60.4204 What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(ii) [NA – UNIT(S) ARE EMERGENCY]

§ 60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA - ENGINE(S) 2007 MODEL YEAR OR LATER]

(b) [NA – ENGINE(S) IS/ARE FIRE PUMP ENGINE(S)]

(c) Owners and operators of fire pump engines with a displacement of less than 30 liters per cylinder must comply with the emission standards in table 4 to this subpart, for all pollutants.

TABLE 4 REQUIREMENTS

Maximum Engine Power: $75 \leq KW < 130$ ($100 \leq HP < 175$)

Model Year: 2010+

Standards expressed as g/kW-hr (g/hp-hr)

NMHC + NOX: 4.0 (3.0)

PM: 0.30 (0.22)

END OF TABLE 4 REQUIREMENTS

(d) [NA - UNIT(S) < 30 L/CYL]

(e) [NA - DOES NOT CONDUCT PERFORMANCE TESTS IN USE]

(f) [NA - NOT MODIFIED/RECONSTRUCTED]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

§ 60.4206 How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?

**SECTION E. Source Group Restrictions.**

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§ 60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

Fuel Requirements for Owners and Operators

§ 60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?

(a) Beginning October 1, 2007, owners and operators of stationary CI ICE subject to this subpart that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(a).

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(b) for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

(c) [Reserved]

(d) [NA - UNIT(S) < 30 L/CYL]

(e) [NA – NO NATIONAL SECURITY EXEMPTION]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013]

Other Requirements for Owners and Operators

§ 60.4208 What is the deadline for importing or installing stationary CI ICE produced in previous model years?

(a) [NA – ENGINE(S) IS/ARE FIRE PUMP ENGINE(S)]

(b) [NA – ENGINE(S) IS/ARE FIRE PUMP ENGINE(S)]

(c) - (g) [NA - UNIT(S) ARE EMERGENCY]

(h) [NA - IMPORTATION NOT RELEVANT IN THIS CASE]

(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

§ 60.4209 What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in § 60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) [NA – NOT SUBJECT TO 60.4204]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

Compliance Requirements

**SECTION E. Source Group Restrictions.**

§ 60.4210 What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer?

[NA - NOT AN ENGINE MANUFACTURER]

§ 60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR parts 89, 94 and/or 1068, as they apply to you.

(b) [NA - THE EMERGENCY FIRE PUMP WAS MANUFACTURED AFTER THE APPLICABLE MODEL YEAR IN TABLE 3]

(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(b) or §60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in §60.4205(c), you must comply by purchasing an engine certified to the emission standards in §60.4204(b), or §60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

[NOTE: THE ENGINE LABEL INDICATES THAT IT HAS BEEN CERTIFIED PER SUBPART IIII]

(d) [NA - UNITS NOT SUBJECT TO § 60.4204(c) or § 60.4205(d)]

(e) [NA - NOT MODIFIED/RECONSTRUCTED]

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii)-(iii) [NA – NOT OPERATED FOR DEMAND RESPONSE OR VOLTAGE DEVIATION]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) [NA – NOT USED TO SUPPLY POWER AS PART OF A FINANCIAL ARRANGEMENT]

(ii) [Reserved]



SECTION E. Source Group Restrictions.

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) [NA – ENGINE(S) >100 HP]

(2) If you are an owner or operator of a stationary CI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer.

(3) [NA – ENGINE(S) < 500 HP]

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

Testing Requirements for Owners and Operators

§ 60.4212 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?

[NA – TESTING NOT REQUIRED FOR CERTIFIED UNITS WHICH ARE NOT ALTERED PER 60.4211(g)]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

§ 60.4213 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?

[NA – DISPLACEMENT <30 L/CYL]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

Notification, Reports, and Records for Owners and Operators

§ 60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA – UNIT(S) ARE EMERGENCY]

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

Table 5 to Subpart IIII of Part 60

Engine Power	Starting model year
56<=KW<130 (75<=HP<175)	2012

**SECTION E. Source Group Restrictions.**

(c) [NA – NOT SUBJECT TO 60.4204]

(d) [NA – NOT OPERATED FOR DEMAND RESPONSE OR VOLTAGE DEVIATION OR TO SUPPLY POWER AS PART OF A FINANCIAL ARRANGEMENT]

(e) Owners or operators of stationary CI ICE equipped with AECs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECs as required by 40 CFR 1039.665(e).

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

General Provisions

§ 60.4218 What parts of the General Provisions apply to me?

Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart IIII shall comply with all applicable requirements of the Subpart. 40 CFR 60.8 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director
Air Protection Division (3AP00)
U.S. EPA Region III
1650 Arch Street
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager
PA Department of Environmental Protection
909 Elmerton Avenue
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this permit.



SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

Air from Sources 0002 (truck grain receiving) and 0009 (rail car grain receiving) collect dust from the two grain dump pits. Dust laden air from receiving goes through a MAC baghouse (Control 0016) before exhausting to atmosphere.

Dust laden air from Source 0417 (whole grain scalping) and the whole grain elevator goes through a MAC baghouse (Control 0218) before exhausting to atmosphere.

Dust laden air from Source 0031 (softstock scalping), softstock elevator and mixed grain elevator goes through a MAC baghouse (Control 0215) before exhausting to atmosphere. Restrictions on Source 0417 also apply to Source 0031.

Dust laden air from Sources 0406, 0407 and 0443 (whole grain hammermills) is picked up by the respective pneumatic conveying systems and goes through MAC baghouses (Controls 0410, 0411 and 0444) before exhausting to atmosphere. Restrictions on Source 0406 also apply to Sources 0407 and 0444.

Dust laden air from Source 0202 (odd pound dust collection) goes through a baghouse (Control 0500) before exhausting to atmosphere.

Dust laden air from Sources 1102, 1202, 1302, 1402, 1502, and 1604 (whole stream hammermills) goes through MAC baghouses (Controls 1105, 1205, 1305, 1405, 1505, and 1605) before exhausting to atmosphere. Restrictions on Source 1102 also apply to Sources 1202, 1302, 1402, 1502, 1573,

Source 1573 is the #5 hammermill pneumatic conveyance system that transports material from Source 1502 to 1551, the source is controlled by a filter receiver (control 1573-10). Sources 1671 and 1681 are conveyors associated with the new Bank #6 extruder and are controlled by MAC filters (controls 1675 and 1685). Restrictions on Source 1573 also apply to Sources 1671 and 1681.

Extruder pneumatic conveying systems Sources 1151, 1251, 1351, 1451, 1551, 1671, and 1681 pick up product from extruder Bank1, Bank2, Bank3, Bank4, Bank5, and Bank6 and deliver the product to dryers. Restrictions on exhausts from Source 1151 also apply to Sources 1251, 1351, 1451, 1551 1671, and 1681.

Dust laden air from Sources 2106, 2206, 2306, 2406 and 2506 (dryer exhausts) goes through Buhler separators (Controls 2110, 2210, 2310, 2410 and 2510) before exhausting to atmosphere. Restrictions on Source 2106 also apply to Sources 2206, 2306, 2406 and 2506.

Dust laden air from Sources 2176, 2276, 2376, 2476 and 2576 (dry coating bulk bag dump stations) goes through MAC baghouses (Controls 2173, 2273, 2373, 2473 and 2573) before exhausting to atmosphere. Restrictions on Source 2176 also apply to Sources 2276, 2376, 2476 and 2576.

Dust laden air from Sources 2163, 2263, 2363, 2463 and 2563 (finished product coolers) goes through Buhler separators (Controls 2164, 2264, 2364, 2464 and 2564) before exhausting to atmosphere. Restrictions on Source 2163 also apply to Sources 2263, 2363, 2463 and 2563.

Air from By-Product pneumatic conveying system, Source 2910A goes through a MAC filter receiver (Control 2910) before exhausting to atmosphere.

Dust Laden Air from By-Product and Further Processing aspiration systems, Sources 2520A, 2920A, 2128, 2593, and 2549 goes through fabric collectors (Controls 2520, 2920, 2125, 2593-61, 2593-71 and 2547) before exhausting to atmosphere. Restrictions on Source 2920A also apply to Sources 2520A, 2128, 2593, and 2549.

Dust laden air from Source 0822 (Super Sack Conveying System) goes through a Flexicon filter receiver (Control 0821) before exhausting to atmosphere.

Miura Boilers, Sources 9130, 9133 and 9136 (each 7.88 mmBtu/hr natural gas, 200 BHP, Model No. LX-200 SG) exhausts uncontrolled through Stacks TT, UU and VV. Restrictions on Source 9130 also apply to Sources 9133 and 9136.

Source ID 101 - Emergency Fire Pump (166 HP Deutz, Diesel, Compression Ignition, Manufactured 2013, Model DFP6-2012-C31) exhausts uncontrolled through Stack S101.

The following equipment and activities are not subject to any other specific work practices, testing, monitoring, recordkeeping, or reporting requirements:

**SECTION H. Miscellaneous.**

300 gallon diesel fuel tank for filling mobile equipment
 300 gallon No. 2 fuel oil tank for the fire pump
 Vents on two elevator legs
 Ink jet date coders
 Dynamic Dual Conditioners for Bank #5
 Space heaters
 Outside Soft Stock Storage Silos controlled by bin vent filters
 DA Mixers Aspirations for FP Areas 1 - 5
 Central Vacuums
 Laboratory Hood Exhausts
 Propane Mixing Burner 0.8 mmBtu/hr
 Source 1151 preheater 0.7 mmBtu/hr

For clarity, here is a list of sources and their control device. The first item of each section is the source/control/stack listed in the permit, if different, and contains the items following in that section.

ID #	SOURCE DESCRIPTION	CTRL	CONTROL DESCRIPTION	STACK
0002	Rail & Truck Unloading	0016	MAC Filter Receiver	M
0002	Truck Unloading Hopper	0016	MAC Filter Receiver	M
0009	Rail Car Unloading Hopper	0016	MAC Filter Receiver	M
0417	Whole Grain & Soft Stock Scalper	0218	Scalper Fabric Collectors	P
0417	Whole Grain Scalper	0218	MAC Fabric Filter	P
0031	Soft Stock Scalper	0215	MAC Fabric Filter	N
0406	Whole Grain Hammermills	0410	Whole Grain Hammermill Filters	R
0406	Whole Grain Hammermill	0411	MAC Fabric Filter	R
0443	Whole Grain Hammermill	0444	MAC Fabric Filter	S
0407	Whole Grain Hammermill	0410	MAC Fabric Filter	Q
0202	Odd Pound Bins	0500	Odd Pounds Bins Dust Collector	T
0202	Odd Pound Bins	0500	MAC Fabric Filter	T
1102	Whole Stream Hammermill Banks	1105	Whole Stream Hammermill Filters	U
1102	Bank #1 Whole Stream Hammermill	1105	MAC Fabric Filter	U
1202	Bank #2 Whole Stream Hammermill	1205	MAC Fabric Filter	V
1302	Bank #3 Whole Stream Hammermill	1305	MAC Fabric Filter	W
1402	Bank #4 Whole Stream Hammermill	1405	MAC Fabric Filter	X
1502	Bank #5 Whole Stream Hammermill	1505	MAC Fabric Filter	HH
1604	Bank #6 Whole Stream Hammermill	1605	MAC Fabric Filter	AAA
1573A	Controlled Conveyors	1574	Fabric Filters	A
1573	Bank #5 Whole Stream Air Conveyance	1573-10	Filter Receiver	JJ
1671	Bank #6 Conveyance System	1671	MAC Filter	AAB
1681	Bank #6 Conveyance System	1671	MAC Filter	AAC
1151	Extruder Bank Conveyors			A
1151	Extruder Bank #1 Air Conveyance System			A
1251	Extruder Bank #2 Air Conveyance System			B
1351	Extruder Bank #3 Air Conveyance System			C
1451	Extruder Bank #4 Air Conveyance System			D
1551	Extruder Bank #5 Air Conveyance System			KK
2106	Dryer Exhausts	2110	Dryer Cyclonic Separators	E
2106	Dryer #1 Exhaust	2110	Buhler Separator	E
2206	Dryer #2 Exhaust	2210	Buhler Separator	F
2306	Dryer #3 Exhaust	2310	Buhler Separator	G
2406	Dryer #4 Exhaust	2410	Buhler Separator	H
2506	Dryer #5 Exhaust	2510	Buhler Separator	LL

**SECTION H. Miscellaneous.**

2163	Bank FP Coolers	2164	FP Cooler Cyclonic Separators	J
2163	Bank #1 Final Product Cooler	2164	Buhler Separator	J
2263	Bank #2 Final Product Cooler	2264	Buhler Separator	K
2363	Bank #3 Final Product Cooler	2364	Buhler Separator	L
2463	Bank #4 Final Product Cooler	2464	Buhler Separator	FF
2563	Bank #5 Final Product Cooler	2564	Buhler Separator	MM
2176	Bulk Bag Unloading & Conveying	2173	Bulk Bag Unloading Filter Receiver	Y
2176	FP1 Powder Conveying System	2173	MAC Filter Receiver	Y
2276	FP2 Powder Conveying System	2273	MAC Filter Receiver	Z
2376	FP3 Powder Conveying System	2373	MAC Filter Receiver	AA
2476	FP4 Powder Conveying System	2473	MAC Filter Receiver	GG
2576	FP5 Powder Conveying System	2573	MAC Filter Receiver	PP
2910A	By-Product Conveying	2910	By-Product Receiver	BB
2910A	By-Product Conveying	2910	MAC Filter Receiver	BB
2920A	By-Product & FP Dust Aspiration	2920	By-Product Dust Collection Filters	CC
2520A	Further Process Line 4 & 5 Aspiration	2520	MAC Fabric Collector	NN
2920A	Further Process / By-Product Aspiration	2920	MAC Fabric Collector	CC
2128	FP Line 1 Screw Conveyor Aspiration	2125	MAC Fabric Collector	WW
2593	Bank #5 Live Bottom Bin Aspiration	2593-61	Fabric Filter Bin Vent	XX
		2593-71	Fabric Filter Bin Vent	XX
2549	Bank #1 Live Bottom Bin&Transfer Dust Col.	2547	Fabric Collector	YY
0822	Super Sack Conveying System	0821	Flexicon Filter Receiver	SS
9105	Boiler #2 (2002)		Boiler #2 Stack	EE
9105	Hurst natural gas/propane fired Boiler #2			EE
9130	Miura Boilers		Miura Boiler Stack	TT
9130	Miura Boiler			TT
9133	Miura Boiler			UU
9136	Miura Boiler			VV
101	Emergency Fire Pump (166 HP)		Emergency Fire Pump Stack	S101



***** End of Report *****
