



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
AIR QUALITY PROGRAM

STATE ONLY OPERATING PERMIT

Issue Date: August 3, 2020

Effective Date: December 1, 2020

Expiration Date: November 30, 2025

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 21-05068

Synthetic Minor

Federal Tax Id - Plant Code: 23-6002831-18

Owner Information

Name: PA DEPT OF CORR CAMP HILL STATE CORR INST  
Mailing Address: PO BOX 8837  
2500 LISBURN RD  
CAMP HILL, PA 17001-8837

Plant Information

Plant: PA DEPT OF CORR/CAMP HILL SCI  
Location: 21 Cumberland County 21912 Lower Allen Township  
SIC Code: 9223 Public Admin. - Correctional Institutions

Responsible Official

Name: LAUREL HARRY  
Title: SUPT  
Phone: (717) 737 - 4531 Ext.5206

Permit Contact Person

Name: CAROL A PIONTKOWSKI, P.E.  
Title: ENV ENG CONSULTANT  
Phone: (717) 728 - 0372

[Signature] \_\_\_\_\_  
WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



## SECTION A. Table of Contents

### Section A. Facility/Source Identification

Table of Contents  
Site Inventory List

### Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

### Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

### Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

### Section E. Source Group Restrictions

- E-I: Restrictions



## **SECTION A. Table of Contents**

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

### **Section F. Alternative Operating Scenario(s)**

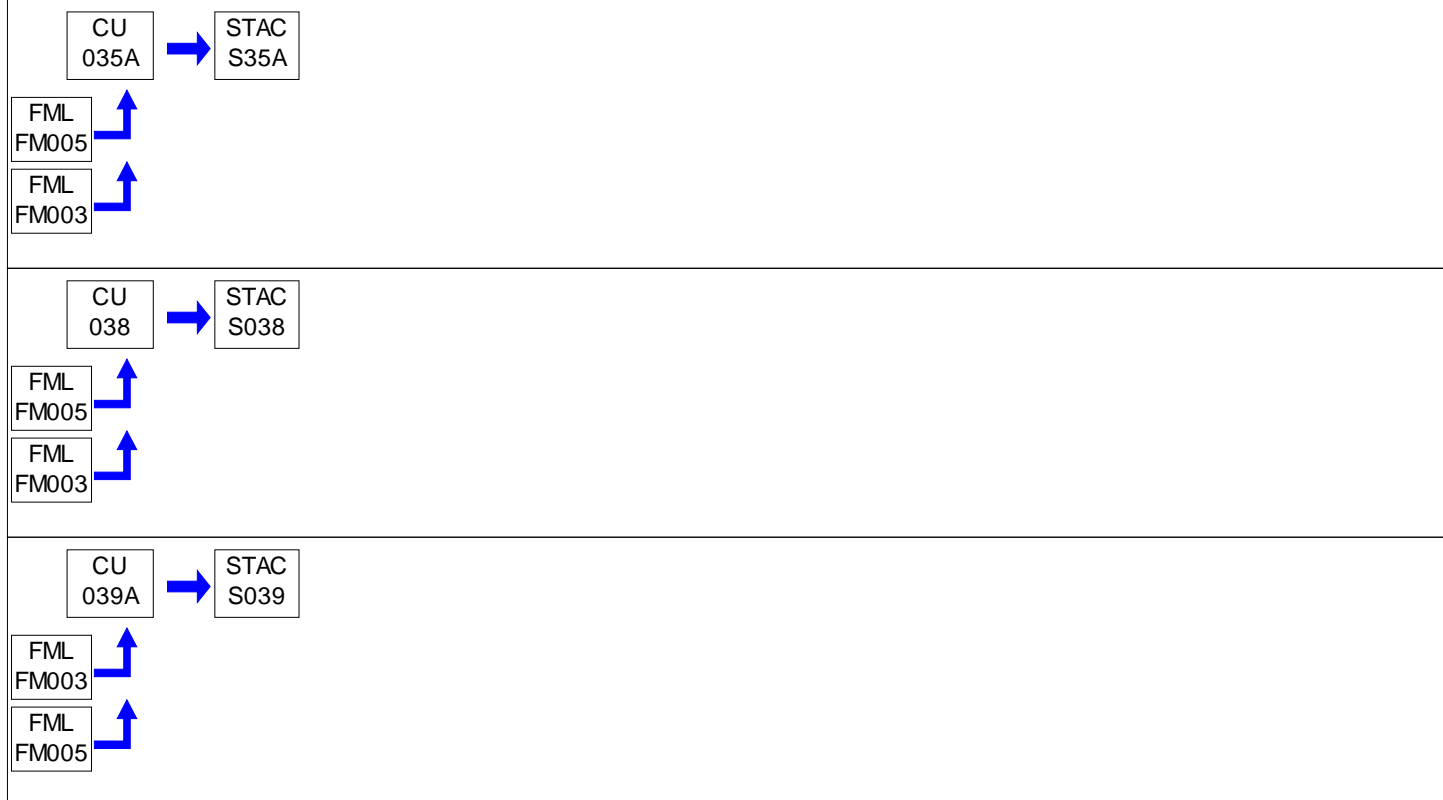
- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

### **Section G. Emission Restriction Summary**

### **Section H. Miscellaneous**

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
035A	PACKAGE BOILER 1 (NEBRASKA)	19.300 MMBTU/HR	
		145.000 Gal/HR	#2 Oil
		18.920 MCF/HR	NATURAL GAS
038	BOILER 4 (NEBRASKA)	63.900 MMBTU/HR	
		463.000 Gal/HR	#2 Oil
		60.860 MCF/HR	NATURAL GAS
039A	NEBRASKA/CLEAVER BROOKS NOS-2AS-67 BOILER	94.700 MMBTU/HR	
		94.700 MCF/HR	Natural Gas
		661.800 Gal/HR	#2 Oil
036	EMERGENCY GENERATOR 1	107.100 Gal/HR	DIESEL FUEL
037	EMERGENCY GENERATOR 2	107.100 Gal/HR	DIESEL FUEL
C039A	SOURCE 039A LOW NOX BURNER(S)		
C039B	SOURCE 039A FLUE GAS RECIRCULATION		
FM003	#2 FUEL OIL		
FM004	DIESEL FUEL STORAGE TANK		
FM005	NATURAL GAS		
S02	GENERATOR 1 & 2 STACK		
S038	BOILER 4 STACK		
S039	NEBRASKA / CLEAVER BROOKS BOILER STACK		
S35A	PACKAGE BOILER 1 STACK		

**PERMIT MAPS**



### PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

**#002 [25 Pa. Code § 127.446]****Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

**#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)&(c)]****Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application and an additional annual administrative fee as specified in 25 Pa. Code § 127.703(b) and (c). The fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund" and shall be for the amount specified in the following schedule specified in 25 Pa. Code § 127.703(b) and (c).
- (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

**#004 [25 Pa. Code § 127.703]****Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay fees according to the following schedule specified in 25 Pa. Code § 127.703(b):
- (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

This fee schedule shall apply to the processing of an application for an operating permit as well as the extension,

**SECTION B. General State Only Requirements**

modification, revision, renewal, and re-issuance of each operating permit or part thereof.

(b) The permittee shall pay an annual operating permit administrative fee according to the fee schedule established in 25 Pa. Code § 127.703(c).

(1) Two hundred fifty dollars for applications filed during the 1995-1999 calendar years.

(2) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(3) Three hundred seventy-five dollars for applications filed during the years beginning in 2005.

(c) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund".

**#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]****Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

**#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]****Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

**#007 [25 Pa. Code §§ 127.441 & 127.444]****Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes

**SECTION B. General State Only Requirements**

a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

**#008 [25 Pa. Code § 127.441]****Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

**#009 [25 Pa. Code §§ 127.442(a) & 127.461]****Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

**#010 [25 Pa. Code § 127.461]****Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

**#011 [25 Pa. Code §§ 127.450 & 127.462]****Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and



**SECTION B. General State Only Requirements**

significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall make administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall make minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Permit modifications which do not qualify as minor permit modifications under 25 Pa. Code § 127.541 will be treated as a significant operating permit revision subject to the public notification procedures in §§ 127.424 and 127.425.

**#012 [25 Pa. Code § 127.441]****Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

**#013 [25 Pa. Code § 127.449]****De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO<sub>x</sub> from a single source during the term of the permit and 5 tons of NO<sub>x</sub> at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM<sub>10</sub> from a single source during the term of the permit and 3.0 tons of PM<sub>10</sub> at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

**#014 [25 Pa. Code § 127.3]****Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

(1) Section 127.14 (relating to exemptions)

(2) Section 127.447 (relating to alternative operating scenarios)

(3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)

(4) Section 127.449 (relating to de minimis emission increases)

(5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

**#015 [25 Pa. Code § 127.11]****Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

**#016 [25 Pa. Code § 127.36]****Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

**#017 [25 Pa. Code § 121.9]****Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

**#018 [25 Pa. Code §§ 127.402(d) & 127.442]****Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager  
PA Department of Environmental Protection  
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

**#019 [25 Pa. Code §§ 127.441(c) & 135.5]****Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

**#020 [25 Pa. Code §§ 127.441(c) and 135.5]****Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

**#021 [25 Pa. Code § 127.441(a)]****Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

**#022 [25 Pa. Code § 127.447]****Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

**#024 [25 Pa. Code §135.4]****Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall not allow the emission into the outdoor atmosphere of any fugitive air contaminant from a source other than the following:

- (a) Construction or demolition of building or structure.
- (b) Grading, paving and maintenance of roads and streets.
- (c) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (d) Clearing of land.
- (e) Stockpiling of material.
- (f) Open burning operations.
- (g) Sources and classes of sources other than those identified in paragraphs (a) through (f), above, for which the operator has obtained a determination from the Department, in accordance with §123.1(b), that fugitive emissions from the source, after appropriate control, meet the following requirements:
  - (1) The emissions are of minor significance with respect to causing air pollution.
  - (2) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air standard.

**# 002 [25 Pa. Code §123.2]****Fugitive particulate matter**

The permittee shall not allow the emission of fugitive particulate matter into the outdoor atmosphere from a source specified in Condition #001 if the emissions are visible at the point the emissions pass outside the permittee's property.

**# 003 [25 Pa. Code §123.31]****Limitations**

The permittee shall not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

**# 004 [25 Pa. Code §123.41]****Limitations**

The permittee shall not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (a) Equal to or greater than 20 percent for a period or periods aggregating more than three minutes in any 1 hour.
- (b) Equal to or greater than 60 percent at any time.

**# 005 [25 Pa. Code §123.42]****Exceptions**

The emission limitation of 25 Pa. Code §123.41 shall not apply when:

- (a) The presence of uncombined water is the only reason for failure of the emission to meet the limitation.
- (b) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (c) The emission results from sources specified in Section C, Condition #001.

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the facility's annual emissions of the following air pollutants to the level specified, based on any consecutive 12 months:

- (a) Nitrogen oxides, expressed as NO<sub>x</sub>: Less than 100 tons,
- (b) Sulfur oxides, expressed as SO<sub>x</sub>: Less than 100 tons,
- (c) Carbon Monoxide: Less than 100 tons,
- (d) PM-10: Less than 100 tons,
- (e) PM-2.5: Less than 100 tons,
- (f) Volatile Organic Compounds (VOC): Less than 50 tons,
- (g) Hazardous air pollutant (HAP): Less than 10 tons for any single HAP, and
- (h) Combined HAPs: Less than 25 tons of combined HAPs.

**II. TESTING REQUIREMENTS.****# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of sources as necessary during the permit term to verify emissions for purposes including permit condition violations, emission fees or malfunctioning.

**# 008 [25 Pa. Code §139.1]****Sampling facilities.**

Upon request by the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance tests on such source by the Department. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.

**III. MONITORING REQUIREMENTS.****# 009 [25 Pa. Code §123.43]****Measuring techniques**

Visible air contaminants may be measured using either of the following:

- (a) A device approved by the Department and maintained to provide accurate opacity measurement.
- (b) Observers, trained and certified in EPA Method 9 to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

**# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall conduct a weekly inspection around the boiler-plant periphery during daylight hours when the plant is in production to detect visible emissions, fugitive visible emissions and malodorous emissions as follows:

- (a) Visible emissions in excess of the limits stated in Section C, Condition #004. Visible emissions may be measured according to the methods specified in Section C, Condition #009. As an alternative, plant personnel who observe such emissions may report the incidence of visible emissions to the Department within two hours of each incident and make arrangements for a certified observer to verify the visible emissions.
- (b) The presence of fugitive visible emissions beyond the boiler-plant boundaries, as stated in Section C, Condition #002.

**SECTION C. Site Level Requirements**

(c) The presence of malodorous air contaminants beyond the plant property boundaries as stated in Section C, Condition #003.

**# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Compliance with the facility's NOx emissions limits in above Condition #006 shall be ensured with monthly monitoring of:

- (a) Fuel combusted in the boilers and engines, and
- (b) NOx emissions calculations.

**IV. RECORDKEEPING REQUIREMENTS.****# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain a logbook for recording status of visible emissions and fugitive visible emission exceedences. The logbook shall also include the name of the facility representative, and the date and time the monitoring was conducted.

**# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain a record of the monthly fuel usage in boilers and emergency generators for #2 Oil.

**V. REPORTING REQUIREMENTS.****# 014 [25 Pa. Code §127.512]****Operating permit terms and conditions.**

[Additional authority for this permit condition is derived from 25 Pa. code §127.511(c)(1)].

The permittee shall report malfunctions which occur at the facility to the Department. A malfunction is defined as any sudden, infrequent and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

(a) Malfunctions which occur at the facility and which pose an imminent danger to the public health, safety, welfare and environment, shall be immediately reported to the Department by telephone. Telephone reports can be made to the Air Quality Program at 717-705-4886 during normal business hours or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>.

The telephone report of such malfunctions shall occur no later than two hours after the incident. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.

(b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirements of paragraph (a), above, shall be reported to the Department, in writing, within five (5) days of discovery of the malfunction.

**VI. WORK PRACTICE REQUIREMENTS.****# 015 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from a source identified in Condition #001 from becoming airborne, as per §123.1(c). These actions shall include, but are not limited to, the following:

- (a) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (b) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may





## SECTION C. Site Level Requirements

give rise to airborne dusts.

(c) Paving and maintenance of roadways.

(d) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

### VII. ADDITIONAL REQUIREMENTS.

#### # 016 [25 Pa. Code §129.14]

##### Open burning operations

(a) No person shall conduct open burning of materials in such a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the permittee's property.
- (2) Malodorous air contaminants from the open burning are detectable outside the permittee's property.
- (3) The emissions interfere with the reasonable enjoyment of life and property.
- (4) The emission cause damage to vegetation or property.
- (5) The emissions are or may be deleterious to human or animal health.

(b) Exceptions. The requirements of Subsection (a) do not apply where the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public official.
- (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(c) This permit does not constitute authorization to burn solid waste pursuant to Section 610 (3) of the Solid Waste Management Act, 35 P. S. Section 6018.610 (3), or any other provision of the Solid Waste Management Act.

### VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

### IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

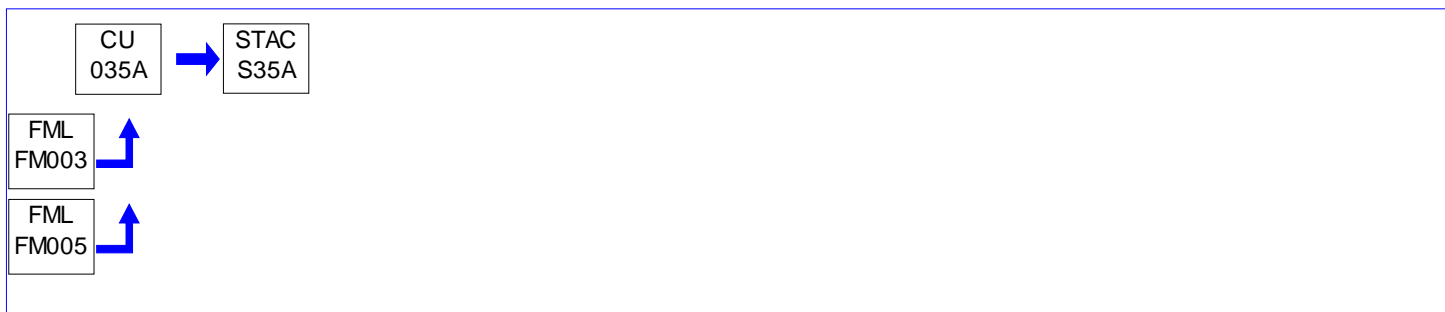
**SECTION D. Source Level Requirements**

Source ID: 035A

Source Name: PACKAGE BOILER 1 (NEBRASKA)

Source Capacity/Throughput: 19.300 MMBTU/HR  
 145.000 Gal/HR #2 Oil  
 18.920 MCF/HR NATURAL GAS

Conditions for this source occur in the following groups: G001

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter from Source ID 035A in excess of 0.4 pound per million btu of heat input as specified in 25 Pa. Code §123.11(a)(1).

[Additional authority for this permit condition is derived from General Permit No. GP1-21-05005C]

**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall not allow the emission into the outdoor atmosphere of the the following pollutants from Source ID 035A in excess of the quantity specified:

- (a) Nitrogen oxides expressed as NOx - 30 ppmvd at 3 percent oxygen when firing gas;
- (b) Nitrogen oxides expressed as NOx - 90 ppmvd at 3 percent oxygen when firing No. 2 fuel oil; and
- (c) Carbon monoxide (CO) - 300 ppmvd at 3 percent oxygen.

[Additional authority for this permit condition is derived from General Permit No. GP1-21-05005C]

**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate Package Boiler 1 (Source ID 035A) using either natural gas or No. 2 fuel oil only.

**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

No. 2 fuel use shall not exceed 6,670 hours of operation during any consecutive 12-month period.

**Fuel Restriction(s).****# 005 [25 Pa. Code §123.22]****Combustion units**

Maximum Allowable Sulfur Content Beginning July 1, 2016, Expressed as Parts per Million (ppm) by Weight or Percentage by Weight:

Grades Commercial Fuel Oil (Consistent with ASTM D396)  
 No. 2 and lighter oil 500 ppm (0.05%)

**SECTION D. Source Level Requirements****II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

**# 006 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The permittee shall monitor the fuel usage on a monthly basis, as opposed to daily, as per the custom schedule approved by EPA Region III.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 007 [25 Pa. Code §127.444]**

**Compliance requirements.**

The permittee shall operate and maintain Source ID 035A in accordance with the manufacturer's specifications.

**VII. ADDITIONAL REQUIREMENTS.**

**# 008 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

Emissions restrictions listed above Section D, Conditions #001 and #003 do not apply during the start-up and shut down, subject to maximum one hour at a time during each start-up and each shut down.

**# 009 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The boiler is currently not subject to 40 CFR Part 63, Subpart JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources (MACT Subpart JJJJJJ) since they fire natural gas or No. 2 fuel oil exclusively. Furthermore, No. 2 fuel oil is only fired during periods of natural gas curtailment, natural gas supply emergencies, or periodic testing (periodic testing of No. 2 fuel oil does not exceed a combined total of 48 hours during any calendar year per boiler). Pursuant to the definition of "gas-fired boiler" contained in 40 CFR §63.11237: "Gas-fired boiler includes any boiler that burns gaseous fuels not combined with any solid fuels, burns liquid fuel only during periods of gas curtailment, gas supply emergencies, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year."

In order to maintain this exemption, the permittee must keep records verifying that the operation of boiler meets the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), during each calendar year. These records shall include the No. 2 fuel oil periodic testing operating hours of boiler during each calendar year. The permittee shall retain these records for a minimum of five (5) years and the records shall be made available to the Department upon its request.

If at any time of the boiler fails to meet the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), the boiler(s) shall become subject to MACT Subpart JJJJJJ and all applicable requirements therein. The permittee shall at that time notify the Department of the change in status of the boiler(s).

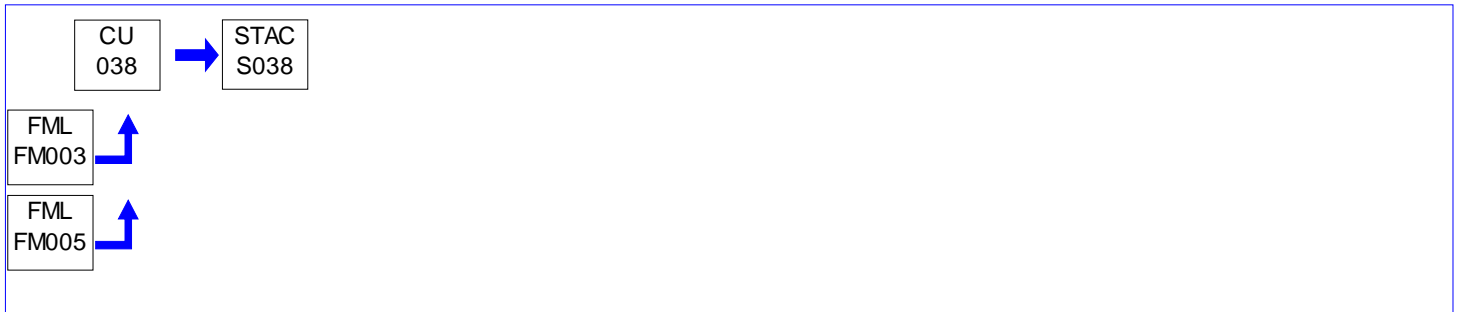
**SECTION D. Source Level Requirements**

Source ID: 038

Source Name: BOILER 4 (NEBRASKA)

Source Capacity/Throughput: 63.900 MMBTU/HR  
 463.000 Gal/HR #2 Oil  
 60.860 MCF/HR NATURAL GAS

Conditions for this source occur in the following groups: G003

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee shall not allow the emission of particulate matter into the outdoor atmosphere from the boiler in excess of the following:

The rate determined by the following formula:

$$A = 3.6E^{-0.56}$$

where:

- A = Allowable emissions in pounds per million BTUs of heat input, and
- E = Heat input to the boiler in millions of BTUs per hour, and
- 0.56 = Exponent of E,
- when E is equal to or greater than 50 but less than 600.

**# 002 [25 Pa. Code §123.22]****Combustion units**

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from Source ID 038 in excess of 4 lbs/mmbtu of heat input, as per §123.22(a)(1).

**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this permit condition is derived from Plan Approval No. 21-05005B.]

(a) The permittee shall not allow the emission into the outdoor atmosphere of nitrogen oxides, expressed as NO<sub>x</sub>, from Source ID 038 in excess of:

- (1) 90 ppmvd at 3 percent oxygen for #2 Oil combustion, and
- (2) 30 ppmvd at 3 percent oxygen for natural gas combustion.

(b) No person shall permit the emission into the outdoor atmosphere of CO from Source ID 038 in excess of 400 ppmvd at 3 percent oxygen.

**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

No. 2 fuel use shall not exceed 6,670 hours of operation during any consecutive 12-month period.

**SECTION D. Source Level Requirements****Fuel Restriction(s).****# 005 [25 Pa. Code §123.22]****Combustion units**

Maximum Allowable Sulfur Content Beginning July 1, 2016, Expressed as Parts per Million (ppm) by Weight or Percentage by Weight:

Grades Commercial Fuel Oil (Consistent with ASTM D396)

No. 2 and lighter oil	500 ppm	(0.05%)
-----------------------	---------	---------

**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate boiler 4 (Source ID 038) using either natural gas or No. 2 fuel oil.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 007 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

(a) The permittee shall maintain comprehensive and accurate record of the following for Source ID 038:

- (1) Operating hours on a monthly and calendar year basis.
- (2) Amount of fuel consumed on a monthly and calendar year basis.
- (3) Fuel analysis and sulfur content of fuel on a quarterly and calendar year basis.

(b) The permittee shall maintain a logbook, and keep a record of annual adjustment and maintenance.

(c) Records shall be made available to the Department's representative upon request.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.****# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate and maintain the Source ID 038 in accordance with the manufacturer's specifications.

**# 009 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall perform an annual adjustment and /or tune up on Source ID 038, which include the following:

- (a) Inspection, adjustment, cleaning or replacement of fuel burning equipment, including the burners and moving parts necessary for proper operation, as specified by the manufacturer.

**SECTION D. Source Level Requirements**

(b) Inspection of air-to-fuel ratio control system and adjustments necessary to ensure proper calibration and operation as per the manufacturer's handout or the operational manual.

**VII. ADDITIONAL REQUIREMENTS.****# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The boiler is currently not subject to 40 CFR Part 63, Subpart JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources (MACT Subpart JJJJJJ) since they fire natural gas or No. 2 fuel oil exclusively. Furthermore, No. 2 fuel oil is only fired during periods of natural gas curtailment, natural gas supply emergencies, or periodic testing (periodic testing of No. 2 fuel oil does not exceed a combined total of 48 hours during any calendar year per boiler).

Pursuant to the definition of "gas-fired boiler" contained in 40 CFR §63.11237: "Gas-fired boiler includes any boiler that burns gaseous fuels not combined with any solid fuels, burns liquid fuel only during periods of gas curtailment, gas supply emergencies, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year."

In order to maintain this exemption, the permittee must keep records verifying that the operation of boiler meets the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), during each calendar year. These records shall include the No. 2 fuel oil periodic testing operating hours of boiler during each calendar year. The permittee shall retain these records for a minimum of five (5) years and the records shall be made available to the Department upon its request.

If at any time of the boiler fails to meet the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), the boiler(s) shall become subject to MACT Subpart JJJJJJ and all applicable requirements therein. The permittee shall at that time notify the Department of the change in status of the boiler(s).

**# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Emissions restrictions listed above Section D, Conditions #001, #002 and #003 do not apply during the start-up and shut down, subject to maximum one hour at a time during each start-up and each shut down.

**SECTION D. Source Level Requirements**

Source ID: 039A

Source Name: NEBRASKA/CLEAVER BROOKS NOS-2AS-67 BOILER

Source Capacity/Throughput:	94.700 MMBTU/HR	
	94.700 MCF/HR	Natural Gas
	661.800 Gal/HR	#2 Oil

Conditions for this source occur in the following groups: G003

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee shall not allow the emission of particulate matter into the outdoor atmosphere from the boiler in excess of the following:

The rate determined by the following formula:

$$A = 3.6E^{(-0.56)}$$

where:

A = Allowable emissions in pounds per million BTUs of heat input, and

E = Heat input to the boiler in millions of BTUs per hour, and

-0.56 = Exponent of E,

when E is equal to or greater than 50 but less than 600.

**# 002 [25 Pa. Code §123.22]****Combustion units**

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from the boiler in excess of four (4) pounds per million BTU of heat input over any one (1) hour period.

**# 003 [25 Pa. Code §127.1]****Purpose.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1, the permittee shall not allow the emission of NO<sub>x</sub> into the outdoor atmosphere from the boiler in excess of the following limits:

(a) 25 ppmvd (corrected to 3% oxygen) when firing natural gas; and

(b) 90 ppmvd (corrected to 3% oxygen) when firing No. 2 fuel oil.

**# 004 [25 Pa. Code §127.1]****Purpose.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1, the permittee shall not allow the emission of CO into the outdoor atmosphere from the boiler in excess of 50 ppmvd @ 3% oxygen.

**SECTION D. Source Level Requirements****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

No. 2 fuel use shall not exceed 6,670 hours of operation during any consecutive 12-month period.

**Fuel Restriction(s).****# 006 [25 Pa. Code §123.22]****Combustion units**

Maximum Allowable Sulfur Content Beginning July 1, 2016, Expressed as Parts per Million (ppm) by Weight or Percentage by Weight:

Grades Commercial Fuel Oil (Consistent with ASTM D396)

No. 2 and lighter oil      500 ppm      (0.05%)

**# 007 [25 Pa. Code §127.1]****Purpose.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1:

(a) PM emissions shall be less than 0.005 lb/mmBtu for natural gas and 0.01 lb/mmBtu for No. 2 oil fuel.

(b) VOC emissions shall be less than 0.004 lb/mmBtu for natural gas and No. 2 oil fuel.

**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate the boiler using either natural gas or No. 2 fuel oil only.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.****# 009 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall calculate the monthly air emissions from the boiler using AP-42 emission factors, manufacturer supplied emission factors, mass material balance, performance (stack) test data, or other method(s) acceptable to the Department.

**IV. RECORDKEEPING REQUIREMENTS.****# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) The permittee shall maintain records of the boiler's monthly air emissions.

(b) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.****# 011 [25 Pa. Code §127.1]****Purpose.**

Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1, the permittee shall install, operate and maintain low NOx burner(s) and a flue gas recirculation (FGR) system in the boiler.

**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The boiler and its associated low NOx burner(s) and FGR system shall be:

- (a) Operated in such a manner as not to cause air pollution.
- (b) Operated and maintained in a manner consistent with good operating and maintenance practices.
- (c) Operated and maintained in accordance with the manufacturer's specifications.

**VII. ADDITIONAL REQUIREMENTS.****# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The boiler is currently not subject to 40 CFR Part 63, Subpart JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources (MACT Subpart JJJJJJ) since they fire natural gas or No. 2 fuel oil exclusively. Furthermore, No. 2 fuel oil is only fired during periods of natural gas curtailment, natural gas supply emergencies, or periodic testing (periodic testing of No. 2 fuel oil does not exceed a combined total of 48 hours during any calendar year per boiler).

Pursuant to the definition of "gas-fired boiler" contained in 40 CFR §63.11237: "Gas-fired boiler includes any boiler that burns gaseous fuels not combined with any solid fuels, burns liquid fuel only during periods of gas curtailment, gas supply emergencies, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year."

In order to maintain this exemption, the permittee must keep records verifying that the operation of boiler meets the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), during each calendar year. These records shall include the No. 2 fuel oil periodic testing operating hours of boiler during each calendar year. The permittee shall retain these records for a minimum of five (5) years and the records shall be made available to the Department upon its request.

If at any time the boiler fails to meet the definition of "gas-fired boiler", above (or as otherwise defined in MACT Subpart JJJJJJ), the boiler(s) shall become subject to MACT Subpart JJJJJJ and all applicable requirements therein. The permittee shall at that time notify the Department of the change in status of the boiler(s).



**SECTION D. Source Level Requirements**

Source ID: 036

Source Name: EMERGENCY GENERATOR 1

Source Capacity/Throughput: 107.100 Gal/HR DIESEL FUEL

Conditions for this source occur in the following groups: G002



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



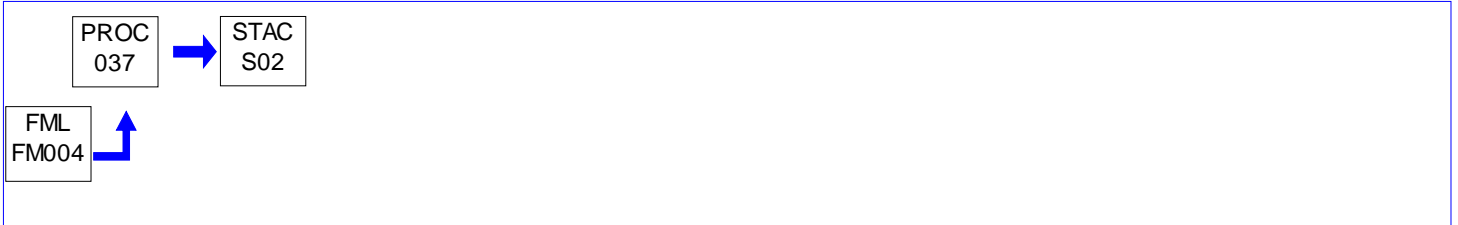
**SECTION D. Source Level Requirements**

Source ID: 037

Source Name: EMERGENCY GENERATOR 2

Source Capacity/Throughput: 107.100 Gal/HR DIESEL FUEL

Conditions for this source occur in the following groups: G002



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION E. Source Group Restrictions.**

Group Name: G001

Group Description: 40 CFR Part 60 Subpart Dc (&lt; 30 mmBtu/hr)

**Sources included in this group**

ID	Name
	035A PACKAGE BOILER 1 (NEBRASKA)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]  
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units  
Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]



**SECTION E. Source Group Restrictions.**

(g) [NA – NOT SUBJECT TO NSPS BBBB]

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO<sub>2</sub>).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) Other fuels-fired affected facilities with heat input capacities between 2.9 and 8.7 MW (10 and 30 MMBtu/h).

(i) The SO<sub>2</sub> emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) [NA – UNIT(S) < 30 MMBTU]

(d) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]



**SECTION E. Source Group Restrictions.**

(e)(1) [NA – UNIT(S) < 30 MMBTU]

(2) [NA – UNIT(S) < 30 MMBTU]

(3) [NA – UNIT(S) < 30 MMBTU]

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO2 emissions is not subject to the PM limit in this section.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO2 standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(b) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(c) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO2 standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

(a) - (f) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16,

**SECTION E. Source Group Restrictions.**

2012]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

(d) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

(1) Calendar dates covered in the reporting period.

(2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) For other fuels:

(i) The name of the supplier of the fuel;

(ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and

(iii) The method used to determine the potential sulfur emissions rate of the fuel.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the

**SECTION E. Source Group Restrictions.**

SO<sub>2</sub> standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO<sub>2</sub> standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

**Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



**SECTION E. Source Group Restrictions.**

Group Name: G002

Group Description: Emergency Generators

Sources included in this group

ID	Name
036	EMERGENCY GENERATOR 1
037	EMERGENCY GENERATOR 2

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter from Source IDs 036 and 037 in a manner that the concentration of particulate in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

**# 002 [25 Pa. Code §123.21]****General**

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides from Source IDs 036 and 037 in a manner that the concentration of sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the annual operating hours on Source IDs 036 and 037 to maximum of 200 hours each.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep a record of each emergency generator operating hours on a calendar year basis.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate and maintain Source IDs 036 and 037 in accordance with the manufacturer's specifications, or as per the operational instructions.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: G003

Group Description: 40 CFR Part 60 Subpart Dc (&gt; 30 mmBtu/hr)

**Sources included in this group**

ID	Name
038	BOILER 4 (NEBRASKA)
039A	NEBRASKA/CLEAVER BROOKS NOS-2AS-67 BOILER

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]  
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units  
Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]

(g) [NA – NOT SUBJECT TO NSPS BBBB]

**SECTION E. Source Group Restrictions.**

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO<sub>2</sub>).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) [NA - THE BOILER 'S HEAT INPUT CAPACITY IS GREATER THAN 30 mmBTU/hr]

(i) The SO<sub>2</sub> emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts coal, wood, or oil and has a heat input capacity of 8.7 MW (30 MMBtu/h) or greater shall cause to be discharged into the atmosphere from that affected facility any gases that exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity. Owners and operators of an affected facility that elect to install, calibrate, maintain, and operate a

**SECTION E. Source Group Restrictions.**

continuous emissions monitoring system (CEMS) for measuring PM emissions according to the requirements of this subpart and are subject to a federally enforceable PM limit of 0.030 lb/MMBtu or less are exempt from the opacity standard specified in this paragraph (c).

(d) The PM and opacity standards under this section apply at all times, except during periods of startup, shutdown, or malfunction.

(e)(1) On and after the date on which the initial performance test is completed or is required to be completed under 40 CFR §60.8, whichever date comes first, no owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels and has a heat input capacity of 8.7 MW (30 mmBTU/hr) or greater shall cause to be discharged into the atmosphere from that affected facility any gases that contain particulate matter (PM) in excess of 13 ng/J (0.030 lb/mmBTU) heat input, except as provided in 40 CFR §60.43c(e)(2), (e)(3), and (e)(4), below. [SOURCE ID 038 WAS INSTALLED IN 2001, WHICH IS BEFORE 2/28/05, AND HAS NOT BEEN "MODIFIED" PER THE NSPS, SINCE. THEREFORE, SOURCE ID 038 IS EXEMPT FROM THIS REQUIREMENT]

(2) [N/A - APPLIES TO A BOILER MODIFICATION; ALSO, SEE PART PART (e)(4), BELOW]

(3) [N/A - THE BOILER DOES NOT FIRE WOOD; IT FIRES NATURAL GAS OR NO. 2 FUEL OIL ONLY]

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO<sub>2</sub> emissions is not subject to the PM limit in this section. [THE NO. 2 FUEL OIL COMBUSTED BY SOURCE ID 039A IS REQUIRED TO HAVE A SULFUR CONTENT NO GREATER THAN 0.5 WEIGHT PERCENT PURSUANT TO 25 Pa. Code §127.1 (BEST AVAILABLE TECHNOLOGY [BAT])]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [INITIAL PERFORMANCE TEST WAS CONDUCTED IN THE PAST]

(b) [NA - NOT SUBJECT TO § 60.43c(b)(2)]

(c) [NA- CEMS NOT USED]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h). [THE BOILER DOES NOT FIRE RESIDUAL OIL; IT FIRES NO. 2 (DISTILLATE) FUEL OIL OR NATURAL GAS ONLY]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

**SECTION E. Source Group Restrictions.**

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

(a) Except as provided in paragraphs (c), (d), (e), and (f) of this section, owner or operator of an affected facility subject to an opacity standard in § 60.43c(c) that is not required to use a COMS due to paragraphs (c), (d), (e), or (f) of this section that elects not to use a COMS shall conduct a performance test using Method 9 of appendix A-4 of this part and the procedures in § 60.11 to demonstrate compliance with the applicable limit in § 60.43c by April 29, 2011, within 45 days of stopping use of an existing COMS, or within 180 days after initial startup of the facility, whichever is later, and shall comply with either paragraphs (a)(1), (a)(2), or (a)(3) of this section. The observation period for Method 9 of appendix A-4 of this part performance tests may be reduced from 3 hours to 60 minutes if all 6-minute averages are less than 10 percent and all individual 15-second observations are less than or equal to 20 percent during the initial 60 minutes of observation.

(1) Except as provided in paragraph (a)(2) and (a)(3) of this section, the owner or operator shall conduct subsequent Method 9 of appendix A-4 of this part performance tests using the procedures in paragraph (a) of this section according to the applicable schedule in paragraphs (a)(1)(i) through (a)(1)(iv) of this section, as determined by the most recent Method 9 of appendix A-4 of this part performance test results.

(i) If no visible emissions are observed, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 12 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(ii) If visible emissions are observed but the maximum 6-minute average opacity is less than or equal to 5 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 6 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(iii) If the maximum 6-minute average opacity is greater than 5 percent but less than or equal to 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 3 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later; or

(iv) If the maximum 6-minute average opacity is greater than 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 45 calendar days from the date that the most recent performance test was conducted.

(2) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 of this part performance tests, elect to perform subsequent monitoring using Method 22 of appendix A-7 of this part according to the procedures specified in paragraphs (a)(2)(i) and (ii) of this section.

(i) The owner or operator shall conduct 10 minute observations (during normal operation) each operating day the affected facility fires fuel for which an opacity standard is applicable using Method 22 of appendix A-7 of this part and demonstrate that the sum of the occurrences of any visible emissions is not in excess of 5 percent of the observation period ( i.e. , 30 seconds per 10 minute period). If the sum of the occurrence of any visible emissions is greater than 30 seconds during the initial 10 minute observation, immediately conduct a 30 minute observation. If the sum of the occurrence of visible emissions is greater than 5 percent of the observation period ( i.e., 90 seconds per 30 minute period), the owner or operator shall either document and adjust the operation of the facility and demonstrate within 24 hours that the sum of the occurrence of visible emissions is equal to or less than 5 percent during a 30 minute observation ( i.e., 90 seconds) or conduct a new Method 9 of appendix A-4 of this part performance test using the procedures in paragraph (a) of this section within 45 calendar days according to the requirements in § 60.45c(a)(8).

**SECTION E. Source Group Restrictions.**

(ii) If no visible emissions are observed for 10 operating days during which an opacity standard is applicable, observations can be reduced to once every 7 operating days during which an opacity standard is applicable. If any visible emissions are observed, daily observations shall be resumed.

(3) [NA - DIGITAL OPACITY COMPLIANCE SYSTEM NOT USED]

(b) [NA – COMS NOT REQUIRED PER (C)]

(c) Owners and operators of an affected facilities that burn only distillate oil that contains no more than 0.5 weight percent sulfur and/or liquid or gaseous fuels with potential sulfur dioxide emission rates of 26 ng/J (0.060 lb/MMBtu) heat input or less and that do not use a post-combustion technology to reduce SO<sub>2</sub> or PM emissions and that are subject to an opacity standard in § 60.43c(c) are not required to operate a COMS if they follow the applicable procedures in § 60.48c(f).

(d) [NA - PM CEMS NOT USED]

(e) [NA - DOES NOT MAINTAIN CO EMISSION RECORDS ON AN OPERATING DAY BASIS]

(f) An owner or operator of an affected facility that is subject to an opacity standard in § 60.43c(c) is not required to operate a COMS provided that the affected facility meets the conditions in either paragraphs (f)(1), (2), or (3) of this section.

(1) [NA - NO BAGHOUSE]

(2) [NA - NO ESP]

(3) The affected facility burns only gaseous fuels and/or fuel oils that contain no greater than 0.5 weight percent sulfur, and the owner or operator operates the unit according to a written site-specific monitoring plan approved by the permitting authority. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard. For testing performed as part of this site-specific monitoring plan, the permitting authority may require as an alternative to the notification and reporting requirements specified in §§ 60.8 and 60.11 that the owner or operator submit any deviations with the excess emissions report required under § 60.48c(c). [THE PERIODIC PLANT PERIPHERY INSPECTIONS REQUIRED IN SECTION C OF THIS PERMIT WILL SERVE AS THE SITE-SPECIFIC MONITORING PLAN]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) In addition to the applicable requirements in § 60.7, the owner or operator of an affected facility subject to the opacity limits in § 60.43c(c) shall submit excess emission reports for any excess emissions from the affected facility that occur during the reporting period and maintain records according to the requirements specified in paragraphs (c)(1) through (3) of this section, as applicable to the visible emissions monitoring method used.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (c)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

**SECTION E. Source Group Restrictions.**

- (iii) Copies of all visible emission observer opacity field data sheets;
- (2) For each performance test conducted using Method 22 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (c)(2)(i) through (iv) of this section.
  - (i) Dates and time intervals of all visible emissions observation periods;
  - (ii) Name and affiliation for each visible emission observer participating in the performance test;
  - (iii) Copies of all visible emission observer opacity field data sheets; and
  - (iv) Documentation of any adjustments made and the time the adjustments were completed to the affected facility operation by the owner or operator to demonstrate compliance with the applicable monitoring requirements.
- (3) [NA – NO COMS USED]
  - (d) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.
  - (e) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.
    - (1) Calendar dates covered in the reporting period.
    - (2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]
      - (11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.
    - (f) Fuel supplier certification shall include the following information:
      - (1) For distillate oil:
        - (i) The name of the oil supplier;
        - (ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and
        - (iii) The sulfur content or maximum sulfur content of the oil.
  - (2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]
  - (3) [NA – UNIT(S) NOT COAL FIRED]
  - (4) For other fuels:
    - (i) The name of the supplier of the fuel;
    - (ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and
    - (iii) The method used to determine the potential sulfur emissions rate of the fuel.
- (g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

**SECTION E. Source Group Restrictions.**

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the SO<sub>2</sub> standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO<sub>2</sub> standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

#### Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.





**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this permit.



**SECTION G. Emission Restriction Summary.**

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

#001 The following underground diesel fuel (#2 Oil) tanks for Emergency Generators do not require any restrictions, work practice standards or testing, monitoring, recordkeeping and reporting requirements:

- (a) Storage tank capacity 5,000 gallons.
- (b) Storage tank capacity 3,000 gallons.

#002 This permit incorporates the following permits:

- (a) Plan Approval No. 21-05005B for Source ID 038, New Boiler (Nebraska), #2 Oil or natural gas fired. PA was issued on Dec. 10, 2001.
- (b) General Permit (GP) No. GP1-21-05005C for Source ID 035A, Package Boiler (Nebraska), #2 Oil or natural gas fired.
- (c) Plan Approval No. 21-05005D for Source ID 039A, Nebraska Boiler, natural gas or #2 oil-fired. PA was issued on Oct. 11, 2016.

-----  
RFD # 1392 was approved by the Department in May 2016 regarding the conversion of Source ID 035A (Package Boiler 1) to natural gas with #2 fuel oil as a back up.



\*\*\*\*\* End of Report \*\*\*\*\*

---