



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
AIR QUALITY PROGRAM

STATE ONLY OPERATING PERMIT

Issue Date: May 2, 2018

Effective Date: June 1, 2018

Expiration Date: May 31, 2023

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 36-05125

Synthetic Minor

Federal Tax Id - Plant Code: 23-6002831-28

Owner Information

Name: PA DEPT OF CORR

Mailing Address: 1451 N MARKET ST

ELIZABETHTOWN, PA 17022-1223

Plant Information

Plant: PA DEPT OF CORR/ELIZABETHTOWN TRAINING ACAD

Location: 36 Lancaster County

36942 Mount Joy Township

SIC Code: 9223 Public Admin. - Correctional Institutions

Responsible Official

Name: MICHAEL DOOLEY

Title: DIR

Phone: (717) 367 - 9070

Permit Contact Person

Name: CAROL PIONTKOWSKI

Title: ENV ENG CONSULT

Phone: (717) 728 - 0372

[Signature] \_\_\_\_\_

WILLIAMR. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER

## SECTION A. Table of Contents

### Section A. Facility/Source Identification

Table of Contents  
Site Inventory List

### Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.

### Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

### Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

### Section E. Source Group Restrictions

- E-I: Restrictions
- E-II: Testing Requirements
- E-III: Monitoring Requirements



## **SECTION A. Table of Contents**

E-IV: Recordkeeping Requirements  
E-V: Reporting Requirements  
E-VI: Work Practice Standards  
E-VII: Additional Requirements

### **Section F. Alternative Operating Scenario(s)**

F-I: Restrictions  
F-II: Testing Requirements  
F-III: Monitoring Requirements  
F-IV: Recordkeeping Requirements  
F-V: Reporting Requirements  
F-VI: Work Practice Standards  
F-VII: Additional Requirements

### **Section G. Emission Restriction Summary**

### **Section H. Miscellaneous**

## SECTION A. Site Inventory List

| Source ID | Source Name                           | Capacity/Throughput | Fuel/Material   |
|-----------|---------------------------------------|---------------------|-----------------|
| 031       | KEELER BOILER 1                       | 17.200 MMBTU/HR     |                 |
|           |                                       | 0.700 Tons/HR       | ANTHRACITE COAL |
| 032       | KEELER BOILER 2                       | 17.200 MMBTU/HR     |                 |
|           |                                       | 0.700 Tons/HR       | ANTHRACITE COAL |
| 033       | CLEAVER BROOKS BOILER (GP1-36-05125A) | 13.750 MCF/HR       | Natural Gas     |
|           |                                       | 104.000 Gal/HR      | #2 Oil          |
| 101       | EMERGENCY GENERATORS                  | 100.000 Gal/HR      | DIESEL FUEL     |
|           |                                       | 1.050 Gal/HR        | Propane         |
| FML01     | NATURAL GAS                           |                     |                 |
| FML02     | ANTHRACITE COAL                       |                     |                 |
| FML03     | PROPANE                               |                     |                 |
| FML101    | DIESEL FUEL                           |                     |                 |
| S01       | COMBINED STACK FOR BOTH BOILERS       |                     |                 |
| S033      | STACK FOR CLEAVER BROOKS BOILER (033) |                     |                 |
| S101      | GENERATOR STACK                       |                     |                 |

### PERMIT MAPS



## SECTION B. General State Only Requirements

### #001 [25 Pa. Code § 121.1]

#### Definitions.

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

### #002 [25 Pa. Code § 127.446]

#### Operating Permit Duration.

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

### #003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)&(c)]

#### Permit Renewal.

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application and an additional annual administrative fee as specified in 25 Pa. Code § 127.703(b) and (c). The fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund" and shall be for the amount specified in the following schedule specified in 25 Pa. Code § 127.703(b) and (c).
  - (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

### #004 [25 Pa. Code § 127.703]

#### Operating Permit Fees under Subchapter I.

- (a) The permittee shall pay fees according to the following schedule specified in 25 Pa. Code § 127.703(b):
  - (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

This fee schedule shall apply to the processing of an application for an operating permit as well as the extension,

## SECTION B. General State Only Requirements

modification, revision, renewal, and re-issuance of each operating permit or part thereof.

(b) The permittee shall pay an annual operating permit administrative fee according to the fee schedule established in 25 Pa. Code § 127.703(c).

(1) Two hundred fifty dollars for applications filed during the 1995-1999 calendar years.

(2) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(3) Three hundred seventy-five dollars for applications filed during the years beginning in 2005.

(c) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund".

### #005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]

#### Transfer of Operating Permits.

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

### #006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]

#### Inspection and Entry.

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

### #007 [25 Pa. Code §§ 127.441 & 127.444]

#### Compliance Requirements.

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes

## SECTION B. General State Only Requirements

a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

### #008 [25 Pa. Code § 127.441]

#### Need to Halt or Reduce Activity Not a Defense.

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

### #009 [25 Pa. Code §§ 127.442(a) & 127.461]

#### Duty to Provide Information.

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

### #010 [25 Pa. Code § 127.461]

#### Revising an Operating Permit for Cause.

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

### #011 [25 Pa. Code §§ 127.450 & 127.462]

#### Operating Permit Modifications

- (a) The permittee is authorized to make administrative amendments, minor operating permit modifications and

## SECTION B. General State Only Requirements

significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall make administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall make minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Permit modifications which do not qualify as minor permit modifications under 25 Pa. Code § 127.541 will be treated as a significant operating permit revision subject to the public notification procedures in §§ 127.424 and 127.425.

### #012 [25 Pa. Code § 127.441]

#### Severability Clause.

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

### #013 [25 Pa. Code § 127.449]

#### De Minimis Emission Increases.

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO<sub>x</sub> from a single source during the term of the permit and 5 tons of NO<sub>x</sub> at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM<sub>10</sub> from a single source during the term of the permit and 3.0 tons of PM<sub>10</sub> at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

## SECTION B. General State Only Requirements

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
  - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
  - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
  - (4) Space heaters which heat by direct heat transfer.
  - (5) Laboratory equipment used exclusively for chemical or physical analysis.
  - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
  - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
  - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

### #014 [25 Pa. Code § 127.3]

#### Operational Flexibility.

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

## SECTION B. General State Only Requirements

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

### #015 [25 Pa. Code § 127.11]

#### Reactivation

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

### #016 [25 Pa. Code § 127.36]

#### Health Risk-based Emission Standards and Operating Practice Requirements.

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

### #017 [25 Pa. Code § 121.9]

#### Circumvention.

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

### #018 [25 Pa. Code §§ 127.402(d) & 127.442]

#### Reporting Requirements.

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager  
PA Department of Environmental Protection  
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

## SECTION B. General State Only Requirements

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

### #019 [25 Pa. Code §§ 127.441(c) & 135.5]

#### Sampling, Testing and Monitoring Procedures.

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

### #020 [25 Pa. Code §§ 127.441(c) and 135.5]

#### Recordkeeping.

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

### #021 [25 Pa. Code § 127.441(a)]

#### Property Rights.

This permit does not convey any property rights of any sort, or any exclusive privileges.

### #022 [25 Pa. Code § 127.447]

#### Alternative Operating Scenarios.

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

## SECTION C. Site Level Requirements

### I. RESTRICTIONS.

#### Emission Restriction(s).

##### # 001 [25 Pa. Code §123.1]

##### **Prohibition of certain fugitive emissions**

The permittee may not allow the emission into the outdoor atmosphere of any fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) Sources and classes of sources other than those identified above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
  - (a) the emissions are of minor significance with respect to causing air pollution;
  - (b) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

##### # 002 [25 Pa. Code §123.2]

##### **Fugitive particulate matter**

The permittee may not allow fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in Section C, Condition # 001, if the emissions are visible at the point the emissions pass outside the permittee's property.

##### # 003 [25 Pa. Code §123.31]

##### **Limitations**

The permittee may not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

##### # 004 [25 Pa. Code §123.41]

##### **Limitations**

The permittee may not allow the emission of visible air contaminants into the outdoor atmosphere in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20 % for a period or periods aggregating more than three minutes in any one hour.
- (2) Equal to or greater than 60 % at any time.

##### # 005 [25 Pa. Code §123.42]

##### **Exceptions**

The emission limitations of Section C, Condition #004 (25 Pa Code section 123.41) shall not apply when:

- (1) The presence of uncombined water is the only reason for failure of the emission to meet the limitation.
- (2) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions;
- (3) The emission results from sources specified in Section C, Condition #001 subsections (1)-(7).

## SECTION C. Site Level Requirements

### # 006 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

In order to maintain the facility's Synthetic Minor status, the permittee shall limit the facility's actual emissions to below the following levels based on any consecutive 12-month period:

- (a) 100 tons per year (TPY) of NO<sub>x</sub>.
- (b) 100 TPY of carbon monoxide (CO).
- (c) 50 TPY of volatile organic compounds (VOC).
- (d) 100 TPY of sulfur oxides (SO<sub>x</sub>) expressed as sulfur dioxide (SO<sub>2</sub>).
- (e) 100 TPY of PM-10 (particulate matter having an effective aerodynamic diameter less than or equal to a nominal 10 micron body)
- (f) 100 TPY of PM-2.5 (particulate matter having an effective aerodynamic diameter less than or equal to a nominal 2.5 micron body)
- (g) 10 TPY of any individual hazardous air pollutant (HAP)
- (h) 25 TPY of aggregate HAPs

Compliance verification requires emissions be calculated for each month and each consecutive 12-month period.

### # 007 [25 Pa. Code §129.14]

#### Open burning operations

(a) The permittee may not allow or conduct open burning of materials in such a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the permittee's property.
- (2) Malodorous air contaminants from the open burning are detectable outside the permittee's property.
- (3) The emissions interfere with the reasonable enjoyment of life and property.
- (4) The emissions cause damage to vegetation or property.
- (5) The emissions are or may be deleterious to human or animal health.

(b) Exceptions. The requirements of subsection (a), above, do not apply where the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(c) This permit does not constitute authorization to burn solid waste pursuant to section 610 (3) of the Solid Waste Management Act (SWMA). 35 PS Section 6018.610 (3) or any other provision of the SWMA.

## II. TESTING REQUIREMENTS.

### # 008 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

The Department reserves the right to require exhaust stack testing of the sources and controls referenced in this permit to measure emissions for purposes including verification of permit condition compliance and estimation of annual air emissions.

## SECTION C. Site Level Requirements

### # 009 [25 Pa. Code §139.1]

#### Sampling facilities.

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such sources. In the request, the Department will set forth the time period in which the facilities shall be provided as well as the specifications for such facilities.

## III. MONITORING REQUIREMENTS.

### # 010 [25 Pa. Code §123.43]

#### Measuring techniques

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and certified, to measure plume opacity with the naked eye, as per EPA Method 9, or with the aid of any devices approved by the Department.

### # 011 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

The permittee shall conduct a monthly inspection during regular business workdays around the plant periphery during the daylight hours when the plant is in production to detect visible emissions, fugitive visible emissions and malodorous air contaminants. Monthly inspections are necessary to determine:

- (a) The presence of visible emissions. Visible emissions may be measured according to the methods specified in Section C, Condition #010. Alternatively, plant personnel who observe such visible emissions shall report each incident to the Department within two (2) hours of the occurrence and arrange for a certified observer to read the visible emissions.
- (b) Presence of visible fugitive emissions beyond the facility property boundaries, as stated in Section C, Condition #002.
- (c) Presence of malodorous air contaminants beyond the facility property boundaries as stated in Section C, Condition #003.

## IV. RECORDKEEPING REQUIREMENTS.

### # 012 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

The permittee shall, monthly, unless another period is specified, record the fuel usage, fuel sulfur content, and quantities of all air contaminants listed in Section C, Condition #006. The fuel usage, sulfur content and list of contaminants shall be broken down on a source by source basis. The permittee shall perform monthly calculations to demonstrate compliance with the 12 consecutive month limitations. Additionally, the permittee shall keep appropriate records of all monitoring and testing requirements, if any. Monitoring requirements shall also be recorded monthly, unless otherwise specified. All records shall be kept for a period of five (5) years and shall be made available to the Department upon request.

### # 013 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

The permittee shall maintain a logbook of inspections as referenced in Section C, Condition #011. The logbook shall include, at minimum, the following information:

- (1) The name of the company representative doing the observation.
- (2) A description of the emissions and/or malodors observed and the actions taken to mitigate them.
- (3) The date and time of the monitoring.
- (4) The wind direction.

These records shall be maintained at the facility for the most recent five (5) year period and be made available to the Department upon request.

## SECTION C. Site Level Requirements

### # 014 [25 Pa. Code §135.5]

#### Recordkeeping

The permittee shall maintain and make available upon request by the Department, records including computerized records that may be necessary to comply with 25 Pa. Code Sections 135.3, and 135.21 (relating to reporting, fuel usage, maintenance of production or pollution control equipment, or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions). If direct recordkeeping is not possible or practical, sufficient records shall be kept to provide the needed information by indirect means.

## V. REPORTING REQUIREMENTS.

### # 015 [25 Pa. Code §127.441]

#### Operating permit terms and conditions.

The permittee shall report malfunctions to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

- (a) Any malfunction which poses an imminent danger to the public health, safety, welfare, and environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two (2) hours after the incident. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.
- (b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirement of subsection (a) above, shall be reported to the Department, in writing, within five (5) days of malfunction discovery.
- (c) Telephone reports can be made to the Lancaster District Office at (717) 299-7601 during normal business hours or to the Department's Emergency Hotline (866) 825-0208 at any time.

### # 016 [25 Pa. Code §135.3]

#### Reporting

An annual report containing monthly records, unless otherwise specified, of fuel usage, fuel sulfur content, material throughputs, operating hours and quantities of all other air contaminants listed in Section C, Condition #006, shall be submitted to the Air Quality District Supervisor. The report for January 1 through December 31 is due no later than March 1 of the following year for each operating year authorized by the permit.

## VI. WORK PRACTICE REQUIREMENTS.

### # 017 [25 Pa. Code §123.1]

#### Prohibition of certain fugitive emissions

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne from any source specified in Section C, Condition #001(1)-(7). These actions shall include, but are not limited to the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water, or suitable chemicals on dirt roads, material stockpiles, and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

### # 018 [25 Pa. Code §127.444]

#### Compliance requirements.

The permittee shall operate and maintain all sources and air cleaning devices identified in this operating permit in accordance with the manufacturer's recommendations/specifications, as well as consistent with good operating practices.

**SECTION C. Site Level Requirements****VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VIII. COMPLIANCE CERTIFICATION.**

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

**IX. COMPLIANCE SCHEDULE.**

No compliance milestones exist.


## SECTION D. Source Level Requirements

Source ID: 031

Source Name: KEELER BOILER 1

Source Capacity/Throughput: 17.200 MMBTU/HR  
0.700 Tons/HR ANTHRACITE COAL

Conditions for this source occur in the following groups: GRP 001  
GRP 002

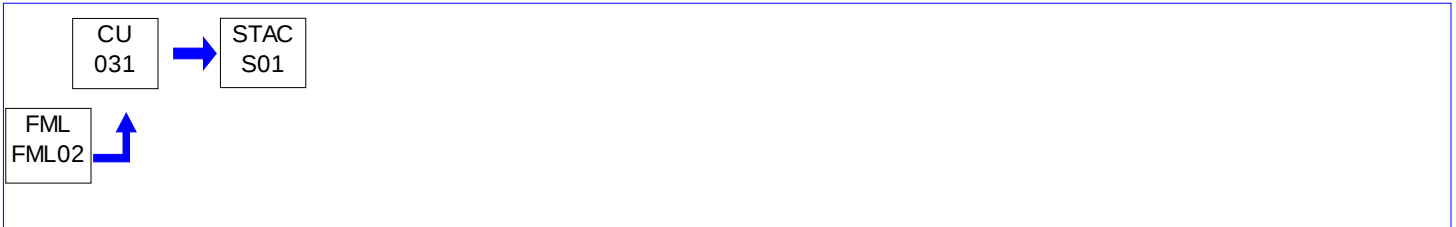

### I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


## SECTION D. Source Level Requirements

Source ID: 032

Source Name: KEELER BOILER 2

Source Capacity/Throughput: 17.200 MMBTU/HR  
0.700 Tons/HR ANTHRACITE COAL

Conditions for this source occur in the following groups: GRP 001  
GRP 002

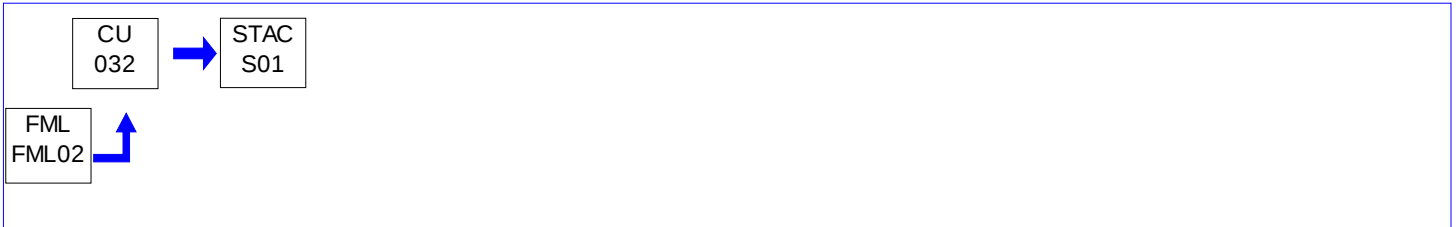

### I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

### VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

## SECTION D. Source Level Requirements

Source ID: 033

Source Name: CLEAVER BROOKS BOILER (GP1-36-05125A)

|                             |                |             |
|-----------------------------|----------------|-------------|
| Source Capacity/Throughput: | 13.750 MCF/HR  | Natural Gas |
|                             | 104.000 Gal/HR | #2 Oil      |

Conditions for this source occur in the following groups: GRP 003



### I. RESTRICTIONS.

#### Emission Restriction(s).

**# 001 [25 Pa. Code §123.11]**

##### Combustion units

No person shall permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the rate of 0.4 pounds per million Btu of heat input.

**# 002 [25 Pa. Code §123.22]**

##### Combustion units

The sulfur content of the No. 2 Fuel Oil in this boiler shall not, at any time, exceed 0.5%, by weight.  
Beginning July 1, 2016, the permittee shall not purchase No. 2 fuel oil with a sulfur content greater than 500 ppm.  
Commercial fuel oil stored in this Commonwealth by the ultimate consumer prior to July 1, 2016, which met the applicable maximum allowable sulfur content for commercial fuel oil through June 30, 2016, at the time it was stored, may be used by the ultimate consumer in this Commonwealth on and after July 1, 2016.  
Beginning July 1, 2016, the Department may temporarily suspend or increase the applicable maximum allowable sulfur content for a commercial fuel oil as set forth in 25 PA Code 123.22.

**# 003 [25 Pa. Code §123.22]**

##### Combustion units

No person shall permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, in excess of the rate of 4 pounds per million Btu of heat input over any one hour period.

**# 004 [25 Pa. Code §127.441]**

##### Operating permit terms and conditions.

[Additional authority for this permit condition is derived from General Plan Approval BAQ-GPA/GP-1]

Source 033 shall be:

- Operated in such a manner as not to cause air pollution.
- Operated and maintained in a manner consistent with good operating and maintenance practices and in accordance with the manufacturer's specifications.
- Fired only on natural gas or No. 2 commercial fuel oil to which there has been no reclaimed or waste oil or other waste materials added.
- Operated with nitrogen oxides (NO<sub>x</sub>) and carbon monoxide (CO) emissions less than or equal to:

**SECTION D. Source Level Requirements**

- i. 30 ppm<sub>dv</sub> NO<sub>x</sub> at 3% O<sub>2</sub> when firing natural gas;
- ii. 90 ppm<sub>dv</sub> NO<sub>x</sub> at 3% O<sub>2</sub> when firing No. 2 fuel oil; and
- iii. 300 ppm<sub>dv</sub> CO at 3% O<sub>2</sub>.

For Source 033, the permittee shall install and maintain the necessary meter(s) to determine and to record the amount of fuel usage.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

**# 005 [25 Pa. Code §127.511]**

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall monitor the sulfur content in the No. 2 commercial fuel oil by either laboratory analysis or fuel suppliers certification for each fuel shipment received.

**IV. RECORDKEEPING REQUIREMENTS.**

**# 006 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The permittee shall maintain permanent records in a manner approved by the Department. The records shall maintain the following information:

- a. Monthly fuel consumption
- b. Type of fuel
- c. Heating value of fuel (BTU/LB)
- d. Sulfur content (% by wt) for each shipment received

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

**# 007 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

Source 033 is not subject to 40 CFR 63, Subpart JJJJJJ since it is classified as a gas-fired boiler. The boiler, however, is subject to NSPS Subpart Dc pursuant to GRP 003 (NSPS Dc).

## SECTION D. Source Level Requirements

Source ID: 101

Source Name: EMERGENCY GENERATORS

Source Capacity/Throughput:

100.000 Gal/HR

DIESEL FUEL

1.050 Gal/HR

Propane



### I. RESTRICTIONS.

#### Emission Restriction(s).

# 001 [25 Pa. Code §123.13]

##### Processes

The permittee may not allow the emission into the outdoor atmosphere of particulate matter from each emergency generator in a manner that the concentration of particulate matter in the effluent gas exceeds 0.02 grains per dry standard cubic foot.

# 002 [25 Pa. Code §123.21]

##### General

The permittee shall not permit the emission into the outdoor atmosphere of sulfur oxides from each emergency generator in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

#### Operation Hours Restriction(s).

# 003 [25 Pa. Code §127.441]

##### Operating permit terms and conditions.

(a) Emergency generators may be operated for the purpose of maintenance checks and readiness testing. Maintenance checks and readiness testing of each generator is limited to 100 hours per each 12-month consecutive period. There is no time limit on the use of emergency generators in emergency situations.

(b) Any operation of emergency generators other than emergency operation, and maintenance and testing is prohibited.

### II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### IV. RECORDKEEPING REQUIREMENTS.

# 004 [25 Pa. Code §127.441]

##### Operating permit terms and conditions.

(a) The permittee shall maintain records that document the operation of each emergency generator at the facility. At a minimum, these records shall include the following information:

**SECTION D. Source Level Requirements**

- (1) The date and time of operation for each generator.
  - (2) For each operational occurrence, the permittee shall record the reason for operating each generator, e.g., maintenance checks and readiness testing, emergency situation, etc., and the duration of operation, in hours.
  - (3) The nature of the emergency situation, if applicable.
  - (4) The number of hours of operation of each generator during each calendar month and each consecutive 12-month period.
- (b) These records shall be kept on site for the most recent 5-year period and made available to the Department upon request.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

## SECTION E. Source Group Restrictions.

Group Name: GRP 001

Group Description: Boilers

Sources included in this group

| ID  | Name            |
|-----|-----------------|
| 031 | KEELER BOILER 1 |
| 032 | KEELER BOILER 2 |

### I. RESTRICTIONS.

#### Emission Restriction(s).

# 001 [25 Pa. Code §123.11]

##### Combustion units

The permittee shall not allow the emission into the outdoor atmosphere of Particulate Matter(PM) from any combustion unit in Group G01 in excess of 0.4 pound per million Btu's of heat input.

# 002 [25 Pa. Code §123.22]

##### Combustion units

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from any combustion unit in Group G01 in excess of the rate of 4 pounds per million Btu's of heat input over any 1-hour period.

#### Fuel Restriction(s).

# 003 [25 Pa. Code §127.441]

##### Operating permit terms and conditions.

The combustion units in Group G01 shall only operate on anthracite coal.

# 004 [25 Pa. Code §127.441]

##### Operating permit terms and conditions.

The permittee shall not combust Anthracite coal with a sulfur content in excess of 1.00% by weight. Compliance with this limit may be demonstrated based on a certification from the coal supplier for each shipment of coal. The permittee shall keep coal certification records on site for the most recent 5 year period and made available to the Department upon request.

### II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

### VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: GRP 002

Group Description: 40 CFR 63 Subpart JJJJJ Limited-Use Boilers

**Sources included in this group**

| ID  | Name            |
|-----|-----------------|
| 031 | KEELER BOILER 1 |
| 032 | KEELER BOILER 2 |

**I. RESTRICTIONS.****Throughput Restriction(s).****# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Anthracite coal usage in each boiler shall not exceed 10% of the maximum annual rated heat input capacity in any calendar year. Based on each boiler's heat input rating of 17.2 million Btu per hour, each boiler shall comply by one of the following methods:

- (a) Limiting the heat input to less than 15,067 million Btu per year, based on a calendar year; OR
- (b) Combusting no more than 598 tons of coal per year, based on a calendar year.

NOTE: This condition was requested by the permittee for the boilers to meet the definition of limited-use boilers defined under 40 CFR 63.11237.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]****SUBPART JJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

§ 63.11193 Am I subject to this subpart?

You are subject to this subpart if you own or operate an industrial, commercial, or institutional boiler as defined in § 63.11237 that is located at, or is part of, an area source of hazardous air pollutants (HAP), as defined in § 63.2, except as

## SECTION E. Source Group Restrictions.

specified in § 63.11195.

§ 63.11194 What is the affected source of this subpart?

(a) This subpart applies to each new, reconstructed, or existing affected source as defined in paragraphs (a)(1) and (2) of this section.

(1) The affected source of this subpart is the collection of all existing industrial, commercial, and institutional boilers within a subcategory, as listed in § 63.11200 and defined in § 63.11237, located at an area source.

(2) The affected source of this subpart is each new or reconstructed industrial, commercial, or institutional boiler within a subcategory, as listed in § 63.11200 and as defined in § 63.11237, located at an area source.

(b) An affected source is an existing source if you commenced construction or reconstruction of the affected source on or before June 4, 2010.

(c) – (d) [NA – UNIT(S) ARE EXISTING]

(e) [NA – UNIT(S) ARE COAL-FIRED]

(f) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or part 71 as a result of this subpart. You may, however, be required to obtain a title V permit due to another reason or reasons. See 40 CFR 70.3(a) and (b) or 71.3(a) and (b). Notwithstanding the exemption from title V permitting for area sources under this subpart, you must continue to comply with the provisions of this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

§ 63.11195 Are any boilers not subject to this subpart?

The types of boilers listed in paragraphs (a) through (k) of this section are not subject to this subpart and to any requirements in this subpart.

(a) [NA – NO UNITS PART OF SOURCES SUBJECT TO OTHER PART 63 SUBPART]

(b) [NA – NO CAA SECTION 129 UNITS]

(c) [NA – UNITS DO NOT BURN HAZARDOUS WASTE].

(d) [NA – UNITS ARE NOT R&D]

(e) [NA – UNITS ARE NOT DEFINED AS GAS-FIRED]

(f) [NA – UNITS NOT DEFINED AS HOT WATER HEATERS]

(g) [NA – UNITS NOT USED AS CONTROL DEVICES]

(h) [NA – UNITS DO NOT QUALIFY AS TEMPORARY UNITS]

(i) [NA – UNITS ARE NOT DEFINED AS RESIDENTIAL]

(j) [NA – UNITS ARE NOT DEFINED AS ELECTRIC]

(k) [NA – UNITS ARE NOT EGUs]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11196 What are my compliance dates?

## SECTION E. Source Group Restrictions.

(a) If you own or operate an existing affected boiler, you must achieve compliance with the applicable provisions in this subpart as specified in paragraphs (a)(1) through (3) of this section.

(1) If the existing affected boiler is subject to a work practice or management practice standard of a tune-up, you must achieve compliance with the work practice or management practice standard no later than March 21, 2014.

(2) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(3) [NA – ENERGY ASSESSMENT NOT REQUIRED]

(b) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(c) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(d) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Emission Limits, Work Practice Standards, Emission Reduction Measures, and Management Practices

§ 63.11200 What are the subcategories of boilers?

The subcategories of boilers, as defined in § 63.11237 are:

(a) Coal.

(b) [NA – UNIT(S) ARE COAL-FIRED]

(c) [NA – UNIT(S) ARE COAL-FIRED]

(d) [NA – UNIT(S) NOT DEFINED AS SEASONAL]

(e) [NA – UNIT(S) ARE COAL-FIRED]

(f) [NA – NO O<sub>2</sub> TRIM SYSTEM]

(g) Limited-use boilers.

[78 FR 7506, Feb. 1, 2013]

§ 63.11201 What standards must I meet?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must comply with each work practice standard, emission reduction measure, and management practice specified in Table 2 to this subpart that applies to your boiler. An energy assessment completed on or after January 1, 2008 that meets or is amended to meet the energy assessment requirements in Table 2 to this subpart satisfies the energy assessment requirement. A facility that operates under an energy management program established through energy management systems compatible with ISO 50001, that includes the affected units, also satisfies the energy assessment requirement.

TABLE 2 REQUIREMENTS:

As stated in § 63.11201, you must comply with the following applicable work practice standards, emission reduction measures, and management practices:

10. If your boiler is in this subcategory: Existing limited-use boilers, you must meet the following: Conduct an initial tune-up

**SECTION E. Source Group Restrictions.**

as specified in § 63.11214, and conduct a tune-up of the boiler every 5 years as specified in § 63.11223.

**END OF TABLE 2 REQUIREMENTS**

(c) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(d) These standards apply at all times the affected boiler is operating, except during periods of startup and shutdown as defined in § 63.11237, during which time you must comply only with Table 2 to this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

**General Compliance Requirements**

§ 63.11205 What are my general requirements for complying with this subpart?

(a) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

**Initial Compliance Requirements**

§ 63.11210 What are my initial compliance requirements and by what date must I conduct them?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) For existing affected boilers that have applicable work practice standards, management practices, or emission reduction measures, you must demonstrate initial compliance no later than the compliance date that is specified in § 63.11196 and according to the applicable provisions in § 63.7(a)(2), except as provided in paragraph (j) of this section.

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(e) –(g) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(h) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

(i) For affected boilers that switch fuels or make a physical change to the boiler that results in the applicability of a different subcategory within subpart JJJJJJ or the boiler becoming subject to subpart JJJJJJ, you must demonstrate compliance within 180 days of the effective date of the fuel switch or the physical change. Notification of such changes must be submitted according to § 63.11225(g).

(j) [NA – FACILITY IS MINOR FOR HAP]

(k) [NA – UNITS HAVE OPERATED SINCE 6J EFFECTIVE DATE]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7507, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

## SECTION E. Source Group Restrictions.

§ 63.11211 How do I demonstrate initial compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11212 What stack tests and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11213 What fuel analyses and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11214 How do I demonstrate initial compliance with the work practice standard, emission reduction measures, and management practice?

(a) [NA – UNIT(S) > 10 MMBTU]

(b) [NA – UNITS ARE COAL-FIRED]

(c) [NA – ENERGY ASSESSMENT NOT REQUIRED]

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7508, Feb. 1, 2013; 81 FR 63126, Sept. 14, 2016]

### Continuous Compliance Requirements

§ 63.11220 When must I conduct subsequent performance tests or fuel analyses?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING OR FUEL ANALYSES]

§ 63.11221 Is there a minimum amount of monitoring data I must obtain?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11222 How do I demonstrate continuous compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 81 FR 63127, Sept. 14, 2016]

§ 63.11223 How do I demonstrate continuous compliance with the work practice and management practice standards?

(a) For affected sources subject to the work practice standard or the management practices of a tune-up, you must conduct a performance tune-up according to paragraph (b) of this section and keep records as required in § 63.11225(c) to demonstrate continuous compliance. You must conduct the tune-up while burning the type of fuel (or fuels in the case of boilers that routinely burn two types of fuels at the same time) that provided the majority of the heat input to the boiler over the 12 months prior to the tune-up.

(b) Except as specified in paragraphs (c) through (f) of this section, you must conduct a tune-up of the boiler biennially to demonstrate continuous compliance as specified in paragraphs (b)(1) through (7) of this section. Each biennial tune-up must be conducted no more than 25 months after the previous tune-up. For a new or reconstructed boiler, the first biennial tune-up must be no later than 25 months after the initial startup of the new or reconstructed boiler.

(1) As applicable, inspect the burner, and clean or replace any components of the burner as necessary (you may delay the burner inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the burner inspection until the first outage, not to exceed 36 months from the previous

## SECTION E. Source Group Restrictions.

inspection.

(2) Inspect the flame pattern, as applicable, and adjust the burner as necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available.

(3) Inspect the system controlling the air-to-fuel ratio, as applicable, and ensure that it is correctly calibrated and functioning properly (you may delay the inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the inspection until the first outage, not to exceed 36 months from the previous inspection.

(4) Optimize total emissions of CO. This optimization should be consistent with the manufacturer's specifications, if available, and with any nitrogen oxide requirement to which the unit is subject.

(5) Measure the concentrations in the effluent stream of CO in parts per million, by volume, and oxygen in volume percent, before and after the adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). Measurements may be taken using a portable CO analyzer.

(6) Maintain on-site and submit, if requested by the Administrator, a report containing the information in paragraphs (b)(6)(i) through (iii) of this section.

(i) The concentrations of CO in the effluent stream in parts per million, by volume, and oxygen in volume percent, measured at high fire or typical operating load, before and after the tune-up of the boiler.

(ii) A description of any corrective actions taken as a part of the tune-up of the boiler.

(iii) The type and amount of fuel used over the 12 months prior to the tune-up of the boiler, but only if the unit was physically and legally capable of using more than one type of fuel during that period. Units sharing a fuel meter may estimate the fuel use by each unit.

(7) If the unit is not operating on the required date for a tune-up, the tune-up must be conducted within 30 days of startup.

(c) [NA – SOURCES IN THIS GROUP DO NOT HAVE OXYGEN TRIM SYSTEM]

(d) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(e) [NA – UNIT(S) ARE COAL-FIRED]

(f) Limited-use boilers must conduct a tune-up every 5 years as specified in paragraphs (b)(1) through (7) of this section. Each 5-year tune-up must be conducted no more than 61 months after the previous tune-up. For a new or reconstructed limited-use boiler, the first 5-year tune-up must be no later than 61 months after the initial startup. You may delay the burner inspection specified in paragraph (b)(1) of this section and inspection of the system controlling the air-to-fuel ratio specified in paragraph (b)(3) of this section until the next scheduled unit shutdown, but you must inspect each burner and system controlling the air-to-fuel ratio at least once every 72 months. Limited-use boilers are not subject to the emission limits in Table 1 to this subpart, the energy assessment requirements in Table 2 to this subpart, or the operating limits in Table 3 to this subpart.

(g) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7509, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§ 63.11224 What are my monitoring, installation, operation, and maintenance requirements?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

## SECTION E. Source Group Restrictions.

(d) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(f) [NA – BLDS NOT USED OR REQUIRED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7510, Feb. 1, 2013]

§ 63.11225 What are my notification, reporting, and recordkeeping requirements?

(a) You must submit the notifications specified in paragraphs (a)(1) through (5) of this section to the administrator.

(1) You must submit all of the notifications in §§ 63.7(b); 63.8(e) and (f); and 63.9(b) through (e), (g), and (h) that apply to you by the dates specified in those sections except as specified in paragraphs (a)(2) and (4) of this section.

(2) [REQUIREMENT IS IN THE PAST]

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(4) [REQUIREMENT IS IN THE PAST]

(5) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must prepare, by March 1 of each year, and submit to the delegated authority upon request, an annual compliance certification report for the previous calendar year containing the information specified in paragraphs (b)(1) through (4) of this section. You must submit the report by March 15 if you had any instance described by paragraph (b)(3) of this section. For boilers that are subject only to the energy assessment requirement and/or a requirement to conduct a biennial or 5-year tune-up according to §63.11223(a) and not subject to emission limits or operating limits, you may prepare only a biennial or 5-year compliance report as specified in paragraphs (b)(1) and (2) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with the official's name, title, phone number, email address, and signature, certifying the truth, accuracy and completeness of the notification and a statement of whether the source has complied with all the relevant standards and other requirements of this subpart. Your notification must include the following certification(s) of compliance, as applicable, and signed by a responsible official:

(i) "This facility complies with the requirements in § 63.11223 to conduct a biennial or 5-year tune-up, as applicable, of each boiler."

(ii) [NA – UNIT(S) DO NOT FIRE SOLID WASTE]

(iii) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(3) If the source experiences any deviations from the applicable requirements during the reporting period, include a description of deviations, the time periods during which the deviations occurred, and the corrective actions taken.

(4) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) You must maintain the records specified in paragraphs (c)(1) through (7) of this section.

(1) As required in § 63.10(b)(2)(xiv), you must keep a copy of each notification and report that you submitted to comply with this subpart and all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted.

(2) You must keep records to document conformance with the work practices, emission reduction measures, and management practices required by § 63.11214 and § 63.11223 as specified in paragraphs (c)(2)(i) through (vi) of this

## SECTION E. Source Group Restrictions.

section.

(i) Records must identify each boiler, the date of tune-up, the procedures followed for tune-up, and the manufacturer's specifications to which the boiler was tuned.

(ii) [NA – UNIT(S) DO NOT BURN SOLID WASTE]

(iii) [NA – ENERGY ASSESSMENT NOT REQUIRED]

(iv) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(v) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(vi) For each boiler that meets the definition of limited-use boiler, you must keep a copy of the federally enforceable permit that limits the annual capacity factor to less than or equal to 10 percent and records of fuel use for the days the boiler is operating.

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO FUEL ANALYSES]

(4) Records of the occurrence and duration of each malfunction of the boiler, or of the associated air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with the general duty to minimize emissions in § 63.11205(a), including corrective actions to restore the malfunctioning boiler, air pollution control, or monitoring equipment to its normal or usual manner of operation.

(6) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(7) [NA – BLDS NOT USED OR REQUIRED]

(d) Your records must be in a form suitable and readily available for expeditious review. You must keep each record for 5 years following the date of each recorded action. You must keep each record on-site or be accessible from a central location by computer or other means that instantly provide access at the site for at least 2 years after the date of each recorded action. You may keep the records off site for the remaining 3 years.

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(f) [NA – UNIT(S) DO NOT BURN SOLID WASTE]

(g) If you have switched fuels or made a physical change to the boiler and the fuel switch or change resulted in the applicability of a different subcategory within this subpart, in the boiler becoming subject to this subpart, or in the boiler switching out of this subpart due to a fuel change that results in the boiler meeting the definition of gas-fired boiler, as defined in §63.11237, or you have taken a permit limit that resulted in you becoming subject to this subpart or no longer being subject to this subpart, you must provide notice of the date upon which you switched fuels, made the physical change, or took a permit limit within 30 days of the change. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that have switched fuels, were physically changed, or took a permit limit, and the date of the notice.

(2) The date upon which the fuel switch, physical change, or permit limit occurred.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7511, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§63.11226 [Reserved]

Other Requirements and Information

**SECTION E. Source Group Restrictions.**

§ 63.11236 Who implements and enforces this subpart? [INCORPORATED BY REFERENCE]

§ 63.11237 What definitions apply to this subpart? [INCORPORATED BY REFERENCE]

**Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 63 Subpart JJJJJJ shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: GRP 003

Group Description: NSPS Dc

Sources included in this group

| ID  | Name                                  |
|-----|---------------------------------------|
| 033 | CLEAVER BROOKS BOILER (GP1-36-05125A) |

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]**  
**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units**  
**Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]

## SECTION E. Source Group Restrictions.

(g) [NA – NOT SUBJECT TO NSPS BBBBB]

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO<sub>2</sub>).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) Other fuels-fired affected facilities with heat input capacities between 2.9 and 8.7 MW (10 and 30 MMBtu/h).

(i) The SO<sub>2</sub> emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) [NA – UNIT(S) < 30 MMBTU]

(d) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

**SECTION E. Source Group Restrictions.**

(e)(1) [NA – UNIT(S) < 30 MMBTU]

(2) [NA – UNIT(S) < 30 MMBTU]

(3) [NA – UNIT(S) < 30 MMBTU]

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO<sub>2</sub> emissions is not subject to the PM limit in this section.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(b) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(c) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

(a) - (f) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16,

**SECTION E. Source Group Restrictions.**

2012]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

(d) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

(1) Calendar dates covered in the reporting period.

(2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) For other fuels:

(i) The name of the supplier of the fuel;

(ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and

(iii) The method used to determine the potential sulfur emissions rate of the fuel.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the

**SECTION E. Source Group Restrictions.**

SO<sub>2</sub> standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO<sub>2</sub> standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

**Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. Copies of all requests, reports and other communications shall be forwarded to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**# 002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]****Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units  
Applicability and delegation of authority.**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. Copies of all requests, reports and other communications shall be forwarded to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

**SECTION E. Source Group Restrictions.**

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



## **SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this State Only facility.



## SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

#001

Information has been gathered from Operating Permit No. 36-05125 which was issued on December 31, 2012 and modified March 19, 2015. This permit renewal supersedes that permit.

#002

This permit also supersedes GP1-36-05125A for DEP Source ID No. 033 (Cleaver Brooks Boiler)

#003

Source ID 101, Emergency Generators consists of the following sources:

- One (1) Caterpillar-600hp-Diesel-CI-Manuf. 2006-Main-Approx. run time-30hrs/yr
- One (1) Kohler 1-200hp-Diesel-CI-Manuf. 1975-Elder- Approx. run time-15hrs/yr
- One (1) Kohler 2-200hp-Diesel-CI-Manuf. 1975-Elder- Approx. run time-15hrs/yr


#004

The NAIC code 922140 for Correctional Facilities exempts the generators (listed in #003 above) from MACT 4Z. Also, all of the generators (listed in #003 above) were built prior to 4/1/06 and hence, the generators are also exempt from NSPS 4I and 4J.

#005

The following operations are not subject to any specific work practice standards, testing, monitoring, record keeping or reporting requirements.

- Diesel fuel storage tanks
- Pump house electric heaters
- Kitchen and Culinary propane fired ovens



\*\*\*\*\* End of Report \*\*\*\*\*