

Issue Date:

May 9, 2024

November 1, 2024



COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF ENVIRONMENTAL PROTECTION AIR QUALITY PROGRAM

STATE ONLY NATURAL MINOR OPERATING PERMIT

Effective Date:

amended, and 25 Pa. Code Chapter 127, the permittee) identified below is authorized by the operate the air emission source(s) more fully d conditions specified in this permit. Nothing in the with all applicable Federal, State and Local laws	rmit condition is set forth in brackets. All terms and conditions			
	y Permit No: 21-03128			
Natural Minor				
Federal Tax Id - Plant Code: 23-1512747-1				
C	Owner Information			
Name: PSH HOLY SPIRIT MED CTR				
Mailing Address: 503 N 21ST ST				
CAMP HILL, PA 17011-2288				
F	Plant Information			
Plant: HOLY SPIRIT HOSP/HARRISBURG				
Location: 21 Cumberland County	21909 East Pennsboro Township			
SIC Code: 8062 Services - General Medical And Surgio	cal Hospitals			
Re	esponsible Official			
Name: DAVID J BARTO				
Title: VICE PRESIDENT FACILITIES				
Phone: (717) 531 - 4525	Email: dbarto@pennstatehealth.psu.edu			
Per	rmit Contact Person			
Name: JAMES TESCHE				
Title: FACILITIES ENGR MANAGER				
Phone: (717) 972 - 7302	Email: jteche1@pennstatehealth.psu.edu			
[Signature] WILLIAM R. WEAVER, SOUTHCENTRAL REGION AIR				
WILLIAWK. WEAVER, SOUTHCENTRAL REGION AIR	(PRUGRAMINANAGER			





SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

E-I: Restrictions

21-03128



- **SECTION A. Table of Contents**
 - E-II: Testing Requirements
 - E-III: Monitoring Requirements
 - E-IV: Recordkeeping Requirements
 - E-V: Reporting Requirements
 - E-VI: Work Practice Standards
 - E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary


Section H. Miscellaneous






SECTION A. Site Inventory List

D Source Name	Capacity/	Throughput	Fuel/Material
1489 HP EMERGENCY GENERATOR	10.070	MMBTU/HR	
	73.500	Gal/HR	#2 Oil
1502 HP EMERGENCY GENERATOR	10.138	MMBTU/HR	
	74.000	Gal/HR	#2 Oil
2206 HP EMERGENCY ENGINE (BOILER ROOM)	14.385	MMBTU/HR	
	105.000	Gal/HR	#2 Oil
1474 HP EMERGENCY ENGINE (DATA CENTER #1)	9.864	MMBTU/HR	
	72.000	Gal/HR	#2 Oil
1474 HP EMERGENCY ENGINE (DATA CENTER #2)	9.864	MMBTU/HR	
	72.000	Gal/HR	#2 Oil
2206 HP EMERGENCY ENGINE (#5)	14.385	MMBTU/HR	
	105.000	Gal/HR	#2 Oil
60 HP EMERGENCY FIRE PUMP ENGINE	0.548	MMBTU/HR	
	4.000	Gal/HR	#2 Oil
NO. 2 FUEL OIL			
EMER GEN 2 STACK			
EMER GEN 3 STACK			
SOURCE 106 STACK			
SOURCE 107 STACK			
SOURCE 108 STACK			
SOURCE 109 STACK			
SOURCE 110 STACK			
	 1489 HP EMERGENCY GENERATOR 1502 HP EMERGENCY GENERATOR 2206 HP EMERGENCY ENGINE (BOILER ROOM) 1474 HP EMERGENCY ENGINE (DATA CENTER #1) 1474 HP EMERGENCY ENGINE (DATA CENTER #2) 2206 HP EMERGENCY ENGINE (DATA CENTER #2) 2206 HP EMERGENCY FIRE PUMP ENGINE (#5) 60 HP EMERGENCY FIRE PUMP ENGINE NO. 2 FUEL OIL EMER GEN 2 STACK SOURCE 106 STACK SOURCE 107 STACK SOURCE 109 STACK 	1489 HP EMERGENCY GENERATOR 10.070 1489 HP EMERGENCY GENERATOR 10.138 1502 HP EMERGENCY GENERATOR 10.138 2206 HP EMERGENCY ENGINE (BOILER ROOM) 14.385 105.000 105.000 1474 HP EMERGENCY ENGINE (DATA CENTER #1) 9.864 72.000 1474 HP EMERGENCY ENGINE (DATA CENTER #2) 9.864 72.000 2206 HP EMERGENCY ENGINE (#5) 14.385 105.000 105.000 105.000 2206 HP EMERGENCY ENGINE (#5) 14.385 105.000 206 HP EMERGENCY ENGINE (#5) 14.385 105.000 60 HP EMERGENCY FIRE PUMP ENGINE 0.548 4.000 NO. 2 FUEL OIL 4.000 4.000 NO. 2 FUEL OIL 4.000 105.000 SOURCE 106 STACK 50000 105.000 SOURCE 107 STACK 500000 105.000 SOURCE 109 STACK 500000 100000	1489 HP EMERGENCY GENERATOR 10.070 MMBTU/HR 1502 HP EMERGENCY GENERATOR 10.138 MMBTU/HR 1502 HP EMERGENCY ENGINE (BOILER ROOM) 14.385 MMBTU/HR 2206 HP EMERGENCY ENGINE (BOILER ROOM) 14.385 MMBTU/HR 1474 HP EMERGENCY ENGINE (DATA CENTER #1) 9.864 MMBTU/HR 1474 HP EMERGENCY ENGINE (DATA CENTER #2) 9.864 MMBTU/HR 1474 HP EMERGENCY ENGINE (DATA CENTER #2) 9.864 MMBTU/HR 1474 HP EMERGENCY ENGINE (BATA CENTER #2) 9.864 MMBTU/HR 2206 HP EMERGENCY ENGINE (#5) 14.385 MMBTU/HR 1474 HP EMERGENCY ENGINE (#5) 14.385 MMBTU/HR 2206 HP EMERGENCY ENGINE (#5) 14.385 MMBTU/HR 60 HP EMERGENCY FIRE PUMP ENGINE 0.548 MMBTU/HR 60 HP EMERGENCY FIRE PUMP ENGINE 0.548 MMBTU/HR NO. 2 FUEL OIL E E E EMER GEN 3 STACK E I I SOURCE 106 STACK I I I SOURCE 108 STACK I I I

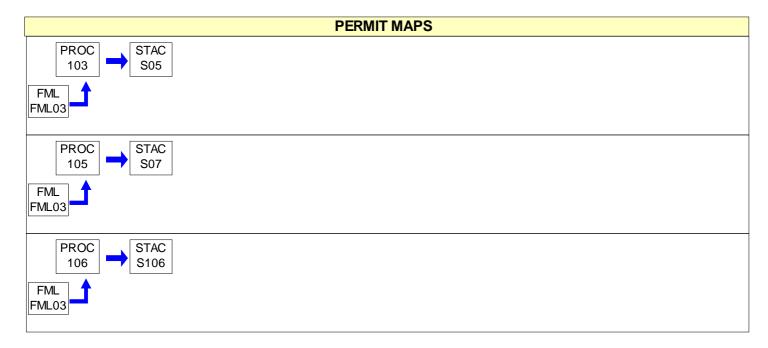





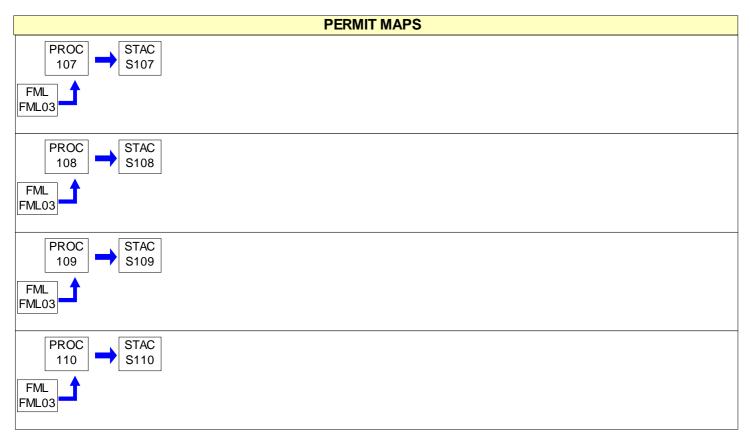





#001 [25 Pa. Code § 121.1] Definitions. Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1. #002 [25 Pa. Code § 127.446] **Operating Permit Duration.** (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit. (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit. #003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)] Permit Renewal. (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit. (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official. (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office. (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413. (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j). (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application. #004 [25 Pa. Code § 127.703] **Operating Permit Fees under Subchapter I.** (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year. (1) For a synthetic minor facility, a fee equal to: (i) Four thousand dollars (\$4,000) for calendar years 2021-2025. (ii) Five thousand dollars (\$5,000) for calendar years 2026-2030. (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.



(2) For a facility that is not a synthetic minor, a fee equal to:

(i) Two thousand dollars (\$2,000) for calendar years 2021-2025.

(ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026-2030.

(iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]

Transfer of Operating Permits.

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]

Inspection and Entry.

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]

Compliance Requirements.

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:





- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]

Need to Halt or Reduce Activity Not a Defense.

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]

Duty to Provide Information.

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]

Revising an Operating Permit for Cause.

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

(1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.

(2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.

(3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.

(4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]

Operating Permit Modifications

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:





(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]

Severability Clause.

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]

De Minimis Emission Increases.

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NOx from a single source during the term of the permit and 5 tons of NOx at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM10 from a single source during the term of the permit and 3.0 tons of PM10 at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:



(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]

Operational Flexibility.

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)





	(6) Section 127.462 (relating to minor operating permit modifications)
	(7) Subchapter H (relating to general plan approvals and general operating permits)
#015	[25 Pa. Code § 127.11]
Reactiva	ation
	(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).
	(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).
#016	[25 Pa. Code § 127.36]
Health F	Risk-based Emission Standards and Operating Practice Requirements.
	(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].
	(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.
#017	[25 Pa. Code § 121.9]
Circum	<i>r</i> ention.
	No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.
#018	[25 Pa. Code §§ 127.402(d) & 127.442]
Reporti	ng Requirements.
	(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.
	thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.
	thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139. (b) The permittee shall submit reports to the Department containing information the Department may prescribe relative
	thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139. (b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.
	 thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139. (b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source. (c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the: Regional Air Program Manager PA Department of Environmental Protection (At the address given in the permit transmittal letter, or otherwise





	records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act
	and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any
	emissions data generated for the facility.
¢019	[25 Pa. Code §§ 127.441(c) & 135.5]
amplin	g, Testing and Monitoring Procedures.
	(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.
	(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.
#020	[25 Pa. Code §§ 127.441(c) and 135.5]
Recordk	eeping.
	(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:
	(1) The date, place (as defined in the permit) and time of sampling or measurements.
	(2) The dates the analyses were performed.
	(3) The company or entity that performed the analyses.
	(4) The analytical techniques or methods used.
	(5) The results of the analyses.
	(6) The operating conditions as existing at the time of sampling or measurement.
	(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.
	(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.
#021	[25 Pa. Code § 127.441(a)]
Property	Rights.
	This permit does not convey any property rights of any sort, or any exclusive privileges.
#022	[25 Pa. Code § 127.447]
Alternati	ve Operating Scenarios.
	The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.





#023 [25 Pa. Code §135.3]

Reporting

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]

Report Format

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.





I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.1] Prohibition of certain fugitive emissions

The permittee shall not allow the emission into the outdoor atmosphere of a fugitive air contaminant from a source other than the following:

(a) Construction or demolition of buildings or structures.

(b) Grading, paving, and maintenance of roads and streets.

(c) Use of roads and streets. Emissions from material in or on trucks, railroad cars, and other vehicular equipment are not considered as emissions from use of roads and streets.

(d) Clearing of land.

(e) Stockpiling of materials.

(f) Sources and classes of sources other than those identified in (a)-(e), above, for which the permittee has obtained a determination from the Department, in accordance with 25 Pa. Code §123.1(b), that fugitive emissions from the source, after appropriate control, meet the following requirements:

(1) The emissions are of minor significance with respect to causing air pollution; and

(2) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

002 [25 Pa. Code §123.2]

Fugitive particulate matter

The permittee shall not allow the emission of fugitive particulate matter into the outdoor atmosphere from a source specified in Section C, Condition #001(a)-(f), if the emissions are visible at the point the emissions pass outside the permittee's property.

003 [25 Pa. Code §123.31]

Limitations

The permittee shall not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

004 [25 Pa. Code §123.41]

Limitations

The permittee shall not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

(a) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any one hour.

(b) Equal to or greater than 60% at any time.

005 [25 Pa. Code §123.42]

Exceptions

The emission limitations of Section C, Condition #004, shall not apply when:

(a) The presence of uncombined water is the only reason for failure of the emission to meet the limitations.

(b) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.

(c) The emission results from sources specified in Section C, Condition #001(a)-(f).





006 [25 Pa. Code §129.14]

Open burning operations

The permittee shall not allow the open burning of material on the permittee's property except when the open burning operations result from:

(a) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.

(b) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.

(c) A fire set for the prevention and control of disease or pests, when approved by the Department.

(d) A fire set solely for recreational or ceremonial purposes.

(e) A fire set solely for cooking food.

II. TESTING REQUIREMENTS.

007 [25 Pa. Code §127.444]

Compliance requirements.

The Department reserves the right to require exhaust stack testing of the sources referenced in this operating permit to measure emissions for purposes including verification of operating permit condition compliance and estimation of annual air emissions.

008 [25 Pa. Code §139.1]

Sampling facilities.

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on any source. In the request, the Department will set forth the time period in which the facilities shall be provided as well as the specifications for such facilities.

009 [25 Pa. Code §139.11]

General requirements.

(a) As specified in 25 Pa. Code Section 139.11(1), performance tests shall be conducted while the source is operating at maximum routine operating conditions or under such other conditions, within the capacity of the equipment, as may be requested by the Department.

(b) As specified in 25 Pa. Code Section 139.11(2), the Department will consider test results for approval where sufficient information is provided to verify the source conditions existing at the time of the test and where adequate data is available to show the manner in which the test was conducted. Information submitted to the Department shall include, at a minimum, all of the following:

(1) A thorough source description, including a description of any air cleaning devices and the flue.

(2) Process conditions, for example, the fuel firing rate, stack temperature, and other conditions which may affect emissions from the process.

(3) The location of the sampling ports.

(4) Effluent characteristics, including velocity, temperature, moisture content, gas density (percentage CO, CO2, O2, and N2), static and barometric pressures.

(5) Sample collection techniques employed, including procedures used, equipment descriptions, and data to verify that isokinetic sampling for particulate matter collection occurred and that acceptable test conditions were met.

(6) Laboratory procedures and results.

(7) Calculated results.





III. MONITORING REQUIREMENTS.

010 [25 Pa. Code §123.43]

Measuring techniques

The permittee shall measure visible emissions (referenced in Section C, Conditions #004, #005, and #011) using either of the following:

(a) A device approved by the Department and maintained to provide accurate opacity measurements (e.g., Continuous Opacity Monitor).

(b) Observers trained and certified in EPA Reference Method 9 to measure plume opacity with the naked eye; or with the aid of any device(s) approved by the Department.

011 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall conduct a monthly inspection around the plant periphery during daylight hours when the plant is in production to detect visible emissions, fugitive particulate matter emissions, and malodorous air contaminants. Monthly inspections are necessary to determine:

(a) The presence of visible emissions as stated in Section C, Condition #004. Visible emissions may be measured according to the methods specified in Section C, Condition #010. Alternately, plant personnel who observe visible emissions may report the incidence of visible emissions to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions unless otherwise approved in writing by DEP.

(b) The presence of fugitive particulate matter emissions beyond the plant property boundaries, as stated in Section C, Condition #002.

(c) The presence of malodorous air contaminants beyond the plant property boundaries, as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.

012 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall maintain records of the monthly inspections referenced in Section C, Condition #011. The records shall include, at a minimum, the following information:

- (1) The name of the company representative monitoring each inspection.
- (2) The date and time of each inspection.
- (3) The wind direction during each inspection.

(4) A description of the visible emissions, fugitive particulate matter emissions (beyond the plant property boundaries), and malodorous air contaminants (beyond the plant property boundaries) observed, if any, and actions taken to mitigate them. If no visible emissions or fugitive particulate matter emissions or malodors are observed, then document that none were observed.

(b) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

V. REPORTING REQUIREMENTS.

013 [25 Pa. Code §127.442] Reporting requirements.

The permittee shall report malfunctions which occur at the facility to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner that may result in an increase in air emissions above minor significance. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as



follows:

(a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Air Quality Program at (717) 705-4702 during normal business hours, or to the Department's Emergency Hotline 866-825-0208 at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx.

(1) The notice shall describe the:

- (i) name and location of the facility;
- (ii) nature and cause of the malfunction or breakdown;
- (iii) time when the malfunction or breakdown was first observed;
- (iv) expected duration of excess emissions; and
- (v) estimated rate of emissions.

(2) The owner or operator shall notify the Department immediately when corrective measures have been accomplished.

(3) The permittee shall submit a written report of instances of such malfunctions to the department, in writing, within three (3) days of the of the telephone report.

(4) The owner or operator shall submit reports on the operation and maintenance of the source to the Regional Air Program Manager at such intervals and in such form and detail as may be required by the Department. Information required in the reports may include, but is not limited to, process weight rates, firing rates, hours of operation, and maintenance schedules.

(b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirements of (a) above, shall be reported to the Department, in writing, within five (5) days of discovery of the malfunction.

(c) Unless otherwise approved by DEP, all malfunctions shall be reported through the Department's Greenport PUP system available through: https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home

VI. WORK PRACTICE REQUIREMENTS.

014 [25 Pa. Code §123.1] Prohibition of certain fugitive emissions

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne from any source specified in Section C, Condition #001(a)-(f). These actions shall include, but not be limited to, the following:

(a) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.

(b) Application of asphalt, oil, water, or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.

(c) Paving and maintenance of roadways.

(d) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

015 [25 Pa. Code §127.444] Compliance requirements.

The permittee shall operate and maintain all sources and any air cleaning devices identified in this operating permit in accordance with the manufacturer's recommendations/specifications, as well as in a manner consistent with good operating and air pollution control practices that minimize air emissions.





VII. ADDITIONAL REQUIREMENTS.

016 [25 Pa. Code §121.7]

Prohibition of air pollution.

The permittee shall not permit air pollution as that term is defined in the Air Pollution Control Act (35 P.S. §§4001 - 4015).

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

SECTION D. Sour	ce Level Requirements			• 2000
Source ID: 103	Source Name: 1489 HP EMERGE	NCY GENERATOR		
	Source Capacity/Throughput:	10.070 MMBTU/HR		
		73.500 Gal/HR	#2 Oil	
Conditions for this sour	ce occur in the following groups: 01			
	03			
103 - S05				

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

21-03128		HOLY	HOLY SPIRIT HOSP/HARRISBURG	
SECTION D. Sour	ce Level Requirements			
Source ID: 105	Source Name: 1502 HP EMERGE	NCY GENERATOR		
	Source Capacity/Throughput:	10.138 MMBTU/HR 74.000 Gal/HR	#2 Oil	
Conditions for this sou	ce occur in the following groups: 01 03			
PROC 105 → STAC S07				

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

21-03128	HOLY SPIRIT HOSP/HARRISBURG	Ž
SECTION D. Source Level Requirements		
Source ID: 106 Source Name: 2206 HP EMERGEI	NCY ENGINE (BOILER ROOM)	
Source Capacity/Throughput:	14.385 MMBTU/HR	
	105.000 Gal/HR #2 Oil	
Conditions for this source occur in the following groups: 02		
04		
PROC 106 STAC S106		
FML FML03		

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

21-03128		HOLY	Y SPIRIT HOSP/HARRISBURG	Ž
SECTION D. Source I	Level Requirements			
Source ID: 107	Source Name: 1474 HP EMERGEN	ICY ENGINE (DATA CEI	NTER #1)	
	Source Capacity/Throughput:	9.864 MMBTU/HR		
		72.000 Gal/HR	#2 Oil	
Conditions for this source of	occur in the following groups: 02			
	04			
PROC 107 → STAC S107				

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

21-03128			HOLY	SPIRIT HOSP/HARRISBURG	Ž
SECTION D. Source Level Requirements					
Source ID: 108 Source Name: 1474 H	PEMERGEN	NCYENGIN	IE (DATA CEN	ITER #2)	
Source Capacity/Thro	ughput:	9.864	MMBTU/HR		
		72.000	Gal/HR	#2 Oil	
Conditions for this source occur in the following gro	ups: 02				
	04				
PROC 108					

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

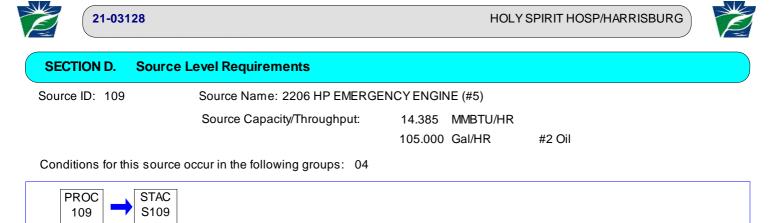

FML FML03

Emission Restriction(s).

001 [25 Pa. Code §127.441] Operating permit terms and conditions.

The permittee shall not operate Source ID 109 more than 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

002 [25 Pa. Code §127.441] Operating permit terms and conditions.

In the event that Source 109, and any other exempt engines which may be installed at the site, regardless of size, emit combined NOx emissions greater than or equal to 100 lbs/hr, 1000 lbs/day, 2.75 tons per ozone season or 6.6 tpy on a 12-month rolling basis, the permittee shall within 30 days of such exceedance notify DEP in writing of the exceedance, and shall either propose a schedule for submission of a plan approval application or general permit application, or shall provide





SECTION D. Source Level Requirements

a plan of how emissions will in the future be kept below those trigger levels. Depending on the circumstances and history of the matter at the time of notification, DEP may require submission of either a plan approval application or a general permit application.



21-03128

Source ID: 110

SECTION D.


Source Name: 60 HP EMERGENCY FIRE PUMP ENGINE

Source Capacity/Throughput:

0.548 MMBTU/HR 4.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: 03

Source Level Requirements



I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.13]

Processes

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter from the Source 110 fire pump engine in a manner that the concentration of particulate in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21] General

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides from the Source 110 fire pump engine in a manner that the concentration of the sulfur oxides (expressed as SO2) in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Operation Hours Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the Source 110 fire pump engine to 500 hours or less during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

004 [25 Pa. Code §127.441] Operating permit terms and conditions.

(a) The permittee shall maintain records of the Source 110 fire pump engine's monthly hours of operation.

(b) The permittee shall maintain records of the Source 110 fire pump engine's cumulative hours of operations for each consecutive 12-month period. This is necessary to demonstrate compliance with Condition #003, above and with 40 CFR Section 63.6640(f) addressed in Section E, Group 03.





SECTION D. Source Level Requirements

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

005 [25 Pa. Code §127.441] Operating permit terms and conditions.

The Source 110 fire pump engine shall be operated and maintained in accordance with the manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.





Group Name: 01

Group Description: Old Emergency Generators, from TVOP 21-05038

Sources included in this group

103 1489 HP EMERGENCY GENERATOR	
103 1409 HE EWERGENCT GENERATOR	
105 1502 HP EMERGENCY GENERATOR	

I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.13]

Processes

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter (PM) from each Group 01 engine in a manner that the concentration of PM in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides from each of the Group 01 engines in a manner that the concentration of the sulfur oxides (expressed as SO2) in the effluent gas exceeds 500 parts per million, by volume, dry basis.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is derived from TVOP No. 21-05038]

(a) The permittee shall limit the operation of the Source ID 103 engine to 365 hours or less during any consecutive 12-month period.

(c) The permittee shall limit the operation of the Source ID 105 engine to 200 hours or less during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall maintain records of each Group 01 engine's monthly hours of operation.

(b) The permittee shall maintain records of each Group 01 engine's cumulative hours of operations for each consecutive 12-month period. This is necessary to demonstrate compliance with Section E (Group 01), Condition #003, above.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).





VI. WORK PRACTICE REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

Each Group 01 engine shall be operated and maintained in accordance with the manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).





Group Name: 02

Group Description: Newer Emergency Generators, CI RICE, Installed 06/2013 & 01/2017

Sources included in this group

ID	Name
106	2206 HP EMERGENCY ENGINE (BOILER ROOM)
107	1474 HP EMERGENCY ENGINE (DATA CENTER #1)
108	1474 HP EMERGENCY ENGINE (DATA CENTER #2)

I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.13]

Processes

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter (PM) from each Group 02 engine in a manner that the concentration of PM in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO2, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Compliance with the diesel fuel maximum per gallon sulfur content of 1,000 parts per million in 40 CFR § 60.4207(d) addressed in Section E Group 04 assures compliance with this condition.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition (a) is also derived from Operating Permit No. GP9-21-05038A]

(a) Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1, the permittee shall not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

(1) Equal to or greater than 10% for a period or periods aggregating more than three minutes in any one hour; and

(2) Equal to or greater than 30% at any time.

(b) The emission limitations specified in part (a), above, shall apply at all times except during periods of start-up and shutdown, provided that the duration of start-up and shut-down do not exceed one hour per occurrence.

[Compliance with the requirements specified in this streamlined plan approval condition assures compliance with the visible emission limits specified in 25 Pa. §123.41 except during the prescribed periods of start-up and shutdown]

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Operating Permit No. GP9-21-05038A]

Each engine shall not operate more than 500 hours during any consecutive 12-month period.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Operating Permit No. GP9-21-05038A]

(a) Pursuant to the Best Available Technology (BAT) provisions of 25 Pa. Code §127.1, the permittee shall not allow the emission of air pollutants into the outdoor atmosphere from engines in excess of the following limits:





- (1) Total Hydrocarbons (THC): 1.0 g/bhp-hr
- (2) NOx: 6.9 gms/hp-hr
- (3) CO: 2.0 g/bhp-hr
- (4) Particulate matter: 0.4 gms/bhp-hr

(b) The emission limitations specified in part (a), above, shall apply at all times except during periods of start-up and shutdown, provided that the duration of start-up and shut-down do not exceed one hour per occurrence.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Operating Permit No. GP9-21-05038A]

The permittee shall operate each engine using diesel/No. 2 fuel oil only.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

007 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall maintain records of the fuel supplier's certification or laboratory analysis for each diesel/No. 2 fuel oil delivery received in order to demonstrate compliance with 40 CFR §60.4207(d) addressed in Section E, Group 04, NSPS Subpart IIII. The fuel supplier's certification or laboratory analysis shall include, at a minimum, the percent sulfur (by weight).

(b) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

008 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall maintain records of each engine's monthly hours of operation using a non-resettable hour meter.

(b) The permittee shall maintain records of each engine's cumulative hours of operation for each consecutive 12-month period.

(c) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

009 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Operating Permit No. GP9-21-05038A]

(a) The permittee shall maintain records of each engine's monthly and annual fuel usage. The fuel usage may be combined for the Group 02 Sources.

(b) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.





010 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is also derived from Operating Permit No. GP9-21-05038A]

The permittee shall maintain records of the following:

(a) Records including a description of testing methods, results, engine operating data collected during each test and a copy of the calculations performed to determine compliance with the applicable emission standards.

(b) Copies of each test report that demonstrates that the engines were operating at rated brake horsepower and rated speed conditions during performance testing.

(c) The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

011 [25 Pa. Code §127.441]

Operating permit terms and conditions.

Group 02 engines shall be operated and maintained in accordance with the manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).





Group Name: 03

Group Description: EMERGENCY GENERATORS (CI AND/OR SI) AT AREA HAP SOURCES

Sources included in this group

ID	Name
103	1489 HP EMERGENCY GENERATOR
105	1502 HP EMERGENCY GENERATOR
110	60 HP EMERGENCY FIRE PUMP ENGINE

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

001 [25 Pa. Code §127.441]

Operating permit terms and conditions.

In order to maintain MACT Subpart ZZZZ exemption for institutional emergency engines, all applicable requirements in Section 66.6640(f) shall be met:

63.6640(f) - If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

(2) You may operate your emergency stationary RICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization





or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

(ii)-(iii) [VACATED AS OF 5/2/16 PER COURT ORDER]

(3) [NA-NOT A MAJOR HAP SOURCE]

(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in nonemergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or nonemergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) Prior to May 3, 2014, the 50 hours per year for non-emergency situations can be used for peak shaving or non-emergency demand response to generate income for a facility, or to otherwise supply power as part of a financial arrangement with another entity if the engine is operated as part of a peak shaving (load management program) with the local distribution system operator and the power is provided only to the facility itself or to support the local distribution system.

(ii) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator.

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.



21-03128

SECTION E. Source Group Restrictions.

Group Name: 04

Group Description: CI RICE, NSPS Subpart IIII, New Four Emergency Generators

Sources included in this group

ID	Name
106	2206 HP EMERGENCY ENGINE (BOILER ROOM)
107	1474 HP EMERGENCY ENGINE (DATA CENTER #1)
108	1474 HP EMERGENCY ENGINE (DATA CENTER #2)
109	2206 HP EMERGENCY ENGINE (#5)

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200] Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines Am I subject to this subpart?

§60.4200 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [NA-NOT AN ENGINE MANUFACTURER]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

(i) Manufactured after April 1, 2006, and are not fire pump engines, or

(ii) [NA-NOT FIRE PUMP ENGINES]





(3) [NA-NOT MODIFIED/RECONSTRUCTED].

(4) The provisions of §60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

(b) [NA - NOT STATIONARY CI ICE TEST CELL/STAND]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) Stationary CI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

(e) [NA-NOT TEMPORARY REPLACEMENT UNITS

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 86 FR 34357, June 29, 2021]

EMISSION STANDARDS FOR MANUFACTURERS

§60.4201 What emission standards must I meet for non-emergency engines if I am a stationary CI internal combustion engine manufacturer? [NA – NOT AN ENGINE MANUFACTURER]

§60.4202 What emission standards must I meet for emergency engines if I am a stationary CI internal combustion engine manufacturer? [NA – NOT AN ENGINE MANUFACTURER]

§60.4203 How long must my engines meet the emission standards if I am a manufacturer of stationary CI internal combustion engines? [NA – NOT AN ENGINE MANUFACTURER]

EMISSION STANDARDS FOR OWNERS AND OPERATORS

§ 60.4204 What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine? [NA – UNITS ARE EMERGENCY]

§ 60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA – UNIT(S) POST 2007]

(b) [NA - ENGINE DISPLACEMENT > 30 L PER CYLINDER]

(c) [NA - ENGINES ARE NOT FIRE PUMPS]


(d) Owners and operators of emergency stationary CI engines with a displacement of greater than or equal to 30 liters per cylinder must meet the requirements in this section.

(1) [NA - ENGINES INSTALLED AFTER 01-01-2012]

(2) For engines installed on or after January 1, 2012, limit the emissions of NOX in the stationary CI internal combustion engine exhaust to the following:

(i) 14.4 g/KW-hr (10.7 g/HP-hr) when maximum engine speed is less than 130 rpm;

(ii) $44 \cdot n^0.23 \text{ g/KW-hr}$ ($33 \cdot n^0.23 \text{ g/HP-hr}$) when maximum engine speed is greater than or equal to 130 but less than 2,000 rpm and where n is maximum engine speed; and [MAX ENGINE SPEED = 1800 RPM; NOX EMISSION LIMIT = 5.9





Ž

SECTION E. Source Group Restrictions.

g/HP-hr]

(iii) 7.7 g/KW-hr (5.7 g/HP-hr) when maximum engine speed is greater than or equal to 2,000 rpm.

(3) Limit the emissions of PM in the stationary CI internal combustion engine exhaust to 0.40 g/KW-hr (0.30 g/HP-hr).

(e) [NA - ENGINE DISPLACEMENT > 30 L PER CYLINDER]

(f) [NA - ENGINES NOT RECONSTRUCTED]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 86 FR 34358, June 29, 2021]

§60.4206 How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

FUEL REQUIREMENTS FOR OWNERS AND OPERATORS

§60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?

(a) [Reserved]

(b) [NA - ENGINE DISPLACEMENT > 30 L PER CYLINDER]

(c) [Reserved]

(d) Beginning June 1, 2012, owners and operators of stationary CI ICE subject to this subpart with a displacement of greater than or equal to 30 liters per cylinder must use diesel fuel that meets a maximum per-gallon sulfur content of 1,000 parts per million (ppm).

(e) [NA - NO NATIONAL SECURITY EXEMPTION]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 85 FR 78463, Dec. 4, 2020]

OTHER REQUIREMENTS FOR OWNERS AND OPERATORS

§60.4208 What is the deadline for importing or installing stationary CI ICE produced in previous model years?

(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

(b) – (g) [NA – SPECIFIED DETAILS DO NOT APPLY]

(h) In addition to the requirements specified in §§60.4201, 60.4202, 60.4204, and 60.4205, it is prohibited to import stationary CI ICE with a displacement of less than 30 liters per cylinder that do not meet the applicable requirements specified in paragraphs (a) through (g) of this section after the dates specified in paragraphs (a) through (g) of this section.

(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]





§60.4209 What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in §60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) [NA-NO DIESEL PARTICULATE FILTERS].

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

COMPLIANCE REQUIREMENTS

§60.4210 What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer? [NA – NOT AN ENGINE MANUFACTURER]

§60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR part 1068, as they apply to you.

(b) [NA-UNIT(S) > 2007 YEAR]

(c) [NA – SPECIFIED SECTIONS DO NOT APPLY]

(d) If you are an owner or operator and must comply with the emission standards specified in 60.4204(c) or 60.4205(d), you must demonstrate compliance according to the requirements specified in paragraphs (d)(1) through (3) of this section.

(1) Conducting an initial performance test to demonstrate initial compliance with the emission standards as specified in § 60.4213.

(2) Establishing operating parameters to be monitored continuously to ensure the stationary internal combustion engine continues to meet the emission standards. The owner or operator must petition the Administrator for approval of operating parameters to be monitored continuously. The petition must include the information described in paragraphs (d)(2)(i) through (v) of this section.

(i) Identification of the specific parameters you propose to monitor continuously;

(ii) A discussion of the relationship between these parameters and NOX and PM emissions, identifying how the emissions of these pollutants change with changes in these parameters, and how limitations on these parameters will serve to limit NOX and PM emissions;

(iii) A discussion of how you will establish the upper and/or lower values for these parameters which will establish the limits on these parameters in the operating limitations;

(iv) A discussion identifying the methods and the instruments you will use to monitor these parameters, as well as the relative accuracy and precision of these methods and instruments; and





(v) A discussion identifying the frequency and methods for recalibrating the instruments you will use for monitoring these parameters.

(3) [NA - UNITS ARE EMERGENCY ENGINES]

(e) [NA - UNIT(S) NOT MODIFIED OR RECONSTRUCTED AFTER 7/11/05]

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii) – (iii) [VACATED BY COURT ORDER AS OF 5/2/16]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

(ii) [Reserved]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's





emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) [NA-UNIT(S) > 100 HP]

21-03128

(2) [NA-UNIT(S) > 500 HP]

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECDs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

TESTING REQUIREMENTS FOR OWNERS AND OPERATORS

§60.4212 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder? [NA – DISPLACEMENT > 30 L/CYL]

§60.4213 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?

Owners and operators of stationary CI ICE with a displacement of greater than or equal to 30 liters per cylinder must conduct performance tests according to paragraphs (a) through (f) of this section.

(a) Each performance test must be conducted according to the requirements in § 60.8 and under the specific conditions that this subpart specifies in table 7. The test must be conducted within 10 percent of 100 percent peak (or the highest achievable) load.

(b) You may not conduct performance tests during periods of startup, shutdown, or malfunction, as specified in § 60.8(c).

(c) You must conduct three separate test runs for each performance test required in this section, as specified in § 60.8(f). Each test run must last at least 1 hour.

(d) To determine compliance with the percent reduction requirement, you must follow the requirements as specified in paragraphs (d)(1) through (3) of this section.

(1) You must use Equation 2 of this section to determine compliance with the percent reduction requirement: [EQUATION 2 INCORPORATED BY REFERENCE]

(2) You must normalize the NOX or PM concentrations at the inlet and outlet of the control device to a dry basis and to 15 percent oxygen (O2) using Equation 3 of this section, or an equivalent percent carbon dioxide (CO2) using the procedures described in paragraph (d)(3) of this section. [EQUATION 3 INCORPORATED BY REFERENCE]

(3) If pollutant concentrations are to be corrected to 15 percent O2 and CO2 concentration is measured in lieu of O2 concentration measurement, a CO2 correction factor is needed. Calculate the CO2 correction factor as described in paragraphs (d)(3)(i) through (iii) of this section.





(i) Calculate the fuel-specific Fo value for the fuel burned during the test using values obtained from Method 19, Section 5.2, and the following equation: [EQUATION 4 INCORPORATED BY REFERENCE]

(ii) Calculate the CO2 correction factor for correcting measurement data to 15 percent O2, as follows: [EQUATION 5 INCORPORATED BY REFERENCE]

(iii) Calculate the NOX and PM gas concentrations adjusted to 15 percent O2 using CO2 as follows: [EQUATION 6 INCORPORATED BY REFERENCE]

(e) To determine compliance with the NOX mass per unit output emission limitation, convert the concentration of NOX in the engine exhaust using Equation 7 of this section: [EQUATION 7 INCORPORATED BY REFERENCE]

(f) To determine compliance with the PM mass per unit output emission limitation, convert the concentration of PM in the engine exhaust using Equation 8 of this section: [EQUATION 8 INCORPORATED BY REFERENCE]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011]

NOTIFICATION, REPORTS, AND RECORDS FOR OWNERS AND OPERATORS

§60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA – UNIT(S) ARE EMERGENCY]

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

(c) [NA - NO DIESEL PARTICULATE FILTER(S)]

(d) If you own or operate an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates for the purpose specified in 60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (d)(1) through (3) of this section.

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v)-(vi) [Reserved]

(vii) Hours spent for operation for the purposes specified in 60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in 60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and





Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in §60.4.

(e) Owners or operators of stationary CI ICE equipped with AECDs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECDs as required by 40 CFR 1039.665(e).

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 87 FR 48606, Aug. 10, 2022]

SPECIAL REQUIREMENTS

§60.4215 What requirements must I meet for engines used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands? [NA – ENGINE(S) DO NOT MEET SPECIFIED GEOGRAPHY]

§60.4216 What requirements must I meet for engines used in Alaska? [NA – ENGINE(S) DO NOT MEET SPECIFIED GEOGRAPHY]

§60.4217 What emission standards must I meet if I am an owner or operator of a stationary internal combustion engine using special fuels? [NA – ENGINE(S) DO NOT USE SPECIAL FUELS]

GENERAL PROVISIONS

§60.4218 What General Provisions and confidential information provisions apply to me?

(a) Table 8 to this subpart shows which parts of the General Provisions in §§60.1 through 60.19 apply to you. [TABLE 8 INCORPORATED BY REFERENCE]

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

DEFINITIONS [INCORPORATED BY REFERENCE]

REGULATORY CHANGES

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart IIII shall comply with all applicable requirements of the Subpart. 40 CFR §63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director United States Environmental Protection Agency Region III, Air and Radiation Division Permits Branch (3AD10) Four Penn Center 1600 John F. Kennedy Boulevard Philadelphia, Pennsylvania 19103-2852

The Department copies shall be forwarded to wiweaver@pa.gov, unless otherwise specified in writing by DEP.

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



HOLY SPIRIT HOSP/HARRISBURG



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.





SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.





SECTION H. Miscellaneous.

21-03128

#001. NOTE: The capacities/throughputs listed in Section A are for informational use only and should not be used as enforceable limitations.

#002. The following sources of minor significance have been exempted from work practice standards, and testing, monitoring, record keeping, and reporting requirements:

(a) No. 2 fuel oil storage tanks:

- (i) Boilers & Generators 2 through 5 30,000 gallon underground tank
- (ii) Generator 2 100 gallon day tank
- (iii) Generator 3 160 gallon day tank
- (iv) Generator 4 160 gallon day tank
- (v) Generator 5 160 gallon day tank
- (vi) Generator A (Data Center) 3,500 gallon belly tank
- (vii) Generator B (Data Center) 3,500 gallon belly tank
- (viii) Fire Pump 120 gallon day tank

(b) Four boilers, natural gas with No. 2 oil fuel backup, each rated at 9.9 mmbtu/hr (Facility's Source ID 034, 035, 036, and 037). They are limited to 48 hrs/year on No. 2 oil fuel for maintenance. Should the operating hours exceed 48 hr/yr, the boilers will be subject to 40 CFR 63 Subpart JJJJJJ, in accordance with Section 63.11195 and 11237 (Definition).

#003. The following serves as a description of some of the Source IDs:

- Source IDs 106, 107 and 108 were previously the subject of Plan Approval/Operating Permit No. GP9-21-05038A.

- Source ID 109 was installed as per GP9-21-05038B, but per a 3/5/18 company letter, they requested that the GP9 be rescinded because the generator operates so infrequently so as to be of minor significance. (NOTE: For information, RFD #1432 dated 9/13/16 had not exapted the engine and required the subject GP9 submission).

- Two boilers were installed as per RFD #1446 approved on 9/20/16. Each boiler is rated at 9.99 mmbtu/hr and combust natural gas as primary fuel and backup No. 2 fuel oil. They replaced Source ID 032, Boiler 2.

- Two boilers were installed as per RFD #1601 approved on 4/24/17. Each boiler is rated at 9.99 mmbtu/hr and combust natural gas as primary fuel and backup No. 2 fuel oil. They replaced Source ID 031, Boiler 1.

#004. This natural minor operating permit supercedes the facility's operating permit No. 21-03128 issued on October 29, 2019.





****** End of Report ******