



**COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM**

STATE ONLY NATURAL MINOR OPERATING PERMIT

Issue Date: February 28, 2024

Effective Date: May 7, 2024

Expiration Date: May 7, 2029

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 45-00021

Natural Minor

Federal Tax Id - Plant Code: 24-0795623-2

Owner Information

Name: LEHIGH VALLEY HOSPITAL POCONO

Mailing Address: 206 E BROWN ST
EAST STROUDSBURG, PA 18301-3094

Plant Information

Plant: LEHIGH VALLEY HEALTH NETWORK/EAST STROUDSBURG

Location: 45 Monroe County 45801 East Stroudsburg Borough

SIC Code: 8062 Services - General Medical And Surgical Hospitals

Responsible Official

Name: RAFFAEL LUCCI

Title: FACILITIES DIRECTOR

Phone: (570) 421 - 4000

Email: raffael.lucci@lvhn.org

Permit Contact Person

Name: RAFFAEL LUCCI

Title: FACILITIES DIRECTOR

Phone: (570) 421 - 4000

Email: raffael.lucci@lvhn.org

[Signature] _____

MARK J. WEJKSZNER, NORTHEAST REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)


- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous








**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
031	BOILER 1	20.900 MMBTU/HR	
032	BOILER 2	16.300 MMBTU/HR	
033	BOILER 3	8.400 MMBTU/HR	
034	BOILER 4	6.000 MMBTU/HR	
035	BOILER 5	6.000 MMBTU/HR	
101	400 KW EMERGENCY GENERATOR #1		
102	400 KW EMERGENCY GENERATOR #2		
103	400 KW EMERGENCY GENERATOR #3		
104	400 KW EMERGENCY GENERATOR #4		
105	750 KW EMERGENCY GENERATOR #5		
106	400 KW EMERGENCY GENERATOR #8		
107	1000 KW EMERGENCY GENERATOR #9		
FML01	#2 FUEL OIL - UST #1 (15,000 GAL)		
FML02	#2 FUEL OIL - UST #2 (2,000 GAL)		
FML03	NATURAL GAS MAIN; BOILERS		
FML04	#2 FUEL OIL - AST #5 (2,100 GAL)		
FML05	#2 FUEL OIL - AST #6 (2,500 GAL)		
S01	BOILER 1 STACK		
S02	BOILER 2 STACK		
S03	BOILER 3 STACK		
S04	BOILER 4 STACK		
S05	BOILER 5 STACK		
S06	GENERATOR #1 STACK		
S07	GENERATOR #2 STACK		
S08	GENERATOR #3 STACK		
S09	GENERATOR #4 STACK		
S10	GENERATOR #5 STACK		
S11	GENERATOR #8 STACK		
S12	GENERATOR #9 STACK		

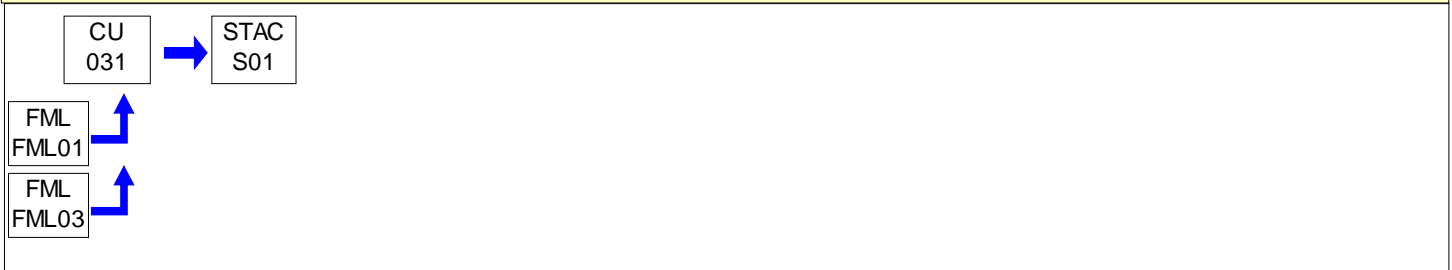PERMIT MAPS



PERMIT MAPS





PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
- (1) For a synthetic minor facility, a fee equal to:
- (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
 - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
 - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

**SECTION B. General State Only Requirements**

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

**SECTION B. General State Only Requirements**

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11]**Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

(a) No person may permit the emission into the outdoor atmosphere of fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) Sources and classes of sources other than those identified in paragraphs (1)-(6), for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (i) the emissions are of minor significance with respect to causing air pollution; and
 - (ii) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

A person may not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in Site Condition #001 (relating to prohibition of certain fugitive emissions) if such emissions are visible at the point the emissions pass outside the person's property.

003 [25 Pa. Code §123.31]**Limitations**

A person may not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]**Limitations**

A person may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.
- (2) Equal to or greater than 60% at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The limitations of Site Condition #004 shall not apply to a visible emission in any of the following instances:

- (1) when the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) When the emission results from sources specified in Site Condition #001 (relating to prohibition of certain fugitive emissions).

006 [25 Pa. Code §129.14]**Open burning operations**

(a) No person may permit the open burning of material in an area outside of air basins in a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.
- (2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.
- (3) The emissions interfere with the reasonable enjoyment of life or property.

**SECTION C. Site Level Requirements**

(4) The emissions cause damage to vegetation or property.

(5) The emissions are or may be deleterious to human or animal health.

(b) Exceptions: The requirements of subsections (a) do not apply where the open burning operations result from:

(1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.

(2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.

(3) A fire set for the prevention and control of disease or pests, when approved by the Department.

(4) A fire set in conjunction with the production of agricultural commodities in their unmanufactured state on the premises of the farm operation.

(5) A fire set for the purpose of burning domestic refuse, when the fire is on the premises of a structure occupied solely as a dwelling by two families or less and when the refuse results from the normal occupancy of such structure.

(6) A fire set solely for recreational or ceremonial purposes.

(7) A fire set solely for cooking food.

II. TESTING REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

If at any time the Department has cause to believe that air contaminant emissions from the aforementioned source(s) may be in excess of the limitations specified in, or established pursuant to, any applicable rule or regulation contained in Article III of the Rules and Regulations of the Department of Environmental Protection, the company shall be required to conduct whatever tests are deemed necessary by the Department to determine the actual emission rate(s). Such testing shall be conducted in accordance with the revisions of Chapter 139 of the Rules and Regulations Environmental Protection, where applicable, and in accordance with any restrictions or limitations established by the Department at such time as it notifies the company that testing is required.

008 [25 Pa. Code §139.1]**Sampling facilities.**

Upon the request of the Department, the person responsible for a source shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such source. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.

009 [25 Pa. Code §139.11]**General requirements.**

The following provisions are applicable to source tests for determining emissions from stationary sources:

(1) Performance tests shall be conducted while the source is operating at maximum routine operating conditions or under such other conditions, within the capacity of the equipment, as may be requested by the Department.

(2) The Department will consider for approval where sufficient information is provided to verify the source conditions existing at the time of the test and where adequate data is available to show the manner in which the test was conducted. Information submitted to the Department shall include, as a minimum all of the following:

(i) A thorough source description, including a description of any air cleaning devices and the flue.

(ii) Process conditions, for example, the charging rate of raw material or rate of production of final product, boiler pressure, oven temperature, and other conditions which may affect emissions from the process.

(iii) The location of the sampling ports.

(iv) Effluent characteristics, including velocity, temperature, moisture content, gas density (percentage CO, CO₂, O₂ and N₂), static and barometric pressures.

**SECTION C. Site Level Requirements**

- (v) Sample collection techniques employed, including procedures used, equipment descriptions and data to verify that isokinetic sampling for particulate matter collection occurred and that acceptable test conditions were met.
- (vi) Laboratory procedures and results.
- (vii) Calculated results.

III. MONITORING REQUIREMENTS.**# 010 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall conduct a weekly inspection during daylight hours when the plant is in production to inspect for visible, fugitive, and malodor emissions. If visible, fugitive or malodor emissions are detected, corrective actions shall be taken immediately to abate the emission.

IV. RECORDKEEPING REQUIREMENTS.**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

All weekly inspection results for visible, fugitive, or malodor emissions, shall be recorded in a logbook. The logbook shall be maintained on-site and be made available to the Department upon request. At a minimum, the permittee shall record the date, time, results of the inspection, and individual conducting the inspection.

013 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The company shall maintain a file containing all records and other data that are required to be collected pursuant to the various provisions of this operating permit. The file shall include, but not be limited to: all air pollution control systems performance evaluations and records of calibration checks, adjustments and maintenance performed on all equipment which is subject to this operating permit. All measurements, records and other data required to be maintained by the company shall be retained for at least five years following the date on which such measurements, records or data are recorded.

V. REPORTING REQUIREMENTS.**# 014 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The company, within one hour of discovery of occurrence, shall notify the Department, at (570) 826-2511, of any malfunction of the source(s) or associated air cleaning device(s) which results in, or may possibly be resulting in, the emission of air contaminants in excess of the limitations specified in, or established pursuant to, any applicable rule or regulation contained in Article III of the Rules and Regulations of the Department of Environmental Protection. A written report shall be submitted to the Department within two working days following the incident describing the malfunctions and corrective actions taken.

2) Any changes in the location of the aforementioned source, or any changes in the process or control equipment would be consider a modification and would require the submittal of an amended application for plan approval in accordance with the provisions of 25 PA Code 127.11 and 127.12.

3) Any notification as a result of any condition herein should be directed to:

Air Quality Program Manager
Department of Environmental Protection
2 Public Square

**SECTION C. Site Level Requirements**

Wilkes-Barre, PA 18711-0790

VI. WORK PRACTICE REQUIREMENTS.**# 015 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.



SECTION D. Source Level Requirements

Source ID: 031

Source Name: BOILER 1

Source Capacity/Throughput: 20.900 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 1



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 032

Source Name: BOILER 2

Source Capacity/Throughput: 16.300 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 1

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 033

Source Name: BOILER 3

Source Capacity/Throughput: 8.400 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 2

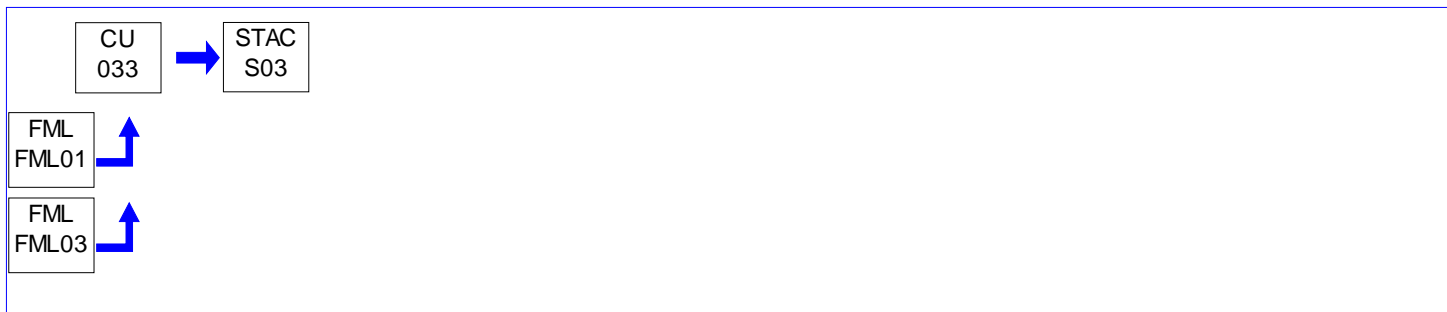**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 034

Source Name: BOILER 4

Source Capacity/Throughput: 6.000 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 2

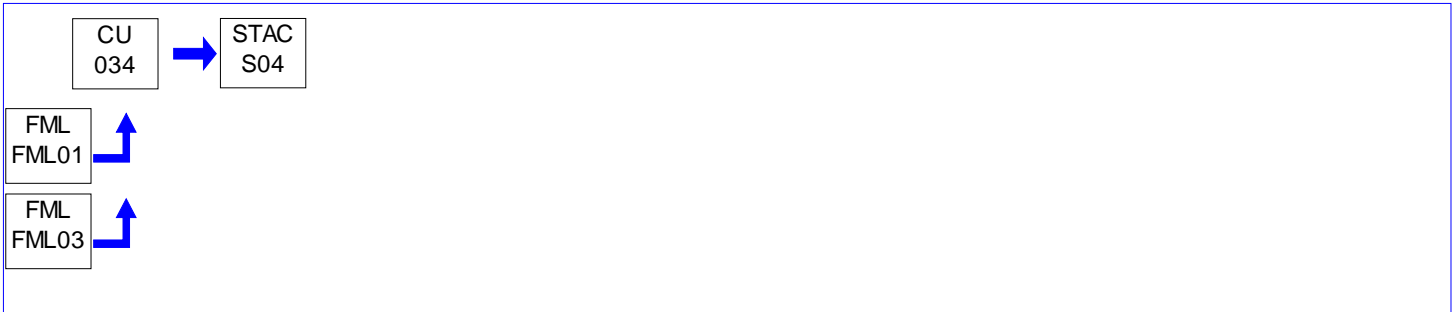**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 035

Source Name: BOILER 5

Source Capacity/Throughput: 6.000 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 2

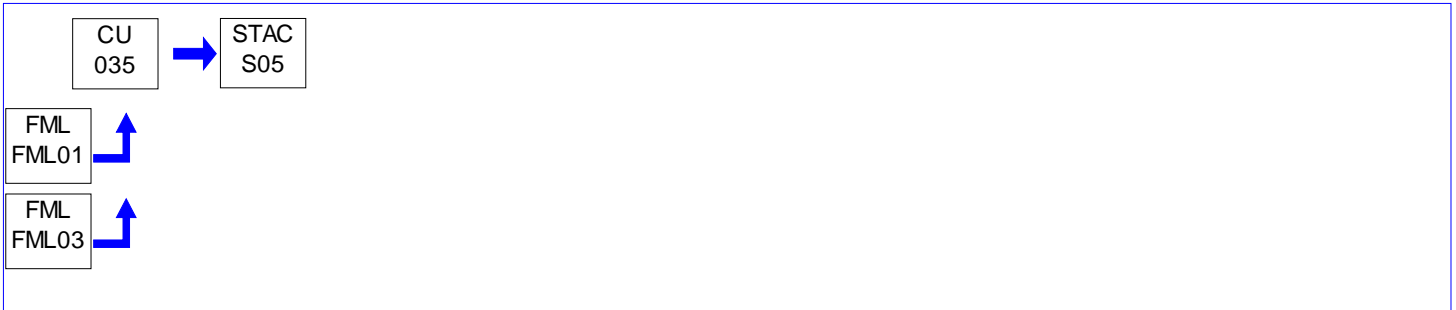**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 101

Source Name: 400 KW EMERGENCY GENERATOR #1

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 3

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 102

Source Name: 400 KW EMERGENCY GENERATOR #2

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 3

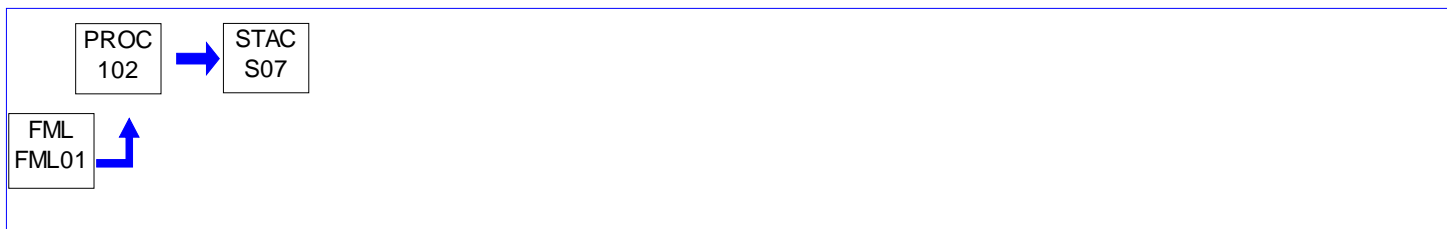**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 103

Source Name: 400 KW EMERGENCY GENERATOR #3

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 3

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 104

Source Name: 400 KW EMERGENCY GENERATOR #4

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 3

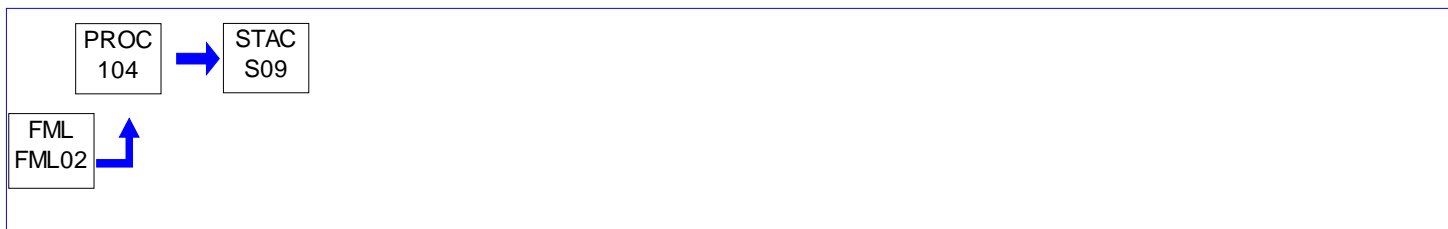**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 105

Source Name: 750 KW EMERGENCY GENERATOR #5

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 3

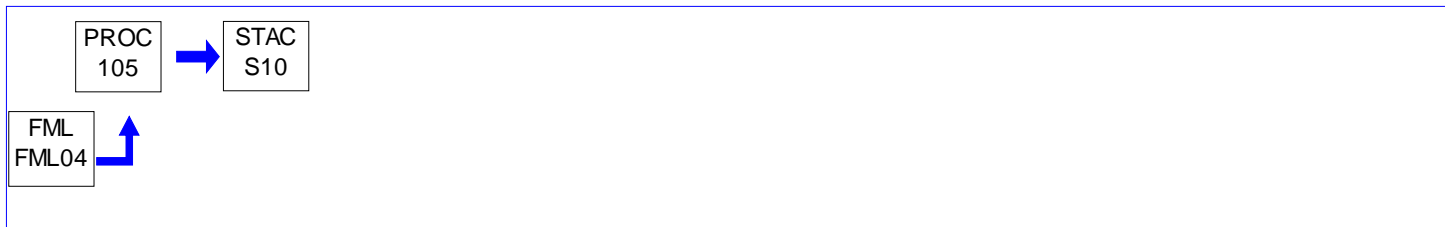**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 106

Source Name: 400 KW EMERGENCY GENERATOR #8

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 4

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 107

Source Name: 1000 KW EMERGENCY GENERATOR #9

Source Capacity/Throughput:

Conditions for this source occur in the following groups: GROUP 4

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 1

Group Description: Main Boilers 1 and 2

Sources included in this group

ID	Name
031	BOILER 1
032	BOILER 2

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

(a) A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

002 [25 Pa. Code §123.22]**Combustion units**

A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period.

003 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

Pursuant to the Best Available Technology provision of 25 Pa. Code §§127.1 and 127.12(a)(5), the facility is subject to the following air contaminant emission limitations from each boiler:

- A. 30 ppm_{dv} NO_x at 3% O₂ when firing gas at high fire.
- B. 300 ppm_{dv} CO at 3% O₂.
- C. 90 ppm_{dv} NO_x at 3% O₂ (when firing No. 2 oil at high fire)

The combustion unit(s) shall be fired only on gas (natural or liquefied petroleum) or No. 2 commercial fuel oil to which there has been no reclaimed or waste oil or other waste materials added.

004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.42c]**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units Standard for sulfur dioxide.**

(h) For affected facilities listed under paragraphs (h)(1) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under §60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

Fuel Restriction(s).**# 005 [25 Pa. Code §123.22]****Combustion units**

The sulfur content of No. 2 fuel oil shall not exceed 15 ppm (0.0015%).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****III. MONITORING REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The company shall install and maintain the necessary meter(s) to determine and to record amount of fuel usage.

007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.46c]**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Emission monitoring for sulfur dioxide**

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to §60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, as described under §60.48c(f), as applicable.

IV. RECORDKEEPING REQUIREMENTS.**# 008 [25 Pa. Code §123.22]****Combustion units**

(g) Recordkeeping and reporting.

(1) Beginning with the refinery owner or operator who sells or transfers commercial fuel oil into or within this Commonwealth for use in this Commonwealth and ending with the ultimate consumer, each time the physical custody of, or title to, a shipment of commercial fuel oil changes hands on or after July 1, 2016, the transferor shall provide to the transferee an electronic or paper record described in this paragraph. This record must legibly and conspicuously contain the following information:

- (i) The date of the sale or transfer.
 - (ii) The name and address of the transferor.
 - (iii) The name and address of the transferee.
 - (iv) The volume of commercial fuel oil being sold or transferred.
 - (v) The identification of the sulfur content of the shipment of commercial fuel oil, determined using the sampling and testing methods specified in subsection (f)(1), expressed as one of the following statements:
 - (A) For a shipment of No. 2 and lighter commercial fuel oil, "The sulfur content of this shipment is 500 ppm or below."
 - (B) – (C) Not applicable.
 - (vi) The location of the commercial fuel oil at the time of transfer.
 - (vii) Not applicable.
- (2) - (3) Not applicable.
- (4) A person subject to this section shall do both of the following:
- (i) Maintain the applicable records required under paragraph (1) in electronic or paper format for 2 years unless a longer period is required under § 127.511(b)(2) (relating to monitoring and related recordkeeping and reporting requirements).
 - (ii) Provide an electronic or written copy of the applicable record to the Department upon request.
- (5) Not applicable.

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The company shall maintain daily records indicating the fuel type, average hourly firing rate, and total quantity used in accordance with 40 CFR §60.48c(g). Records shall be kept for the fuel firing rates of the combustion unit on a monthly basis in order to determine sulfur dioxide (SO₂) emissions in accordance with 40 CFR §60.48c(d).

010 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The company shall comply with the recordkeeping and certification requirements in accordance with 40 CFR §§60.46c(e), 60.42c(h) and 60.48c(f)(1). Reports shall be submitted on a quarterly basis unless no excess emissions occurred. If there are no excess emissions, the company shall semi-annually report that no excess emissions occurred during the semi-annual reporting period.

011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.48c]**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Reporting and recordkeeping requirements.**

(d) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under §60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under §60.42c shall keep records and submit reports as required under paragraph (d) of this

**SECTION E. Source Group Restrictions.**

section, including the following information, as applicable.

(1) - (10) Not applicable.

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in §60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) – (4) Not applicable.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in §60.48c(f) to demonstrate compliance with the SO₂ standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel combusted during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in §60.42C to use fuel certification to demonstrate compliance with the SO₂ standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel delivered to that property during each calendar month.

(h) - (i) Not applicable.

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period.

V. REPORTING REQUIREMENTS.

012 [25 Pa. Code §127.441]

Operating permit terms and conditions.

These sources are subject to Subpart Dc of the Standards of Performance for New Stationary Sources and shall comply with all applicable requirements of this Subpart. 40 CFR §60.4 requires submission of copies of all requests, reports, applications, submittals, and other communications to both EPA and the Department. The EPA copies shall be forwarded to:

Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, PA 19103-2852

**SECTION E. Source Group Restrictions.****# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Any notification as a result of any condition herein should be directed to:

Air Quality Program Manager
Department of Environmental Protection
2 Public Square
Wilkes-Barre, PA 18711-0790

VI. WORK PRACTICE REQUIREMENTS.**# 014 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The aforementioned source(s) may only be operated as long as the associated air pollution control devices are operated and maintained in accordance with the specifications set forth in the respective plan approval(s), and the application(s) submitted for said plan approval(s) (as approved by the Department), and in accordance with any conditions set forth herein.

015 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The company shall perform an annual adjustment and/or tune-up on the combustion process as per manufacturer specifications.

016 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The company shall maintain and operate the boilers in accordance with the manufacturer specification and with good engineering practice.

017 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The boilers are exempt from 40 CFR 63 Subpart JJJJJ, if they meet the following requirement(s).

- (a) The boilers shall only fire natural gas except during periods of gas curtailment, gas supply emergencies, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year.
- (b) Whenever the boilers are fired on anything other than natural gas, the facility shall keep records of the hours of operation and type of fuel used.
- (c) If the conditions described above are not met, the facility shall immediately comply with the requirements of 40 CFR Part 63 Subpart JJJJJ. The requirements of 40 CFR Part 63 Subpart JJJJJ will remain in effect throughout the remaining term of the permit.

VII. ADDITIONAL REQUIREMENTS.**# 018 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The company shall not impose conditions upon or otherwise restrict the Department's access to the aforementioned source(s) and/or any associated air cleaning device(s) and shall allow the Department to have access at any time to said source(s) and associated air cleaning device(s) with such measuring and recording equipment, including equipment recording visual observations, as the Department deems necessary and proper for performing its duties and for the effective enforcement of the Air Pollution Control Act.

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 2

Group Description: Boilers 3, 4, & 5

Sources included in this group

ID	Name
033	BOILER 3
034	BOILER 4
035	BOILER 5

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

(a) A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

002 [25 Pa. Code §123.22]**Combustion units**

A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period.

Fuel Restriction(s).**# 003 [25 Pa. Code §123.22]****Combustion units**

The sulfur content of No. 2 fuel oil shall not exceed 15 ppm (0.0015%).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 004 [25 Pa. Code §123.22]****Combustion units**

(g) Recordkeeping and reporting.

(1) Beginning with the refinery owner or operator who sells or transfers commercial fuel oil into or within this Commonwealth for use in this Commonwealth and ending with the ultimate consumer, each time the physical custody of, or title to, a shipment of commercial fuel oil changes hands on or after July 1, 2016, the transferor shall provide to the transferee an electronic or paper record described in this paragraph. This record must legibly and conspicuously contain the following information:

- (i) The date of the sale or transfer.
- (ii) The name and address of the transferor.
- (iii) The name and address of the transferee.
- (iv) The volume of commercial fuel oil being sold or transferred.
- (v) The identification of the sulfur content of the shipment of commercial fuel oil, determined using the sampling and testing methods specified in subsection (f)(1), expressed as one of the following statements:
 - (A) For a shipment of No. 2 and lighter commercial fuel oil, "The sulfur content of this shipment is 500 ppm or below."
 - (B) – (C) Not applicable.

**SECTION E. Source Group Restrictions.**

- (vi) The location of the commercial fuel oil at the time of transfer.
- (vii) Not applicable.
- (2) - (3) Not applicable.
- (4) A person subject to this section shall do both of the following:
 - (i) Maintain the applicable records required under paragraph (1) in electronic or paper format for 2 years unless a longer period is required under § 127.511(b)(2) (relating to monitoring and related recordkeeping and reporting requirements).
 - (ii) Provide an electronic or written copy of the applicable record to the Department upon request.
- (5) Not applicable.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The boilers are exempt from 40 CFR 63 Subpart JJJJJJ, if they meet the following requirement(s).

- (a) The boilers shall only fire natural gas except during periods of gas curtailment, gas supply emergencies, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year.
- (b) Whenever the boilers are fired on anything other than natural gas, the facility shall keep records of the hours of operation and type of fuel used.
- (c) If the conditions described above are not met, the facility shall immediately comply with the requirements of 40 CFR Part 63 Subpart JJJJJJ. The requirements of 40 CFR Part 63 Subpart JJJJJJ will remain in effect throughout the remaining term of the permit.

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 3

Group Description: Emergency Generators

Sources included in this group

ID	Name
101	400 KW EMERGENCY GENERATOR #1
102	400 KW EMERGENCY GENERATOR #2
103	400 KW EMERGENCY GENERATOR #3
104	400 KW EMERGENCY GENERATOR #4
105	750 KW EMERGENCY GENERATOR #5

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §127.441]

Operating permit terms and conditions.

Combined NOx emissions for all exempt engines at the site shall be less than 100 lbs/hr, 1000 lbs/day, 2.75 tons per ozone season and 6.6 tons per year on a 12-month rolling basis.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

002 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The facility shall keep adequate records to show compliance with emission limitations.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The owner or operator of the emergency generator shall maintain an operating log that includes the dates the unit operated, total operating hours per day and total number of days and hours of operation per each 12-month rolling period.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The emergency generator shall be equipped with a non-resettable hour meter prior to startup of the engine and the meter shall be operated at all times the source is in operation. These records shall be maintained and kept on site for the most recent 5-year period and made available to the Department upon request.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 4

Group Description: Emergency Generators GP9-45-010

Sources included in this group

ID	Name
106	400 KW EMERGENCY GENERATOR #8
107	1000 KW EMERGENCY GENERATOR #9

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(7) Emissions Limits for Diesel Engines:

(a) Not Applicable

(b) Any diesel engine for which construction commenced on or after July 1, 1972 and best available technology requirements have not been previously established:

(i) If the diesel-fired internal combustion engine has an engine rating greater than 100 brake horsepower, the engine shall, at a minimum, comply with a Total Hydrocarbon (THC) emission standard of 1.0 gm/bhp-hr.

(ii) If the diesel-fired internal combustion engine is equal to or greater than 200 brake horsepower and number of hours of operation of engine are equal to or greater than the hours per year listed in the following table, then the engine shall be installed with NOx control device with a minimum of 80% NOx control efficiency.

Facilities Located in the "Severe" Ozone Non-Attainment Area

Engine Rating (BHP) > Engine Rating (BHP) <Actual Annual Operating Hours >

200 500 2,000

500 1,000 700

1,000 ----- 500

Facilities Located in "Moderate" (or lower classified) Ozone Non-Attainment Areas

Engine Rating (BHP) > Engine Rating (BHP) <Actual Annual Operating Hours >

200 250 7,000

250 500 4,000

500 750 1,700

750 1,000 1,500

1,000 1,500 1,100

1,500 2,000 750

2,000 ----- 500

If NOx emissions from engine(s) are controlled using control technology that uses ammonia or urea as a reagent, then the company shall limit the exhaust ammonia slip at 10 ppmvd, or less corrected at 15% O2.

All other diesel engines shall at a minimum comply with the NOx emission standard of 6.9 gms/hp-hr.

(iii) If the diesel-fired engine is equal to or greater than 100 brake horsepower and number of hours of operation of engine are equal to or greater than the hours per year listed in the following table, then the engine shall be installed with CO Oxidation Catalyst control device with a minimum of 90% control efficiency.

Engine Rating (BHP) > Engine Rating (BHP) <Actual Annual Operating Hours >

100 150 4,800

150 250 2,800

250 500 1,850

500 750 1,200

**SECTION E. Source Group Restrictions.**

750	1,000	950
1,000	1,500	700
1,500	2,000	670
2,000	2,500	500
2,500	-----	100

All other diesel engines shall at a minimum comply with CO emission standard of 2.0 gms/bhp-hr.

- (iv) The sulfur content in diesel fuel shall not, at any time exceed 0.3 percent (by weight).
- (v) The particulate matter emissions from each engine shall not exceed 0.4 gms/bhp-hr.
- (vi) Visible emissions from diesel engine(s) stacks shall not exceed the following limitations:

- (A) Equal to or greater than 10% for a period or periods aggregating more than three (3) minutes in any one (1) hour; and
- (B) Equal to or greater than 30% at any time.

(vii) Odor emissions in such a manner that the malodors are detectable outside the property of the permittee as specified in 25 Pa. Code §123.31.

II. TESTING REQUIREMENTS.**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(8) Performance Testing:

(a) For a new diesel-fired internal combustion engine installed in accordance with Conditions 2 and 7.b. and which has a rated capacity equal to or less than 500 brake horsepower, vendor guarantees shall be sufficient to fulfill this requirement. However, the Department reserves the right to require an additional verification of emission rates which may include source testing in accordance with applicable provisions of 25 Pa. Code Chapter 139 (relating to sampling and testing) or portable exhaust gas analyzers approved by the Department if the NOx emissions from the facility including the proposed diesel engines are equal to or greater than:

- (i) 22.5 tons per year if the facility is located in severe ozone non-attainment areas; and
- (ii) 90 tons per year if the facility is located in any other area than those listed above in 8.a.i.

(b) For a new internal combustion engine installed in accordance with Conditions 2 and 7.b. and which has a rated capacity greater than 500 brake horsepower, within 180 days of receiving authority to construct under this general permit, the permittee shall perform stack testing in accordance with 25 Pa. Code Chapter 139.

(c) In addition to the stack testing required by this condition, within 12 months after the initial stack testing, and annually thereafter, the permittee shall perform NOx emissions tests upon each of the respective engines subjected to the BAT as stated in Condition 7.b. herein using a portable analyzer approved by the Department. The Department may alter the frequency of annual portable analyzer tests based on the results. The Department may also waive all or parts of this requirement if the permittee demonstrates compliance, in lieu of testing, through alternate means satisfactory to the Department.

(d) The Department reserves the right to require stack tests in accordance with EPA reference methods should the data from the portable analyzer warrant such tests. The purpose of this testing is to demonstrate compliance with the emission limitations required for new engines.

(e) The Department may accept the vendor guarantees or recent on-site test data on similar engines, or any other means approved by the Department as a verification of NOx emission if the NOx emissions from a diesel engine located in severe non-attainment area for ozone are less than 2.5 tons per year or 10 tons per year if a diesel engine is located in areas other than severe non-attainment for ozone.

**SECTION E. Source Group Restrictions.**

(f) If performance stack tests are required for the demonstration of compliance with applicable emissions limits, the owner or operator of the affected facility shall comply with the following requirements:

(i) Within sixty (60) days after achieving the maximum production rate at which the affected facility will be operated, but no later than one hundred eighty (180) days after the initial startup of the source and the owner or operator shall demonstrate compliance with the applicable emission limits.

(ii) At least sixty (60) days prior to the test, the company shall submit to the Department for approval the procedures for the test and a sketch with dimensions indicating the location of sampling ports and other data to ensure the collection of representative samples.

(iii) At least thirty (30) days prior to the test, the Department shall be informed of the date and time of the test.

(iv) Within sixty (60) days after the source test(s), two copies of the complete test report, including all operating conditions, shall be submitted to the Department.

III. MONITORING REQUIREMENTS.**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(9) Monitoring, Recordkeeping and Reporting:

(a) The permittee shall maintain accurate records, which, at a minimum, shall include:

(i) The number of hours per calendar year that each engine or piece of equipment operated using non-resettable hour meter.

(ii) The amount of fuel used per calendar year in each engine or piece of equipment.

(b) When a new diesel-fired internal combustion engine is installed in accordance with Conditions 2 and 7.b and is required to conduct a performance test, the permittee shall maintain records or report the following:

(i) Records including a description of testing methods, results, all engine operating data collected during the tests and a copy of the calculations performed to determine compliance with emission standards.

(ii) Copies of the report that demonstrates that the engines were operating at rated brake horsepower and rated speed conditions during performance testing.

(iii) Submittal of reports in accordance with the requirements and schedules outlined in this Diesel Engine(s) General Permit.

(c) These records shall be retained for a minimum of five (5) years and shall be made available to the Department upon request. The Department reserves the right to expand the list contained in this condition as it may reasonably prescribe pursuant to the provisions of Section 4 of the Pennsylvania Air Pollution Control Act (35 P. S. §§4004), and as it may deem necessary to determine compliance with any condition contained herein.

IV. RECORDKEEPING REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The owner or operator of the emergency generator shall maintain an operating log that includes the dates the unit operated, total operating hours per day and total number of days and hours of operation per each 12-month rolling period.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The emergency generator shall be equipped with a non-resettable hour meter prior to startup of the engine and the meter shall be operated at all times the source is in operation. These records shall be maintained and kept on site for the most recent 5-year period and made available to the Department upon request.

**SECTION E. Source Group Restrictions.****VII. ADDITIONAL REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

These engines shall comply with all applicable conditions stated in GP9-45-010.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The engines are subject to NSPS 40 CFR Part 60, Subpart IIII and shall comply with all applicable requirements as specified in 40 CFR Part 60, Subpart IIII.



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.



SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

(a) The Natural Minor Operating Permit application was received on December 15, 2023. The annual operating permit maintenance fee shall be submitted to the Department in accordance with 25 Pa. Code, Chapter 127, Section 127.703. The annual maintenance fees are due no later than December 31, annually.

(b) The facility operated under operating permit NM-45-00021 before issuance of this permit.

(c) General Permit No. GP9-45-010 was issued on December 16, 2021 for for two (2) of the emergency generator engines: one (1) Caterpillar Model C15 619 bhp engine (Source 106) and one (1) Caterpillar Model C32 1,483 bhp engine (Source 107).

(d) Plan Approvals include:
45-302-077 issued 02/24/2011.

(e) Requests for Determination (RfDs) include:
45-0332 issued 2/1/2011 for existing 8.4 MMBtu/hr boiler
45-0373 issued 8/26/2013 for 400 kW emergency generator
45-0374 issued 8/26/2013 for 1000 kW emergency generator
45-0530 issued 3/7/2019 for two existing 6 MMBtu/hr boilers



***** End of Report *****
