



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM

STATE ONLY SYNTHETIC MINOR OPERATING PERMIT

Issue Date: November 5, 2024

Effective Date: April 1, 2025

Expiration Date: March 31, 2030

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 06-05151

Synthetic Minor

Federal Tax Id - Plant Code: 23-2250505-2

Owner Information

Name: PA STATE SYS OF HIGHER ED KUTZTOWN UNIV
Mailing Address: PO BOX 730
15200 KUTZTOWN RD
KUTZTOWN, PA 19530-0730

Plant Information

Plant: PA STATE SYS OF HIGHER ED/KUTZTOWN UNIV OF PA
Location: 06 Berks County 06944 Maxatawny Township
SIC Code: 8221 Services - Colleges And Universities

Responsible Official

Name: DAVID YODER
Title: CAMPUS UTILITIES MGR
Phone: (610) 698 - 4919 Email: dyoder@kutztown.edu

Permit Contact Person

Name: DAVID YODER
Title: CAMPUS UTILITIES MGR
Phone: (610) 698 - 4919 Email: dyoder@kutztown.edu

[Signature] _____
WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation of Sources
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous









**SECTION A. Site Inventory List**

| Source ID | Source Name | Capacity/Throughput | Fuel/Material |
|-----------|--------------------------------------------|---------------------|---------------|
| 036 | DOMESTIC HOT WATER HEATERS | 19,237.000 CF/HR | NATURAL GAS |
| 037 | POOL HEATER | 1.800 MMBTU/HR | |
| | | 1,772.000 CF/HR | NATURAL GAS |
| 039 | HOT WATER HEATERS (OIL FIRED) | 11.000 Gal/HR | #2 OIL |
| 040 | TWO GREENHOUSE HEATERS | 0.400 MMBTU/HR | |
| | | 350.000 CF/HR | NATURAL GAS |
| 042 | BOILERS (NG-FIRED) | 50.250 MMCF/HR | NATURAL GAS |
| 043 | MISCELLANEOUS COMBUSTION SOURCES (NAT GAS) | 5.000 MCF/HR | NATURAL GAS |
| 051 | BOILER 6 (BURNHAM) | 37.660 MMBTU/HR | |
| | | 272.000 Gal/HR | #2 OIL |
| | | 36.563 MCF/HR | NATURAL GAS |
| 052 | BOILER 7 (BURNHAM) | 37.660 MMBTU/HR | |
| | | 272.000 Gal/HR | #2 OIL |
| | | 36.563 MCF/HR | NATURAL GAS |
| 053 | BOILER 8 (BURNHAM) | 37.660 MMBTU/HR | |
| | | 272.000 Gal/HR | #2 OIL |
| | | 36.563 MCF/HR | NATURAL GAS |
| 101 | EXISTING EMERGENCY IC ENGINES | 8.710 MMBTU/HR | |
| 101A | CI EMERGENCY IC ENGINES | 28.310 MMBTU/HR | |
| 101B | SI EMERGENCY IC ENGINES | 0.110 MMBTU/HR | |
| 102 | THREE KILNS | 754.000 CF/HR | NATURAL GAS |
| FM002 | PIPELINE, NATURAL GAS | | |
| FM003 | TANK, NO.2 OIL | | |
| FM004 | PROPANE TANK | | |
| S04 | STACK: POOL HEATER | | |
| S101 | STACKS: EXISTING EMERGENCY IC ENGINES | | |
| S101A | STACKS: CI EMERGENCY IC ENGINES | | |
| S101B | STACKS: SI EMERGENCY IC ENGINES | | |
| S102 | STACKS: KILNS | | |
| S36 | STACKS: DOM HOT WATER HTRS | | |
| S39 | STACKS: BOILERS (OIL FIRED) | | |
| S40 | STACK: GREENHOUSE HEATERS | | |
| S42 | STACKS: BOILERS (NAT GAS) | | |
| S51 | STACK: BOILER 6 | | |
| S52 | STACK: BOILER 7 | | |
| S53 | STACK: BOILER 8 | | |
| Z08 | FUGITIVE: MISC SOURCES (NAT GAS) | | |

PERMIT MAPS




PERMIT MAPS





PERMIT MAPS

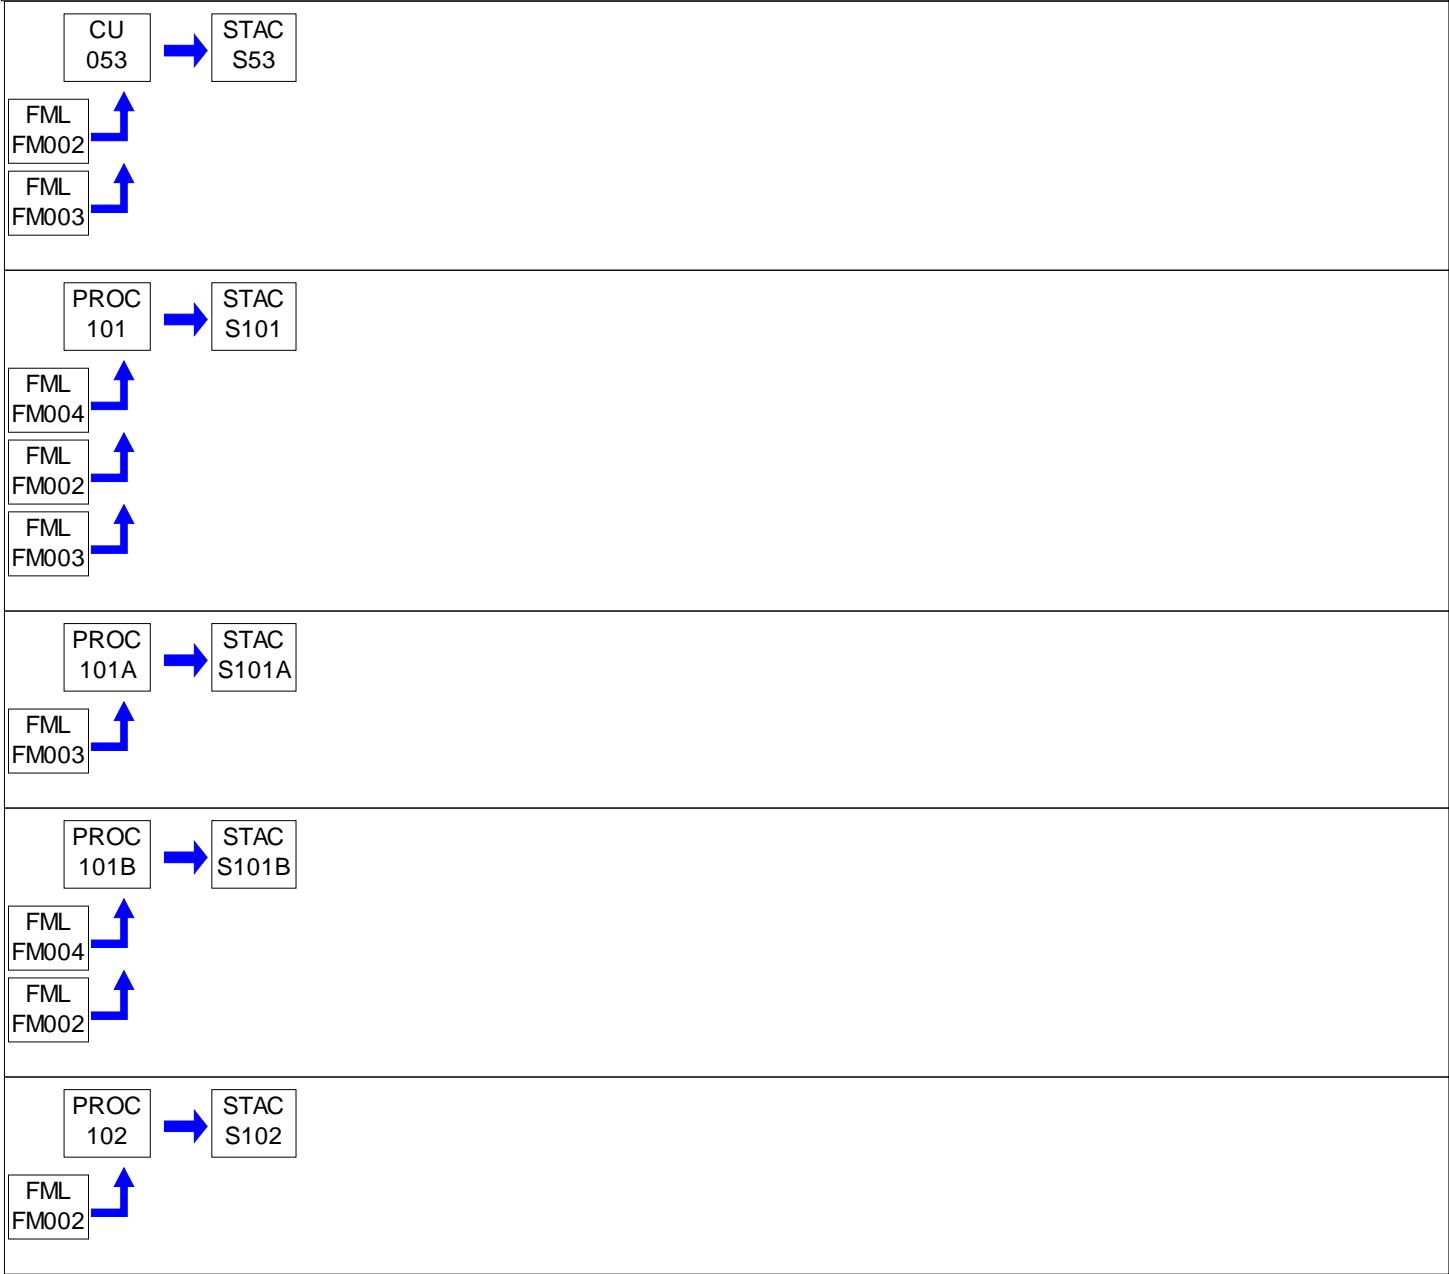

**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

(a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.

(b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

(a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.

(b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.

(c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.

(d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.

(e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).

(f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

(a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.

(1) For a synthetic minor facility, a fee equal to:

(i) Four thousand dollars (\$4,000) for calendar years 2021—2025.

(ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.

(iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:



SECTION B. General State Only Requirements

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]

Need to Halt or Reduce Activity Not a Defense.

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]

Duty to Provide Information.

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]

Revising an Operating Permit for Cause.

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]

Operating Permit Modifications

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

**SECTION B. General State Only Requirements**

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

(1) Section 127.14 (relating to exemptions)

(2) Section 127.447 (relating to alternative operating scenarios)

(3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)

(4) Section 127.449 (relating to de minimis emission increases)

(5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11a]**Reactivation of Sources**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall not allow the emission into the outdoor atmosphere of any fugitive air contaminant from a source other than the following:

- (a) Construction or demolition of buildings or structures.
- (b) Grading, paving and maintenance of roads and streets.
- (c) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (d) Clearing of land.
- (e) Stockpiling of materials.
- (f) Sources and classes of sources other than those identified in (a) - (e), above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - 1) the emissions are of minor significance with respect to causing air pollution; and
 - 2) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air standard.

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

No person shall permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in the preceding permit Condition #001, Section C, if such emissions are visible at the point the emissions pass outside the person's property.

003 [25 Pa. Code §123.31]**Limitations**

No person shall emit any malodorous air contaminants into the outdoor atmosphere from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]**Limitations**

No person shall emit visible air contaminants into the outdoor atmosphere in such a manner that the opacity of the emission is either of the following unless otherwise stated in this permit:

- a. Equal to or greater than 20 percent for a period or periods aggregating more than three minutes in any one hour.
- b. Equal to or greater than 60 percent at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The limitations of 25 Pa. Code Section 123.41 (relating to limitations) do not apply to a visible emission in any of the following instances:

- a. When the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- b. When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- c. When the emission results from sources specified in Condition #001, Section C (relating to prohibition of certain fugitive emissions).

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the facility's total actual emissions below the following levels to maintain the facility's synthetic minor status:

- (a) 100 tons/year of sulfur oxides (SO_x)
- (b) 100 tons/year of nitrogen oxides (NO_x)
- (c) 100 tons/year of carbon monoxide (CO)
- (d) 100 tons/year of PM-10 (particulate matter with an effective aerodynamic diameter of less than or equal to a nominal 10 micrometer body as measured by the applicable reference method or an equal method)
- (e) 100 tons/year of PM-2.5
- (f) 50 tons/year of volatile organic compounds (VOC)
- (g) 10 tons/year of any individual hazardous air pollutant (HAP)
- (h) 25 tons/year of total combined hazardous air pollutants (HAP)

The above emission limits are based upon a 12-month rolling average and apply to each consecutive 12-month period. Compliance verification requires emissions to be calculated for each month and each consecutive 12-month period. Calculation records shall be maintained on-site for the most recent five-year period and made available to Department representatives upon request.

007 [25 Pa. Code §129.14]**Open burning operations**

- (a) No person may permit the open burning of material in a manner that:
 - (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.
 - (2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.
 - (3) The emissions interfere with the reasonable enjoyment of life or property.
 - (4) The emissions cause damage to vegetation or property.
 - (5) The emissions are or may be deleterious to human or animal health.
- (b) The requirements of subsection (a) does not apply where the open burning operations result from:
 - (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
 - (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
 - (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
 - (4) A fire set in conjunction with the production of agricultural commodities in their unmanufactured state on the premises of the farm operation.

**SECTION C. Site Level Requirements**

- (5) A fire set for the purpose of burning domestic refuse, when the fire is on the premises of a structure occupied solely as a dwelling by two families or less and when the refuse results from the normal occupancy of the structure.
- (6) A fire set solely for recreational or ceremonial purposes.
- (7) A fire set solely for cooking food.
- (c) This permit does not constitute authorization to burn solid waste pursuant to section 610 (3) of the Solid Waste Management Act 35 P.S. Section 6018.610 (3), or any other provision of the Solid Waste Management Act.

II. TESTING REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of the sources and control devices referenced in this permit to measure emissions for purposes including verification of permit condition compliance and estimation of annual air emissions.

009 [25 Pa. Code §139.1]**Sampling facilities.**

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such sources. In the request, the Department will set forth the time period in which the facilities shall be provided as well as the specifications for such facilities.

III. MONITORING REQUIREMENTS.**# 010 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured by using either of the following:

- a. A device approved by the Department and maintained to provide accurate opacity measurements.
- b. Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall conduct a monthly inspection around the plant periphery during daylight hours when the plant is in production to detect visible emissions, fugitive emissions, and malodorous air contaminants. Monthly inspections are necessary to determine:

- (a) The presence of visible emissions as stated in Section C, Condition #004. Visible emissions may be measured according to the methods specified in Section C, Condition #010. Alternatively, plant personnel who observe visible emissions may report the incident of visible emissions to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions.
- (b) The presence of fugitive emissions beyond the plant property boundaries, as stated in Section C, Condition #002.
- (c) The presence of malodorous air contaminants beyond the plant property boundaries, as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Unless otherwise noted, all records required by this and subsequent operating permits shall be maintained for the most recent five-year period and shall be readily available to the Department upon request. The most recent two years of records

**SECTION C. Site Level Requirements**

must be retained at the facility. The remaining three years of records may be retained off site. The records may be retained on paper, microfilm, microfiche or computer disks. If the records are retained on computer disks, the records must be in commonly available software. Commonly available software is usually compatible with a Microsoft application such as Word or Excel. For records kept off site, readily available is defined as available within one business day.

013 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain records of inspections around the facility periphery. The records shall include, at minimum, the following information:

- (a) The name of the company representative conducting the inspection.
- (b) The date and time of the inspection.
- (c) The wind direction.
- (d) Description of any emissions and/or malodors observed and actions taken to mitigate them. If none, record "NONE."

014 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall maintain permanent records for all sources covered by this permit in a manner approved by the Department. The records shall include the following:

- a. Monthly fuel consumption
- b. Type of fuel
- c. Heating value of the fuel (BTU/LB)
- d. Sulfur content (% by weight or ppm as applicable)
- e. Monthly hours of operation
- f. Annual fuel consumption

V. REPORTING REQUIREMENTS.**# 015 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall report malfunctions to the Department. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner that affects the facility's ability to comply with a permit term. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

- (a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Reading District Office at (610) 916-0100 during normal business hours, or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.
- (b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirement of subsection (a) above, shall be reported to the Department, in writing, within five (5) days of malfunction discovery.
- (c) Unless otherwise approved by DEP, all malfunctions shall be reported through the Department's Greenport PUP system available through: <https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

VI. WORK PRACTICE REQUIREMENTS.**# 016 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne from any source specified in Section C, Condition #001(a) - (f). These actions shall include, but are not limited to, the following:

- (a) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction



SECTION C. Site Level Requirements

operations, the grading of roads, or the clearing of land.

(b) Application of asphalt, oil, water, or suitable chemicals on dirt roads, material stockpiles, and other surfaces, which may give rise to airborne dusts.

(c) Paving and maintenance of roadways.

(d) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

VII. ADDITIONAL REQUIREMENTS.

017 [25 Pa. Code §127.441]

Operating permit terms and conditions.

1. Kutztown University of Pennsylvania is granted the following Creditable Emissions Decreases (CED) from the shutdown of Sources 031, 032, 033 and 034:

| SOURCE | NOx | PM-2.5 | VOC |
|----------------------|------------|-----------|----------|
| 031 Keeler Boiler #2 | 5.12 tons | 1.10 tons | 0.04 ton |
| 032 Keeler Boiler #3 | 5.86 tons | 1.15 tons | 0.05 ton |
| 033 Keeler Boiler #4 | 13.97 tons | 2.83 tons | 0.11 ton |
| 034 Boiler #1 | 0.37 ton | 0.00 ton | 0.01 ton |
| Totals | 25.32 tons | 5.08 tons | 0.21 ton |

2. These CED may be used after the approved entry of the CED by the Department in the Pennsylvania ERC Registry.

3. Pursant to 25 PA Code Section 127.207(7), if the sources addressed in this CED Approval have not been dismantled or removed, Kutztown University of Pennsylvania shall on an annual basis certify in writing to the Deepartment the continuance of the shutdown.

4. Kutztown University of Pennsylvania and any subsequent user of this CED Approval shall comply with the requirements of 25 PA Code Sections 127.206 - 127.209.

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.




SECTION D. Source Level Requirements

Source ID: 036

Source Name: DOMESTIC HOT WATER HEATERS

Source Capacity/Throughput: 19,237.000 CF/HR NATURAL GAS

Conditions for this source occur in the following groups: SG01 MISC SOURCES

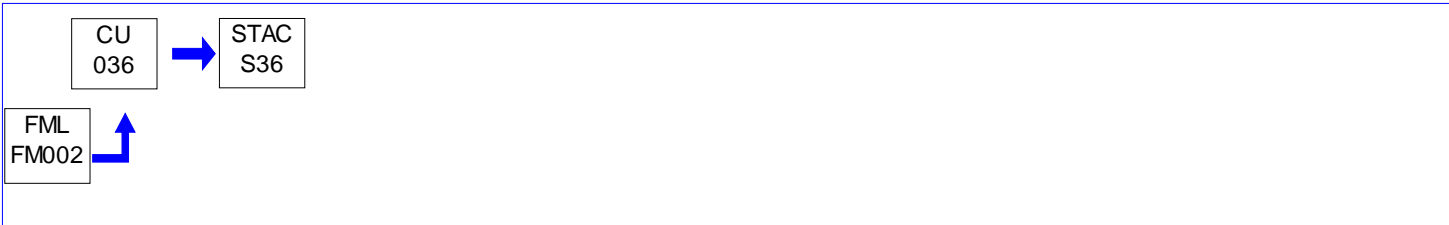

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 037


Source Name: POOL HEATER

Source Capacity/Throughput: 1.800 MMBTU/HR

1,772.000 CF/HR

NATURAL GAS

Conditions for this source occur in the following groups: SG01 MISC SOURCES

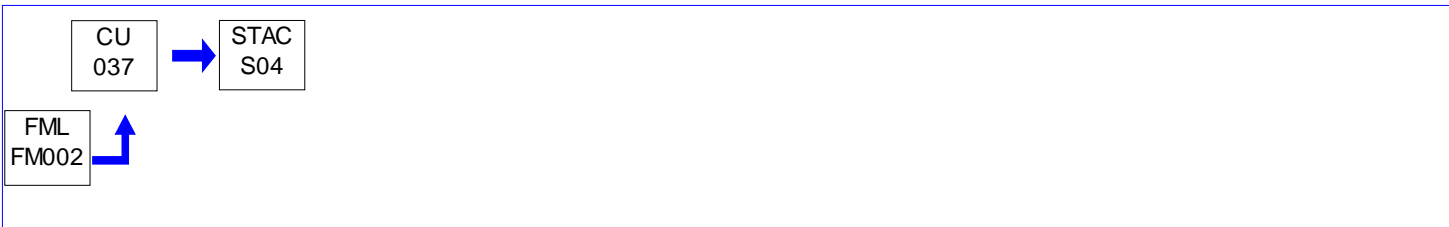

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 039

Source Name: HOT WATER HEATERS (OIL FIRED)

Source Capacity/Throughput: 11.000 Gal/HR #2 OIL



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



SECTION D. Source Level Requirements

Source ID: 040

Source Name: TWO GREENHOUSE HEATERS

Source Capacity/Throughput: 0.400 MMBTU/HR

350.000 CF/HR

NATURAL GAS

Conditions for this source occur in the following groups: SG01 MISC SOURCES



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 042

Source Name: BOILERS (NG-FIRED)

Source Capacity/Throughput: 50.250 MMCF/HR NATURAL GAS

Conditions for this source occur in the following groups: SG01 MISC SOURCES

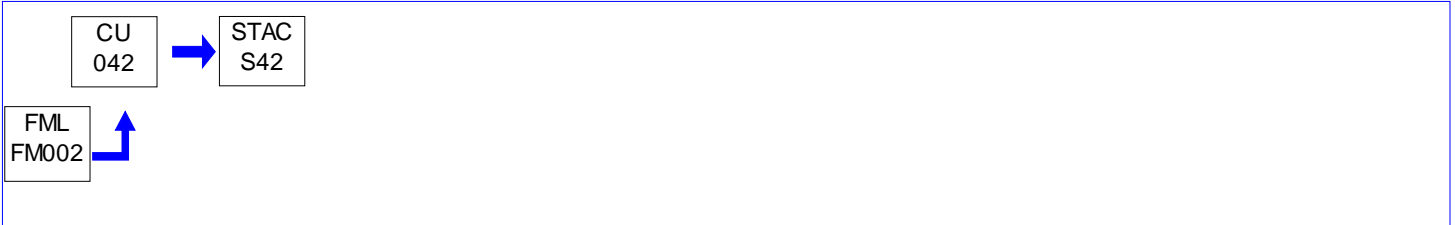

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 043

Source Name: MISCELLANEOUS COMBUSTION SOURCES (NAT GAS)

Source Capacity/Throughput: 5.000 MCF/HR NATURAL GAS



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).




SECTION D. Source Level Requirements

Source ID: 051

Source Name: BOILER 6 (BURNHAM)

| | | | |
|-----------------------------|---------|----------|-------------|
| Source Capacity/Throughput: | 37.660 | MMBTU/HR | |
| | 272.000 | Gal/HR | #2 OIL |
| | 36.563 | MCF/HR | NATURAL GAS |

Conditions for this source occur in the following groups: SG02 BOILER HOUSE
SG06

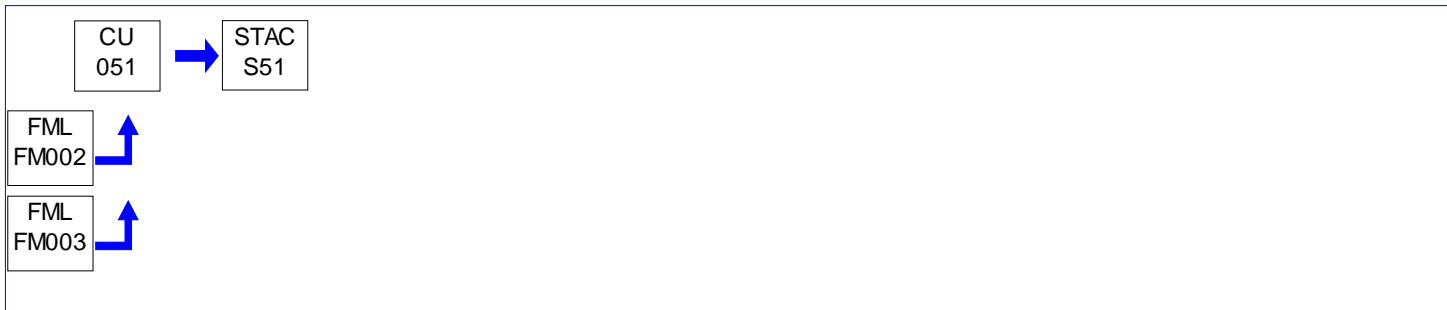

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 052

Source Name: BOILER 7 (BURNHAM)

| | | | |
|-----------------------------|---------|----------|-------------|
| Source Capacity/Throughput: | 37.660 | MMBTU/HR | |
| | 272.000 | Gal/HR | #2 OIL |
| | 36.563 | MCF/HR | NATURAL GAS |

Conditions for this source occur in the following groups: SG02 BOILER HOUSE
SG06

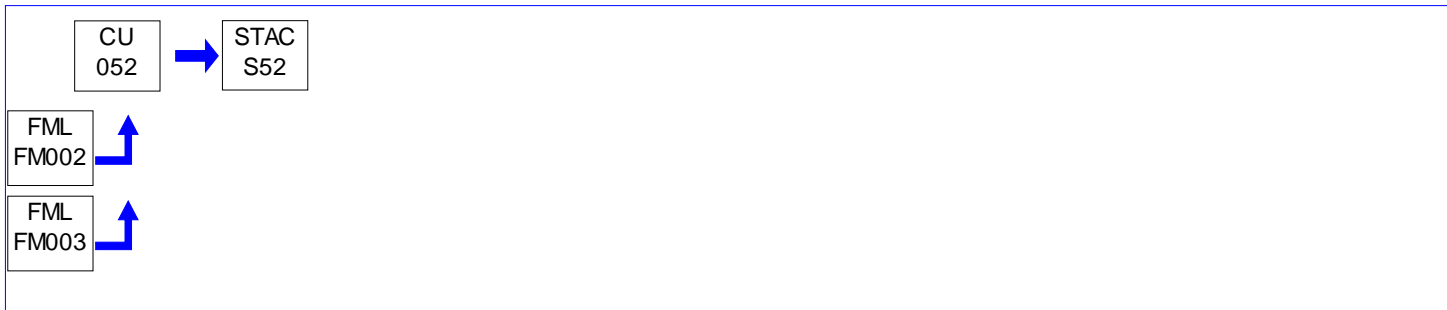

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 053

Source Name: BOILER 8 (BURNHAM)

| | | | |
|-----------------------------|---------|----------|-------------|
| Source Capacity/Throughput: | 37.660 | MMBTU/HR | |
| | 272.000 | Gal/HR | #2 OIL |
| | 36.563 | MCF/HR | NATURAL GAS |

Conditions for this source occur in the following groups: SG02 BOILER HOUSE
SG06

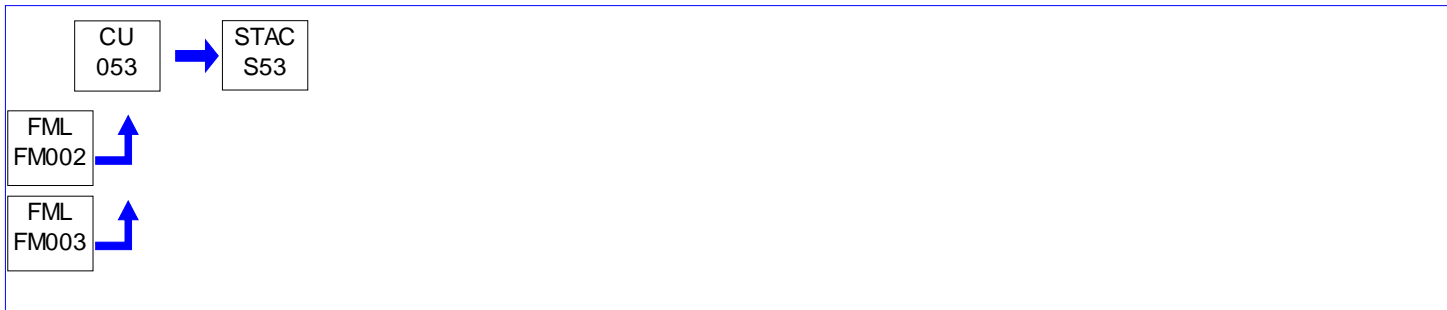

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 101

Source Name: EXISTING EMERGENCY IC ENGINES

Source Capacity/Throughput: 8.710 MMBTU/HR

Conditions for this source occur in the following groups: SG03



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 101A

Source Name: CI EMERGENCY IC ENGINES

Source Capacity/Throughput: 28.310 MMBTU/HR

Conditions for this source occur in the following groups: SG03
SG04

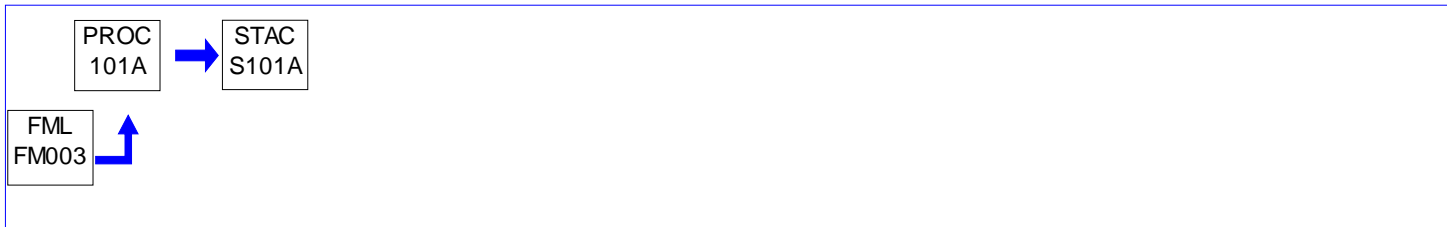

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 101B

Source Name: SI EMERGENCY IC ENGINES

Source Capacity/Throughput: 0.110 MMBTU/HR

Conditions for this source occur in the following groups: SG03
SG05



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 102

Source Name: THREE KILNS

Source Capacity/Throughput: 754.000 CF/HR NATURAL GAS

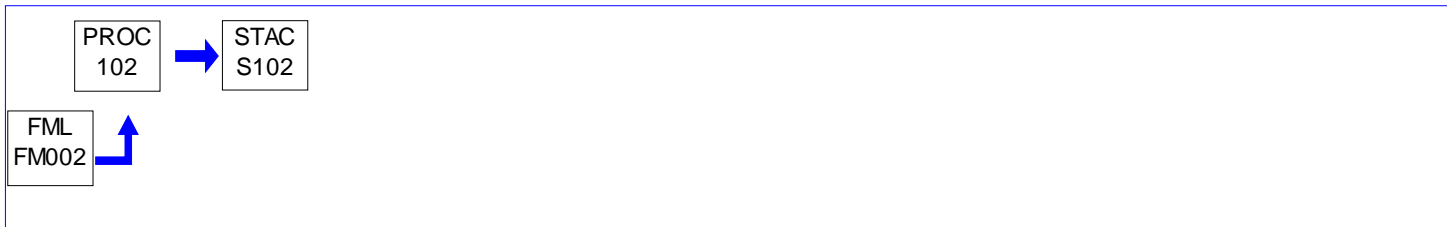

I. RESTRICTIONS.

Emission Restriction(s).

**# 001 [25 Pa. Code §123.13]
Processes**

The permittee shall not permit the emission to the atmosphere of particulate matter from the source in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

**# 002 [25 Pa. Code §123.21]
General**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

**# 003 [25 Pa. Code §127.441]
Operating permit terms and conditions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.91, RACT]

The permittee shall maintain a list of all of the sources in this source group. The list shall be updated quarterly and made available to the Department upon request. An updated list shall be submitted to the Department annually by March 1st. The permittee shall notify the Department of any new kilns that increase the potential emissions of NO_x by more than 1 TPY, except for units specifically exempted by 25 PA Code Section 127.14. Any new kiln subject to the Department's Chapter

**SECTION D. Source Level Requirements**

127 permitting conditions will be required to receive a Plan Approval before construction.

VI. WORK PRACTICE REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this condition is derived from 25 PA Code Section 129.93, RACT]

The permittee shall maintain and operate each kiln in accordance with the manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG01 MISC SOURCES

Group Description: Miscellaneous Natural Gas Fired Sources

Sources included in this group

| ID | Name |
|-----|----------------------------|
| 036 | DOMESTIC HOT WATER HEATERS |
| 037 | POOL HEATER |
| 040 | TWO GREENHOUSE HEATERS |
| 042 | BOILERS (NG-FIRED) |

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §123.11]

Combustion units

The permittee shall limit the emissions of particulate matter to 0.4 pounds per million BTU of heat input or less.

002 [25 Pa. Code §123.22]

Combustion units

No person may permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from any combustion unit, at any time, in excess of the rate of 4 pounds per million BTU of heat input over any one-hour period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this condition is derived from 25 PA Code Section 129.91, RACT]

The permittee shall maintain a list of all of the sources in this source group. The list shall be updated quarterly and made available to the Department upon request. An updated list shall be submitted to the Department annually by March 1st. The permittee shall notify the Department of any new sources that increase the potential emissions of NO_x by more than one TPY, except for sources specifically exempted by 25 PA Code Section 127.14. Any new sources subject to the Department's Chapter 127 permitting conditions will be required to receive a Plan Approval before construction.

VI. WORK PRACTICE REQUIREMENTS.

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

**SECTION E. Source Group Restrictions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.91, RACT]

The permittee shall maintain and operate each of the above sources in accordance with the manufacturer's specifications.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG02 BOILER HOUSE

Group Description: Boiler House

Sources included in this group

| ID | Name |
|-----|--------------------|
| 051 | BOILER 6 (BURNHAM) |
| 052 | BOILER 7 (BURNHAM) |
| 053 | BOILER 8 (BURNHAM) |

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.22]****Combustion units**

The permittee shall limit the sulfur content of the fuel oil fired in each boiler to 0.0015 percent by weight.

The permittee shall not purchase No. 2 fuel oil with a sulfur content greater than 15 ppm.

002 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

[Additional authority for this condition is derived from 40 CFR Section 60.43c, NSPS]

The permittee shall limit the emissions from the boilers to the following levels:

- a. Particulate - 0.03 pounds per million BTU (13 ng/J)
- b. NO_x - 30 ppmv (when firing natural gas)
- c. NO_x - 90 ppmv (when firing No. 2 fuel oil)
- d. CO- 50 ppmv

Note: The particulate emission limit does not apply during periods of start-up, shutdown or malfunction.

Fuel Restriction(s).**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee is permitted to operate the boilers on only natural gas and No. 2 fuel oil.

Control Device Efficiency Restriction(s).**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain each boiler with a Low NO_x Burner and a flue gas recirculation (FGR) system.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****III. MONITORING REQUIREMENTS.****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 40 CFR Section 60.42c, NSPS]

The permittee shall sample each shipment of fuel oil before use in either of the boilers. As an alternative, the permittee shall obtain annually a certification for each oil supplier as to the sulfur content and the heating value in BTUs of the oil as delivered and a delivery receipt with each delivery.

IV. RECORDKEEPING REQUIREMENTS.**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 40 CFR Sections 60.42c and 60.48c, NSPS]

The annual certification shall contain the following information: name of the supplier, sampling location, sample methods, frequency of sampling and sulfur content. The delivery receipt shall list the supplier, the type of fuel oil, the sulfur content and the heating value in BTUs.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

[Additional authority for this condition is derived from 40 CFR Section 60.48c, NSPS]

The permittee shall maintain records of the amount of each fuel fired by each boiler on a monthly basis.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate each boiler as follows:

- a. Operate in such a manner as not to cause air pollution.
- b. Operate and maintain in a manner consistent with good operating and maintenance practices.
- c. Operate and maintain in accordance with the manufacturer's specifications and the applicable terms and conditions of this permit.

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall perform an annual adjustment and/or tune-up on each unit which shall include the following:

- a. Inspection, adjustment, cleaning or replacement of fuel-burning equipment, including the burners and moving parts necessary for proper operation as specified by the manufacturer.
- b. Inspection of the flame pattern or characteristics and adjustments necessary to minimize emissions of NO_x, and to the



SECTION E. Source Group Restrictions.

extent practicable minimize emissions of CO.

c. Inspection of the air-to-fuel ratio control system and adjustments necessary to ensure proper calibration and operation as specified by the manufacturer.

The permittee shall maintain a permanently bound logbook or other method approved by the Department. This log shall contain, at a minimum, the following information:

- a. The date of the tuning procedures,
- b. The name of the service company and technicians,
- c. The final operating rate or load,
- d. Any other information required by this permit.

**# 010 [25 Pa. Code §127.441]
Operating permit terms and conditions.**

The permittee shall limit the combined No. 2 fuel oil consumption by Boilers 6, 7 & 8 to a maximum of 2,571,930 gallons in any consecutive 12-month period.

The permittee requested this condition to be a synthetic minor facility.

**# 011 [25 Pa. Code §127.441]
Operating permit terms and conditions.**

To meet the definition of gas-fired boilers in 40 CFR 63.11237, each boiler shall burn gaseous fuels not combined with any solid fuels and burn liquid fuel only during periods of gas curtailment, gas supply interruption, startups, or periodic testing on liquid fuel. For each boiler, periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG03

Group Description: Emergency Engines

Sources included in this group

| ID | Name |
|------|-------------------------------|
| 101 | EXISTING EMERGENCY IC ENGINES |
| 101A | CI EMERGENCY IC ENGINES |
| 101B | SI EMERGENCY IC ENGINES |

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee shall not permit the emission to the atmosphere of particulate matter from the source in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]**General**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Operation Hours Restriction(s).**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.93, RACT]

The permittee shall not operate any of the emergency IC engines more than 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.91, RACT]

The permittee shall maintain an hour meter, or use another method approved by the Department, to measure and record the operating time of each emergency electrical generator.

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****V. REPORTING REQUIREMENTS.****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.91, RACT]

The permittee shall maintain a list of all the engines in these sources. The list shall be updated quarterly and made available to the Department upon request. An updated list shall be submitted to the Department annually by March 1st. The permittee shall notify the Department of any new engines that increase the potential emissions of NOx by more than 1 TPY, except for units specifically exempted by 25 PA Code Section 127.14. Any new engines subject to the Department's Chapter 127 permitting conditions will be required to receive a Plan Approval before construction.

VI. WORK PRACTICE REQUIREMENTS.**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this condition is derived from 25 PA Code Section 129.93, RACT]

The permittee shall maintain and operate each of the engines in accordance with the manufacturer's specifications.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The emergency generators shall only be used during electrical failures or to perform preventative maintenance. The emergency generator shall not be used to supplement the primary power supply to the facility.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



SECTION E. Source Group Restrictions.

Group Name: SG04

Group Description: 40 CFR 60 Subpart IIII

Sources included in this group

| ID | Name |
|------|-------------------------|
| 101A | CI EMERGENCY IC ENGINES |

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200] Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines Am I subject to this subpart?

§ 60.4200 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [NA - NOT AN ENGINE MANUFACTURER]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

- (i) Manufactured after April 1, 2006, and are not fire pump engines, or
- (ii) [NA - NOT FIRE PUMP ENGINES]

(3) [NA - NOT MODIFIED OR RECONSTRUCTED]

(4) The provisions of § 60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.



SECTION E. Source Group Restrictions.

(b) [NA - TEST CELL NOT INVOLVED]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) Stationary CI ICE may be eligible for exemption from the requirements of this subpart as described in 40 CFR part 1068, subpart C, except that owners and operators, as well as manufacturers, may be eligible to request an exemption for national security.

(e) [NA - NOT TEMPORARY REPLACEMENT UNITS]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 86 FR 34357, June 29, 2021]

40 CFR 60.4201

[NA - NOT AN ENGINE MANUFACTURER]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 81 FR 44219, July 7, 2016; 86 FR 34357, June 29, 2021]

40 CFR 60.4202

[NA - NOT AN ENGINE MANUFACTURER]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37968, June 28, 2011; 81 FR 44219, July 7, 2016; 86 FR 34358, June 29, 2021; 88 FR 4471, Jan. 24, 2023]

40 CFR 60.4203

[NA - NOT AN ENGINE MANUFACTURER]

40 CFR 60.4204

[NA - UNITS ARE EMERGENCY]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37968, June 28, 2011; 81 FR 44219, July 7, 2016; 86 FR 34358, June 29, 2021]

40 CFR 60.4205

§ 60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA - ENGINES 2007 MODEL YEAR OR LATER]

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in § 60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

60.4202 REQUIREMENTS

60.4202(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1)

**SECTION E. Source Group Restrictions.**

through (2) of this section.

60.4202(a)(1) [NA - UNIT(S) > 37 KW (50 HP)]

60.4202(a)(2) For engines with a maximum engine power greater than or equal to 37 KW (50 HP), the certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants beginning in model year 2007.

NOTE: THE UNITS ARE RATED AT 400 & 200 KW AND HAVE CERTIFICATES OF CONFORMITY.

TABLE 1 OF 89.112

FOR $130 \leq kW \leq 225$, TIER 3:

NMHC + NOX: 4.0 g/kW-hr

CO: 3.5 g/kW-hr

PM: 0.2 g/kW-hr

FOR $225 \leq kW \leq 450$, TIER 3:

NMHC + NOX: 4.0 g/kW-hr

CO: 3.5 g/kW-hr

PM: 0.2 g/kW-hr

FROM 89.113

(a) Exhaust opacity from compression-ignition nonroad engines for which this subpart is applicable must not exceed:

(1) 20 percent during the acceleration mode;

(2) 15 percent during the lugging mode; and

(3) 50 percent during the peaks in either the acceleration or lugging modes.

END OF 60.4202 REQUIREMENTS

(c) [NA – NOT FIRE PUMP ENGINES]

(d) [NA - UNITS < 30 L/CYL]

(e) [NA - DOES NOT CONDUCT PERFORMANCE TESTS IN USE]

(f) [NA - NOT MODIFIED OR RECONSTRUCTED]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 86 FR 34358, June 29, 2021]

40 CFR 60.4206

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in § 60.4204 and 60.4205 over the entire life of the engine.

[76 FR page 37969, June 28, 2011]

40 CFR 60.4207

§ 60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?

(a) [Reserved]

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 1090.305 for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

(c) [Reserved]

**SECTION E. Source Group Restrictions.**

(d) Beginning June 1, 2012, owners and operators of stationary CI ICE subject to this subpart with a displacement of greater than or equal to 30 liters per cylinder must use diesel fuel that meets a maximum per-gallon sulfur content of 1,000 parts per million (ppm).

(e) [NA - NO NATIONAL SECURITY EXEMPTION]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 85 FR 78463, Dec. 4, 2020]

40 CFR 60.4208

60.4208(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

60.4208(b) [NA - UNITS >25 HP]

60.4208(c)-(g) [NA - UNITS ARE EMERGENCY]

60.4208(h) [NA - IMPORTATION NOT RELEVANT IN THIS CASE]

60.4208(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[Amended at 76 FR page 37969, June 28, 2011]

40 CFR 60.4209

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in § 60.4211.

60.4209(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

60.4209(b) [NA - FILTER NOT INSTALLED OR REQUIRED]

[Amended at 76 FR page 37969, June 28, 2011]

40 CFR 60.4210

[NA - NOT AN ENGINE MANUFACTURER]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 81 FR 44219, July 7, 2016; 86 FR 34358, June 29, 2021]

40 CFR 60.4211

§ 60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

- (1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;
- (2) Change only those emission-related settings that are permitted by the manufacturer; and

**SECTION E. Source Group Restrictions.**

(3) Meet the requirements of 40 CFR part 1068, as they apply to you.

(b) [NA - ENGINES ARE 2007 MODEL YEAR OR LATER]

(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in § 60.4204(b) or § 60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in § 60.4205(c), you must comply by purchasing an engine certified to the emission standards in § 60.4204(b), or § 60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

(d) [NA - NOT SUBJECT TO § 60.4204(c) OR § 60.4205(d)]

(e) [NA - NOT MODIFIED OR RECONSTRUCTED]

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii)–(iii) [Reserved]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

(ii) [Reserved]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

**SECTION E. Source Group Restrictions.**

(1) [NA - ENGINES >100 HP]

(2) If you are an owner or operator of a stationary CI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer.

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

40 CFR 60.4212

[NA - TESTING NOT REQUIRED FOR CERTIFIED UNITS WHICH ARE NOT ALTERED PER 60.4211(g)]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37971, June 28, 2011; 86 FR 34359, June 29, 2021]

40 CFR 60.4213

[NA - DISPLACEMENT <30 L/CYL]

40 CFR 60.4214

§ 60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA - UNITS ARE EMERGENCY]

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

(c) If the stationary CI internal combustion engine is equipped with a diesel particulate filter, the owner or operator must keep records of any corrective action taken after the backpressure monitor has notified the owner or operator that the high backpressure limit of the engine is approached.

(d) If you own or operate an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates for the purpose specified in § 60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (d)(1) through (3) of this section.

**SECTION E. Source Group Restrictions.**

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v)-(vi) [Reserved]

(vii) Hours spent for operation for the purposes specified in § 60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in § 60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov>). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in § 60.4. Beginning on February 26, 2025, submit annual report electronically according to paragraph (g) of this section.

(e) Owners or operators of stationary CI ICE equipped with AECDs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECDs as required by 40 CFR 1039.665(e).

(f) Beginning on February 26, 2025, within 60 days after the date of completing each performance test required by this subpart, you must submit the results of the performance test required under this section following the procedures specified in paragraphs (f)(1) and (2) of this section.

(1) Data collected using test methods supported by the EPA's Electronic Reporting Tool (ERT) as listed on the EPA's ERT website (<https://www.epa.gov/electronic-reporting-air-emissions/electronic-reporting-tool-ert>) at the time of the test. Submit the results of the performance test to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), according to paragraph (g) of this section. The data must be submitted in a file format generated using the EPA's ERT. Alternatively, you may submit an electronic file consistent with the extensible markup language (XML) schema listed on the EPA's ERT website.

(2) Data collected using test methods that are not supported by the EPA's ERT as listed on the EPA's ERT website at the time of the test. The results of the performance test must be included as an attachment in the ERT or an alternate electronic file consistent with the XML schema listed on the EPA's ERT website. Submit the ERT generated package or alternative file to the EPA via CEDRI according to paragraph (g) of this section.

(g) If you are required to submit notifications or reports following the procedure specified in this paragraph (g), you must submit notifications or reports to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov>). The EPA will make all the information submitted through CEDRI available to the public without further notice to you. Do not use CEDRI to submit information you claim as CBI. Although we do not expect persons to assert a claim of CBI, if you wish to assert a CBI claim for some of the information in the report or notification, you must submit a complete file in the format specified in this subpart, including information claimed to be CBI, to the EPA following the procedures in paragraphs (g)(1) and (2) of this section. Clearly mark the part or all of the information that you claim to be CBI. Information not marked as CBI may be authorized for public release without prior notice. Information marked as CBI will not be disclosed except in accordance with procedures set forth in 40 CFR part 2. All CBI claims must be asserted at the time of submission. Anything submitted using CEDRI cannot later be claimed CBI. Furthermore, under CAA section 114(c), emissions data is not entitled to confidential treatment, and the EPA is required to make emissions data available to the public. Thus, emissions data will not be protected as CBI and will be made publicly available. You must submit the same file submitted to the CBI office with the CBI omitted to the EPA via the EPA's CDX as described earlier in this paragraph (g).

(1) The preferred method to receive CBI is for it to be transmitted electronically using email attachments, File Transfer Protocol, or other online file sharing services. Electronic submissions must be transmitted directly to the OAQPS CBI Office at the email address oaqpscbi@epa.gov, and as described in paragraph (g) of this section, should include clear CBI markings. ERT files should be flagged to the attention of the Group Leader, Measurement Policy Group; all other files

**SECTION E. Source Group Restrictions.**

should be flagged to the attention of the Stationary Compression Ignition Internal Combustion Engine Sector Lead. If assistance is needed with submitting large electronic files that exceed the file size limit for email attachments, and if you do not have your own file sharing service, please email oaqpscbi@epa.gov to request a file transfer link.

(2) If you cannot transmit the file electronically, you may send CBI information through the postal service to the following address: OAQPS Document Control Officer (C404-02), OAQPS, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, P.O. Box 12055, Research Triangle Park, North Carolina 27711. ERT files should be sent to the attention of the Group Leader, Measurement Policy Group, and all other files should be sent to the attention of the Stationary Compression Ignition Internal Combustion Engine Sector Lead. The mailed CBI material should be double wrapped and clearly marked. Any CBI markings should not show through the outer envelope.

(h) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to timely comply with that reporting requirement. To assert a claim of EPA system outage, you must meet the requirements outlined in paragraphs (h)(1) through (7) of this section.

(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

(2) The outage must have occurred within the period of time beginning five business days prior to the date that the submission is due.

(3) The outage may be planned or unplanned.

(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(5) You must provide to the Administrator a written description identifying:

- (i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;
- (ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;
- (iii) A description of measures taken or to be taken to minimize the delay in reporting; and
- (iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

(i) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to timely comply with that reporting requirement. To assert a claim of force majeure, you must meet the requirements outlined in paragraphs (i)(1) through (5) of this section.

(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning five business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(3) You must provide to the Administrator:

- (i) A written description of the force majeure event;
- (ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;
- (iii) A description of measures taken or to be taken to minimize the delay in reporting; and

**SECTION E. Source Group Restrictions.**

(iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

(j) Any records required to be maintained by this subpart that are submitted electronically via the EPA's CEDRI may be maintained in electronic format. This ability to maintain electronic copies does not affect the requirement for facilities to make records, data, and reports available upon request to a delegated air agency or the EPA as part of an on-site compliance evaluation.

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 87 FR 48606, Aug. 10, 2022; 89 FR 70512, Aug. 30, 2024]

40 CFR 60.4218

§ 60.4218 What General Provisions and confidential information provisions apply to me?

(a) Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

40 CFR 60.4218

§ 60.4218 What General Provisions and confidential information provisions apply to me?

(a) Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart IIII shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA.

The EPA copies shall be forwarded to:

Associate Director
United States Environmental Protection Agency
Region III, Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through:

<https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

**SECTION E. Source Group Restrictions.**

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



SECTION E. Source Group Restrictions.

Group Name: SG05

Group Description: 40 CFR 60 Subpart JJJJ

Sources included in this group

| ID | Name |
|------|-------------------------|
| 101B | SI EMERGENCY IC ENGINES |

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4230]
 Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
 Am I subject to this subpart?**

§ 60.4230 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary spark ignition (SI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (6) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(a)(1) [NA - NOT AN ENGINE MANUFACTURER]

(a)(2) [NA - NOT AN ENGINE MANUFACTURER]

(a)(3) [NA - NOT AN ENGINE MANUFACTURER]

(a)(4) Owners and operators of stationary SI ICE that commence construction after June 12, 2006, where the stationary SI ICE are manufactured:

(a)(4)(i) [NA - UNIT(S) < 500 HP]

(a)(4)(ii) [NA - UNIT(S) < 500 HP]

**SECTION E. Source Group Restrictions.**

(a)(4)(iii) on or after July 1, 2008, for engines with a maximum engine power less than 500 HP; or

(a)(4)(iv) on or after January 1, 2009, for emergency engines with a maximum engine power greater than 19 KW (25 HP).

(a)(5) [NA - ENGINES NOT MODIFIED OR RECONSTRUCTED]

(a)(6) The provisions of § 60.4236 of this subpart are applicable to all owners and operators of stationary SI ICE that commence construction after June 12, 2006.

(b) [NA - ENGINE TEST CELL NOT RELEVANT HERE]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart as applicable.

(d) [NA - UNIT(S) NOT GASOLINE-FUELED]

(e) [NA - NO NATIONAL SECURITY EXEMPTION]

(f) [NA - NOT TEMPORARY REPLACEMENT UNITS]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37972, June 28, 2011; 86 FR 34360, June 29, 2021]

Emission Standards for Owners and Operators

§ 60.4233 What emission standards must I meet if I am an owner or operator of a stationary SI internal combustion engine?

[NOTE: THIS SUBSECTION APPLIES TO OLD WATER TOWER ENGINE, 9.5 HP]

(a) Owners and operators of stationary SI ICE with a maximum engine power less than or equal to 19 KW (25 HP) manufactured on or after July 1, 2008, must comply with the emission standards in §60.4231(a) for their stationary SI ICE.

NOTE: Paragraph 60.4231(a) requires these engines to meet requirements for nonhandheld engines under 40 CFR 1054.

40 CFR 1054.105, TABLE 1 REQUIREMENTS:

Engine type: Emergency

Fuel: Propane

Maximum engine power: HP = 9.5

Class II (nonhandheld =>225 cc)

Manufacture date: 2012

Emission standards:

NOx + HC (g/kW-hr): 8.0

CO (g/kW-hr): 610

END OF 40 CFR 1054.105, TABLE 1 REQUIREMENTS

(b) [NA - UNIT(S) DO NOT BURN GASOLINE]

(c) [NA - LPG UNIT IS < 25 HP]

[NOTE: THIS SUBSECTION APPLIES TO DINING HALL ENGINE, 34 HP]

(d) Owners and operators of stationary SI ICE with a maximum engine power greater than 19 KW (25 HP) and less than 75 KW (100 HP) (except gasoline and rich burn engines that use LPG) must comply with the emission standards for field testing in 40 CFR 1048.101(c) for their non-emergency stationary SI ICE and with the emission standards in Table 1 to this

**SECTION E. Source Group Restrictions.**

subpart for their emergency stationary SI ICE. Owners and operators of stationary SI ICE with a maximum engine power greater than 19 KW (25 HP) and less than 75 KW (100 HP) manufactured prior to January 1, 2011, that were certified to the standards in Table 1 to this subpart applicable to engines with a maximum engine power greater than or equal to 100 HP and less than 500 HP, may optionally choose to meet those standards.

[EMISSION STANDARDS ARE LISTED ON CERTIFICATION SHEET FOR UNIT]

(e) [NA - UNIT(S) < 100 HP]

(f) [NA - UNIT(S) NOT MODIFIED OR RECONSTRUCTED]

(g) [NA - STATIONARY WELLHEAD GAS NOT USED]

(h) Owners and operators of stationary SI ICE that are required to meet standards that reference 40 CFR 1048.101 must, if testing their engines in use, meet the standards in that section applicable to field testing, except as indicated in paragraph (e) of this section.

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37973, June 28, 2011]

§ 60.4234 How long must I meet the emission standards if I am an owner or operator of a stationary SI internal combustion engine?

Owners and operators of stationary SI ICE must operate and maintain stationary SI ICE that achieve the emission standards as required in § 60.4233 over the entire life of the engine.

Other Requirements for Owners and Operators

§ 60.4235 [NA - UNIT(S) DO NOT BURN GASOLINE]

[73 FR 3591, Jan. 18, 2008, as amended at 85 FR 78463, Dec. 4, 2020]

§ 60.4236 What is the deadline for importing or installing stationary SI ICE produced in previous model years?

(a) After July 1, 2010, owners and operators may not install stationary SI ICE with a maximum engine power of less than 500 HP that do not meet the applicable requirements in § 60.4233.

(b) [NA - UNIT(S) < 500 HP]

(c) For emergency stationary SI ICE with a maximum engine power of greater than 19 KW (25 HP), owners and operators may not install engines that do not meet the applicable requirements in § 60.4233 after January 1, 2011.

(d) [NA - IMPORTATION NOT RELEVANT IN THIS CASE]

(e) The requirements of this section do not apply to owners and operators of stationary SI ICE that have been modified or reconstructed, and they do not apply to engines that were removed from one existing location and reinstalled at a new location.

§ 60.4237 What are the monitoring requirements if I am an owner or operator of an emergency stationary SI internal combustion engine?

(a) [NA - UNIT(S) < 500 HP]

(b) [NA - UNIT(S) < 130 HP]

(c) If you are an owner or operator of an emergency stationary SI internal combustion engine that is less than 130 HP, was built on or after July 1, 2008, and does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter upon startup of your emergency engine.

**SECTION E. Source Group Restrictions.**

Compliance Requirements for Owners and Operators

§ 60.4243 What are my compliance requirements if I am an owner or operator of a stationary SI internal combustion engine?

(a) [THIS SECTION APPLIES, AS REFERENCED BACK FROM 60.4243(b)(1)] If you are an owner or operator of a stationary SI internal combustion engine that is manufactured after July 1, 2008, and must comply with the emission standards specified in § 60.4233(a) through (c), you must comply by purchasing an engine certified to the emission standards in § 60.4231(a) through (c), as applicable, for the same engine class and maximum engine power. In addition, you must meet one of the requirements specified in (a)(1) and (2) of this section.

NOTE: SEE SECTION H FOR EPA CERTIFICATION INFORMATION FOR THESE TWO UNITS

(a)(1) If you operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, you must keep records of conducted maintenance to demonstrate compliance, but no performance testing is required if you are an owner or operator. You must also meet the requirements as specified in 40 CFR part 1068, subparts A through D, as they apply to you. If you adjust engine settings according to and consistent with the manufacturer's instructions, your stationary SI internal combustion engine will not be considered out of compliance.

(a)(2) If you do not operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, your engine will be considered a non-certified engine, and you must demonstrate compliance according to (a)(2)(i) through (iii) of this section, as appropriate.

(a)(2)(i) If you are an owner or operator of a stationary SI internal combustion engine less than 100 HP, you must keep a maintenance plan and records of conducted maintenance to demonstrate compliance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions, but no performance testing is required if you are an owner or operator.

(a)(2)(ii) [NA - UNIT(S) < 100 HP]

(a)(2)(iii) [NA - UNIT(S) < 500 HP]

(b) If you are an owner or operator of a stationary SI internal combustion engine and must comply with the emission standards specified in § 60.4233(d) or (e), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) and (2) of this section.

(b)(1) Purchasing an engine certified according to procedures specified in this subpart, for the same model year and demonstrating compliance according to one of the methods specified in paragraph (a) of this section.

(b)(2) [NA - CERTIFIED ENGINE(S) PURCHASED]

(c) [NA - UNIT(S) NOT MODIFIED OR RECONSTRUCTED]

(d) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (d)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (d)(1) through (3), is prohibited. If you do not operate the engine according to the requirements in paragraphs (d)(1) through (3), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(d)(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(d)(2) You may operate your emergency stationary ICE for the purpose specified in paragraph (d)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (d)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (d)(2).



SECTION E. Source Group Restrictions.

(d)(2)(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(d)(2)(ii)-(iii) [RESERVED]

(d)(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (d)(2) of this section. Except as provided in paragraph (d)(3)(i) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(d)(3)(i) [NA - THESE ENGINES ARE NOT USED TO SUPPLY POWER AS A PART OF A FINANCIAL ARRANGEMENT]

(d)(3)(ii) [Reserved]

(e) Owners and operators of stationary SI natural gas fired engines may operate their engines using propane for a maximum of 100 hours per year as an alternative fuel solely during emergency operations, but must keep records of such use. If propane is used for more than 100 hours per year in an engine that is not certified to the emission standards when using propane, the owners and operators are required to conduct a performance test to demonstrate compliance with the emission standards of § 60.4233.

(f) If you are an owner or operator of a stationary SI internal combustion engine that is less than or equal to 500 HP and you purchase a non-certified engine or you do not operate and maintain your certified stationary SI internal combustion engine and control device according to the manufacturer's written emission-related instructions, you are required to perform initial performance testing as indicated in this section, but you are not required to conduct subsequent performance testing unless the stationary engine undergoes rebuild, major repair or maintenance. Engine rebuilding means to overhaul an engine or to otherwise perform extensive service on the engine (or on a portion of the engine or engine system). For the purpose of this paragraph (f), perform extensive service means to disassemble the engine (or portion of the engine or engine system), inspect and/or replace many of the parts, and reassemble the engine (or portion of the engine or engine system) in such a manner that significantly increases the service life of the resultant engine.

(g) [NA - CATALYSTS NOT EMPLOYED]

(h) [NA - UNIT(S) < 500 HP]

(i) [NA - UNIT(S) NOT MODIFIED OR RECONSTRUCTED]

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37974, June 28, 2011; 78 FR 6697, Jan. 30, 2013; 86 FR 34362, June 29, 2021; 87 FR 48606, Aug. 10, 2022]

Testing Requirements for Owners and Operators

§ 60.4244 [NA– TESTING NOT REQUIRED FOR CERTIFIED UNITS WHICH ARE NOT ALTERED PER 60.4243(f)]

Notification, Reports, and Records for Owners and Operators

§ 60.4245 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?

Owners or operators of stationary SI ICE must meet the following notification, reporting and recordkeeping requirements.

(a) Owners and operators of all stationary SI ICE must keep records of the information in paragraphs (a)(1) through (4) of

**SECTION E. Source Group Restrictions.**

this section.

- (1) All notifications submitted to comply with this subpart and all documentation supporting any notification.
 - (2) Maintenance conducted on the engine.
 - (3) If the stationary SI internal combustion engine is a certified engine, documentation from the manufacturer that the engine is certified to meet the emission standards and information as required in 40 CFR parts 1048, 1054, and 1060, as applicable.
 - (4) If the stationary SI internal combustion engine is not a certified engine or is a certified engine operating in a non-certified manner and subject to § 60.4243(a)(2), documentation that the engine meets the emission standards.
- (b) For all stationary SI emergency ICE greater than or equal to 500 HP manufactured on or after July 1, 2010, that do not meet the standards applicable to non-emergency engines, the owner or operator of must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. For all stationary SI emergency ICE greater than or equal to 130 HP and less than 500 HP manufactured on or after July 1, 2011 that do not meet the standards applicable to non-emergency engines, the owner or operator of must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. For all stationary SI emergency ICE greater than 25 HP and less than 130 HP manufactured on or after July 1, 2008, that do not meet the standards applicable to non-emergency engines, the owner or operator of must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. The owner or operator must document how many hours are spent for emergency operation, including what classified the operation as emergency and how many hours are spent for non-emergency operation.
- (c) [NA - UNIT(S) < 500 HP]
- (d) [NA – TESTING NOT REQUIRED FOR CERTIFIED UNITS WHICH ARE NOT ALTERED PER 60.4243(f)]
- (e) [NA - UNIT(S) < 100 HP]
- (f) Beginning on February 26, 2025, within 60 days after the date of completing each performance test, you must submit the results following the procedures specified in paragraph (g) of this section. Data collected using test methods that are supported by the EPA's Electronic Reporting Tool (ERT) as listed on the EPA's ERT website (<https://www.epa.gov/electronic-reporting-air-emissions/electronic-reporting-tool-ert>) at the time of the test must be submitted in a file format generated using the EPA's ERT. Alternatively, you may submit an electronic file consistent with the extensible markup language (XML) schema listed on the EPA's ERT website. Data collected using test methods that are not supported by the EPA's ERT as listed on the EPA's ERT website at the time of the test must be included as an attachment in the ERT or an alternate electronic file.
- (g) If you are required to submit notifications or reports following the procedure specified in this paragraph (g), you must submit notifications or reports to the EPA via the Compliance and Emissions Data Reporting Interface (CEDRI), which can be accessed through the EPA's Central Data Exchange (CDX) (<https://cdx.epa.gov/>). The EPA will make all the information submitted through CEDRI available to the public without further notice to you. Do not use CEDRI to submit information you claim as CBI. Although we do not expect persons to assert a claim of CBI, if you wish to assert a CBI claim for some of the information in the report or notification, you must submit a complete file in the format specified in this subpart, including information claimed to be CBI, to the EPA following the procedures in paragraphs (g)(1) and (2) of this section. Clearly mark the part or all of the information that you claim to be CBI. Information not marked as CBI may be authorized for public release without prior notice. Information marked as CBI will not be disclosed except in accordance with procedures set forth in 40 CFR part 2. All CBI claims must be asserted at the time of submission. Anything submitted using CEDRI cannot later be claimed CBI. Furthermore, under CAA section 114(c), emissions data is not entitled to confidential treatment, and the EPA is required to make emissions data available to the public. Thus, emissions data will not be protected as CBI and will be made publicly available. You must submit the same file submitted to the CBI office with the CBI omitted to the EPA via the EPA's CDX as described earlier in this paragraph (g).
- (1) The preferred method to receive CBI is for it to be transmitted electronically using email attachments, File Transfer Protocol, or other online file sharing services. Electronic submissions must be transmitted directly to the OAQPS CBI Office at the email address oaqpscbi@epa.gov, and as described in paragraph (g) of this section, should include clear CBI

**SECTION E. Source Group Restrictions.**

markings. ERT files should be flagged to the attention of the Group Leader, Measurement Policy Group; all other files should be flagged to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. If assistance is needed with submitting large electronic files that exceed the file size limit for email attachments, and if you do not have your own file sharing service, please email oaqpscbi@epa.gov to request a file transfer link.

(2) If you cannot transmit the file electronically, you may send CBI information through the postal service to the following address: OAQPS Document Control Officer (C404-02), OAQPS, U.S. Environmental Protection Agency, 109 T.W. Alexander Drive, P.O. Box 12055, Research Triangle Park, North Carolina 27711. ERT files should be sent to the attention of the Group Leader, Measurement Policy Group, and all other files should be sent to the attention of the Stationary Spark Ignition Internal Combustion Engine Sector Lead. The mailed CBI material should be double wrapped and clearly marked. Any CBI markings should not show through the outer envelope.

(h) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of EPA system outage for failure to timely comply with that reporting requirement. To assert a claim of EPA system outage, you must meet the requirements outlined in paragraphs (h)(1) through (7) of this section.

(1) You must have been or will be precluded from accessing CEDRI and submitting a required report within the time prescribed due to an outage of either the EPA's CEDRI or CDX systems.

(2) The outage must have occurred within the period of time beginning five business days prior to the date that the submission is due.

(3) The outage may be planned or unplanned.

(4) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(5) You must provide to the Administrator a written description identifying:

- (i) The date(s) and time(s) when CDX or CEDRI was accessed and the system was unavailable;
- (ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to EPA system outage;
- (iii) A description of measures taken or to be taken to minimize the delay in reporting; and
- (iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(6) The decision to accept the claim of EPA system outage and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

(7) In any circumstance, the report must be submitted electronically as soon as possible after the outage is resolved.

(i) If you are required to electronically submit a report through CEDRI in the EPA's CDX, you may assert a claim of force majeure for failure to timely comply with that reporting requirement. To assert a claim of force majeure, you must meet the requirements outlined in paragraphs (i)(1) through (5) of this section.

(1) You may submit a claim if a force majeure event is about to occur, occurs, or has occurred or there are lingering effects from such an event within the period of time beginning five business days prior to the date the submission is due. For the purposes of this section, a force majeure event is defined as an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents you from complying with the requirement to submit a report electronically within the time period prescribed. Examples of such events are acts of nature (e.g., hurricanes, earthquakes, or floods), acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility (e.g., large scale power outage).

(2) You must submit notification to the Administrator in writing as soon as possible following the date you first knew, or through due diligence should have known, that the event may cause or has caused a delay in reporting.

(3) You must provide to the Administrator:

- (i) A written description of the force majeure event;
- (ii) A rationale for attributing the delay in reporting beyond the regulatory deadline to the force majeure event;

**SECTION E. Source Group Restrictions.**

- (iii) A description of measures taken or to be taken to minimize the delay in reporting; and
- (iv) The date by which you propose to report, or if you have already met the reporting requirement at the time of the notification, the date you reported.

(4) The decision to accept the claim of force majeure and allow an extension to the reporting deadline is solely within the discretion of the Administrator.

(5) In any circumstance, the reporting must occur as soon as possible after the force majeure event occurs.

(j) Any records required to be maintained by this subpart that are submitted electronically via the EPA's CEDRI may be maintained in electronic format. This ability to maintain electronic copies does not affect the requirement for facilities to make records, data, and reports available upon request to a delegated air agency or the EPA as part of an on-site compliance evaluation.

[73 FR 3591, Jan. 18, 2008, as amended at 73 FR 59177, Oct. 8, 2008; 78 FR 6697, Jan. 30, 2013; 81 FR 59809, Aug. 30, 2016; 86 FR 34362, June 29, 2021; 87 FR 48606, Aug. 10, 2022; 89 FR 70514, Aug. 30, 2024]

General Provisions

§ 60.4246 What parts of the General Provisions apply to me?

(a) Table 3 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart JJJJ shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA.

The EPA copies shall be forwarded to:

Associate Director
 United States Environmental Protection Agency
 Region III, Enforcement & Compliance Assurance Division
 Air, RCRA and Toxics Branch (3ED21)
 Four Penn Center
 1600 John F. Kennedy Boulevard
 Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through:

<https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



SECTION E. Source Group Restrictions.

Group Name: SG06

Group Description: 40 CFR 60 Subpart Dc

Sources included in this group

| ID | Name |
|-----|--------------------|
| 051 | BOILER 6 (BURNHAM) |
| 052 | BOILER 7 (BURNHAM) |
| 053 | BOILER 8 (BURNHAM) |

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c] Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units Applicability and delegation of authority.

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]

**SECTION E. Source Group Restrictions.**

(g) [NA – NOT SUBJECT TO NSPS BBBBB]

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

§ 60.42c Standard for sulfur dioxide (SO₂).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO₂ in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) [NA - UNIT(S) >30 MMBTU/HR]

(i) The SO₂ emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts coal, wood, or oil and has a heat input capacity of 8.7 MW (30 MMBtu/h) or greater shall cause to be discharged into the atmosphere from that affected facility any gases that exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity. Owners and operators of an affected facility that elect to install, calibrate, maintain, and operate a

**SECTION E. Source Group Restrictions.**

continuous emissions monitoring system (CEMS) for measuring PM emissions according to the requirements of this subpart and are subject to a federally enforceable PM limit of 0.030 lb/MMBtu or less are exempt from the opacity standard specified in this paragraph (c).

(d) The PM and opacity standards under this section apply at all times, except during periods of startup, shutdown, or malfunction.

(e)(1) On and after the date on which the initial performance test is completed or is required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels and has a heat input capacity of 8.7 MW (30 MMBtu/h) or greater shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 13 ng/J (0.030 lb/MMBtu) heat input, except as provided in paragraphs (e)(2), (e)(3), and (e)(4) of this section.

(e)(2) As an alternative to meeting the requirements of paragraph (e)(1) of this section, the owner or operator of an affected facility for which modification commenced after February 28, 2005, may elect to meet the requirements of this paragraph. On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commences modification after February 28, 2005 shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of both:

(e)(2)(i) 22 ng/J (0.051 lb/MMBtu) heat input derived from the combustion of coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels; and

(e)(2)(ii) 0.2 percent of the combustion concentration (99.8 percent reduction) when combusting coal, oil, wood, a mixture of these fuels, or a mixture of these fuels with any other fuels.

(e)(3) On and after the date on which the initial performance test is completed or is required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that commences modification after February 28, 2005, and that combusts over 30 percent wood (by heat input) on an annual basis and has a heat input capacity of 8.7 MW (30 MMBtu/h) or greater shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of 43 ng/J (0.10 lb/MMBtu) heat input.

(e)(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO₂ emissions is not subject to the PM limit in this section.

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [INITIAL PERFORMANCE TEST WERE CONDUCTED ON 12/21/10, 12/22/10, 12/23/10, 1/3/11 & 1/4/11]

(b) [NA - NOT SUBJECT TO § 60.43c(b)(2)]

**SECTION E. Source Group Restrictions.**

(c) [NA- CEMS NOT USED]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

(a) [FIRST SENTENCE OF THIS SUBSECTION IS NA, AND HAS BEEN OMITTED BECAUSE (f) APPLIES] The owner or operator of an affected facility subject to an opacity standard in § 60.43c(c) that is not required to use a COMS due to paragraphs (c), (d), (e), or (f) of this section that elects not to use a COMS shall conduct a performance test using Method 9 of appendix A-4 of this part and the procedures in § 60.11 to demonstrate compliance with the applicable limit in § 60.43c by April 29, 2011, within 45 days of stopping use of an existing COMS, or within 180 days after initial startup of the facility, whichever is later, and shall comply with either paragraphs (a)(1), (a)(2), or (a)(3) of this section. The observation period for Method 9 of appendix A-4 of this part performance tests may be reduced from 3 hours to 60 minutes if all 6-minute averages are less than 10 percent and all individual 15-second observations are less than or equal to 20 percent during the initial 60 minutes of observation.

(1) Except as provided in paragraph (a)(2) and (a)(3) of this section, the owner or operator shall conduct subsequent Method 9 of appendix A-4 of this part performance tests using the procedures in paragraph (a) of this section according to the applicable schedule in paragraphs (a)(1)(i) through (a)(1)(iv) of this section, as determined by the most recent Method 9 of appendix A-4 of this part performance test results.

(i) If no visible emissions are observed, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 12 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(ii) If visible emissions are observed but the maximum 6-minute average opacity is less than or equal to 5 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 6 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later;

(iii) If the maximum 6-minute average opacity is greater than 5 percent but less than or equal to 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 3 calendar months from the date that the most recent performance test was conducted or within 45 days of the next day that fuel with an opacity standard is combusted, whichever is later; or

(iv) If the maximum 6-minute average opacity is greater than 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 45 calendar days from the date that the most recent performance test was conducted.

(2) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 of this part performance tests, elect to perform subsequent monitoring using Method 22 of appendix A-7 of this part according to the procedures specified in paragraphs (a)(2)(i) and (ii) of this section.

**SECTION E. Source Group Restrictions.**

(i) The owner or operator shall conduct 10 minute observations (during normal operation) each operating day the affected facility fires fuel for which an opacity standard is applicable using Method 22 of appendix A-7 of this part and demonstrate that the sum of the occurrences of any visible emissions is not in excess of 5 percent of the observation period (i.e. , 30 seconds per 10 minute period). If the sum of the occurrence of any visible emissions is greater than 30 seconds during the initial 10 minute observation, immediately conduct a 30 minute observation. If the sum of the occurrence of visible emissions is greater than 5 percent of the observation period (i.e., 90 seconds per 30 minute period), the owner or operator shall either document and adjust the operation of the facility and demonstrate within 24 hours that the sum of the occurrence of visible emissions is equal to or less than 5 percent during a 30 minute observation (i.e., 90 seconds) or conduct a new Method 9 of appendix A-4 of this part performance test using the procedures in paragraph (a) of this section within 45 calendar days according to the requirements in § 60.45c(a)(8).

(ii) If no visible emissions are observed for 10 operating days during which an opacity standard is applicable, observations can be reduced to once every 7 operating days during which an opacity standard is applicable. If any visible emissions are observed, daily observations shall be resumed.

(3) [NA - DIGITAL OPACITY COMPLIANCE SYSTEM NOT USED]

(b) [NA – COMS NOT REQUIRED OR USED]

(c) Owners and operators of an affected facilities that burn only distillate oil that contains no more than 0.5 weight percent sulfur and/or liquid or gaseous fuels with potential sulfur dioxide emission rates of 26 ng/J (0.060 lb/MMBtu) heat input or less and that do not use a post-combustion technology to reduce SO₂ or PM emissions and that are subject to an opacity standard in § 60.43c(c) are not required to operate a COMS if they follow the applicable procedures in § 60.48c(f).

(d) [NA - PM CEMS NOT USED]

(e) [NA - DOES NOT MAINTAIN CO EMISSION RECORDS ON AN OPERATING DAY BASIS]

(f) An owner or operator of an affected facility that is subject to an opacity standard in § 60.43c(c) is not required to operate a COMS provided that the affected facility meets the conditions in either paragraphs (f)(1), (2), or (3) of this section.

(1) [NA - NO BAGHOUSE]

(2) [NA - NO ESP]

(3) The affected facility burns only gaseous fuels and/or fuel oils that contain no greater than 0.5 weight percent sulfur, and the owner or operator operates the unit according to a written site-specific monitoring plan approved by the permitting authority. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard. For testing performed as part of this site-specific monitoring plan, the permitting authority may require as an alternative to the notification and reporting requirements specified in §§ 60.8 and 60.11 that the owner or operator submit any deviations with the excess emissions report required under § 60.48c(c). [THE PERIODIC PLANT PERIPHERY INSPECTIONS REQUIRED IN SECTION C OF THIS PERMIT WILL SERVE AS THE SITE-SPECIFIC MONITORING PLAN]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO₂ emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) In addition to the applicable requirements in § 60.7, the owner or operator of an affected facility subject to the opacity limits in § 60.43c(c) shall submit excess emission reports for any excess emissions from the affected facility that occur during the reporting period and maintain records according to the requirements specified in paragraphs (c)(1) through (3) of

**SECTION E. Source Group Restrictions.**

this section, as applicable to the visible emissions monitoring method used.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (c)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

(iii) Copies of all visible emission observer opacity field data sheets;

(2) For each performance test conducted using Method 22 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (c)(2)(i) through (iv) of this section.

(i) Dates and time intervals of all visible emissions observation periods;

(ii) Name and affiliation for each visible emission observer participating in the performance test;

(iii) Copies of all visible emission observer opacity field data sheets; and

(iv) Documentation of any adjustments made and the time the adjustments were completed to the affected facility operation by the owner or operator to demonstrate compliance with the applicable monitoring requirements.

(3) For each digital opacity compliance system, the owner or operator shall maintain records and submit reports according to the requirements specified in the site-specific monitoring plan approved by the Administrator

(d) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

(1) Calendar dates covered in the reporting period.

(2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

**SECTION E. Source Group Restrictions.**

(4) For other fuels:

(i) The name of the supplier of the fuel;

(ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and

(iii) The method used to determine the potential sulfur emissions rate of the fuel.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the SO₂ standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO₂ standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]

**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Applicability and delegation of authority.**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. Copies of all requests, reports and other communications shall be forwarded to both the Department and the EPA.

The EPA copies shall be forwarded to:

Associate Director
United States Environmental Protection Agency
Region III, Enforcement & Compliance Assurance Division
Air, RCRA and Toxics Branch (3ED21)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

Unless otherwise approved by DEP, the DEP copies shall be reported through the Department's Greenport PUP system available through:

<https://greenport.pa.gov/ePermitPublicAccess/PublicSubmission/Home>

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.



SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

This State Only Permit Renewal supersedes operating permit 06-05151 issued February 13, 2020.

#001

In this permit renewal, Source ID 100 (Degreaser) was removed from the permit along with conditions from 25 PA Code 129.63. Additionally, the inventory of combustion sources at the university has been updated in Section H.

#002

The following activities do not require any emission restrictions, testing, monitoring, reporting, record keeping requirements or work practice standards.

- a. Various Bunsen Burners
- b. Laboratory facilities - Science and Arts Materials
- c. New Pole Barn Heater (Natural Gas less then 10 MMBTU)

#003

Comments for various sources in the permit:

- a. Domestic Hot Water Heaters (Source 036) - At the time of this renewal Kutztown operates 20 hot water heaters to supply domestic hot water to the various buildings on the campus. All of the heaters operate only on natural gas. Each heater is equipped with a stack of varying diameters and heights.
- b. Pool Heater (Source 037) - At the time of this renewal Kutztown operates one natural gas fired heater to supply heat to the indoor swimming pool. The heater operates on natural gas, the heater has a single vertical stack (2' diameter) with a 35' height and cap.
- c. Hot Water Heaters (Oil Fired) (Source 039) - At the time of this renewal Kutztown operates two hot water heaters that operate only on #2 fuel oil. The two 0.77 mmBtu/hr hot water heaters are for the North Water Tower. The two hot water heaters heat the stored water to 40 degrees to keep it from freezing. Heat is applied to a short circulating loop which heats the tank water via a flat plate heat exchanger. These hot water hot water heaters meet the definition in 40 CFR 63.11237 of a hot water heater (heat input capacity less than 1.6 mmBtu/hr). In accordance with 40 CFR 63.11195(f) these hot water heaters are not subject to 40 CFR 63 Subpart JJJJJ.
- d. Greenhouse Heaters (Source 040) - At the time of this renewal Kutztown operates two heaters for the campus greenhouse. The heaters fire natural gas to heat the greenhouse in the winter. Each heater has a horizontal stack (6" dia) with a 20' height and caps.
- e. Boilers (Natural Gas) (Source 042) - At the time of this renewal Kutztown operates 21 boilers that fire only natural gas. The boilers are used to supply building heat to various buildings throughout the campus. Each unit is located on a building roof and has no stack.
- f. Miscellaneous Combustion Units (Source 043) - At the time of this renewal Kutztown operates 19 natural gas fired space and water heaters venting within the buildings.
- g. Emergency IC Engines (Sources 101, 101A & 101B) - At the time of this renewal Kutztown operates 31 emergency generators throughout the campus to supply electric during periods of power failure. The units use diesel oil, propane or natural gas. Each unit has a single vertical stack with a cap.
- h. Kilns (Source 102) - At the time of this renewal Kutztown operates three natural gas fired kilns in the Art Department. Two kilns have a vertical stack (16" dia) with 25' height and cap. One kiln has a vertical stack (10" dia) with a 15' height and cap.

#004

All of the capacity/throughput values listed in Sections A and D are for informational purposes only and are not operating limits unless stated so in conditions in Section D or Section E.

#005

**SECTION H. Miscellaneous.****SOURCE 101 (EXISTING EMERGENCY IC ENGINES):**

In accordance with 40 CFR 63.6585(f) and 40 CFR 63.6590(a)(1)(iii), the following existing institutional emergency stationary RICE constructed prior to June 12, 2006, are not subject to 40 CFR 63 Subpart ZZZZ:

| Location | Fuel | Engine Mfr | BHP |
|-----------------------------|------|------------|------|
| Beekey Education Bldg | NG | Ford | 40 |
| deFrancesco Bldg | NG | Onan | 25 |
| Rickenbach Learning Center | NG | GM | 134 |
| McFarland Student Union | NG | Ford | 134 |
| Rohrbach Library | NG | GM | 47 |
| Lytle Hall | P | Onan | 10 |
| Academic Forum | D | MTU | 1495 |
| Grim Science Bldg | NG | Onan | 9.4 |
| Boehm Science Center | D | Cummins | 268 |
| Rothermel Hall | NG | Ford | 27 |
| Old Main | NG | Ford | 80 |
| Deatrick Hall | NG | Ford | 225 |
| Johnson Hall | NG | GM | 75 |
| Bonner Hall | NG | GM | 107 |
| University Place | NG | Onan | 20 |
| Keystone Hall | NG | Onan | 30 |
| Student Recreation Center | NG | GM | 168 |
| Facilities Maintenance Bldg | D | Cummins | 532 |

SOURCE 101A (CI EMERGENCY IC ENGINES):

In accordance with 40 CFR 63.6585(f), 40 CFR 63.6590(a)(2)(iii), 40 CFR 63.6590(a)(3)(iii) and 40 CFR 63.6590(c), the following compression ignition emergency stationary RICE constructed after June 12, 2006, are subject to 40 CFR 60 Subpart IIII:

| Location | Fuel | Engine Mfr | Mfr Date | BHP | EPA Tier | Certified Label? |
|---------------------------|------|----------------|----------|------|----------|---------------------------|
| Sharadin Arts Bldg | D | Detroit Diesel | 2007 | 685 | 3 | Yes - 2007 |
| Schaeffer Auditorium | D | John Deere | 2012 | 342 | 3 | Yes - 2012 |
| Stratton Admin Center - 1 | D | Caterpillar | 2012 | 713 | 4 | Yes - 2012 |
| Stratton Admin Center - 2 | D | Caterpillar | 2012 | 713 | 4 | Yes - 2012 |
| Beck Hall | D | John Deere | 2009 | 335 | 3 | Yes - 2009 |
| Lehigh Hall | D | John Deere | 2012 | 469 | 3 | Yes - 2012 |
| Dixon Hall | D | Detroit Diesel | 2008 | 685 | 3 | Yes - 2008 |
| Dining Hall | D | MTU | 2013 | 1193 | 2 | No - exempt |
| Heat Plant Generator | D | John Deere | 2006 | 536 | 1 | No - exempt except Tier 1 |
| Deatrick Hall | D | John Deere | 2017 | 284 | 3 | Yes - 2016 |
| Rothermel Hall | D | Caterpillar | 2018 | 172 | 4 | Yes - 2018 |

SOURCE 101B (SI EMERGENCY IC ENGINES):

In accordance with 40 CFR 63.6585(f) and 40 CFR 63.6590(a)(2)(iii) and 40 CFR 63.6590(c), the following spark ignition emergency stationary RICE constructed after June 12, 2006, are subject to 40 CFR 60 Subpart JJJJ:

| Location | Fuel | Engine Mfr | Mfr Date | BHP | EPA Certified? |
|-----------------|------|-----------------|----------|-----|------------------------|
| Dining Hall | NG | Power Solutions | 2013 | 34 | Yes |
| Old Water Tower | P | Generac | 2012 | 9.5 | Yes (per manufacturer) |
| DeFran Building | NG | Kohler | 2023 | 107 | Yes |

NOTE: BHP listed above is the BHP on the engine label if available. Otherwise BHP is based on maintenance records and purchase orders.



***** End of Report *****
