



**COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM**

STATE ONLY NATURAL MINOR OPERATING PERMIT

Issue Date:	November 20, 2023	Effective Date:	December 3, 2024
Revision Date:	December 3, 2024	Expiration Date:	October 31, 2028
Revision Type:	Amendment		

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 10-00331

Natural Minor

Federal Tax Id - Plant Code: 25-0965274-1

Owner Information

Name: BUTLER HEALTHCARE PROVIDERS

Mailing Address: 1 HOSPITAL WAY
BUTLER, PA 16001-4670

Plant Information

Plant: BUTLER MEMORIAL HOSP/BUTLER

Location: 10 Butler County 10001 Butler City

SIC Code: 8062 Services - General Medical And Surgical Hospitals

Responsible Official

Name: SCOTT KOSCHO

Title: V.P. , SUPPORT SERVICES

Phone: (724) 284 - 4207

Email: Scott.Koscho@independence.health

Permit Contact Person

Name: MATTHEW HOSS

Title: MAINTENANCE SUPERVISOR

Phone: (724) 284 - 4250

Email: matthew.hoss@independence.health

[Signature] _____

LORI L. MCNABB, NORTHWEST REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation of Sources
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous







**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput		Fuel/Material
031	BABCOCK AND WILCOX BOILER #1	19.400	MMBTU/HR	
		19,400.000	CF/HR	Natural Gas
		140.000	Gal/HR	#2 Oil
032	BABCOCK AND WILCOX BOILER #2	19.400	MMBTU/HR	
		19,400.000	CF/HR	Natural Gas
		140.000	Gal/HR	#2 Oil
033	UNILUX BOILER #1	9.000	MMBTU/HR	
		9,000.000	CF/HR	Natural Gas
		65.000	Gal/HR	#2 Oil
034	UNILUX BOILER #2	9.000	MMBTU/HR	
		9,000.000	CF/HR	Natural Gas
		65.000	Gal/HR	#2 Oil
035	UNILUX BOILER #3	5.400	MMBTU/HR	
		5,400.000	CF/HR	Natural Gas
		39.000	Gal/HR	#2 Oil
036	UNILUX BOILER #4	5.400	MMBTU/HR	
		5,400.000	CF/HR	Natural Gas
		39.000	Gal/HR	#2 Oil
GEN-1	TOWER GENERATOR 1 (1214 HP)	58.000	Gal/HR	#2 Oil
GEN-2	TOWER GENERATOR 2 (1214 HP)	58.000	Gal/HR	#2 Oil
GEN-3	T BUNKER GENERATOR (375 HP)	22.000	Gal/HR	#2 Oil
GEN-4	T PENTHOUSE GENERATOR (680 HP)	36.000	Gal/HR	#2 Oil
GEN-5	NORTH WING GENERATOR (896 HP)	47.000	Gal/HR	#2 Oil
GEN-6	MAIN WING GENERATOR (545 HP)	30.000	Gal/HR	#2 Oil
FML-1	NATURAL GAS PIPELINE			
FML-2	NO. 2 FUEL OIL TANKS (8)			
S001	STACK - BABCOCK AND WILCOX BOILERS #1 & #2			
S002	STACK - UNILUX BOILERS 1 & 2			
S03	STACK - UNILUX BOILERS 3 & 4			
S04	STACK - TOWER GERNERATORS 1 & 2 (GEN-1 & 2)			
S05	STACK - T BUNKER GENERATOR (GEN-3)			
S06	STACK - T PENTHOUSE GENERATOR (GEN-4)			
S07	STACK - NORTH WING GENERATOR (GEN-5)			
S08	STACK - MAIN WING GENERATOR (GEN-6)			

PERMIT MAPS









PERMIT MAPS





PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
- (1) For a synthetic minor facility, a fee equal to:
- (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
 - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
 - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

**SECTION B. General State Only Requirements**

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

**SECTION B. General State Only Requirements**

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11a]**Reactivation of Sources**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §121.7]****Prohibition of air pollution.**

No person may permit air pollution as that term is defined in the act.

002 [25 Pa. Code §123.1]**Prohibition of certain fugitive emissions**

(a) No person may permit the emission into the outdoor atmosphere of fugitive air contaminant from a source other than the following:

(1) Construction or demolition of buildings or structures.

(2) Grading, paving and maintenance of roads and streets.

(3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.

(4) Clearing of land.

(5) Stockpiling of materials.

(6) Open burning operations.

(7) Not Applicable

(8) Not Applicable

(9) Sources and classes of sources other than those identified above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:

(i) the emissions are of minor significance with respect to causing air pollution; and

(ii) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

003 [25 Pa. Code §123.2]**Fugitive particulate matter**

A person may not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in Condition #001 above, (relating to prohibition of certain fugitive emissions), if such emissions are visible at the point the emissions pass outside the person's property.

004 [25 Pa. Code §123.31]**Limitations**

A person may not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source, in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

005 [25 Pa. Code §123.41]**Limitations**

A person may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

(1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.

(2) Equal to or greater than 60% at any time.

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §123.42]****Exceptions**

The limitations of Condition #004 above,(relating to limitations), shall not apply to a visible emission in any of the following instances:

- (1) when the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) When the emission results from sources specified in 123.1(a)(1) -- (9) (relating to prohibition of certain fugitive emissions).
- (4) [Not Applicable]

007 [25 Pa. Code §129.14]**Open burning operations**

a) Outside of air basins. No person may permit the open burning of material in an area outside of air basins in a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.
- (2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.
- (3) The emissions interfere with the reasonable enjoyment of life or property.
- (4) The emissions cause damage to vegetation or property.
- (5) The emissions are or may be deleterious to human or animal health.

b) Exceptions: The requirements of subsections (a) do not apply where the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

[This permit does not constitute authorization to burn solid waste pursuant to Section 610(3) of the Solid Waste Management Act, 35 P.S. Section 6018.610(3), or any other provision of the Solid Waste Management Act.]

II. TESTING REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of any source(s) as necessary to verify emissions for purposes of determining malfunctions or compliance with any applicable requirements.



SECTION C. Site Level Requirements

III. MONITORING REQUIREMENTS.

009 [25 Pa. Code §123.43]

Measuring techniques

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

010 [25 Pa. Code §123.1]

Prohibition of certain fugitive emissions

(c) A person responsible for any source specified in Condition #001 shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

**SECTION D. Source Level Requirements**

Source ID: 031

Source Name: BABCOCK AND WILCOX BOILER #1

Source Capacity/Throughput: 19.400 MMBTU/HR


19,400.000 CF/HR

Natural Gas

140.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, > 10 MMBTU/HR

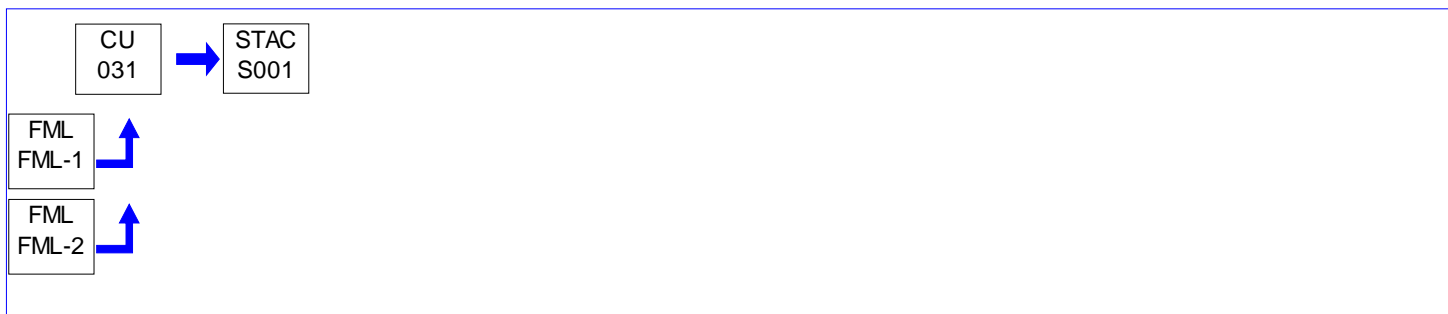**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 032

Source Name: BABCOCK AND WILCOX BOILER #2

Source Capacity/Throughput: 19.400 MMBTU/HR


19,400.000 CF/HR

Natural Gas

140.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, > 10 MMBTU/HR

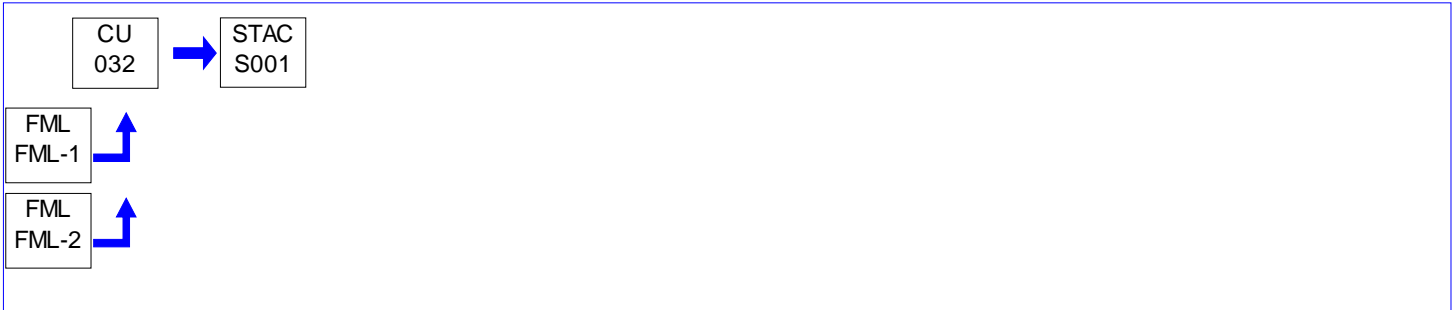**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 033

Source Name: UNILUX BOILER #1

Source Capacity/Throughput: 9.000 MMBTU/HR

9,000.000 CF/HR

Natural Gas

65.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, < 10 MMBTU/HR

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 034

Source Name: UNILUX BOILER #2

Source Capacity/Throughput: 9.000 MMBTU/HR


9,000.000 CF/HR

Natural Gas

65.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, < 10 MMBTU/HR

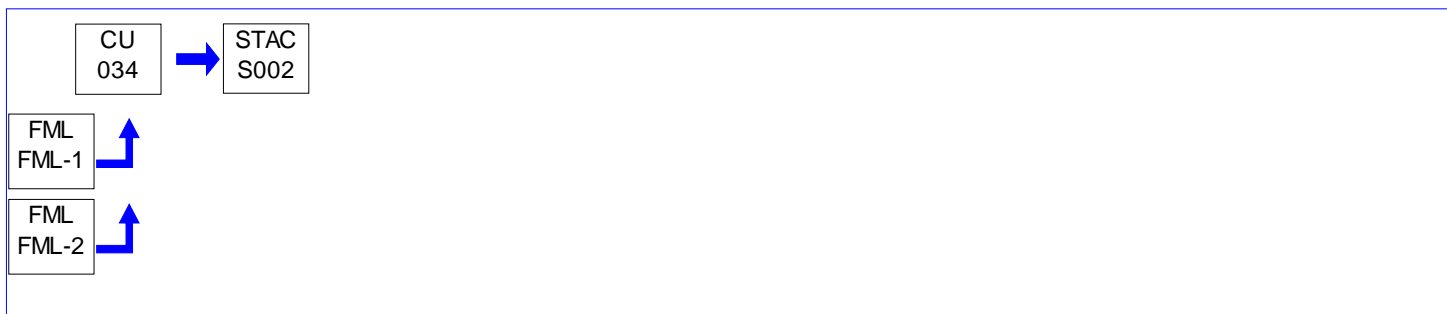**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 035

Source Name: UNILUX BOILER #3

Source Capacity/Throughput: 5.400 MMBTU/HR


5,400.000 CF/HR

Natural Gas

39.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, < 10 MMBTU/HR

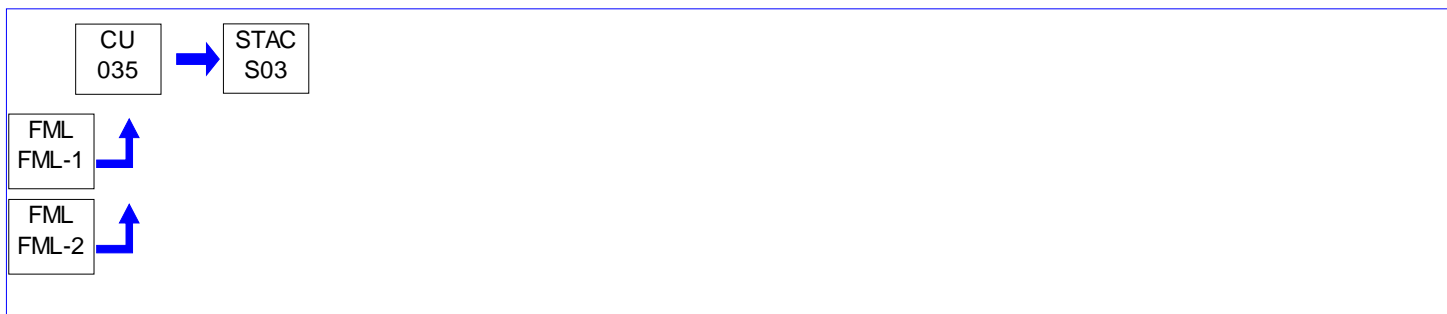**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 036

Source Name: UNILUX BOILER #4

Source Capacity/Throughput: 5.400 MMBTU/HR


5,400.000 CF/HR

Natural Gas

39.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: BOILERS, < 10 MMBTU/HR

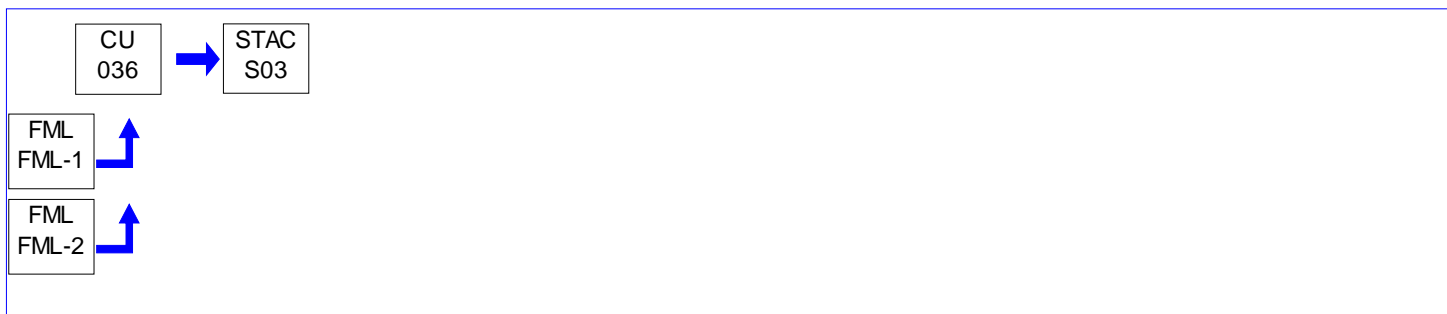**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: GEN-1

Source Name: TOWER GENERATOR 1 (1214 HP)

Source Capacity/Throughput: 58.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: GENERATORS - NEW ENGINES

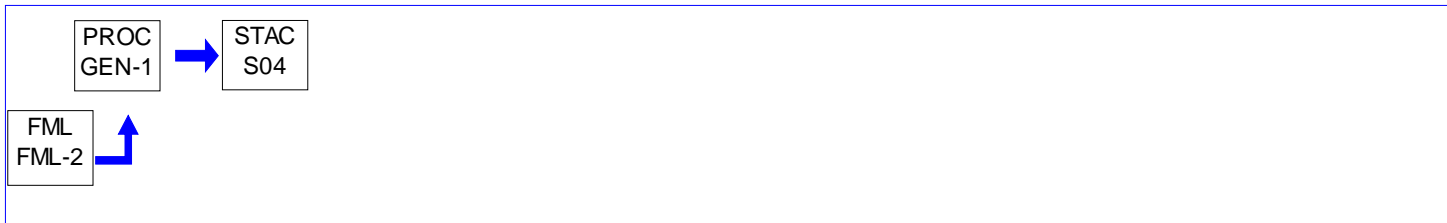**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: GEN-2

Source Name: TOWER GENERATOR 2 (1214 HP)

Source Capacity/Throughput:

58.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: GENERATORS - NEW ENGINES

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: GEN-3

Source Name: T BUNKER GENERATOR (375 HP)

Source Capacity/Throughput:

22.000 Gal/HR

#2 Oil

Conditions for this source occur in the following groups: GENERATORS - EXISTING ENGINES

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: GEN-4

Source Name: T PENTHOUSE GENERATOR (680 HP)

Source Capacity/Throughput: 36.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: GENERATORS - EXISTING ENGINES

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: GEN-5

Source Name: NORTH WING GENERATOR (896 HP)

Source Capacity/Throughput: 47.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: GENERATORS - EXISTING ENGINES

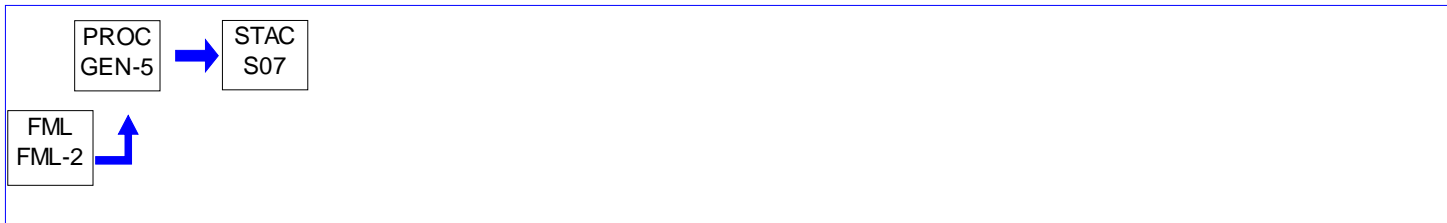**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: GEN-6

Source Name: MAIN WING GENERATOR (545 HP)

Source Capacity/Throughput: 30.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: GENERATORS - EXISTING ENGINES

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION E. Source Group Restrictions.**

Group Name: BOILERS, < 10 MMBTU/HR

Group Description: Boilers with ratings less than 10 mmbtu/hr

Sources included in this group

ID	Name
033	UNILUX BOILER #1
034	UNILUX BOILER #2
035	UNILUX BOILER #3
036	UNILUX BOILER #4

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

A person may not permit the emission into the outdoor atmosphere of particulate matter from this combustion unit at a rate in excess of 0.4 pound per million Btu of heat input.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(1) General provision. A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period, except as provided in paragraph (4).

(2) [See I. Restrictions, Fuel Restrictions for this source/source group.]

(3) - (4) [Not Applicable]

(b) - (e) [Not Applicable]

(f) [See VI. Additional Requirements for this source/source group. Added for informational purposes only.]

(g) [See IV. Recordkeeping Requirements for this source/source group.]

(h) [See V. Reporting Requirements for this source/source group.]

Fuel Restriction(s).**# 003 [25 Pa. Code §123.22]****Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(2) Commercial fuel oil.

(i) Except as specified in subparagraphs (ii) and (iii), a person may not offer for sale, deliver for use, exchange in trade or permit the use of commercial fuel oil in nonair basin areas if the commercial fuel oil contains sulfur in excess of the applicable maximum allowable sulfur content set forth in the following tables:

MAXIMUM ALLOWABLE SULFUR CONTENT Beginning September 1, 2020
Expressed as Parts per Million (ppm) by Weight or Percentage by Weight

No. 2 and lighter oil - 15 ppm (0.0015%)

(ii) [Not Applicable]

**SECTION E. Source Group Restrictions.**

(iii) The Department may temporarily suspend or increase the applicable maximum allowable sulfur content for a commercial fuel oil set forth in subparagraph (i) if the following occur:

(A) The Department receives a written request at the address specified in subsection (h) for a suspension or increase on the basis that compliant commercial fuel oil is not reasonably available in a nonair basin area. The request must include the following:

(I) The nonair basin county or counties for which the suspension or increase is requested.

(II) The reason compliant commercial fuel oil is not reasonably available.

(III) The duration of time for which the suspension or increase is requested and the justification for the requested duration.

(B) The Department determines that an insufficient quantity of compliant commercial fuel oil is reasonably available in the nonair basin area and that the circumstances leading to the insufficiency are due to events that could not have been reasonably foreseen or prevented and are not due to lack of prudent planning on the part of the transferor of the commercial fuel oil into or within the specified nonair basin area.

(C) The Department approves the request, in writing, prior to the transferor distributing the noncompliant commercial fuel oil into or within the specified nonair basin area.

(iv) The Department will limit a suspension or increase in the applicable maximum allowable sulfur content granted under subparagraph (iii) to the shortest duration in which adequate supplies of compliant commercial fuel oil can be made reasonably available, but in no case longer than 60 days from the date the Department grants the suspension or increase.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

To maintain its exemption from § 40 CFR 63 Subpart JJJJJJ as a gas-fired boiler, use of liquid fuels in this source is subject to the following restrictions.

(1) There is no time limit on the use of liquid fuels in this source in period of gas curtailment or gas supply interruptions.

(2) For purposes of periodic testing, maintenance, and operator training on liquid fuel, this source may be operated for a maximum of 48 hours per calendar year.

[For definitions for 'gas-fired boiler' and 'period of gas curtailment or gas supply interruptions' pursuant to § 40 CFR 63 Subpart JJJJJJ, see VII. Additional Requirements for this source/source group.]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §123.22]

Combustion units

(g) Recordkeeping and reporting.

(1) Beginning with the refinery owner or operator who sells or transfers commercial fuel oil into or within this

**SECTION E. Source Group Restrictions.**

Commonwealth for use in this Commonwealth and ending with the ultimate consumer, each time the physical custody of, or title to, a shipment of commercial fuel oil changes hands, the transferor shall provide to the transferee an electronic or paper record described in this paragraph. This record must legibly and conspicuously contain the following information:

- (i) The date of the sale or transfer.
- (ii) The name and address of the transferor.
- (iii) The name and address of the transferee.
- (iv) The volume of commercial fuel oil being sold or transferred.
- (v) The identification of the sulfur content of the shipment of commercial fuel oil, determined using the sampling and testing methods specified in subsection (f)(1), expressed as one of the following statements:

(A) For a shipment of No. 2 and lighter commercial fuel oil:

(I) Prior to September 1, 2020—"The sulfur content of this shipment is 500 ppm or below."

(II) On and after September 1, 2020—"The sulfur content of this shipment is 15 ppm or below."

(B) - (C) [Not Applicable]

(vi) The location of the commercial fuel oil at the time of transfer.

(vii) [Not Applicable]

(2) - (3) [Not Applicable]

(4) A person subject to this section shall do both of the following:

(i) Maintain the applicable records required under paragraphs (1)—(3) in electronic or paper format for 2 years unless a longer period is required under § 127.511(b)(2) (relating to monitoring and related recordkeeping and reporting requirements).

(ii) Provide an electronic or written copy of the applicable record to the Department upon request.

(5) The ultimate consumer shall maintain in electronic or paper format the record containing the information listed in paragraph (1), except in either of the following situations:

(i) - (ii) [Not Applicable]

V. REPORTING REQUIREMENTS.

006 [25 Pa. Code §123.22]

Combustion units

(h) Written request. The written request for suspension of or increase in the sulfur content limit on the basis that compliant commercial fuel oil is not reasonably available shall be addressed to the Department of Environmental Protection, Bureau of Air Quality, Chief of the Division of Compliance and Enforcement, P.O. Box 8468, Harrisburg, Pennsylvania 17105-8468.

VI. WORK PRACTICE REQUIREMENTS.

007 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall maintain and operate this source according to the manufacturer's specifications and in accordance with good air pollution control practices.

**SECTION E. Source Group Restrictions.****VII. ADDITIONAL REQUIREMENTS.****# 008 [25 Pa. Code §123.22]****Combustion units**

[As an ultimate consumer, the permittee is not subject to testing requirements pursuant to § 123.22(f). Cited in § 123.22(g)(1)(v), § 123.22(f) is incorporated into the permit for informational purposes only.]

(f) Sampling and testing.

(1) For the purpose of determining compliance with the requirements of this section, the actual sulfur content of commercial fuel oil shall be determined by one of the following:

(i) In accordance with the sample collection, test methods and procedures specified under § 139.16 (relating to sulfur in fuel oil).

(ii) Other methods developed or approved by the Department or the Administrator of the EPA, or both.

(2) - (3) [Not Applicable]

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

GAS-FIRED BOILER includes any boiler that burns gaseous fuels not combined with any solid fuels and burns liquid fuel only during periods of gas curtailment, gas supply interruption, startups, or for periodic testing, maintenance, or operator training on liquid fuel. Periodic testing, maintenance, or operator training on liquid fuel shall not exceed a combined total of 48 hours during any calendar year.

PERIOD OF GAS CURTAILMENT OR SUPPLY INTERRUPTION means a period of time during which the supply of gaseous fuel to an affected boiler is restricted or halted for reasons beyond the control of the facility. The act of entering into a contractual agreement with a supplier of natural gas established for curtailment purposes does not constitute a reason that is under the control of a facility for the purposes of this definition. An increase in the cost or unit price of natural gas due to normal market fluctuations not during periods of supplier delivery restriction does not constitute a period of natural gas curtailment or supply interruption. On-site gaseous fuel system emergencies or equipment failures qualify as periods of supply interruption when the emergency or failure is beyond the control of the facility.

[From § 40 CFR § 63.11237, as amended at 78 FR 7513, Feb. 1, 2013; 81 FR 61328, Sept. 14, 2016]

**SECTION E. Source Group Restrictions.**

Group Name: BOILERS, > 10 MMBTU/HR

Group Description: Boilers with ratings at least 10 mmbtu/hr

Sources included in this group

ID	Name
031	BABCOCK AND WILCOX BOILER #1
032	BABCOCK AND WILCOX BOILER #2

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.22]****Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(1) General provision. A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period, except as provided in paragraph (4).

(2) [See I. Restrictions, Fuel Restrictions for this source/source group.]

(3) - (4) [Not Applicable]

(b) - (e) [Not Applicable]

(f) [See VI. Additional Requirements for this source/source group. Added for informational purposes only.]

(g) [See IV. Recordkeeping Requirements for this source/source group.]

(h) [See V. Reporting Requirements for this source/source group.]

002 [25 Pa. Code §127.12b]**Plan approval terms and conditions.**

15. Combustion Units Constructed On or Before June 9, 1989

Any combustion unit operated under this Small Combustion Unit General Permit may not, at any time, result in the emission of:

a. Visible emissions in excess of the limitations specified in 25 Pa. Code §123.41 (relating to limitations) as follows:

i. Equal to or greater than 20% for a period or periods aggregating more than 3 minutes in any one hour.

ii. Equal to or greater than 60% at any time.

b. Particulate matter in excess of 0.4 pound per million Btu of heat input as specified in 25 Pa. Code §123.11 (relating to combustion units).

c. Sulfur oxides in excess of the limitations specified in 25 Pa. Code §123.22 (relating to combustion units) as follows:

i. [Compliance with 25 Pa. Code § 123.22, incorporated as Condition #003 for this source/source group, assures compliance with the 0.5% sulfur content limit of this condition.]

ii. & iii. [Do not apply]

[From GP-1, Condition #15]

**SECTION E. Source Group Restrictions.****Fuel Restriction(s).****# 003 [25 Pa. Code §123.22]****Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(2) Commercial fuel oil.

(i) Except as specified in subparagraphs (ii) and (iii), a person may not offer for sale, deliver for use, exchange in trade or permit the use of commercial fuel oil in nonair basin areas if the commercial fuel oil contains sulfur in excess of the applicable maximum allowable sulfur content set forth in the following tables:

MAXIMUM ALLOWABLE SULFUR CONTENT Beginning September 1, 2020
Expressed as Parts per Million (ppm) by Weight or Percentage by Weight

No. 2 and lighter oil - 15 ppm (0.0015%)

(ii) [Not Applicable]

(iii) The Department may temporarily suspend or increase the applicable maximum allowable sulfur content for a commercial fuel oil set forth in subparagraph (i) if the following occur:

(A) The Department receives a written request at the address specified in subsection (h) for a suspension or increase on the basis that compliant commercial fuel oil is not reasonably available in a nonair basin area. The request must include the following:

(I) The nonair basin county or counties for which the suspension or increase is requested.

(II) The reason compliant commercial fuel oil is not reasonably available.

(III) The duration of time for which the suspension or increase is requested and the justification for the requested duration.

(B) The Department determines that an insufficient quantity of compliant commercial fuel oil is reasonably available in the nonair basin area and that the circumstances leading to the insufficiency are due to events that could not have been reasonably foreseen or prevented and are not due to lack of prudent planning on the part of the transferor of the commercial fuel oil into or within the specified nonair basin area.

(C) The Department approves the request, in writing, prior to the transferor distributing the noncompliant commercial fuel oil into or within the specified nonair basin area.

(iv) The Department will limit a suspension or increase in the applicable maximum allowable sulfur content granted under subparagraph (iii) to the shortest duration in which adequate supplies of compliant commercial fuel oil can be made reasonably available, but in no case longer than 60 days from the date the Department grants the suspension or increase.

Operation Hours Restriction(s).**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

To maintain its exemption from § 40 CFR 63 Subpart JJJJJJ as a gas-fired boiler, use of liquid fuels in this source is subject to the following restrictions.

(1) There is no time limit on the use of liquid fuels in this source in period of gas curtailment or gas supply interruptions.

(2) For purposes of periodic testing, maintenance, and operator training on liquid fuel, this source may be operated for a maximum of 48 hours per calendar year.

[For definitions for 'gas-fired boiler' and 'period of gas curtailment or gas supply interruptions' pursuant to § 40 CFR 63

**SECTION E. Source Group Restrictions.**

Subpart JJJJJJ, see VII. Additional Requirements for this source/source group.]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 005 [25 Pa. Code §123.22]****Combustion units**

(g) Recordkeeping and reporting.

(1) Beginning with the refinery owner or operator who sells or transfers commercial fuel oil into or within this Commonwealth for use in this Commonwealth and ending with the ultimate consumer, each time the physical custody of, or title to, a shipment of commercial fuel oil changes hands, the transferor shall provide to the transferee an electronic or paper record described in this paragraph. This record must legibly and conspicuously contain the following information:

(i) The date of the sale or transfer.

(ii) The name and address of the transferor.

(iii) The name and address of the transferee.

(iv) The volume of commercial fuel oil being sold or transferred.

(v) The identification of the sulfur content of the shipment of commercial fuel oil, determined using the sampling and testing methods specified in subsection (f)(1), expressed as one of the following statements:

(A) For a shipment of No. 2 and lighter commercial fuel oil:

(I) Prior to September 1, 2020—"The sulfur content of this shipment is 500 ppm or below."

(II) On and after September 1, 2020—"The sulfur content of this shipment is 15 ppm or below."

(B) - (C) [Not Applicable]

(vi) The location of the commercial fuel oil at the time of transfer.

(vii) [Not Applicable]

(2) - (3) [Not Applicable]

(4) A person subject to this section shall do both of the following:

(i) Maintain the applicable records required under paragraphs (1)—(3) in electronic or paper format for 2 years unless a longer period is required under § 127.511(b)(2) (relating to monitoring and related recordkeeping and reporting requirements).

(ii) Provide an electronic or written copy of the applicable record to the Department upon request.

**SECTION E. Source Group Restrictions.**

(5) The ultimate consumer shall maintain in electronic or paper format the record containing the information listed in paragraph (1), except in either of the following situations:

(i) - (ii) [Not Applicable]

V. REPORTING REQUIREMENTS.**# 006 [25 Pa. Code §123.22]****Combustion units**

(h) Written request. The written request for suspension of or increase in the sulfur content limit on the basis that compliant commercial fuel oil is not reasonably available shall be addressed to the Department of Environmental Protection, Bureau of Air Quality, Chief of the Division of Compliance and Enforcement, P.O. Box 8468, Harrisburg, Pennsylvania 17105-8468.

007 [25 Pa. Code §127.12b]**Plan approval terms and conditions.**

6. Notice Requirements

The permittee shall notify the Department in writing, within 24 hours of the discovery during a business day or by 5:00 pm on the first business day after a weekend or holiday, of any malfunction of the combustion unit which results in, or may result in, the emission of air contaminants in excess of the limitations specified in, or established pursuant to, any applicable rule or regulation contained in 25 Pa. Code, Subpart C, Article III (relating to air resources).

[From GP-1, Condition #6]

VI. WORK PRACTICE REQUIREMENTS.**# 008 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

4. Compliance

The combustion unit and any associated air cleaning devices shall be:

- a. Operated in such a manner as not to cause air pollution.
- b. Operated and maintained in a manner consistent with good operating and maintenance practices.
- c. Operated and maintained in accordance with the manufacturer's specifications and the applicable terms and conditions of this Small Combustion Unit General Permit.

[From GP-1, Condition #4]

VII. ADDITIONAL REQUIREMENTS.**# 009 [25 Pa. Code §123.22]****Combustion units**

[As an ultimate consumer, the permittee is not subject to testing requirements pursuant to § 123.22(f). Cited in § 123.22(g)(1)(v), § 123.22(f) is incorporated into the permit for informational purposes only.]

(f) Sampling and testing.

(1) For the purpose of determining compliance with the requirements of this section, the actual sulfur content of commercial fuel oil shall be determined by one of the following:

- (i) In accordance with the sample collection, test methods and procedures specified under § 139.16 (relating to sulfur in fuel oil).
- (ii) Other methods developed or approved by the Department or the Administrator of the EPA, or both.

(2) - (3) [Not Applicable]

**SECTION E. Source Group Restrictions.****# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

GAS-FIRED BOILER includes any boiler that burns gaseous fuels not combined with any solid fuels and burns liquid fuel only during periods of gas curtailment, gas supply interruption, startups, or for periodic testing, maintenance, or operator training on liquid fuel. Periodic testing, maintenance, or operator training on liquid fuel shall not exceed a combined total of 48 hours during any calendar year.

PERIOD OF GAS CURTAILMENT OR SUPPLY INTERRUPTION means a period of time during which the supply of gaseous fuel to an affected boiler is restricted or halted for reasons beyond the control of the facility. The act of entering into a contractual agreement with a supplier of natural gas established for curtailment purposes does not constitute a reason that is under the control of a facility for the purposes of this definition. An increase in the cost or unit price of natural gas due to normal market fluctuations not during periods of supplier delivery restriction does not constitute a period of natural gas curtailment or supply interruption. On-site gaseous fuel system emergencies or equipment failures qualify as periods of supply interruption when the emergency or failure is beyond the control of the facility.

[From § 40 CFR § 63.11237, as amended at 78 FR 7513, Feb. 1, 2013; 81 FR 61328, Sept. 14, 2016]

**SECTION E. Source Group Restrictions.**

Group Name: GENERATORS - EXISTING ENGINES

Group Description: CI engines installed before June 12, 2006

Sources included in this group

ID	Name
	GEN-3 T BUNKER GENERATOR (375 HP)
	GEN-4 T PENTHOUSE GENERATOR (680 HP)
	GEN-5 NORTH WING GENERATOR (896 HP)
	GEN-6 MAIN WING GENERATOR (545 HP)

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

No person may permit the emission into the outdoor atmosphere of particulate matter from this process in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

In order to demonstrate compliance with the SO_x emission limits, this source shall use only #2 fuel oil as a fuel source.

Operation Hours Restriction(s).

004 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6640]

Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?**

(a) - (e) [Not Applicable]

(f) If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4), is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4), the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

(2) You may operate your emergency stationary RICE for the purpose specified in paragraph (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

**SECTION E. Source Group Restrictions.**

(ii)–(iii) [Reserved]

(3) Emergency stationary RICE located at major sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. The 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to supply power to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) Prior to May 3, 2014, the 50 hours per year for non-emergency situations can be used for peak shaving or non-emergency demand response to generate income for a facility, or to otherwise supply power as part of a financial arrangement with another entity if the engine is operated as part of a peak shaving (load management program) with the local distribution system operator and the power is provided only to the facility itself or to support the local distribution system.

(ii) [Not applied to claim exemption from this subpart pursuant to § 63.6585(f)(3).]

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6704, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) The permittee shall maintain records of all hours of operation for each emergency generator at this facility. These records shall include the date, operating times, and the purpose of operation.

(b) The permittee shall calculate and record the NOx emissions from the emergency generators on an annual basis.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6585]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal**

**SECTION E. Source Group Restrictions.****Combustion Engines****Am I subject to this subpart?**

You are subject to this subpart if you own or operate a stationary RICE at a major or area source of HAP emissions, except if the stationary RICE is being tested at a stationary RICE test cell/stand.

(a) - (e) [Not applicable]

(f) The emergency stationary RICE listed in paragraphs (f)(1) through (3) of this section are not subject to this subpart. The stationary RICE must meet the definition of an emergency stationary RICE in § 63.6675, which includes operating according to the provisions specified in § 63.6640(f).

(1) - (2) [Not Applicable]

(3) Existing institutional emergency stationary RICE located at an area source of HAP emissions that do not operate for the purpose specified in § 63.6640(f)(4)(ii).

[69 FR 33506, June 15, 2004, as amended at 73 FR 3603, Jan. 18, 2008; 78 FR 6700, Jan. 30, 2013; 87 FR 48607, Aug. 10, 2022]

007 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6675]**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What definitions apply to this subpart?**

Terms used in this subpart are defined in the Clean Air Act (CAA); in 40 CFR 63.2, the General Provisions of this part; and in this section as follows:

EMERGENCY STATIONARY RICE means any stationary reciprocating internal combustion engine that meets all of the criteria in paragraphs (1) through (3) of this definition. All emergency stationary RICE must comply with the requirements specified in § 63.6640(f) in order to be considered emergency stationary RICE. If the engine does not comply with the requirements specified in § 63.6640(f), then it is not considered to be an emergency stationary RICE under this subpart.

(1) The stationary RICE is operated to provide electrical power or mechanical work during an emergency situation. Examples include stationary RICE used to produce power for critical networks or equipment (including power supplied to portions of a facility) when electric power from the local utility (or the normal power source, if the facility runs on its own power production) is interrupted, or stationary RICE used to pump water in the case of fire or flood, etc.

(2) The stationary RICE is operated under limited circumstances for situations not included in paragraph (1) of this definition, as specified in § 63.6640(f).

(3) The stationary RICE operates as part of a financial arrangement with another entity in situations not included in paragraph (1) of this definition only as allowed in § 63.6640(f)(4)(i) or (ii).

INSTITUTIONAL EMERGENCY STATIONARY RICE means an emergency stationary RICE used in institutional establishments such as medical centers, nursing homes, research centers, institutions of higher education, correctional facilities, elementary and secondary schools, libraries, religious establishments, police stations, and fire stations.

[For the rest of the terms used in this subpart, please refer to § 63.6675 under Title 40 - Protection of Environment in www.ecfr.gov.]

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3607, Jan. 18, 2008; 75 FR 9679, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 76 FR 12867, Mar. 9, 2011; 78 FR 6706, Jan. 30, 2013; 87 FR 48608, Aug. 10, 2022]

**SECTION E. Source Group Restrictions.**

Group Name: GENERATORS - NEW ENGINES

Group Description: CI engines installed on or after June 12, 2006

Sources included in this group

ID	Name
	GEN-1 TOWER GENERATOR 1 (1214 HP)
	GEN-2 TOWER GENERATOR 2 (1214 HP)

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from this process in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

002 [25 Pa. Code §123.21]**General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4205]**Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal cor**

(a) [Does not apply]

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in § 60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

[From § 60.4202(a)(2)]

(2) For engines with a rated power greater than or equal to 37 KW (50 HP), the Tier 2 or Tier 3 emission standards for new nonroad CI engines for the same rated power as described in 40 CFR part 1039, appendix I, for all pollutants and the smoke standards as specified in 40 CFR 1039.105 beginning in model year 2007.

[Appendix I to Part 1039]

The following standards, which EPA originally adopted under 40 CFR part 89, apply to nonroad compression-ignition engines produced before the model years specified in § 1039.1:

[Generators #1 and #2 have been certified under the Model Year 2006, Tier 2 imits.]

Pollutant	Limit (g/kW-hr)
NMHC + NO _x	6.4
CO	3.5
PM	0.20

[From § 1039.105]

Measure smoke as specified in § 1039.501(c). Smoke from your engines may not exceed the following standards:

(1) 20 percent during the acceleration mode.

(2) 15 percent during the lugging mode.

**SECTION E. Source Group Restrictions.**

(3) 50 percent during the peaks in either the acceleration or lugging modes.

(c) - (e) [Do not apply]

(f) Owners and operators of any modified or reconstructed emergency stationary CI ICE subject to this subpart must meet the emission standards applicable to the model year, maximum engine power, and displacement of the modified or reconstructed CI ICE that are specified in paragraphs (a) through (e) of this section.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 86 FR 34358, June 29, 2021]

004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4206]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§ 60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

Fuel Restriction(s).

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

In order to demonstrate compliance with the SOx emission limits, this source shall use only #2 fuel oil as a fuel source.

006 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4207]

Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines

What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to

(a) [Reserved]

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 1090.305 for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

[From 40 CFR 1090.305]

§ 1090.305 ULSD standards.

(a) Overview. Except as specified in § 1090.300(a), diesel fuel must meet the ULSD per-gallon standards of this section.

(b) Sulfur standard. Maximum sulfur content of 15 ppm.

(c) Cetane index or aromatic content. Diesel fuel must meet one of the following standards:

(1) Minimum cetane index of 40.

(2) Maximum aromatic content of 35 volume percent.

(c) [Reserved]

(d) - (e) [Do not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 85 FR 78463, Dec. 4, 2020]

**SECTION E. Source Group Restrictions.****Operation Hours Restriction(s).****# 007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]****Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for any combination of the purposes specified in paragraphs (f)(2)(i) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii) - (iii) [Reserved]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

(ii) [Reserved]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

**SECTION E. Source Group Restrictions.**

[Other paragraphs of § 60.4211 under VI. Work Practice Requirements for this source/source groups.]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

**# 008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4209]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?**

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in § 60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) [Does not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

IV. RECORDKEEPING REQUIREMENTS.

**# 009 [25 Pa. Code §127.441]
Operating permit terms and conditions.**

(a) The permittee shall maintain records of all hours of operation for each emergency generator at this facility. These records shall include the date, operating times, and the purpose of operation.

(b) The permittee shall calculate and record the NOx emissions from the emergency generators on an annual basis.

V. REPORTING REQUIREMENTS.

**# 010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4214]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) [Does not apply]

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification.

(c) [Does not apply]

(d) If you own or operate an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates for the purposes specified in § 60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (d)(1) through (3) of this section.

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

**SECTION E. Source Group Restrictions.**

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v) - (vi) [Reserved]

(vii) Hours spent for operation for the purposes specified in § 60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in § 60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in § 60.4.

(e) [Does not apply]

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 87 FR 48606, Aug. 10, 2022]

VI. WORK PRACTICE REQUIREMENTS.**# 011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]****Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR part 1068, as they apply to you.

(b) [Does not apply]

(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in § 60.4204(b) or § 60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in § 60.4205(c), you must comply by purchasing an engine certified to the emission standards in § 60.4204(b), or § 60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

(d) [Does not apply]

(e) If you are an owner or operator of a modified or reconstructed stationary CI internal combustion engine and must comply with the emission standards specified in § 60.4204(e) or § 60.4205(f), you must demonstrate compliance according to one of the methods specified in paragraphs (e)(1) or (2) of this section.

(1) Purchasing, or otherwise owning or operating, an engine certified to the emission standards in § 60.4204(e) or § 60.4205(f), as applicable.

(2) Conducting a performance test to demonstrate initial compliance with the emission standards according to the requirements specified in § 60.4212 or § 60.4213, as appropriate. The test must be conducted within 60 days after the engine commences operation after the modification or reconstruction.

**SECTION E. Source Group Restrictions.**

(f) [See I. Restrictions - Operation Hours Restriction(s) for this source/source group.]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) - (2) [Do not apply]

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) [Does not apply]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016; 86 FR 34359, June 29, 2021; 87 FR 48605, Aug. 10, 2022]

VII. ADDITIONAL REQUIREMENTS.**# 012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200]****Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****Am I subject to this subpart?**

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) Manufacturers of stationary CI ICE with a displacement of less than 30 liters per cylinder where the model year is:

(i) 2007 or later, for engines that are not fire pump engines;

(ii) [Not applicable]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

(i) Manufactured after April 1, 2006, and are not fire pump engines, or

(ii) [Not applicable]

(3) [Not applicable]

(4) The provisions of §60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

(b) - (d) [Not applicable]

(e) Owners and operators of facilities with CI ICE that are acting as temporary replacement units and that are located at a stationary source for less than 1 year and that have been properly certified as meeting the standards that would be applicable to such engine under the appropriate nonroad engine provisions, are not required to meet any other provisions under this subpart with regard to such engines.

**SECTION E. Source Group Restrictions.**

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011; 86 FR 34357, June 29, 2021]

**# 013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4208]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What is the deadline for importing or installing stationary CI ICE produced in the previous model year?**

(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

(b) After December 31, 2009, owners and operators may not install stationary CI ICE with a maximum engine power of less than 19 KW (25 HP) (excluding fire pump engines) that do not meet the applicable requirements for 2008 model year engines.

(c) After December 31, 2014, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 19 KW (25 HP) and less than 56 KW (75 HP) that do not meet the applicable requirements for 2013 model year non-emergency engines.

(d) After December 31, 2013, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 56 KW (75 HP) and less than 130 KW (175 HP) that do not meet the applicable requirements for 2012 model year non-emergency engines.

(e) After December 31, 2012, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 130 KW (175 HP), including those above 560 KW (750 HP), that do not meet the applicable requirements for 2011 model year non-emergency engines.

(f) After December 31, 2016, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power of greater than or equal to 560 KW (750 HP) that do not meet the applicable requirements for 2015 model year non-emergency engines.

(g) After December 31, 2018, owners and operators may not install non-emergency stationary CI ICE with a maximum engine power greater than or equal to 600 KW (804 HP) and less than 2,000 KW (2,680 HP) and a displacement of greater than or equal to 10 liters per cylinder and less than 30 liters per cylinder that do not meet the applicable requirements for 2017 model year non-emergency engines.

(h) In addition to the requirements specified in §§ 60.4201, 60.4202, 60.4204, and 60.4205, it is prohibited to import stationary CI ICE with a displacement of less than 30 liters per cylinder that do not meet the applicable requirements specified in paragraphs (a) through (g) of this section after the dates specified in paragraphs (a) through (g) of this section.

(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

**# 014 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4218]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What parts of the General Provisions apply to me?**

(a) Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

(b) The provisions of 40 CFR 1068.10 and 1068.11 apply for engine manufacturers. For others, the general confidential business information (CBI) provisions apply as described in 40 CFR part 2.

[88 FR 4471, Jan. 24, 2023]

**# 015 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4219]
Subpart III - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What definitions apply to this subpart?**

[Please refer to § 60.4219 under Title 40 - Protection of Environment in www.ecfr.gov for definitions related to § 60 Subpart



SECTION E. Source Group Restrictions.

III.]



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description		
031	BABCOCK AND WILCOX BOILER #1		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
032	BABCOCK AND WILCOX BOILER #2		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
033	UNILUX BOILER #1		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
034	UNILUX BOILER #2		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
035	UNILUX BOILER #3		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
036	UNILUX BOILER #4		
Emission Limit		Pollutant	
4.000	Lbs/MMBTU	Of heat input over any 1 hour period.	SOX
0.400	Lbs/MMBTU		TSP
GEN-1	TOWER GENERATOR 1 (1214 HP)		
Emission Limit		Pollutant	
500.000	PPMV		SOX
0.040	gr/DRY FT3		TSP
GEN-2	TOWER GENERATOR 2 (1214 HP)		
Emission Limit		Pollutant	
500.000	PPMV		SOX
0.040	gr/DRY FT3		TSP
GEN-3	T BUNKER GENERATOR (375 HP)		
Emission Limit		Pollutant	
500.000	PPMV		SOX
0.040	gr/DRY FT3		TSP

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description
GEN-4	T PENTHOUSE GENERATOR (680 HP)
Emission Limit	
500.000 PPMV	Pollutant SOX
0.040 gr/DRY FT3	TSP
GEN-5	NORTH WING GENERATOR (896 HP)
Emission Limit	
500.000 PPMV	Pollutant SOX
0.040 gr/DRY FT3	TSP
GEN-6	MAIN WING GENERATOR (545 HP)
Emission Limit	
500.000 PPMV	Pollutant SOX
0.040 gr/DRY FT3	TSP

Site Emission Restriction Summary

Emission Limit	Pollutant
----------------	-----------

**SECTION H. Miscellaneous.**

- (a) The Capacity/Throughput numbers listed in Section A, the Site Inventory List, and provided in Section D of this permit for individual sources are for informational purposes only and are not to be considered enforceable limits. Enforceable limits are listed in the Restriction section for the site in Section C and for each source in Section D (or for each source group in Section E). The emission limitations contained in Section G of this permit are also for informational purposes only and are not to be considered enforceable limits.
- (b) Below are the trivial/insignificant activities at this facility.
- (b.1) Eight (8) diesel horizontal storage tanks - Capacities ranging from 300 to 15,000 gallons. Insignificant activities/sources because no federal and state regulations apply.
- (c) Information on exemption (or non-exemption) of the permitted sources from plan approval requirements.
- (c.1) Sources 031 & 032. Not exempt from plan approval requirements. Initially permitted using a general permit (GP-1).
- (c.2) Sources 033, 034, 035, & 036. Each of this boiler was exempt from plan approval requirements pursuant to § 127.14(a)(3).
- (c.3) Sources GEN-1, GEN-2, GEN-3, GEN-4, GEN-5, GEN-6. These six (6) generators were exempt from plan approval pursuant to § 127.14(a)(8), Item #6 - i.e., internal combustion engines regardless of size, with combined NOx emissions less than 100 lbs/hr, 1000 lbs/day, 2.75 tons per ozone season and 6.6 tons per year on a 12-month rolling basis for all exempt engines at the site.
- (d) NOx emission factors for the generators (from 2012 Permit Application)
- (d.1) Source GEN-1: 13.74 lb/hr
- (d.2) Source GEN-2: 13.74 lb/hr
- (d.3) Source GEN-3: 8.10 lb/hr
- (d.4) Source GEN-4: 14.48 lb/hr
- (d.5) Source GEN-5: 10.53 lb/hr
- (d.6) Source GEN-6: 11.20 lb/hr
- (e) This permit was administratively amended on February 24, 2021 to incorporate the change of responsible official.
- (f) This permit was renewed on November 20, 2023.
- (g) This permit was administratively amended on December 3, 2024 to incorporate the change of responsible official.



***** End of Report *****
