



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM

STATE ONLY SYNTHETIC MINOR OPERATING PERMIT

Issue Date: September 18, 2025

Effective Date: September 25, 2025

Expiration Date: September 24, 2030

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 23-00103

Synthetic Minor

Federal Tax Id - Plant Code: 23-1352117-1

Owner Information

Name: ELWYN

Mailing Address: 111 ELWYN RD
ELWYN, PA 19063-4622

Plant Information

Plant: ELWYN/MIDDLETOWN TWP

Location: 23 Delaware County

23940 Middletown Township

SIC Code: 8361 Services - Residential Care

Responsible Official

Name: PETER M THOMAS

Title: CORPORATE FACILITY MGR

Phone: (610) 842 - 3609

Email: pete_thomas@elwyn.org

Permit Contact Person

Name: GLENN WILSON

Title: DIR OF BLDGS & GROUNDS

Phone: (610) 842 - 3608

Email: glenn.wilson@elwyn.org

[Signature] _____

JILLIAN A. GALLAGHER, SOUTHEAST REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation of Sources
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

E-II: Testing Requirements
E-III: Monitoring Requirements
E-IV: Recordkeeping Requirements
E-V: Reporting Requirements
E-VI: Work Practice Standards
E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

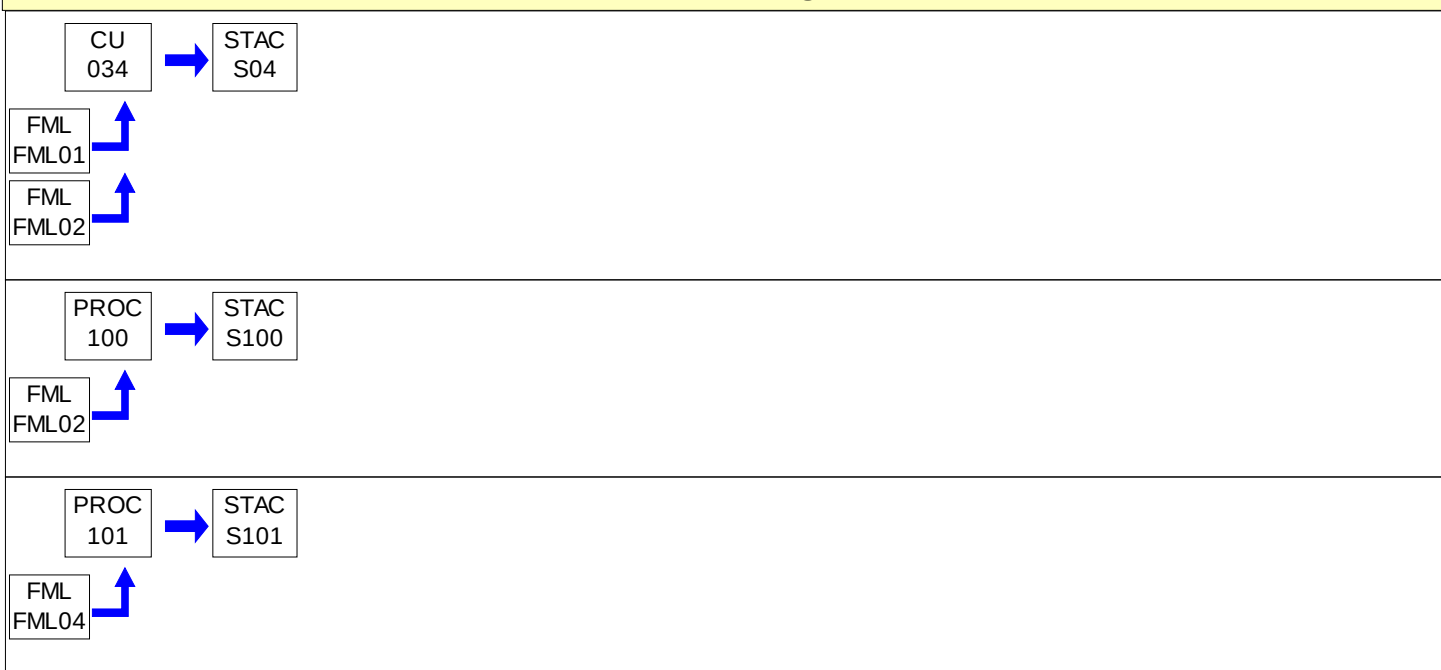
F-I: Restrictions
F-II: Testing Requirements
F-III: Monitoring Requirements
F-IV: Recordkeeping Requirements
F-V: Reporting Requirements
F-VI: Work Practice Standards
F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput		Fuel/Material
034	TWO (2) DUAL-FUEL (400 HP) CLEAVER BROOKS BOILERS	16.329	MMBTU/HR	
		0.020	MMCF/HR	Natural Gas
		118.000	Gal/HR	#2 Oil
100	EMERGENCY GENERATORS	28.000	Gal/HR	NO. 2 FUEL OIL
101	ALL EXEMPT EMERGENCY GENERATORS	N/A		NO 2 FUEL OIL
102	ENGINES SUBJECT TO 40 C.F.R. 60 SUBPART IIII			
FML01	NATURAL GAS			
FML02	#2 FUEL OIL TANK 1			
FML04	EXEMPT ER GEN FUEL TANKS			
S04	CLEAVER BROOK BOILER STACKS			
S100	STACK FOR EMERGENCY GENERATORS			
S101	STACKS FOR EXEMPT ER EGENS			

PERMIT MAPS

**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
 - (1) For a synthetic minor facility, a fee equal to:
 - (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
 - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
 - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

**SECTION B. General State Only Requirements**

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

**SECTION B. General State Only Requirements**

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11a]**Reactivation of Sources**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §121.7]****Prohibition of air pollution.**

The permittee shall not permit air pollution as that term is defined in the Air Pollution Control Act 35 P.S. (Section 4003).

002 [25 Pa. Code §123.1]**Prohibition of certain fugitive emissions**

(a) No person shall permit the emission into the outdoor atmosphere of fugitive air contaminant from a source other than the following:

(1) Construction or demolition of buildings or structures.

(2) Grading, paving and maintenance of roads and streets.

(3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.

(4) Clearing of land.

(5) Stockpiling of materials.

(6) Open burning operations.

(7) Blasting in open pit mines. Emissions from drilling are not considered as emissions from blasting.

(8) Coke oven batteries, provided the fugitive air contaminants emitted from any coke oven battery comply with the standards for visible fugitive emissions in § § 123.44 and 129.15 (relating to limitations of visible fugitive air contaminants from operation of any coke oven battery; and coke pushing operations).

(9) Sources and classes of sources other than those identified in paragraphs (1)-(8), for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:

(i) the emissions are of minor significance with respect to causing air pollution; and

(ii) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

003 [25 Pa. Code §123.2]**Fugitive particulate matter**

The permittee shall not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in 25 Pa Code §123.1(a) (related to prohibition of certain fugitive emissions), if such emissions are visible at the point the emissions pass outside the person's property.

004 [25 Pa. Code §123.31]**Limitations**

The permittee shall not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

005 [25 Pa. Code §123.41]**Limitations**

The permittee shall not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission in either of the following:

(a) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.

(b) Equal to or greater than 60% at any time.

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §123.42]****Exceptions**

The opacity limitations as per 25 Pa. Code § 123.41 shall not apply to a visible emission in any of the following instances:

- (a) When the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (b) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (c) When the emission results from the sources specified in 25 Pa. Code § 123.1(a)

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The total NO_x emissions for the facility shall be limited to less than 24.9 tons per year, calculated on a 12-month rolling sum.

008 [25 Pa. Code §129.14]**Open burning operations**

No person may permit the open burning of material in the Southeast Air Basin except where the open burning operations result from:

- (a) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (b) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (c) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (d) A fire set in conjunction with the production of agricultural commodities in their unmanufactured state on the premises of the farm operation.
- (e) A fire set for the purpose of burning domestic refuse, when the fire is on the premises of a structure occupied solely as a dwelling by two families or less and when the refuse results from the normal occupancy of the structure.
- (f) A fire set solely for recreational or ceremonial purposes.
- (g) A fire set solely for cooking food.

II. TESTING REQUIREMENTS.**# 009 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

- (a) If at any time the Department has cause to believe that air contaminant emissions from any source may be in excess of the limitations specified in this Permit, or established pursuant to, any applicable rule or regulation contained in 25 Pa. Code Article III, the permittee shall be required to conduct whatever tests are deemed necessary by the Department to determine the actual emission rate(s).
- (b) Such testing shall be conducted in accordance with the provisions of 25 Pa. Code Chapter 139, the most current version of the DEP Source Testing Manual, and the EPA Clean Air Act National Stack Testing Guidance, when applicable, and in accordance with any restrictions or limitations established by the Department at such time as it notifies the permittee that testing is required.

**SECTION C. Site Level Requirements****III. MONITORING REQUIREMENTS.****# 010 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions of 25 Pa. Code §123.41, shall be measured using either of the following:

- (a) A device approved by the Department and maintained to provide accurate opacity measurements.
- (b) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

[Additional authority for this permit condition is also derived from 25 Pa. Code § 127.511]

- (a) The permittee shall monitor the facility, once per operating day, for the following:
 - (1) odors which may be objectionable (as per 25 Pa. Code §123.31);
 - (2) visible emissions (as per 25 Pa. Code §§123.41 and 123.42); and
 - (3) fugitive particulate matter (as per 25 Pa. Code §§ 123.1 and 123.2).
- (b) Objectionable odors, fugitive particulate emissions, and visible emissions that are caused or may be caused by operations at the site shall:
 - (1) be investigated;
 - (2) be reported to the facility management, or individual(s) designated by the permittee;
 - (3) have appropriate corrective action taken (for emissions that originate on-site); and
 - (4) be recorded in a permanent written log.
- (c) After six (6) months of daily monitoring, and upon the permittee's request, the Department will determine the feasibility of decreasing the monitoring frequency to weekly for the next six month period.
- (d) After six (6) months of weekly monitoring, and upon the permittee's request, the Department will determine the feasibility of decreasing the frequency of monitoring to monthly.
- (e) The Department reserves the right to change the above monitoring requirements at any time, based on but not limited to: the review of the compliance certification, complaints, monitoring results, and/or Department findings.

012 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall calculate the total NO_x emissions for the entire facility monthly and on a 12-month rolling sum.

IV. RECORDKEEPING REQUIREMENTS.**# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep records of all monitoring of fugitive emissions, visible emissions and odors, including those that deviate from the conditions found in this permit. The record of deviations shall contain, at a minimum, the following items:

- (a) Date, time, and location of the incident(s).
- (b) The cause of the event.
- (c) The corrective action taken, if necessary to abate the situation and prevent future occurrences.

014 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall keep records of the total NO_x emissions for the entire facility monthly and on a 12-month rolling sum.

**SECTION C. Site Level Requirements****V. REPORTING REQUIREMENTS.****# 015 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

[Additional authority for this permit condition is also derived from 40 CFR Part 68.]

(a) If required by Section 112(r) of the Clean Air Act, the permittee shall develop and implement an accidental release [25 Pa. Code § 127.441(d) and 40 CFR Part 68] program consistent with requirements of the Clean Air Act, 40 CFR Part 68 (relating to chemical accident prevention provisions) and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act (P.L. 106-40).

(b) The permittee shall prepare and implement a Risk Management Plan (RMP) which meets the requirements of Section 112(r) of the Clean Air Act, 40 CFR Part 68 and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act when a regulated substance listed in 40 CFR § 68.130 is present in a process in more than the threshold quantity at a major facility. The permittee shall submit the RMP to the federal Environmental Protection Agency according to the following schedule and requirements:

- (1) The permittee shall submit the first RMP to a central point specified by EPA no later than the latest of the following:
 - (i) Three years after the date on which a regulated substance is first listed under 40 CFR § 68.130; or,
 - (ii) The date on which a regulated substance is first present above a threshold quantity in a process.
- (2) The permittee shall submit any additional relevant information requested by the Department or EPA concerning the RMP and shall make subsequent submissions of RMPs in accordance with 40 CFR § 68.190.
- (3) The permittee shall certify that the RMP is accurate and complete in accordance with the requirements of 40 CFR Part 68, including a checklist addressing the required elements of a complete RMP.

(c) As used in this permit condition, the term "process" shall be as defined in 40 CFR § 68.3. The term "process" means any activity involving a regulated substance including any use, storage, manufacturing, handling, or on-site movement of such substances or any combination of these activities. For purposes of this definition, any group of vessels that are interconnected, or separate vessels that are located such that a regulated substance could be involved in a potential release, shall be considered a single process.

- (d) If this facility is subject to 40 CFR Part 68, as part of the certification required under this permit, the permittee shall:
- (1) Submit a compliance schedule for satisfying the requirements of 40 CFR Part 68 by the date specified in 40 CFR § 68.10(a); or,
 - (2) Certify that this facility is in compliance with all requirements of 40 CFR Part 68 including the registration and submission of the RMP.

(e) If this facility is subject to 40 CFR Part 68, the permittee shall maintain records supporting the implementation of an accidental release program for five (5) years in accordance with 40 CFR § 68.200.

(f) When this facility is subject to the accidental release program requirements of Section 112(r) of the Clean Air Act and 40 CFR Part 68, appropriate enforcement action will be taken by the Department if:

- (1) The permittee fails to register and submit the RMP or a revised plan pursuant to 40 CFR Part 68.
- (2) The permittee fails to submit a compliance schedule or include a statement in an annual Compliance Certification submittal for the previous year indicating compliance with the requirements of the terms and conditions of this permit, and the requirements of Section 112(r) of the Clean Air Act and 40 CFR Part 68. The certification shall include:
 - (i) The identification of each term or condition of the permit that is the basis of the certification.
 - (ii) The compliance status.
 - (iii) The methods used for determining the compliance status of the source, currently and over the reporting period.
 - (iv) Whether compliance was continuous or intermittent.

(g) The compliance certification should be postmarked or hand-delivered within thirty days of each anniversary date of the date of issuance of this permit.

016 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

(a) The permittee shall report malfunctions, emergencies or incidents of excess emissions to DEP's 24-hour Emergency Hotline at 800.541.2050. A malfunction is any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. An emergency is any

**SECTION C. Site Level Requirements**

situation arising from sudden and reasonably unforeseeable events beyond the control of the owner or operator of a facility which requires immediate corrective action to restore normal operation and which causes the emission source to exceed emissions, due to unavoidable increases in emissions attributable to the situation. An emergency shall not include situations caused by improperly designed equipment, lack of preventive maintenance, careless or improper operation, or operator error.

(b) When the malfunction, emergency or incident of excess emissions poses an imminent danger to the public health, safety, welfare, or environment, it shall be reported to the Department and the County Emergency Management Agency by telephone within one (1) hour after the discovery of the malfunction, emergency or incident of excess emissions. The owner or operator shall submit a written or emailed report of instances of such malfunctions, emergencies or incidents of excess emissions to the Department within three (3) business days of the telephone report.

(c) The report shall describe the following:

- (1) Name, permit or authorization number, and location of the facility;
- (2) Nature and cause of the malfunction, emergency or incident;
- (3) Date and time when the malfunction, emergency or incident was first observed;
- (4) Expected duration of excess emissions;
- (5) Estimated rate of emissions; and
- (6) Corrective actions or preventative measures taken.

(d) Any malfunction, emergency or incident of excess emissions that is not subject to the notice requirements of paragraph (b) of this condition shall be reported to the Department by telephone within 24 hours (or by 4:00 PM of the next business day, whichever is later) of discovery and in writing or by e-mail within five (5) business days of discovery. The report shall contain the same information required by paragraph (c), and any permit specific malfunction reporting requirements.

(e) During an emergency an owner or operator may continue to operate the source at their discretion provided they submit justification for continued operation of a source during the emergency and follow all the notification and reporting requirements in accordance with paragraphs (b)-(d), as applicable, including any permit specific malfunction reporting requirements.

(f) Reports regarding malfunctions, emergencies or incidents of excess emissions shall be submitted to the appropriate DEP Regional Office Air Program Manager.

(g) Any emissions resulted from malfunction or emergency are to be reported in the annual emissions inventory report, if the annual emissions inventory report is required by permit or authorization.

017 [25 Pa. Code §135.3]**Reporting**

[Additional authority for this permit condition is also derived from 25 Pa. Code § 127.441.]

The permittee, who has been previously advised by the Department to submit a source report, shall submit by March 1, of each year, a source report for the preceding calendar year. The report shall include information from all previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported, including those sources listed in the Miscellaneous Section of this permit.

The permittee may request an extension of time from the Department for the filing of a source report, and the Department may grant the extension for reasonable cause.

VI. WORK PRACTICE REQUIREMENTS.**# 018 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

A person responsible for any source(s) specified in 25 Pa Code § 123.1(a) shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall include, but not be limited to, the following:

**SECTION C. Site Level Requirements**

(a) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.

(b) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.

(c) Paving and maintenance of roadways.

(d) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

019 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall immediately, upon discovery, implement measures, which may include the application for the installation of an air cleaning device(s), if necessary, to reduce the air contaminant emissions to within applicable limitations, if at any time the operation of the source(s) identified in Section A, of this permit, is causing the emission of air contaminants in excess of the limitations specified in, or established pursuant to, 25 Pa. Code Article III or any other applicable rule promulgated under the Clean Air Act.

020 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall not modify any air contaminant system identified in this permit, prior to obtaining Department approval, except those modifications authorized by Condition #013(g), of Section B, of this permit.

021 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall ensure that the source(s) and air pollution control device(s), listed in Section A and Section G, where applicable, of this permit, are operated and maintained in a manner consistent with good operating and maintenance practices, and in accordance with manufacturers specifications.

VII. ADDITIONAL REQUIREMENTS.**# 022 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Facility-wide emissions include emissions from the source(s) listed in this operating permit, all sources listed in Section A of the facility-wide operating permit No. 23-00103, as well as miscellaneous sources exempt from plan approval requirements which are listed in Section H of the facility-wide operating permit No. 23-00103.

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

**SECTION D. Source Level Requirements**

Source ID: 034

Source Name: TWO (2) DUAL-FUEL (400 HP) CLEAVER BROOKS BOILERS

Source Capacity/Throughput:

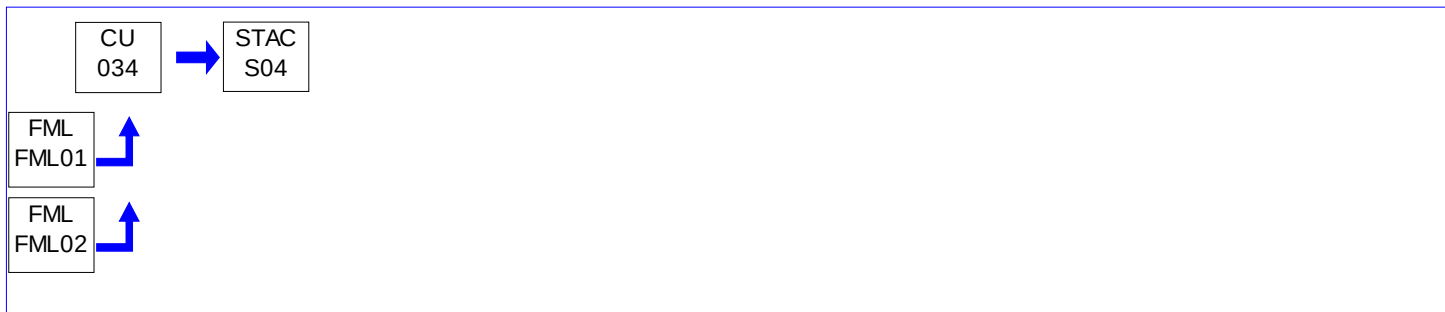
16.329 MMBTU/HR

0.020 MMBTU/HR

Natural Gas

118.000 Gal/HR

#2 Oil

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee shall not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of 0.4 pounds per million Btu of heat input, pursuant to 25 Pa. Code § 123.11(a)(1/2/3).

002 [25 Pa. Code §123.22]**Combustion units**

The permittee shall not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from any combustion unit, in the Southeast Air Basin, in excess of 1.0 pounds per million Btu of heat input, pursuant to 25 Pa. Code § 123.22(e)(1).

003 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall comply with the following concentration limits for this source, compliance shall be demonstrated during the stack testings:

- (a). 30 ppm_{dv} NO_x at 3% O₂ when firing gas;
- (b). 90 ppm_{dv} NO_x at 3% O₂ when firing No.2 fuel oil; and
- (c). 300 ppm_{dv} CO at 3% O₂.

Fuel Restriction(s).**# 004 [25 Pa. Code §123.22]****Combustion units**

(a) A person may not offer for sale, deliver for use, exchange in trade or permit the use of commercial fuel oil in a combustion unit in the Southeast Pennsylvania air basin if the commercial fuel oil contains sulfur in excess of [15 ppm or 0.0015% by weight for No. 2] by weight sulfur content, pursuant to 25 Pa. Code § 123.22(e)(2)(i), except as described in 25 Pa. Code § 123.22(e)(2)(ii) and (iii).

(b) Commercial fuel oil that was stored in the Commonwealth by the ultimate consumer

a. prior to September 1, 2020 which met the applicable maximum allowable sulfur content for commercial fuel oil through August 31, 2020 in subparagraph (a) at the time it was stored, may be used by the ultimate consumer in this Commonwealth on and after August 31, 2020.

(c) Only for Number 2 Fuel oil

[Compliance with this condition assures compliance with 40 C.F.R. § 60.42c(d).]

**SECTION D. Source Level Requirements****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

- (a) The permittee shall only use natural gas as the primary fuel for this boiler.
- (b). The permittee shall only burn No. 2 fuel oil during periods of gas curtailment, gas emergencies, or periodic testing of liquid fuel.
- (c). The permittee shall limit the burning of No. 2 fuel oil for periodic testing of liquid fuels to less than 48 hours during any calendar year.
- [Compliance with conditions (b) and (c) above, ensures that this source is considered a gas fired boiler for the purposes of 40 C.F.R. Part 63 Subpart JJJJJ]

II. TESTING REQUIREMENTS.**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

- (a) The permittee shall perform a stack test using Department-approved procedures once every five (5) calendar years, where five (5) calendar years is defined as beginning with the calendar year the latest stack test was performed and ending on December 31, five (5) years later. In accordance with 25 Pa. Code § 139.11(1), performance tests shall be conducted while the source is operating at maximum routine operating conditions or under such other conditions, within the capacity of the equipment, as may be requested by the Department. Refer to PADEP Source Testing Program website online for further information related to source testing including Source Testing FAQ and the PADEP Source Testing Manual.
- (b) The stack test shall, at a minimum, test for NO_x and CO concentration limits established for this Source ID. Tests shall be conducted in accordance with the provisions of [EPA Method/s] or other Department approved methodology and 25 Pa. Code Chapter 139. Tests shall also be conducted in accordance with the provisions of the current version of the DEP Source Testing Manual and the EPA Clean Air Act National Stack Testing Guidance.
- (c) At least ninety (90) days prior to the test, the permittee shall submit to the Department for approval the procedures for the test and a sketch with dimensions indicating the location of sampling ports and other data to ensure the collection of representative samples.
- (d) At least thirty (30) days prior to the test, the Regional Air Quality Manager, shall be informed of the date and time of the test. Keep in mind if the test is required as per MACT, then as per 40 CFR § 63.7(b)(1), notification is at least 60 days. NSPS (40 CFR 60.8(d)), at least 30 days, and NESHAP (40 CFR 61.13(c)), at least 30 days.
- (e) Within sixty (60) days after the source test(s) (unless a more stringent regulatory requirement applies), an electronic copy of the complete test report, including all operating conditions, shall be submitted to the Regional Air Quality Manager for approval.
- (f) In the event that any of the above deadlines cannot be met, the permittee may request an extension for the due date(s) in writing and include a justification for the extension. The Department may grant an extension for a reasonable cause.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

- (a) The permittee shall email all source test submissions (notifications, protocols, reports, supplemental information, etc.) to both the AQ Program Manager for the Southeast Regional Office and the PSIMS Administrator in Central Office (email addresses are provided below). Any questions or concerns about source testing submissions can be sent to RA-EPstacktesting@pa.gov and the PSIMS Administrator will address them.

Southeast Region
RA-EPSEstacktesting@pa.gov

**SECTION D. Source Level Requirements**

Central Office
RA-EPstacktesting@pa.gov

(b) The following pertinent information shall be listed on the title page.

1. Test Date(s)

- a. For protocols, provide the proposed date on which testing will commence or "TBD"
- b. For reports, provide the first and last day of testing

2. Facility Identification Number (Facility - ID): For test programs that were conducted under a multi-site protocol, also include the PF ID under which the protocol was stored in PSIMS, as indicated in the protocol response letter.

3. Source ID(s) for the applicable source(s) and air pollution control device(s): The term Source ID is used in the permit but "Other Id" is used in DEP electronic systems. They are the same number and must also be listed for control equipment

4. Testing Requirements (all that apply): NO_x and CO concentration limits

- a. Operating permit number
- b. Applicable federal subpart(s) (i.e. 40 CFR 60, Subpart JJJJ)
- c. Special purpose(s) (Consent Order, RFD, RACT, Tier II, etc.)

(c) If confidential information must be submitted, submit both a public copy, which has been redacted, and a confidential copy. The cover page of each submittal should state whether it is a "Public Copy" or "Confidential Copy" and each page of the latter must be marked "CONFIDENTIAL".

008 [25 Pa. Code §139.16]

Sulfur in fuel oil.

(a) The following are applicable to the analysis of commercial fuel oil:

(1) the fuel oil sample for chemical analysis shall be collected in a manner that provides a representative sample. Upon the request of a Department official, the person responsible for the operation of the source shall collect the sample employing the procedures and equipment specified in 25 Pa. Code § 139.4(10) (relating to references);

(2) test methods and procedures for the determination of sulfur shall be those specified in 25 Pa. Code § 139.4(12)--(15); and

(3) results shall be reported in accordance with the units specified in 25 Pa. Code § 123.22 (relating to combustion units).

(b) The requirements in subpart (a), above, shall be waived in the event that a delivery receipt from the supplier, showing the maximum percent sulfur in the fuel, is obtained each time a fuel oil delivery is made.

III. MONITORING REQUIREMENTS.

009 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall monitor the hours of operation and type of fuel used for this source monthly and on a 12-month rolling sum.

IV. RECORDKEEPING REQUIREMENTS.

010 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record the hours of operation and type of fuel used for this source monthly and on a 12-month rolling sum.

**SECTION D. Source Level Requirements**

[Compliance with this condition assures compliance with 40 C.F.R. § 60.48c(g).]

011 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall receive with each fuel oil delivery an electronic or paper record which legibly and conspicuously contains the following information:

- (a) the date of the sale or transfer;
- (b) the name and address of the seller;
- (c) the name and address of the buyer;
- (d) the delivery address;
- (e) the volume of commercial fuel oil purchased; and
- (f) the identification of the sulfur content of the shipment of fuel oil, determined using the sampling and testing methods specified in the testing requirement above, expressed as one of the following statements:
 - (A) For a shipment of No. 2 and lighter commercial fuel oil:
 - (I) Prior to September 1, 2020 - "The sulfur content of this shipment is 500 ppm or below."
 - (II) On and after September 1, 2020 - "The sulfur content of this shipment is 15 ppm or below."
 - (B) The permittee shall provide an electronic or written copy of applicable record to the department upon request.

[Compliance with this condition assures compliance with 40 CFR § 60.46c(e), § 60.42c(h) and § 60.48c(f)(1)]

012 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall keep records of the following when this source burns No. 2 Fuel Oil:

- a. The date and duration of burning No. 2 fuel oil, recorded in hours
- b. The reason for burning No. 2 fuel oil, and
- c. The hours per calendar year that No. 2 fuel oil was used for periodic testing of liquid fuels.

V. REPORTING REQUIREMENTS.**# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall comply with the recordkeeping and certification requirements in accordance with 40 C.F.R. § 60.46c(e), 60.42c(h) and 60.48c(f)(1). Reports shall be submitted on a semi-annual basis unless no excess emissions occurred. If there are no excess emissions, the permittee shall semi-annually report that no excess emissions occurred during the semi-annual reporting period.

014 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

Semi-annual reports shall be submitted by the permittee in accordance with 40 C.F.R. § 60.48c(d), 60.48c(e)(11) and 60.48c(j). Each subsequent report shall be postmarked by the 30th day following the end of the reporting period.

VI. WORK PRACTICE REQUIREMENTS.**# 015 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate and maintain this source in a manner consistent with safety and good air pollution practices for minimizing emissions and in accordance with the manufacturer's specifications.

[Compliance with this condition assures compliance with 40 C.F.F. 63.11205(a)]

VII. ADDITIONAL REQUIREMENTS.**# 016 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

This source consists of two (2) 400 HP dual fired boilers, manufactured by Cleaver Brooks, model number CB-LE-200-400-

**SECTION D. Source Level Requirements**

150ST. Each boiler is equipped with Low NOx burners and Flue gas recirculation. The rated heat input is 16.3 MMBTU/HR. The facility identifies the boilers as Boiler #2 (serial number OL105511) and Boiler #3 (serial number OL105510).

The boilers were installed in January 2007, therefore, the boilers are subject to all applicable requirements in 40 C.F.R. 60 Subpart Dc.

The boilers are subject to all applicable requirements in 40 C.F.R. 63 Subpart JJJJJ.

**SECTION D. Source Level Requirements**

Source ID: 100

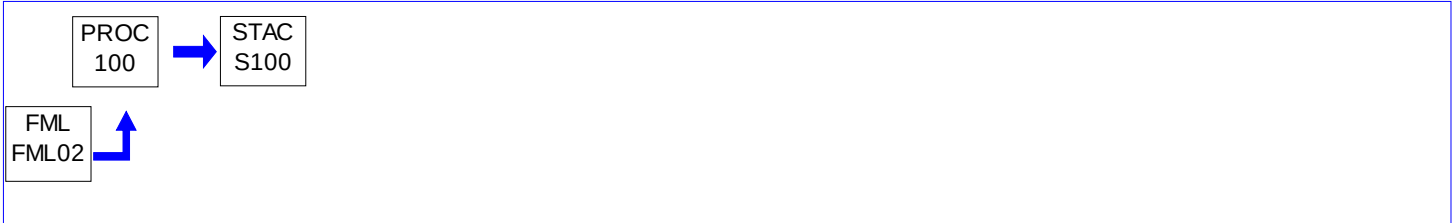
Source Name: EMERGENCY GENERATORS

Source Capacity/Throughput:

28.000 Gal/HR

NO. 2 FUEL OIL

Conditions for this source occur in the following groups: SMITH HALL KATOLIGHT GEN

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall not permit the emission into the outdoor atmosphere of particulate matter from this source (each generator) at any time, in excess of 0.04 gr/dscf, pursuant to 25 Pa. Code § 123.13 (c)(1)(i).

002 [25 Pa. Code §123.21]

General

The permittee shall not permit the emission into the outdoor atmosphere of sulfur oxides from this source (each generator) in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 ppmvd.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only use No. 2 Fuel Oil as fuel for the emergency generators listed under this Source ID.

II. TESTING REQUIREMENTS.

004 [25 Pa. Code §139.16]

Sulfur in fuel oil.

(a) The following are applicable to the analysis of commercial fuel oil:

(1) The fuel oil sample for chemical analysis shall be collected in a manner that provides a representative sample. Upon the request of a Department official, the person responsible for the operation of the source shall collect the sample employing the procedures and equipment specified in 25 Pa. Code § 139.4(10) (relating to references).

(2) Test methods and procedures for the determination of sulfur shall be those specified in 25 Pa. Code § 139.4(12)--(15).

(3) Results shall be reported in accordance with the units specified in 25 Pa. Code § 123.22 (relating to combustion units).

(b) The requirements in subpart (a), above, shall be waived in the event that a delivery receipt from the supplier, showing the maximum percent sulfur in the fuel, is obtained each time a fuel oil delivery is made.

III. MONITORING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall monitor the hours of operation monthly and on a 12-month rolling sum for each emergency generator listed under this Source ID.

**SECTION D. Source Level Requirements****IV. RECORDKEEPING REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep records of the hours of operation for each emergency generator monthly, and on a 12-month rolling sum.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall obtain from the fuel oil supplier, a delivery receipt that certifies the percentage of sulfur, by weight, is less than or equal to 0.0015 percent, each time a delivery is made.

In the event that a delivery is made, and no receipt is obtained, the permittee shall perform testing in accordance with 25 Pa. Code § 139.16.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

This source ID is made up of the following Emergency Generators:

Powerhouse Generator #2: Kohler, 350 KW
Maris Hall Generator: Katolight 375 KW
Smith Hall Generator: Katolight 800 KW
Centennial Generator: Katolight 375 KW
Cottage's 2&3 Generator: Katolight 300 KW
Whitney Hall Generator: Kohler 150 KW
Glenview Generator: Katolight 300 KW
Wechsler A Generator: Cummins 500 KW
Wechsler B Generator: Cummins 500 KW
Sewer Plant: Cummins 10 KW

**SECTION D. Source Level Requirements**

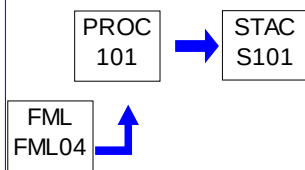
Source ID: 101

Source Name: ALL EXEMPT EMERGENCY GENERATORS

Source Capacity/Throughput:

N/A

NO 2 FUEL OIL

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall not permit the emission into the outdoor atmosphere of particulate matter from this source (each generator) at any time, in excess of 0.04 gr/dscf, pursuant to 25 Pa. Code § 123.13 (c)(1)(i).

002 [25 Pa. Code §123.21]

General

The permittee shall not permit the emission into the outdoor atmosphere of sulfur oxides from this source (each generator) in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 ppmvd.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the total combined NO_x emissions from all the generators listed under this Source ID (All Exempt Emergency Generators) to less than the following:

- 100 pounds per hour, averaged monthly
- 1000 pounds per day, averaged monthly
- 2.75 tons per ozone season (May 1st through September 30 of each year) and
- 6.6 tons per year calculated on a 12-month rolling sum.

Fuel Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only use No. 2 Fuel Oil as fuel for the emergency generators listed under this Source ID.

Operation Hours Restriction(s).

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of each exempt emergency generator to less than 300 hours per year, calculated on a 12-month rolling basis.

II. TESTING REQUIREMENTS.

006 [25 Pa. Code §139.16]

Sulfur in fuel oil.

(a) The following are applicable to the analysis of commercial fuel oil:

(1) The fuel oil sample for chemical analysis shall be collected in a manner that provides a representative sample. Upon the request of a Department official, the person responsible for the operation of the source shall collect the sample employing the procedures and equipment specified in 25 Pa. Code § 139.4(10) (relating to references).

**SECTION D. Source Level Requirements**

- (2) Test methods and procedures for the determination of sulfur shall be those specified in 25 Pa. Code § 139.4(12)--(15).
- (3) Results shall be reported in accordance with the units specified in 25 Pa. Code § 123.22 (relating to combustion units).
- (b) The requirements in subpart (a), above, shall be waived in the event that a delivery receipt from the supplier, showing the maximum percent sulfur in the fuel, is obtained each time a fuel oil delivery is made.

III. MONITORING REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall monitor the hours of operation monthly and on a 12-month rolling sum for each emergency generator listed under this Source ID.

IV. RECORDKEEPING REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep records of the total combined NO_x emissions from all the generators listed under this Source ID (All Exempt Emergency Generators) according to the frequency listed below:

- 100 pounds per hour, averaged monthly
- 1000 pounds per day, averaged monthly
- 2.75 tons per ozone season (May 1st through September 30 of each year) and
- 6.6 tons per year calculated on a 12-month rolling sum.

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall keep records of the hours of operation for each emergency generator monthly, and on a 12-month rolling sum.

010 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall obtain from the fuel oil supplier, a delivery receipt that certifies the percentage of sulfur, by weight, is less than or equal to 0.0015 percent, each time a delivery is made.

In the event that a delivery is made, and no receipt is obtained, the permittee shall perform testing in accordance with 25 Pa. Code § 139.16.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

This source ID is made up of the following Emergency Generators:

- (a) Hilltop generator, Caterpillar, 250 kW

**SECTION D. Source Level Requirements**

- (b) Beatty Hall generator, Katolight, 375 kW
- (c) Cottage's 1 & 6 generators, Katolight, 300 kW
- (d) Cottage's 4 & 5 generators, Katolight, 300 kW
- (e) Cottage 7 generator, Katolight, 100 kW
- (f) Sun Center generator, Katolight, 375 kW
- (g) Kitchen generator, Kohler, 500 kW

**SECTION D. Source Level Requirements**

Source ID: 102

Source Name: ENGINES SUBJECT TO 40 C.F.R. 60 SUBPART IIII

Source Capacity/Throughput:

I. RESTRICTIONS.**Emission Restriction(s).**

001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4205]
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?
[Additional Authority for this permit condition is also derived from 40 C.F.R. 60 § 60.4202 and 40 C.F.R § 94.8]

The following emission limits are only applicable to the following engines ;Cottage 7, Weschsler A and Weschsler B:

THC+NOX shall not exceed 8.7 g/kW-hr
CO shall not exceed 5.0 g/kW-hr
PM shall not exceed 0.5 g/kW-hr

002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4205]
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?
[Additional Authority for this permit condition is also derived from 40 C.F.R. 60 § 60.4202]

The following emission limits are only applicable to the following engine:Smith Hall.

The permittee shall limit the NOx emissions to less than the following:

- (i) 17.0 g/KW-hr (12.7 g/HP-hr) when maximum engine speed is less than 130 rpm;
- (ii) $45 * n - 0.2$ g/KW-hr ($34 * n - 0.2$ g/HP-hr) when maximum engine speed is 130 or more but less than 2,000 rpm, where n is maximum engine speed; and
- (iii) 9.8 g/kW-hr (7.3 g/HP-hr) when maximum engine speed is 2,000 rpm or more.

[Compliance with this condition assures compliance with 40 C.F.R. § 60.4205(d)(1)]

Fuel Restriction(s).

003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4207]
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?
[Additional authority for this permit condition is also derived from 40 C.F.R. § 80.510]

The permittee shall ensure the diesel fuel used for the emergency engines listed under this Source ID meets the following per-gallon standards:

- (1) Sulfur content. 15 ppm maximum.
- (2) Cetane index or aromatic content, as follows:
 - (i) A minimum cetane index of 40; or
 - (ii) A maximum aromatic content of 35 volume percent.

Operation Hours Restriction(s).

004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines
What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?
(a) The permittee shall operate the emergency stationary R.I.C.E. according to the requirements in the most recent version

**SECTION D. Source Level Requirements**

of 40 C.F.R. § 60.4211(f).

(b) If the permittee does not operate the engine according to the requirements of 40 C.F.R. § 60.4211(f), the engine will not be considered an emergency engine under 40 C.F.R. Part 60 Subpart IIII and must meet all requirements for non-emergency engines.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep and make available on site, records of the manufacturer's emission data for each emergency engine listed under this Source ID. The manufacturer data will be used to demonstrate compliance with the emission standards listed under this Source ID.

[Compliance with this condition assures compliance with 40 C.F.R. § 60.4211(b)(3)].

006 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall keep and maintain on site records of the following:

Records of tune-ups, repairs, parts replacements and other maintenance performed in accordance with manufacturers' specifications.

007 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall obtain and keep a copy of a dated statement, upon each delivery, from the fuel supplier that states that the diesel fuel complies with the specifications in 40 C.F.R. § 80.510(b) for nonroad diesel fuel.

008 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

a. The permittee shall keep records of the hours of operation for each engine listed under this source ID monthly and on a 12-month rolling sum.

b. The hours of operation records shall indicate how many hours are spent for emergency operation, non-emergency operation, demand response, maintenance and readiness testing.

c. The permittee shall keep records of the notification of the emergency situation, the date, start time and end time of the engine if the engine is used for demand response operation.

[Compliance with this condition assures compliance with 40 C.F.R. § 60.4214(b)]

**SECTION D. Source Level Requirements****V. REPORTING REQUIREMENTS.****# 009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4214]****Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?**

If the permittee operates an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in 40 C.F.R. § 60.4211(f)(2)(ii) and (iii) or that operates for the purposes specified in 40 C.F.R. § 60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (1) through (3):

(1) The report must contain the following information:

- (i) Company name and address where the engine is located.
- (ii) Date of the report and beginning and ending dates of the reporting period.
- (iii) Engine site rating and model year.
- (iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.
- (v) Hours operated for the purposes specified in 40 C.F.R. § 60.4211(f)(2)(ii) and (iii), including the date, start time, and end time for engine operation for the purposes specified in 40 C.F.R. § 60.4211(f)(2)(ii) and (iii).
- (vi) Number of hours the engine is contractually obligated to be available for the purposes specified in 40 C.F.R. § 60.4211(f)(2)(ii) and (iii).
- (vii) Hours spent for operation for the purposes specified in 40 C.F.R. § 60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in 40 C.F.R. § 60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in 40 C.F.R. § 60.4.

VI. WORK PRACTICE REQUIREMENTS.**# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall operate and maintain a non-resettable hour meter for the emergency engines listed under this Source ID.

[Compliance with this condition assures compliance with 40 C.F.R. § 60.4209]

011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4211]**Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?**

The permittee shall do all of the following, except as permitted under paragraph (g) of 40 C.F.R. § 60.4211:

- (1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

**SECTION D. Source Level Requirements**

- (2) Change only those emission-related settings that are permitted by the manufacturer; and
- (3) Meet the requirements of 40 CFR parts 89, 94 and/or 1068, as they apply to you.

VII. ADDITIONAL REQUIREMENTS.**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Source ID 102 was created to address the applicable requirements under 40 C.F.R. 60 Subpart IIII. Four (4) engines on site are applicable to the requirements.

The following 4 engines shall comply with 40 C.F.R. 60 Subpart IIII:

Building	Manufacturer	kW	Displ: L/cylinder
Smith Hall	Katolight	800	33.9
Cottage 7	Katolight	100	12.5
Wechsler A	Cummings	500	15
Wechsler B	Cummings	500	15

The 4 engines are also listed under Source ID 100 or Source ID 101, the 4 engines listed above, shall comply with all the requirements under the appropriate Source ID to include the requirements under Source ID 102 (Engines Subject to 40 C.F.R. 60 Subpart IIII).

**SECTION E. Source Group Restrictions.**

Group Name: SMITH HALL KATOLIGHT GEN

Group Description: 25 Pa. Code Section 129.203 and 129.204

Sources included in this group

ID	Name
100	EMERGENCY GENERATORS

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §129.203]****Stationary internal combustion engines.**

The following condition is only applicable to the emergency generator: Smith Hall, Katolight, 800 kW:

The permittee shall calculate the difference between the actual NO_x emissions from the unit during the period from May 1 through September 30 and the allowable emissions for that period.

The permittee shall calculate the allowable NO_x emissions by multiplying the cumulative hours of operations for the unit for the period by the horsepower rating of the unit and by the applicable emission rate set forth in (1) or (2) below.

(1) For a spark-ignited engine, 3.0 grams of NO_x per brake horsepower-hour.

(2) For a compression ignition stationary internal combustion engine firing diesel fuel or a combination of diesel fuel and natural gas, 2.3 grams of NO_x per brake horsepower-hour.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The following condition is only applicable to the emergency generator Smith Hall, Katolight, 800 kW:

The permittee shall calculate and monitor the actual and allowable NO_x emissions during the period from May 1st through September 30th each year pursuant to 25 Pa. Code § 129.203.

003 [25 Pa. Code §129.204]**Emission accountability.**

The following condition is only applicable to the emergency generator: Smith Hall, Katolight, 800 kW:

(a). The owner or operator shall determine the actual NO_x emissions in accordance with 25 Pa. Code § 129.204(b)(2)(ii), using the manufacturer's emission factor of 5.32 g/hp-hr.

(b). An alternate calculation and recordkeeping procedure based upon emissions testing and correlations with operating parameters. The operator of the unit shall demonstrate that the alternate procedure does not underestimate actual emissions throughout the allowable range of operating conditions. In regard to obtaining the Department's approval for an alternate calculation method and recordkeeping procedure for actual emissions, the owner or operator may request an adjustment to the allowable emissions calculations set forth in §§ 129.201--129.203. An allowable emission adjustment may not overestimate a unit's allowable emissions and must be based upon the parameters and procedures proposed in the alternate calculation method for actual emissions. The alternate calculation and recordkeeping procedures must be approved by the Department, in writing, prior to implementation.

**SECTION E. Source Group Restrictions.****IV. RECORDKEEPING REQUIREMENTS.****# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The following condition is only applicable to the emergency generator Smith Hall, Katolight, 800 kW:

The permittee shall record the actual and allowable NOx emissions during the period from May 1st through September 30th each year.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 005 [25 Pa. Code §129.204]****Emission accountability.**

The following condition is only applicable to the emergency generator: Smith Hall, Katolight, 800 kW:

(a) The owner or operator of a unit subject to this section shall surrender to the Department one CAIR NOx allowance and one CAIR NOx Ozone Season allowance, as defined in 40 CFR 96.102 and 96.302 (relating to definitions), for each ton of NOx by which the combined actual emissions exceed the allowable emissions of the units subject to this section at a facility from May 1 through September 30. The surrendered allowances shall be of current year vintage. For the purpose of determining the amount of allowances to surrender, any remaining fraction of a ton equal to or greater than 0.50 ton is deemed to equal 1 ton and any fraction of a ton less than 0.50 ton is deemed to equal zero tons.

(b) If the combined allowable emissions from units subject to this section at a facility from May 1 through September 30 exceed the combined actual emissions from units subject to this section at the facility during the same period, the owner or operator may deduct the difference or any portion of the difference from the amount of actual emissions from units subject to this section at the owner or operator's other facilities.

(c) By November 1 of each year, an owner or operator of a unit subject to this section shall surrender the required NOx allowances to the Department's designated NOx allowance tracking system account and provide to the Department, in writing, the following:

- (1) The serial number of each NOx allowance surrendered.
- (2) The calculations used to determine the quantity of NOx allowances required to be surrendered.

(d) If an owner or operator fails to comply with subsection (e), the owner or operator shall by December 31 surrender three NOx allowances of the current or later year vintage for each NOx allowance that was required to be surrendered by November 1 of that year.

(e) The surrender of NOx allowances under subsection (f) does not affect the liability of the owner or operator of the unit for any fine, penalty or assessment, or an obligation to comply with any other remedy for the same violation, under the CAA or the act.

(1) For purposes of determining the number of days of violation, if a facility has excess emissions for the period May 1 through September 30, each day in that period (153 days) constitutes a day in violation unless the owner or operator of the unit demonstrates that a lesser number of days should be considered.

- (2) Each ton of excess emissions is a separate violation.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this State Only facility.

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description		
034	TWO (2) DUAL-FUEL (400 HP) CLEAVER BROOKS BOILERS		
Emission Limit		Pollutant	
0.400	Lbs/MMBTU	PM10	
1.000	Lbs/MMBTU	SOX	
100	EMERGENCY GENERATORS		
Emission Limit		Pollutant	
0.040	gr/DRY FT3	PM10	
500.000	PPMV	dry basis	SOX
101	ALL EXEMPT EMERGENCY GENERATORS		
Emission Limit		Pollutant	
2.750	Tons	per ozone season	NOX
6.600	Tons/Yr	calculated on a 12-month rolling sum	NOX
100.000	Lbs/Hr	averaged monthly	NOX
1,000.000	Lbs/Day	averaged monthly	NOX
500.000	PPMV	SOX	
0.040	gr/DRY FT3	TSP	

Site Emission Restriction Summary

Emission Limit	Pollutant
24.900 Tons/Yr	NOX

**SECTION H. Miscellaneous.**

(A) The Department has determined that emissions from the following sources, excluding those indicated as site level requirements in Section C of this permit, are of insignificant size and do not require additional limitations, monitoring, or recordkeeping.

(1) Boiler #4, Cleaver Brooks Natural Gas fired 50hp steam generator, rated input 2.092 MMBTU/hr. (Under Plan Approval and Operating Permit Exemptions, 25 Pa. Code Chapter 127.)

APS: 505317 AUTH: 825386

-The information in Section A is for informational purposes only.

-This operating permit has been renewed.

-This renewal removed Source ID 030 (Boiler 2) and Source ID 031 (Boiler 3) from the operating permit. These 2 boilers were replaced by 2 new boilers issued under GP23-302-144, issued on October 25, 2006. The 2 new boilers under GP23-302-144 were incorporated into the renewal permit as Source ID 034 (2-400 hp dual fired boilers).

APS: 505317 AUTH: 1052889

This operating permit has been renewed.

Source ID 033 (Boiler 5) has been removed from the permit as the boiler was taken out of service on May 27, 2011.

Source ID 101 (All Exempt ER GENS) was created and added to the permit. This source ID was created because RFD # 2096 was approved on 4/5/2011. The limits established for this source ID are based on the exemption in which they were installed, 25 Pa. Code 127.14(a)(8)(6) from DEP document # 275-2101-003 / July 26, 2003 - DEP Plan Approval and Operating Permit exemptions.

The ER Generators located at this site are exempt from 40 C.F.R. 63 Subpart ZZZZ as the facility falls under the definition of Institutional per exemption under 40 C.F.R. 63.6590(b)(3)(viii).

Only four (4) ER Generators are subject to 40 C.F.R. 60 Subpart IIII. Source ID 102 (Engines subject to 40 C.F.R. 60 Subpart IIII) was created and added to Section D of the permit along with all applicable requirements and conditions.

Source ID 034 (Two dual fired 400 hp boilers) are subject to the applicable requirements found in 40 C.F.R. 63 Subpart JJJJJJ, conditions have been added to the permit.

AUTH No. 1310228

This Operating Permit has been renewed.

AUTH No. 1513489

This Operating Permit has been renewed.

- Elwyn removed FLM 03 (#2 Fuel Oil Tank 2 - 20,000 gallons) from the facility.

- Elwyn removed the Allis Chalmers Generator (listed under Source ID 100, Company ID (C)) from service due to mechanical failure.

- Elwyn no longer operates the N. Hall (Evergreen) Caterpillar generator listed under Source ID 100, Company ID H. The generator is no longer on site and was shut down in May 2025.

- Elwyn added a small used generator listed under Source ID 100 (named Sewer Plant - 10 Kw)



***** End of Report *****
