



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM

STATE ONLY OPERATING PERMIT

Issue Date: December 14, 2012

Effective Date: January 1, 2013

Expiration Date: December 31, 2017

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 21-03098

Federal Tax Id - Plant Code: 75-2548221-1

Owner Information

Name: HP ENTERPRISE SVC LLC
Mailing Address: 225 GRANDVIEW AVE
CAMP HILL, PA 17011-1712

Plant Information

Plant: HP ENTERPRISE SVC LLC/CAMP HILL
Location: 21 Cumberland County 21909 East Pennsboro Township
SIC Code: 7374 Services - Data Processing Services

Responsible Official

Name: JACK BAMBARY
Title: GRE SITE MANAGER
Phone: (610) 438 - 1972

Permit Contact Person

Name: THOMAS MORAN
Title: ISS - HP ACCOUNT
Phone: (717) 763 - 6140

[Signature] _____
WILLIAMR. WEAVER, SOUTHCENTRAL REGION AIR PROGRAM MANAGER

SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions
- E-II: Testing Requirements
- E-III: Monitoring Requirements



SECTION A. Table of Contents

E-IV: Recordkeeping Requirements
E-V: Reporting Requirements
E-VI: Work Practice Standards
E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

F-I: Restrictions
F-II: Testing Requirements
F-III: Monitoring Requirements
F-IV: Recordkeeping Requirements
F-V: Reporting Requirements
F-VI: Work Practice Standards
F-VII: Additional Requirements


Section G. Emission Restriction Summary




Section H. Miscellaneous

SECTION A. Site Inventory List

Source ID	Source Name	Capacity/Throughput	Fuel/Material
101A	STEWART & STEVENSON EM GENERATOR	5.100 MMBTU/HR	
101B	STEWART & STEVENSON EM GENERATOR	5.100 MMBTU/HR	
101C	STEWART & STEVENSON EM GENERATOR	5.100 MMBTU/HR	
102	KOHLER 150REZG EM GENERATOR	0.520 MMBTU/HR	
103	KOHLER FAST RESPONSE 88 KW EM GENERATOR	0.300 MMBTU/HR	
104	MARATHON ELECTRIC 175 KW EM GENERATOR	0.600 MMBTU/HR	
105	CUMMINS 130 HP EMERGENCY DIESEL FIRED FIRE PUMP	0.330 MMBTU/HR	
C102	NG ENGINE 3 WAY NSCR		
FML001	NO. 2 OIL FUEL		
FML002	NATURAL GAS LINE		
S101A	STEWART & STEVENSON STACK		
S101B	STEWART & STEVENSON STACK		
S101C	STEWART & STEVENSON STACK		
S102	KOHLER 150REZG STACK		
S103	KOHLER FAST RESPONSE STACK		
S104	MARATHON ELECTRIC MAGNA ONE STACK		
S105	CUMMINS FIRE PUMP STACK		

PERMIT MAPS

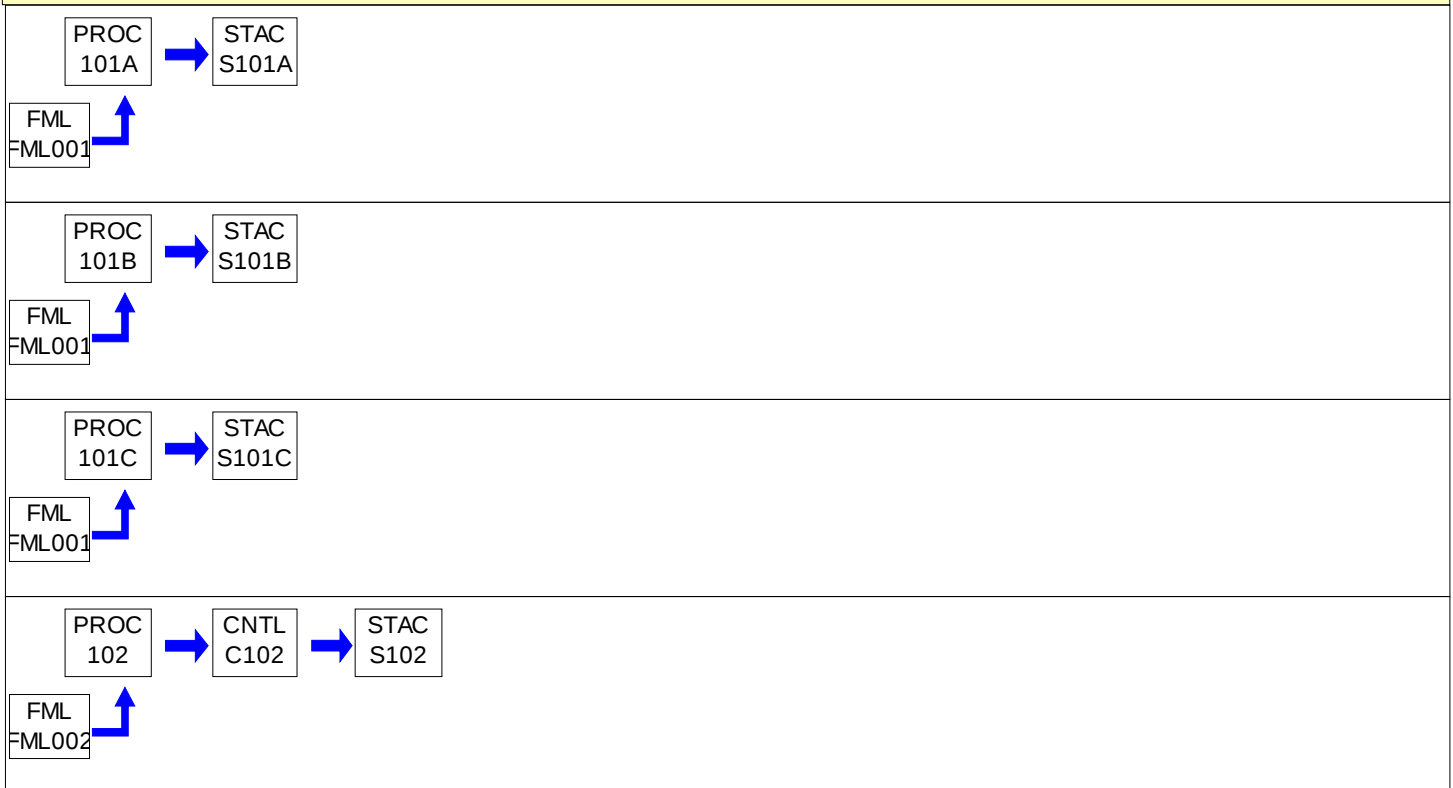

PERMIT MAPS

SECTION B. General State Only Requirements

#001 [25 Pa. Code § 121.1]

Definitions.

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]

Operating Permit Duration.

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)&(c)]

Permit Renewal.

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application and an additional annual administrative fee as specified in 25 Pa. Code § 127.703(b) and (c). The fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund" and shall be for the amount specified in the following schedule specified in 25 Pa. Code § 127.703(b) and (c).
 - (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
 - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]

Operating Permit Fees under Subchapter I.

- (a) The permittee shall pay fees according to the following schedule specified in 25 Pa. Code § 127.703(b):
 - (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
 - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

This fee schedule shall apply to the processing of an application for an operating permit as well as the extension,

SECTION B. General State Only Requirements

modification, revision, renewal, and re-issuance of each operating permit or part thereof.

(b) The permittee shall pay an annual operating permit administrative fee according to the fee schedule established in 25 Pa. Code § 127.703(c).

(1) Two hundred fifty dollars for applications filed during the 1995-1999 calendar years.

(2) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(3) Three hundred seventy-five dollars for applications filed during the years beginning in 2005.

(c) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund".

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]

Transfer of Operating Permits.

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]

Inspection and Entry.

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]

Compliance Requirements.

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes

SECTION B. General State Only Requirements

a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]

Need to Halt or Reduce Activity Not a Defense.

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]

Duty to Provide Information.

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]

Revising an Operating Permit for Cause.

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450 & 127.462]

Operating Permit Modifications

- (a) The permittee is authorized to make administrative amendments, minor operating permit modifications and

SECTION B. General State Only Requirements

significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall make administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall make minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Permit modifications which do not qualify as minor permit modifications under 25 Pa. Code § 127.541 will be treated as a significant operating permit revision subject to the public notification procedures in §§ 127.424 and 127.425.

#012 [25 Pa. Code § 127.441]

Severability Clause.

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]

De Minimis Emission Increases.

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

SECTION B. General State Only Requirements

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]

Operational Flexibility.

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

SECTION B. General State Only Requirements

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11]

Reactivation

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]

Health Risk-based Emission Standards and Operating Practice Requirements.

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]

Circumvention.

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]

Reporting Requirements.

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

SECTION B. General State Only Requirements

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]

Sampling, Testing and Monitoring Procedures.

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]

Recordkeeping.

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]

Property Rights.

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]

Alternative Operating Scenarios.

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

SECTION C. Site Level Requirements

I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.1]

Prohibition of certain fugitive emissions

No person shall permit the emission into the outdoor atmosphere of any fugitive air contaminant from a source other than the following:

- (a) Construction or demolition of buildings or structures.
- (b) Grading, paving and maintenance of roads and streets.
- (c) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (d) Clearing of land.
- (e) Stockpiling of materials.
- (f) Sources and classes of sources other than those identified above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (1) The emissions are of minor significance with respect to causing air pollution;
 - (2) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air standard.

002 [25 Pa. Code §123.2]

Fugitive particulate matter

No person shall permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in Section C, Condition # 001, if the emissions are visible at the point the emissions pass outside the persons property.

003 [25 Pa. Code §123.31]

Limitations

No person shall permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]

Limitations

No person shall emit visible air contaminants into the outdoor atmosphere in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20 % for a period or periods aggregating more than three minutes in any one hour.
- (2) Equal to or greater than 60 % at any time.

005 [25 Pa. Code §123.42]

Exceptions

The emission limitations of Section C, Condition #004 (relating to limitations) do not apply to a visible emission in any of the following instances:

- (a) The presence of uncombined water is the only reason for failure of the emission to meet the limitation.
- (b) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions;
- (c) The emission results from sources specified in Section C, Condition #001 (relating to prohibition of certain fugitive emissions).

SECTION C. Site Level Requirements

006 [25 Pa. Code §129.14]

Open burning operations

(a) No person shall conduct open burning of material at the facility, as per the §§129.14(a), except where the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (2) Any fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(b) This permit does not constitute authorization to burn solid waste pursuant to section 610 (3) of the Solid Waste Management Act 35 P.S. Section 6018.610 (3), or any other provision of the Solid Waste Management Act.

II. TESTING REQUIREMENTS.

007 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The Department reserves the right to require exhaust stack testing of the source(s) as necessary during the permit term to verify emissions for purposes including emission fees, malfunctions or permit condition violations.

008 [25 Pa. Code §139.1]

Sampling facilities.

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such source. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.

III. MONITORING REQUIREMENTS.

009 [25 Pa. Code §123.43]

Measuring techniques

Visible air contaminants may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and certified, to measure plume opacity with the naked eye, as per EPA Method 9, or with the aid of any devices approved by the Department.

010 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall conduct a monthly inspection during regular business workdays around the plant periphery during the daylight hours when the source(s) are in operation to detect visible emissions, fugitive visible emissions and malodorous air contaminants. Monthly inspections are necessary to determine:

- (a) The presence of visible emissions. Visible emissions may be measured according to the methods specified in Section C, Condition #009. Alternately, personnel who observe visible emissions may report the incident to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions.
- (b) The presence of fugitive emissions beyond the plant property boundaries, as stated in Section C, Condition #002.

SECTION C. Site Level Requirements

(c) Presence of malodorous air contaminants beyond the property boundaries, as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.**# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of the monthly inspections referenced in Section C, Condition #010. The records shall include, at minimum, the following information:

- (a) The name of the company representative monitoring each instance,
- (b) A description of the emissions and/or malodors observed and actions taken to mitigate them. If none are observed, record "NONE".
- (c) The date and time of the observation,
- (d) The wind direction and speed during each observation.

The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 012 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from the sources identified in Condition #001, Section C becoming airborne. These actions shall include, but not be limited to, the following:

- (a) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (b) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (c) Paving and maintenance of roadways.
- (d) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

013 [25 Pa. Code §127.444]**Compliance requirements.**

The permittee shall operate and maintain the emission sources referenced in this permit in accordance with the manufacturer's general recommendations and good air pollution control practices.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.



SECTION C. Site Level Requirements

No compliance milestones exist.

SECTION D. Source Level Requirements


Source ID: 101A

Source Name: STEWART & STEVENSON EM GENERATOR

Source Capacity/Throughput:

5.100 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 001

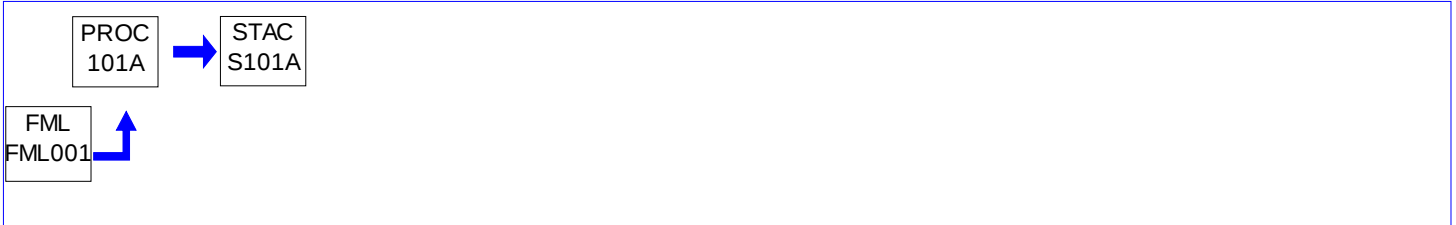

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

SECTION D. Source Level Requirements


Source ID: 101B

Source Name: STEWART & STEVENSON EM GENERATOR

Source Capacity/Throughput:

5.100 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 001

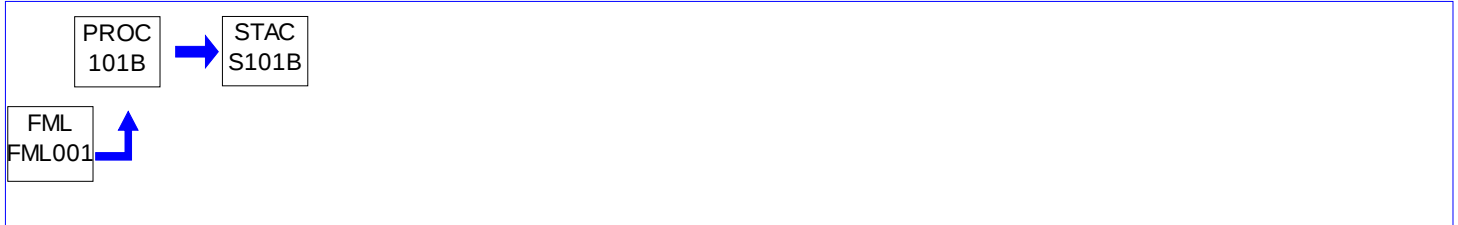

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


SECTION D. Source Level Requirements

Source ID: 101C

Source Name: STEWART & STEVENSON EM GENERATOR

Source Capacity/Throughput: 5.100 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 001

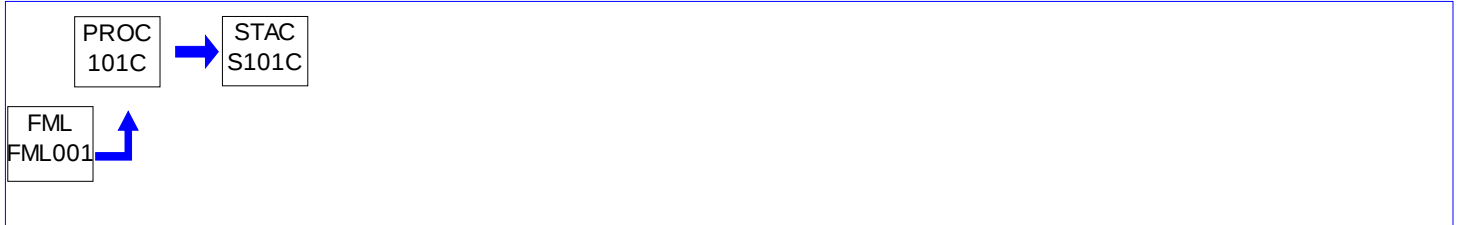

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


SECTION D. Source Level Requirements

Source ID: 102

Source Name: KOHLER 150REZG EM GENERATOR

Source Capacity/Throughput: 0.520 MMBTU/HR

Conditions for this source occur in the following groups: GROUP 002

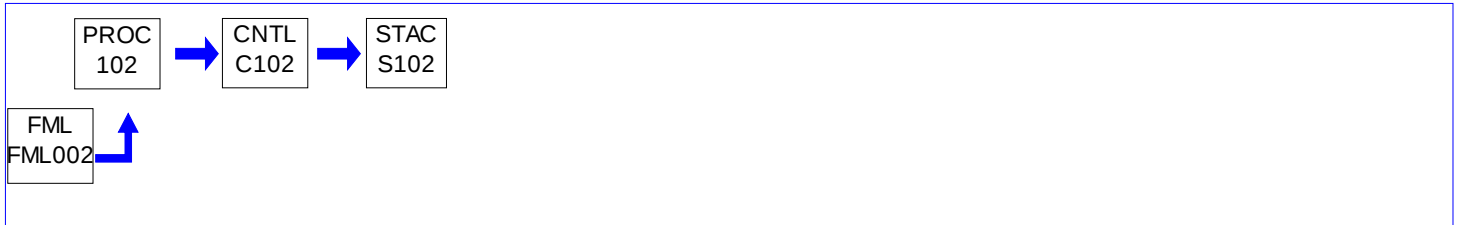**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the sources in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grains per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only operate Source 102 on commercial natural gas.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the generator to 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record monthly the hours of operation of the generator.

SECTION D. Source Level Requirements

These records shall be retained for at least five (5) years and shall be made available to the Department upon request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The emergency generator shall not be used to supplement the primary power supply to the facility for the purposes of peak shaving.

007 [25 Pa. Code §127.441]

Operating permit terms and conditions.

This generator is subject to 40 CFR Part 60, Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines and shall comply with all applicable requirements of the Subpart. Including all applicable portions of 40 CFR Part 60 Subpart A - General Provisions. The permittee shall comply with 40 CFR Part 60 Section 60.4, which requires submission of copies of all requests, reports, applications, submittals, and other communications to both EPA and the Department. The EPA copies shall be forwarded to:

Director of Air Protection Division
US EPA, Region III (3AP00)
1650 Arch Street
Philadelphia, PA 19103-2029

SECTION D. Source Level Requirements

Source ID: 103

Source Name: KOHLER FAST RESPONSE 88 KW EM GENERATOR

Source Capacity/Throughput: 0.300 MMBTU/HR



I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the sources in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grains per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only operate Source 103 on commercial natural gas.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the generator to 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record monthly the hours of operation of the generator.

These records shall be retained for at least five (5) years and shall be made available to the Department upon request.

SECTION D. Source Level Requirements**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The emergency generator shall not be used to supplement the primary power supply to the facility for the purposes of peak shaving.

SECTION D. Source Level Requirements

Source ID: 104

Source Name: MARATHON ELECTRIC 175 KW EM GENERATOR

Source Capacity/Throughput: 0.600 MMBTU/HR



I. RESTRICTIONS.

Emission Restriction(s).

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the sources in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grains per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only operate Source 104 on commercial natural gas.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the generator to 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record monthly the hours of operation of the generator.

These records shall be retained for at least five (5) years and shall be made available to the Department upon request.

**SECTION D. Source Level Requirements****V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The emergency generator shall not be used to supplement the primary power supply to the facility for the purposes of peak shaving.

SECTION D. Source Level Requirements

Source ID: 105

Source Name: CUMMINS 130 HP EMERGENCY DIESEL FIRED FIRE PUMP

Source Capacity/Throughput: 0.330 MMBTU/HR

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the sources in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grains per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only operate the generator on diesel fuel which has a maximum sulfur content of 0.3 percent, by weight.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the generator to 500 hours during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record monthly the hours of operation of the generator.

These records shall be retained for at least five (5) years and shall be made available to the Department upon request.

SECTION D. Source Level Requirements**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of all fuel oil analysis or fuel oil certifications for each shipment of No. 2 fuel oil received for the most recent five (5) year period.

These records shall be made available to the Department upon request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The emergency generator shall not be used to supplement the primary power supply to the facility for the purposes of peak shaving.

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 001

Group Description: Stewart & Stevenson Emergency Generators

Sources included in this group

ID	Name
101A	STEWART & STEVENSON EM GENERATOR
101B	STEWART & STEVENSON EM GENERATOR
101C	STEWART & STEVENSON EM GENERATOR

I. RESTRICTIONS.**Emission Restriction(s).**

001 [25 Pa. Code §123.13]

Processes

The permittee shall limit the emissions of particulate matter to the outdoor atmosphere from the sources in a manner that the concentration of particulate matter in the effluent gas does not exceed 0.04 grains per dry standard cubic foot.

002 [25 Pa. Code §123.21]

General

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO₂, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

Fuel Restriction(s).

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall only operate the generators on diesel fuel which has a maximum sulfur content of 0.3 percent, by weight.

Operation Hours Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall limit the operation of the generators to 150 hours per generator during any consecutive 12-month period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall record monthly the hours of operation of each generator.

These records shall be retained for at least five (5) years and shall be made available to the Department upon request.

006 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The permittee shall maintain records of all fuel oil analysis or fuel oil certifications for each shipment of No. 2 fuel oil received for the most recent five (5) year period.

SECTION E. Source Group Restrictions.

These records shall be made available to the Department upon request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

007 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The emergency generators shall not be used to supplement the primary power supply to the facility for the purposes of peak shaving.

**SECTION E. Source Group Restrictions.**

Group Name: GROUP 002

Group Description: Subpart JJJJ - Standards of Performance for Stationary SI ICE.

Sources included in this group

ID	Name
102	KOHLER 150REZG EM GENERATOR

I. RESTRICTIONS.**Emission Restriction(s).**

001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4233]

Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines

What emission standards must I meet if I am an owner or operator of a stationary SI internal combustion engine?

(a) [N/A - THE MAXIMUM ENGINE POWER IS GREATER THAN 19 KW]

(b) [N/A - THE ENGINE DOES NOT USE GASOLINE]

(c) [N/A - THE ENGINE DOES NOT USE LPG]

(d) [N/A - THE MAXIMUM ENGINE POWER IS GREATER THAN 75 KW]

(e) Owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 75 KW (100 HP) (except gasoline and rich burn engines that use LPG) must comply with the emission standards in Table 1 to this subpart for their stationary SI ICE. For owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 100 HP (except gasoline and rich burn engines that use LPG) manufactured prior to January 1, 2011 that were certified to the certification emission standards in 40 CFR part 1048 applicable to engines that are not severe duty engines, if such stationary SI ICE was certified to a carbon monoxide (CO) standard above the standard in Table 1 to this subpart, then the owners and operators may meet the CO certification (not field testing) standard for which the engine was certified.

Summary of Table 1:

-Engine Type and Fuel: Emergency

-Maximum Power: HP greater than or equal to: 130

-Emission Standards: NOx: 2.0 g/HP-hr; CO: 4.0 g/HP-hr; VOC: 1.0 g/HP-hr

(f) [N/A - THE ENGINE HAS NOT BEEN MODIFIED OR RECONSTRUCTED]

(g) [N/A - THE ENGINE DOES NOT USE WELLHEAD GAS]

(h) Owners and operators of stationary SI ICE that are required to meet standards that reference 40 CFR 1048.101 must, if testing their engines in use, meet the standards in that section applicable to field testing, except as indicated in paragraph (e) of this section.

II. TESTING REQUIREMENTS.

002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4244]

Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines

What test methods and other procedures must I use if I am an owner or operator of a stationary SI internal combustion engine?

Owners and operators of stationary SI ICE who conduct performance tests must follow the procedures in paragraphs (a) through (f) of this section.

(a) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]

(b) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]

(c) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]

SECTION E. Source Group Restrictions.

- (d) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]
- (e) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]
- (f) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]
- (g) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT PERFORMANCE TESTS]

III. MONITORING REQUIREMENTS.

- # 003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4237]**
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What are the monitoring requirements if I am an owner or operator of an emergency stationary SI internal combustion engine?
- (a) [N/A - THE ENGINE POWER IS NOT GREATER THAN OR EQUAL TO 500 HP]
 - (b) [N/A - THE ENGINE WAS BUILT BEFORE JANUARY 1, 2011]
 - (c) [N/A - THE ENGINE POWER IS GREATER THAN 130 HP]

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

- # 004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4245]**
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?
- Owners or operators of stationary SI ICE must meet the following notification, reporting and recordkeeping requirements.
- (a) Owners and operators of all stationary SI ICE must keep records of the information in paragraphs (a)(1) through (4) of this section.
 - (1) All notifications submitted to comply with this subpart and all documentation supporting any notification.
 - (2) Maintenance conducted on the engine.
 - (3) If the stationary SI internal combustion engine is a certified engine, documentation from the manufacturer that the engine is certified to meet the emission standards and information as required in 40 CFR parts 90, 1048, 1054, and 1060, as applicable.
 - (4) If the stationary SI internal combustion engine is not a certified engine or is a certified engine operating in a non-certified manner and subject to § 60.4243(a)(2), documentation that the engine meets the emission standards.
 - (b) [N/A - THE ENGINE MEETS THE STANDARDS APPLICABLE TO NON-EMERGENCY ENGINES]
 - (c) [N/A - THE ENGINE POWER IS NOT GREATER THAN OR EQUAL TO 500 HP]
 - (d) [N/A - THE ENGINE IS NOT REQUIRED TO CONDUCT A PERFORMANCE TEST]

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

SECTION E. Source Group Restrictions.

VII. ADDITIONAL REQUIREMENTS.

**# 005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4230]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
Am I subject to this subpart?**

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary spark ignition (SI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (6) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [THE FACILITY IS NOT A MANUFACTURER OF STATIONARY SI ICE]

(2) [THE FACILITY IS NOT A MANUFACTURER OF STATIONARY SI ICE]

(3) [THE FACILITY IS NOT A MANUFACTURER OF STATIONARY SI ICE]

(4) Owners and operators of stationary SI ICE that commence construction after June 12, 2006, where the stationary SI ICE are manufactured:

(i) [N/A - THE ENGINE POWER IS NOT GREATER THAN OR EQUAL TO 500 HP]

(ii) [N/A - THE ENGINE POWER IS NOT GREATER THAN OR EQUAL TO 500 HP AND LESS THAN 1,350 HP]

(iii) on or after July 1, 2008, for engines with a maximum engine power less than 500 HP; or

(iv) on or after January 1, 2009, for emergency engines with a maximum engine power greater than 19 KW (25 HP).

(5) [N/A - THE ENGINE HAS NOT BEEN MODIFIED OR RECONSTRUCTED]

(6) The provisions of §60.4236 of this subpart are applicable to all owners and operators of stationary SI ICE that commence construction after June 12, 2006.

(b) [N/A - THE ENGINE IS NOT BEING TESTED AT AN ENGINE TEST CELL/STAND]

(c) [N/A - THE FACILITY WILL HAVE A FACILITY PERMIT]

(d) [N/A - THE ENGINE DOES NOT USE ALCOHOL BASED FUELS]

(e) [N/A - THE ENGINE DOES NOT REQUIRE A NATIONAL SECURITY EXEMPTION]

(f) [N/A - THE ENGINE IS NOT A TEMPORARY REPLACEMENT]

**# 006 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4234]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
How long must I meet the emission standards if I am an owner or operator of a stationary SI internal combustion engine?**

Owners and operators of stationary SI ICE must operate and maintain stationary SI ICE that achieve the emission standards as required in § 60.4233 over the entire life of the engine.

**# 007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4236]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What is the deadline for importing or installing stationary SI ICE produced in the previous model year?**

(a) After July 1, 2010, owners and operators may not install stationary SI ICE with a maximum engine power of less than 500 HP that do not meet the applicable requirements in § 60.4233.

(b) After July 1, 2009, owners and operators may not install stationary SI ICE with a maximum engine power of greater than or equal to 500 HP that do not meet the applicable requirements in § 60.4233, except that lean burn engines with a maximum engine power greater than or equal to 500 HP and less than 1,350 HP that do not meet the applicable requirements in § 60.4233 may not be installed after January 1, 2010.

SECTION E. Source Group Restrictions.

(c) For emergency stationary SI ICE with a maximum engine power of greater than 19 KW (25 HP), owners and operators may not install engines that do not meet the applicable requirements in § 60.4233 after January 1, 2011.

(d) In addition to the requirements specified in § 60.4231 and 60.4233, it is prohibited to import stationary SI ICE less than or equal to 19 KW (25 HP), stationary rich burn LPG SI ICE, and stationary gasoline SI ICE that do not meet the applicable requirements specified in paragraphs (a), (b), and (c) of this section, after the date specified in paragraph (a), (b), and (c) of this section.

(e) The requirements of this section do not apply to owners and operators of stationary SI ICE that have been modified or reconstructed, and they do not apply to engines that were removed from one existing location and reinstalled at a new location.

008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4243]

Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines

What are my compliance requirements if I am an owner or operator of a stationary SI internal combustion engine?

(a) If you are an owner or operator of a stationary SI internal combustion engine that is manufactured after July 1, 2008, and must comply with the emission standards specified in § 60.4233(a) through (c), you must comply by purchasing an engine certified to the emission standards in § 60.4231(a) through (c), as applicable, for the same engine class and maximum engine power. In addition, you must meet one of the requirements specified in (a)(1) and (2) of this section.

(1) If you operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, you must keep records of conducted maintenance to demonstrate compliance, but no performance testing is required if you are an owner or operator. You must also meet the requirements as specified in 40 CFR part 1068, subparts A through D, as they apply to you. If you adjust engine settings according to and consistent with the manufacturer's instructions, your stationary SI internal combustion engine will not be considered out of compliance.

(i) [N/A - THE ENGINE HAS NOT BEEN MODIFIED OR RECONSTRUCTED]

(2) If you do not operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, your engine will be considered a non-certified engine, and you must demonstrate compliance according to (a)(2)(i) through (iii) of this section, as appropriate.

(i) [N/A - THE ENGINE POWER IS GREATER THAN 100 HP]

(ii) If you are an owner or operator of a stationary SI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test within 1 year of engine startup to demonstrate compliance.

(iii) [N/A - THE ENGINE POWER IS NOT GREATER THAN 500 HP]

(b) If you are an owner or operator of a stationary SI internal combustion engine and must comply with the emission standards specified in § 60.4233(d) or (e), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) and (2) of this section.

(1) Purchasing an engine certified according to procedures specified in this subpart, for the same model year and demonstrating compliance according to one of the methods specified in paragraph (a) of this section.

(2) Purchasing a non-certified engine and demonstrating compliance with the emission standards specified in § 60.4233(d) or (e) and according to the requirements specified in § 60.4244, as applicable, and according to paragraphs (b)(2)(i) and (ii) of this section.

(i) If you are an owner or operator of a stationary SI internal combustion engine greater than 25 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions.

SECTION E. Source Group Restrictions.

In addition, you must conduct an initial performance test to demonstrate compliance.

(ii) [N/A - THE ENGINE POWER IS NOT GREATER THAN 500 HP]

(c) [N/A - THE ENGINE HAS NOT BEEN MODIFIED OR RECONSTRUCTED]

(d) Emergency stationary ICE may be operated for the purpose of maintenance checks and readiness testing, provided that the tests are recommended by Federal, State or local government, the manufacturer, the vendor, or the insurance company associated with the engine. Maintenance checks and readiness testing of such units is limited to 100 hours per year. There is no time limit on the use of emergency stationary ICE in emergency situations. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that Federal, State, or local standards require maintenance and testing of emergency ICE beyond 100 hours per year. Emergency stationary ICE may operate up to 50 hours per year in non-emergency situations, but those 50 hours are counted towards the 100 hours per year provided for maintenance and testing. The 50 hours per year for non-emergency situations cannot be used for peak shaving or to generate income for a facility to supply power to an electric grid or otherwise supply power as part of a financial arrangement with another entity. For owners and operators of emergency engines, any operation other than emergency operation, maintenance and testing, and operation in non-emergency situations for 50 hours per year, as permitted in this section, is prohibited.

(e) Owners and operators of stationary SI natural gas fired engines may operate their engines using propane for a maximum of 100 hours per year as an alternative fuel solely during emergency operations, but must keep records of such use. If propane is used for more than 100 hours per year in an engine that is not certified to the emission standards when using propane, the owners and operators are required to conduct a performance test to demonstrate compliance with the emission standards of § 60.4233.

(f) If you are an owner or operator of a stationary SI internal combustion engine that is less than or equal to 500 HP and you purchase a non-certified engine or you do not operate and maintain your certified stationary SI internal combustion engine and control device according to the manufacturer's written emission-related instructions, you are required to perform initial performance testing as indicated in this section, but you are not required to conduct subsequent performance testing unless the stationary engine is rebuilt or undergoes major repair or maintenance. A rebuilt stationary SI ICE means an engine that has been rebuilt as that term is defined in 40 CFR 94.11(a).

(g) It is expected that air-to-fuel ratio controllers will be used with the operation of three-way catalysts/non-selective catalytic reduction. The AFR controller must be maintained and operated appropriately in order to ensure proper operation of the engine and control device to minimize emissions at all times.

(h) [N/A - THE ENGINE POWER IS LESS THAN 500 HP]

009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4246]
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines
What parts of the General Provisions apply to me?

Table 3 to this subpart shows which parts of the General Provisions in § § 60.1 through 60.19 apply to you.



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.




SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

The following sources are not subject to any work practice standards, testing, monitoring, recordkeeping or reporting requirements:

- PowrMatic Power Flame Burner 1.625 MMBtu per hour natural gas fired space heater
- Bryan Boilers 2.4 MMBtu per hour natural gas fired space heater



***** End of Report *****
