

Application Type Renewal
Facility Type Non-Municipal
Major / Minor Minor

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Application No. PA0084174
APS ID 1007796
Authorization ID 1446134

Applicant and Facility Information

Applicant Name	<u>Envigo Global Services Inc.</u>	Facility Name	<u>Envigo Global Services Inc.</u>
Applicant Address	<u>310 Swamp Bridge Road</u> <u>Denver, PA 17517-8723</u>	Facility Address	<u>310 Swamp Bridge Road</u> <u>Denver, PA 17517-8723</u>
Applicant Contact	<u>Daniel Harp</u>	Facility Contact	<u>Daniel Harp</u>
Applicant Phone	<u>(717) 335-1281</u>	Facility Phone	<u>(717) 335-1281</u>
Client ID	<u>25810</u>	Site ID	<u>451861</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>West Cocalico Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Lancaster</u>
Date Application Received	<u>July 3, 2023</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>July 17, 2023</u>	If No, Reason	<u></u>
Purpose of Application	<u>NPDES Renewal.</u>		

Summary of Review

Envigo Global Services Inc. has applied to the Pennsylvania Department of Environmental Protection (DEP) for reissuance of its National Pollutant Discharge Elimination System (NPDES) permit. The existing permit was issued on December 27, 2018, and became effective on January 1, 2019, authorizing discharge of treated sewage from the facility into the UNT to Cocalico Creek. The existing permit expiration date was December 31, 2023, and the permit has been administratively extended since that time. A transfer permit was issued on November 30, 2021, transferring the permit to Envigo Global Services Inc.

Changes in this renewal: A Total Copper limit has been added. E. Coli monitoring has been added. A more stringent TRC limit has been added.

Sludge use and disposal description and location(s): Sludge holding tank with offsite disposal

Supplemental information for this facility is provided at the end of this fact sheet.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Benjamin R. Lockwood Benjamin R. Lockwood / Environmental Engineering Specialist	March 7, 2024
X		Maria D. Bebenek for Daniel W. Martin, P.E. / Environmental Engineer Manager	March 22, 2024

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.05
Latitude	40° 15' 40"	Longitude	76° 8' 21"
Quad Name		Quad Code	
Wastewater Description:		Sewage Effluent	
Receiving Waters	Unnamed Tributary to Cocalico Creek (WWF)	Stream Code	7730
NHD Com ID	57461247	RMI	0.45
Drainage Area	0.58 mi ²	Yield (cfs/mi ²)	0.12
Q ₇₋₁₀ Flow (cfs)	0.0696	Q ₇₋₁₀ Basis	USGS Stream Gage
Elevation (ft)	448	Slope (ft/ft)	
Watershed No.	7-J	Chapter 93 Class.	WWF
Existing Use	N/A	Existing Use Qualifier	N/A
Exceptions to Use	N/A	Exceptions to Criteria	N/A
Assessment Status	Impaired		
Cause(s) of Impairment	Pathogens, Habitat Alterations		
Source(s) of Impairment	Source Unknown, Habitat Modification – Other Than Hydromodification		
TMDL Status	N/A	Name	N/A
Nearest Downstream Public Water Supply Intake	Lancaster City Water Bureau		
PWS Waters	Conestoga River	Flow at Intake (cfs)	
PWS RMI		Distance from Outfall (mi)	29.7

Changes Since Last Permit Issuance: The USGS PA StreamStats provided a drainage area of 0.58 mi². A Q₇₋₁₀ flow of .0696 cubic feet per second (cfs) was determined by establishing a correlation to the yield of USGS Gage Station # 01576500 on the Conestoga River. The Q₇₋₁₀ and drainage area at the gage are 38.6 cfs and 324 mi², respectively. These values are taken from the USGS document "Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania." The Q₇₋₁₀ runoff rate at the gage station was calculated as follows:

$$\text{Yield} = (38.6 \text{ cfs}) / 324 \text{ mi}^2 = 0.12 \text{ cfs/mi}^2$$

The drainage area at the discharge point, taken from USGS PA StreamStats = 0.58 mi²

The Q₇₋₁₀ at the discharge point = 0.58 mi² x 0.12 cfs/mi² = 0.0696 cfs

Other Comments: None

Treatment Facility Summary				
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary w/ Phosphorus Removal	Extended Aeration	Sodium Hypochlorite	0.05
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.05		Not Overloaded	Sludge Holding	Other WWTP

Changes Since Last Permit Issuance: None

Other Comments: There are 2 treatment trains each consisting of: Comminutor – 2 Equalization Tanks – 6 Aeration Tanks – 2 Clarifiers – Chlorine Contact Tank – Post Aeration Tank - Sludge Holding Tank – Outfall to UNT to Cocalico Creek

Compliance History	
Summary of DMRs:	A summary of past DMR effluent data is presented on the next page of this fact sheet.
Summary of Inspections:	<p>2/4/2019: A routine inspection was conducted. The chlorine contact tank had some white billowy foam, and the sodium hypochlorite disinfection system was functioning upon inspection. Field results were collected from the outfall pipe, and were within permitted limits. An accumulation of solids and hair were visible at the outfall pipe. Solids could be seen down slope between the outfall pipe and receiving stream. It was confirmed on 2/8/19 that the solids had been cleaned.</p> <p>12/6/2019: A routine inspection was conducted. The chlorine contact tank was aerated and had some white billowy foam. A defoamer is used as needed. The sodium hypochlorite system was functioning upon inspection. Field results were collected from the outfall and were within permitted limits. An accumulation of solids and hair were again visible at the outfall pipe.</p> <p>3/3/2020: A Notice of Violation (NOV) was issued for failure to pay annual fees.</p> <p>5/26/2020: An administrative inspection was conducted. All treatment units were online and operable. There were no outstanding issues or needs at the time of inspection.</p> <p>10/11/2021: A routine inspection was conducted. The chlorine contact tank was aerated, and had white billowy foam. The sodium hypochlorite system was functioning upon inspection. Field results were collected and within permitted limits. The outfall was observed, and the effluent appeared clear. The ground underneath the outfall appeared free of solids and hair accumulation. The vegetated area just downhill of the outfall prior to the stream had evidence of small accumulations of hair.</p>

Other Comments: There are no open violations for this facility for the Clean Water Program.

Compliance History

DMR Data for Outfall 001 (from January 1, 2023 to December 31, 2023)

Parameter	DEC-23	NOV-23	OCT-23	SEP-23	AUG-23	JUL-23	JUN-23	MAY-23	APR-23	MAR-23	FEB-23	JAN-23
Flow (MGD) Average Monthly	0.030	0.023	0.020	0.020	0.023	0.027	0.027	0.024	0.024	0.022	0.021	0.025
Flow (MGD) Daily Maximum	0.055	0.044	0.031	0.028	0.036	0.053	0.044	0.038	0.043	0.036	0.29	0.043
pH (S.U.) Instantaneous Minimum	5.21	6.01	6.01	6.58	6.80	6.78	6.94	6.71	6.17	6.92	6.18	6.15
pH (S.U.) Instantaneous Maximum	7.54	7.67	7.69	7.59	8.59	7.97	7.86	8.19	7.69	7.78	7.50	7.83
DO (mg/L) Instantaneous Minimum	7.49	6.67	5.86	5.75	6.89	6.28	6.89	7.20	7.29	8.65	9.42	9.12
TRC (mg/L) Average Monthly	0.005	0.013	0.002	< 0.01	< 0.01	0.004	< 0.001	< 0.01	< 0.01	0.01	0.01	0.01
TRC (mg/L) Instantaneous Maximum	0.006	0.07	0.04	< 0.01	< 0.01	0.11	0.02	0.01	0.02	0.05	0.01	0.01
CBOD5 (mg/L) Average Monthly	12	3.7	5.7	3.25	4.2	3.45	5.8	8.45	8.95	6.85	8.85	5.7
TSS (mg/L) Average Monthly	8.8	6.0	7.8	4.0	4.5	4.6	4.66	< 4.0	20.0	16	7.4	4.00
Fecal Coliform (No./100 ml) Average Monthly	1	1.73	345.2	172.9	27.21	6.08	2.802	1.732	< 1	< 1	< 1	< 1
Fecal Coliform (No./100 ml) Instantaneous Maximum	1	3	608	431	96	37	22	3	1	< 1	< 1	< 1
Nitrate-Nitrite (mg/L) Average Monthly	17.4	24.7	19.7	12.9	5.28	2.785	9.88	15.8	16.1	11.44	17.55	6.03
Total Nitrogen (mg/L) Average Monthly	26.2	26.0	21.4	14.2	8.21	4.11	11.4	16.5	23.85	15.0	19.6	10.2
Ammonia (mg/L) Average Monthly	6.05	< 0.10	< 0.10	< 0.10	1.16	< 0.1	0.16	< 0.1	3.89	1.37	0.68	1.68
TKN (mg/L) Average Monthly	8.75	1.41	1.71	1.30	2.94	1.33	1.53	1.05	7.74	3.55	2.38	4.19

Total Phosphorus (mg/L) Average Monthly	0.74	0.39	0.42	0.95	1.07	0.675	9.32	1.41	4.755	2.95	3.78	5.81
Total Copper (mg/L) Average Monthly	0.046	0.02	0.013	0.012	0.009	0.008	0.077	0.023	0.0595	0.05	0.025	0.25
Total Zinc (mg/L) Average Monthly	0.825	0.193	0.059	0.072	0.045	0.063	0.067	0.077	0.1335	0.261	0.10	0.063
Total Hardness (mg/L) Average Monthly	431	333	343	369	305	269	293	330	291	363	338	319.5

Compliance History

Effluent Violations for Outfall 001, from: February 1, 2023 To: December 31, 2023

Parameter	Date	SBC	DMR Value	Units	Limit Value	Units
pH	12/31/23	Inst Min	5.21	S.U.	6.0	S.U.
Total Phosphorus	03/31/23	Avg Mo	2.95	mg/L	2.0	mg/L
Total Phosphorus	06/30/23	Avg Mo	9.32	mg/L	2.0	mg/L
Total Phosphorus	02/28/23	Avg Mo	3.78	mg/L	2.0	mg/L
Total Phosphorus	04/30/23	Avg Mo	4.755	mg/L	2.0	mg/L
Total Zinc	12/31/23	Avg Mo	0.825	mg/L	.3	mg/L

Existing Effluent Limitations and Monitoring Requirements

Outfall 001

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day)		Concentrations (mg/L)				Minimum Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	5.0	XXX	XXX	XXX	1/day	Grab
Total Residual Chlorine (TRC)	XXX	XXX	XXX	0.2	XXX	0.8	1/day	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5)	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
Total Suspended Solids	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000	XXX	10,000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200	XXX	1,000	2/month	Grab
Zinc, Total	XXX	XXX	XXX	0.3	XXX	0.7	2/month	8-Hr Composite
Hardness, Total (as CaCO3)	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Copper, Total	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Ammonia-Nitrogen Nov 1 - Apr 30	XXX	XXX	XXX	9.0	XXX	18	2/month	8-Hr Composite
Ammonia-Nitrogen May 1 - Oct 31	XXX	XXX	XXX	3.0	XXX	9.0	2/month	8-Hr Composite
Total Kjeldahl Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Nitrate-Nitrite as N	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Total Phosphorus	XXX	XXX	XXX	2.0	XXX	4.0	2/month	8-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Development of Effluent Limitations

Outfall No.	001	Design Flow (MGD)	.05
Latitude	40° 15' 40"	Longitude	76° 8' 21"
Wastewater Description: Sewage Effluent			

Technology-Based Limitations

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Water Quality-Based Limitations

CBOD₅, NH₃-N

Pursuant to 40 CFR § 122.44(d)(1)(i), more stringent requirements should be considered when pollutants are discharged at the levels which have the reasonable potential to cause or contribute to excursions above water quality standards.

WQM 7.0 ver. 1.1b is a water quality model designed to assist DEP in determining appropriate water quality based effluent limits (WQBELs) for carbonaceous biochemical oxygen demand (CBOD₅), ammonia (NH₃-N) and dissolved oxygen (D.O.). DEP's Technical Guidance No. 391-2000-007 provides the technical methods contained in WQM 7.0 for determining wasteload allocations and for determining recommended NPDES effluent limits for point source discharges. The model was utilized for this permit renewal. The model output indicated a CBOD₅ average monthly limit of 25 mg/l, an NH₃-N average monthly limit of 3.63 mg/l, and a D.O. minimum limit of 5.0 mg/l were protective of water quality. The flow data used to run the model was acquired from USGS PA StreamStats and is included as an attachment. The existing CBOD₅ limit of 25 mg/l is the same as the existing permit limit, and will remain. The existing NH₃-N limit of 3.0 mg/l is more stringent, and will remain in the permit.

Toxics

Effluent sample results for toxic pollutants reported on the renewal application were entered into DEP's Toxics Management Spreadsheet Version 1.4 to develop appropriate permit requirements for toxic pollutants of concern. The Toxics Management Spreadsheet combines the functions of PENTOXSD and DEP's Toxics Screening Analysis. Data was analyzed from the Water Quality Network (WQN) Station ID 273 from October 2004 to December 2018. DEP's Standard Operating Procedure (SOP) No. BPNPSM-PMT-033 (Establishing Effluent Limitations for Individual Sewage Permits) recommends using the 90th percentile of long-term data for background and discharge characteristics when using WQM 7.0. A 90th percentile analysis was performed on the data and resulted in a Stream pH of 8.4 and a Stream Hardness of 270 mg/l. Based on effluent sample results reported on the application, the Toxics Management Spreadsheet recommended a limit for Total Copper of 0.049 mg/l monthly average, and a limit for Total Zinc of 0.4 mg/l.

This data was analyzed based on the guidelines found in DEP's Water Quality Toxics Management Strategy (Document No. 361-0100-003) and DEP's SOP No. BPNPSM-PMT-033. The results are attached to this fact sheet. The Toxics Management Spreadsheet uses the following logic:

- a. Establish average monthly and instantaneous maximum (IMAX) limits in the draft permit where the maximum reported concentration exceeds 50% of the WQBEL.
- b. For non-conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 25% - 50% of the WQBEL.
- c. For conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 10%-50% of the WQBEL.

The existing permit has a monitoring requirement for Total Copper, and a limit of 0.3 mg/l average monthly for Total Zinc. The existing Total Zinc limit is more stringent and will remain in the permit. The past year of DMR data has been reviewed, and the facility is capable of meeting the Total Copper limit.

Additional Considerations

Chesapeake Bay Total Maximum Daily Load (TMDL)

DEP developed a strategy to comply with the EPA and Chesapeake Bay Foundation requirements by reducing point source loadings of Total Nitrogen (TN) and Total Phosphorus (TP). This strategy can be located in the *Pennsylvania Chesapeake Watershed Implementation Plan* (WIP), dated January 11, 2011. Subsequently, an update to the WIP was published as the Phase 2 WIP. As part of the Phase 2 WIP, a *Phase 2 Watershed Implementation Plan Wastewater Supplement* (Phase 2 Supplement) was developed, providing an update on TMDL implementation for point sources and DEP's current implementation strategy for wastewater. A new update to the WIP was published as the Phase 3 WIP in August 2019. As part of the Phase 3 WIP, a *Phase 3 Watershed Implementation Plan Wastewater Supplement* (Phase 3 Supplement) was developed, and was most recently revised on July 29, 2022, and is the basis for the development of any Chesapeake Bay related permit parameters. Sewage discharges have been prioritized based on their design flow to the Bay. The highest priority (Phases 1, 2, and 3) dischargers will receive annual Cap Loads based on their design flow on August 29, 2005 and concentrations of 6 mg/l TN and 0.8 mg/l TP. These limits may be achieved through a combination of treatment technology, credits, or offsets. For Phase 4 and 5 facilities, Cap Loads are not currently being implemented for renewed or amended permits for facilities that do not increase design flow.

Envigo is considered a Phase 5 discharger, with a design flow greater than 0.002 mgd and less than 0.2 mgd. According to the Phase 3 Supplement, issuance of permits with monitoring and reporting for Total Nitrogen (TN) and Total Phosphorus (TP) is recommended for any Phase 5 non-significant sewage facility. This is consistent with the existing permit monitoring requirements.

Dissolved Oxygen

A minimum D.O. limit of 5.0 mg/L is a D.O. water quality criterion found in 25 Pa. Code § 93.7(a). This limit is included in the existing NPDES permit based BPJ. It is still recommended to include this limit in the draft permit to ensure that the facility continues to achieve compliance with DEP water quality standards.

Total Phosphorus

For Total Phosphorus (TP), the current NPDES permit requires the permittee to comply with average monthly and IMAX limits of 2.0 mg/L and 4.0 mg/L, respectively. These existing limits will remain unchanged in the permit to protect the local watershed.

Total Hardness

Total Hardness is critical in the determination of Total Zinc limits. It was recommended that hardness be monitored when zinc is sampled. This requirement was in the existing permit, and will remain in the permit.

Fecal Coliform

PA Code § 92a.47.(a)(4) requires a monthly average limit of 200/100 mL as a geometric mean and an instantaneous maximum limit not greater than 1,000/100 mL from May through September for fecal coliform. PA Code § 92a.47.(a)(5) requires a monthly average limit of 2,000/100 mL as a geometric mean and an instantaneous maximum limit not greater than 10,000/100 mL from October through April for fecal coliform. These limits are consistent with the existing permit.

E. Coli

PA Code § 92a.61 requires IMAX reporting of E. Coli. Per DEP's SOP No. BCW-PMT-033, sewage dischargers with a design flow of ≥ 0.05 mgd and < 1 mgd will include E. Coli monitoring with a frequency of 1/quarter. This parameter has been added to the renewal permit.

Total Residual Chlorine

The attached computer printout utilizes the equations and calculations as presented in the Department's May 1, 2003 Implementation Guidance for Total Residual Chlorine (TRC) (ID No. 391-2000-015) for developing chlorine limitations. The Guidance references Chapter 92, Section 92.2d (3) which establishes a standard BAT limit of 0.5 mg/l unless a facility-specific BAT has been developed. The attached printout indicates that a water quality limit of 0.14 mg/l would be needed to prevent toxicity concerns. The more stringent limits of 0.14 mg/l average monthly, and 0.42 mg/l instantaneous maximum will be added to the permit. A review of the past year of DMR data shows the facility will be capable of meeting these more stringent limits.

Sampling Frequency & Sample Type

The monitoring requirements were established based on BPJ and/or Table 6-3 of DEP's Technical Guidance No. 362-0400-001.

Anti-Degradation

The effluent limits for this discharge have been developed to ensure that existing instream water uses and the level of water quality necessary to protect the existing uses are maintained and protected. No High Quality Waters are impacted by this discharge. No Exceptional Value Waters are impacted by this discharge.

303(d) Listed Streams

The discharge is located on a stream segment that is designated on the 303(d) list as impaired. There is a recreational impairment for pathogens due to an unknown source. There is an aquatic life impairment for habitat alterations due to habitat modifications – other than hydromodification.

Class A Wild Trout Fisheries

No Class A Wild Trout Fisheries are impacted by this discharge.

Anti-Backsliding

Pursuant to 40 CFR § 122.44(l)(1), all proposed permit requirements addressed in this fact sheet are at least as stringent as the requirements implemented in the existing NPDES permit unless any exceptions are addressed by DEP in this fact sheet.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (386-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.14	XXX	0.46	1/day	Grab
CBOD5	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
TSS	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	XXX	Report	1/quarter	Grab
Nitrate-Nitrite	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Ammonia Nov 1 - Apr 30	XXX	XXX	XXX	9.0	XXX	18	2/month	8-Hr Composite
Ammonia May 1 - Oct 31	XXX	XXX	XXX	3.0	XXX	9.0	2/month	8-Hr Composite
TKN	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite

Outfall 001 , Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Total Phosphorus	XXX	XXX	XXX	2.0	XXX	4.0	2/month	8-Hr Composite
Total Copper	XXX	XXX	XXX	0.049	XXX	0.12	2/month	8-Hr Composite
Total Zinc	XXX	XXX	XXX	0.3	XXX	0.7	2/month	8-Hr Composite
Total Hardness	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite


Compliance Sampling Location: Outfall 001

Other Comments: None

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment)
<input checked="" type="checkbox"/>	Toxics Management Spreadsheet (see Attachment)
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment)
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment)
<input checked="" type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input checked="" type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input checked="" type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: SOP: BCW-PMT-033, BCW-PMT-002
<input type="checkbox"/>	Other:

Envigo Global Services Inc. PA0084174 Outfall 001

Region ID: PA
Workspace ID: PA20240306153135305000
Clicked Point (Latitude, Longitude): 40.26129, -76.14113
Time: 2024-03-06 10:31:59 -0500

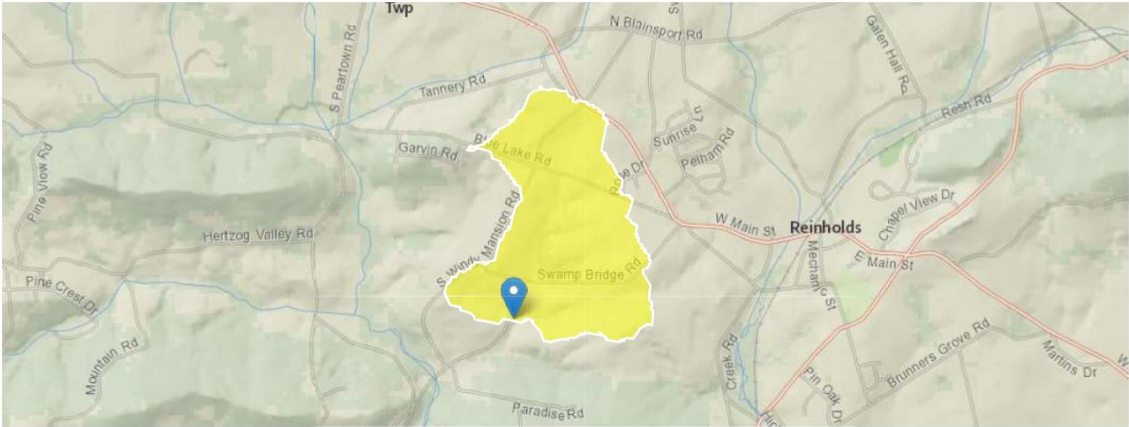

⊞ Collapse All

➤ Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
BSLOPD	Mean basin slope measured in degrees	2.6136	degrees
DRNAREA	Area that drains to a point on a stream	0.58	square miles
ROCKDEP	Depth to rock	4	feet
URBAN	Percentage of basin with urban development	0.5386	percent

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.58	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	2.6136	degrees	1.7	6.4
ROCKDEP	Depth to Rock	4	feet	4.13	5.21
URBAN	Percent Urban	0.5386	percent	0	89

Low-Flow Statistics Disclaimers [Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.0264	ft^3/s
30 Day 2 Year Low Flow	0.0438	ft^3/s
7 Day 10 Year Low Flow	0.00744	ft^3/s
30 Day 10 Year Low Flow	0.0135	ft^3/s
90 Day 10 Year Low Flow	0.0329	ft^3/s

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.19.4

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.19.4

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1

TRC_CALC

1A	B	C	D	E	F	G
2	TRC EVALUATION					
3	Input appropriate values in B4:B8 and E4:E7					
4	0.0696	= Q stream (cfs)		0.5	= CV Daily	
5	0.05	= Q discharge (MGD)		0.5	= CV Hourly	
6	30	= no. samples		1	= AFC_Partial Mix Factor	
7	0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor	
8	0	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)	
9	0.5	= BAT/BPJ Value		720	= CFC_Criteria Compliance Time (min)	
	0	= % Factor of Safety (FOS)			= Decay Coefficient (K)	
10	Source	Reference	AFC Calculations		Reference	CFC Calculations
11	TRC	1.3.2.iii	WLA afc = 0.306		1.3.2.iii	WLA cfc = 0.291
12	PENTOXSD TRG	5.1a	LTAMULT afc = 0.373		5.1c	LTAMULT cfc = 0.581
13	PENTOXSD TRG	5.1b	LTA_afc= 0.114		5.1d	LTA_cfc = 0.169
14						
15	Source	Effluent Limit Calculations				
16	PENTOXSD TRG	5.1f	AML MULT = 1.231			
17	PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.140		AFC	
18			INST MAX LIMIT (mg/l) = 0.459			
	WLA afc	(.019/e(-k*AFC_tc)) + [(AFC_Yc*Qs*.019/Qd*e(-k*AFC_tc))... ...+ Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)				
	LTAMULT afc	EXP((0.5*LN(cvh^2+1))-2.326*LN(cvh^2+1)^0.5)				
	LTA_afc	wla_afc*LTAMULT_afc				
	WLA_cfc	(.011/e(-k*CFC_tc)) + [(CFC_Yc*Qs*.011/Qd*e(-k*CFC_tc))... ...+ Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)				
	LTAMULT_cfc	EXP((0.5*LN(cvd^2/no_samples+1))-2.326*LN(cvd^2/no_samples+1)^0.5)				
	LTA_cfc	wla_cfc*LTAMULT_cfc				
	AML MULT	EXP(2.326*LN((cvd^2/no_samples+1)^0.5)-0.5*LN(cvd^2/no_samples+1))				
	AVG MON LIMIT	MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)*AML_MULT)				
	INST MAX LIMIT	1.5*((av_mon_limit/AML_MULT)/LTAMULT_afc)				



Discharge Information

Instructions Discharge Stream

Facility: **Envigo Global Services Inc** NPDES Permit No.: **PA0084174** Outfall No.: **001**
Evaluation Type: **Major Sewage / Industrial Waste** Wastewater Description: **Sewage Effluent**

Discharge Characteristics								
Design Flow (MGD)*	Hardness (mg/l)*	pH (SU)*	Partial Mix Factors (PMFs)				Complete Mix Times (min)	
			AFC	CFC	THH	CRL	Q ₇₋₁₀	Q _h
0.05	431	6.02						

				0 if left blank		0.5 if left blank		0 if left blank			1 if left blank			
Discharge Pollutant				Units	Max Discharge Conc	Trib Conc	Stream Conc	Daily CV	Hourly CV	Stream CV	Fate Coeff	FOS	Criteria Mod	Chem Transl
Group 1	Total Dissolved Solids (PWS)	mg/L												
	Chloride (PWS)	mg/L												
	Bromide	mg/L												
	Sulfate (PWS)	mg/L												
	Fluoride (PWS)	mg/L												
Group 2	Total Aluminum	µg/L												
	Total Antimony	µg/L												
	Total Arsenic	µg/L												
	Total Barium	µg/L												
	Total Beryllium	µg/L												
	Total Boron	µg/L												
	Total Cadmium	µg/L												
	Total Chromium (III)	µg/L												
	Hexavalent Chromium	µg/L												
	Total Cobalt	µg/L												
	Total Copper	mg/L	0.082											
	Free Cyanide	µg/L												
	Total Cyanide	µg/L												
	Dissolved Iron	µg/L												
	Total Iron	µg/L												
	Total Lead	µg/L												
	Total Manganese	µg/L												
	Total Mercury	µg/L												
	Total Nickel	µg/L												
	Total Phenols (Phenolics) (PWS)	µg/L												
	Total Selenium	µg/L												
	Total Silver	µg/L												
	Total Thallium	µg/L												
	Total Zinc	mg/L	0.319											
	Total Molybdenum	µg/L												
	Acrolein	µg/L	<											
	Acrylamide	µg/L	<											
	Acrylonitrile	µg/L	<											
	Benzene	µg/L	<											
	Bromoform	µg/L	<											

Group 3	Carbon Tetrachloride	µg/L	<																	
	Chlorobenzene	µg/L																		
	Chlorodibromomethane	µg/L	<																	
	Chloroethane	µg/L	<																	
	2-Chloroethyl Vinyl Ether	µg/L	<																	
	Chloroform	µg/L	<																	
	Dichlorobromomethane	µg/L	<																	
	1,1-Dichloroethane	µg/L	<																	
	1,2-Dichloroethane	µg/L	<																	
	1,1-Dichloroethylene	µg/L	<																	
	1,2-Dichloropropane	µg/L	<																	
	1,3-Dichloropropylene	µg/L	<																	
	1,4-Dioxane	µg/L	<																	
	Ethylbenzene	µg/L	<																	
	Methyl Bromide	µg/L	<																	
	Methyl Chloride	µg/L	<																	
	Methylene Chloride	µg/L	<																	
	1,1,2,2-Tetrachloroethane	µg/L	<																	
	Tetrachloroethylene	µg/L	<																	
	Toluene	µg/L	<																	
	1,2-trans-Dichloroethylene	µg/L	<																	
	1,1,1-Trichloroethane	µg/L	<																	
	1,1,2-Trichloroethane	µg/L	<																	
	Trichloroethylene	µg/L	<																	
	Vinyl Chloride	µg/L	<																	
Group 4	2-Chlorophenol	µg/L	<																	
	2,4-Dichlorophenol	µg/L	<																	
	2,4-Dimethylphenol	µg/L	<																	
	4,6-Dinitro-o-Cresol	µg/L	<																	
	2,4-Dinitrophenol	µg/L	<																	
	2-Nitrophenol	µg/L	<																	
	4-Nitrophenol	µg/L	<																	
	p-Chloro-m-Cresol	µg/L	<																	
	Pentachlorophenol	µg/L	<																	
	Phenol	µg/L	<																	
	2,4,6-Trichlorophenol	µg/L	<																	
Group 5	Acenaphthene	µg/L	<																	
	Acenaphthylene	µg/L	<																	
	Anthracene	µg/L	<																	
	Benzidine	µg/L	<																	
	Benzo(a)Anthracene	µg/L	<																	
	Benzo(a)Pyrene	µg/L	<																	
	3,4-Benzofluoranthene	µg/L	<																	
	Benzo(ghi)Perylene	µg/L	<																	
	Benzo(k)Fluoranthene	µg/L	<																	
	Bis(2-Chloroethoxy)Methane	µg/L	<																	
	Bis(2-Chloroethyl)Ether	µg/L	<																	
	Bis(2-Chloroisopropyl)Ether	µg/L	<																	
	Bis(2-Ethylhexyl)Phthalate	µg/L	<																	
	4-Bromophenyl Phenyl Ether	µg/L	<																	
	Butyl Benzyl Phthalate	µg/L	<																	
	2-Chloronaphthalene	µg/L	<																	
	4-Chlorophenyl Phenyl Ether	µg/L	<																	
	Chrysene	µg/L	<																	
	Dibenzo(a,h)Anthracene	µg/L	<																	
	1,2-Dichlorobenzene	µg/L	<																	
	1,3-Dichlorobenzene	µg/L	<																	
	1,4-Dichlorobenzene	µg/L	<																	
	3,3-Dichlorobenzidine	µg/L	<																	
	Diethyl Phthalate	µg/L	<																	
	Dimethyl Phthalate	µg/L	<																	
	Di-n-Butyl Phthalate	µg/L	<																	
	2,4-Dinitrotoluene	µg/L	<																	

21



Toxics Management Spreadsheet
Version 1.4, May 2023

Stream / Surface Water Information

Envigo Global Services Inc, NPDES Permit No. PA0084174, Outfall 001

Instructions

Discharge

Stream

Receiving Surface Water Name: **UNT to Cocalico Creek** No. Reaches to Model: **1**

- ☒ Statewide Criteria
- ☐ Great Lakes Criteria
- ☐ ORSANCO Criteria

Location	Stream Code*	RMI*	Elevation (ft)*	DA (mi ²)*	Slope (ft/ft)	PWS Withdrawal (MGD)	Apply Fish Criteria*
Point of Discharge	007730	0.45	448	0.58			Yes
End of Reach 1	007730	0	420	1.01			Yes

Q₇₋₁₀

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	0.45	0.1										270	8.4		
End of Reach 1	0	0.1										270	8.4		

Q_h

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness	pH	Hardness	pH
Point of Discharge	0.45														
End of Reach 1	0														



Toxics Management Spreadsheet
Version 1.4, May 2023

Model Results

Envigo Global Services Inc, NPDES Permit No. PA0084174, Outfall 001

Instructions

Results

RETURN TO INPUTS

SAVE AS PDF

PRINT

All

Inputs

Results

Limits

☐ Hydrodynamics

☒ Wasteload Allocations

☒ AFC

CCT (min): 0.201 PMF: 1 Analysis Hardness (mg/l): 362.01 Analysis pH: 6.26

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Copper	0	0		0	45.164	47.0	82.3	Chem Translator of 0.96 applied
Total Zinc	0	0		0	348.544	356	624	Chem Translator of 0.978 applied

23

☒ CFC

CCT (min): 0.201 PMF: 1 Analysis Hardness (mg/l): 362.01 Analysis pH: 6.26

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Copper	0	0		0	26.886	28.0	49.0	Chem Translator of 0.96 applied
Total Zinc	0	0		0	351.395	356	624	Chem Translator of 0.986 applied

☒ THH

CCT (min): 0.201 PMF: 1 Analysis Hardness (mg/l): N/A Analysis pH: N/A

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Copper	0	0		0	N/A	N/A	N/A	
Total Zinc	0	0		0	N/A	N/A	N/A	

☒ CRL

CCT (min): 0.293 PMF: 1 Analysis Hardness (mg/l): N/A Analysis pH: N/A

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Copper	0	0		0	N/A	N/A	N/A	
Total Zinc	0	0		0	N/A	N/A	N/A	

☒ Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

Pollutants	Mass Limits			Concentration Limits			Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	MDL	AML	MDL	IMAX			
Total Copper	0.02	0.032	0.076	0.049	0.076	0.12	0.049	CFC	Discharge Conc ≥ 50% WQBEL (RP)
Total Zinc	0.17	0.26	0.62	0.4	0.62	1.	0.4	AFC	Discharge Conc ≥ 50% WQBEL (RP)

☒ Other Pollutants without Limits or Monitoring

The following pollutants do not require effluent limits or monitoring based on water quality because reasonable potential to exceed water quality criteria was not determined and the discharge concentration was less than thresholds for monitoring, or the pollutant was not detected and a sufficiently sensitive analytical method was used (e.g., <= Target QL).

Pollutants	Governing WQBEL	Units	Comments

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07J	7730	Trib 07730 to Cocalico Creek	0.450	448.00	0.58	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)						Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.100	0.00	0.07	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Envigo	PA0084174	0.0500	0.0500	0.0500	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07J	7730 Trib	07730 to Cocalico Creek	0.000	420.00	1.01	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)				(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.100	0.00	0.12	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

WQM 7.0 Hydrodynamic Outputs

<u>SWP Basin</u>		<u>Stream Code</u>				<u>Stream Name</u>						
07J		7730				Trib 07730 to Cocalico Creek						
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis Flow	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
	(cfs)	(cfs)	(cfs)	(cfs)	(ft/ft)	(ft)	(ft)		(fps)	(days)	(°C)	
Q7-10 Flow												
0.450	0.07	0.00	0.07	.0773	0.01178	.375	4.51	12.03	0.09	0.316	22.63	7.00
Q1-10 Flow												
0.450	0.04	0.00	0.04	.0773	0.01178	NA	NA	NA	0.08	0.351	23.17	7.00
Q30-10 Flow												
0.450	0.09	0.00	0.09	.0773	0.01178	NA	NA	NA	0.09	0.290	22.25	7.00

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		

WQM 7.0 Wasteload Allocations

<u>SWP Basin</u>		<u>Stream Code</u>		<u>Stream Name</u>					
07J		7730		Trib 07730 to Cocalico Creek					
NH3-N Acute Allocations									
RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction		
0.450	Envigo	12.88	20.3	12.88	20.3	0	0		
NH3-N Chronic Allocations									
RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction		
0.450	Envigo	1.63	3.63	1.63	3.63	0	0		
Dissolved Oxygen Allocations									
RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
0.45	Envigo	25	25	3.63	3.63	5	5	0	0

WQM 7.0 D.O.Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07J	7730	Trib 07730 to Cocalico Creek		
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
0.450	0.050	22.632	7.000	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
4.511	0.375	12.033	0.087	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
14.11	1.370	1.91	0.857	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
6.536	27.603	Owens	5	
<u>Reach Travel Time (days)</u>	Subreach Results			
0.316	TravTime (days)	CBOD5 (mg/L)	NH3-N (mg/L)	D.O. (mg/L)
	0.032	13.43	1.86	6.99
	0.063	12.79	1.81	7.21
	0.095	12.18	1.76	7.34
	0.127	11.60	1.71	7.43
	0.158	11.05	1.67	7.49
	0.190	10.52	1.62	7.55
	0.222	10.02	1.58	7.61
	0.253	9.54	1.54	7.65
	0.285	9.08	1.50	7.70
	0.316	8.65	1.46	7.75

WQM 7.0 Effluent Limits

<u>SWP Basin</u>		<u>Stream Code</u>	<u>Stream Name</u>				
07J		7730	Trib 07730 to Cocalico Creek				
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
0.450	Envigo	PA0084174	0.050	CBOD5	25		
				NH3-N	3.63	7.26	
				Dissolved Oxygen			5