

Application Type Renewal
Facility Type Municipal
Major / Minor Minor

NPDES PERMIT FACT SHEET INDIVIDUAL SEWAGE

Application No. PA0087661
APS ID 22959
Authorization ID 1393549

Applicant and Facility Information

| | |
|--|---|
| <p>Applicant Name <u>Chestnut Ridge Area Joint Authority</u></p> <p>Applicant Address <u>320 Lane Metal Road</u> <u>New Paris, PA 15554-9238</u></p> <p>Applicant Contact <u>Douglas Vitovich</u></p> <p>Applicant Phone <u>(814) 623-9009</u></p> <p>Client ID <u>92213</u></p> <p>Ch 94 Load Status <u>Not Overloaded</u></p> <p>Connection Status <u>No Limitations</u></p> <p>Date Application Received <u>April 26, 2022</u></p> <p>Date Application Accepted <u>May 5, 2022</u></p> <p>Purpose of Application <u>This is an application request for NPDES renewal.</u></p> | <p>Facility Name <u>Chestnut Ridge Area Joint Municipal Authority STP</u></p> <p>Facility Address <u>320 Lane Metal Road</u> <u>New Paris, PA 15554-9238</u></p> <p>Facility Contact <u>Douglas Vitovich</u></p> <p>Facility Phone <u>(814) 623-9009</u></p> <p>Site ID <u>461094</u></p> <p>Municipality <u>East Saint Clair Township</u></p> <p>County <u>Bedford</u></p> <p>EPA Waived? <u>No</u></p> <p>If No, Reason <u>Significant CB Discharge</u></p> |
|--|---|

Summary of Review

IMPORTANT NOTE:

A Fact Sheet was submitted to the client on June 23, 2022. This draft based water quality modeling on only the Chestnut Ridge WWTP discharge point.

The Fact Sheet has been redrafted to incorporate water quality modeling to determine impacts from the four dischargers on Dunning Creek. There is one industrial waste discharger (Reynoldsdale Fish Hatchery) and three sewage dischargers (East St. Clair Stone Creek, East St. Clair Fishertown, and Chestnut Ridge).

Water quality modeling was completed using the highest average annual flow rate among the years 2019, 2022, 2021. The data was abstracted from the NPDES application or DEP water management system.

The application submitted by the applicant requests a NPDES renewal permit for the Chestnut Ridge Area Joint Authority STP located at 320 Lane Metal Road, New Paris, PA 15554 in Bedford County, municipality of East St. Clair Township. The existing permit became effective on December 1, 2017 and expire(s)d on November 30, 2022. The application for renewal was received by DEP Southcentral Regional Office (SCRO) on April 26, 2022.

The purpose of this Fact Sheet is to present the basis of information used for establishing the proposed NPDES permit effluent limitations. The Fact Sheet includes a description of the facility, a description of the facility's receiving waters, a description of the facility's receiving waters attainment/non-attainment assessment status, and a description of any changes to the proposed

| Approve | Deny | Signatures | Date |
|---------|------|--|-----------------|
| X | | Nicholas Hong, P.E. / Environmental Engineer Nick Hong (via electronic signature) | August 4, 2022 |
| X | | Daniel W. Martin, P.E. / Environmental Engineer Manager Daniel W. Martin | August 29, 2022 |

Summary of Review

monitoring/sampling frequency. Section 6 provides the justification for the proposed NPDES effluent limits derived from technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), total maximum daily loading (TMDL), antidegradation, anti-backsliding, and/or whole effluent toxicity (WET). A brief summary of the outlined descriptions has been included in the Summary of Review section.

The subject facility is a 0.705 MGD average annual design flow treatment facility. The hydraulic design capacity is 0.915 MGD. The applicant does not anticipate any proposed upgrades to the treatment facility in the next five years. The NPDES application has been processed as a Minor Sewage Facility (Level 2) due to the type of sewage and the design flow rate for the facility. The applicant disclosed the Act 14 requirement to Bedford County Commissioner and East St. Clair Township Supervisors and the notice was received by the parties on March 24, 2022 and March 25, 2022. A planning approval letter was not necessary as the facility is neither new or expanding.

Utilizing the DEP's web-based Emap-PA information system, the receiving waters has been determined to be Dunning Creek. The sequence of receiving streams that Dunning Creek discharges into are the Raystown Branch Juniata River, the Juniata River, and the Susquehanna River which eventually drains into the Chesapeake Bay. The subject site is subject to the Chesapeake Bay implementation requirements. The receiving water has protected water usage for warm water fishes (WWF) and migratory fishes (MF). No Class A Wild Trout fisheries are impacted by this discharge. The absence of high quality and/or exceptional value surface waters removes the need for an additional evaluation of anti-degradation requirements.

The Dunning Creek is a Category 2 stream listed in the 2020 Integrated List of All Waters (formerly 303d Listed Streams). This stream is an attaining stream that supports aquatic life. The receiving waters is not subject to a total maximum daily load (TMDL) plan to improve water quality in the subject facility's watershed.

The existing permit and proposed permit differ as follows:

- **Monitoring for E.Coli, total copper, and total zinc.**
- **CBOD and ammonia nitrogen have reduced effluent limits**

Sludge use and disposal description and location(s): Sewage sludge/biosolids disposed at Mosteller Landfill in Somerset Township in Somerset County.

The proposed permit will expire five (5) years from the effective date.

Based on the review in this report, it is recommended that the permit be drafted. DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Any additional information or public review of documents associated with the discharge or facility may be available at PA DEP Southcentral Regional Office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file review, contact the SCRO File Review Coordinator at 717.705.4700.

1.0 Applicant

1.1 General Information

This fact sheet summarizes PA Department of Environmental Protection's review for the NPDES renewal for the following subject facility.

Facility Name: Chestnut Ridge Are Joint MA

NPDES Permit # PA0087661

Physical Address: 320 Lane Metal Road
New Paris, PA 15554

Mailing Address: 320 Lane Metal Road
New Paris, PA 15554

Contact: Douglas Vitovich
Facility Manager
Dvito07@hotmail.com

Consultant: July Musselman
Senior Environmental Scientist
GHD
Judy.musselman@ghd.com
717-585-6359

1.2 Permit History

Permit submittal included the following information.

- NPDES Application
- Flow Diagrams
- Influent Sample Data
- Effluent Sample Data

2.0 Treatment Facility Summary

2.1.1 Site location

The physical address for the facility is 320 Lane Metal Road, New Paris, PA 15554. A topographical and an aerial photograph of the facility are depicted as Figure 1 and Figure 2.

Figure 1: Topographical map of the subject facility


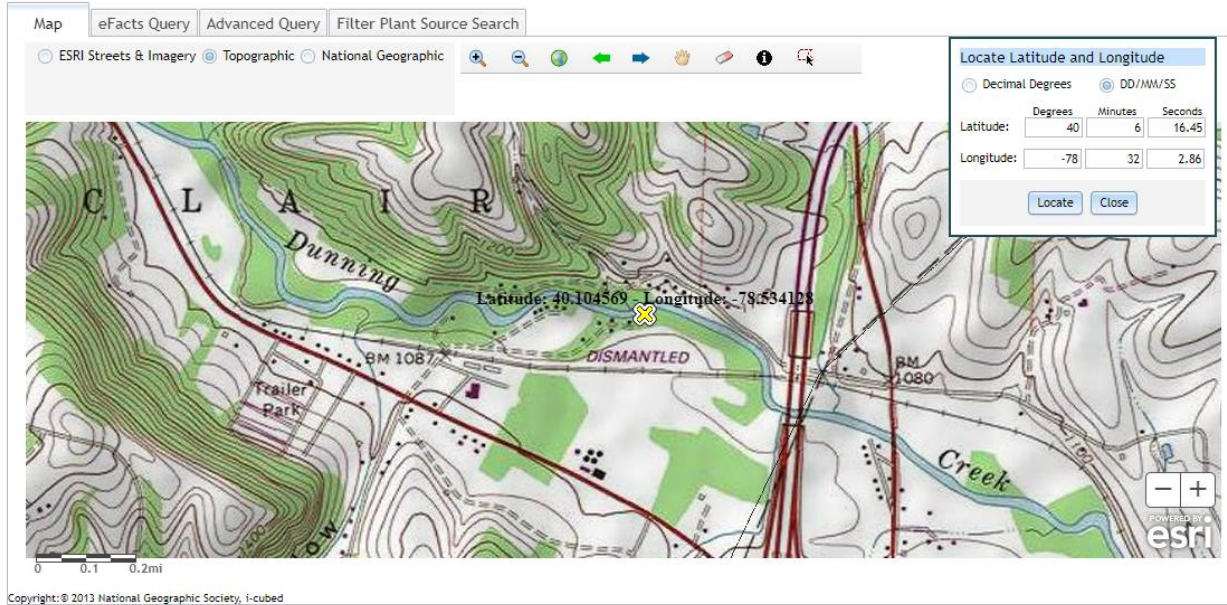


Figure 2: Aerial Photograph of the subject facility

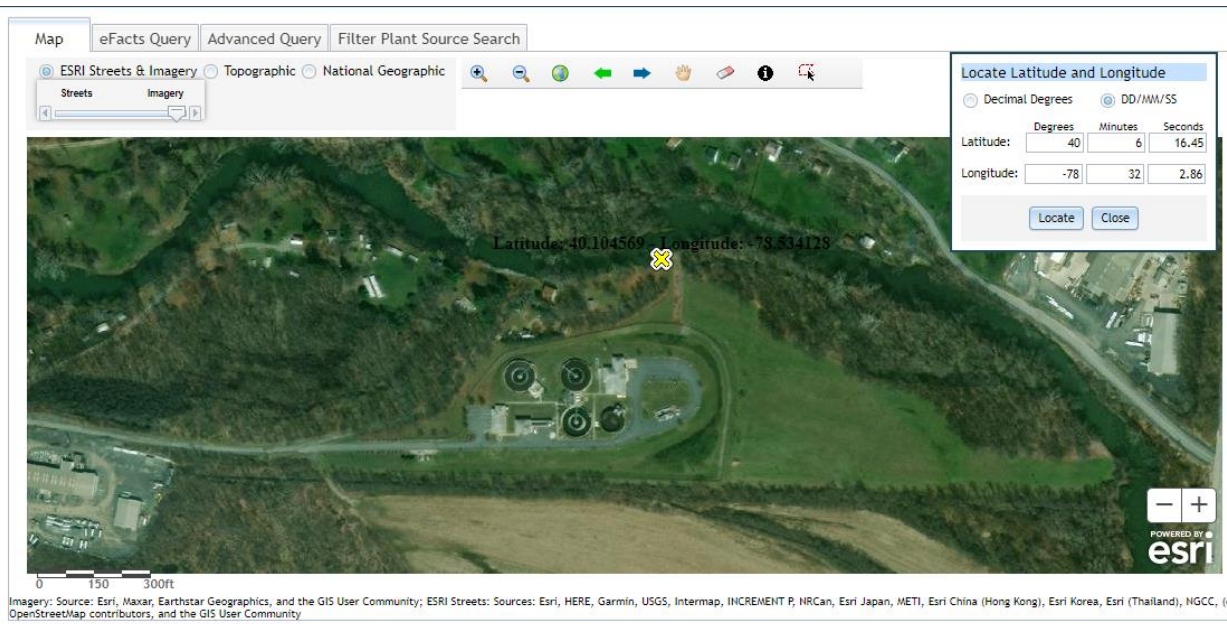

LEGEND

- - - - - MAJOR EXISTING CONTOUR - MAJOR
- - - - - MINOR EXISTING CONTOUR - MINOR
- ===== EXISTING PIPE
- SW - SW EXISTING STORMWATER PIPE
- E E EXISTING ELECTRIC - OVERHEAD
- + + + + + EXISTING FENCE
- ~~~~~ EXISTING TREELINE
- — — — — EXISTING STREAM
- - - - - EXISTING PROPERTY LINE
- STORMWATER AREA (229,979 SQ FT)

The site plan illustrates the layout of the wastewater treatment facility, including Dunning Creek to the north, various treatment units (Schreiber Countercurrent Treatment Units #1 & #2, Sludge Digestion Building, Sludge Loading Station), a Stormwater Retention Basin, UV Chamber, Raw Pump Station, Admin Buildings, Headworks, and Outfalls 001 and 002. A north arrow is located in the top right corner.

Project No. 15568729
 NPOES PERMIT RENEWAL
 DATE: APRIL 2022

GHD
 GROUNDHOG DESIGN GROUP INC.
1000 WEST 10TH AVENUE SUITE 200 DENVER CO 80202

APPENDIX 3

The table summarizes the municipalities served by the Chestnut Ridge WWTP.

| Municipalities Served | Flow Contribution | Population |
|-------------------------|-------------------|-------------|
| East St. Clair Township | 35.00 | 1547 |
| West St. Clair Township | 30.00 | 1326 |
| King Township | 20.70 | 915 |
| Napier Township | 4.05 | 179 |
| New Paris Borough | 4.35 | 192 |
| Pleasantville Borough | 4.32 | 191 |
| St. Clairsville Borough | 1.72 | 76 |
| Total | 100.14 | 4426 |

The facility has the following outfall information for stormwater.

- Outfall 002 located at Longitude 40⁰ 06' 16.70" and latitude -78⁰ 32' 2.36".

The table summarizes industrial / commercial wastewater contributions. The facility does not have an EPA-approved pretreatment program.

**Chestnut Ridge Area Joint Municipal Authority
Industrial/Commercial Wastewater Contributions**

| | Business Name | Type of Business | EDUs | Average Wastewater Flow, Gallons |
|-----|-----------------------------------|------------------|------|----------------------------------|
| 1. | TMW Candies, LLC | Manufacturing | 2 | 525 |
| 2. | Imler Area Volunteer Fire Co. | Fire Hall | 2 | 525 |
| 3. | Bedford Reinforced Plastics | Manufacturing | 6 | 1,575 |
| 4. | Lane Enterprises, Inc. | Manufacturing | 5 | 1,313 |
| 5. | Barefoot Trucking | Transportation | 1 | 263 |
| 6. | Orchard Valley Realty - Medical | Medical Office | 2 | 525 |
| 7. | Orchard Valley Realty - Lab | Medical Office | 1 | 263 |
| 8. | Orchard Valley Realty -Cardiology | Medical Office | 1 | 263 |
| 9. | Orchard Valley Realty -Medical #2 | Medical Office | 1 | 263 |
| 10. | Bureau of Fisheries | Fish Hatchery | 3 | 788 |
| 11. | Claycomb Car Wash | Service | 2 | 525 |
| 12. | The Cow Ice Cream Stand | Sales | 1 | 263 |
| 13. | Mission Critical Solutions | Manufacturing | 4 | 1,050 |
| 14. | Alum Bank Community Fire Company | Fire Hall | 1 | 263 |
| 15. | Alum Bank Professional Building | Medical Office | 3 | 788 |
| 16. | Creative Pultrusions | Manufacturing | 19 | 4,988 |
| 17. | Jack Geisel Funeral Home | Funeral Home | 1 | 263 |
| 18. | Robert Blackburn Funeral Home | Funeral Home | 1 | 263 |
| 19. | Best Way Pizza | Restaurant | 4 | 1,050 |
| 20. | Corle Building Systems | Manufacturing | 22 | 5,775 |
| 21. | Slick's Ivy Stone | Restaurant | 13 | 3,413 |
| 22. | Stombaugh Car Wash | Car Wash | 2 | 525 |
| | | Total | 97 | 25,463 |


2.2 Description of Wastewater Treatment Process

The subject facility is a 0.705 MGD annual average design flow facility. The hydraulic design capacity is 0.915 MGD. The subject facility treats wastewater using a Schreiber countercurrent aeration treatment unit(s) and a UV disinfection unit prior to discharge through the outfall. The facility is being evaluated for flow, pH, dissolved oxygen, CBOD5, TSS, fecal coliform, UV intensity, nitrogen species, and phosphorus. The existing permits limits for the facility is summarized in Section 2.4.

The treatment process is summarized in the table.

| Treatment Facility Summary | | | | |
|---|----------------------------------|-------------------|---------------------|------------------------|
| Treatment Facility Name: Chestnut Ridge Area WWTP | | | | |
| Waste Type | Degree of Treatment | Process Type | Disinfection | Avg Annual Flow (MGD) |
| Sewage | Secondary With Ammonia Reduction | Extended Aeration | Ultraviolet | 0.705 |
| Hydraulic Capacity (MGD) | Organic Capacity (lbs/day) | Load Status | Biosolids Treatment | Biosolids Use/Disposal |
| 0.915 | 1800 | Not Overloaded | Aerobic Digestion | Combination of methods |

A schematic of the treatment process is depicted.

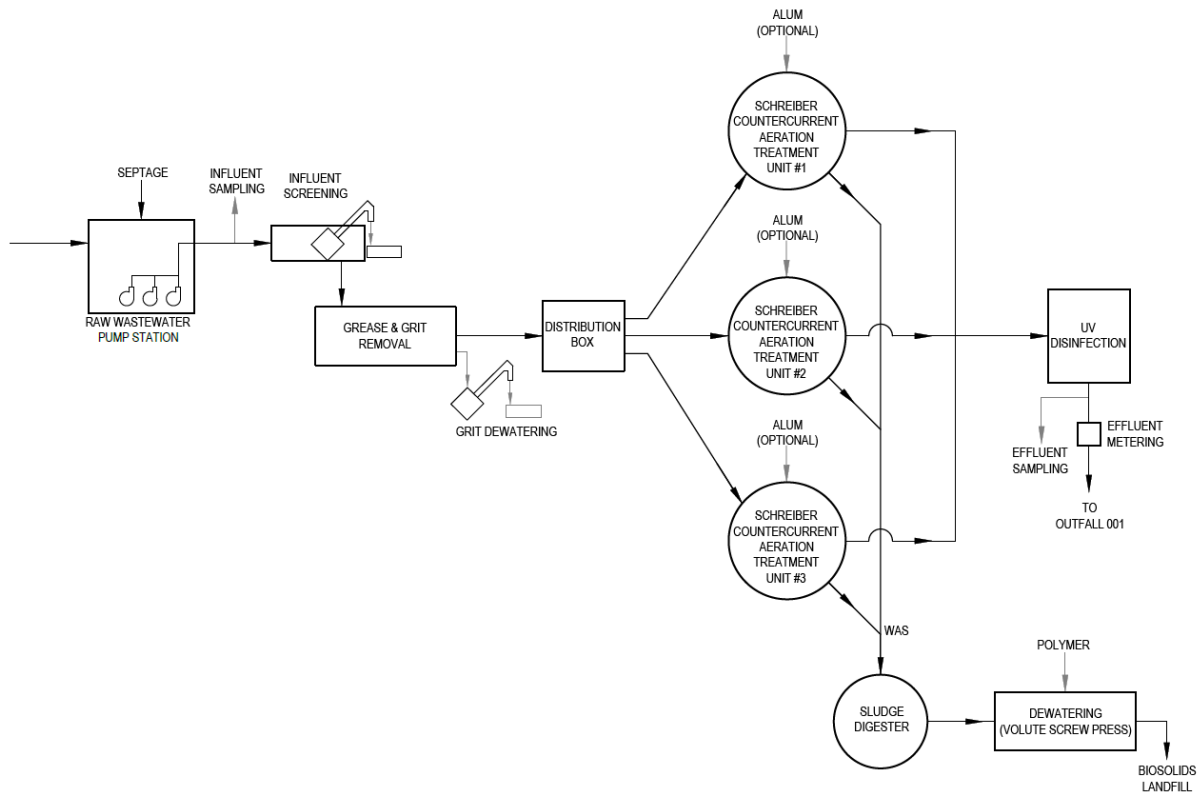

2.3 Facility Outfall Information

The facility has the following outfall information for wastewater.

| | | | |
|-------------------------|-----------------|-------------------|----------------|
| Outfall No. | 001 | Design Flow (MGD) | .915 |
| Latitude | 40° 6' 16.45" | Longitude | -78° 32' 2.86" |
| Wastewater Description: | Sewage Effluent | | |

2.3.1 Operational Considerations- Chemical Additives

Chemical additives are chemical products introduced into a waste stream that is used for cleaning, disinfecting, or maintenance and which may be detected in effluent discharged to waters of the Commonwealth. Chemicals excluded are those used for neutralization of waste streams, the production of goods, and treatment of wastewater.

The subject facility utilizes the following chemicals as part of their treatment process.

- Pollu-Tech CL 416 as a dewatering aid.
- Alum/DelPac for use in the future to aid in phosphorus removal. The chemical is not currently being used.

2.4 Existing NPDES Permits Limits

The existing NPDES permit limits are summarized in the table.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 6' 16.45", Longitude 78° 32' 2.86", River Mile Index 8.9, Stream Code 14586

Receiving Waters: Dunning Creek

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from December 1, 2017 through November 30, 2022.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|---|-------------------------------------|------------------|-----------------------|-----------------|----------------|------------------|--|----------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Average Monthly | Weekly Average | Daily Minimum | Average Monthly | Weekly Average | Instant. Maximum | | |
| Flow (MGD) | Report | Report Daily Max | XXX | XXX | XXX | XXX | Continuous | Measured |
| pH (S.U.) | XXX | XXX | 6.0 Min 5.0 Min | XXX | 9.0 Max | XXX | 1/day | Grab |
| Dissolved Oxygen | XXX | XXX | XXX | XXX | XXX | XXX | 1/day | Grab |
| Carbonaceous Biochemical Oxygen Demand (CBOD5) | 147 | 235 | XXX | 25.0 | 40.0 | 50 | 1/week | 24-Hr Composite |
| Biochemical Oxygen Demand (BOD5) | Report | Report Daily Max | XXX | Report | XXX | XXX | 1/week | 24-Hr Composite |
| Raw Sewage Influent | Report | Report Daily Max | XXX | Report | XXX | XXX | 1/week | 24-Hr Composite |
| Total Suspended Solids | 176 | 264 | XXX | 30.0 | 45.0 | 60 | 1/week | 24-Hr Composite |
| Total Suspended Solids Raw Sewage Influent | Report | Report Daily Max | XXX | Report | XXX | XXX | 1/week | 24-Hr Composite |
| Fecal Coliform (CFU/100 ml) Oct 1 - Apr 30 | XXX | XXX | XXX | 2000 Geo Mean | XXX | 10000 | 1/week | Grab |
| Fecal Coliform (CFU/100 ml) May 1 - Sep 30 | XXX | XXX | XXX | 200 Geo Mean | XXX | 1000 | 1/week | Grab |
| Ultraviolet light intensity (mW/cm ²) | XXX | XXX | Report | XXX | XXX | XXX | 1/day | Recorded |
| Ammonia-Nitrogen Nov 1 - Apr 30 | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |

Outfall 001, Continued (from December 1, 2017 through November 30, 2022)

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|------------------------------------|-------------------------------------|-------------------|-----------------------|--------------------|-------------------|---------------------|--|----------------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Average Monthly | Weekly Average | Daily Minimum | Average Monthly | Weekly Average | Instant. Maximum | | |
| Ammonia-Nitrogen May 1 - Oct 31 | 50 | XXX | XXX | 8.5 | XXX | 17 | 2/week | 24-Hr Composite |
| Total Phosphorus | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. B. For Outfall 001, Latitude 40° 6' 16.45", Longitude 78° 32' 2.86", River Mile Index 8.9, Stream Code 14586

Receiving Waters: Dunning Creek

Type of Effluent: Sewage Effluent

- The permittee is authorized to discharge during the period from December 1, 2017 through November 30, 2022.
- Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|----------------------|-------------------------------------|--------|-----------------------|--------------------|---------|---------------------|--|----------------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Monthly | Annual | Monthly | Monthly Average | Maximum | Instant. Maximum | | |
| Ammonia--N | Report | Report | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Kjeldahl--N | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Nitrate-Nitrite as N | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Total Nitrogen | Report | Report | XXX | Report | XXX | XXX | 1/month | Calculation |
| Total Phosphorus | Report | Report | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Net Total Nitrogen | Report | 12877 | XXX | XXX | XXX | XXX | 1/month | Calculation |
| Net Total Phosphorus | Report | 1717 | XXX | XXX | XXX | XXX | 1/month | Calculation |

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Footnotes:

(1) See Part C for Chesapeake Bay Requirements.

(2) This is the minimum number of sampling events required. Permittees are encouraged, and it may be advantageous in demonstrating compliance, to perform more than the minimum number of sampling events required.

(3) The permittee is authorized to use 10,000 lbs/year of Total Nitrogen (TN) Offsets towards compliance with the Annual Net TN mass load limitation (Cap Load), in accordance with Part C of this permit. These Offsets may be applied throughout the Compliance Year or during the Truing Period. The application of Offsets must be reported to DEP as described in Part C. The Offsets are authorized for the following pollutant load reduction activities:

- Connection of 400 on-lot sewage disposal systems to the public sewer system after January 1, 2003 in which 25 lbs/year of TN offsets are granted per connection.

3.0 Facility NPDES Compliance History

3.1 Summary of Inspections

A summary of the most recent inspections during the existing permit review cycle is as follows.

The DEP inspector noted the following during the inspection.

01/12/2018: There was nothing significant to report.

02/28/2020: The facility intends to replace the disinfection with UV in 2018.

01/06/2020:

- The net total nitrogen loading on the annual DMR did not reflect the reduction for nitrogen offsets.
- The October 2018 and December DMR did not coincide with the Chesapeake Bay supplemental report for nitrogen species.

12/23/2020:

- The facility purchased 2,109 lbs of phosphorus credits. A total of 10,000 lbs of nitrogen offsets were approved in December 2017 for the elimination of on-lot sewage.
- There were errors in the DMR reporting for both nitrogen and phosphorus.

10/27/2021:

- Equipment repairs were made for new influent VFD, new back-up high level alarm, and new stainless steel scrapers for two of the Schreiber units.
- Thermometers in both composite sampler refrigerators showed a temperature of 10 C. The appropriate storage temperature should not exceed 6 C.
- The supplemental form included an error on the November 2020 DMR for phosphorus.

3.2 Summary of DMR Data

A review of approximately 1-year of DMR data shows that the monthly average flow data for the facility below the design capacity of the treatment system. The maximum average flow data for the DMR reviewed was 0.83 MGD February 2022. The design capacity of the treatment system is 0.915 MGD.

The off-site laboratory used for the analysis of the parameters was Fairways Laboratories, Inc. located at 2019 Ninth Avenue, Altoona, PA 16603.

DMR Data for Outfall 001 (from July 1, 2021 to June 30, 2022)

| Parameter | JUN-22 | MAY-22 | APR-22 | MAR-22 | FEB-22 | JAN-22 | DEC-21 | NOV-21 | OCT-21 | SEP-21 | AUG-21 | JUL-21 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Flow (MGD) Average Monthly | 0.400 | 0.592 | 0.625 | 0.560 | 0.83 | 0.569 | 0.519 | 0.464 | 0.447 | 0.666 | 0.405 | 0.396 |
| Flow (MGD) Daily Maximum | 0.617 | 1.087 | 1.167 | 0.778 | 1.278 | 1.022 | 0.846 | 0.528 | 0.663 | 2.186 | 0.911 | 0.790 |
| pH (S.U.) Minimum | 6.6 | 6.4 | 6.6 | 6.6 | 6.5 | 6.5 | 6.5 | 6.6 | 6.8 | 6.7 | 6.7 | 6.6 |
| pH (S.U.) Maximum | 7.1 | 7.1 | 7.1 | 7.2 | 7.1 | 7.1 | 6.7 | 6.9 | 7.0 | 7.9 | 7.9 | 7.8 |
| DO (mg/L) Minimum | 5.8 | 6.1 | 6.3 | 5.8 | 6.4 | 6.5 | 5.8 | 5.7 | 5.4 | 5.8 | 5.8 | 5.5 |
| CBOD5 (lbs/day) Average Monthly | < 1.0 | < 21.0 | < 18.0 | < 14.0 | < 19.0 | 24.0 | < 15.0 | < 11.0 | < 10.0 | < 22.0 | < 11.0 | < 9.0 |
| CBOD5 (lbs/day) Weekly Average | < 12.0 | 44.0 | < 24.0 | < 18.0 | < 22.0 | 31.0 | 28.0 | < 12.0 | < 11.0 | < 55.0 | < 17.0 | < 10.0 |
| CBOD5 (mg/L) Average Monthly | < 3.0 | < 4.2 | < 3.0 | < 3.0 | < 3.1 | 5.4 | < 3.2 | < 3.0 | < 3.0 | < 3.0 | < 3.0 | < 3.0 |
| CBOD5 (mg/L) Weekly Average | < 3.0 | 7.6 | < 3.0 | < 3.0 | 3.5 | 8.3 | 3.9 | < 3.0 | < 3.0 | < 3.0 | < 3.0 | < 3.0 |
| BOD5 (lbs/day) Raw Sewage Influent Average Monthly | 269.0 | 362.0 | 512.0 | 203.0 | 156.0 | 181.0 | 180.0 | 150.0 | 316.0 | 376 | 286.0 | 156.0 |
| BOD5 (lbs/day) Raw Sewage Influent Daily Maximum | 640.0 | 1030.0 | 1163.0 | 225.0 | 228.0 | 236.0 | 287.0 | 251.0 | 423.0 | 1336.0 | 504.0 | 234.0 |
| BOD5 (mg/L) Raw Sewage Influent Average Monthly | 77.0 | 66.0 | 84.0 | 45.0 | 27.0 | 41.0 | 40.0 | 39.0 | 90.0 | 37.0 | 75.0 | 52.0 |
| TSS (lbs/day) Average Monthly | < 6.0 | < 9.0 | < 24.0 | < 12.0 | < 13.0 | 38.0 | < 23.0 | 9.0 | < 6.0 | < 43.0 | < 9.0 | < 11.0 |
| TSS (lbs/day) Raw Sewage Influent Average Monthly | 250.0 | 89.0 | 153.0 | 104.0 | 126.0 | 92.0 | 180.0 | 104.0 | 289.0 | 336.0 | 253.0 | 143.0 |
| TSS (lbs/day) Raw Sewage Influent Daily Maximum | 534.0 | 210.0 | 302.0 | 186.0 | 147.0 | 125.0 | 254.0 | 163.0 | 387.0 | 1167.0 | 381.0 | 287.0 |
| TSS (lbs/day) Weekly Average | 8.0 | 10.0 | 73.0 | 22.0 | 18.0 | 48.0 | 54.0 | 14.0 | 8.0 | 190.0 | 14.0 | 26.0 |

NPDES Permit Fact Sheet
Chestnut Ridge Area Joint Authority STP

NPDES Permit No. PA0087661

| | | | | | | | | | | | | |
|---|---------|----------|----------|----------|----------|----------|----------|----------|----------|-----------|---------|---------|
| TSS (mg/L) Average Monthly | < 1.8 | < 1.8 | < 3.4 | < 2.5 | < 2.4 | 8.2 | < 4.8 | 2.4 | < 1.8 | < 3.2 | < 2.4 | < 3.8 |
| TSS (mg/L) Raw Sewage Influent Average Monthly | 71.0 | 18.0 | 25.0 | 24.0 | 23.0 | 21.0 | 41.0 | 27.0 | 83.0 | 33.0 | 66.0 | 46.0 |
| TSS (mg/L) Weekly Average | 2.4 | 2.4 | 9.0 | 3.6 | 4.4 | 10.0 | 7.6 | 3.8 | 2.4 | 10.4 | 3.6 | 9.2 |
| Fecal Coliform (CFU/100 ml) Geometric Mean | < 3.0 | < 1.0 | < 1.0 | < 1.0 | < 3.0 | 3.0 | < 2.0 | < 1.0 | < 1.0 | < 3.0 | < 1.0 | < 2.0 |
| Fecal Coliform (CFU/100 ml) Instantaneous Maximum | 12.1 | 1.0 | 2.0 | 2.0 | 19.9 | 11.0 | 21.1 | 2.0 | < 1.0 | 14.5 | < 1.0 | 8.6 |
| UV Intensity (mW/cm²) Daily Minimum | 169.2 | 162.6 | 158.6 | 131.2 | 147.8 | 125.3 | 115.1 | 114.0 | 147.6 | 117.5 | 101.4 | 113.8 |
| Nitrate-Nitrite (mg/L) Average Monthly | < 1.9 | < 10.6 | < 7.8 | < 10.5 | < 9.3 | < 7.8 | < 18.8 | < 18.7 | < 14.9 | < 9.5 | < 8.3 | < 5.5 |
| Nitrate-Nitrite (lbs) Total Monthly | < 188.3 | < 1585.2 | < 1275.7 | < 1512.8 | < 1537.4 | < 1081.8 | < 2428.2 | < 2194.2 | < 1760.5 | < 1865.7 | < 845.2 | < 504.9 |
| Total Nitrogen (mg/L) Average Monthly | < 4.6 | < 11.1 | < 8.6 | < 11.5 | < 10.5 | < 11.7 | < 19.3 | < 19.2 | < 15.4 | < 10.8 | < 8.8 | < 6.9 |
| Total Nitrogen (lbs) Effluent Net Total Monthly | < 467.4 | < 1663.8 | < 1456.5 | < 1657.2 | < 1759.6 | < 1599.2 | < 2494.7 | < 2252.6 | < 1819.1 | < 2126.9 | < 902.2 | < 692.6 |
| Total Nitrogen (lbs) Total Monthly | < 467.4 | < 1663.8 | < 1456.5 | < 1657.2 | < 1759.6 | < 1599.2 | < 2494.7 | < 2252.6 | < 1819.1 | < 2126.9 | < 902.2 | < 692.6 |
| Total Nitrogen (lbs) Effluent Net Total Annual | | | | | | | | | | < 4223.0 | | |
| Total Nitrogen (lbs) Total Annual | | | | | | | | | | < 14223.0 | | |
| Ammonia (lbs/day) Average Monthly | 7.3 | < 0.5 | < 0.6 | < 3.0 | < 6.0 | < 12.0 | < 1.0 | < 0.4 | < 0.3 | < 3.0 | < 0.5 | < 5.0 |
| Ammonia (mg/L) Average Monthly | 2.2 | < 0.1 | < 0.1 | < 0.6 | < 0.9 | < 2.7 | < 0.2 | < 0.1 | < 0.1 | < 0.6 | < 0.2 | < 1.1 |
| Ammonia (lbs) Total Monthly | 219.6 | < 16.0 | < 17.0 | < 94.0 | < 162.7 | < 364.0 | < 33.3 | < 13.1 | < 12.0 | < 103.0 | < 15.3 | < 158.0 |
| Ammonia (lbs) Total Annual | | | | | | | | | | < 2543.0 | | |
| TKN (mg/L) Average Monthly | 2.8 | < 0.5 | < 0.8 | < 0.9 | < 1.2 | < 3.9 | < 0.5 | < 0.5 | < 0.5 | < 1.3 | < 0.5 | < 1.4 |

NPDES Permit Fact Sheet
Chestnut Ridge Area Joint Authority STP

NPDES Permit No. PA0087661

| | | | | | | | | | | | | |
|---|-------|--------|---------|---------|---------|---------|--------|--------|--------|---------|--------|---------|
| TKN (lbs) Total Monthly | 279.1 | < 78.6 | < 168.0 | < 139.4 | < 219.3 | < 517.5 | < 66.6 | < 58.5 | < 58.6 | < 261.2 | < 57.0 | < 179.6 |
| Total Phosphorus (lbs/day) Average Monthly | 13.0 | 11.0 | 12.0 | 9.0 | 9.70 | 9.0 | 16.1 | 15.0 | 14.5 | 16.0 | 15.0 | 13.0 |
| Total Phosphorus (mg/L) Average Monthly | 3.8 | 2.3 | 2.4 | 1.9 | 1.6 | 2.2 | 3.9 | 3.9 | 3.8 | 2.3 | 4.2 | 4.0 |
| Total Phosphorus (lbs) Effluent Net Total Monthly | 391.0 | 351.4 | 371.7 | 267.1 | 271.8 | 300.6 | 499.6 | 457.0 | 449.0 | 468.0 | 452.0 | 388.7 |
| Total Phosphorus (lbs) Total Monthly | 391.0 | 351.4 | 371.7 | 267.1 | 272.0 | 300.6 | 499.6 | 457.0 | 449.0 | 468.0 | 452.0 | 388.7 |
| Total Phosphorus (lbs) Effluent Net Total Annual | | | | | | | | | | 1716.0 | | |
| Total Phosphorus (lbs) Total Annual | | | | | | | | | | 4397.0 | | |

3.2.1 Chesapeake Bay Truing

The table summarizes the facility's compliance/noncompliance with Chesapeake Bay cap loads.

The facility purchased credits for phosphorus.

The facility has offsets for nitrogen.

| Chesapeake Bay Annual Nutrient Summary | | | | | | | | | | |
|--|-------------------|---------------------|----------------------|---------------------|-------------------|---------------------|---------------------|------------------|--|------------|
| Chestnut Ridge Area Joint MA | | | | | | | | | | |
| PA0087661 | | | | | | | | | | |
| Year for Truing Period (Oct 1 - Sept 30) | Annual Total Mass | | Lbs Credit Purchased | | Offsets | | Net Effluent Limits | | Compliant with Permit Limits (Yes/No) | |
| | Nitrogen (lbs) | Phosphorus (lbs) | Nitrogen (lbs) | Phosphorus (lbs) | Nitrogen (lbs) | Phosphorus (lbs) | Nitrogen (lbs) | Phosphorus (lbs) | Nitrogen | Phosphorus |
| | | | | | | | 12,877 | 1,717 | | |
| 2017 | 14,913 | 3,889 | 0 | 2,172 | 10,000 | 0 | 4,913 | 1,717 | Yes | Yes |
| 2018 | 13,775 | 3,582 | 0 | 1,867 | 10,000 | 0 | 3,775 | 1,715 | Yes | Yes |
| 2019 | 11,214 | 3,823 | 0 | 2,109 | 10,000 | 0 | 1,214 | 1,714 | Yes | Yes |
| 2020 | 14,223 | 4,397 | 0 | 2,681 | 10,000 | 0 | 4,223 | 1,716 | Yes | Yes |

3.3 Non-Compliance

3.3.1 Non-Compliance- NPDES Effluent

A summary of the non-compliance to the permit limits for the existing permit cycle is as follows.

From the DMR data beginning in December 1, 2017 to May 31, 2022, the following table summarizes observed effluent non-compliances.

| Summary of Non-Compliance with NPDES Effluent Limits | | | | | | | | |
|--|--------------------------|----------------|--------------|---------------------|--------------|-----------------|-----------------------|---|
| Beginning December 1, 2017 and Ending May 31, 2022 | | | | | | | | |
| NON_COMPL_TYPE_DESC | NON_COMPL_CATEG_ORY_DESC | PARAMETER | SAMPLE_VALUE | VIOLATION_CONDITION | PERMIT_VALUE | UNIT_OF_MEASURE | STAT_BASE_CODE | FACILITY_COMMENTS |
| Violation of permit condition | Effluent | Fecal Coliform | 9678.4 | > | 1000 | CFU/100 ml | Instantaneous Maximum | clarifer tripped due to power bump resulting in solids not being returned to aeration the issue was corrected and will be monitored |
| Violation of permit condition | Effluent | Fecal Coliform | 5654.4 | > | 1000 | CFU/100 ml | Instantaneous Maximum | had bank issue next to sensor |
| Violation of permit condition | Effluent | Fecal Coliform | 1203 | > | 1000 | CFU/100 ml | Instantaneous Maximum | |

3.3.2 Non-Compliance- Enforcement Actions

A summary of the non-compliance enforcement actions for the current permit cycle is as follows:

Beginning in December 1, 2017 to May 31, 2022, there were no observed enforcement actions.

3.4 Summary of Biosolids Disposal

A summary of the biosolids disposed of from the facility is as follows.

| 2021 | | | |
|---|----------------|----------|----------|
| Sewage Sludge / Biosolids Production Information | | | |
| | | | |
| Hauled Off-Site | | | |
| 2021 | Tons Dewatered | % Solids | Dry Tons |
| January | 0 | | |
| February | 0 | | |
| March | 0 | | |
| April | 0 | | |
| May | 0 | | |
| June | 36.2 | 18.6 | 6.74 |
| July | 35.85 | 19.25 | 6.9 |
| August | 0 | | |
| September | 0 | | |
| October | 0 | | |
| November | 0 | | |
| December | 18.16 | 15.4 | 2.8 |
| | | | |
| Notes: | | | |
| Sewage sludge/biosolids disposed at Mostellers Landfill in Somerset Township, Somerset County | | | |

3.5 Open Violations

No open violations existed as of August 2022.

4.0 Receiving Waters and Water Supply Information Detail Summary

4.1 Receiving Waters

The receiving waters has been determined to be Dunning Creek. The sequence of receiving streams that Dunning Creek discharges into are the Raystown Branch Juniata River, the Juniata River, and the Susquehanna River which eventually drains into the Chesapeake Bay.

4.2 Public Water Supply (PWS) Intake

The closest PWS to the subject facility is Saxton Municipal Water Authority (PWS ID #4050021) located approximately 58 miles downstream of the subject facility on the Raystown Branch Juniata River. Based upon the distance and the flow rate of the facility, the PWS should not be impacted.

4.3 Class A Wild Trout Streams

Class A Wild Trout Streams are waters that support a population of naturally produced trout of sufficient size and abundance to support long-term and rewarding sport fishery. DEP classifies these waters as high-quality coldwater fisheries.

The information obtained from EMAP suggests that no Class A Wild Trout Fishery will be impacted by this discharge.

4.4 2020 Integrated List of All Waters (303d Listed Streams)

Section 303(d) of the Clean Water Act requires States to list all impaired surface waters not supporting uses even after appropriate and required water pollution control technologies have been applied. The 303(d) list includes the reason for impairment which may be one or more point sources (i.e. industrial or sewage discharges) or non-point sources (i.e. abandoned mine lands or agricultural runoff and the pollutant causing the impairment such as metals, pH, mercury or siltation).

States or the U.S. Environmental Protection Agency (EPA) must determine the conditions that would return the water to a condition that meets water quality standards. As a follow-up to listing, the state or EPA must develop a Total Maximum Daily Load (TMDL) for each waterbody on the list. A TMDL identifies allowable pollutant loads to a waterbody from both point and non-point sources that will prevent a violation of water quality standards. A TMDL also includes a margin of safety to ensure protection of the water.

The water quality status of Pennsylvania's waters uses a five-part categorization (lists) of waters per their attainment use status. The categories represent varying levels of attainment, ranging from Category 1, where all designated water uses are met to Category 5 where impairment by pollutants requires a TMDL for water quality protection.

The receiving waters is listed in the 2020 Pennsylvania Integrated Water Quality Monitoring and Assessment Report as a Category 2 waterbody. The surface waters is an attaining stream that supports aquatic life. The designated use has been classified as protected waters for warm water fishes (WWF) and migratory fishes (MF).

4.5 Low Flow Stream Conditions

Water quality modeling estimates are based upon conservative data inputs. The data are typically estimated using either a stream gauge or through USGS web based StreamStats program. The NPDES effluent limits are based upon the combined flows from both the stream and the facility discharge.

A conservative approach to estimate the impact of the facility discharge using values which minimize the total combined volume of the stream and the facility discharge. The volumetric flow rate for the stream is based upon the seven-day, 10-year low flow (Q710) which is the lowest estimated flow rate of the stream during a 7 consecutive day period that occurs once in 10 -year time period. The facility discharge is based upon a known design capacity of the subject facility.

The closest WQN station to the subject facility is the Raystown Branch Juniata River (WQN223). This WQN station is located approximately 59 miles downstream of the subject facility.

The closest gauge station to the subject facility is the Dunning Creek station at Belden, PA (USGS station number 1560000). This gauge station is located approximately 4 miles downstream of the subject facility.

For WQM modeling, default pH and stream water temperature data were used. pH was estimated to be 7 and the stream water temperature was estimated to be 25 C.

The hardness of the stream was estimated by collecting a sample upstream of the facility. The sampling result was 79.5 mg/l CaCO₃.

The low flow yield and the Q710 for the subject facility was estimated using StreamStats.

The low flow yield is 0.0332 ft³/s/mi² and the Q710 is 4.98 ft³/s.

4.6 Summary of Discharge, Receiving Waters and Water Supply Information

| | | | |
|--|---|---|--------------------------------|
| Outfall No. | <u>001</u> | Design Flow (MGD) | <u>.915</u> |
| Latitude | <u>40° 6' 17.23"</u> | Longitude | <u>-78° 32' 2.94"</u> |
| Quad Name | <u></u> | Quad Code | <u></u> |
| Wastewater Description: <u>Sewage Effluent</u> | | | |
| | | | |
| Receiving Waters | <u>Dunning Creek (WWF)</u> | Stream Code | <u>14586</u> |
| NHD Com ID | <u>65845543</u> | RMI | <u>8.9</u> |
| Drainage Area | <u>150</u> | Yield (cfs/mi²) | <u>0.0332</u> |
| Q ₇₋₁₀ Flow (cfs) | <u>4.98</u> | Q ₇₋₁₀ Basis | <u>StreamStats/streamgauge</u> |
| Elevation (ft) | <u>1071</u> | Slope (ft/ft) | <u></u> |
| Watershed No. | <u>11-C</u> | Chapter 93 Class. | <u>WWF, MF</u> |
| Existing Use | <u>Same as Chapter 93 class</u> | Existing Use Qualifier | <u></u> |
| Exceptions to Use | <u></u> | Exceptions to Criteria | <u></u> |
| Assessment Status | <u>Attaining Use(s) supports aquatic life</u> | | |
| Cause(s) of Impairment | <u>Not applicable</u> | | |
| Source(s) of Impairment | <u>Not applicable</u> | | |
| TMDL Status | <u>Not applicable</u> | Name | <u></u> |
| | | | |
| Background/Ambient Data | | Data Source | |
| pH (SU) | <u>7</u> | Default | <u></u> |
| Temperature (°C) | <u>25</u> | Default | <u></u> |
| Hardness (mg/L) | <u>79.5</u> | <u>NPDES application; average of 3 grab samples</u> | |
| Other: | <u></u> | <u></u> | |
| | | | |
| Nearest Downstream Public Water Supply Intake | <u>Saxton MW Authority</u> | | |
| PWS Waters | <u>Raystown Branch Juniata River</u> | Flow at Intake (cfs) | <u></u> |
| PWS RMI | <u>39</u> | Distance from Outfall (mi) | <u>58</u> |

5.0: Overview of Presiding Water Quality Standards

5.1 General

There are at least six (6) different policies which determines the effluent performance limits for the NPDES permit. The policies are technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), antidegradation, total maximum daily loading (TMDL), anti-backsliding, and whole effluent toxicity (WET). The effluent performance limitations enforced are the selected permit limits that is most protective to the designated use of the receiving waters. An overview of each of the policies that are applicable to the subject facility has been presented in Section 6.

5.2.1 Technology-Based Limitations

TBEL treatment requirements under section 301(b) of the Act represent the minimum level of control that must be imposed in a permit issued under section 402 of the Act (40 CFR 125.3). Available TBEL requirements for the state of Pennsylvania are itemized in PA Code 25, Chapter 92a.47.

The presiding sources for the basis for the effluent limitations are governed by either federal or state regulation. The reference sources for each of the parameters is itemized in the tables. The following technology-based limitations apply, subject to water quality analysis and best professional judgement (BPJ) where applicable:

| Parameter | Limit (mg/l) | SBC | Federal Regulation | State Regulation |
|------------------------------|-----------------|-----------------|--------------------|------------------|
| CBOD ₅ | 25 | Average Monthly | 133.102(a)(4)(i) | 92a.47(a)(1) |
| | 40 | Average Weekly | 133.102(a)(4)(ii) | 92a.47(a)(2) |
| Total Suspended Solids | 30 | Average Monthly | 133.102(b)(1) | 92a.47(a)(1) |
| | 45 | Average Weekly | 133.102(b)(2) | 92a.47(a)(2) |
| pH | 6.0 – 9.0 S.U. | Min – Max | 133.102(c) | 95.2(1) |
| Fecal Coliform (5/1 – 9/30) | 200 / 100 ml | Geo Mean | - | 92a.47(a)(4) |
| Fecal Coliform (5/1 – 9/30) | 1,000 / 100 ml | IMAX | - | 92a.47(a)(4) |
| Fecal Coliform (10/1 – 4/30) | 2,000 / 100 ml | Geo Mean | - | 92a.47(a)(5) |
| Fecal Coliform (10/1 – 4/30) | 10,000 / 100 ml | IMAX | - | 92a.47(a)(5) |
| Total Residual Chlorine | 0.5 | Average Monthly | - | 92a.48(b)(2) |

5.2.2 Mass Based Limits

For publicly owned treatment works (POTW), mass loadings are calculated based upon design flow rate of the facility and the permit limit concentration. The generalized calculation for mass loadings is shown below:

$$Quantity \left(\frac{lb}{day} \right) = (MGD)(Concentration)(8.34)$$

5.3 Water Quality-Based Limitations

WQBEL are based on the need to attain or maintain the water quality criteria and to assure protection of designated and existing uses (PA Code 25, Chapter 92a.2). The subject facility that is typically enforced is the more stringent limit of either the TBEL or the WQBEL.

Determination of WQBEL is calculated by spreadsheet analysis or by a computer modeling program developed by DEP. DEP permit engineers utilize the following computing programs for WQBEL permit limitations: (1) MS Excel worksheet for Total Residual Chlorine (TRC); (2) WQM 7.0 for Windows Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen Version 1.1 (WQM Model) and (3) Toxics using DEP Toxics Management Spreadsheet for Toxics pollutants.

The modeling point nodes utilized for this facility are summarized in Section 6.1.

5.3.1 Water Quality Modeling 7.0

The WQM Model is a computer model that is used to determine NPDES discharge effluent limitations for Carbonaceous BOD (CBOD5), Ammonia Nitrogen (NH₃-N), and Dissolved Oxygen (DO) for single and multiple point source discharges scenarios. WQM Model is a complete-mix model which means that the discharge flow and the stream flow are assumed to instantly and completely mixed at the discharge node.

WQM recommends effluent limits for DO, CBOD5, and NH₃-N in mg/l for the discharge(s) in the simulation.

Four types of limits may be recommended. The limits are

- (a) *a minimum concentration for DO in the discharge as 30-day average;*
- (b) *a 30-day average concentration for CBOD5 in the discharge;*
- (c) *a 30-day average concentration for the NH₃-N in the discharge;*
- (d) *24-hour average concentration for NH₃-N in the discharge.*

The WQM Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

The applicable WQM Effluent Limit Type are discussed in Section 6 under the corresponding parameter which is either DO, CBOD, or ammonia-nitrogen.

5.3.2 Toxics Modeling

The Toxics Management Spreadsheet model is a computer model that is used to determine effluent limitations for toxics (and other substances) for single discharge wasteload allocations. This computer model uses a mass-balance water quality analysis that includes consideration for mixing, first-order decay, and other factors used to determine recommended water quality-based effluent limits. Toxics Management Spreadsheet does not assume that all discharges completely mix with the stream. The point of compliance with water quality criteria are established using criteria compliance times (CCTs). The available CCTs are either acute fish criterion (AFC), chronic fish criterion (CFC), or human health criteria (THH & CRL).

Acute Fish Criterion (AFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 15 minutes travel time downstream of the current discharge) or the complete mix time whichever comes first. AFC is evaluated at Q710 conditions.

Chronic Fish Criterion (CFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CFC is evaluated at Q710 conditions.

Threshold Human Health (THH) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the estimated travel time downstream to the nearest potable water supply intake whichever comes first. THH is evaluated at Q710 conditions.

Cancer Risk Level (CRL) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CRL is evaluated at Qh (harmonic mean or normal flow) conditions.

The Toxics Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

5.3.2.1 Determining if NPDES Permit Will Require Monitoring/Limits in the Proposed Permit for Toxic Pollutants

To determine if Toxics modeling is necessary, DEP has developed a Toxics Management Spreadsheet to identify toxics of concern. Toxic pollutants whose maximum concentrations as reported in the permit application or on DMRs are greater than the most stringent applicable water quality criterion are pollutants of concern. A Reasonable Potential Analysis was utilized to determine (a) if the toxic parameters modeled would require monitoring or (b) if permit limitations would be required for the parameters. The toxics reviewed for reasonable potential were the following pollutants TDS, chloride, bromide, sulfate, total copper, total lead, and total zinc.

Based upon the SOP- Establishing Water Quality-Based Effluent Limitations (WQBELs) and Permit Conditions for Toxic Pollutants (Revised January 10, 2019), monitoring and/or limits will be established as follows.

- (a) When reasonable potential is demonstrated, establish limits where the maximum reported concentration equals or exceeds 50% of the WQBEL.
- (b) For non-conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 25% - 50% of the WQBEL.
- (c) For conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 10% - 50% of the WQBEL.

Applicable monitoring or permit limits for toxics are summarized in Section 6.

The Toxics Management Spreadsheet output has been included in Attachment B.

5.3.3 Whole Effluent Toxicity (WET)

The facility is not subject to WET.

5.4 Total Maximum Daily Loading (TMDL)

5.4.1 TMDL

The goal of the Clean Water Act (CWA), which governs water pollution, is to ensure that all of the Nation's waters are clean and healthy enough to support aquatic life and recreation. To achieve this goal, the CWA created programs designed to regulate and reduce the amount of pollution entering United States waters. Section 303(d) of the CWA requires states to assess their waterbodies to identify those not meeting water quality standards. If a waterbody is not meeting standards, it is listed as impaired and reported to the U.S. Environmental Protection Agency. The state then develops a plan to clean up the impaired waterbody. This plan includes the development of a Total Maximum Daily Load (TMDL) for the pollutant(s) that were found to be the cause of the water quality violations. A Total Maximum Daily Load (TMDL) calculates the maximum amount of a specific pollutant that a waterbody can receive and still meet water quality standards.

A TMDL for a given pollutant and waterbody is composed of the sum of individual wasteload allocations (WLAs) for point sources and load allocations (LAs) for nonpoint sources and natural background levels. In addition, the TMDL must include an implicit or explicit margin of safety (MOS) to account for the uncertainty in the relationship between pollutant loads and the quality of the receiving waterbody. The TMDL components are illustrated using the following equation:

$$TMDL = \Sigma WLAs + \Sigma LAs + MOS$$

Pennsylvania has committed to restoring all impaired waters by developing TMDLs and TMDL alternatives for all impaired waterbodies. The TMDL serves as the starting point or planning tool for restoring water quality.

5.4.1.1 Local TMDL

The subject facility does not discharge into a local TMDL.

5.4.1.2 Chesapeake Bay TMDL Requirement

The Chesapeake Bay Watershed is a large ecosystem that encompasses approximately 64,000 square miles in Maryland, Delaware, Virginia, West Virginia, Pennsylvania, New York and the District of Columbia. An ecosystem is composed of interrelated parts that interact with each other to form a whole. All of the plants and animals in an ecosystem depend on each other in some way. Every living thing needs a healthy ecosystem to survive. Human activities affect the Chesapeake Bay ecosystem by adding pollution, using resources and changing the character of the land.

Most of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the federal Water Pollution Control Act ("Clean Water Act"), 33 U.S.C. § 1313(d). While the Chesapeake Bay is outside the boundaries of Pennsylvania, more than half of the State lies within the watershed. Two major rivers in Pennsylvania are part of the Chesapeake Bay Watershed. They are (a) the Susquehanna River and (b) the Potomac River. These two rivers total 40 percent of the entire Chesapeake Bay watershed.

The overall management approach needed for reducing nitrogen, phosphorus and sediment are provided in the Bay TMDL document and the Phase I, II, and III WIPs which is described in the Bay TMDL document and Executive Order 13508.

The Bay TMDL is a comprehensive pollution reduction effort in the Chesapeake Bay watershed identifying the necessary pollution reductions of nitrogen, phosphorus and sediment across the seven Bay watershed jurisdictions of Delaware, Maryland, New York, Pennsylvania, Virginia, West Virginia and the District of Columbia to meet applicable water quality standards in the Bay and its tidal waters.

The Watershed Implementation Plans (WIPs) provides objectives for how the jurisdictions in partnership with federal and local governments will achieve the Bay TMDL's nutrient and sediment allocations.

Phase 3 WIP provides an update on Chesapeake Bay TMDL implementation activities for point sources and DEP's current implementation strategy for wastewater. The latest revision of the supplement was September 13, 2021.

The Chesapeake Bay TMDL (Appendix Q) categorizes point sources into four sectors:

- Sector A- significant sewage dischargers;
- Sector B- significant industrial waste (IW) dischargers;
- Sector C- non-significant dischargers (both sewage and IW facilities); and
- Sector D- combined sewer overflows (CSOs).

All sectors contain a listing of individual facilities with NPDES permits that were believed to be discharging at the time the TMDL was published (2010). All sectors with the exception of the non-significant dischargers have individual wasteload allocations (WLAs) for TN and TP assigned to specific facilities. Non-significant dischargers have a bulk or aggregate allocation for TN and TP based on the facilities in that sector that were believed to be discharging at that time and their estimated nutrient loads.

Cap Loads will be established in permits as Net Annual TN and TP loads (lbs/yr) that apply during the period of October 1 – September 30. For facilities that have received Cap Loads in any other form, the Cap Loads will be modified accordingly when the permits are renewed.

Offsets have been incorporated into Cap Loads in several permits issued to date. From this point forward, permits will be issued with the WLAs as Cap Loads and will identify Offsets separately to facilitate nutrient trading activities and compliance with the TMDL.

Based upon the supplement the subject facility has been categorized as a Sector A discharger. The supplement defines Sector A as a sewage facility is considered significant if it has a design flow of at least 0.4 MGD.

Table 5 of the Phase 3 WIP (revised July 29, 2022) presents all NPDES permits for Significant Sewage dischargers with Cap Loads. The NPDES Permit No., phase, facility name, latest permit issuance date, expiration date, Cap Load compliance start date, TN and TP Cap Loads, and TN and TP Delivery Ratios are presented. In addition, if TN Offsets were incorporated into the TN Cap Loads when the permit was issued, the amount is shown; these Offsets will be removed from Cap Loads upon issuance of renewed permits to implement Section IV of this document (i.e., a facility may use Offsets for compliance but may not register them as credits).

The total nitrogen (TN) and total phosphorus (TP) cap loads itemized by Table 5 for the subject facility are as follows:

| | |
|----------------------|--------|
| TN Cap Load (lbs/yr) | 12,877 |
| TN Delivery Ratio | 0.540 |
| TP Cap Load (lbs/yr) | 1,717 |
| TP Delivery Ratio | 0.225 |

Expansions by any Significant Sewage discharger will not result in any increase in Cap Loads. Where non-significant facilities expand to a design flow of 0.4 MGD or greater, the lesser of baseline Cap Loads of 7,306 lbs/yr TN and 974 lbs/yr TP or existing performance will be used for permits, and the load will be moved from the Non-Significant sector load to the Significant Sewage sector load. If considered necessary for environmental protection, DEP may decide to move load from the Point Source Reserve to the Significant Sewage sector in the future.

The minimum monitoring frequency for TN species and TP in new or renewed NPDES permits for Significant Sewage dischargers is 2/week.

This facility is subject to Sector A monitoring requirements. Monitoring shall be required at least 2x/wk.

Reporting

Cap Loads will be established in permits as Net Annual TN and TP loads (lbs/yr) that apply during the period of October 1 – September 30.

Facilities with NPDES permits must use DEP's eDMR system for reporting, except small flow treatment facilities. An Annual DMR must be submitted by the end of the Truing Period, November 28. As attachments to the Annual DMR a facility must submit a completed Annual Chesapeake Bay Spreadsheet, available through DEP's Supplemental Reports website, which contains an Annual Nutrient Monitoring worksheet and an Annual Nutrient Budget worksheet. This Spreadsheet will be submitted once per Compliance Year only, and reflect all nutrient sample results (for the period October 1 – September 30), Credit transactions (including the Truing Period) and Offsets applied during the Compliance Year.

5.5 Anti-Degradation Requirement

Chapter 93.4a of the PA regulations requires that surface water of the Commonwealth of Pennsylvania may not be degraded below levels that protect the existing uses. The regulations specifically state that *Existing instream water uses and the level of water quality necessary to protect the existing uses shall be maintained and protected*. Antidegradation requirements are implemented through DEP's guidance manual entitled Water Quality Antidegradation Implementation Guidance (Document #391-0300-02).

The policy requires DEP to protect the existing uses of all surface waters and the existing quality of High Quality (HQ) and Exceptional Value (EV) Waters. Existing uses are protected when DEP makes a final decision on any permit or approval for an activity that may affect a protected use. Existing uses are protected based upon DEP's evaluation of the best available information (which satisfies DEP protocols and Quality Assurance/Quality Control (QA/QC) procedures) that indicates the protected use of the waterbody.

For a new, additional, or increased point source discharge to an HQ or EV water, the person proposing the discharge is required to utilize a nondischarge alternative that is cost-effective and environmentally sound when compared with the cost of the proposed discharge. If a nondischarge alternative is not cost-effective and environmentally sound, the person must use the best available combination of treatment, pollution prevention, and wastewater reuse technologies and assure that any discharge is nondegrading. In the case of HQ waters, DEP may find that after satisfaction of intergovernmental coordination and public participation requirements lower water quality is necessary to accommodate important economic or social development in the area in which the waters are located. In addition, DEP will assure that cost-effective and reasonable best management practices for nonpoint source control in HQ and EV waters are achieved.

The subject facility's discharge will be to a non-special protection waters and the permit conditions are imposed to protect existing instream water quality and uses. Neither HQ waters or EV waters is impacted by this discharge.

5.6 Anti-Backsliding

Anti-backsliding is a federal regulation which prohibits a permit from being renewed, reissued, or modified containing effluent limitations which are less stringent than the comparable effluent limitations in the previous permit (40 CFR 122.I.1 and 40 CFR 122.I.2). A review of the existing permit limitations with the proposed permit limitations confirm that the facility is consistent with anti-backsliding requirements. The facility has proposed effluent limitations that are as stringent as the existing permit.

6.0 NPDES Parameter Details

The basis for the proposed sampling and their monitoring frequency that will appear in the permit for each individual parameter are itemized in this Section. The final limits are the more stringent of technology based effluent treatment (TBEL) requirements, water quality based (WQBEL) limits, TMDL, antidegradation, anti-degradation, or WET.

The reader will find in this section:

- a justification of recommended permit monitoring requirements and limitations for each parameter in the proposed NPDES permit;
- a summary of changes from the existing NPDES permit to the proposed permit; and
- a summary of the proposed NPDES effluent limits.

6.1 Recommended Monitoring Requirements and Effluent Limitations

A 6-mile segment of Dunning Creek includes a total of four dischargers (one industrial waste facility and three minor sewage discharge facilities). Hillside Terrace MHB which was modelled in previous renewals has been abandoned. The four dischargers were modeled to determine the impacts of each of the dischargers on the next downstream discharger. The previous renewal modeled the discharge individually and did not review impacts to the upstream and downstream dischargers.

Tabulated below are assumptions used for the model

- Drainage area Q710, and low flow yield were abstracted from the web based Stream Stats program. The annual average flow rate utilized was the highest flow rate among the years 2019, 2020, or 2021. The flow rate was collected either from DMR data download data or the flow rate reported on the NPDES application.
- Consistent with DEP guidance documents, a default discharge temperature of 20 C was used.
- The discharge pH input into the model was the average of the most recent 12 months of DMR data (i.e. June/July 2021 to May/June 2022).

The table summarizes data inputs into the water quality modeling program.

| Node Point | Facility | Latitude | Longitude | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (mi ²) | Q710 (ft ³ /s) | Low Flow Yield | Annual Average Flow Rate (MGD) | Discharge Temp (C) | Discharge pH |
|------------|----------------------------|----------|-----------|-------------|---------------|------|----------------|----------------------------------|---------------------------|----------------|--------------------------------|--------------------|--------------|
| 1 | Reynoldsdale FH | 40.15602 | -78.56965 | 14586 | Dunning Creek | 14.8 | 1112 | 57.5 | 1.5 | 0.0261 | 1.850 | 20 | 6.93 |
| 2 | East St. Clair Stone Creek | 40.14599 | -78.5622 | 14586 | Dunning Creek | 13.9 | 1097 | 59.4 | 1.57 | 0.0264 | 0.042 | 20 | 7.59 |
| 3 | East St. Clair Fishertown | 40.11285 | -78.55725 | 14586 | Dunning Creek | 10.4 | 1085 | 146 | 4.85 | 0.0332 | 0.057 | 20 | 7.70 |
| 4 | Chestnut Ridge | 40.10476 | -78.53375 | 14586 | Dunning Creek | 8.9 | 1071 | 150 | 4.98 | 0.0332 | 0.546 | 20 | 6.92 |
| 5 | ----- | 40.0923 | -78.51096 | 14586 | Dunning Creek | 7.26 | 1063 | 164 | 5.52 | 0.0337 | ----- | ----- | ----- |
| 6 | ----- | 40.0717 | -78.49519 | 14586 | Dunning Creek | 4.9 | 1055 | 172 | 5.91 | 0.0344 | ----- | ----- | ----- |

Modeling with the highest annual average flow rate represents a worst-case scenario using reasonable flow rates.

For Reynoldsdale Fish Hatchery, the WQM Part 2 permit limits average annual flow to 1.44 MGD and the design hydraulic capacity at 1.6 MGD. The average annual design flow in 2019 was 1.85 MGD. This exceeds their permit limit. DEP will be coordinating with the facility on a re-rate. The effluent limits for CBOD and ammonia-nitrogen shall be reduced slightly. Seasonal limits shall apply. DMR data from July 2021 to June 2022 show the maximum monthly average CBOD and ammonia nitrogen were 7 mg/l and 1.5 mg/l, respectively. The facility should be able to meet their effluent limits.

East St. Clair Stone Creek and East St. Clair Fishertown appear to be unaffected.

Chestnut Ridge will reduce CBOD to 20 mg/l, a summer ammonia nitrogen limit of 7 mg/l, and a winter ammonia limit of 21 mg/l. DMR data from July 2021 to June 2022 confirm that the facility shall not have issues with meeting the reduced effluent limits. The maximum monthly average CBOD and ammonia nitrogen were 5.4 mg/l and <2.7 mg/l, respectively.

The effluent limits for CBOD and ammonia nitrogen are in the table. Both current limits and proposed limits are summarized.

| Current Effluent Limits | | | | | |
|--------------------------|-------|-----------------|-----------------|----------------|----------------|
| Parameter | Units | Reynoldsdale FH | ESC Stone Creek | ESC Fishertown | Chestnut Ridge |
| CBOD (5/1 - 10/31) | mg/l | 8 | 25 | 25 | 25 |
| CBOD (11/1 - 4/30) | mg/l | 16 | 25 | 25 | 25 |
| Ammonia (5/1 - 10/31) | mg/l | 2.5 | ----- | ----- | 8.5 |
| Ammonia (11/1 - 4/30) | mg/l | 7.5 | ----- | ----- | ----- |
| Proposed Effluent Limits | | | | | |
| Parameter | Units | Reynoldsdale FH | ESC Stone Creek | ESC Fishertown | Chestnut Ridge |
| CBOD (5/1 - 10/31) | mg/l | 7 | 25 | 25 | 20 |
| CBOD (11/1 - 4/30) | mg/l | 14 | 25 | 25 | 20 |
| Ammonia (5/1 - 10/31) | mg/l | 2 | ----- | ----- | 7 |
| Ammonia (11/1 - 4/30) | mg/l | 6 | ----- | ----- | 21 |

A summary of the recommended monitoring requirements and effluent limitations are itemized in the tables. The tables are categorized by (a) Conventional Pollutants and Disinfection, (b) Nitrogen Species and Phosphorus, and (c) Toxics.

The mass loadings were based upon a flow rate of 0.705 MGD. Water quality modeling was based upon a flow rate of 0.546 MGD.

6.1.1 Conventional Pollutants and Disinfection

| Summary of Proposed NPDES Parameter Details for Conventional Pollutants and Disinfection Chestnut Ridge Area Joint Authority; PA0087661 | | | |
|--|--|-----------------|---|
| Parameter | Permit Limitation Required by ¹ : | Recommendation | |
| pH (S.U.) | TBEL | Monitoring: | The monitoring frequency shall be daily as a grab sample (Table 6-3). |
| | | Effluent Limit: | Effluent limits may range from pH = 6.0 to 9.0 |
| | | Rationale: | The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 95.2(1). |
| Dissolved Oxygen | BPJ | Monitoring: | The monitoring frequency shall be daily as a grab sample (Table 6-3). |
| | | Effluent Limit: | Effluent limits shall be greater than 5.0 mg/l. |
| | | Rationale: | The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by best professional judgement. |
| CBOD | WQBEL | Monitoring: | The monitoring frequency shall be 1x/wk as an 8-hr composite sample (Table 6-3). |
| | | Effluent Limit: | Effluent limits shall not exceed 117 lbs/day and 20 mg/l as an average monthly. |
| | | Rationale: | The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by either Chapter 92a.47(a)(1) or water quality based effluent limits. Water quality modeling was completed using a total of four dischargers on Dunning Creek.. WQM modeling indicates that the WQBEL is more stringent than the TBEL. Thus, the permit limit is confined to WQBEL. |
| TSS | TBEL | Monitoring: | The monitoring frequency shall be 1x/wk as a 24-hr composite sample (Table 6-3). |
| | | Effluent Limit: | Effluent limits shall not exceed 176 lbs/day and 30 mg/l as an average monthly. |
| | | Rationale: | The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(1). While there is no WQM modeling for this parameter, the permit limit for TSS is generally assigned similar effluent limits as CBOD or BOD. Since the TBEL is more stringent than TBEL, TBEL will apply. |
| UV disinfection | SOP | Monitoring: | The monitoring frequency is 1/day. The facility will be required to record the UV intensity. |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Consistent with the SOP- Establishing Effluent Limitations for Individual Sewage Permits (Revised January 10, 2019), the facility will be required to have routine monitoring for UV transmittance, UV dosage, or UV intensity. |
| Fecal Coliform | TBEL | Monitoring: | The monitoring frequency shall be 1x/wk as a grab sample (Table 6-3). |
| | | Effluent Limit: | Summer effluent limits shall not exceed 200 No./100 mL as a geometric mean. Winter effluent limits shall not exceed 2000 No./100 mL as a geometric mean. |
| | | Rationale: | The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(4) and 92a.47(a)(5). |
| E. Coli | SOP; Chapter 92a.61 | Monitoring: | The monitoring frequency shall be 1x/quarter as a grab sample. |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Consistent with the SOP- Establishing Effluent Limitations for Individual Sewage Permits (Revised March 22, 2019) and under the authority of Chapter 92a.61, the facility will be required to monitor for E.Coli. |

Notes:

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other

2 Monitoring frequency based on flow rate of 0.705 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

6.1.2 Nitrogen Species and Phosphorus

| Summary of Proposed NPDES Parameter Details for Nitrogen Species and Phosphorus | | | |
|--|--|-----------------|--|
| Chestnut Ridge Area Joint Authority; PA0087661 | | | |
| Parameter | Permit Limitation Required by ¹ : | Recommendation | |
| Ammonia-Nitrogen | WQBEL | Monitoring: | The monitoring frequency shall be 2x/wk as a 24-hr composite sample |
| | | Effluent Limit: | During the months of May 1 to October 31, effluent limits shall not exceed 41 lbs/day and 7.0 mg/l as an average monthly. During the months of November 1 to April 30, effluent limits shall not exceed 123 lbs/day and 21.0 mg/l as an average monthly. |
| | | Rationale: | Water quality modeling was completed using a total of four dischargers on Dunning Creek. Modeling recommends effluent limits |
| Nitrate-Nitrite as N | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 2x/wk as a 24-hr composite sample |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/wk. |
| Total Nitrogen | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 1x/mo as a calculation |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/mo. |
| TKN | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 2x/wk as a 24-hr composite sample |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/wk. |
| Total Phosphorus | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 2x/wk as a 24-hr composite sample |
| | | Effluent Limit: | No effluent requirements. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/wk. |
| Net Total Nitrogen | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 1x/yr as a 24-hr composite sample |
| | | Effluent Limit: | The cap load is 12,877 lbs/yr. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr. |
| Net Total Phosphorus | Chesapeake Bay TMDL | Monitoring: | The monitoring frequency shall be 1x/yr as a 24-hr composite sample |
| | | Effluent Limit: | The cap load is 1,717 lbs/yr. |
| | | Rationale: | Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr. |
| Notes: | | | |
| 1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other | | | |
| 2 Monitoring frequency based on flow rate of 0.705 MGD. | | | |
| 3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97 | | | |
| 4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002) | | | |
| 5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021 | | | |

6.1.3 Toxics

The Toxics Management Spreadsheet was run using an annual flow rate of 0.546 MGD and 0.705 MGD. Both scenarios would still require monitoring for total copper and total zinc.

| Summary of Proposed NPDES Parameter Details for Toxics | | | |
|--|--|-----------------|---|
| Chestnut Ridge Area Joint Authority; PA0087661 | | | |
| Parameter | Permit Limitation Required by ¹ : | Recommendation | |
| Total Copper | WQBEL | Monitoring: | The monitoring frequency shall be 2x/year as a 24-hr composite sample |
| | | Effluent Limit: | No effluent requirement |
| | | Rationale: | Toxics Management Spreadsheet recommends monitoring. Monitoring shall be required 2x/yr. Pending favorable results, future renewals may reduce or eliminate monitoring. |
| Total Zinc | WQBEL | Monitoring: | The monitoring frequency shall be 2x/year as a 24-hr composite sample |
| | | Effluent Limit: | No effluent requirement |
| | | Rationale: | Toxics Management Spreadsheet recommends monitoring. Monitoring shall be required 2x/yr. Pending favorable results, future renewals may reduce or eliminate monitoring. |
| Notes: | | | |

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other

2 Monitoring frequency based on flow rate of 0.705 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

6.1.3.1 Implementation of Regulation- Chapter 92a.61

Chapter 92a.61 provides provisions to DEP to monitor for pollutants that may have an impact on the quality of waters of the Commonwealth. Based upon DEP policy directives issued on March 22, 2021 and in conjunction with EPA's 2017 Triennial Review, monitoring for E. Coli shall be required.

6.2 Summary of Changes From Existing Permit to Proposed Permit

A summary of how the proposed NPDES permit differs from the existing NPDES permit is summarized as follows.

| Changes in Permit Monitoring or Effluent Quality | | |
|--|---|--|
| Parameter | Existing Permit | Draft Permit |
| CBOD | Effluent limits shall not exceed 147 lbs/day and 25 mg/l as an average monthly. | Effluent limits shall not exceed 117 lbs/day and 20 mg/l as an average monthly. Water quality modeling was completed using a total of four dischargers on Dunning Creek. WQM modeling indicates that the WQBEL is more stringent than the TBEL. Thus, the permit limit is confined to WQBEL. |
| Ammonia-Nitrogen | During the months of May 1 to October 31, effluent limits shall not exceed 50 lbs/day and 8.5 mg/l as an average monthly. | During the months of May 1 to October 31, effluent limits shall not exceed 41 lbs/day and 7.0 mg/l as an average monthly. During the months of November 1 to April 30, effluent limits shall not exceed 123 lbs/day and 21.0 mg/l as an average monthly. |
| E. Coli | No monitoring or effluent limits | Due to the EPA triennial review, monitoring shall be 1x/quarter |
| Total Copper | No monitoring or effluent limits | Monitoring shall be 2x/yr. Pending favorable results, future renewals may reduce or eliminate monitoring. |
| Total Zinc | No monitoring or effluent limits | Monitoring shall be 2x/yr. Pending favorable results, future renewals may reduce or eliminate monitoring. |

6.3.1 Summary of Proposed NPDES Effluent Limits

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

The proposed NPDES effluent limitations are summarized in the table below.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 6' 16.45", Longitude 78° 32' 2.86", River Mile Index 8.9, Stream Code 14586

Receiving Waters: Dunning Creek (WWF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|--|-------------------------------------|------------------|-----------------|-----------------------|------------------|------------------|--|----------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Daily Minimum | Concentrations (mg/L) | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Average Monthly | Weekly Average | | Average Monthly | Weekly Average | Instant. Maximum | | |
| Flow (MGD) | Report | Report Daily Max | XXX | XXX | XXX | XXX | Continuous | Measured |
| pH (S.U.) | XXX | XXX | 6.0 Inst Min | XXX | XXX | 9.0 | 1/day | Grab |
| Dissolved Oxygen | XXX | XXX | 5.0 Inst Min | XXX | XXX | XXX | 1/day | Grab |
| Carbonaceous Biochemical Oxygen Demand (CBOD5) | 117 | 188 | XXX | 20.0 | 32.0 | 40 | 1/week | 24-Hr Composite |
| Biochemical Oxygen Demand (BOD5) Raw Sewage Influent | Report | Report Daily Max | XXX | Report | XXX | XXX | 1/week | 24-Hr Composite |
| Total Suspended Solids | 176 | 264 | XXX | 30.0 | 45.0 | 60 | 1/week | 24-Hr Composite |
| Total Suspended Solids Raw Sewage Influent | Report | Report Daily Max | XXX | Report | XXX | XXX | 1/week | 24-Hr Composite |
| Fecal Coliform (No./100 ml) Oct 1 - Apr 30 | XXX | XXX | XXX | 2000 Geo Mean | XXX | 10000 | 1/week | Grab |
| Fecal Coliform (No./100 ml) May 1 - Sep 30 | XXX | XXX | XXX | 200 Geo Mean | XXX | 1000 | 1/week | Grab |
| E. Coli (No./100 ml) | XXX | XXX | XXX | XXX | Report Daily Max | XXX | 1/quarter | Grab |

Outfall001 , Continued (from Permit Effective Date through Permit Expiration Date)

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|--|-------------------------------------|-------------------|-----------------------|--------------------|-------------------|---------------------|--|----------------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Average Monthly | Weekly Average | Daily Minimum | Average Monthly | Weekly Average | Instant. Maximum | | |
| Ultraviolet light intensity (mW/cm ²) | XXX | XXX | Report | XXX | XXX | XXX | 1/day | Recorded |
| Ammonia-Nitrogen Nov 1 - Apr 30 | 123 | XXX | XXX | 21.0 | XXX | 42 | 2/week | 24-Hr Composite |
| Ammonia-Nitrogen May 1 - Oct 31 | 41 | XXX | XXX | 7.0 | XXX | 14 | 2/week | 24-Hr Composite |
| Total Phosphorus | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Copper, Total | Report SEMI AVG | XXX | XXX | Report SEMI AVG | XXX | XXX | 1/6 months | 24-Hr Composite |
| Zinc, Total | Report SEMI AVG | XXX | XXX | Report SEMI AVG | XXX | XXX | 1/6 months | 24-Hr Composite |

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. B. For Outfall 001, Latitude 40° 6' 16.45", Longitude 78° 32' 2.86", River Mile Index 8.9, Stream Code 14586

Receiving Waters: Dunning Creek (WWF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

| Parameter | Effluent Limitations | | | | | | Monitoring Requirements | |
|----------------------|-------------------------------------|--------|-----------------------|--------------------|---------|---------------------|--|-----------------------------------|
| | Mass Units (lbs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | | Minimum ⁽²⁾ Measurement Frequency | Required Sample Type |
| | Monthly | Annual | Monthly | Monthly Average | Maximum | Instant. Maximum | | |
| Ammonia-N | Report | Report | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Kjeldahl-N | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Nitrate-Nitrite as N | Report | XXX | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Total Nitrogen | Report | Report | XXX | Report | XXX | XXX | 1/month | Calculation 24-Hr Composite |
| Total Phosphorus | Report | Report | XXX | Report | XXX | XXX | 2/week | 24-Hr Composite |
| Net Total Nitrogen | XXX | 12877 | XXX | XXX | XXX | XXX | 1/year | Calculation |
| Net Total Phosphorus | XXX | 1717 | XXX | XXX | XXX | XXX | 1/year | Calculation |

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Footnotes:

- (1) See Part C for Chesapeake Bay Requirements.
- (2) This is the minimum number of sampling events required. Permittees are encouraged, and it may be advantageous in demonstrating compliance, to perform more than the minimum number of sampling events required.

(3) The permittee is authorized to use 10,000 lbs/year of Total Nitrogen (TN) Offsets towards compliance with the Annual Net TN mass load limitation (Cap Load), in accordance with Part C of this permit. These Offsets may be applied throughout the Compliance Year or during the Truing Period. The application of Offsets must be reported to DEP as described in Part C. The Offsets are authorized for the following pollutant load reduction activities:

- Connection of 400 on-lot sewage disposal systems to the public sewer system after January 1, 2003 in which 25 lbs/year of TN offsets are granted per connection.

6.3.2 Summary of Proposed Permit Part C Conditions

The subject facility has the following Part C conditions.

- Hauled-in Waste Restrictions
- Chesapeake Bay Nutrient Definitions
- Solids Management for Non-Lagoon Treatment Systems

| Tools and References Used to Develop Permit | |
|---|--|
| <input checked="" type="checkbox"/> | WQM for Windows Model (see Attachment) |
| <input checked="" type="checkbox"/> | Toxics Management Spreadsheet (see Attachment) |
| <input type="checkbox"/> | TRC Model Spreadsheet (see Attachment) |
| <input type="checkbox"/> | Temperature Model Spreadsheet (see Attachment) |
| <input type="checkbox"/> | Water Quality Toxics Management Strategy, 361-0100-003, 4/06. |
| <input type="checkbox"/> | Technical Guidance for the Development and Specification of Effluent Limitations, 362-0400-001, 10/97. |
| <input type="checkbox"/> | Policy for Permitting Surface Water Diversions, 362-2000-003, 3/98. |
| <input type="checkbox"/> | Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 362-2000-008, 11/96. |
| <input type="checkbox"/> | Technology-Based Control Requirements for Water Treatment Plant Wastes, 362-2183-003, 10/97. |
| <input type="checkbox"/> | Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 362-2183-004, 12/97. |
| <input type="checkbox"/> | Pennsylvania CSO Policy, 385-2000-011, 9/08. |
| <input type="checkbox"/> | Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03. |
| <input type="checkbox"/> | Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 391-2000-002, 4/97. |
| <input type="checkbox"/> | Determining Water Quality-Based Effluent Limits, 391-2000-003, 12/97. |
| <input type="checkbox"/> | Implementation Guidance Design Conditions, 391-2000-006, 9/97. |
| <input type="checkbox"/> | Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 391-2000-007, 6/2004. |
| <input type="checkbox"/> | Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 391-2000-008, 10/1997. |
| <input type="checkbox"/> | Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 391-2000-010, 3/99. |
| <input type="checkbox"/> | Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 391-2000-011, 5/2004. |
| <input type="checkbox"/> | Implementation Guidance for Section 93.7 Ammonia Criteria, 391-2000-013, 11/97. |
| <input type="checkbox"/> | Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 391-2000-014, 4/2008. |
| <input type="checkbox"/> | Implementation Guidance Total Residual Chlorine (TRC) Regulation, 391-2000-015, 11/1994. |
| <input type="checkbox"/> | Implementation Guidance for Temperature Criteria, 391-2000-017, 4/09. |
| <input type="checkbox"/> | Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 391-2000-018, 10/97. |
| <input type="checkbox"/> | Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 391-2000-019, 10/97. |
| <input type="checkbox"/> | Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 391-2000-021, 3/99. |
| <input type="checkbox"/> | Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 391-2000-022, 3/1999. |
| <input type="checkbox"/> | Design Stream Flows, 391-2000-023, 9/98. |
| <input type="checkbox"/> | Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 391-2000-024, 10/98. |
| <input type="checkbox"/> | Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 391-3200-013, 6/97. |
| <input type="checkbox"/> | Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07. |
| <input checked="" type="checkbox"/> | SOP: New and Reissuance Sewage Individual NPDES Permit Applications, revised 02/03/2022 |
| <input type="checkbox"/> | Other: |

Attachment A

Stream Stats/Gauge Data

Table 1 13

Table 1. List of U.S. Geological Survey streamgage locations in and near Pennsylvania with updated streamflow statistics.—Continued

[Latitude and Longitude in decimal degrees; mi², square miles]

| Streamgage number | Streamgage name | Latitude | Longitude | Drainage area (mi ²) | Regulated ¹ |
|-------------------|---|----------|-----------|----------------------------------|------------------------|
| 01541303 | West Branch Susquehanna River at Hyde, Pa. | 41.005 | -78.457 | 474 | Y |
| 01541308 | Bradley Run near Ashville, Pa. | 40.509 | -78.584 | 6.77 | N |
| 01541500 | Clearfield Creek at Dimeling, Pa. | 40.972 | -78.406 | 371 | Y |
| 01542000 | Moshannon Creek at Osceola Mills, Pa. | 40.850 | -78.268 | 68.8 | N |
| 01542500 | WB Susquehanna River at Karthaus, Pa. | 41.118 | -78.109 | 1,462 | Y |
| 01542810 | Waldy Run near Emporium, Pa. | 41.579 | -78.293 | 5.24 | N |
| 01543000 | Driftwood Branch Sinnemahoning Creek at Sterling Run, Pa. | 41.413 | -78.197 | 272 | N |
| 01543500 | Sinnemahoning Creek at Sinnemahoning, Pa. | 41.317 | -78.103 | 685 | N |
| 01544000 | First Fork Sinnemahoning Creek near Sinnemahoning, Pa. | 41.402 | -78.024 | 245 | Y |
| 01544500 | Kettle Creek at Cross Fork, Pa. | 41.476 | -77.826 | 136 | N |
| 01545000 | Kettle Creek near Westport, Pa. | 41.320 | -77.874 | 233 | Y |
| 01545500 | West Branch Susquehanna River at Renovo, Pa. | 41.325 | -77.751 | 2,975 | Y |
| 01545600 | Young Womans Creek near Renovo, Pa. | 41.390 | -77.691 | 46.2 | N |
| 01546000 | North Bald Eagle Creek at Milesburg, Pa. | 40.942 | -77.794 | 119 | N |
| 01546400 | Spring Creek at Houserville, Pa. | 40.834 | -77.828 | 58.5 | N |
| 01546500 | Spring Creek near Axemann, Pa. | 40.890 | -77.794 | 87.2 | N |
| 01547100 | Spring Creek at Milesburg, Pa. | 40.932 | -77.786 | 142 | N |
| 01547200 | Bald Eagle Creek below Spring Creek at Milesburg, Pa. | 40.943 | -77.786 | 265 | N |
| 01547500 | Bald Eagle Creek at Blanchard, Pa. | 41.052 | -77.604 | 339 | Y |
| 01547700 | Marsh Creek at Blanchard, Pa. | 41.060 | -77.606 | 44.1 | N |
| 01547800 | South Fork Beech Creek near Snow Shoe, Pa. | 41.024 | -77.904 | 12.2 | N |
| 01547950 | Beech Creek at Monument, Pa. | 41.112 | -77.702 | 152 | N |
| 01548005 | Bald Eagle Creek near Beech Creek Station, Pa. | 41.081 | -77.549 | 562 | Y |
| 01548500 | Pine Creek at Cedar Run, Pa. | 41.522 | -77.447 | 604 | N |
| 01549000 | Pine Creek near Waterville, Pa. | 41.313 | -77.379 | 750 | N |
| 01549500 | Blockhouse Creek near English Center, Pa. | 41.474 | -77.231 | 37.7 | N |
| 01549700 | Pine Creek below Little Pine Creek near Waterville, Pa. | 41.274 | -77.324 | 944 | Y |
| 01550000 | Lycoming Creek near Trout Run, Pa. | 41.418 | -77.033 | 173 | N |
| 01551500 | WB Susquehanna River at Williamsport, Pa. | 41.236 | -76.997 | 5,682 | Y |
| 01552000 | Loyalsock Creek at Loyalsockville, Pa. | 41.325 | -76.912 | 435 | N |
| 01552500 | Muncy Creek near Sonestown, Pa. | 41.357 | -76.535 | 23.8 | N |
| 01553130 | Sand Spring Run near White Deer, Pa. | 41.059 | -77.077 | 4.93 | N |
| 01553500 | West Branch Susquehanna River at Lewisburg, Pa. | 40.968 | -76.876 | 6,847 | Y |
| 01553700 | Chillisquaue Creek at Washingtonville, Pa. | 41.062 | -76.680 | 51.3 | N |
| 01554000 | Susquehanna River at Sunbury, Pa. | 40.835 | -76.827 | 18,300 | Y |
| 01554500 | Shamokin Creek near Shamokin, Pa. | 40.810 | -76.584 | 54.2 | N |
| 01555000 | Penns Creek at Penns Creek, Pa. | 40.867 | -77.048 | 301 | N |
| 01555500 | East Mahantango Creek near Dalmatia, Pa. | 40.611 | -76.912 | 162 | N |
| 01556000 | Frankstown Branch Juniata River at Williamsburg, Pa. | 40.463 | -78.200 | 291 | N |
| 01557500 | Bald Eagle Creek at Tyrone, Pa. | 40.684 | -78.234 | 44.1 | N |
| 01558000 | Little Juniata River at Spruce Creek, Pa. | 40.613 | -78.141 | 220 | N |
| 01559000 | Juniata River at Huntingdon, Pa. | 40.485 | -78.019 | 816 | LF |
| 01559500 | Standing Stone Creek near Huntingdon, Pa. | 40.524 | -77.971 | 128 | N |
| 01559700 | Sulphur Springs Creek near Manns Choice, Pa. | 39.978 | -78.619 | 5.28 | N |
| 01560000 | Dunning Creek at Belden, Pa. | 40.072 | -78.493 | 172 | N |

26 Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania

Table 2. Selected low-flow statistics for streamgage locations in and near Pennsylvania.—Continued

[ft³/s; cubic feet per second; —, statistic not computed; <, less than]

| Streamgage number | Period of record used in analysis ¹ | Number of years used in analysis | 1-day, 10-year (ft ³ /s) | 7-day, 10-year (ft ³ /s) | 7-day, 2-year (ft ³ /s) | 30-day, 10-year (ft ³ /s) | 30-day, 2-year (ft ³ /s) | 90-day, 10-year (ft ³ /s) |
|-------------------|--|----------------------------------|-------------------------------------|-------------------------------------|------------------------------------|--------------------------------------|-------------------------------------|--------------------------------------|
| 01546000 | 1912–1934 | 17 | 1.8 | 2.2 | 6.8 | 3.7 | 12.1 | 11.2 |
| 01546400 | 1986–2008 | 23 | 13.5 | 14.0 | 19.6 | 15.4 | 22.3 | 18.7 |
| 01546500 | 1942–2008 | 67 | 26.8 | 29.0 | 41.3 | 31.2 | 44.2 | 33.7 |
| 01547100 | 1969–2008 | 40 | 102 | 105 | 128 | 111 | 133 | 117 |
| 01547200 | 1957–2008 | 52 | 99.4 | 101 | 132 | 106 | 142 | 115 |
| 01547500 | ² 1971–2008 | 38 | 28.2 | 109 | 151 | 131 | 172 | 153 |
| 01547500 | ³ 1956–1969 | 14 | 90.0 | 94.9 | 123 | 98.1 | 131 | 105 |
| 01547700 | 1957–2008 | 52 | .5 | .6 | 2.7 | 1.1 | 3.9 | 2.2 |
| 01547800 | 1971–1981 | 11 | 1.6 | 1.8 | 2.4 | 2.1 | 2.9 | 3.5 |
| 01547950 | 1970–2008 | 39 | 12.1 | 13.6 | 28.2 | 17.3 | 36.4 | 23.8 |
| 01548005 | ² 1971–2000 | 25 | 142 | 151 | 206 | 178 | 241 | 223 |
| 01548005 | ³ 1912–1969 | 58 | 105 | 114 | 147 | 125 | 165 | 140 |
| 01548500 | 1920–2008 | 89 | 21.2 | 24.2 | 50.1 | 33.6 | 68.6 | 49.3 |
| 01549000 | 1910–1920 | 11 | 26.0 | 32.9 | 78.0 | 46.4 | 106 | 89.8 |
| 01549500 | 1942–2008 | 67 | .6 | .8 | 2.5 | 1.4 | 3.9 | 2.6 |
| 01549700 | 1959–2008 | 50 | 33.3 | 37.2 | 83.8 | 51.2 | 117 | 78.4 |
| 01550000 | 1915–2008 | 94 | 6.6 | 7.6 | 16.8 | 11.2 | 24.6 | 18.6 |
| 01551500 | ² 1963–2008 | 46 | 520 | 578 | 1,020 | 678 | 1,330 | 919 |
| 01551500 | ³ 1901–1961 | 61 | 400 | 439 | 742 | 523 | 943 | 752 |
| 01552000 | 1927–2008 | 80 | 20.5 | 22.2 | 49.5 | 29.2 | 69.8 | 49.6 |
| 01552500 | 1942–2008 | 67 | .9 | 1.2 | 3.1 | 1.7 | 4.4 | 3.3 |
| 01553130 | 1969–1981 | 13 | 1.0 | 1.1 | 1.5 | 1.3 | 1.8 | 1.7 |
| 01553500 | ² 1968–2008 | 41 | 760 | 838 | 1,440 | 1,000 | 1,850 | 1,470 |
| 01553500 | ³ 1941–1966 | 26 | 562 | 619 | 880 | 690 | 1,090 | 881 |
| 01553700 | 1981–2008 | 28 | 9.1 | 10.9 | 15.0 | 12.6 | 17.1 | 15.2 |
| 01554000 | ² 1981–2008 | 28 | 1,830 | 1,990 | 3,270 | 2,320 | 4,210 | 3,160 |
| 01554000 | ³ 1939–1979 | 41 | 1,560 | 1,630 | 2,870 | 1,880 | 3,620 | 2,570 |
| 01554500 | 1941–1993 | 53 | 16.2 | 22.0 | 31.2 | 25.9 | 35.7 | 31.4 |
| 01555000 | 1931–2008 | 78 | 33.5 | 37.6 | 58.8 | 43.4 | 69.6 | 54.6 |
| 01555500 | 1931–2008 | 78 | 4.9 | 6.5 | 18.0 | 9.4 | 24.3 | 16.6 |
| 01556000 | 1918–2008 | 91 | 43.3 | 47.8 | 66.0 | 55.1 | 75.0 | 63.7 |
| 01557500 | 1946–2008 | 63 | 2.8 | 3.2 | 6.3 | 4.2 | 8.1 | 5.8 |
| 01558000 | 1940–2008 | 69 | 56.3 | 59.0 | 79.8 | 65.7 | 86.2 | 73.7 |
| 01559000 | 1943–2008 | 66 | 104 | 177 | 249 | 198 | 279 | 227 |
| 01559500 | 1931–1958 | 28 | 9.3 | 10.5 | 15.0 | 12.4 | 17.8 | 15.8 |
| 01559700 | 1963–1978 | 16 | .1 | .1 | .2 | .1 | .3 | .2 |
| 01560000 | 1941–2008 | 68 | 8.5 | 9.4 | 15.6 | 12.0 | 20.2 | 16.2 |
| 01561000 | 1932–1958 | 27 | .4 | .5 | 1.6 | .8 | 2.5 | 1.7 |
| 01562000 | 1913–2008 | 96 | 64.1 | 67.1 | 106 | 77.4 | 122 | 94.5 |
| 01562500 | 1931–1957 | 27 | 1.1 | 1.6 | 3.8 | 2.3 | 5.4 | 3.7 |
| 01563200 | ² 1974–2008 | 35 | — | — | — | 112 | 266 | 129 |
| 01563200 | ³ 1948–1972 | 25 | 10.3 | 28.2 | 86.1 | 64.5 | 113 | 95.5 |
| 01563500 | ² 1974–2008 | 35 | 384 | 415 | 519 | 441 | 580 | 493 |
| 01563500 | ³ 1939–1972 | 34 | 153 | 242 | 343 | 278 | 399 | 333 |
| 01564500 | 1940–2008 | 69 | 3.6 | 4.2 | 10.0 | 6.2 | 14.4 | 10.6 |


StreamStats Report

Region ID: PA

Workspace ID: PA20220726181829433000

Clicked Point (Latitude, Longitude): 40.15602, -78.56965

Time: 2022-07-26 14:18:49 -0400

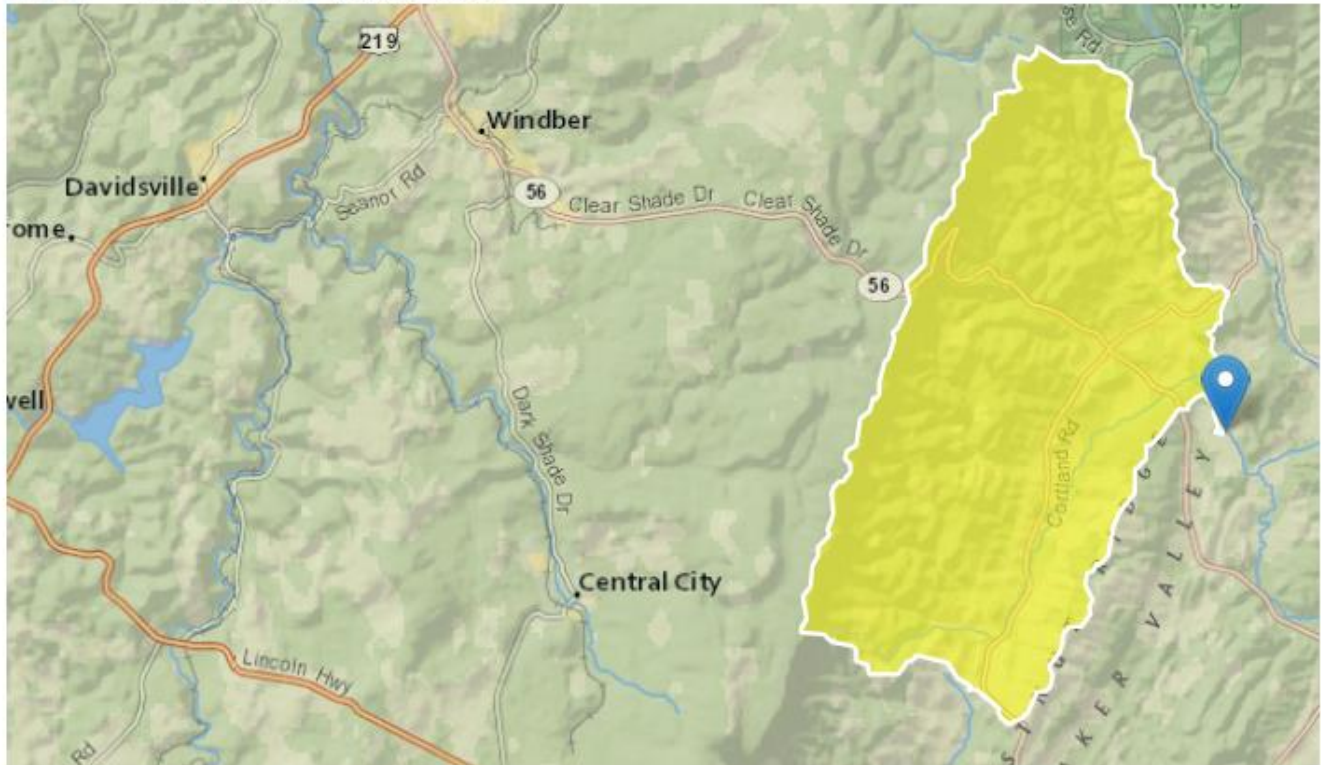

Dunning Creek- Modeling for Reynoldsdale, East. St. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #1 July 2022

[+ Collapse All](#)

> Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 0.28 | percent |
| DRNAREA | Area that drains to a point on a stream | 57.5 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 3.9 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.22 | miles per square mile |

> Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (57.5 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 57.5 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.22 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 3.9 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 0.28 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (57.5 square miles) Low Flow Region 2]

PIl: Prediction Interval-Lower, PIu: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)

| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 3.65 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 5.25 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 1.5 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 2.22 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 3.83 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.


Application Version: 4.10.1

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1

StreamStats Report

Region ID: PA
Workspace ID: PA20220726182428844000
Clicked Point (Latitude, Longitude): 40.14599, -78.56220
Time: 2022-07-26 14:24:48 -0400

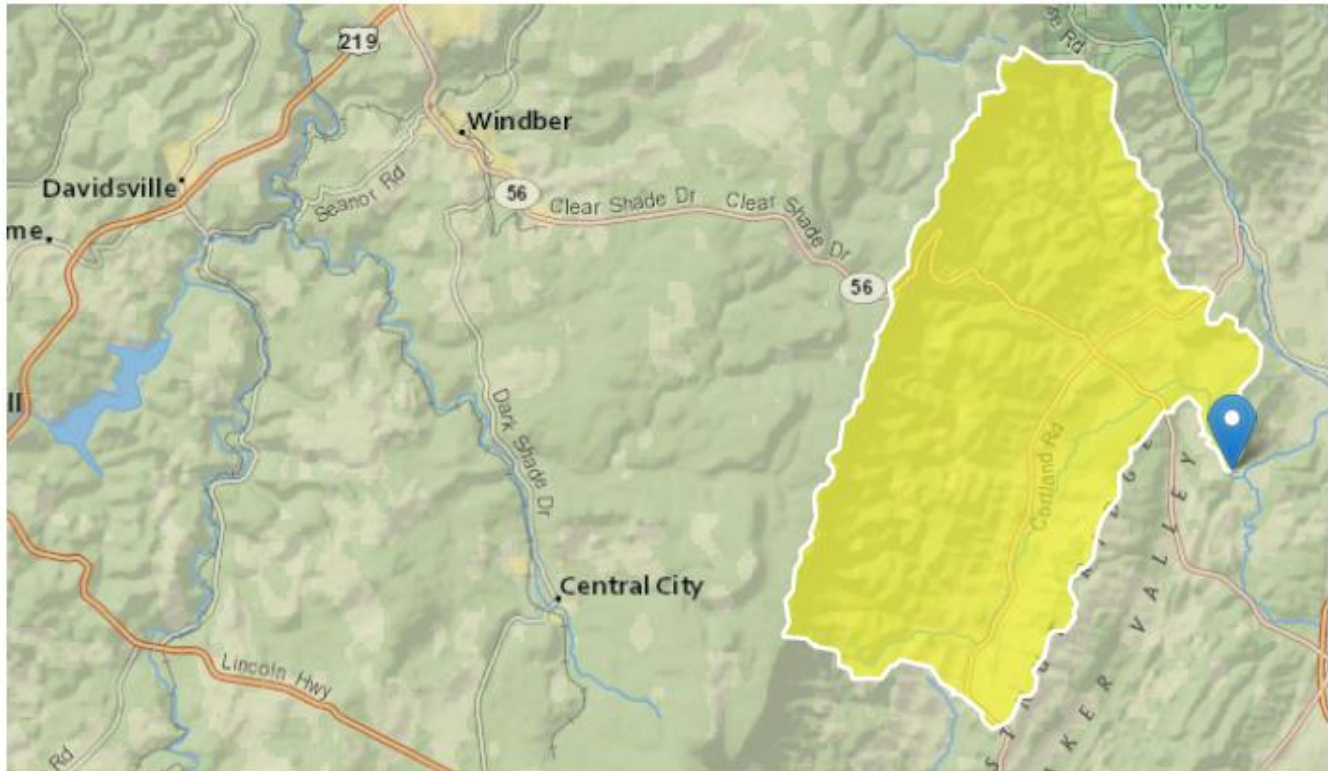

Dunning Creek- Modeling for Reynoldsdale, East. St. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #2 July 2022

[+ Collapse All](#)

> Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 0.27 | percent |
| DRNAREA | Area that drains to a point on a stream | 59.4 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 3.9 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.21 | miles per square mile |

> Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (59.4 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 59.4 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.21 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 3.9 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 0.27 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (59.4 square miles) Low Flow Region 2]

PIl: Prediction Interval-Lower, Plu: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)


| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 3.8 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 5.46 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 1.57 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 2.31 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 3.99 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

StreamStats Report

Region ID: PA
Workspace ID: PA20220726182722518000
Clicked Point (Latitude, Longitude): 40.11285, -78.55725
Time: 2022-07-26 14:27:42 -0400

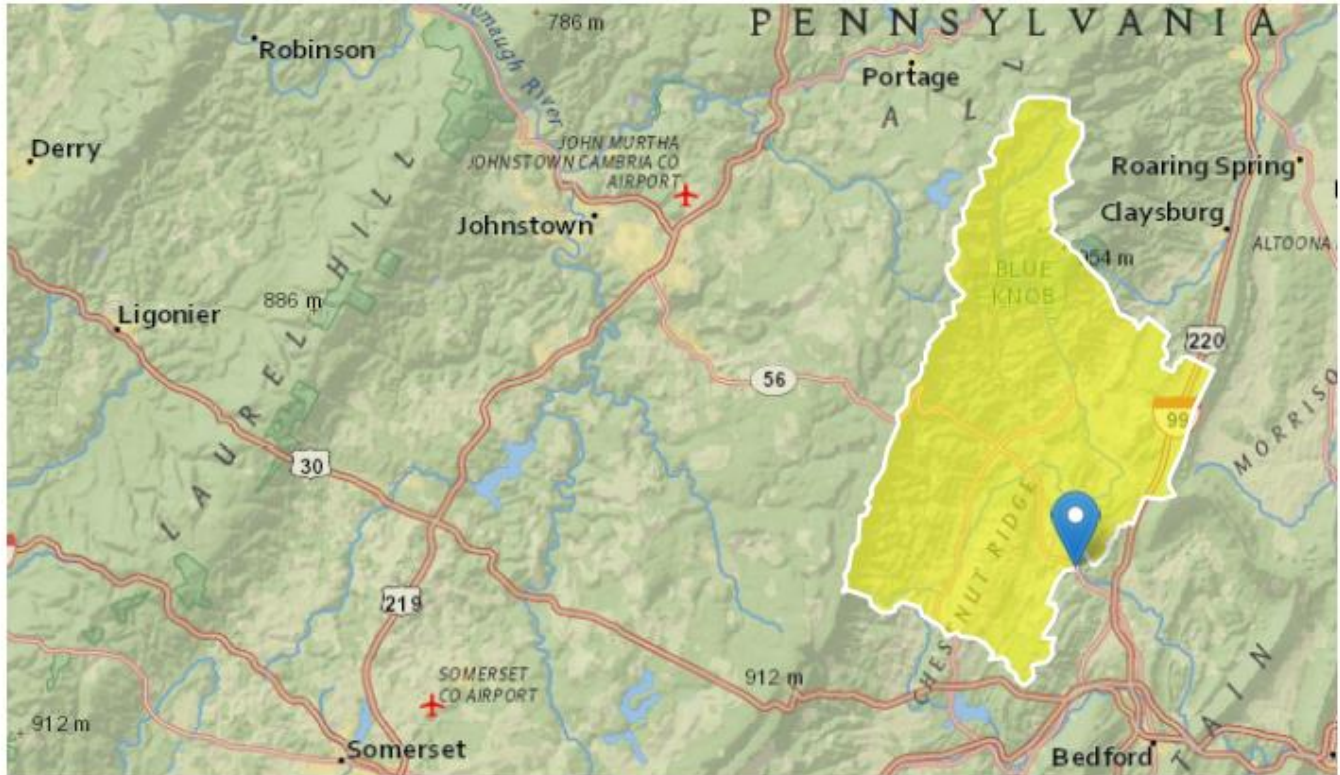

Dunning Creek- Modeling for Reynoldsdale, East. St. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #3 July 2022

Collapse All

➤ Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 2.75 | percent |
| DRNAREA | Area that drains to a point on a stream | 146 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 4 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.29 | miles per square mile |

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (146 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 146 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.29 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 4 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 2.75 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (146 square miles) Low Flow Region 2]

PIl: Prediction Interval-Lower, PIu: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)


| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 10.7 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 15 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 4.85 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 6.92 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 11.3 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

StreamStats Report

Region ID: PA
Workspace ID: PA20220726183107966000
Clicked Point (Latitude, Longitude): 40.10476, -78.53375
Time: 2022-07-26 14:31:31 -0400

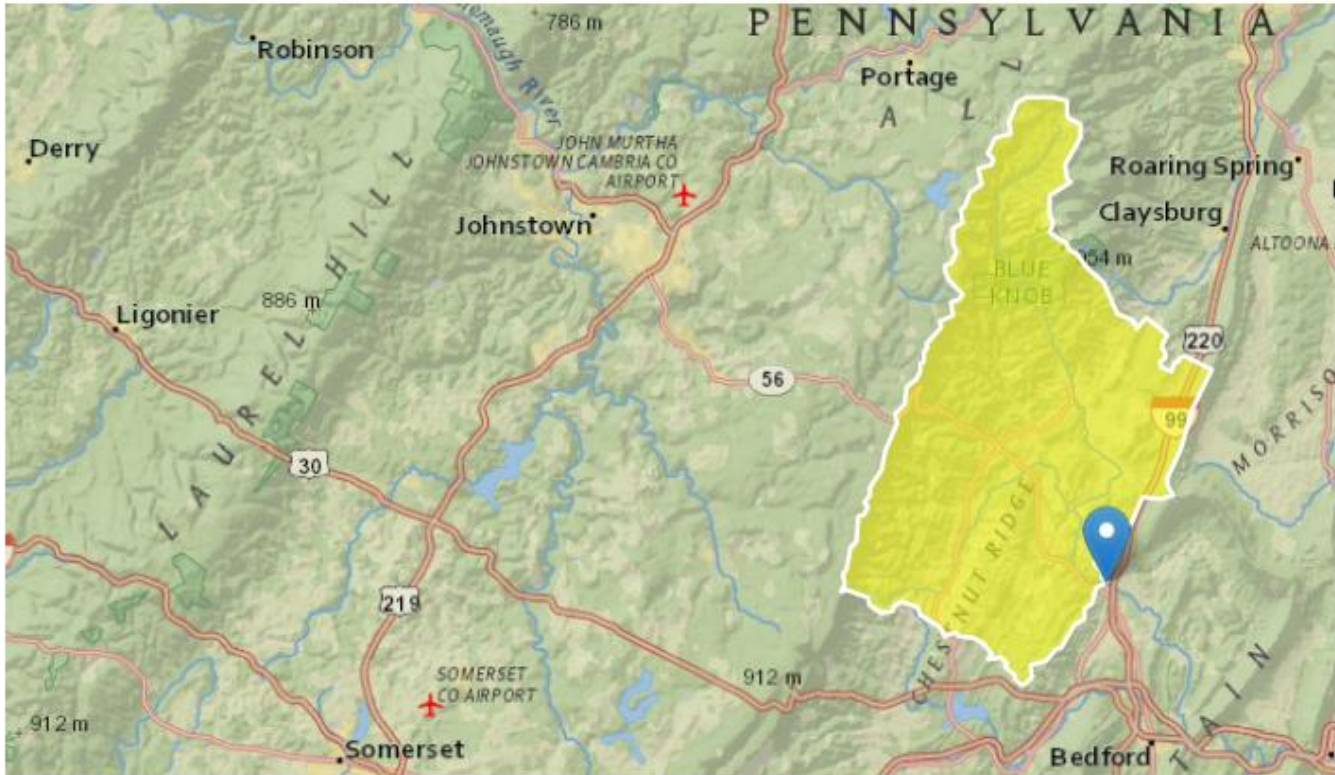

Dunning Creek- Modeling for Reynoldsdale, East. St. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #4 July 2022

Collapse All

➤ Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 2.68 | percent |
| DRNAREA | Area that drains to a point on a stream | 150 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 4 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.3 | miles per square mile |

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (150 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 150 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.3 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 4 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 2.68 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (150 square miles) Low Flow Region 2]

PIl: Prediction Interval-Lower, PIu: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)


| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 11 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 15.4 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 4.98 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 7.1 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 11.6 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

StreamStats Report

Region ID: PA
Workspace ID: PA20220726183350068000
Clicked Point (Latitude, Longitude): 40.09230, -78.51096
Time: 2022-07-26 14:34:13 -0400

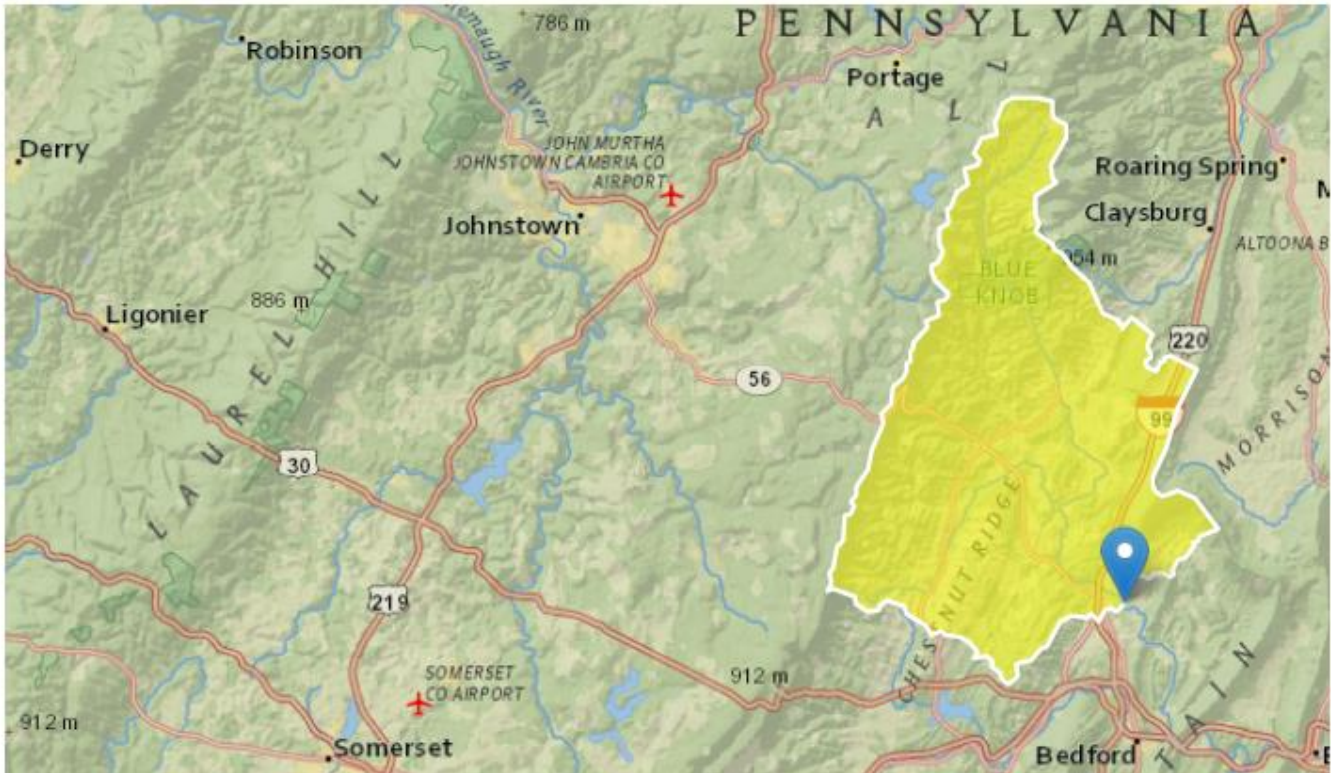

Dunning Creek- Modeling for Reynoldsdale, East. St. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #5 July 2022

[+ Collapse All](#)

> Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 3.13 | percent |
| DRNAREA | Area that drains to a point on a stream | 164 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 4 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.32 | miles per square mile |

> Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (164 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 164 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.32 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 4 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 3.13 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (164 square miles) Low Flow Region 2]

PIl: Prediction Interval-Lower, PIu: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)


| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 12.1 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 16.9 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 5.52 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 7.85 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 12.7 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

StreamStats Report

Region ID: PA
Workspace ID: PA20220727170625220000
Clicked Point (Latitude, Longitude): 40.07170, -78.49519
Time: 2022-07-27 13:06:49 -0400

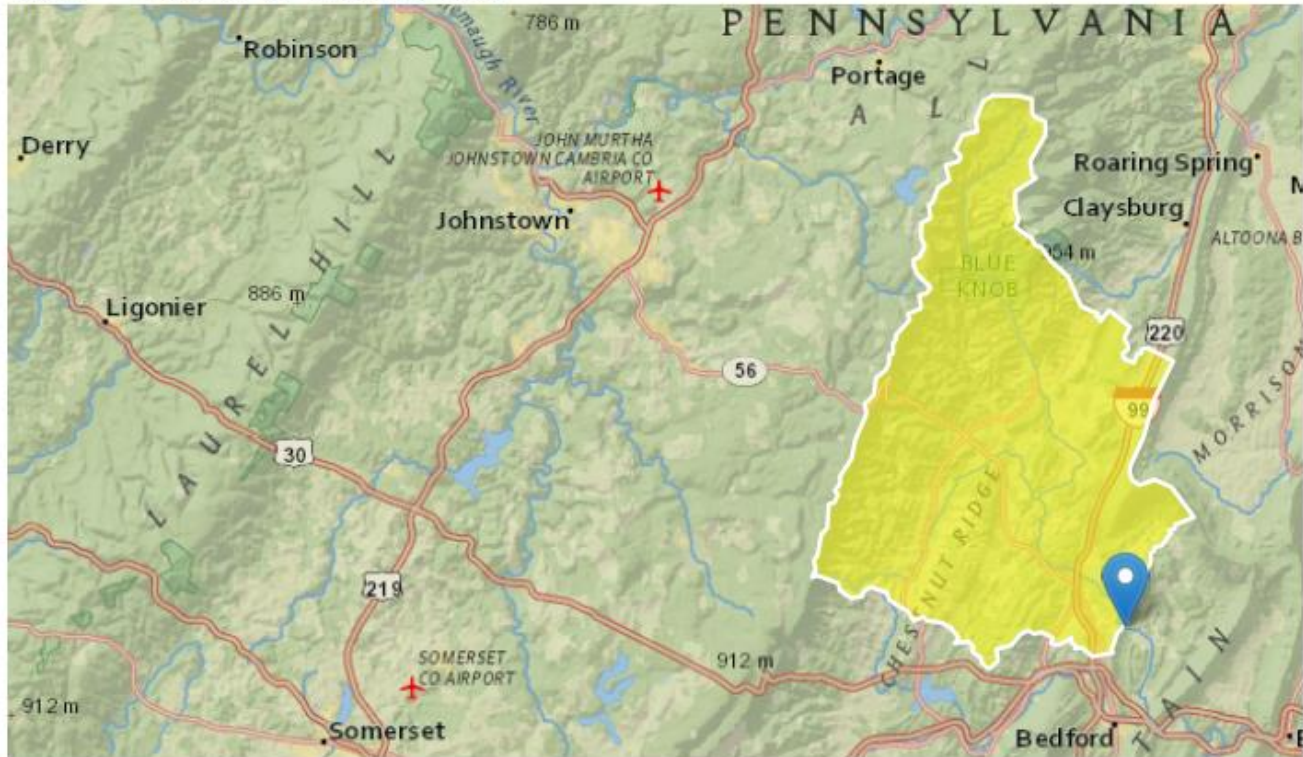

Dunning Creek - Modeling for Reynoldsdale, East ST. Clair Stone Creek/Fishertown, Chestnut Ridge Modeling Point #6 July 2022

[+ Collapse All](#)

> Basin Characteristics

| Parameter Code | Parameter Description | Value | Unit |
|----------------|---|-------|--------------|
| CARBON | Percentage of area of carbonate rock | 4.47 | percent |
| DRNAREA | Area that drains to a point on a stream | 172 | square miles |
| PRECIP | Mean Annual Precipitation | 39 | inches |
| ROCKDEP | Depth to rock | 4 | feet |

| Parameter Code | Parameter Description | Value | Unit |
|----------------|--|-------|-----------------------|
| STRDEN | Stream Density -- total length of streams divided by drainage area | 2.34 | miles per square mile |

> Low-Flow Statistics

Low-Flow Statistics Parameters [100.0 Percent (172 square miles) Low Flow Region 2]

| Parameter Code | Parameter Name | Value | Units | Min Limit | Max Limit |
|----------------|---------------------------|-------|-----------------------|-----------|-----------|
| DRNAREA | Drainage Area | 172 | square miles | 4.93 | 1280 |
| PRECIP | Mean Annual Precipitation | 39 | inches | 35 | 50.4 |
| STRDEN | Stream Density | 2.34 | miles per square mile | 0.51 | 3.1 |
| ROCKDEP | Depth to Rock | 4 | feet | 3.32 | 5.65 |
| CARBON | Percent Carbonate | 4.47 | percent | 0 | 99 |

Low-Flow Statistics Flow Report [100.0 Percent (172 square miles) Low Flow Region 2]

PII: Prediction Interval-Lower, PIU: Prediction Interval-Upper, ASEp: Average Standard Error of Prediction, SE: Standard Error (other -- see report)

| Statistic | Value | Unit | SE | ASEp |
|-------------------------|-------|--------------------|----|------|
| 7 Day 2 Year Low Flow | 12.9 | ft ³ /s | 38 | 38 |
| 30 Day 2 Year Low Flow | 17.9 | ft ³ /s | 33 | 33 |
| 7 Day 10 Year Low Flow | 5.91 | ft ³ /s | 51 | 51 |
| 30 Day 10 Year Low Flow | 8.39 | ft ³ /s | 46 | 46 |
| 90 Day 10 Year Low Flow | 13.5 | ft ³ /s | 36 | 36 |

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

Attachment B

WQM 7.0 Modeling Output Values Toxics Management Spreadsheet Output Values

WQM 7.0 Effluent Limits

| <u>SWP Basin</u> | <u>Stream Code</u> | <u>Stream Name</u> | | | | | |
|------------------|--------------------|--------------------|-----------------|------------------|--------------------------------|----------------------------|----------------------------|
| 11C | 14586 | DUNNING CREEK | | | | | |
| RMI | Name | Permit Number | Disc Flow (mgd) | Parameter | Effl. Limit 30-day Ave. (mg/L) | Effl. Limit Maximum (mg/L) | Effl. Limit Minimum (mg/L) |
| 14.800 | Reynoldsdale | PA0044059-1 | 1.850 | CBOD5 | 6.62 | | |
| | | | | NH3-N | 1.99 | 3.98 | |
| | | | | Dissolved Oxygen | | | 5 |
| RMI | Name | Permit Number | Disc Flow (mgd) | Parameter | Effl. Limit 30-day Ave. (mg/L) | Effl. Limit Maximum (mg/L) | Effl. Limit Minimum (mg/L) |
| 13.900 | STONECREEK | PA0082732-2 | 0.042 | CBOD5 | 25 | | |
| | | | | NH3-N | 20.26 | 40.52 | |
| | | | | Dissolved Oxygen | | | 5 |
| RMI | Name | Permit Number | Disc Flow (mgd) | Parameter | Effl. Limit 30-day Ave. (mg/L) | Effl. Limit Maximum (mg/L) | Effl. Limit Minimum (mg/L) |
| 10.400 | EST Fishertown | PA0082694-3 | 0.057 | CBOD5 | 25 | | |
| | | | | NH3-N | 25 | 50 | |
| | | | | Dissolved Oxygen | | | 5 |
| RMI | Name | Permit Number | Disc Flow (mgd) | Parameter | Effl. Limit 30-day Ave. (mg/L) | Effl. Limit Maximum (mg/L) | Effl. Limit Minimum (mg/L) |
| 8.900 | CHESTNUT | PA0087661-4 | 0.546 | CBOD5 | 20.1 | | |
| | | | | NH3-N | 7.03 | 14.06 | |
| | | | | Dissolved Oxygen | | | 5 |

WQM 7.0 Wasteload Allocations

| <u>SWP Basin</u> | <u>Stream Code</u> | <u>Stream Name</u> |
|------------------|--------------------|--------------------|
| 11C | 14586 | DUNNING CREEK |

NH3-N Acute Allocations

| RMI | Discharge Name | Baseline Criterion (mg/L) | Baseline WLA (mg/L) | Multiple Criterion (mg/L) | Multiple WLA (mg/L) | Critical Reach | Percent Reduction |
|--------|----------------|---------------------------------|---------------------------|---------------------------------|---------------------------|-------------------|----------------------|
| 14.800 | Reynoldsdale | 15.29 | 22.51 | 15.29 | 22.51 | 0 | 0 |
| 13.900 | STONECREEK | 11.13 | 50 | 15.21 | 50 | 0 | 0 |
| 10.400 | EST Fishertown | 11.1 | 50 | 13.5 | 50 | 0 | 0 |
| 8.900 | CHESTNUT | 12.04 | 50 | 13.88 | 50 | 0 | 0 |
| 7.260 | | NA | NA | 13.72 | NA | NA | NA |

NH3-N Chronic Allocations

| RMI | Discharge Name | Baseline Criterion (mg/L) | Baseline WLA (mg/L) | Multiple Criterion (mg/L) | Multiple WLA (mg/L) | Critical Reach | Percent Reduction |
|--------|----------------|---------------------------------|---------------------------|---------------------------------|---------------------------|-------------------|----------------------|
| 14.800 | Reynoldsdale | 1.68 | 2.81 | 1.68 | 2.81 | 0 | 0 |
| 13.900 | STONECREEK | 1.38 | 25 | 1.68 | 25 | 0 | 0 |
| 10.400 | EST Fishertown | 1.37 | 25 | 1.54 | 25 | 0 | 0 |
| 8.900 | CHESTNUT | 1.43 | 11.31 | 1.57 | 11.31 | 0 | 0 |
| 7.260 | | NA | NA | 1.56 | NA | NA | NA |

Dissolved Oxygen Allocations

| RMI | Discharge Name | <u>CBOD5</u> | | <u>NH3-N</u> | | <u>Dissolved Oxygen</u> | | Critical Reach | Percent Reduction |
|-------|----------------|--------------------|--------------------|--------------------|--------------------|-------------------------|--------------------|-------------------|----------------------|
| | | Baseline (mg/L) | Multiple (mg/L) | Baseline (mg/L) | Multiple (mg/L) | Baseline (mg/L) | Multiple (mg/L) | | |
| 14.80 | Reynoldsdale | 7.72 | 6.62 | 2.32 | 1.99 | 5 | 5 | 2 | 14 |
| 13.90 | STONECREEK | 25 | 25 | 25 | 20.26 | 5 | 5 | 2 | 14 |
| 10.40 | EST Fishertown | 25 | 25 | 25 | 25 | 5 | 5 | 0 | 0 |
| 8.90 | CHESTNUT | 20.1 | 20.1 | 7.03 | 7.03 | 5 | 5 | 0 | 0 |
| 7.26 | | NA | NA | NA | NA | NA | NA | NA | NA |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|--------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 14.800 | 1112.00 | 57.50 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

Stream Data

| Design Cond. | LFY | Trib Flow | Stream Flow | Rch Trav Time (days) | Rch Velocity (fps) | WD Ratio | Rch Width (ft) | Rch Depth (ft) | Tributary Temp (°C) | pH | Stream Temp (°C) | pH |
|-----------------|--------|--------------|----------------|-------------------------------|--------------------------|-------------|----------------------|----------------------|---------------------------|------|------------------------|------|
| | (cfsm) | (cfs) | (cfs) | | | | | | | | | |
| Q7-10 | 0.026 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |

Discharge Data

| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
|--------------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| Reynoldsdale | PA0044059-1 | 1.8500 | 1.8500 | 1.8500 | 0.000 | 20.00 | 6.93 |

Parameter Data

| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 5.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|--------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 13.900 | 1097.00 | 59.40 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

Stream Data

| Design Cond. | LFY (cfsm) | Trib Flow (cfs) | Stream Flow (cfs) | Rch Trav Time (days) | Rch Velocity (fps) | WD Ratio | Rch Width (ft) | Rch Depth (ft) | Tributary Temp (°C) | Stream Temp (°C) | pH |
|-----------------|---------------|-----------------------|-------------------------|-------------------------------|--------------------------|-------------|----------------------|----------------------|---------------------------|------------------------|------|
| Q7-10 | 0.026 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | |

Discharge Data

| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
|------------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| STONECREEK | PA0082732-2 | 0.0420 | 0.0420 | 0.0420 | 0.000 | 20.00 | 7.59 |

Parameter Data

| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 5.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|--------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 10.400 | 1085.00 | 146.00 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

Stream Data

| Design Cond. | LFY (cfs) | Trib Flow (cfs) | Stream Flow (cfs) | Rch Trav Time (days) | Rch Velocity (fps) | WD Ratio | Rch Width (ft) | Rch Depth (ft) | Tributary Temp (°C) | Stream Temp (°C) | pH |
|-----------------|--------------|-----------------------|-------------------------|-------------------------------|--------------------------|-------------|----------------------|----------------------|---------------------------|------------------------|------|
| Q7-10 | 0.033 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | |

Discharge Data

| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
|----------------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| EST Fishertown | PA0082694-3 | 0.0570 | 0.0570 | 0.0570 | 0.000 | 20.00 | 7.70 |

Parameter Data

| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 5.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|-------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 8.900 | 1071.00 | 150.00 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

Stream Data

| Design Cond. | LFY (cfs) | Trib Flow (cfs) | Stream Flow (cfs) | Rch Trav Time (days) | Rch Velocity (fps) | WD Ratio | Rch Width (ft) | Rch Depth (ft) | Tributary Temp (°C) | pH | Stream Temp (°C) | pH |
|-----------------|--------------|-----------------------|-------------------------|-------------------------------|--------------------------|-------------|----------------------|----------------------|---------------------------|------|------------------------|------|
| Q7-10 | 0.033 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |

Discharge Data

| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
|----------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| CHESTNUT | PA0087661-4 | 0.5460 | 0.5460 | 0.5460 | 0.000 | 20.00 | 6.92 |

Parameter Data

| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 5.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|-------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 7.260 | 1063.00 | 164.00 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

| Stream Data | | | | | | | | | | | | |
|-----------------|--------|--------------|----------------|---------------------|-----------------|-------------|--------------|--------------|--------------|------|--------------|------|
| Design Cond. | LFY | Trib Flow | Stream Flow | Rch Trav Time | Rch Velocity | WD Ratio | Rch Width | Rch Depth | Tributary | | Stream | |
| | (cfsm) | (cfs) | (cfs) | (days) | (fps) | | (ft) | (ft) | Temp (°C) | pH | Temp (°C) | pH |
| Q7-10 | 0.034 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |

| Discharge Data | | | | | | | |
|----------------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
| | | 0.0000 | 0.0000 | 0.0000 | 0.000 | 0.00 | 7.00 |

| Parameter Data | | | | |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 3.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

Input Data WQM 7.0

| SWP Basin | Stream Code | Stream Name | RMI | Elevation (ft) | Drainage Area (sq mi) | Slope (ft/ft) | PWS Withdrawal (mgd) | Apply FC |
|--------------|----------------|---------------|-------|-------------------|-----------------------------|------------------|----------------------------|-------------------------------------|
| 11C | 14586 | DUNNING CREEK | 4.900 | 1055.00 | 172.00 | 0.00000 | 0.00 | <input checked="" type="checkbox"/> |

Stream Data

| Design Cond. | LFY (cfs) | Trib Flow (cfs) | Stream Flow (cfs) | Rch Trav Time (days) | Rch Velocity (fps) | WD Ratio | Rch Width (ft) | Rch Depth (ft) | Tributary Temp (°C) | pH | Stream Temp (°C) | pH |
|-----------------|--------------|-----------------------|-------------------------|-------------------------------|--------------------------|-------------|----------------------|----------------------|---------------------------|------|------------------------|------|
| Q7-10 | 0.034 | 0.00 | 0.00 | 0.000 | 0.000 | 0.0 | 0.00 | 0.00 | 25.00 | 7.00 | 0.00 | 0.00 |
| Q1-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |
| Q30-10 | | 0.00 | 0.00 | 0.000 | 0.000 | | | | | | | |

Discharge Data

| Name | Permit Number | Existing Disc Flow (mgd) | Permitted Disc Flow (mgd) | Design Disc Flow (mgd) | Reserve Factor | Disc Temp (°C) | Disc pH |
|------|---------------|-----------------------------------|------------------------------------|---------------------------------|-------------------|----------------------|------------|
| | | 0.0000 | 0.0000 | 0.0000 | 0.000 | 0.00 | 7.00 |

Parameter Data

| Parameter Name | Disc Conc (mg/L) | Trib Conc (mg/L) | Stream Conc (mg/L) | Fate Coef (1/days) |
|------------------|------------------------|------------------------|--------------------------|--------------------------|
| CBOD5 | 25.00 | 2.00 | 0.00 | 1.50 |
| Dissolved Oxygen | 3.00 | 8.24 | 0.00 | 0.00 |
| NH3-N | 25.00 | 0.00 | 0.00 | 0.70 |

WQM 7.0 D.O. Simulation

| <u>SWP Basin</u> | <u>Stream Code</u> | <u>Stream Name</u> | | | |
|---------------------------------|-----------------------------------|----------------------------------|---------------------|-----------------------------|--|
| 11C | 14586 | DUNNING CREEK | | | |
| <u>RMI</u> | <u>Total Discharge Flow (mgd)</u> | <u>Analysis Temperature (°C)</u> | | <u>Analysis pH</u> | |
| 14.800 | 1.850 | 21.720 | | 6.953 | |
| <u>Reach Width (ft)</u> | <u>Reach Depth (ft)</u> | <u>Reach WDRatio</u> | | <u>Reach Velocity (fps)</u> | |
| 33.915 | 0.680 | 49.889 | | 0.189 | |
| <u>Reach CBOD5 (mg/L)</u> | <u>Reach Kc (1/days)</u> | <u>Reach NH3-N (mg/L)</u> | | <u>Reach Kn (1/days)</u> | |
| 5.03 | 0.340 | 1.30 | | 0.799 | |
| <u>Reach DO (mg/L)</u> | <u>Reach Kr (1/days)</u> | <u>Kr Equation</u> | | <u>Reach DO Goal (mg/L)</u> | |
| 6.116 | 5.912 | Tsivoglou | | 5 | |
| <u>Reach Travel Time (days)</u> | <u>Subreach Results</u> | | | | |
| 0.291 | <u>TravTime (days)</u> | <u>CBOD5 (mg/L)</u> | <u>NH3-N (mg/L)</u> | <u>D.O. (mg/L)</u> | |
| | 0.029 | 4.98 | 1.27 | 6.35 | |
| | 0.058 | 4.92 | 1.24 | 6.55 | |
| | 0.087 | 4.87 | 1.22 | 6.73 | |
| | 0.116 | 4.82 | 1.19 | 6.88 | |
| | 0.145 | 4.77 | 1.16 | 7.01 | |
| | 0.174 | 4.72 | 1.13 | 7.12 | |
| | 0.203 | 4.67 | 1.11 | 7.22 | |
| | 0.233 | 4.62 | 1.08 | 7.31 | |
| | 0.262 | 4.57 | 1.06 | 7.38 | |
| | 0.291 | 4.52 | 1.03 | 7.45 | |

| | | | | | |
|---------------------------------|-----------------------------------|----------------------------------|---------------------|-----------------------------|--|
| <u>RMI</u> | <u>Total Discharge Flow (mgd)</u> | <u>Analysis Temperature (°C)</u> | | <u>Analysis pH</u> | |
| 13.900 | 1.892 | 21.732 | | 6.958 | |
| <u>Reach Width (ft)</u> | <u>Reach Depth (ft)</u> | <u>Reach WDRatio</u> | | <u>Reach Velocity (fps)</u> | |
| 37.414 | 0.716 | 52.265 | | 0.167 | |
| <u>Reach CBOD5 (mg/L)</u> | <u>Reach Kc (1/days)</u> | <u>Reach NH3-N (mg/L)</u> | | <u>Reach Kn (1/days)</u> | |
| 4.79 | 0.364 | 1.30 | | 0.800 | |
| <u>Reach DO (mg/L)</u> | <u>Reach Kr (1/days)</u> | <u>Kr Equation</u> | | <u>Reach DO Goal (mg/L)</u> | |
| 7.422 | 1.075 | Tsivoglou | | 5 | |
| <u>Reach Travel Time (days)</u> | <u>Subreach Results</u> | | | | |
| 1.279 | <u>TravTime (days)</u> | <u>CBOD5 (mg/L)</u> | <u>NH3-N (mg/L)</u> | <u>D.O. (mg/L)</u> | |
| | 0.128 | 4.55 | 1.17 | 6.74 | |
| | 0.256 | 4.33 | 1.06 | 6.21 | |
| | 0.384 | 4.12 | 0.96 | 5.82 | |
| | 0.512 | 3.91 | 0.86 | 5.53 | |
| | 0.640 | 3.72 | 0.78 | 5.33 | |
| | 0.768 | 3.54 | 0.70 | 5.20 | |
| | 0.896 | 3.36 | 0.64 | 5.14 | |
| | 1.023 | 3.20 | 0.57 | 5.12 | |
| | 1.151 | 3.04 | 0.52 | 5.15 | |
| | 1.279 | 2.89 | 0.47 | 5.20 | |

WQM 7.0 D.O.Simulation

| <u>SWP Basin</u> | <u>Stream Code</u> | <u>Stream Name</u> | | | |
|---------------------------------|-----------------------------------|----------------------------------|---------------------|-----------------------------|--|
| 11C | 14586 | DUNNING CREEK | | | |
| <u>RMI</u> | <u>Total Discharge Flow (mgd)</u> | <u>Analysis Temperature (°C)</u> | | <u>Analysis pH</u> | |
| 10.400 | 1.949 | 22.974 | | 6.978 | |
| <u>Reach Width (ft)</u> | <u>Reach Depth (ft)</u> | <u>Reach WDRatio</u> | | <u>Reach Velocity (fps)</u> | |
| 48.404 | 0.776 | 62.376 | | 0.198 | |
| <u>Reach CBOD5 (mg/L)</u> | <u>Reach Kc (1/days)</u> | <u>Reach NH3-N (mg/L)</u> | | <u>Reach Kn (1/days)</u> | |
| 2.81 | 0.304 | 0.58 | | 0.880 | |
| <u>Reach DO (mg/L)</u> | <u>Reach Kr (1/days)</u> | <u>Kr Equation</u> | | <u>Reach DO Goal (mg/L)</u> | |
| 6.374 | 3.571 | Tsivoglou | | 5 | |
| <u>Reach Travel Time (days)</u> | <u>Subreach Results</u> | | | | |
| 0.463 | <u>TravTime (days)</u> | <u>CBOD5 (mg/L)</u> | <u>NH3-N (mg/L)</u> | <u>D.O. (mg/L)</u> | |
| | 0.046 | 2.76 | 0.55 | 6.57 | |
| | 0.093 | 2.72 | 0.53 | 6.73 | |
| | 0.139 | 2.68 | 0.51 | 6.88 | |
| | 0.185 | 2.63 | 0.49 | 7.01 | |
| | 0.231 | 2.59 | 0.47 | 7.12 | |
| | 0.278 | 2.55 | 0.45 | 7.22 | |
| | 0.324 | 2.51 | 0.43 | 7.31 | |
| | 0.370 | 2.47 | 0.42 | 7.39 | |
| | 0.416 | 2.43 | 0.40 | 7.46 | |
| | 0.463 | 2.39 | 0.38 | 7.53 | |

| | | | | | |
|---------------------------------|-----------------------------------|----------------------------------|---------------------|-----------------------------|--|
| <u>RMI</u> | <u>Total Discharge Flow (mgd)</u> | <u>Analysis Temperature (°C)</u> | | <u>Analysis pH</u> | |
| 8.900 | 2.495 | 22.708 | | 6.972 | |
| <u>Reach Width (ft)</u> | <u>Reach Depth (ft)</u> | <u>Reach WDRatio</u> | | <u>Reach Velocity (fps)</u> | |
| 52.451 | 0.803 | 65.345 | | 0.200 | |
| <u>Reach CBOD5 (mg/L)</u> | <u>Reach Kc (1/days)</u> | <u>Reach NH3-N (mg/L)</u> | | <u>Reach Kn (1/days)</u> | |
| 4.16 | 0.632 | 1.04 | | 0.862 | |
| <u>Reach DO (mg/L)</u> | <u>Reach Kr (1/days)</u> | <u>Kr Equation</u> | | <u>Reach DO Goal (mg/L)</u> | |
| 7.283 | 1.872 | Tsivoglou | | 5 | |
| <u>Reach Travel Time (days)</u> | <u>Subreach Results</u> | | | | |
| 0.501 | <u>TravTime (days)</u> | <u>CBOD5 (mg/L)</u> | <u>NH3-N (mg/L)</u> | <u>D.O. (mg/L)</u> | |
| | 0.050 | 4.01 | 1.00 | 7.01 | |
| | 0.100 | 3.87 | 0.96 | 6.78 | |
| | 0.150 | 3.74 | 0.92 | 6.58 | |
| | 0.200 | 3.61 | 0.88 | 6.41 | |
| | 0.251 | 3.48 | 0.84 | 6.27 | |
| | 0.301 | 3.36 | 0.81 | 6.16 | |
| | 0.351 | 3.24 | 0.77 | 6.07 | |
| | 0.401 | 3.12 | 0.74 | 6.00 | |
| | 0.451 | 3.01 | 0.71 | 5.95 | |
| | 0.501 | 2.91 | 0.68 | 5.92 | |

WQM 7.0 D.O.Simulation

| <u>SWP Basin</u> | <u>Stream Code</u> | <u>Stream Name</u> | | |
|---------------------------------|-----------------------------------|----------------------------------|-----------------------------|--------------------|
| 11C | 14586 | DUNNING CREEK | | |
| <u>RMI</u> | <u>Total Discharge Flow (mgd)</u> | <u>Analysis Temperature (°C)</u> | <u>Analysis pH</u> | |
| 7.260 | 2.495 | 22.829 | 6.974 | |
| <u>Reach Width (ft)</u> | <u>Reach Depth (ft)</u> | <u>Reach WDRatio</u> | <u>Reach Velocity (fps)</u> | |
| 55.108 | 0.823 | 66.999 | 0.196 | |
| <u>Reach CBOD5 (mg/L)</u> | <u>Reach Kc (1/days)</u> | <u>Reach NH3-N (mg/L)</u> | <u>Reach Kn (1/days)</u> | |
| 2.86 | 0.334 | 0.64 | 0.870 | |
| <u>Reach DO (mg/L)</u> | <u>Reach Kr (1/days)</u> | <u>Kr Equation</u> | <u>Reach DO Goal (mg/L)</u> | |
| 6.041 | 1.280 | Tsivoglou | 5 | |
| <u>Reach Travel Time (days)</u> | <u>Subreach Results</u> | | | |
| 0.735 | <u>TravTime (days)</u> | <u>CBOD5 (mg/L)</u> | <u>NH3-N (mg/L)</u> | <u>D.O. (mg/L)</u> |
| | 0.074 | 2.78 | 0.60 | 5.99 |
| | 0.147 | 2.70 | 0.57 | 5.96 |
| | 0.221 | 2.63 | 0.53 | 5.95 |
| | 0.294 | 2.56 | 0.50 | 5.95 |
| | 0.368 | 2.49 | 0.47 | 5.96 |
| | 0.441 | 2.42 | 0.44 | 5.98 |
| | 0.515 | 2.35 | 0.41 | 6.01 |
| | 0.588 | 2.29 | 0.38 | 6.05 |
| | 0.662 | 2.22 | 0.36 | 6.09 |
| | 0.735 | 2.16 | 0.34 | 6.14 |

WQM 7.0 Hydrodynamic Outputs

| <u>SWP Basin</u> | | <u>Stream Code</u> | | | | <u>Stream Name</u> | | | | | | |
|--------------------|-------------|--------------------|-----------------|--------------------|-------------|--------------------|-------|-----------|----------|-----------------|---------------|-------------|
| 11C | | 14586 | | | | DUNNING CREEK | | | | | | |
| RMI | Stream Flow | PWS With | Net Stream Flow | Disc Analysis Flow | Reach Slope | Depth | Width | W/D Ratio | Velocity | Reach Trav Time | Analysis Temp | Analysis pH |
| | (cfs) | (cfs) | (cfs) | (cfs) | (ft/ft) | (ft) | (ft) | | (fps) | (days) | (°C) | |
| Q7-10 Flow | | | | | | | | | | | | |
| 14.800 | 1.50 | 0.00 | 1.50 | 2.8619 | 0.00316 | .68 | 33.92 | 49.89 | 0.19 | 0.291 | 21.72 | 6.95 |
| 13.900 | 1.55 | 0.00 | 1.55 | 2.9269 | 0.00065 | .716 | 37.41 | 52.26 | 0.17 | 1.279 | 21.73 | 6.96 |
| 10.400 | 4.43 | 0.00 | 4.43 | 3.0151 | 0.00177 | .776 | 48.4 | 62.38 | 0.20 | 0.463 | 22.97 | 6.98 |
| 8.900 | 4.56 | 0.00 | 4.56 | 3.8598 | 0.00092 | .803 | 52.45 | 65.34 | 0.20 | 0.501 | 22.71 | 6.97 |
| 7.260 | 5.03 | 0.00 | 5.03 | 3.8598 | 0.00064 | .823 | 55.11 | 67 | 0.20 | 0.735 | 22.83 | 6.97 |
| Q1-10 Flow | | | | | | | | | | | | |
| 14.800 | 1.35 | 0.00 | 1.35 | 2.8619 | 0.00316 | NA | NA | NA | 0.19 | 0.296 | 21.60 | 6.95 |
| 13.900 | 1.40 | 0.00 | 1.40 | 2.9269 | 0.00065 | NA | NA | NA | 0.16 | 1.305 | 21.61 | 6.96 |
| 10.400 | 3.98 | 0.00 | 3.98 | 3.0151 | 0.00177 | NA | NA | NA | 0.19 | 0.479 | 22.85 | 6.98 |
| 8.900 | 4.10 | 0.00 | 4.10 | 3.8598 | 0.00092 | NA | NA | NA | 0.19 | 0.517 | 22.58 | 6.97 |
| 7.260 | 4.53 | 0.00 | 4.53 | 3.8598 | 0.00064 | NA | NA | NA | 0.19 | 0.760 | 22.70 | 6.97 |
| Q30-10 Flow | | | | | | | | | | | | |
| 14.800 | 1.92 | 0.00 | 1.92 | 2.8619 | 0.00316 | NA | NA | NA | 0.20 | 0.276 | 22.01 | 6.96 |
| 13.900 | 1.99 | 0.00 | 1.99 | 2.9269 | 0.00065 | NA | NA | NA | 0.18 | 1.215 | 22.02 | 6.96 |
| 10.400 | 5.67 | 0.00 | 5.67 | 3.0151 | 0.00177 | NA | NA | NA | 0.22 | 0.424 | 23.26 | 6.98 |
| 8.900 | 5.84 | 0.00 | 5.84 | 3.8598 | 0.00092 | NA | NA | NA | 0.22 | 0.463 | 23.01 | 6.98 |
| 7.260 | 6.44 | 0.00 | 6.44 | 3.8598 | 0.00064 | NA | NA | NA | 0.21 | 0.677 | 23.13 | 6.98 |

WQM 7.0 Modeling Specifications

| | | | |
|--------------------|--------|-------------------------------------|-------------------------------------|
| Parameters | Both | Use Inputted Q1-10 and Q30-10 Flows | <input type="checkbox"/> |
| WLA Method | EMPR | Use Inputted W/D Ratio | <input type="checkbox"/> |
| Q1-10/Q7-10 Ratio | 0.9 | Use Inputted Reach Travel Times | <input type="checkbox"/> |
| Q30-10/Q7-10 Ratio | 1.28 | Temperature Adjust Kr | <input checked="" type="checkbox"/> |
| D.O. Saturation | 90.00% | Use Balanced Technology | <input checked="" type="checkbox"/> |
| D.O. Goal | 5 | | |



Toxics Management Spreadsheet
Version 1.3, March 2021

Discharge Information

Instructions Discharge Stream

Facility: Chestnut Ridge Area Joint MA NPDES Permit No.: PA0087661 Outfall No.: 001

Evaluation Type: Major Sewage / Industrial Waste Wastewater Description: Sewage effluent

| Discharge Characteristics | | | | | | | | |
|---------------------------|------------------|----------|----------------------------|-----|-----|-----|--------------------------|----------------|
| Design Flow (MGD)* | Hardness (mg/l)* | pH (SU)* | Partial Mix Factors (PMFs) | | | | Complete Mix Times (min) | |
| | | | AFC | CFC | THH | CRL | Q ₇₋₁₀ | Q _h |
| 0.705 | 173 | 6.92 | | | | | | |

| | Discharge Pollutant | Units | Max Discharge Conc | 0 if left blank | | 0.5 if left blank | | 0 if left blank | | | 1 if left blank | |
|---------|---------------------------------|-------|--------------------|-----------------|-------------|-------------------|-----------|-----------------|------------|-----|-----------------|------------|
| | | | | Trib Conc | Stream Conc | Daily CV | Hourly CV | Stream CV | Fate Coeff | FOS | Criteria Mod | Chem Trans |
| Group 1 | Total Dissolved Solids (PWS) | mg/L | 422 | | | | | | | | | |
| | Chloride (PWS) | mg/L | 80.1 | | | | | | | | | |
| | Bromide | mg/L | < 0.362 | | | | | | | | | |
| | Sulfate (PWS) | mg/L | 65.9 | | | | | | | | | |
| | Fluoride (PWS) | mg/L | | | | | | | | | | |
| Group 2 | Total Aluminum | µg/L | | | | | | | | | | |
| | Total Antimony | µg/L | | | | | | | | | | |
| | Total Arsenic | µg/L | | | | | | | | | | |
| | Total Barium | µg/L | | | | | | | | | | |
| | Total Beryllium | µg/L | | | | | | | | | | |
| | Total Boron | µg/L | | | | | | | | | | |
| | Total Cadmium | µg/L | | | | | | | | | | |
| | Total Chromium (III) | µg/L | | | | | | | | | | |
| | Hexavalent Chromium | µg/L | | | | | | | | | | |
| | Total Cobalt | µg/L | | | | | | | | | | |
| | Total Copper | mg/L | 0.0085 | | | | | | | | | |
| | Free Cyanide | µg/L | | | | | | | | | | |
| | Total Cyanide | µg/L | | | | | | | | | | |
| | Dissolved Iron | µg/L | | | | | | | | | | |
| | Total Iron | µg/L | | | | | | | | | | |
| | Total Lead | mg/L | < 0.001 | | | | | | | | | |
| | Total Manganese | µg/L | | | | | | | | | | |
| | Total Mercury | µg/L | | | | | | | | | | |
| | Total Nickel | µg/L | | | | | | | | | | |
| | Total Phenols (Phenolics) (PWS) | µg/L | | | | | | | | | | |
| | Total Selenium | µg/L | | | | | | | | | | |
| | Total Silver | µg/L | | | | | | | | | | |
| | Total Thallium | µg/L | | | | | | | | | | |
| | Total Zinc | mg/L | 0.0379 | | | | | | | | | |
| | Total Molybdenum | µg/L | | | | | | | | | | |
| | Acrolein | µg/L | < | | | | | | | | | |
| | Acrylamide | µg/L | < | | | | | | | | | |
| | Acrylonitrile | µg/L | < | | | | | | | | | |
| | Benzene | µg/L | < | | | | | | | | | |
| | Bromoform | µg/L | < | | | | | | | | | |



Stream / Surface Water Information

Chestnut Ridge Area Joint MA, NPDES Permit No. PA0087661, Outfall 001

Instructions Discharge **Stream**

Receiving Surface Water Name: Dunning Creek

No. Reaches to Model: 1

- ☒ Statewide Criteria
☐ Great Lakes Criteria
☐ ORSANCO Criteria

| Location | Stream Code* | RMI* | Elevation (ft)* | DA (mi ²)* | Slope (ft/ft) | PWS Withdrawal (MGD) | Apply Fish Criteria* |
|--------------------|--------------|------|-----------------|------------------------|---------------|----------------------|----------------------|
| Point of Discharge | 014586 | 8.9 | 1071 | 150 | | | Yes |
| End of Reach 1 | 014586 | 4.9 | 1055 | 172 | | | Yes |

Q₇₋₁₀

| Location | RMI | LFY (cfs/mi ²)* | Flow (cfs) | | W/D Ratio | Width (ft) | Depth (ft) | Velocity (fps) | Travel Time (days) | Tributary | | Stream | | Analysis | |
|--------------------|-----|-----------------------------|------------|-----------|-----------|------------|------------|----------------|--------------------|-----------|----|-----------|-----|----------|----|
| | | | Stream | Tributary | | | | | | Hardness | pH | Hardness* | pH* | Hardness | pH |
| Point of Discharge | 8.9 | 0.0332 | | | | | | | | | | 79.5 | 7 | | |
| End of Reach 1 | 4.9 | 0.0344 | | | | | | | | | | 79.5 | 7 | | |

Q_h

| Location | RMI | LFY (cfs/mi ²)* | Flow (cfs) | | W/D Ratio | Width (ft) | Depth (ft) | Velocity (fps) | Travel Time (days) | Tributary | | Stream | | Analysis | |
|--------------------|-----|-----------------------------|------------|-----------|-----------|------------|------------|----------------|--------------------|-----------|----|-----------|-----|----------|----|
| | | | Stream | Tributary | | | | | | Hardness | pH | Hardness* | pH* | Hardness | pH |
| Point of Discharge | 8.9 | | | | | | | | | | | | | | |
| End of Reach 1 | 4.9 | | | | | | | | | | | | | | |



Model Results

Chestnut Ridge Area Joint MA, NPDES Permit No. PA0087661, Outfall 001

Instructions

Results

RETURN TO INPUTS

SAVE AS PDF

PRINT

☒ All

☐ Inputs

☐ Results

☐ Limits

☐ Hydrodynamics

☒ Wasteload Allocations

☒ AFC

CCT (min): 15

PMF: 0.372

Analysis Hardness (mg/l): 114.17

Analysis pH: 6.97

| Pollutants | Stream Conc (µg/L) | Stream CV | Trib Conc (µg/L) | Fate Coef | WQC (µg/L) | WQ Obj (µg/L) | WLA (µg/L) | Comments |
|------------------------------|--------------------|-----------|------------------|-----------|------------|---------------|------------|----------------------------------|
| Total Dissolved Solids (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Chloride (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Sulfate (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Total Copper | 0 | 0 | | 0 | 15.227 | 15.9 | 42.8 | Chem Translator of 0.96 applied |
| Total Lead | 0 | 0 | | 0 | 74.585 | 96.7 | 261 | Chem Translator of 0.772 applied |
| Total Zinc | 0 | 0 | | 0 | 131.108 | 134 | 361 | Chem Translator of 0.978 applied |

☒ CFC

CCT (min): #####

PMF: 1

Analysis Hardness (mg/l): 96.298

Analysis pH: 6.98

| Pollutants | Stream Conc (µg/L) | Stream CV | Trib Conc (µg/L) | Fate Coef | WQC (µg/L) | WQ Obj (µg/L) | WLA (µg/L) | Comments |
|------------------------------|--------------------|-----------|------------------|-----------|------------|---------------|------------|----------------------------------|
| Total Dissolved Solids (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Chloride (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Sulfate (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Total Copper | 0 | 0 | | 0 | 8.672 | 9.03 | 50.3 | Chem Translator of 0.96 applied |
| Total Lead | 0 | 0 | | 0 | 2.415 | 3.03 | 16.9 | Chem Translator of 0.796 applied |
| Total Zinc | 0 | 0 | | 0 | 114.423 | 116 | 646 | Chem Translator of 0.986 applied |

☒ THH

CCT (min): #####

PMF: 1

Analysis Hardness (mg/l): N/A

Analysis pH: N/A

| Pollutants | Stream Conc (µg/L) | Stream CV | Trib Conc (µg/L) | Fate Coef | WQC (µg/L) | WQ Obj (µg/L) | WLA (µg/L) | Comments |
|------------------------------|--------------------|-----------|------------------|-----------|------------|---------------|------------|----------|
| Total Dissolved Solids (PWS) | 0 | 0 | | 0 | 500,000 | 500,000 | N/A | |
| Chloride (PWS) | 0 | 0 | | 0 | 250,000 | 250,000 | N/A | |
| Sulfate (PWS) | 0 | 0 | | 0 | 250,000 | 250,000 | N/A | |

| | | | | | | | |
|--------------|---|---|--|---|-----|-----|-----|
| Total Copper | 0 | 0 | | 0 | N/A | N/A | N/A |
| Total Lead | 0 | 0 | | 0 | N/A | N/A | N/A |
| Total Zinc | 0 | 0 | | 0 | N/A | N/A | N/A |

☒ CRL

CCT (min): 50.932

PMF: 1

Analysis Hardness (mg/l): N/A

Analysis pH: N/A

| Pollutants | Stream Conc (µg/L) | Stream CV | Trib Conc (µg/L) | Fate Coef | WQC (µg/L) | WQ Obj (µg/L) | WLA (µg/L) | Comments |
|------------------------------|--------------------|-----------|------------------|-----------|------------|---------------|------------|----------|
| Total Dissolved Solids (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Chloride (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Sulfate (PWS) | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Total Copper | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Total Lead | 0 | 0 | | 0 | N/A | N/A | N/A | |
| Total Zinc | 0 | 0 | | 0 | N/A | N/A | N/A | |

☒ Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

| Pollutants | Mass Limits | | Concentration Limits | | | | Governing WQBEL | WQBEL Basis | Comments |
|--------------|---------------|---------------|----------------------|--------|--------|-------|-----------------|-------------|------------------------------------|
| | AML (lbs/day) | MDL (lbs/day) | AML | MDL | IMAX | Units | | | |
| Total Copper | Report | Report | Report | Report | Report | mg/L | 0.027 | AFC | Discharge Conc > 10% WQBEL (no RP) |
| Total Zinc | Report | Report | Report | Report | Report | mg/L | 0.23 | AFC | Discharge Conc > 10% WQBEL (no RP) |

☒ Other Pollutants without Limits or Monitoring

The following pollutants do not require effluent limits or monitoring based on water quality because reasonable potential to exceed water quality criteria was not determined and the discharge concentration was less than thresholds for monitoring, or the pollutant was not detected and a sufficiently sensitive analytical method was used (e.g., <= Target QL).

| Pollutants | Governing WQBEL | Units | Comments |
|------------------------------|-----------------|-------|----------------------|
| Total Dissolved Solids (PWS) | N/A | N/A | PWS Not Applicable |
| Chloride (PWS) | N/A | N/A | PWS Not Applicable |
| Bromide | N/A | N/A | No WQS |
| Sulfate (PWS) | N/A | N/A | PWS Not Applicable |
| Total Lead | N/A | N/A | Discharge Conc < TQL |