

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
SRSTP
Renewal
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0102555

 APS ID
 1078405

 Authorization ID
 1422406

Applicant Name	Rocce	o A Defranco	Facility Name	Rocco A Defranco SRSTP	
Applicant Address	1593	Silver Creek Road	Facility Address	1593 Silver Creek Road	
	Johns	onburg, PA 15845-2531		Johnsonburg, PA 15845-2531	
Applicant Contact	Rocco	Defranco	Facility Contact	Rocco Defranco	
Applicant Phone	(814)	594-1449	Facility Phone	(814) 594-1449	
Applicant Email	roccoboat@hotmail.com				
Client ID	256848		Site ID	244426	
SIC Code	8800		Municipality	Jones Township	
SIC Description	Privat	e Households	County	Elk	
Date Application Received		December 22, 2022	WQM Required	Issued	
Date Application Accepted Marc		March 6, 2023	WQM App. No.	2477403 - T3	

Summary of Review

Renewal Permit for a SRSTP consisting of: 1,000-gallon dual compartment septic tank, 600 sq. ft. subsurface sand filter and a 130-gallon chlorine contact tank w/ tablet chlorination.

Act 14 - Proof of Notification was submitted and received.

SPECTIAL CONDITIONS: NONE

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (256848) as of March 6, 2023 4/5/2023 CWY

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
X		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer Trainee	March 6, 2023		
X		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	4/5/2023		

Discharge and Stream Data – 2 - Receiving Waters and PWS

ischarge, Receivin	g Water	s and Water Supply Info	rmation				
Outfall No. 001 Latitude 41° 30′ 47.8″ Quad Name Wilcox			Design Flow (MGD) Longitude Quad Code	.0004 -78° 41' 22.7" 02093			
Wastewater Descr	ription:	Sewage Effluent					
Receiving Waters NHD Com ID	Silver	Creek (HQ-CWF) 4435	Stream Code	50574 1.93			
Drainage Area	-	quare miles	Yield (cfs/mi²) Q ₇₋₁₀ Basis Slope (ft/ft)	0.1			
Q ₇₋₁₀ Flow (cfs) Elevation (ft)	0.702 1493			Default HQ-CWF			
Watershed No.	17-A		Chapter 93 Class.				
Existing Use			Existing Use Qualifier				
Exceptions to Use			Exceptions to Criteria				
Assessment Status	S	Attaining Use(s)					
Cause(s) of Impair							
Source(s) of Impai	rment						
TMDL Status			Name				
Background/Ambient Data			Data Source				
pH (SU)	pH (SU)		Default				
Temperature (°F)			Default				
Hardness (mg/L) Other:		100	Default				
Nearest Downstrea	am Publi	c Water Supply Intake	At the discharge point to the h	HQ stream			
PWS Waters Silver Creek			Flow at Intake (cfs)				
PWS RMI _	1.93		Distance from Outfall (mi) 0				

Changes Since Last Permit Issuance: None.

Other Comments: AMRs have been submitted.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
Farameter	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
TRC	XXX	XXX	XXX	Report Avg Mo	XXX	XXX	1/month	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after Disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7 and the monitoring frequency has been established as "1/month" due to special protection watershed designation (High Quality – HQ).

Outfall Location - eMap with Aerial Imagery

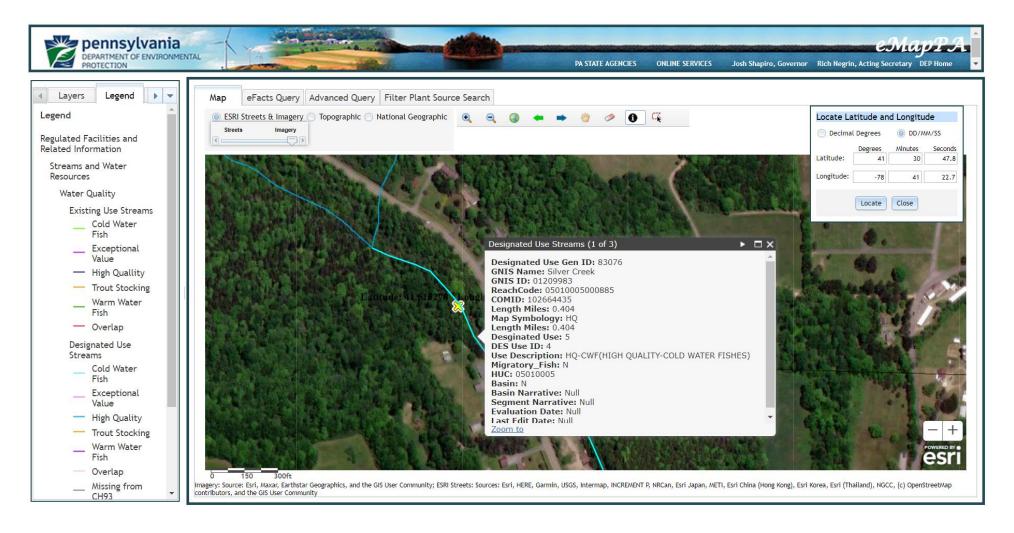

Drainage Area Location – StreamStats with Aerial Imagery

StreamStats Report

Region ID:

Workspace ID:

Clicked Point (Latitude, Longitude):


Time:

PA

PA20230207170120230000

41.51331, -78.68972

2023-02-07 12:01:41 -0500

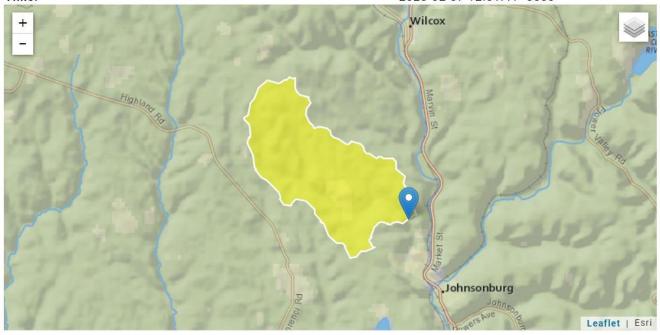

Collapse All

▶ Basin Characteristics Parameter Code Parameter Description Value Unit DRNAREA Area that drains to a point on a stream 7.02 square miles