

Application Type Renewal  
Wastewater Type Sewage  
Facility Type SFTF

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SFTF/SRSTP**

Application No. PA0208574  
APS ID 1151363  
Authorization ID 1550713

**Applicant, Facility and Project Information**

Applicant Name	<u>Coach Stop, LLC</u>	Facility Name	<u>Coach Stop Inn</u>
Applicant Address	<u>4755 Route 6</u> <u>Wellsboro, PA 16901-8046</u>	Facility Address	<u>4755 Route 6</u> <u>Wellsboro, PA 16901-8046</u>
Applicant Contact	<u>Karen Hudecheck</u>	Facility Contact	<u>Karen Hudecheck</u>
Applicant Phone	<u>(570) 290-7867</u>	Facility Phone	<u>(570) 290-7867</u>
Client ID	<u>344164</u>	Site ID	<u>246317</u>
SIC Code	<u>7011</u>	Municipality	<u>Shippen Township</u>
SIC Description	<u>Services - Hotels And Motels</u>	County	<u>Tioga</u>
Date Application Received	<u>November 6, 2025</u>	WQM Required	<u>No</u>
Date Application Accepted	<u>December 3, 2025</u>	WQM App. No.	
Project Description	<u>Renewal of a NPDES Permit</u>		

**Summary of Review**

The subject facility is an existing Small Flow Treatment Facility (SFTF) serving a hotel, residence, and restaurant in Shippen Township, Tioga County. A map of the discharge location is attached (Attachment A).

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
✓		 Keith C. Allison / Project Manager	February 2, 2026
✓		 Nicholas W. Hartranft, P.E. / Environmental Engineer Manager	February 2, 2026

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>0.002</u>
Latitude	<u>41° 44' 25.93"</u>	Longitude	<u>-77° 27' 41.44"</u>
Quad Name	<u>Tiadaghton, PA</u>	Quad Code	<u></u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>UNT to Pine Creek (EV)</u>	Stream Code	<u>21166 (Pine Creek)</u>
NHD Com ID	<u>66536127</u>	RMI	<u>60.1 (Pine Creek)</u>
Drainage Area	<u>277 mi<sup>2</sup> (@ Pine Creek)</u>	Yield (cfs/mi <sup>2</sup> )	<u>0.04</u>
Q <sub>7-10</sub> Flow (cfs)	<u>11</u>	Q <sub>7-10</sub> Basis	<u>USGS Gage 01548500, Pine Creek @ Cedar Run</u>
Elevation (ft)	<u>1250</u>	Slope (ft/ft)	<u>Undetermined</u>
Watershed No.	<u>9-A</u>	Chapter 93 Class.	<u>EV</u>
Existing Use	<u>EV</u>	Existing Use Qualifier	<u>n/a</u>
Exceptions to Use	<u>None</u>	Exceptions to Criteria	<u>None</u>
Assessment Status	<u>Impaired</u>		
Cause(s) of Impairment	<u>MERCURY</u>		
Source(s) of Impairment	<u>SOURCE UNKNOWN</u>		
TMDL Status	<u>Undeveloped</u>	Name	<u></u>
Nearest Downstream Public Water Supply Intake	<u>Jersey Shore Area Joint Water Authority</u>		
PWS Waters	<u>Pine Creek</u>	Distance from Outfall (mi)	<u>~57 Miles</u>

Changes Since Last Permit Issuance: The above stream and drainage characteristics are adequate and are unchanged from previous reviews.

Other Comments: The discharge is to a swale to a wetland and does not generally reach Pine Creek. This discharge was initially permitted in 1993 prior to the proposed rulemaking in 1995 and final rulemaking in 1997 for the designation of Pine Creek as an Exceptional Value (EV) stream.

This discharge is not reasonably expected to be contributing to the impairment to Pine Creek from mercury given its size and the discharge scenario as noted above.

Treatment Facility
The treatment facility, as permitted under WQM permit application No. 5993403 Amendment No. 6, consists of two 1500-gallon BI-A-ROBI extended air treatment units (UPA Class 2), a 1500-gallon dosing tank with duplex pumps, a totalizing meter, two-900 square foot intermittent sand filters, an erosion tablet chlorinator, and a 1000-gallon chlorine contact tank.

**Compliance History**

<b>Summary of AMRs/DMRs:</b>	The facility had apparently not been operating for a number of years. The permittee resumed sending eDMRs for December 2025.
<b>Summary of Inspections:</b>	The most recent onsite inspection of the facility by the Department on April 29, 2021 identified no violations at the time of inspection.
<b>Other Comments:</b>	There are no open violations in eFACTS for Coach Stop, LLC.

**Existing Effluent Limitations and Monitoring Requirements**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/month	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
TRC	XXX	XXX	XXX	0.5	XXX	0.75	1/month	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/month	Grab
TSS	XXX	XXX	XXX	20.0	XXX	40.0	1/month	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200 Geo Mean	XXX	1000	1/year	Grab

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**


Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/month	Estimate
TRC	XXX	XXX	XXX	0.5	XXX	0.75	1/month	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/month	Grab
TSS	XXX	XXX	XXX	20.0	XXX	40.0	1/month	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200 Geo Mean	XXX	1000	1/year	Grab

Compliance Sampling Location: Outfall 001

Other Comments: The above limitations and monitoring requirements are consistent with the Department's typical requirements for SFTFs except for pH monitoring and limits which are not typically required for SFTFs and will be removed at this time. These effluent limitations have been determined by the Department to be adequate to protect the receiving waters from an SFTF discharge. The existing TRC IMAX of 0.75 mg/L is not typical but is from previous modeling and will remain. Because the discharge has limited potential for impact to Pine Creek due to the discharge scenario as noted above and because it predates the final rulemaking for the EV designated use of Pine Creek more stringent requirements for TRC will not be included at this time.

Attachment:

- A. Discharge Location Map

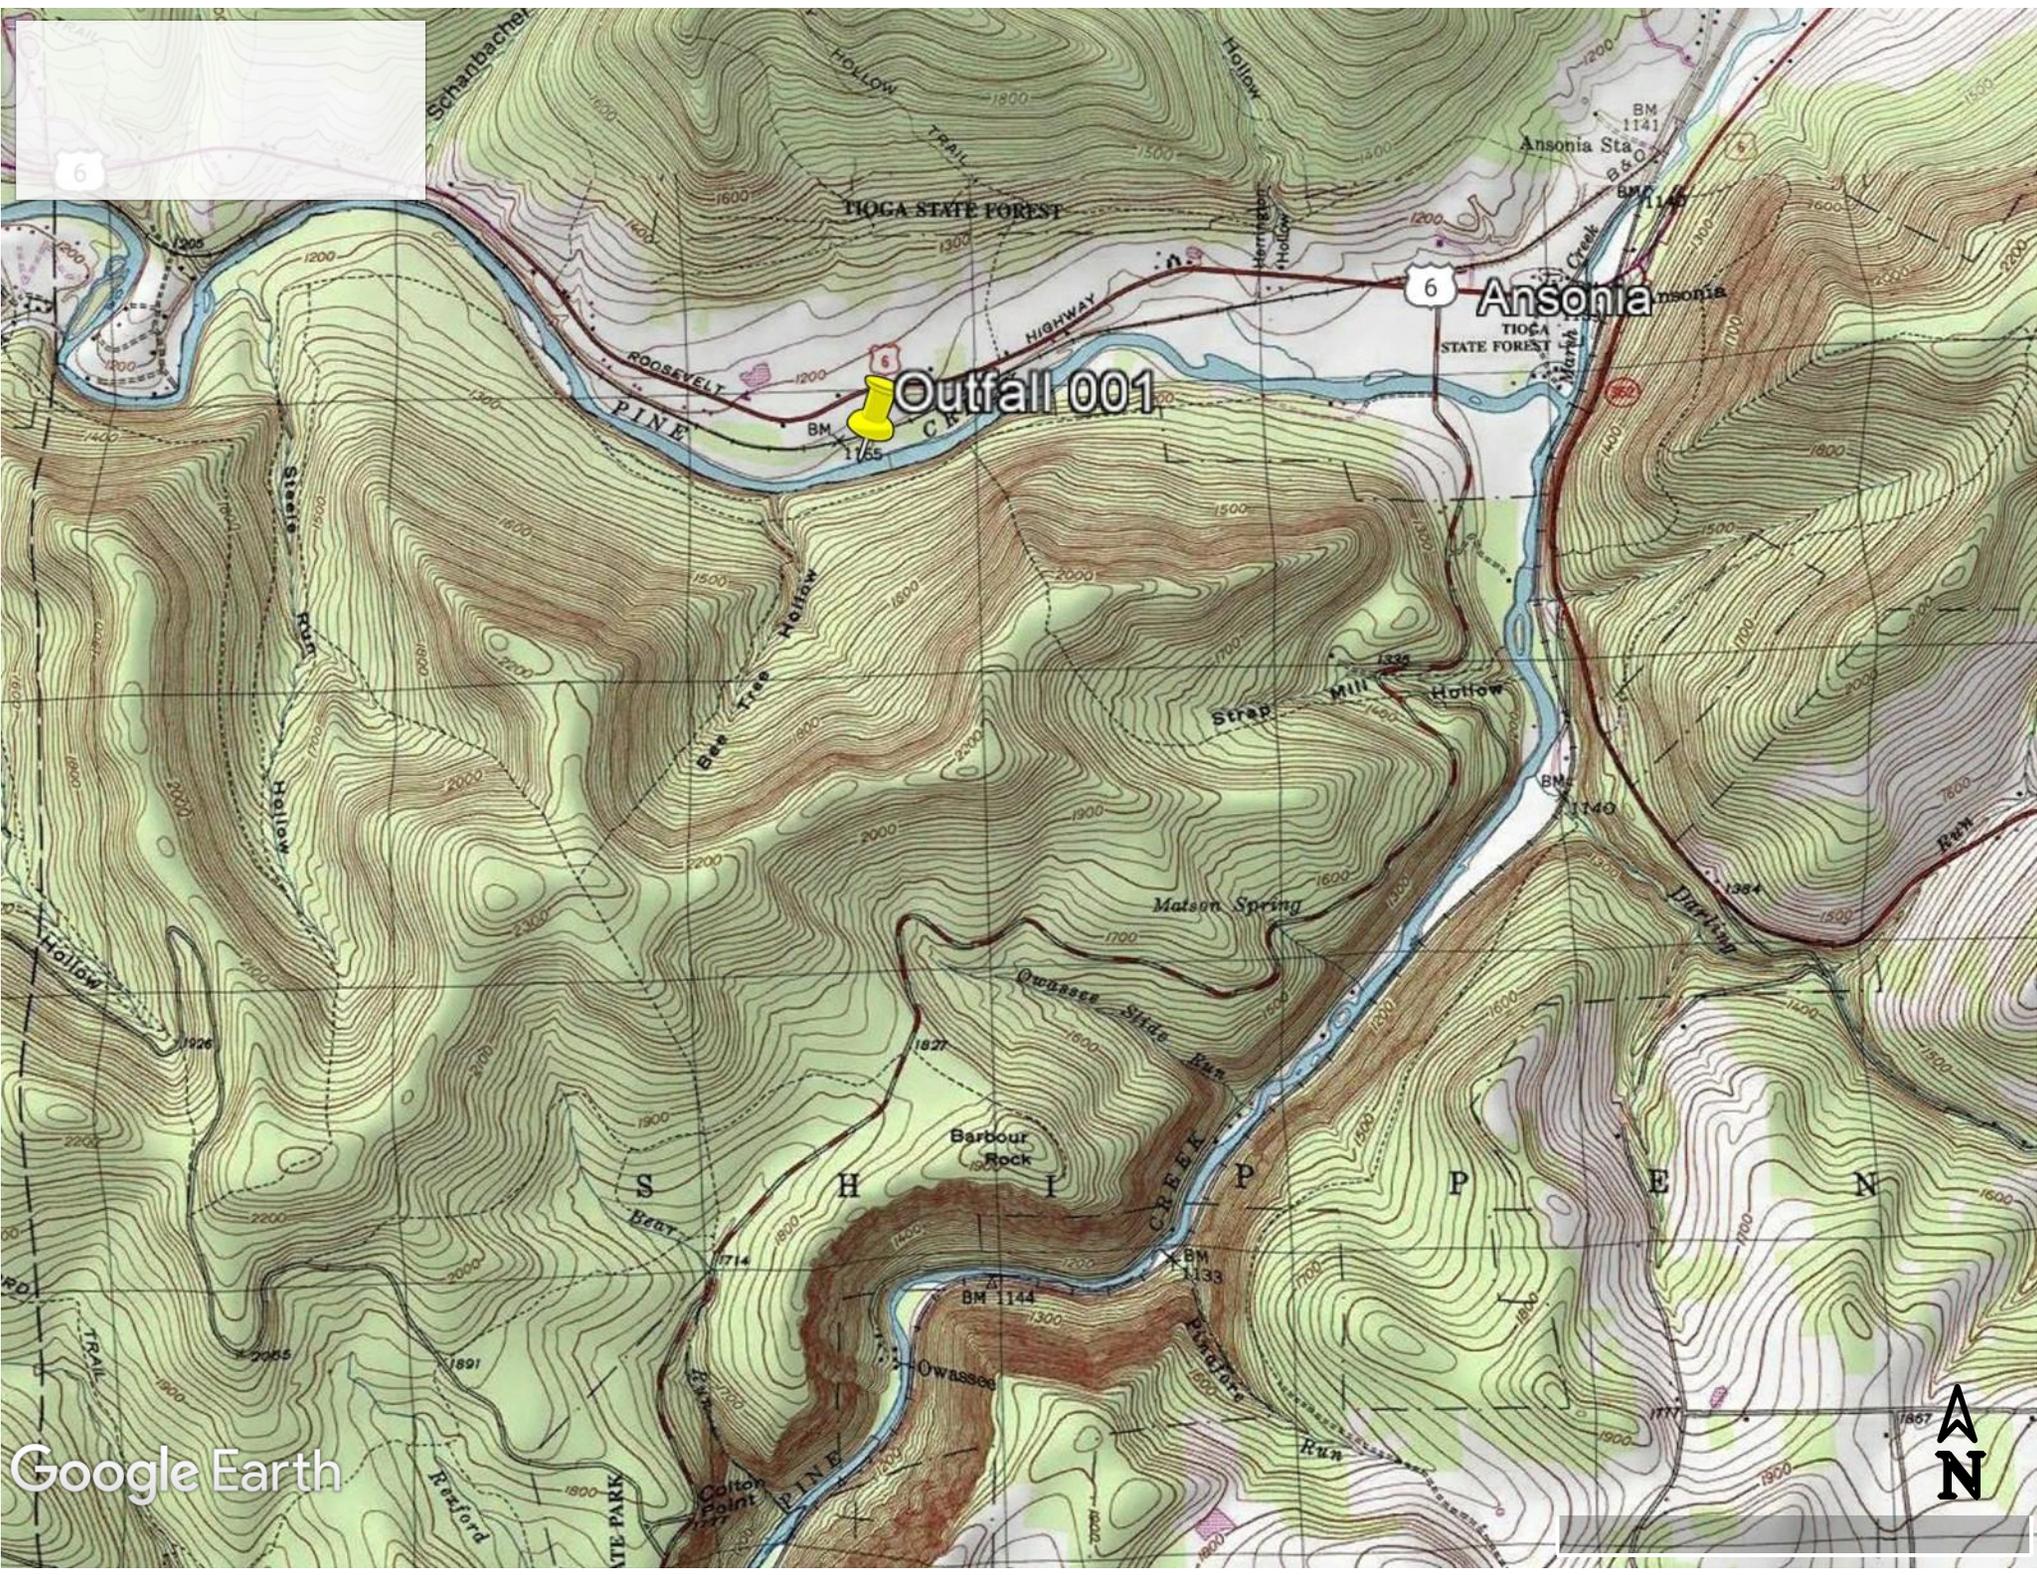

Outfall 001

Ansonia

Google Earth

