

## NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.	PA0240176
APS ID	1089875
Authorization ID	1442277

#### Applicant, Facility and Project Information

Applicant Name	Gene A Strick	Facility Name	Gene A Strick SRSTP
Applicant Address	641 Clermont Road	Facility Address	641 Clermont Road
	Mount Jewett, PA 16740-2213		Mount Jewett, PA 16740-2213
Applicant Contact	Gene Strick	Facility Contact	
Applicant Phone	(814) 778-5404	Facility Phone	
Applicant Email	gene04celi@yahoo.com		
Client ID	174378	Site ID	698232
SIC Code	4952,8811	Municipality	Hamlin Township
SIC Description	Services - Private Households, Trans. & Utilities - Sewerage Systems	County	McKean
Date Application Rec	eivedMay 22, 2023	WQM Required	Issued
Date Application Acce	epted June 9, 2023	WQM App. No.	4208403 T-1
		_	
Project Description	Renewal NPDES Permit for a Sing	le Residence Sewage	Treatment Plant

#### Summary of Review

Renewal Permit for an SRSTP consists of: A 1000-gallon dual chamber septic tank with effluent filter, 680-square foot pressure dosed subsurface sand filter and ultra-violet light disinfection.

Act 14 - Proof of Notification was submitted and received.

SPECTIAL CONDITIONS: NONE

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (174378) as of June 15, 2023 CWY 6/23/2023

#### Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
х		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer Trainee	June 15, 2023
х		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	6/23/2023

## Discharge and Stream Data - 2 - Receiving Waters and PWS

## Discharge, Receiving Waters and Water Supply Information

Outfall No. 001	Design Flow (MGD)	.0004		
Latitude <u>41° 42' 48.25"</u>	Longitude	-78º 31' 41.56"		
Quad Name Hazel Hurst	Quad Code	41078F5		
Wastewater Description: Sewage Effluent				
Receiving Waters <u>Warner Brook (HQ-CWF)</u>	Stream Code	57778		
NHD Com ID 112376861	RMI	1.65		
Drainage Area 3.65	Yield (cfs/mi <sup>2</sup> )	0.1		
Q <sub>7-10</sub> Flow (cfs)0.365	Q <sub>7-10</sub> Basis	Default		
Elevation (ft) 1722	Slope (ft/ft)			
Watershed No. 16-C	Chapter 93 Class.	HQ-CWF		
Existing Use	Existing Use Qualifier			
Exceptions to Use	Exceptions to Criteria			
Assessment Status Attaining Use(s)				
Cause(s) of Impairment				
Source(s) of Impairment				
TMDL Status	Name			
Background/Ambient Data	Data Source			
рН (SU) 7	Default			
Temperature (°F) 20	Default			
Hardness (mg/L) 100	Default			
Other:				
Nearest Downstream Public Water Supply Intake	State of New York			
PWS Waters Allegheny River	Flow at Intake (cfs)			
PWS RMI 264.03	Distance from Outfall (mi)			

Changes Since Last Permit Issuance: None

Other Comments: AMRs have been submitted.

#### Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


#### Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup>	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
BOD5	ххх	xxx	XXX	10.0	xxx	20.0	1/year	Grab
TSS	xxx	xxx	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	ХХХ	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7. Due to the discharging into high-quality stream classification, pH monitoring has been changed to monthly.


### **Outfall Location - eMap with Aerial Imagery**

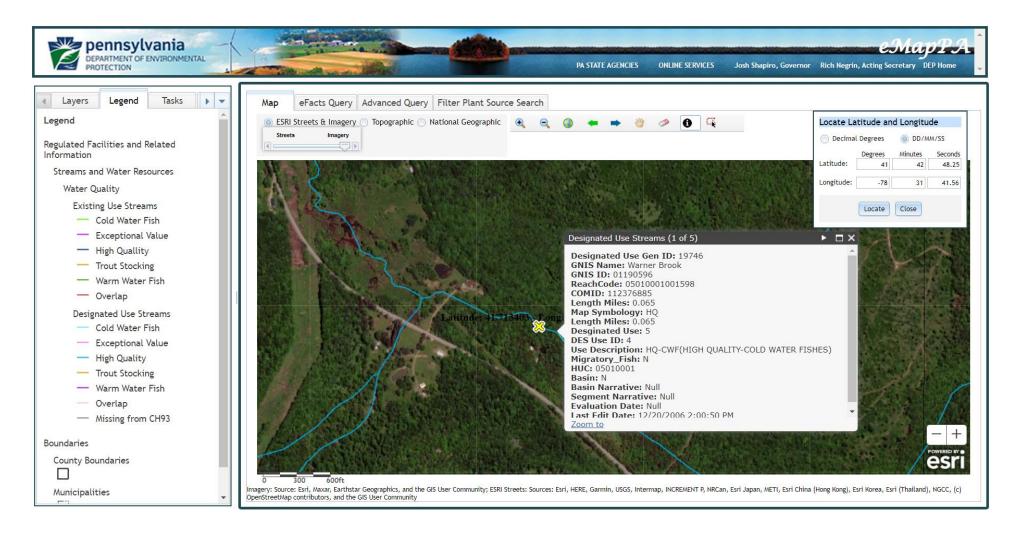

## **Drainage Area Location – StreamStats with Aerial Imagery**

# StreamStats Report

Region ID: Workspace ID: Clicked Point (Latitude, Longitude): Time: PA PA20230609172044789000 41.71340, -78.52828 2023-06-09 13:21:12 -0400

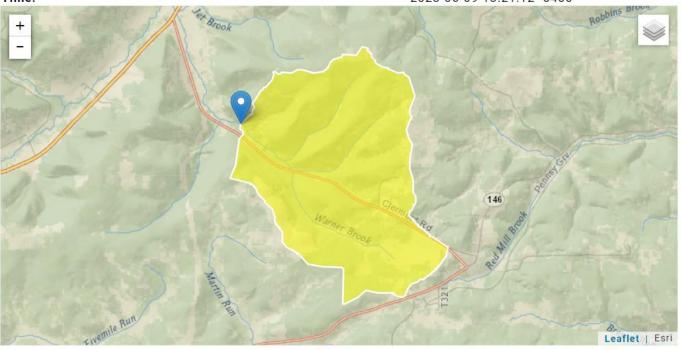

#### Collapse All

Basin Characterist	ics		
Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	3.65	square miles