

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0263826

 APS ID
 1039807

 Authorization ID
 1356145

Applicant Name	Denton A & Twila J Eby	Facility Name	Denton A & Twila J Eby SRSTP		
Applicant Address	17963 State Highway 86	Facility Address	17963 State Highway 86		
	Saegertown, PA 16433-6349		Saegertown, PA 16433-6349		
Applicant Contact	Denton Eby	Facility Contact	Denton Eby		
Applicant Phone	(814) 763-5045	Facility Phone	(814) 763-5045		
Client ID	283778	Site ID	739568		
SIC Code		Municipality	Woodcock Township		
SIC Description		County	Crawford		
Date Application Receiv	ed September 4, 2020	WQM Required	Yes		
Date Application Accept	ed June 2, 2021	WQM App. No.	2020406		

Summary of Review

This is a new discharge for an existing 4-bedroom home and one camper to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2020406): A 1500-gallon dual chambered concrete septic tank followed by a 500-gallon septic tank (from an existing dosing tank), followed by a 1,250 single-compartment septic tank, Premier Tech EC7 Coco Filter unit and an existing UV unit to be relocated.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (283778) as of 8/13/2021.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	August 13, 2021
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	August 16, 2021

Discharge and Stream Data – 2 - Receiving Waters and PWS

ischarge, Receiving	y Water	s and Water Supply Infor	mation		
Outfall No. 001			Design Flow (MGD)	.00125	
			, ,	-80° 6' 25.84"	
Latitude 41º 43' 11.37"			Longitude Quad Code		
Quad Name Blooming Valley			Quad Code	41080F1	
Wastewater Descrip	otion:	Sewage Effluent			
Receiving Waters	Unnar (HQ-C	med Tributary to Bossard R CWF)	un Stream Code	52706	
NHD Com ID	12734	,	 RMI		
Drainage Area	0.049		Yield (cfs/mi²)	0.1	
Q ₇₋₁₀ Flow (cfs)	0.005		Q ₇₋₁₀ Basis	Default	
Elevation (ft)	1362		Slope (ft/ft)		
Watershed No.	16-A		Chapter 93 Class.	HQ-CWF	
Existing Use			Existing Use Qualifier		
Exceptions to Use			Exceptions to Criteria		
Assessment Status		Attaining Use(s)			
Cause(s) of Impairn	nent				
Source(s) of Impair	ment				
TMDL Status			Name		
Do alcono un al/Amabio	at Data		Data Caurea		
Background/Ambient Data		Data Source			
pH (SU) 7.0		Default			
Temperature (°F) 20 Hardness (mg/L) 100					
		Delault			
Outer.					
Nearest Downstrea	m Publi	c Water Supply Intake	Aqua Pennsylvania, Inc Em	lenton	
PWS Waters Allegheny River			Flow at Intake (cfs)	1376	
PWS RMI 90.0		Distance from Outfall (mi)	>25		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on May 29, 2021).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: None.

Attachment 1 eMap – Location Map

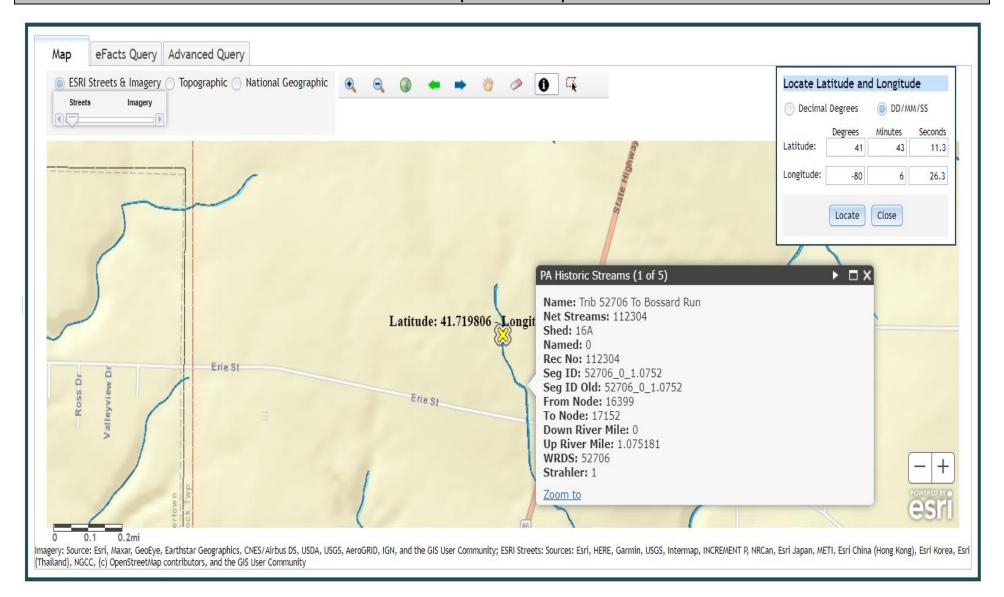

Attachment 2 Google Earth Imagery

