

Northwest Regional Office CLEAN WATER PROGRAM

Application Type

Wastewater Type

Facility Type

Renewal

Sewage

SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0265144

APS ID 1086586

Authorization ID 1436260

| Applicant Name | Lifestyle Support Service Inc. | Facility Name | Lifestyle Support Service Warrer SRSTP | |
|---------------------------|--------------------------------|------------------|--|--|
| Applicant Address | 201 W High Street Suite 1 | Facility Address | 455 Daugherty Run Road | |
| | Ebensburg, PA 15931-1590 | | Warren, PA 16365 | |
| Applicant Contact | Jeff Hartman | Facility Contact | | |
| Applicant Phone | (814) 419-8087 | Facility Phone | | |
| Client ID | 334246 | Site ID | 822010 | |
| SIC Code | 8800 | Municipality | Conewango Township | |
| SIC Description | Private Households | County | Warren | |
| Date Application Rec | eived March 27, 2023 | WQM Required | | |
| Date Application Accepted | | WQM App. No. | 6217407 T-1 | |

Summary of Review

Act 14 - Proof of Notification was submitted and received.

Existing treatment consists of (WQM Permit No. 6217407 T-1): NORWECO Singulair Model 960 Aerobic Unit with BIO-Film Reactor and Salcor 3G UV radiation.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (334246) as of 3/5/2024.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

| Approve | Deny | Signatures | Date |
|---------|------|--|--------------------------------|
| Х | | Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager | March 5, 2024 |
| | | (Vacant) / Environmental Engineer Manager | Okay to Draft JCD 3/11/2024 |

Discharge and Stream Data – 2 - Receiving Waters and PWS

| Discharge, Receiving Waters and Water Supply Information | | | | | | |
|--|---------------|----------------------------|----------------|--|--|--|
| | | | | | | |
| Outfall No. 001 | | Design Flow (MGD) | .0004 | | | |
| Latitude 41° 53' 23.35" | | Longitude | -79° 9' 20.60" | | | |
| Quad Name | | Quad Code | | | | |
| Wastewater Description: Sev | wage Effluent | | | | | |
| | | | | | | |
| Receiving Waters Dougherty | Run (CWF) | Stream Code | 56357 | | | |
| NHD Com ID <u>12944678</u> | 6 | RMI | 0.5700 | | | |
| Drainage Area 1.2 | | Yield (cfs/mi²) | 0.1 | | | |
| O Flow (ofo) 0.12 | | Q ₇₋₁₀ Basis | Default | | | |
| Elevation (ft) 1324 | | Slope (ft/ft) | | | | |
| Watershed No. 16-B | | Chapter 93 Class. | CWF | | | |
| Existing Use | | Existing Use Qualifier | | | | |
| Exceptions to Use | | Exceptions to Criteria | | | | |
| Assessment Status Attaining Use(s) | | | | | | |
| Cause(s) of Impairment | | | | | | |
| Source(s) of Impairment | | | | | | |
| TMDL Status | | Name | | | | |
| | | | | | | |
| Background/Ambient Data | | Data Source | | | | |
| pH (SU) | | Default | | | | |
| Temperature (°F) | 20 | Default | | | | |
| Hardness (mg/L) 100 | | Default | | | | |
| Other: | | | | | | |
| | | | | | | |
| Nearest Downstream Public Water Supply Intake | | Aqua Pennsylvania, Inc Eml | · | | | |
| PWS Waters Allegheny Ri | ver | Flow at Intake (cfs) | 1376 | | | |
| PWS RMI 90.0 | | Distance from Outfall (mi) | >25 | | | |

Changes Since Last Permit Issuance: None.

Other Comments: In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

| | Effluent Limitations | | | | Monitoring Requirements | | | |
|-----------------------------|----------------------|-------------------|-----------------------|-------------------|-------------------------|---------------------|--------------------------|----------------|
| Parameter | Mass Units | (lbs/day) (1) | Concentrations (mg/L) | | | Minimum (2) | Required | |
| Farameter | Average Monthly | Average Weekly | Minimum | Annual Average | Maximum | Instant. Maximum | Measurement Frequency | Sample Type |
| Flow (GPD) | Report Annl Avg | XXX | XXX | XXX | XXX | XXX | 1/year | Estimate |
| pH (S.U.) | XXX | XXX | 6.0 Inst Min | XXX | XXX | 9.0 | Upon Request | Grab |
| BOD5 | XXX | XXX | XXX | 10.0 | XXX | 20 | 1/year | Grab |
| TSS | XXX | XXX | XXX | 10.0 | XXX | 20 | 1/year | Grab |
| Fecal Coliform (No./100 ml) | XXX | XXX | XXX | 200 | XXX | XXX | 1/year | Grab |

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

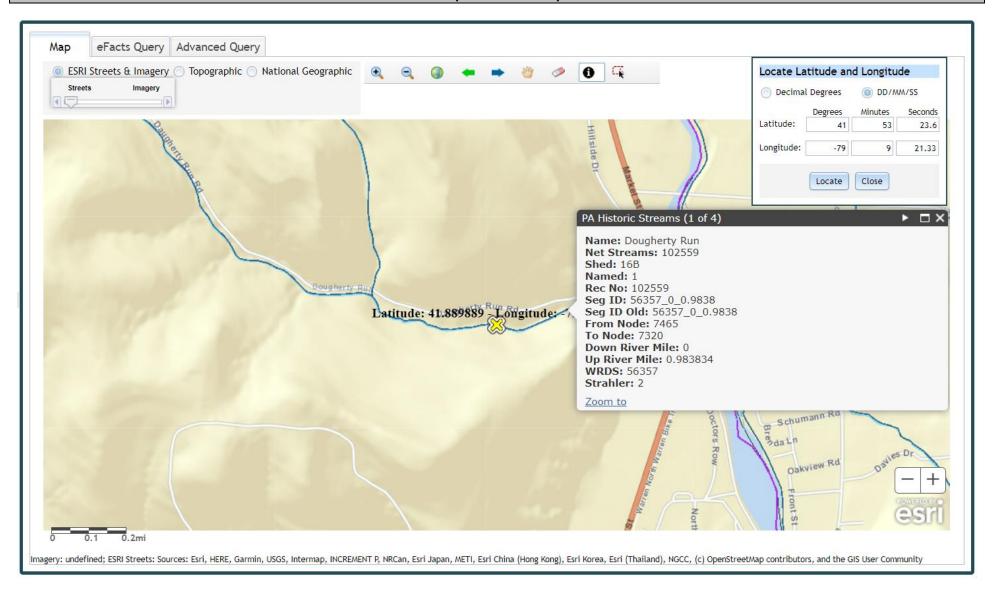

Attachment 2 Google Earth Imagery

