

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0265578

APS ID 1076816

Authorization ID 1419547

Applicant Name	Kevin Black	Facility Name	Kevin Black SRSTP
Applicant Address	470 Smutz Road	Facility Address	470 Smutz Road
	Warren, PA 16365-3835	<u></u>	Warren, PA 16365
Applicant Contact	Kevin Black	Facility Contact	
Applicant Phone	(814) 706-1194	Facility Phone	
Applicant Email	k_black90@hotmail.com		
Client ID	344323	Site ID	824814
SIC Code	4952,8800	Municipality	Conewango Township
SIC Description	Private Households, Trans. & Utilities - Sewerage Systems	County	Warren
Date Application Red	eived November 29, 2022	WQM Required	Issued
Date Application Accepted		WQM App. No.	6217417 T-1

Summary of Review

Renewal Permit for a SRSTP consisting of: A Norweco Singulair Model 960-500 Aerobic unit, a Norweco Bio-Film Reactor, and a Salcor 3G UV unit.

Act 14 - Proof of Notification was submitted and received.

SPECTIAL CONDITIONS: NONE

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (344323) as of March 2, 2023 4/5/2023 CWY

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer Trainee	March 2, 2023
X		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	4/5/2023

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information	mation	
Outfall No. 001	Design Flow (MGD)	.0004
Latitude 41° 54′ 1.00"	Longitude	-79º 16' 31.00"
Quad Name Sugar Grove	Quad Code	41079H3
Wastewater Description: Sewage Effluent		
Unnamed Tributary of Irvine Run		55054
Receiving Waters (CWF)	Stream Code	55851
NHD Com ID <u>112372963</u>	RMI	0.4500
Drainage Area	Yield (cfs/mi²)	
Q ₇₋₁₀ Flow (cfs) 0	Q ₇₋₁₀ Basis	
Elevation (ft) 1783	Slope (ft/ft)	
Watershed No. <u>16-B</u>	Chapter 93 Class.	CWF
Existing Use	Existing Use Qualifier	
Exceptions to Use	Exceptions to Criteria	
Assessment Status Attaining Use(s)		
Cause(s) of Impairment		
Source(s) of Impairment		
TMDL Status	Name	
Background/Ambient Data	Data Source	
pH (SU)	Default	
Temperature (°F) 20	Default	
Hardness (mg/L) 100	Default	
Other:		
Nearest Downstream Public Water Supply Intake	Aqua Pennsylvania, Inc Em	lenton
PWS Waters Allegheny River	Flow at Intake (cfs)	1376
PWS RMI 90		95 (Approximately)

Changes Since Last Permit Issuance: None.

Other Comments: AMRs have been submitted.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
Faranietei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV Disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Outfall Location - eMap with Aerial Imagery

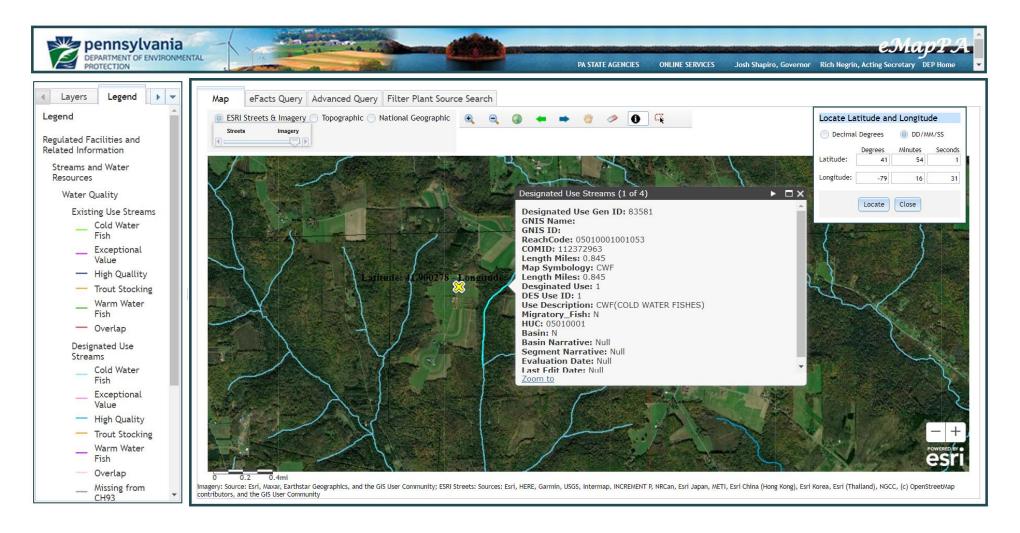

Drainage Area Location – StreamStats with Aerial Imagery

StreamStats Report

Region ID:

Workspace ID:


Clicked Point (Latitude, Longitude):

PA

PA20230303140651655000

41.90030, -79.27525

2023-03-03 09:07:13 -0500

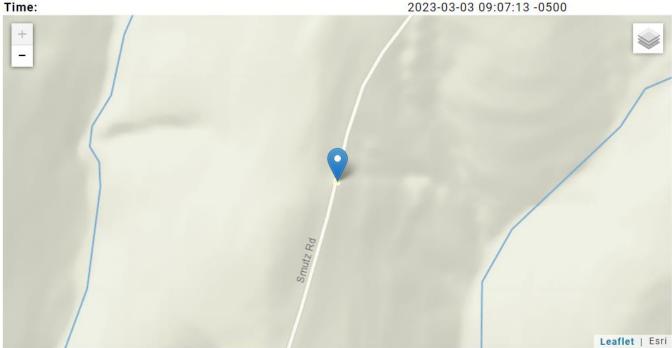

Collapse All

> Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	0.0000386	square miles