

## Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0265705

APS ID 1078078

Authorization ID 1421801

Applicant Name	Jame	es Braun	Facility Name	James Braun SRSTP	
Applicant Address	1450	Fisherman's Cove Road	Facility Address	1450 Fisherman's Cove Road	
	Polk,	PA 16342		Polk, PA 16342	
Applicant Contact	Jame	s Braun	Facility Contact		
Applicant Phone	(410)	596-5971	Facility Phone	826517	
Client ID	3404	47	Site ID		
SIC Code	8800		Municipality	Victory Township	
SIC Description	Private Households		County	Venango	
Date Application Received		December 16, 2022	WQM Required	Issued	
Date Application Accepted		February 3, 2023	WQM App. No.	6118401	

#### **Summary of Review**

Renewal Permit for a SRSTP consisting of: A Norweco Singulair Model 960-500 aerobic unit, a Norweco Bio-film reactor, and a Salcor 3G UV unit.

Act 14 - Proof of Notification was submitted and received.

**SPECTIAL CONDITIONS: NONE** 

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (340447) as of February 3, 2023 4/5/2023 CWY

#### **Public Participation**

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer Trainee	February 3, 2023
X		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	4/5/2023

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information						
Outfall No. 001	Design Flow (MGD)	.0004				
Latitude 41º 19' 10.15"	Longitude	-79° 51' 10.51"				
Quad Name Kennerdell	Quad Code	41079C7				
Wastewater Description: Sewage Effluent						
Receiving Waters Allegheny River (WWF)	Stream Code	42122				
NHD Com ID 100478495	RMI	0.3500				
Drainage Area	Yield (cfs/mi²)					
Q <sub>7-10</sub> Flow (cfs)	Q <sub>7-10</sub> Basis					
Elevation (ft)	Slope (ft/ft)					
Watershed No. 16-G	Chapter 93 Class.	WWF				
Existing Use	Existing Use Qualifier					
Exceptions to Use	Exceptions to Criteria					
Assessment Status Impaired						
Cause(s) of Impairment MERCURY						
Source(s) of Impairment SOURCE UNKNOWN						
TMDL Status	Name					
Background/Ambient Data	Data Source					
pH (SU)	Default					
Temperature (°F)	Default					
Hardness (mg/L)	Default					
Other:						
Nearest Downstream Public Water Supply Intake						
PWS Waters	Flow at Intake (cfs)					
PWS RMI	Distance from Outfall (mi)					

Changes Since Last Permit Issuance: None.

Other Comments: AMRs have been submitted.

#### **Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


#### Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum <sup>(2)</sup>	Required	
r ai ailletei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV Disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

### **Outfall Location - eMap with Aerial Imagery**

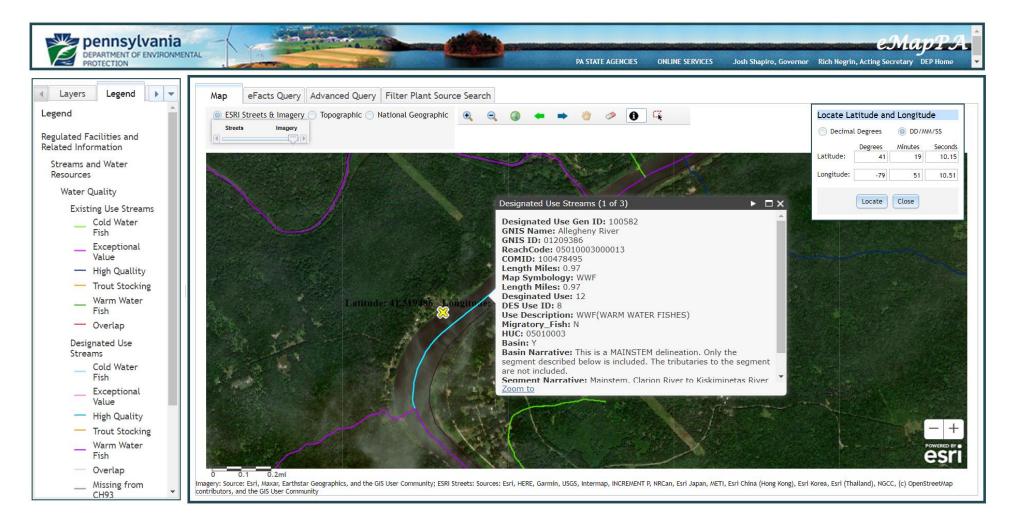


## **Drainage Area Location – StreamStats with Aerial Imagery**

# StreamStats Report

Parameter Code

DRNAREA

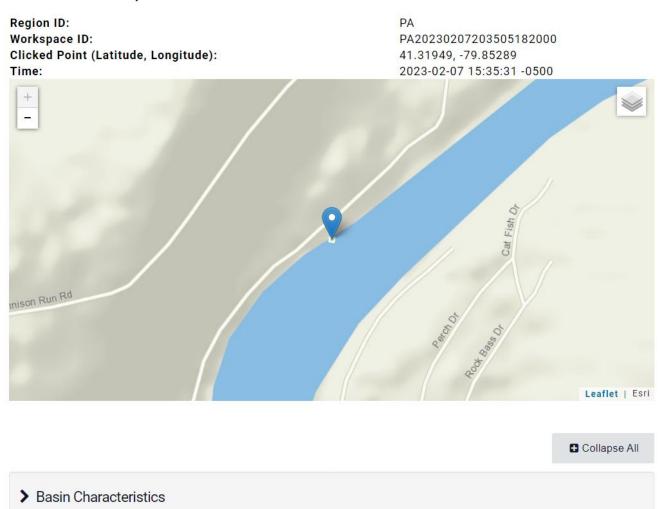

Value

0.0000386

Unit

square miles

**Parameter Description** 

Area that drains to a point on a stream