

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0288322

 APS ID
 1014857

 Authorization ID
 1311429

Applicant, Facility and Project Information

Applicant Name	Kenneth Graber	Facility Name	Kenneth Graber SRSTP
Applicant Address	8925 Day Lilly Court	Facility Address	155 Mohawk Trail
	Fairfax, VA 22031-1464		Slippery Rock, PA 16057
Applicant Contact	Kenneth Graber	r Facility Contact Kenneth Graber	
Applicant Phone	(703) 403-1977	Facility Phone	(703) 403-1977
Client ID	356085	Site ID	841603
SIC Code	8800	Municipality	Slippery Rock Township
SIC Description	Private Households	County	Butler
Date Application Receiv	vedApril 7, 2020	WQM Required	Yes
Date Application Accep	tedApril 20, 2020	WQM App. No.	1020407
Project Description	Single Residence Sewage Treatme	nt Plant.	

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1020407): A 1,000-gallon dual compartment concrete septic tank w/Zabel A300 effluent filter followed by a Premier Tech EC7-C-P Coco Filter unit with an integrated pump Ultraviolet (UV) light disinfection unit, and effluent pumping.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (356085) as of 4/20/2020.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date	
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	April 21, 2020	
х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	April 21, 2020	

Discharge, Receiving Waters and Water Supply Information					
Outfall No. 001	Design Flow (MGD)	.0004			
Latitude 41º 1' 54.70"	Longitude	-80° 0' 33.46"			
Quad Name Slippery Rock	Quad Code	41080A1			
Wastewater Description: Sewage Effluent					
Receiving Waters Slippery Rock Creek (CWF)	Stream Code	34032			
NHD Com ID 126221995	RMI	0.6400			
Drainage Area 127	Yield (cfs/mi ²)	0.1			
Q ₇₋₁₀ Flow (cfs) 12.7	Q7-10 Basis	Default			
Elevation (ft) 1146	Slope (ft/ft)				
Watershed No. 20C	Chapter 93 Class.	Cold Water Fishes			
Existing Use	Existing Use Qualifier				
Exceptions to Use	Exceptions to Criteria				
Assessment Status Attaining Use(s)					
Cause(s) of Impairment					
Source(s) of Impairment					
TMDL Status	Name				
Background/Ambient Data	Data Source				
pH (SU)	Default				
Temperature (°F) 20	Default				
Hardness (mg/L)100	Default				
Other:					
Nearest Downstream Public Water Supply Intake	PA American Water Company	v – Ellwood City			
PWS Waters Slipper Rock Creek	Flow at Intake (cfs)	53.1			
PWS RMI 0.1	Distance from Outfall (mi)	>30 mi			

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on February 11, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7-C-P Coco Filter unit and the discharge is located in a High Quality (HQ) watershed. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Premier Tech EC7 is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations				Monitoring Requirements			
	Mass Units (Ibs/day) ⁽¹⁾		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
рН (S.U.)	ххх	xxx	Report Inst Min	xxx	xxx	Report	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	xxx	xxx	XXX	10.0	xxx	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	xxx	200	xxx	ххх	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

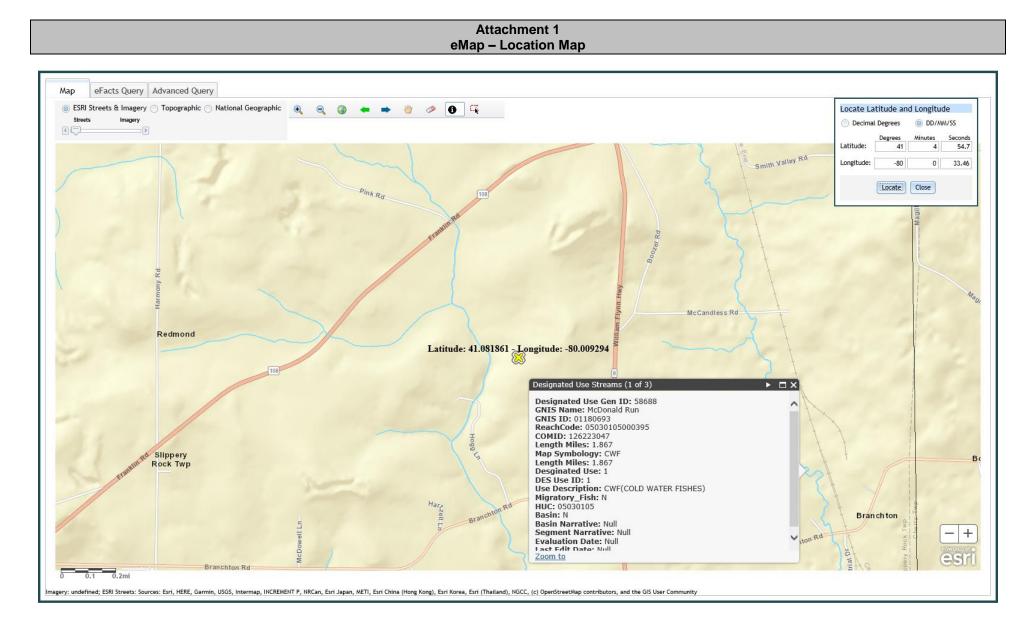

Attachment 2 Google Earth Imagery

