

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0288608

APS ID 1020179

Authorization ID 1321126

olicant Name	Tammy King	Facility Name	Tammy King SRSTP	
olicant Address	120 McGrady Hollow Road	Facility Address	120 McGrady Hollow Road	
	Butler, PA 16002-1056		Butler, PA 16002-1056	
olicant Contact	Tammy King	Facility Contact	Tammy King	
olicant Phone	(724) 332-6945	Facility Phone	(724) 332-6945	
nt ID	357555	Site ID	842201	
Code	8800	Municipality	Summit Township	
Description	Private Households	County	Butler	
e Application Rece	eived	WQM Required	Yes	
Application Acce	epted August 5, 2020	WQM App. No.	1020412	

Summary of Review

This is a new discharge for an existing 4-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1020411): A 1,000 gallon dual compartment concrete septic tank, followed by a Zabel A300 effluence filter, then Premier Tech EC7-500 Ecoflo Coco Filter unit with an integrated pump and DiUV Ultraviolet (UV) light disinfection unit preinstalled by the manufacturer.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (357555) as of 8/12/2020.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	August 12, 2020
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	August 17, 2020

Discharge, Receiving Wate	ers and Water Supply Infor	mation			
Outfall No. 001		Design Flow (MGD)	.0005		
Latitude 40° 52' 23.8	35"	Longitude	-79° 47' 23.13"		
Quad Name Saxonbui	rg	Quad Code	40079G7		
Wastewater Description:	Sewage Effluent				
	amed Tributary of Bonnie k (WWF)	Stream Code	35165		
	221571	RMI	0.1800		
Drainage Area 0.78		Yield (cfs/mi²)	0.1		
Q_{7-10} Flow (cfs) 0.07		Q ₇₋₁₀ Basis	Default		
Elevation (ft)	-	Slope (ft/ft)			
Watershed No. 20C		Chapter 93 Class.	Warm Water Fishes		
Existing Use		Existing Use Qualifier			
Exceptions to Use		Exceptions to Criteria			
Assessment Status	Attaining Use(s)	<u> </u>			
Cause(s) of Impairment					
Source(s) of Impairment					
TMDL Status		Name			
De alemane d'Arabia et Data		Data Carras			
•	Background/Ambient Data		Data Source		
pH (SU)	7.0	Default			
	Temperature (°F) 20		Default		
Hardness (mg/L) 100		Default			
Other:					
Nearest Downstream Public Water Supply Intake		Harmony Borough Water Authority			
			2.0		
PWS RMI 1.1	·	Distance from Outfall (mi)	>25 mi		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on May 29, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter unit. The proposed discharge is to resolve a repair of a malfunctioning onlot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
Farameter	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: <u>Outfall 001, after disinfection</u>

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

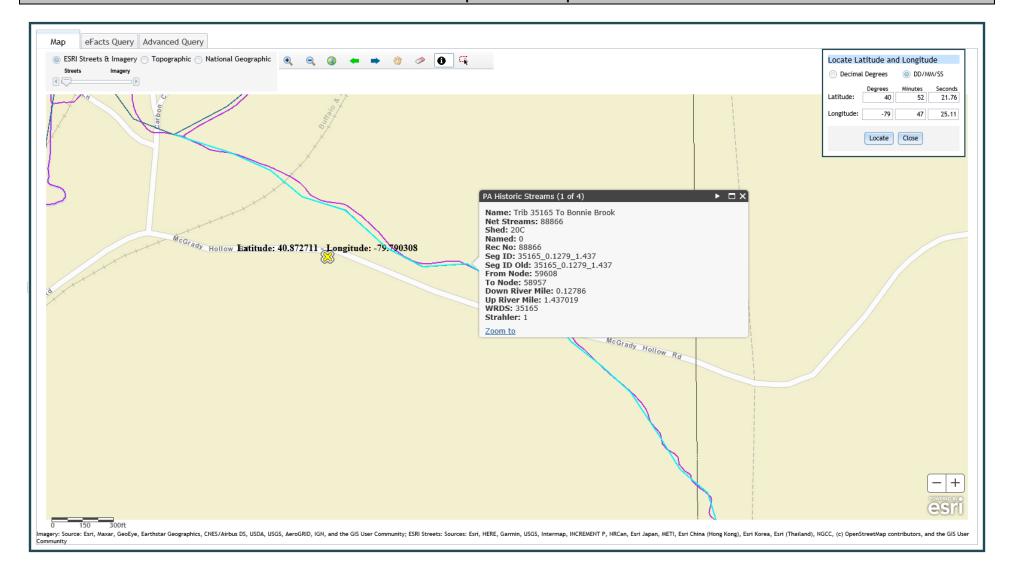

Attachment 2 Google Earth Imagery

