

Application Type	New
Wastewater Type	Sewage
Facility Type	SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.PA0288616APS ID1020399Authorization ID1321478

## Applicant, Facility and Project Information

Applicant Name	Mary	Dekruif	Facility Name	Mary Dekruif SRSTP		
Applicant Address	8734 I	Franklin Pike	Facility Address	8734 Franklin Pike		
	Mead	ville, PA 16335-5106		Meadville, PA 16335-5106		
Applicant Contact	Mary I	Dekruif	Facility Contact	Mary Dekruif		
Applicant Phone	(814) 2	221-7151	Facility Phone	(814) 221-7151		
Client ID	35760	3	Site ID Municipality	841814		
SIC Code	8800			West Mead Township Crawford		
SIC Description	Private	e Households	County			
Date Application Rec	eived	July 14, 2020	WQM Required	Yes		
Date Application Acc	epted	August 5, 2020	WQM App. No.	2020403		

#### Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1020411): A 1,000 gallon concrete septic tank, followed by a Premier Tech Ecoflo Coco Filter unit, followed by a Salcor 3G Ultraviolet (UV) light disinfection unit with effluent pumping.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (357603) as of 8/10/2020.

#### Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	August 10, 2020		
х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	August 11, 2020		

Discharge, Receiving	Waters and Water Sup	Iy Information
Outfall No. 001		Design Flow (MGD)0004
Latitude 41º 3	5' 0.88"	Longitude80° 6' 29.84""
Quad Name Co	chranton	Quad Code 41080E1
Wastewater Descrip	tion: Sewage Effluent	
Dessiving Waters	Unnamed Tributary to F	
Receiving Waters NHD Com ID	Creek (WWF)	Stream Code <u>52402</u>
	127346163	RMI <u>1.3000</u>
Drainage Area	0.054	Yield (cfs/mi²) 0.1
Q <sub>7-10</sub> Flow (cfs)	0.005	Q7-10 Basis Default
Elevation (ft)	1470	Slope (ft/ft)
Watershed No.	16D	Chapter 93 Class. <u>Warm Water Fishes</u>
Existing Use	·	Existing Use Qualifier
Exceptions to Use		Exceptions to Criteria
Assessment Status	Attaining Use(s)	
Cause(s) of Impairm		
Source(s) of Impairr	nent	
TMDL Status		Name
Background/Ambier	nt Data	Data Source
pH (SU)	7.0	Default
Temperature (°F)	20	Default
Hardness (mg/L)	100	Default
Other:		
Nearest Downstrear	n Public Water Supply Int	ake Aqua Pennsylvania, Inc - Emlenton
PWS Waters A	Allegheny River	Flow at Intake (cfs) 1376
PWS RMI 9	00	Distance from Outfall (mi) >50

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on May 1, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter unit. The proposed discharge is to resolve a repair of a malfunctioning onlot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

## Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


#### Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup>	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	xxx	XXX	XXX	1/year	Estimate
рН (S.U.)	XXX	XXX	6.0 Inst Min	XXX	xxx	9.0	Upon Request	Grab
BOD5	xxx	XXX	xxx	10.0	xxx	20	1/year	Grab
TSS	XXX	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	xxx	ххх	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

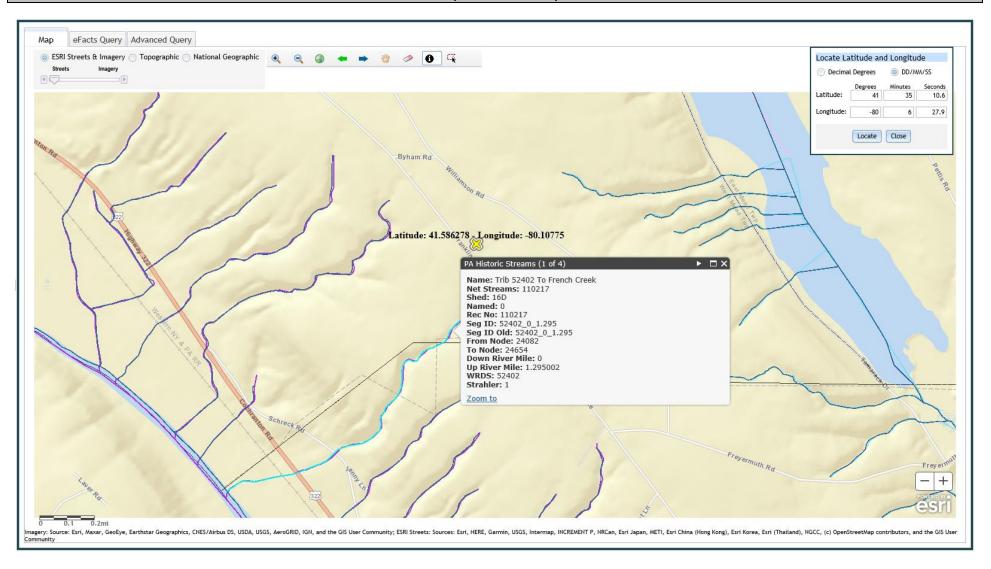

### Attachment 2 Google Earth Imagery

