

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0288691

APS ID 1022243

Authorization ID 1324764

plicant Name	Steve	en J. Weed	Facility Name	Steven Weed SRSTP	
plicant Address	411 P	asadena Drive	Facility Address	13600 Arneman Road	
	Erie,	PA 16505-1036		Edinboro, PA 16412-1918	
plicant Contact	Steve	n Weed	Facility Contact	Steven Weed	
plicant Phone	(814)	392-8568	Facility Phone	(814) 392-8568	
ent ID	358144		Site ID	841733	
C Code	8800		Municipality	Washington Township	
Description	Private Households		County	Erie	
Date Application Received		August 18, 2020	WQM Required	Yes	
ate Application Accepted		September 2, 2020	WQM App. No.	2520421	

Summary of Review

This is a new discharge for an existing 4-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2520421): A Norweco Singulair Green (Model 960) Bio-Kinetic unit with a Norweco Model AT1500 Ultraviolet (UV) light disinfection unit preinstalled by the manufacturer.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (358144) as of 9/2/2020.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey Jordan A. Frey, E.I.T. / Civil Engineer Trainee	September 2, 2020
X		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	September 3, 2020

Discharge, Receiving Waters and Water Supply Information						
Outfall No. 001	Design Flow (MGD) .0005					
Latitude 41° 51′ 34.34″	Longitude <u>-80° 6' 18.24""</u>					
Quad Name Cambridge Springs	Quad Code 41080G1					
Wastewater Description: Sewage Effluent						
Unnamed Tributary to Conneau						
Receiving Waters Creek (WWF)	Stream Code 53040					
NHD Com ID 127344306	RMI <u>0.5300</u>					
Drainage Area 0.68	Yield (cfs/mi²) 0.1					
Q ₇₋₁₀ Flow (cfs) 0.06	Q ₇₋₁₀ Basis Default					
Elevation (ft) 1200	Slope (ft/ft)					
Watershed No. <u>16A</u>	Chapter 93 Class. Warm Water Fishes					
Existing Use	Existing Use Qualifier					
Exceptions to Use	Exceptions to Criteria					
Assessment Status Impaired						
NUTRIENTS, NUTRIEN Cause(s) of Impairment SILTATION, SILTATION	ITS, NUTRIENTS, NUTRIENTS, SILTATION, SILTATION,					
	CULTURE, AGRICULTURE, AGRICULTURE, GRAZING IN					
RIPARIAN OR SHOREL	LINE ZONES, GRAZING IN RIPARIAN OR SHORELINE					
	RIPARIAN OR SHORELINE ZONES, GRAZING IN RIPARIAN					
Source(s) of Impairment OR SHORELINE ZONE	· · · · · · · · · · · · · · · · · · ·					
TMDL Status	Name					
Background/Ambient Data	Data Source					
pH (SU)	Default					
Temperature (°F)	Default					
Hardness (mg/L)	Default					
Other:						
Nearest Downstream Public Water Supply Intake	Kitanning Suburban Joint Water Authority					
PWS Waters Allegheny River	Flow at Intake (cfs) 1407					
PWS RMI 1	Distance from Outfall (mi) >50 mi					

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on August 12, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Norweco Singulair unit. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Norweco Singulair unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)				Minimum ⁽²⁾	Required
raiailletei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: <u>Outfall 001, after disinfection</u>

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

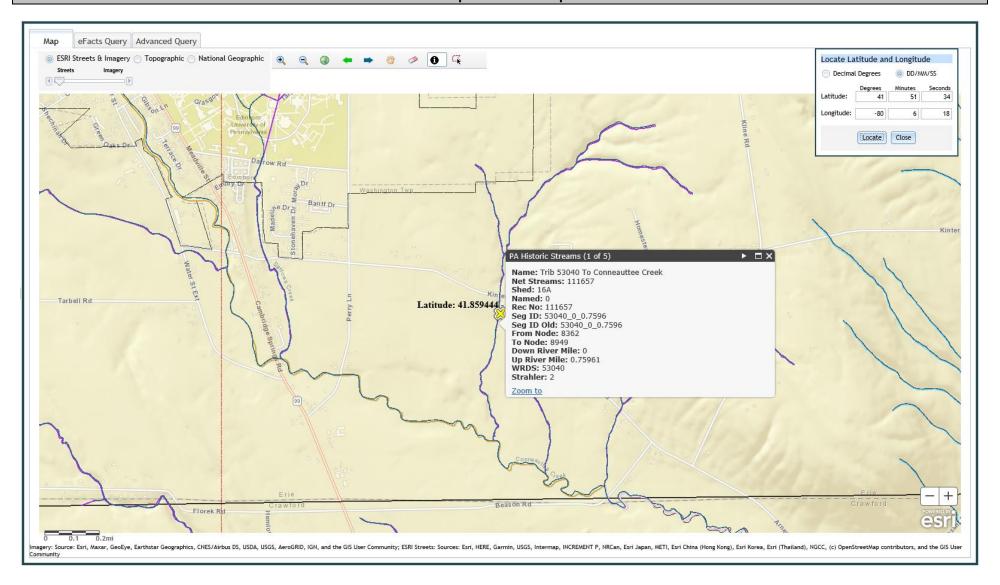

Attachment 2 Google Earth Imagery

