

### Northwest Regional Office CLEAN WATER PROGRAM

Application Type

Wastewater Type

Facility Type

SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0288896

APS ID 1028714

Authorization ID 1336573

oplicant Name	CL H	oldings LLC	Facility Name	CL Holdings SRSTP
oplicant Address	414 N	lorth Washington Street	Facility Address	1035 Perry Highway
	Evans	s City, PA 16033		Harmony, PA 16037-9421
oplicant Contact	Curtis	Graf	Facility Contact	Curtis Graf
oplicant Phone	(724)	841-5226	Facility Phone	(724) 841-5226
lient ID	3600	14	Site ID	844858
C Code	8800		Municipality	Muddycreek Township
C Description	Privat	te Households	County	Butler
Date Application Received		December 3, 2020	WQM Required	Yes
Pate Application Accepted December 24,		December 24, 2020	WQM App. No.	1020417

#### **Summary of Review**

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1020417): A Singulair Bio-Kinetic Model 960-500, then to Hydro-Kinetic Bio-Film Reactor, then to a model AT1500 UV disinfection system.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (360014) as of 02/08/2021.

#### **Public Participation**

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
Х		Jordan A. Frey Jordan A. Frey, E.I.T. / Civil Engineer Trainee	February 10, 2021		
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	February 11, 2021		

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information						
Outfall No. 001		Design Flow (MGD)	.0004			
Latitude 40° 54' 8.36"		Longitude	-80° 8' 22.33"			
Quad Name Portersville	9	Quad Code	40080H2			
Wastewater Description:	Sewage Effluent					
Receiving Waters <u>Little</u>	Yellow Creek (CWF)	Stream Code	34927			
NHD Com ID <u>12621</u>	6718	RMI	0.4800			
Drainage Area 0.037		Yield (cfs/mi²)	0.1			
Q <sub>7-10</sub> Flow (cfs) 0.003		Q <sub>7-10</sub> Basis	Default			
Elevation (ft) 1302		Slope (ft/ft)				
Watershed No. 20-C		Chapter 93 Class.	CWF			
Existing Use		Existing Use Qualifier				
Exceptions to Use		Exceptions to Criteria				
Assessment Status	Attaining Use(s)					
Cause(s) of Impairment	Cause(s) of Impairment					
Source(s) of Impairment						
TMDL Status	Final	Name Little Conno	quenessing Creek Watershed			
Background/Ambient Data		Data Source				
pH (SU)	7.0	Default				
Temperature (°F)	Temperature (°F) 20		Default			
Hardness (mg/L) 100		Default				
Other:						
Nearest Downstream Public Water Supply Intake		Harmony Borough Water Authority				
PWS Waters Little Co	nnoquenessing Creek	Flow at Intake (cfs) 2.0				
PWS RMI 1.1		Distance from Outfall (mi)	10.3			

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on November 9, 2020).

#### Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Singulair unit. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Singulair unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

#### **Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


#### Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum <sup>(2)</sup>	Required	
Farameter	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

## Attachment 1 eMap – Location Map

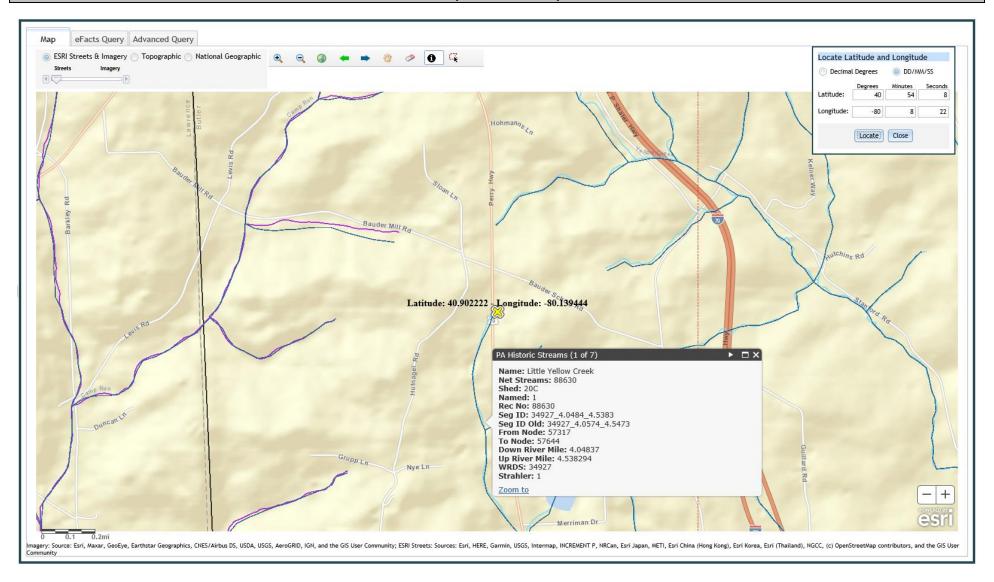

# Attachment 2 Google Earth Imagery

