

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0288926

 APS ID
 1030088

 Authorization ID
 1339038

Applicant, Facility and Project Information

Applicant Name	Gary Twichel	Facility Name	Gary Twichel SRSTP		
Applicant Address	11000 Ivarea Road	Facility Address	11000 Ivarea Road		
	Albion, PA 16401-8940		Albion, PA 16401-8940		
Applicant Contact	Gary Twichel	Facility Contact			
Applicant Phone	(814) 392-7754	Facility Phone			
Client ID	360380	Site ID	844510		
SIC Code	8800	Municipality	Elk Creek Township		
SIC Description	Private Households	County	Erie		
Date Application Receiv	vedDecember 11, 2020	WQM Required	Yes		
Date Application Accep	ted January 22, 2021	WQM App. No.	WQG01252001		
Project Description	Single Residence Sewage Trea	tment Plant.			

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. WQG0125201): A Premier Tech EC7-500-G/P Coco Filter unit with integrated DiUV unit. (A WQG-01 permit application was submitted. However, the proposed treatment does not qualify for coverage under the WQG-01. Therefore, the Department will coordinate with the consultant during the draft permit comment period to get the proper paperwork for an Individual WQM permit application). JCD 3/22/2021

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (360380) as of 03/19/2021.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	March 19, 2021		
х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	March 22, 2021		

Discharge and Stream Data - 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

Outfall No. 001			Design Flow (MGD)	.0004	
Latitude 41° 53' 9.98" Quad Name Albion			Longitude	-80º 16' 11.86"	
			Quad Code	41080H3	
Wastewater Descrip	otion:	Sewage Effluent			
		ned Tributary to Little Elk			
Receiving Waters		(CWF, MF)	Stream Code	62543	
NHD Com ID	123919	9643	RMI	0.5200	
Drainage Area	0.58		Yield (cfs/mi ²)	0.1	
Q ₇₋₁₀ Flow (cfs) 0.058			Q ₇₋₁₀ Basis Slope (ft/ft) Chapter 93 Class. Existing Use Qualifier	Default	
Elevation (ft)				. 	
Watershed No.					
Existing Use					
Exceptions to Use			Exceptions to Criteria		
Assessment Status	_	Attaining Use(s)			
Cause(s) of Impairn	nent				
Source(s) of Impairr	ment				
TMDL Status			Name		
Background/Ambier	nt Data		Data Source		
pH (SU) 7.0		7.0	Default		
Temperature (°F) 20		Default			
Hardness (mg/L) 100		Default			
Other:					
Nearest Downstrea	m Public	Water Supply Intake	Erie Water Works		
PWS Waters Lake Erie		Flow at Intake (cfs) N/A			
PWS RMI N/A			Distance from Outfall (mi) 17.8		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on April 30, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations				Monitoring Requirements			
	Mass Units (Ibs/day) ⁽¹⁾		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	xxx	XXX	XXX	XXX	1/year	Estimate
рН (S.U.)	ххх	xxx	6.0 Inst Min	XXX	xxx	9.0	Upon Request	Grab
BOD5	ххх	xxx	xxx	10.0	xxx	20	1/year	Grab
TSS	ххх	xxx	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	xxx	200	xxx	ххх	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

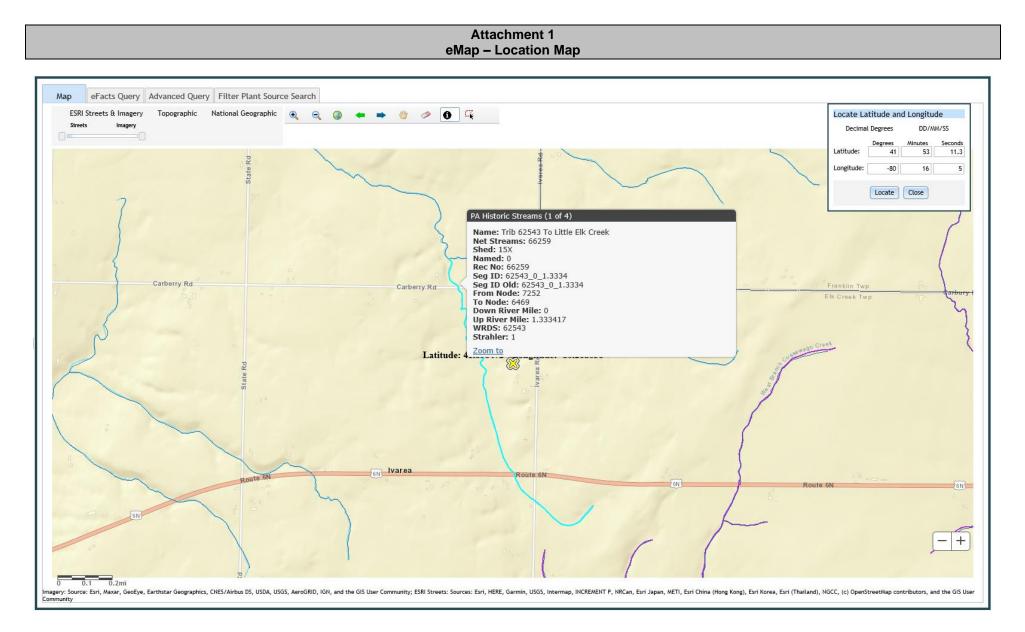

Attachment 2 Google Earth Imagery

