

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0289370

APS ID 1037422

Authorization ID 1351693

Applicant Name	Robert A Griffith Estate	Facility Name	Griffith Estate SRSTP
Applicant Address	10644 Silverthorn Road	Facility Address	4000 Wagner Road
	Edinboro, PA 16412-9720		Erie, PA 16509-4240
Applicant Contact	Heather Kuntz	Facility Contact	Heather Kuntz
Applicant Phone	(814) 823-7264	Facility Phone	(814) 823-7264
Client ID	362587	Site ID	847151
SIC Code	8800	Municipality	McKean Township
IC Description	Private Households	County	Erie
ate Application Rece	eived April 5, 2021	WQM Required	Yes
ate Application Acce	pted May 13, 2021	WQM App. No.	2521411

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2521411): A 1000-gallon concrete septic tank followed by a Premier Tech EC7 Coco Filter unit, UV disinfection unit, followed by a pump tank.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (362587) as of 07/08/2021.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	July 9, 2021
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	July 12, 2021

Discharge and Stream Data – 2 - Receiving Waters and PWS

Outfall No. 001		Design Flow (MGD)	.0004		
Latitude 42° 1' 47.15	; II	Longitude	-80° 7' 38.91"		
Quad Name Erie Sout	h	Quad Code	42080A1		
Wastewater Description:	Sewage Effluent				
Unna	amed Tributary of Walnut				
Receiving Waters Cree	k (HQ-CWF, MF)	Stream Code	62616		
NHD Com ID 1342	05241	RMI	0.25		
Drainage Area 0.78		Yield (cfs/mi²)	0.1		
Q_{7-10} Flow (cfs) 0.7		Q ₇₋₁₀ Basis	Default		
Elevation (ft) 1083		Slope (ft/ft)			
Watershed No. 15-A		Chapter 93 Class.	HQ-CWF, MF		
Existing Use		Existing Use Qualifier			
Exceptions to Use		Exceptions to Criteria			
Cause(s) of Impairment ALTERATIONS, HABITA SITE CLEARANCE (LAND DE		FICATION, FLOW REGIME MODIFICATION, HABITAT AT ALTERATIONS, SILTATION, SILTATION IND DEVELOPMENT OR REDEVELOPMENT), SITE EVELOPMENT OR REDEVELOPMENT), SITE CLEARANCE T OR REDEVELOPMENT), URBAN RUNOFF/STORM			
		NOFF/STORM SEWERS, URBAN RUNOFF/STORM SEWERS			
TMDL Status		Name			
Background/Ambient Data	1	Data Source			
pH (SU)	7.0	Default			
Temperature (°F)	20	Default			
Hardness (mg/L) 100		Default			
Other:					
Nearest Downstream Pub	lic Water Supply Intake	Erie Water Works			
PWS Waters Lake Erie		Flow at Intake (cfs) 0.0			
PWS RMI 0.0		Distance from Outfall (mi)	>25		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on March 11, 2021).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum (2)	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: None.

Attachment 1 eMap – Location Map

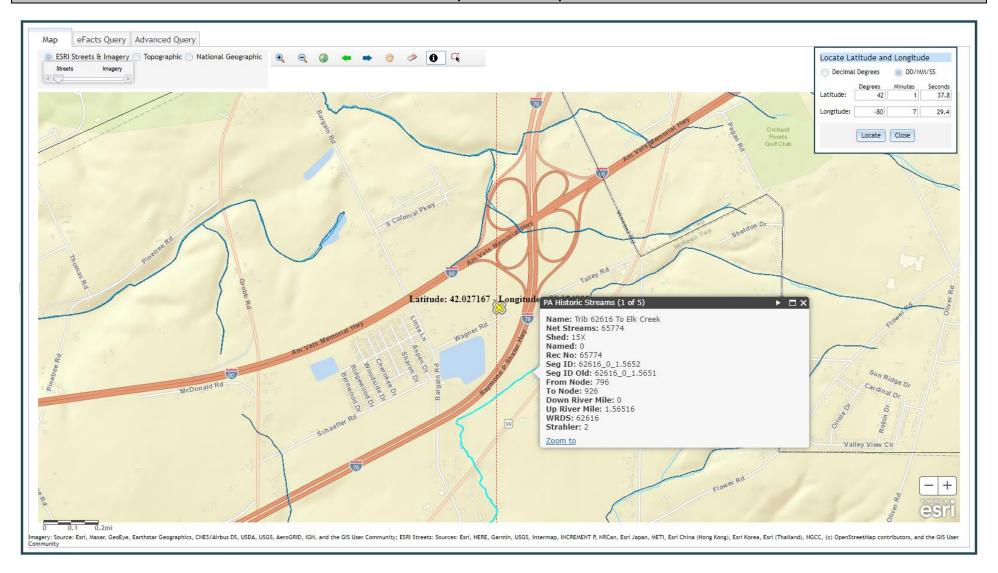

Attachment 2 Google Earth Imagery

