

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0289507

APS ID 1038759

Authorization ID 1354536

Applicant Name	Duane Deha	ass	Facility Name	Duane Dehass SRSTP
Applicant Address	625 State Li	ne Road	Facility Address	625 State Line Road
	Bessemer, F	PA 16112		Bessemer, PA 16112
Applicant Contact	Duane Deha	iss	Facility Contact	
Applicant Phone	(724) 651-17	766	Facility Phone	
Client ID	362977		Site ID	847760
SIC Code	8800		Municipality	North Beaver Township
SIC Description	Private Hous	seholds	County	Lawrence
Date Application Rece	eived <u>Ma</u>	y 13, 2021	WQM Required	Yes
Date Application Acce	pted Ma	y 21, 2021	WQM App. No.	3721403

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 3721403): A Norweco Singulair 960-500 tank and equipment followed by a Norweco Hydro-Kinetic Biofilm Reactor unit, then to an AT 1500 ultraviolet (UV) disinfection unit.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (3721403) as of 7/14/2021.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	July 16, 2021
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	July 26, 2021

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information						
Outfall No. 001		Design Flow (MGD)	.0004			
Latitude 40° 56' 59.9	4"	Longitude	-80° 31' 5.97"			
Quad Name New Mido	lletown	Quad Code	40080H5			
Wastewater Description:	Sewage Effluent					
	med Tributary to Hickory R		07440			
Receiving Waters (TSF	<i>'</i>	Stream Code	35416			
	70241	RMI	0.0300			
Drainage Area 0.37			0.1			
Q ₇₋₁₀ Flow (cfs) 0.04		Q ₇₋₁₀ Basis	Default			
Elevation (ft) 1205						
Watershed No. 20-B		Chapter 93 Class.	TSF			
Existing Use		Existing Use Qualifier				
Exceptions to Use		Exceptions to Criteria				
Assessment Status	Impaired					
Cause(s) of Impairment	METALS, METALS, MET SILTATION	TALS, METALS, SILTATION, SIL	TATION, SILTATION,			
Cause(s) or impairment		ACID MINE DRAINAGE, ACID N	MINE DRAINAGE, ACID MINE			
	DRAINAGE, URBAN RU	NOFF/STORM SEWERS, URBA	N RUNOFF/STORM			
		NOFF/STORM SEWERS, URBAN RUNOFF/STORM SEWERS				
TMDL Status		Name				
Background/Ambient Data		Data Source				
pH (SU)	7.0	Default				
Temperature (°F)	20	Default				
Hardness (mg/L)	100	Default				
Other:						
Nearest Downstream Public Water Supply Intake		Beaver Falls Municipal Authority				
PWS Waters Beaver	River	Flow at Intake (cfs)	561			
PWS RMI 3.5		Distance from Outfall (mi)	>25 mi			

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on April 9, 2021).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Norweco Singulair. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Norweco Singulair unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum (2)	Required	
raidilletei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: <u>Outfall 001, after disinfection</u>

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

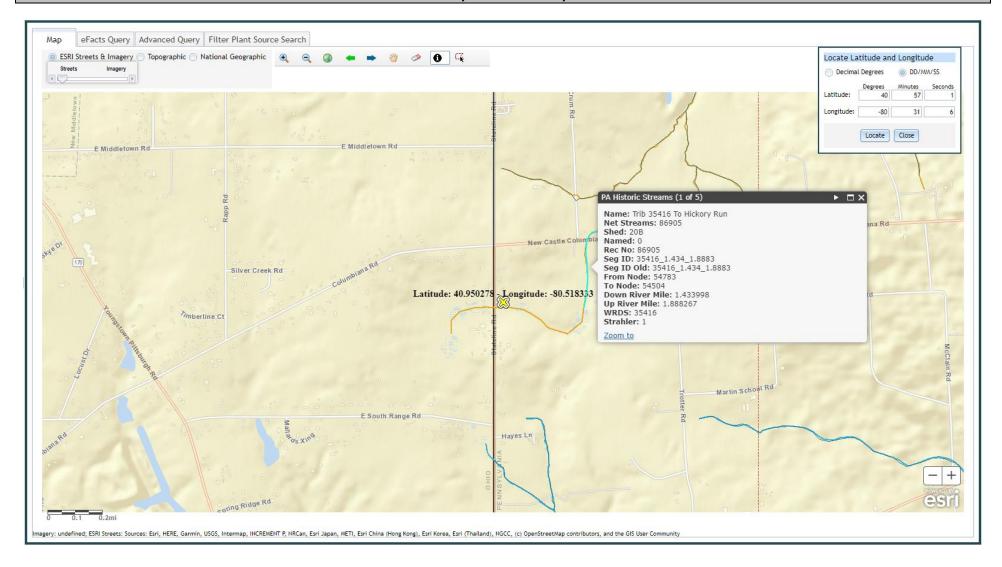

Attachment 2 Google Earth Imagery

