

Northwest Regional Office CLEAN WATER PROGRAM

Application Type	New
Wastewater Type	Sewage
Facility Type	SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0290394

APS ID 1055601

Authorization ID 1383102

Applicant Name	Mark	Bohman	Facility Name	Mark Bohman SRSTP
Applicant Address	9563 F	ry Road	Facility Address	9563 Fry Road
	Mckea	ın, PA 16426-1708		Mckean, PA 16426-1708
Applicant Contact	Mark E	Bohman	Facility Contact	
Applicant Phone	(814)	602-7203	Facility Phone	
Client ID	36789	0	Site ID	853170
SIC Code	8800		Municipality	McKean Township
SIC Description	Private	Households	County	Erie
Date Application Rece	eived	January 24, 2022	WQM Required	Yes
Date Application Acce	pted		WQM App. No.	2522404

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522404): A 1000-gallon dual chambered concrete septic tank followed by a Premier Tech EC7 Coco Filter unit with integrated UV unit.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (367890) as of 02/23/2022.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	March 2, 2022
Х		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	March 9, 2022

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information					
Outfall No. 001	Design Flow (MGD)0005				
Latitude 41° 58' 20.32"	Longitude80° 9' 47.56"				
Quad Name Edinboro North	Quad Code 41080H2				
Wastewater Description: Sewage Effluent					
Unnamed Tributary of E Receiving Waters (CWF, MF)	lk Creek Stream Code 62577				
NHD Com ID 123922452	RMI 0.1500				
Drainage Area 0.0631	Yield (cfs/mi²) 1.0				
Q ₇₋₁₀ Flow (cfs) 0.006	Q ₇₋₁₀ Basis Default				
Elevation (ft) 1241	Slope (ft/ft)				
Watershed No. 15-A	Chapter 93 Class. CWF, MF				
Existing Use	Existing Use Qualifier				
Exceptions to Use	Exceptions to Criteria				
Assessment Status Attaining Use(s)					
Cause(s) of Impairment					
Source(s) of Impairment					
TMDL Status	Name				
·					
Background/Ambient Data	Data Source				
pH (SU) <u>7.0</u>	Default				
Temperature (°F)	Default				
Hardness (mg/L) 100	Default				
Other:					
Nearest Downstream Public Water Supply Int	ake Erie Water Works				
PWS Waters Lake Erie (Chestnut and W	/est) Flow at Intake (cfs) N/A				
PWS RMI N/A	Distance from Outfall (mi) 20.1				

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on January 5, 2022).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations						Monitoring Requirements	
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)				Minimum (2)	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

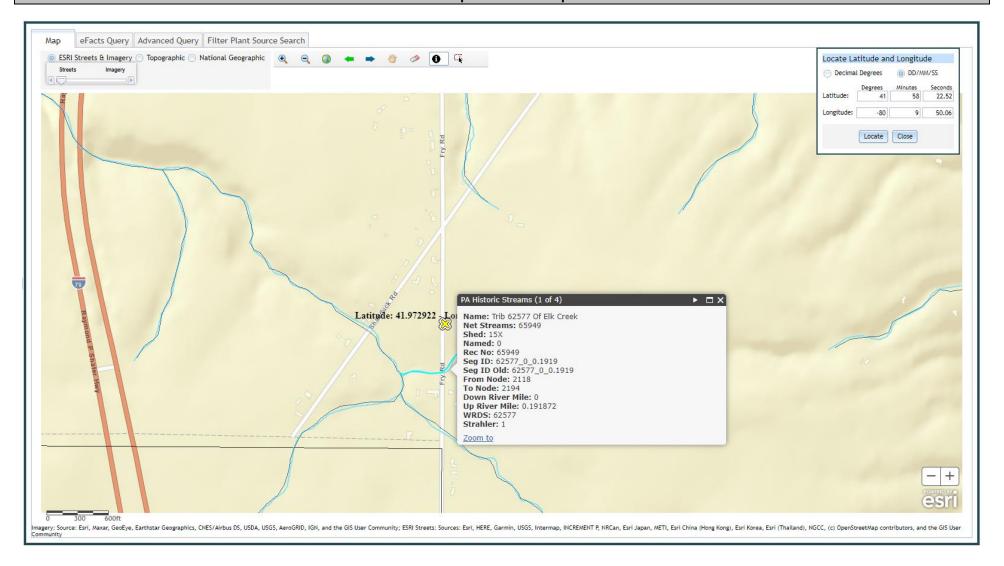

Attachment 2 Google Earth Imagery

