

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0290688

 APS ID
 1062730

 Authorization ID
 1395215

# Applicant, Facility and Project Information

Applicant Name	Melissa Hinkle	Facility Name	Melissa Hinkle SRSTP		
Applicant Address	3207 Reichert Road	Facility Address	3207 Reichert Road		
	Erie, PA 16509-4337		Erie, PA 16509-4337		
Applicant Contact	Melissa Hinkle	Facility Contact			
Applicant Phone	(814) 500-3377	Facility Phone			
Client ID	369869	Site ID	850759		
SIC Code	8800	Municipality	McKean Township		
SIC Description	Private Households	County	Erie		
Date Application Receiv	vedApril 29, 2022	WQM Required	Yes		
Date Application Accep	ted <u>May 10, 2022</u>	WQM App. No.	2522414		
Project Description	Single Residence Sewage	Treatment Plant.			

# Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522414): A Norweco Singulair Green Bio-Kinetic 960-500 treatment tank and equipment, followed by a Norweco Hydro-Kinetic Bio-Film Reactor, and a Model AT1500 ultraviolet (UV) disinfection unit.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (369869) as of 5/10/2022.

#### Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date	
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	May 11, 2022	
х		Adam J. Pesek for Justin C. Dickey, P.E. / Environmental Engineer Manager	May 11, 2022	

Discharge, Receiving Waters and Water Supply Information					
Outfall No. 001	Design Flow (MGD)	0.0004			
Latitude 42° 1' 46.9"	Longitude	-80° 6' 52.4"			
Quad Name Erie South	Quad Code	42080A1			
Wastewater Description: Sewage Effluent					
Unnamed Tributary to Elk Creek Receiving Waters (CWF, MF)	Stream Code	62616			
NHD Com ID 134205236	RMI	0.5600			
Drainage Area 0.44	Viold (cfc/mi <sup>2</sup> )	0.1			
Q <sub>7-10</sub> Flow (cfs) 0.04	Q <sub>7-10</sub> Basis	Default			
Elevation (ft) 1130	Slope (ft/ft)				
Watershed No. 15-A	Chapter 02 Class	CWF, MF			
Existing Use	Evicting Llos Qualifier				
Exceptions to Use	Exceptions to Criteria				
Assessment Status Attaining Use(s)					
Cause(s) of Impairment					
Source(s) of Impairment					
TMDL Status	Name				
Background/Ambient Data	Data Source				
pH (SU) 7.0	Default				
Temperature (°C) 20	Default				
Hardness (mg/L) 100	Default				
Other:					
Nearest Downstream Public Water Supply Intake	Erie Water Works				
PWS Waters Lake Erie (Chestnut and West)	Flow at Intake (cfs)	N/A			
PWS RMI <u>N/A</u>	Distance from Outfall (mi)	25.4			

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on September 13, 2021).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Norweco Singulair unit. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Norweco Singulair unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

## **Proposed Effluent Limitations and Monitoring Requirements**


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

## Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations				Monitoring Requirements			
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)			Minimum <sup>(2)</sup>	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	xxx	XXX	XXX	XXX	1/year	Estimate
рН (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	xxx	10.0	xxx	20	1/year	Grab
TSS	xxx	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are BPJ-technology-based on the Department's "Small Flow Treatment Facilities Manual". The limits for pH are technology-based on Chapter 93.7.

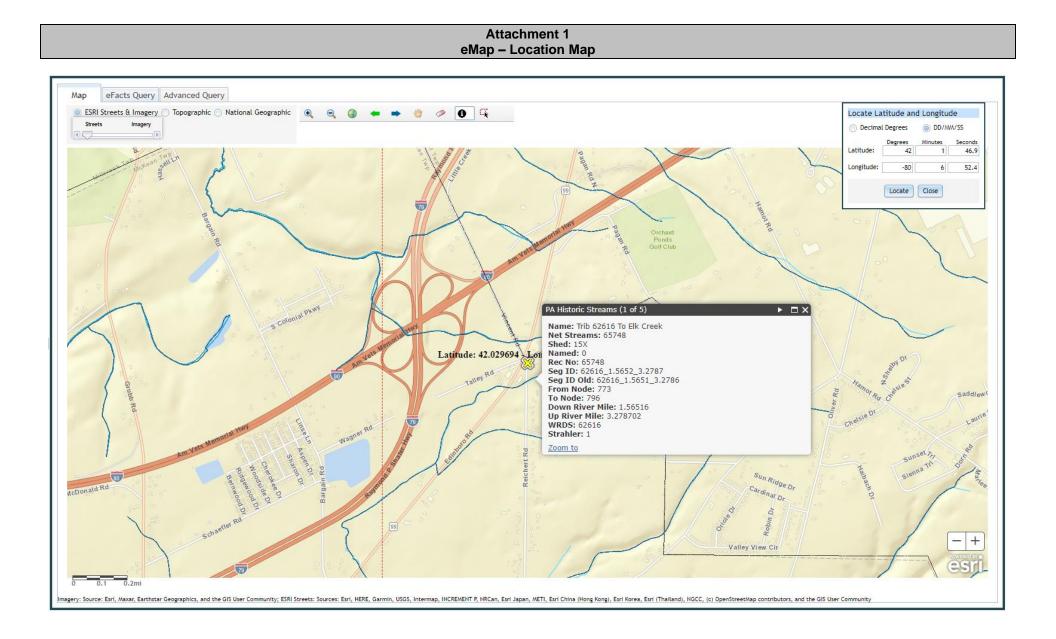

# Attachment 2 Google Earth Imagery

