

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0290882

APS ID 1065880

Authorization ID 1400432

Applicant Name	Kathy	& Thomas Waskiewicz	Facility Name	Kathy & Thomas Waskiewicz SRSTP		
Applicant Address	7100	Old Meadville Road	Facility Address	7100 Old Meadville Road		
	Union	City, PA 16438-5844		Union City, PA 16438-5844		
Applicant Contact	Thoma	as Waskiewicz	Facility Contact			
Applicant Phone	(315)	404-1026	Facility Phone			
Client ID	370699		Site ID	855636		
SIC Code	8800		Municipality	Le Boeuf Township		
SIC Description	Private	e Households	County	Erie		
Date Application Rece	eived	June 17, 2022	WQM Required	Yes		
Date Application Accepted		July 1, 2022	WQM App. No.	2522419		

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522419): An existing septic tank with Polylok A-100 effluent filter on tank outlet followed by a Premier Tech EC7-500-P-P-USA Coco Filter unit with integrated UV unit and pump preinstalled.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (370699) as of 8/16/2022.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	August 16, 2022
Х		Adam J. Pesek (Lead Reviewer) Vacant / Environmental Engineer Manager	August 17, 2022

scharge, Receiving	g Waters and Water Su	<i>i</i> Information			
Outfall No. 001		Design Flow (MGD)	0.0004		
Latitude 41° 5	1' 50.97"	Longitude	-79º 53' 35.96"		
Quad Name Mil	lers Station	Quad Code	41079G8		
Wastewater Descrip	otion: Sewage Efflue				
Receiving Waters	Unnamed Tributary to Branch French Creek	th Stream Code	53631		
NHD Com ID	127351021	RMI	0.3700		
Drainage Area	0.13	Yield (cfs/mi²)			
Q ₇₋₁₀ Flow (cfs)	0	Q ₇₋₁₀ Basis	Dry Stream		
Elevation (ft)	1595	Slope (ft/ft)			
Watershed No.	16-A	Chapter 93 Class.	WWF		
Existing Use		Existing Use Qualifier			
Exceptions to Use		Exceptions to Criteria			
Assessment Status	Attaining Use(
Cause(s) of Impairr	ment				
Source(s) of Impair	ment				
TMDL Status		Name			
Background/Ambie	nt Data	Data Source			
pH (SU) 7.0		Default	Default		
Temperature (°C) 25		Default (WWF)	Default (WWF)		
Hardness (mg/L) 100 Other:		Default	Default		
Nearest Downstrea	m Public Water Supply	e <u>Cambridge Springs Borough</u>			
PWS WatersF	French Creek	Flow at Intake (cfs)	51.45		
PWS RMI 48.35		Distance from Outfall (mi)	>25		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on May 11, 2022).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum (2)	Required	
Farameter	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

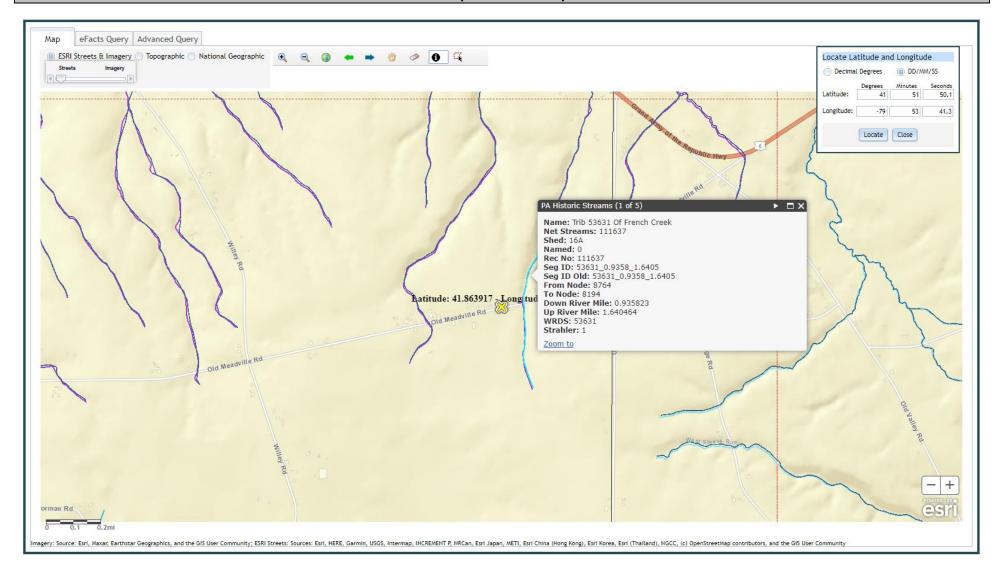

Attachment 2 Google Earth Imagery

