

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0291200

 APS ID
 1070171

 Authorization ID
 1407906

Applicant, Facility and Project Information

| Applicant Name | Albert & Miriam Youschak | Facility Name | Albert & Miriam Youschak SRSTP | | |
|------------------------|----------------------------|--------------------------|--------------------------------|--|--|
| Applicant Address | 9370 Miller Road | Facility Address | 9370 Miller Road | | |
| | Cranesville, PA 16410-9601 | | Cranesville, PA 16410-9601 | | |
| Applicant Contact | Albert Youschak | Facility Contact | | | |
| Applicant Phone | (814) 969-3090 | Facility Phone | | | |
| Client ID | 372085 | Site ID Municipality | 857070 Elk Creek Township | | |
| SIC Code | 8800 | | | | |
| SIC Description | Private Households | County | Erie | | |
| Date Application Recei | vedAugust 24, 2022 | WQM Required | Yes | | |
| Date Application Accep | ted September 7, 2022 | WQM App. No. | 2522432 | | |
| Project Description | Single Residence Sewage | Freatment Plant (SRSTP). | | | |

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522432): An existing minimum 1000-gallon dual chambered concrete septic tank with a Polylok 8" Model A-100 effluent filter, followed by a Premier Tech EC7-500-P-GDV-USA Coco Filter unit, followed by a Norweco AT 1500 ultraviolet (UV) disinfection unit, then to a minimum 300-gallon pump tank before discharge.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (372085) as of 10/20/2022.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

| Approve | Deny | Signatures | Date | |
|---------|------|---|------------------|--|
| х | | Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager | October 20, 2022 | |
| х | | Adam J. Pesek (Lead Reviewer) for Vacant / Environmental Program Manager | October 21, 2022 | |

| Discharge, Receiving Waters and Water Supply Information | | | | | |
|--|-----------------------------|------------------------------|--------------|--|--|
| | | | | | |
| Outfall No. 001 | | Design Flow (MGD) | 0.0004 | | |
| Latitude 41° 55' 4.2" | | Longitude | 80° 19' 1.3" | | |
| Quad Name Albion | | Quad Code | 41080H3 | | |
| Wastewater Description: | Sewage Effluent | | | | |
| | | | | | |
| | ed Tributary to East Branch | | 00440 | | |
| • | ut Creek (CWF, MF) | Stream Code | 63440 | | |
| NHD Com ID 1239190 | 693 | RMI | 0.9700 | | |
| Drainage Area 0.17 | | Yield (cfs/mi ²) | 0.1 | | |
| Q ₇₋₁₀ Flow (cfs) 0.017 | | Q ₇₋₁₀ Basis | Default | | |
| Elevation (ft) 1058 | | Slope (ft/ft) | | | |
| Watershed No. <u>15-A</u> | | | CWF, MF | | |
| Existing Use | | Existing Use Qualifier | | | |
| Exceptions to Use | | Exceptions to Criteria | | | |
| Assessment Status | Attaining Use(s) | | | | |
| Cause(s) of Impairment | | | | | |
| Source(s) of Impairment | | | | | |
| TMDL Status | | Name | | | |
| | | | | | |
| Background/Ambient Data | | Data Source | | | |
| pH (SU) | 7.0 | Default | | | |
| Temperature (°F) _20 | | Default | | | |
| Hardness (mg/L) | | Default | | | |
| Other: | | | | | |
| | | | | | |
| Nearest Downstream Public Water Supply Intake | | Ohio State Line | | | |
| PWS Waters Conneaut Creek | | Flow at Intake (cfs) | N/A | | |
| PWS RMI N/A | | Distance from Outfall (mi) | 20.2 | | |

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on July 15, 2022).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

| Parameter | Effluent Limitations | | | | Monitoring Requirements | | | |
|-----------------------------|-------------------------------------|-------------------|-----------------|-----------------------|-------------------------|---------------------|--------------------------|----------------|
| | Mass Units (Ibs/day) ⁽¹⁾ | | | Concentrations (mg/L) | | | Minimum ⁽²⁾ | Required |
| | Average Monthly | Average Weekly | Minimum | Annual Average | Maximum | Instant. Maximum | Measurement Frequency | Sample Type |
| Flow (GPD) | Report Annl Avg | XXX | XXX | xxx | XXX | XXX | 1/year | Estimate |
| pH (S.U.) | XXX | XXX | 6.0 Inst Min | XXX | XXX | 9.0 | Upon Request | Grab |
| BOD5 | ххх | XXX | xxx | 10.0 | xxx | 20 | 1/year | Grab |
| TSS | ххх | XXX | XXX | 10.0 | xxx | 20 | 1/year | Grab |
| Fecal Coliform (No./100 ml) | ХХХ | XXX | XXX | 200 | XXX | XXX | 1/year | Grab |

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

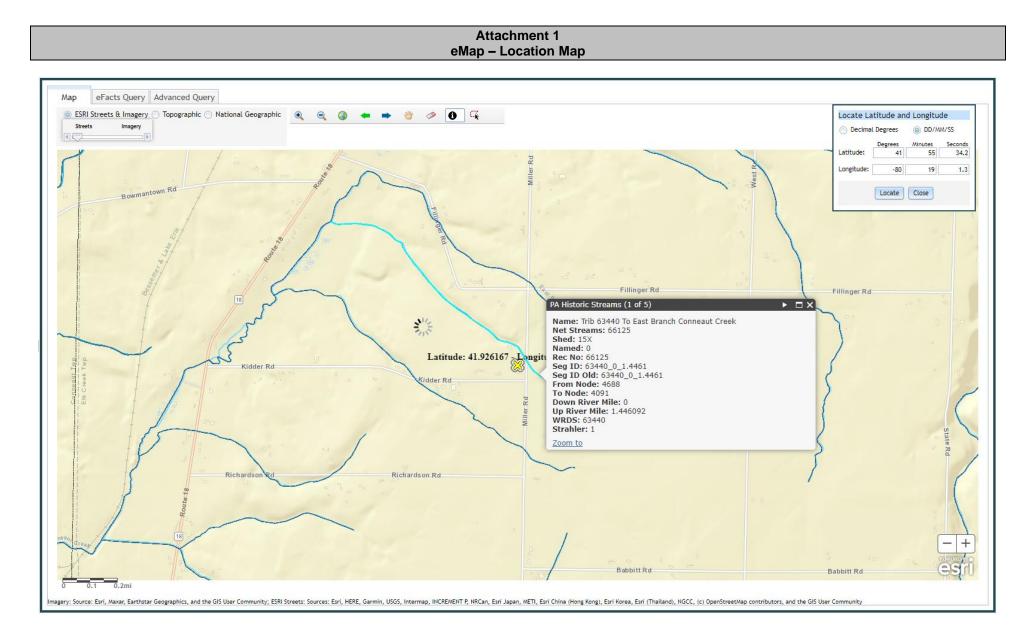

4

Attachment 2 Google Earth Imagery

