

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
Sewage
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0291382

 APS ID
 1074111

 Authorization ID
 1414882

pplicant Name	Patri	ck & Stephanie Hargest	Facility Name	Hargest SRSTP
oplicant Address	5650	Gibson Hill Road	Facility Address	5650 Gibson Hill Road
	Edinb	oro, PA 16412-1817		Edinboro, PA 16412-1817
oplicant Contact	Patric	k Hargest	Facility Contact	
pplicant Phone	(814)	397-5827	Facility Phone	
ient ID	3732	35	Site ID	858774
C Code	8800		Municipality	Washington Township
C Description	Private Households		County	Erie
Date Application Received		October 12, 2022	WQM Required	Yes
ate Application Acce	epted	October 31, 2022	WQM App. No.	2522436

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 – Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522436): A 1000-gallon dual chambered concrete septic tank with 8" Polylok Model A-100 effluent filter on the tank outlet followed by a Premier Tech EC7-500-P-P-USA Coco Filter unit with integrated UV unit and pump preinstalled.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (373235) as of 1/10/2023.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	January 10, 2023
Х		Adam J. Pesek (Lead Reviewer) for Vacant / Environmental Engineering Manager	January 12, 2023

Discharge, Receiving Waters and Water Supply Information							
Outfall No. 001	Design Flow (MGD)0004						
Latitude 41° 51' 26.70"	Longitude80° 9' 40.71"						
Quad Name Edinboro South	Quad Code 41080G2						
Wastewater Description: Sewage Effluent							
Unnamed Tributary of C	Conneauttee						
Receiving Waters Creek (WWF)	Stream Code 53054						
NHD Com ID 127348144	RMI 1.4200						
Drainage Area 0.12	Yield (cfs/mi²) 0.001						
Q ₇₋₁₀ Flow (cfs) 0	Q ₇₋₁₀ Basis Dry Swale						
Elevation (ft) 1481	Slope (ft/ft)						
Watershed No. 16-A	Chapter 93 Class. WWF						
Existing Use	Existing Use Qualifier						
Exceptions to Use	Exceptions to Criteria						
Assessment Status Attaining Use(s)							
Cause(s) of Impairment							
Source(s) of Impairment							
TMDL Status	Name						
Background/Ambient Data	Data Source						
pH (SU) 7.0	Default						
Temperature (°C) 25	Default (WWF)						
Hardness (mg/L) 100	Default						
Other:							
Nearest Downstream Public Water Supply In	take Aqua Pennsylvania, Inc Emlenton						
PWS Waters Allegheny River	Flow at Intake (cfs) 1376						
PWS RMI 90.0	Distance from Outfall (mi) >25						

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on September 20, 2022).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations						Monitoring Requirements	
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)				Minimum (2)	Required
Farameter	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: <u>Outfall 001, after disinfection</u>

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location Map

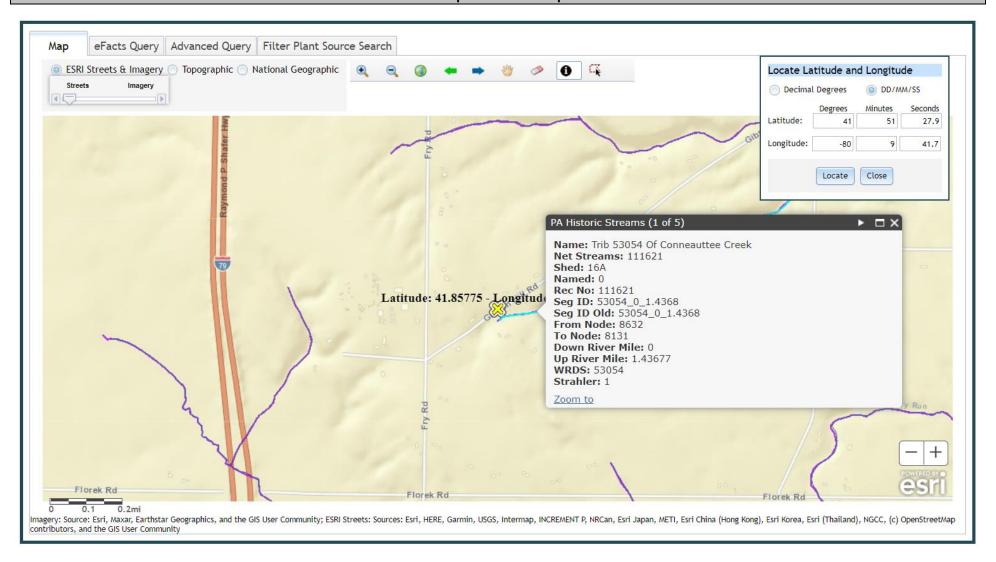

Attachment 2 Google Earth Imagery

