

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.PA0292711APS ID1077333Authorization ID1420459

Applicant, Facility and Project Information

Applicant Name	Michae	l Burrows	Facility Name	Michael Burrows SRSTP
Applicant Address	2929 H	ershey Road	Facility Address	7592 Edinboro Road
	Erie, PA	A 16506-5003		Erie, PA 16509-4457
Applicant Contact	Michae	Burrows	Facility Contact	
Applicant Phone	(814) 8	73-6694	Facility Phone	
Applicant Email	clue000	00@yahoo.com		
Client ID	374147		Site ID	859536
SIC Code	8800		Municipality	Summit Township
SIC Description	Private	Households	County	Erie
Date Application Receiv	ved	December 12, 2022	WQM Required	Yes
Date Application Accept	oted	December 15, 2022	WQM App. No.	2522441
Project Description		Single Residence Sewage Tre	eatment Plant	

Summary of Review

Construction of a SFTF to repair an existing malfunctioning on-lot system serving 3 bedrooms single family residence.

The proposed SFTF will consist of (WQM Permit No. 2522441): A Norweco singular 960-500 GPD Aerobic tank and equipment followed by a Norweco hydro-kinetic bio-film reactor, a Norweco AT1500 ultraviolet disinfection unit and outfall pipe.

Act 14 - Proof of Notification was submitted and received.

SPECTIAL CONDITIONS: NONE

The EPA waiver is in effect.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
х		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer Trainee	December 15, 2022
х		Adam J. Pesek (Lead Reviewer) for <i>Vacant /</i> Environmental Engineer Manager	December 20, 2022

Discharge, Receiving	g Waters and Water Supply Inform	mation	
Quad Name Eri	2' 37.60" ie South	Design Flow (MGD) Longitude Quad Code	0.0004 -80° 6' 38.90" 42080A1
Wastewater Descrip	ption: Sewage Effluent		
Receiving Waters NHD Com ID	Unnamed Tributary of Walnut Creek (CWF, MF) 123922883	Stream Code RMI	<u>62450</u> 0.63
Drainage Area	0.55 square miles	Yield (cfs/mi ²)	0.1
Q ₇₋₁₀ Flow (cfs) Elevation (ft)	<u>0.055</u> 1077	Q ₇₋₁₀ Basis	Default
Watershed No.	15-A	Slope (ft/ft) Chapter 93 Class.	 CWF, MF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Attaining Use(s)		
Cause(s) of Impairr	_		
Source(s) of Impair			
TMDL Status		Name	
Background/Ambie	nt Data	Data Source	
pH (SU)	7.0	Default	
Temperature (°C)	_20	Default	
Hardness (mg/L)	100	Default	
Other:			
Nearest Downstrea	m Public Water Supply Intake	PA – Canadian International E	oundary in Lake Erie
PWS Waters	Lake Erie	Flow at Intake (cfs)	
PWS RMI		Distance from Outfall (mi)	12.69 (approximately to Lake Erie)

Changes Since Last Permit Issuance: N/A-This is a proposed discharge (Planning was approved on November 15, 2022)

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit.

The treatment system is reportedly capable of meeting CBOD5 averages of 10 mg/L and TSS averages of 10 mg/L.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

			Effluent L	imitations			Monitoring Red	quirements
Parameter	Mass Units	(lbs/day) ⁽¹⁾		Concentrat	tions (mg/L)		Minimum ⁽²⁾	Required
i aidinetei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Sa	Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	xxx	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	xxx	10.0	xxx	20	1/year	Grab
TSS	XXX	XXX	xxx	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	XXX	xxx	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV Disinfection.


Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliform are BPJ-technology-based on the Department's "Small Flow Treatment Facilities Manual." The limits for pH are technology-based on Chapter 93.7.

Outfall Location - eMap with Aerial Imagery

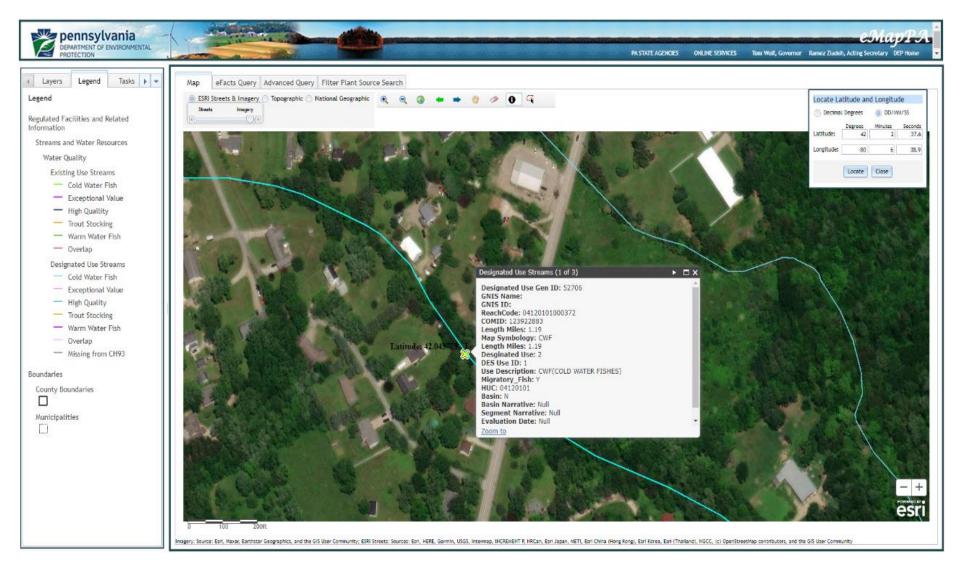

Drainage Area Location – StreamStats with Aerial Imagery

StreamStats Report

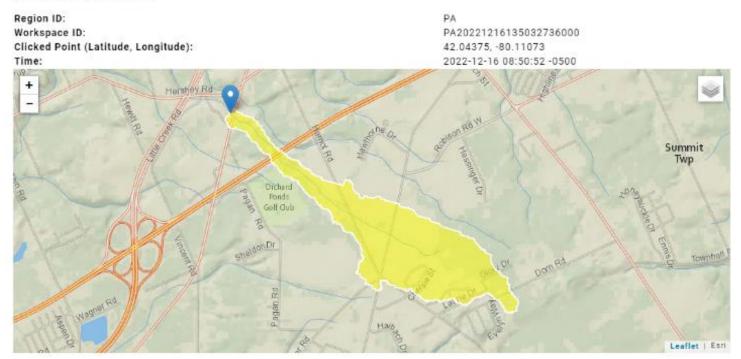

Collapse All

Basin Characteristics			
Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	0.55	square miles