

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0292800

 APS ID
 1078441

 Authorization ID
 1422459

# Applicant, Facility and Project Information

Applicant Name	Rex Schlindwein	Facility Name	Rex Schlindwein SRSTP	
Applicant Address	7759 Old State Road	Facility Address	3691 Crane Road	
	Cranesville, PA 16410-2105		Edinboro, PA 16412-1643	
Applicant Contact	Doris Griffin	Facility Contact	Doris Griffin	
Applicant Phone	(814) 625-1339	Facility Phone	(814) 625-1339	
Client ID	374492	Site ID	858772	
SIC Code	8800	Municipality County	Washington Township	
SIC Description	Private Households		Erie	
Date Application Receiv	ved December 22, 2022	WQM Required	Yes	
Date Application Accepted		WQM App. No.	2522444	
Project Description	Single Residence Sewage Treatme	ent Plant		

### **Summary of Review**

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 2522444): A Norweco Singulair 960-500 unit followed by a Norweco Hydro-Kinetic Biofilm Reactor, then to a Norweco AT1500 ultraviolet (UV) disinfection unit, followed by a 300-gallon pump tank with Liberty Model 280 0.5HP pump.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (374492) as of 2/21/2023.

#### **Public Participation**

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	February 21, 2023		
х		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	March 3, 2023		

# Discharge and Stream Data - 2 - Receiving Waters and PWS

## Discharge, Receiving Waters and Water Supply Information

Outfall No. 001		Design Flow (MGD)	.0004 -80º 5' 55.54"	
Latitude 41° 5	4' 3.46"	Longitude		
Quad Name Ca	mbridge Springs	Quad Code	41080H1	
Wastewater Descrip	otion: Sewage Effluent			
	Unnamed Tributary of Conneaut	ee		
Receiving Waters	Creek (WWF)	Stream Code	53078	
NHD Com ID	127345015	RMI	0.4600	
Drainage Area	0.17	Yield (cfs/mi <sup>2</sup> )		
Q <sub>7-10</sub> Flow (cfs)	0.017	Q <sub>7-10</sub> Basis	Default	
Elevation (ft)	1499	Slope (ft/ft)		
Watershed No.	16-A	Chapter 93 Class.	WWF	
Existing Use		Existing Use Qualifier		
Exceptions to Use		Exceptions to Criteria		
Assessment Status	Attaining Use(s)			
Cause(s) of Impairr	nent			
Source(s) of Impair	ment			
TMDL Status		Name		
Background/Ambie	nt Data	Data Source		
pH (SU) 7.0		Default		
Temperature (°F) 25		Default		
Hardness (mg/L) 100		Default		
Other:				
Nearest Downstrea	m Public Water Supply Intake	Aqua Pennsylvania, Inc Em	lenton	
PWS Waters Allegheny River		Flow at Intake (cfs)	1376	
PWS RMI 90.0		Distance from Outfall (mi)	>25	

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on September 29, 2022).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Norweco Singulair. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Norweco Singulair unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

## Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

## Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations				Monitoring Requirements			
	Mass Units (Ibs/day) <sup>(1)</sup>		Concentrations (mg/L)			Minimum <sup>(2)</sup>	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	XXX	xxx	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	ххх	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	ХХХ	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub> and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

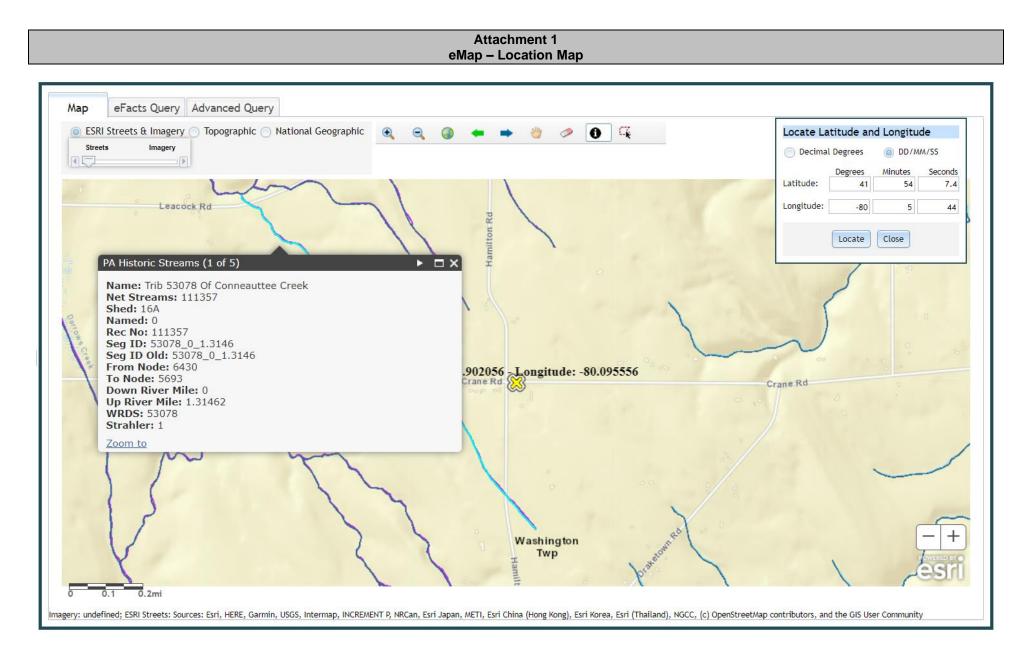

# Attachment 2 Google Earth Imagery

