

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.	PA0292958
APS ID	1081877
Authorization ID	1428534

### Applicant, Facility and Project Information

Applicant Name	Michael Brandon	Facility Name	Michael Brandon SRSTP		
Applicant Address	185 Leslie Road	Facility Address	185 Leslie Road		
	Valencia, PA 16059-1127		Valencia, PA 16059-1127		
Applicant Contact	Michael Brandon	Facility Contact			
Applicant Phone	(724) 816-6798	Facility Phone			
Client ID	375535	Site ID	861441		
SIC Code	8800	Municipality	Middlesex Township		
SIC Description	Private Households	County	Butler		
Date Application Recei	ved February 6, 2023	WQM Required	Yes		
Date Application Accep	ted	WQM App. No.	1023405		
Project Description	Single Residence Sewage	Treatment Plant (SRSTP) for a	n existing dwelling.		

# Summary of Review

This is a new discharge for an existing 4-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1023405): A Premier Tech EC7-500-P-PACK coco filter unit with integrated septic tank and DiUV ultraviolet (UV) disinfection unit.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (375535) as of 4/14/2023. 4/17/2023 CWY

Called applicant to verify email address and get permission to transmit draft permit documents via email on 4/14/2023.

### Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	April 14, 2023
х		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	4/17/2023

# Discharge and Stream Data - 2 - Receiving Waters and PWS

### Discharge, Receiving Waters and Water Supply Information

Outfall No. <u>001</u> Latitude 40º 41' 20.33	<u>}</u> "	Design Flow (MGD) Longitude	.0005 -79º 55' 23.82" 40079F8		
Quad Name Valencia	)	Quad Code			
Wastewater Description:	Sewage Effluent		40079F6		
Unna	med Tributary to Glade Rur	า			
Receiving Waters (WWF	-)	Stream Code	63690		
NHD Com ID 12622	22511	RMI	0.1600		
Drainage Area 0.27		Yield (cfs/mi <sup>2</sup> )	0.1		
Q <sub>7-10</sub> Flow (cfs) 0.027		Q <sub>7-10</sub> Basis	Default		
Elevation (ft) 1153		Slope (ft/ft)			
Watershed No. 20-C		Chapter 93 Class.	WWF		
Existing Use		Existing Use Qualifier			
Exceptions to Use		Exceptions to Criteria			
Assessment Status	Impaired				
Cause(s) of Impairment	NUTRIENTS, NUTRIENT	S, SILTATION, SILTATION			
Source(s) of Impairment	AGRICULTURE, AGRICU	ULTURE, AGRICULTURE, AGRICULTURE			
TMDL Status		Name			
Background/Ambient Data		Data Source			
pH (SU)	7.0	Default			
Temperature (°F)	25	Default			
Hardness (mg/L)	100	Default			
Other:					
Nearest Downstream Publi	c Water Supply Intake	Beaver Falls Municipal Author	rity		
PWS Waters Beaver	River	Flow at Intake (cfs)	561		
PWS RMI 3.5		Distance from Outfall (mi)	>25		

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on February 6, 2023).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

# Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

# Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup>	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	xxx	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	xxx	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	xxx	200	xxx	xxx	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

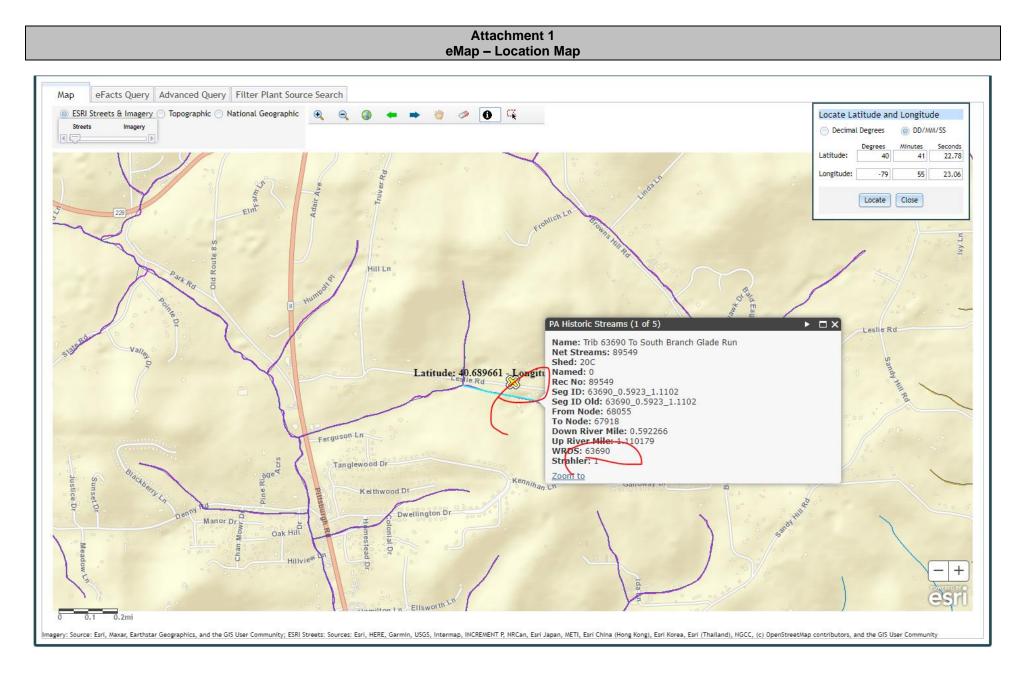

# Attachment 2 Google Earth Imagery

