

| Application Type | New |
|------------------|--------|
| Wastewater Type | Sewage |
| Facility Type | SRSTP |

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

| Application No. | PA0293121 |
|------------------|-----------|
| APS ID | 1086347 |
| Authorization ID | 1435893 |

Applicant, Facility and Project Information

| Applicant Name | James Strausser | Facility Name | James Strausser SRSTP |
|-------------------------|----------------------------------|------------------|---------------------------|
| Applicant Address | 24 Bentley Avenue | Facility Address | 40 Baker Road |
| | Greenville, PA 16125-1847 | | Greenville, PA 16125-9602 |
| Applicant Contact | James Strausser | Facility Contact | |
| Applicant Phone | | Facility Phone | |
| Client ID | 376687 | Site ID | 862095 |
| SIC Code | 8800 | Municipality | Otter Creek Township |
| SIC Description | Private Households | County | Mercer |
| Date Application Receiv | vedMarch 31, 2023 | WQM Required | Yes |
| Date Application Accep | ted | WQM App. No. | 4323409 |
| | | | |
| Project Description | Single Residence Sewage Treatmen | t Plant (SRSTP). | |

Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 4323409): A Norweco Singulair Bio-Kinetic Model 960-500/600 GPD unit with a Norweco Singulair Hydro-Kinetic Bio-Film reactor, an integrated AT 1500 UV disinfection unit and pump preinstalled.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (376687) as of 7/17/2023. 7/24/2023 CWY

PNDI updated search to prove compliance with the Long-Eared Bat habitat protections received 6/30/2023.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

| Approve | Deny | Signatures | Date | | |
|---------|------|---|---------------|--|--|
| х | | Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager | July 17, 2023 | | |
| х | | Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager | 7/24/2023 | | |

Discharge and Stream Data - 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

| Outfall No. 001 | Design Flow (MGD) | .0004 -80° 18' 22.41" 41080D3 | | |
|---|-------------------------------|-------------------------------------|--|--|
| Latitude41º 23' 44.84" | Longitude | | | |
| Quad Name Greenville East | Quad Code | | | |
| Wastewater Description: Sewage Effluent | | | | |
| Unnamed Tributary of Little | | | | |
| Receiving Waters <u>Shenango River (TSF)</u> | Stream Code | 36253 | | |
| NHD Com ID 130027156 | RMI | 1.4500 | | |
| Drainage Area 0.25 | Yield (cfs/mi ²) | 0.1 | | |
| Q ₇₋₁₀ Flow (cfs) Default | Q ₇₋₁₀ Basis | Default | | |
| Elevation (ft) 1215 | Slope (ft/ft) | | | |
| Watershed No. 20-A | Chapter 93 Class. | TSF | | |
| Existing Use | Existing Use Qualifier | | | |
| Exceptions to Use | Exceptions to Criteria | | | |
| Assessment Status Attaining Use(s) | | | | |
| Cause(s) of Impairment | | | | |
| Source(s) of Impairment | | | | |
| TMDL Status | Name | | | |
| Background/Ambient Data | Data Source | | | |
| pH (SU) 7.0 | Default | | | |
| Temperature (°F) 25 | Default | | | |
| Hardness (mg/L) 100 | Default | | | |
| Other: | | | | |
| Nearest Downstream Public Water Supply Intake | Greenville Municipal Water Au | uthority | | |
| PWS Waters Shenango River | Flow at Intake (cfs) | 10.6 | | |
| PWS RMI 8.0 | Distance from Outfall (mi) | 11.5 | | |

Changes Since Last Permit Issuance: N/A - This is a proposed discharge (Planning was approved on March 16, 2023).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Norweco unit. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Norweco unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

| | Effluent Limitations | | | | Monitoring Requirements | | | |
|-----------------------------|-------------------------------------|-------------------|-----------------|-----------------------|-------------------------|---------------------|--------------------------|----------------|
| Parameter | Mass Units (Ibs/day) ⁽¹⁾ | | | Concentrations (mg/L) | | | Minimum ⁽²⁾ | Required |
| raiallieter | Average Monthly | Average Weekly | Minimum | Annual Average | Maximum | Instant. Maximum | Measurement Frequency | Sample Type |
| Flow (GPD) | Report Annl Avg | xxx | xxx | xxx | XXX | XXX | 1/year | Estimate |
| pH (S.U.) | XXX | XXX | 6.0 Inst Min | XXX | XXX | 9.0 | Upon Request | Grab |
| BOD5 | ххх | XXX | xxx | 10.0 | xxx | 20 | 1/year | Grab |
| TSS | ххх | xxx | xxx | 10.0 | xxx | 20 | 1/year | Grab |
| Fecal Coliform (No./100 ml) | ххх | XXX | XXX | 200 | XXX | ххх | 1/year | Grab |

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

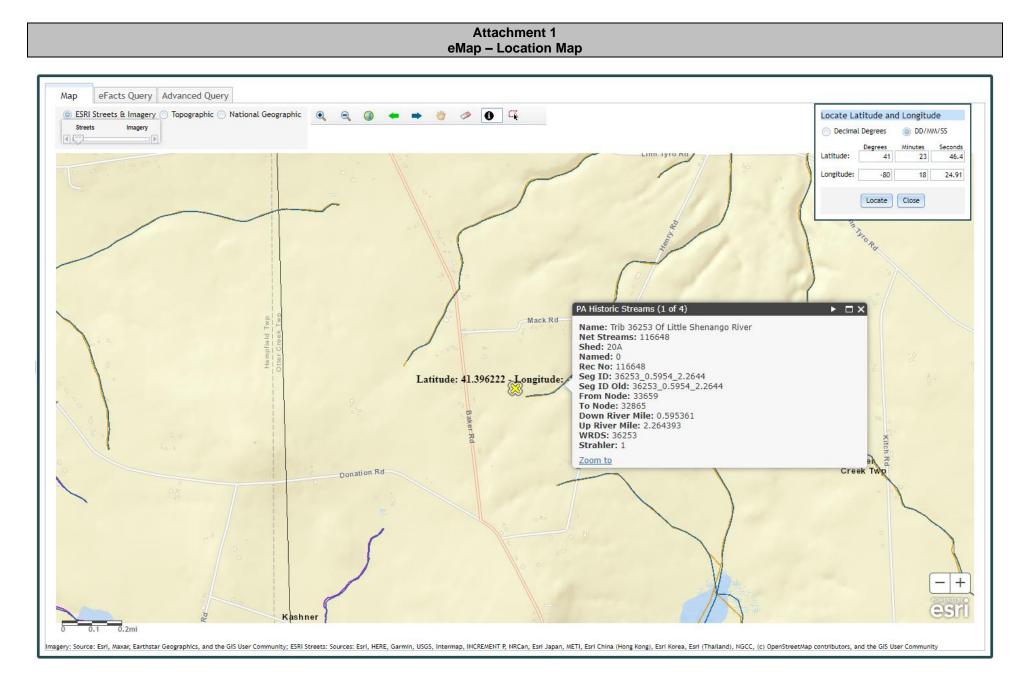

Attachment 2 Google Earth Imagery

