

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.	PA0295205
APS ID	1093198
Authorization ID	1447994

Applicant, Facility and Project Information

Applicant Name	Kenneth Conrad	Facility Name	Kenneth Conrad SRSTP		
Applicant Address	136 Wiegand Drive	Facility Address	136 Wiegand Drive		
	Cranberry Township, PA 16066-3008	-	Cranberry Township, PA 16066-3008		
Applicant Contact	Kenneth Conrad	Facility Contact			
Applicant Phone	(724) 624-8012	Facility Phone			
Client ID	378723	Site ID	864797		
SIC Code	8800	Municipality	Cranberry Township		
SIC Description	Private Households	County	Butler		
Date Application Recei	vedJune 27, 2023	WQM Required	Yes – Application Received		
Date Application Accept	oted	WQM App. No.	1023411		
Project Description	This is a new application for an Inc Plant (SRSTP) for an existing 8-be		or a Single Residence Sewage Treatment		

Summary of Review

This is a new discharge which will serve an existing 8-bedroom home to replace an existing malfunctioning on-lot sewage disposal system.

Act 14 - Notification was submitted and received.

Treatment of this facility will consist of (WQM Permit No. 1023411); Sewage will flow to two, 1,000-gallon concrete septic tanks with an effluent filter and alarm at the outlet end of the second tank, then through an NSF approved Premier Tech EC7-1050-P-P Coco filter then into a Premier Rewatec UV disinfection chamber.

There are no open violations in WMS for the subject Client ID (378723) as of 8/2/2023. 8/7/2023 CWY

EPA Waiver is in effect.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Dustin Hargenrater Dustin Hargenrater / Civil Engineer Trainee	August 2, 2023		
х		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	8/7/2023		

Discharge and Stream Data - 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

Outfall No. 001	Design Flow (MGD)	.0009 -80° 6' 44.73" 40080F1		
Latitude 40° 43' 12.01"	Longitude			
Quad Name Mars	Quad Code			
Wastewater Description: Sewage Effluent				
Unnamed Tributary to Brush Cree	ek			
Receiving Waters (WWF)	Stream Code	34833		
NHD Com ID <u>126220312</u>	RMI	0.1100		
Drainage Area 0.0682	Yield (cfs/mi ²)	0.00425		
Q ₇₋₁₀ Flow (cfs)0.00029	Q ₇₋₁₀ Basis	USGS – StreamStats		
Elevation (ft)1150	Slope (ft/ft)			
Watershed No. 20-C	Chapter 93 Class.	WWF		
Existing Use	Existing Use Qualifier			
Exceptions to Use	Exceptions to Criteria			
Assessment Status Attaining Use(s)				
Cause(s) of Impairment				
Source(s) of Impairment				
TMDL Status	Name			
Background/Ambient Data	Data Source			
pH (SU) 7.0	Default			
Temperature (°F) 75	Default - WWF			
Hardness (mg/L)				
Other:				
Nearest Downstream Public Water Supply Intake	Beaver Falls Municipal Author	rity		
PWS Waters Beaver River	Flow at Intake (cfs)	561		
PWS RMI 3.5	Distance from Outfall (mi)	33		

Changes Since Last Permit Issuance: N/A - This is a new discharge (Planning was approved on June 27, 2023)

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco filter.

The Coco filter is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	xxx	XXX	xxx	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	ххх	XXX	XXX	10.0	xxx	20	1/year	Grab
TSS	ххх	xxx	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	XXX	ххх	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.



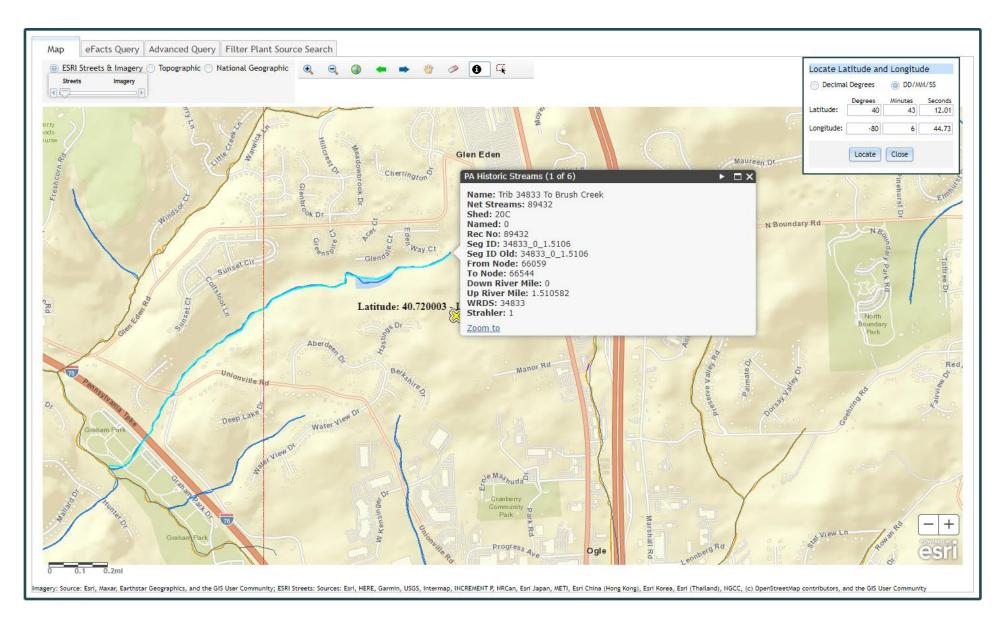

Attachment 2 Google Earth – Site Imagery

