

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.	PA0295299			
APS ID	1095701			
Authorization ID	1452360			

Applicant, Facility and Project Information

Applicant Name	Corey & Katelyn Morris	Facility Name	Corey & Katelyn Morris SRSTP		
Applicant Address	10520 Greenlee Road	Facility Address	10520 Greenlee Road		
	Waterford, PA 16441-8732		Waterford, PA 16441-8732		
Applicant Contact	Katelyn Morris	Facility Contact			
Applicant Phone	(914) 413-8428	Facility Phone			
Client ID	379548	Site ID	860375		
SIC Code	8800	Municipality	McKean Township		
SIC Description	IC Description Private Households		Erie		
Date Application Rece	ived August 10, 2023	WQM Required	Yes – Application Received		
Date Application Acce	pted	WQM App. No.	2523424		
Project Description	This is a new application existing dwelling.	for a Single Residence Sewage	Treatment Plant (SRSTP) which will serve an		

Summary of Review

This is a new discharge which will serve an existing 3-bedroom home and replace an existing malfunctioning on-lot disposal system.

Act 14 - Notification was submitted and received.

Treatment of this facility will consist of (WQM Permit No. 2523424): A 1,000-gallon dual-compartment septic tank, Ecoflo Coco Filter EC7-500-P-P-USA, treatment tank with integrated Rewatec Ultraviolet Disinfection Unit, and an effluent pump tank.

There are no open violation in WMS for the subject Client ID (379548) as of 9/8/2023. 10/2/2023 CWY

EPA Waiver is in effect.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Dustin Hargenrater Dustin Hargenrater / Civil Engineer Trainee	September 8, 2023		
х		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	10/2/2023		

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

Outfall No. 001		Design Flow (MGD)	.0004 -80° 2' 50.3" 41080H1		
	9' 1.9"	Longitude			
Quad Name Car	mbridge Springs	Quad Code			
Wastewater Descrip	otion: Sewage Effluent				
Receiving Waters	Elk Creek (WWF, MF)	Stream Code	62491		
NHD Com ID	123920417	RMI	0.2400		
Drainage Area	3.74 mi ²	Yield (cfs/mi ²)	0.0457		
Q ₇₋₁₀ Flow (cfs)	0.171	Q ₇₋₁₀ Basis	USGS - StreamStats		
Elevation (ft)	1,221	Slope (ft/ft)			
Watershed No.	15-A	Chapter 93 Class.			
Existing Use		Existing Use Qualifier			
Exceptions to Use		Exceptions to Criteria			
Assessment Status	Attaining Use(s)				
Cause(s) of Impairn	nent				
Source(s) of Impair	ment				
TMDL Status		Name			
Background/Ambier	nt Data	Data Source			
pH (SU)	7.0	Default			
Temperature (°F)	75	Default - WWF			
Hardness (mg/L)					
Other:					
Nearest Downstrea	m Public Water Supply Intake	Lake Erie			
PWS Waters L	_ake Erie	Flow at Intake (cfs)			
PWS RMI -	-	Distance from Outfall (mi)	28.7		

Changes Since Last Permit Issuance: N/A – This is a new discharge (Planning was approved on 12/19/2022) -An updated PNDI will be requested from the consultant.

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of the Coco Filter system.

The Coco filter is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	XXX	xxx	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	ххх	xxx	xxx	10.0	xxx	20	1/year	Grab
TSS	ххх	xxx	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	XXX	ххх	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location and Receiving Stream Data

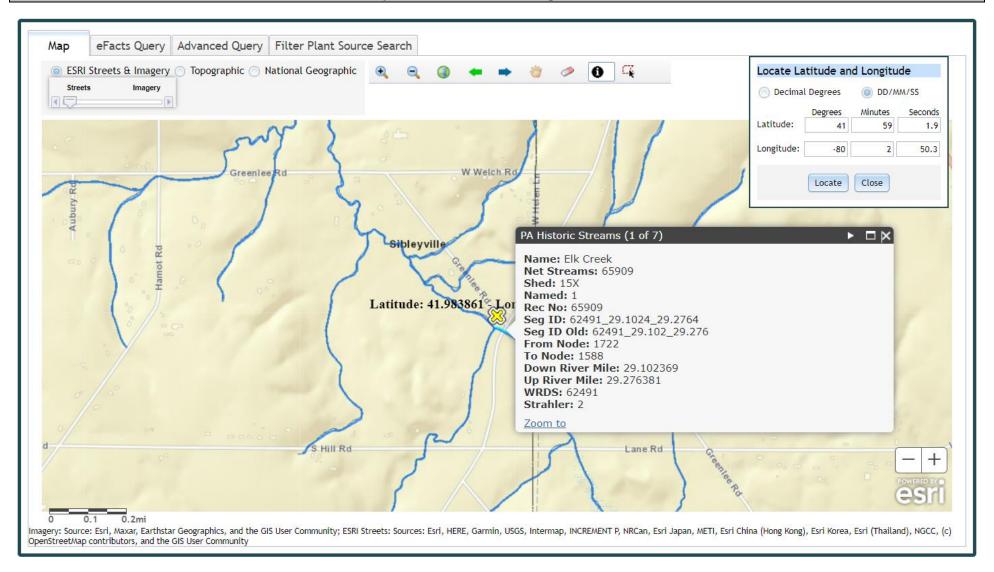

Attachment 2 Google Earth – Site Imagery

