

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

PA0295329
1096350
1453952

Applicant, Facility and Project Information

Applicant Name	David & Heather	Defazio	Facility Name	David & Heather Defazio SRSTP
Applicant Address	2506 Deer Run Tra	Run Trail Facility Address		2506 Deer Run Trail
	Erie, PA 16509-56	576		Erie, PA 16509-5676
Applicant Contact	David Defazio		Facility Contact	
Applicant Phone	(814) 450-7814		Facility Phone	
Client ID	379679		Site ID	862124
SIC Code	8800		Municipality	Greene Township
SIC Description	Private Household	ls	County	Erie
Date Application Rece	ived August 3	1, 2023	WQM Required	Yes – Application Received
Date Application Accepted			WQM App. No.	2523425
Project Description	This is an existing d		le Residence Sewage	Treatment Plant (SRSTP) that will serve an

Summary of Review

This is a new discharge which will serve an existing 3-bedroom home and replace an existing malfunctioning on-lot disposal system.

Act 14 - Notification was submitted and received.

Treatment of this facility will consist of (WQM Permit No. 2523425): A dual compartment septic tank, an Ecoflo Coco Filter EC7-500-P-P-USA, with an integrated Rewatec Ultraviolet Disinfection Unit.

There are no open violations in WMS for the subject Client ID (379679) as of 9/15/2023. 9/15/2023 CWY

EPA Waiver is in effect.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
х		Dustin Hargenrater Dustin Hargenrater / Civil Engineer Trainee	September 15, 2023
x		Chad W. Yurisic Chad W. Yurisic, P.E. / Environmental Engineer Manager	9/15/2023

Discharge and Stream Data - 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

Outfall No. 001	Design Flow (MGD)	.0004 -79º 59' 20.2" 42079A8		
Latitude 42° 2' 47.4"	Longitude			
Quad Name Hammett	Quad Code			
Wastewater Description: Sewage Effluent				
Unnamed Tributary of Walnut				
Receiving Waters Creek (CWF, MF)	Stream Code	63777		
NHD Com ID 123923514	RMI	0.0200		
Drainage Area 0.0369	Yield (cfs/mi ²)			
Q ₇₋₁₀ Flow (cfs) 0.00125	Q7-10 Basis	USGS - StreamStats		
Elevation (ft) 1,459	Slope (ft/ft)	 _CWF, MF		
Watershed No. 15-A	Chapter 93 Class.			
Existing Use	Existing Use Qualifier			
Exceptions to Use	Exceptions to Criteria			
Assessment Status Attaining Use(s)				
Cause(s) of Impairment				
Source(s) of Impairment				
TMDL Status	Name			
Background/Ambient Data	Data Source			
pH (SU) 7.0	Default			
Temperature (°F) 68	Default			
Hardness (mg/L)				
Other:				
Nearest Downstream Public Water Supply Intake	Lake Erie			
PWS Waters Lake Erie	Flow at Intake (cfs)			
PWS RMI	Distance from Outfall (mi)	23.2		

Changes Since Last Permit Issuance: N/A - This is a new discharge (Planning was approved on June 27, 2023)

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter.

The Coco filter is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations					Monitoring Requirements		
Parameter	Mass Units (Ibs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾	Required
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	xxx	xxx	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Daily Min	XXX	9.0 Daily Max	XXX	Upon Request	Grab
BOD5	ххх	XXX	xxx	10.0	xxx	20	1/year	Grab
TSS	xxx	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	ххх	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location and Receiving Stream Data

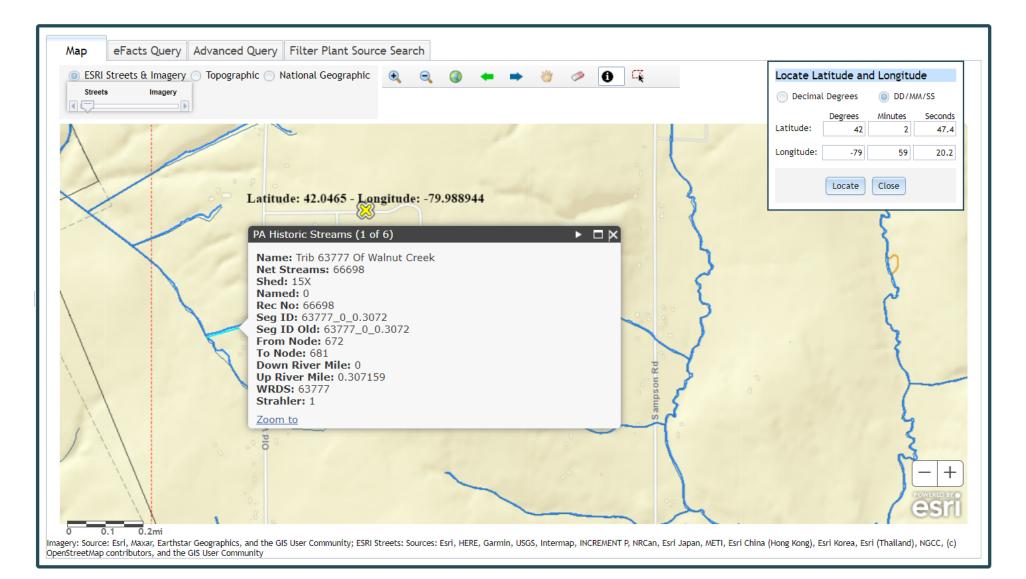

Attachment 2 Google Earth – Site Imagery

