



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
AIR QUALITY PROGRAM

STATE ONLY OPERATING PERMIT

Issue Date: August 23, 2019

Effective Date: September 1, 2019

Expiration Date: August 31, 2024

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 06-05096

Synthetic Minor

Federal Tax Id - Plant Code: 23-1352204-1

Owner Information

Name: TOWER HEALTH SYS READING HOSP

Mailing Address: PO BOX 16052  
READING, PA 19612-6052

Plant Information

Plant: TOWER HEALTH SYS/READING HOSP

Location: 06 Berks County 06812 West Reading Borough

SIC Code: 8062 Services - General Medical And Surgical Hospitals

Responsible Official

Name: MARK MCNASH

Title: EXECUTIVE V.P. SERVICES

Phone: (484) 628 - 9198

Permit Contact Person

Name: DAVID WOLFSKILL

Title: DIRECTOR FACILITIES MGMT.

Phone: (484) 628 - 8447

[Signature] \_\_\_\_\_

WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



## SECTION A. Table of Contents

### Section A. Facility/Source Identification

Table of Contents  
Site Inventory List

### Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.

### Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

### Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

### Section E. Source Group Restrictions

- E-I: Restrictions
- E-II: Testing Requirements
- E-III: Monitoring Requirements



**SECTION A. Table of Contents**

- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

**Section F. Alternative Operating Scenario(s)**

- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

**Section G. Emission Restriction Summary**

**Section H. Miscellaneous**

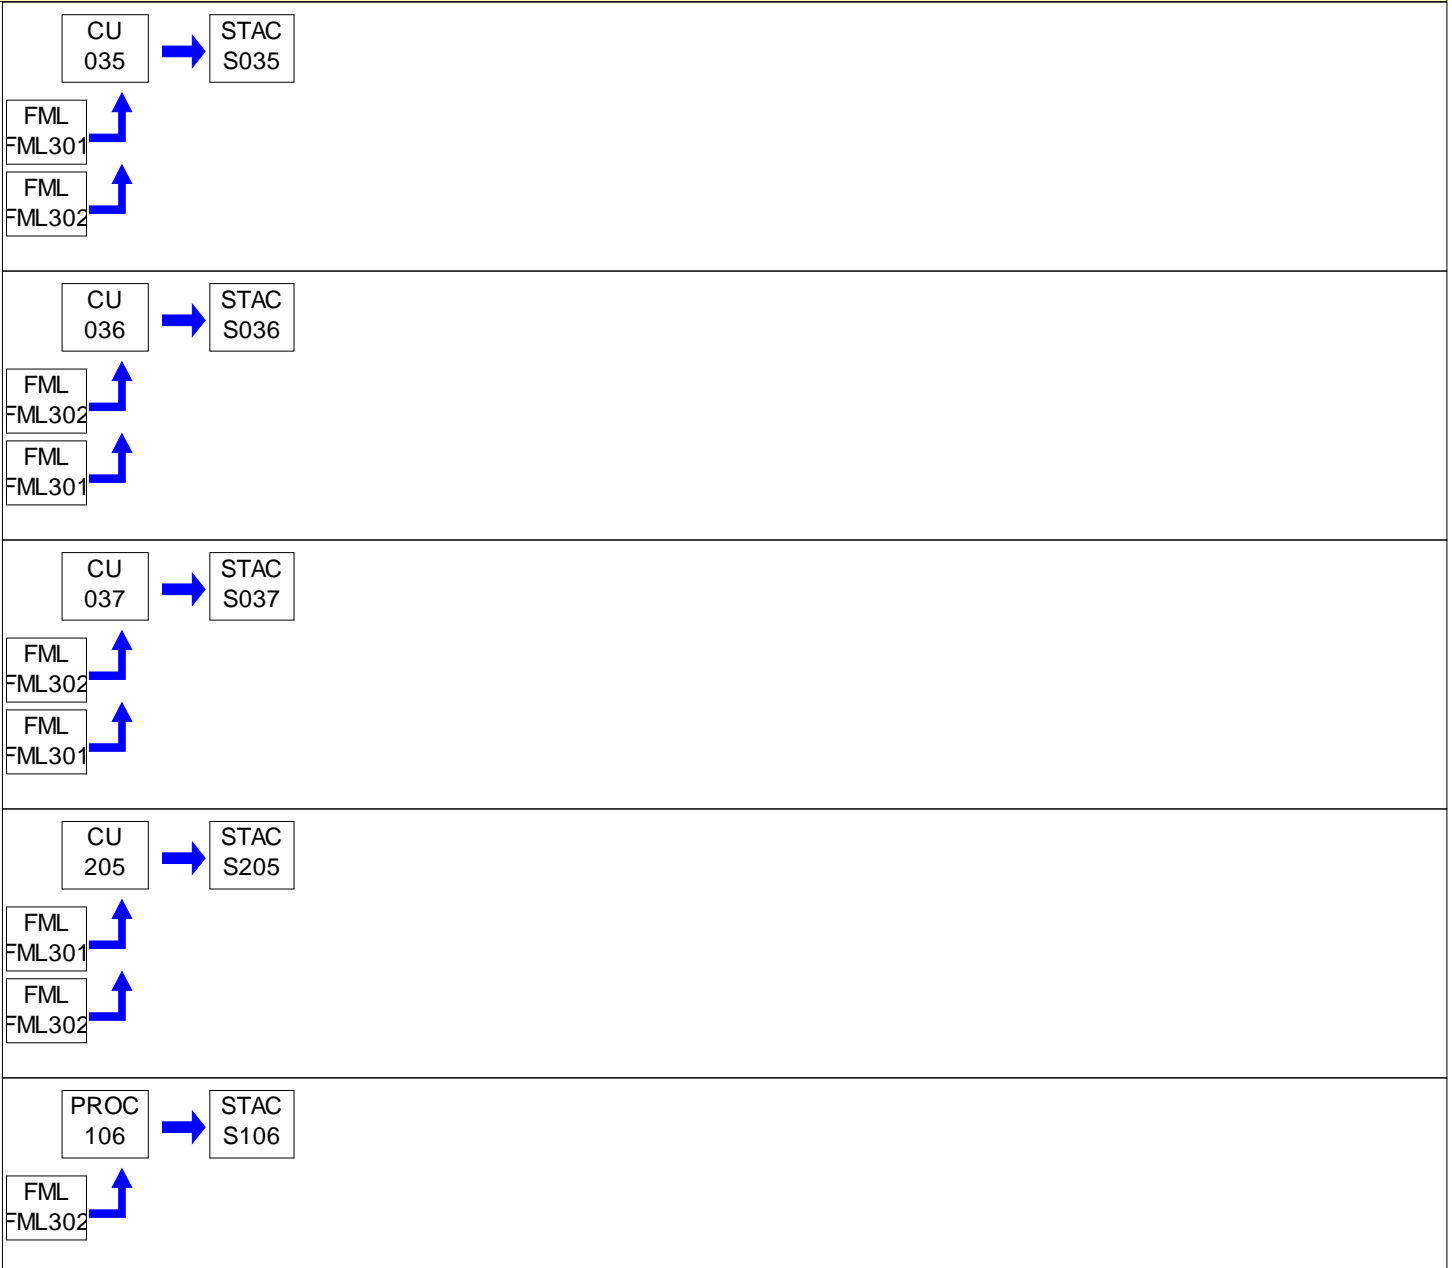
**SECTION A. Site Inventory List**










Source ID	Source Name	Capacity/Throughput	Fuel/Material
035	BOILER 5	37.700 MMBTU/HR	
		273.000 Gal/HR	#2 Oil
		27.500 MCF/HR	Natural Gas
036	BOILER 6	37.700 MMBTU/HR	
		273.000 Gal/HR	#2 Oil
		27.500 MCF/HR	Natural Gas
037	BOILER 7	37.700 MMBTU/HR	
		273.000 Gal/HR	#2 Oil
		27.500 MCF/HR	Natural Gas
205	R BUILDING BOILER	33.500 MMBTU/HR	
		32.500 MCF/HR	Natural Gas
		243.000 Gal/HR	#2 Oil
106	GENERATOR 6	25.500 Gal/HR	#2 Oil
110	GENERATOR 10	37.600 Gal/HR	#2 Oil
111	GENERATOR 11	37.600 Gal/HR	#2 Oil
112	GENERATOR 12	2.900 CF/HR	Natural Gas
113	GENERATOR 13	47.400 CF/HR	Natural Gas
114	GENERATOR 14	104.000 Gal/HR	#2 Oil
115	GENERATOR 15	104.000 Gal/HR	#2 Oil
116	GENERATOR 16	104.000 Gal/HR	#2 Oil
117	GENERATOR 17	110.000 Gal/HR	#2 Oil
118	GENERATOR 18	110.000 Gal/HR	#2 Oil
301	600 GALLON GASOLINE TANK		
401	TURBINE #1 - 5 MEGAWATT	58.150 MMBTU/HR	
		56.000 MCF/HR	Natural Gas
402	TURBINE #2 - 5 MEGAWATT	58.150 MMBTU/HR	
		56.000 MCF/HR	Natural Gas
403	WASTE HEAT RECOVERY BOILER #1 [NO BURNER]	23.400 MMBTU/HR	
404	WASTE HEAT RECOVERY BOILER #2 [NO BURNER]	23.400 MMBTU/HR	
900	COLD CLEANING MACHINES (DEGREASERS)		
FML301	NATURAL GAS PIPELINE (F301)		
FML302	FUEL OIL #2		
S035	BOILER 5 STACK		
S036	BOILER 6 STACK		
S037	BOILER 7 STACK		
S106	GENERATOR 6 STACK		
S110	GENERATOR 10 STACK		
S111	GENERATOR 11 STACK		
S112	GENERATOR 12 STACK		
S113	GENERATOR 13 STACK		
S114	GENERATOR 14 STACK		







**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
S115	GENERATOR 15 STACK		
S116	GENERATOR 16 STACK		
S117	GENERATOR 17 STACK		
S118	GENERATOR 18 STACK		
S205	R BUILDING BOILER STACK		
S401	TURBINE 1 & HEAT RECOVERY BOILER 1 STACK		
S402	TURBINE 2 & HEAT RECOVERY BOILER 2 STACK		
Z301	FUGITIVE GASOLINE FUMES		
Z900	DEGREASER FUGITIVE EMISSIONS		

**PERMIT MAPS**



**PERMIT MAPS**

**PERMIT MAPS**

**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

**#002 [25 Pa. Code § 127.446]****Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

**#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)&(c)]****Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application and an additional annual administrative fee as specified in 25 Pa. Code § 127.703(b) and (c). The fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund" and shall be for the amount specified in the following schedule specified in 25 Pa. Code § 127.703(b) and (c).
- (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

**#004 [25 Pa. Code § 127.703]****Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay fees according to the following schedule specified in 25 Pa. Code § 127.703(b):
- (1) Three hundred dollars for applications filed during the 2000-2004 calendar years.
  - (2) Three hundred seventy-five dollars for applications filed for the calendar years beginning in 2005.

This fee schedule shall apply to the processing of an application for an operating permit as well as the extension,



**SECTION B. General State Only Requirements**

modification, revision, renewal, and re-issuance of each operating permit or part thereof.

(b) The permittee shall pay an annual operating permit administrative fee according to the fee schedule established in 25 Pa. Code § 127.703(c).

(1) Two hundred fifty dollars for applications filed during the 1995-1999 calendar years.

(2) Three hundred dollars for applications filed during the 2000-2004 calendar years.

(3) Three hundred seventy-five dollars for applications filed during the years beginning in 2005.

(c) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania - Clean Air Fund".

**#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]****Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

**#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]****Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

**#007 [25 Pa. Code §§ 127.441 & 127.444]****Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes

**SECTION B. General State Only Requirements**

a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

**#008 [25 Pa. Code § 127.441]****Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

**#009 [25 Pa. Code §§ 127.442(a) & 127.461]****Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

**#010 [25 Pa. Code § 127.461]****Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

**#011 [25 Pa. Code §§ 127.450 & 127.462]****Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and

**SECTION B. General State Only Requirements**

significant operating permit modifications, under this permit, as outlined below:

(b) Administrative Amendments. The permittee shall make administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall make minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Permit modifications which do not qualify as minor permit modifications under 25 Pa. Code § 127.541 will be treated as a significant operating permit revision subject to the public notification procedures in §§ 127.424 and 127.425.

**#012 [25 Pa. Code § 127.441]****Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

**#013 [25 Pa. Code § 127.449]****De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO<sub>x</sub> from a single source during the term of the permit and 5 tons of NO<sub>x</sub> at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM<sub>10</sub> from a single source during the term of the permit and 3.0 tons of PM<sub>10</sub> at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

(1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.

(2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

**#014 [25 Pa. Code § 127.3]****Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

(1) Section 127.14 (relating to exemptions)

(2) Section 127.447 (relating to alternative operating scenarios)

(3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)

(4) Section 127.449 (relating to de minimis emission increases)

(5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

**#015 [25 Pa. Code § 127.11]****Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

**#016 [25 Pa. Code § 127.36]****Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

**#017 [25 Pa. Code § 121.9]****Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

**#018 [25 Pa. Code §§ 127.402(d) & 127.442]****Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager  
PA Department of Environmental Protection  
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

**#019 [25 Pa. Code §§ 127.441(c) & 135.5]****Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

**#020 [25 Pa. Code §§ 127.441(c) and 135.5]****Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

**#021 [25 Pa. Code § 127.441(a)]****Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

**#022 [25 Pa. Code § 127.447]****Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall not allow the emission into the outdoor atmosphere of a fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving, and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars, and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Sources and classes of sources other than those identified in (1)-(5), above, for which the permittee has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
  - (i) The emissions are of minor significance with respect to causing air pollution; and
  - (ii) The emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

**# 002 [25 Pa. Code §123.2]****Fugitive particulate matter**

The permittee shall not allow the emission of fugitive particulate matter into the outdoor atmosphere from a source specified in Section C, Condition #001, if the emissions are visible at the point the emissions pass outside the permittee's property.

**# 003 [25 Pa. Code §123.31]****Limitations**

The permittee shall not allow the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the permittee's property.

**# 004 [25 Pa. Code §123.41]****Limitations**

The permittee shall not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any one hour.
- (2) Equal to or greater than 60% at any time.

**# 005 [25 Pa. Code §123.42]****Exceptions**

The emission limitation shall not apply when:

- (1) The presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.
- (3) The emission results from sources specified in Section C, Condition #001(1)-(6).

**SECTION C. Site Level Requirements****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the facility's total annual actual emissions for the pollutants below, to the following levels to maintain the facility's Synthetic Minor status:

- (a) 100 tons/year of sulfur oxides
- (b) 100 tons/year of nitrogen oxides
- (c) 100 tons/year of carbon monoxide
- (d) 100 tons/year of PM-10 (particulate matter with an effective aerodynamic diameter of less than or equal to a nominal 10 micrometer body as measured by the applicable reference method or an equal method)
- (e) 50 tons/year of volatile organic compounds
- (f) 10 tons/year of any individual hazardous air pollutant
- (g) 25 tons/year of total combined hazardous air pollutants

The above emission limits are based upon a 12-month rolling average and apply to each consecutive 12-month period. Compliance verification requires emissions to be calculated for each month and each consecutive 12-month period.

**# 007 [25 Pa. Code §129.14]****Open burning operations**

(a) The permittee shall not allow the open burning of material on the permittee's property except when the open burning operations result from:

- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
- (2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
- (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
- (4) A fire set solely for recreational or ceremonial purposes.
- (5) A fire set solely for cooking food.

(b) This permit does not constitute authorization to burn solid waste pursuant to Section 610(3) of the Solid Waste Management Act, 35 P.S. Section 6018.610 (3), or any other provision of the Solid Waste Management Act.

**II. TESTING REQUIREMENTS.****# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of the sources and control devices referenced in this permit to measure emissions for purposes including verification of permit condition compliance and estimation of annual air emissions.

**# 009 [25 Pa. Code §139.1]****Sampling facilities.**

Upon the request of the Department, the permittee shall provide adequate sampling ports, safe sampling platforms and adequate utilities for the performance by the Department of tests on such source. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.



**SECTION C. Site Level Requirements****# 010 [25 Pa. Code §139.11]****General requirements.**

(a) As specified in 25 Pa. Code Section 139.11(1), performance tests shall be conducted while the source is operating at maximum routine operating conditions or under such other conditions, within the capacity of the equipment, as may be requested by the Department.

(b) As specified in 25 Pa. Code Section 139.11(2), the Department will consider test results for approval where sufficient information is provided to verify the source conditions existing at the time of the test and where adequate data is available to show the manner in which the test was conducted. Information submitted to the Department shall include, at a minimum, all of the following:

- (1) A thorough source description, including a description of any air cleaning devices and the flue.
- (2) Process conditions, for example, the throughput rate of production, and other conditions, which may affect emissions from the process.
- (3) The location of the sampling ports.
- (4) Effluent characteristics, including velocity, temperature, moisture content, gas density (percentage CO, CO<sub>2</sub>, O<sub>2</sub>, and N<sub>2</sub>), static and barometric pressures.
- (5) Sample collection techniques employed, including procedures used, equipment descriptions, and data to verify that isokinetic sampling for particulate matter collection occurred and that acceptable test conditions were met.
- (6) Laboratory procedures and results.
- (7) Calculated results.

**III. MONITORING REQUIREMENTS.****# 011 [25 Pa. Code §123.43]****Measuring techniques**

Visible air contaminants may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and certified, to measure plume opacity with the naked eye, as per EPA Method 9, or with the aid of any devices approved by the Department.

**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall conduct a monthly inspection around the facility periphery during daylight hours when the facility is in operation to detect visible emissions, fugitive emission, and malodorous air contaminants. Inspections are necessary to determine:

- (a) The presence of visible emissions. Visible emissions may be measured according to the methods specified in Section C, Condition #011. Alternatively, personnel who observe visible emissions may report the incidence of visible emissions to the Department within two (2) hours of the incident and make arrangements for a certified observer to measure the visible emissions.
- (b) The presence of fugitive emissions beyond the property boundaries, as stated in Section C, Condition #002.
- (c) The presence of odorous air contaminants beyond the property boundaries, as stated in Section C, Condition #003.

**SECTION C. Site Level Requirements****IV. RECORDKEEPING REQUIREMENTS.****# 013 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Unless otherwise noted, all records required by this and subsequent operating permits shall be maintained for the most recent five-year period and shall be readily available to the Department upon request. The most recent two years of records must be retained at the facility. The remaining three years of records may be retained off site. The records may be retained on paper, microfilm, microfiche or computer disks. If the records are retained on computer disks, the records must be in commonly available software. Commonly available software is usually compatible with a Microsoft application such as Word or Excel. For records kept off site, readily available is defined as available within one business day.

**# 014 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records on a yearly basis of operating hours and cubic feet of natural gas and gallons of fuel oil/year consumed. These records shall be retained for a minimum of five (5) years and be made available to the Department upon its request.

**# 015 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of inspections around the facility periphery. The records shall include, at minimum, the following information:

- 1.) The name of the company representative conducting the inspection.
- 2.) The date and time of the inspection.
- 3.) The wind direction.
- 4.) A description of any emissions and/or malodors observed and the actions taken to mitigate them. If none, record "NONE."

**V. REPORTING REQUIREMENTS.****# 016 [25 Pa. Code §127.442]****Reporting requirements.**

The permittee shall report malfunctions which occur at the facility to the Department. A malfunction is defined as any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

- (a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Air Quality Program at (610) 916-0100 during normal business hours, or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>. The permittee shall submit a written report of instances of such malfunctions to the Department within three (3) days of the telephone report.
- (b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirements of this section, shall be reported to the Department, in writing, within five (5) days of discovery of the malfunction.

**# 017 [25 Pa. Code §135.3]****Reporting**

An annual report containing monthly records of, unless otherwise specified, fuel usage, material throughputs, operating hours and quantities of all facility emissions shall be submitted to the Supervisor at the Air Quality District Office. The report for January 1 through December 31 is due no later than March 1 of the following year for each operating year authorized by the permit.

**VI. WORK PRACTICE REQUIREMENTS.****# 018 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall

## SECTION C. Site Level Requirements

include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means [25 Pa Code 123.1 and 123.2].

### # 019 [25 Pa. Code §127.444]

#### **Compliance requirements.**

The permittee shall operate and maintain all sources and any air cleaning devices identified in this operating permit in accordance with the manufacturer's recommendations/specifications, as well as in a manner consistent with good operating practices.

#### **VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

#### **VIII. COMPLIANCE CERTIFICATION.**

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

#### **IX. COMPLIANCE SCHEDULE.**

No compliance milestones exist.



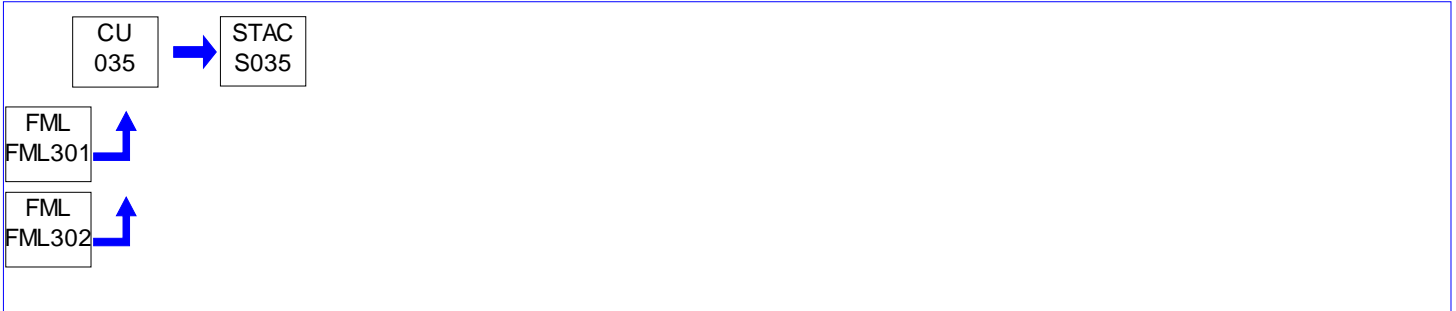
**SECTION D. Source Level Requirements**

Source ID: 035

Source Name: BOILER 5

Source Capacity/Throughput:	37.700 MMBTU/HR	
	273.000 Gal/HR	#2 Oil
	27.500 MCF/HR	Natural Gas

Conditions for this source occur in the following groups: SG02  
SG03  
SG05



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

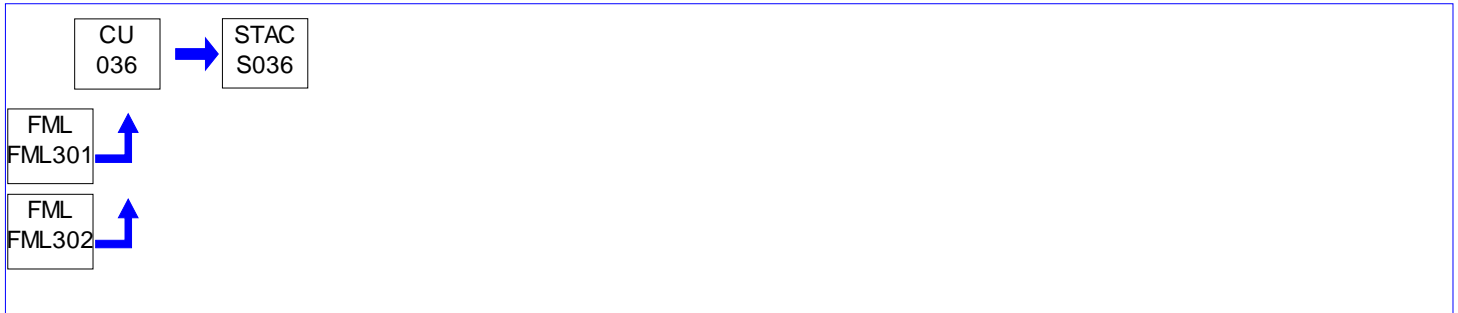
**SECTION D. Source Level Requirements**

Source ID: 036

Source Name: BOILER 6

Source Capacity/Throughput: 37.700 MMBTU/HR  
 273.000 Gal/HR #2 Oil  
 27.500 MCF/HR Natural Gas

Conditions for this source occur in the following groups: SG02  
 SG03  
 SG05

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



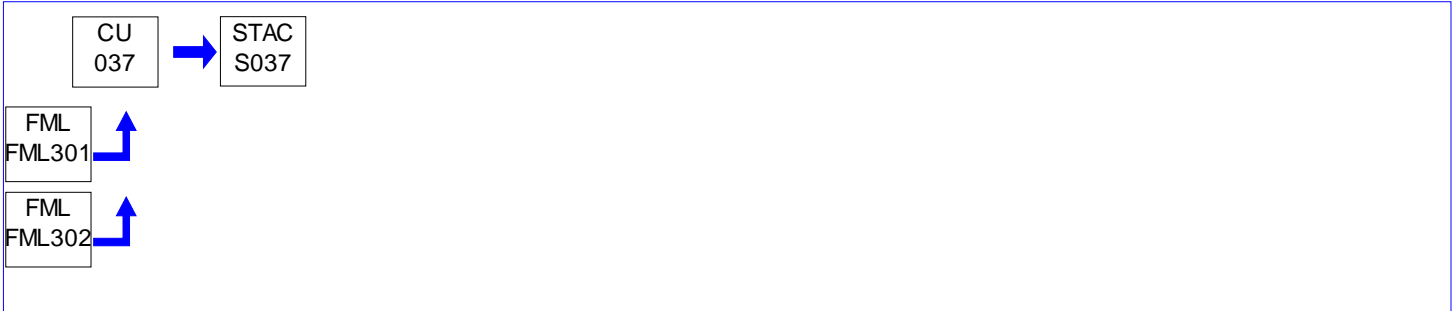
**SECTION D. Source Level Requirements**

Source ID: 037

Source Name: BOILER 7

Source Capacity/Throughput:	37.700	MMBTU/HR	
	273.000	Gal/HR	#2 Oil
	27.500	MCF/HR	Natural Gas

Conditions for this source occur in the following groups: SG02  
SG03  
SG05



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



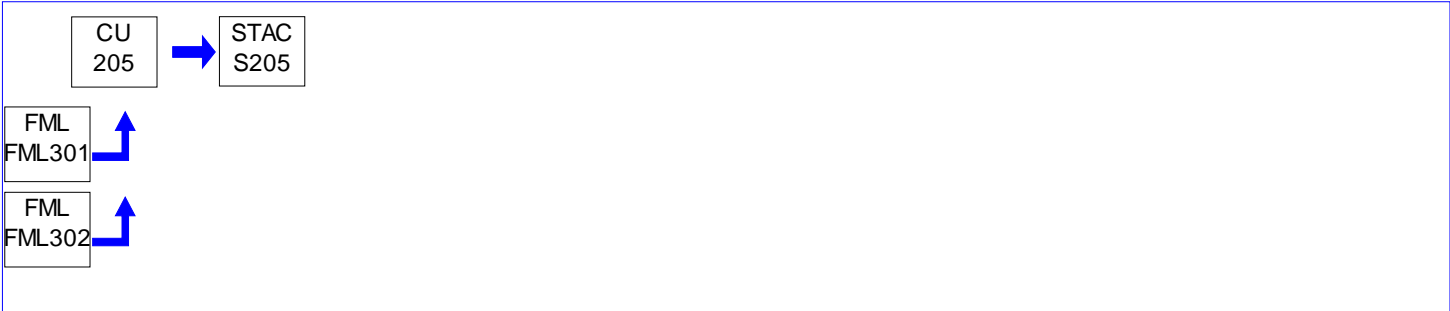
**SECTION D. Source Level Requirements**

Source ID: 205

Source Name: R BUILDING BOILER

Source Capacity/Throughput:	33.500	MMBTU/HR	
	32.500	MCF/HR	Natural Gas
	243.000	Gal/HR	#2 Oil

Conditions for this source occur in the following groups: SG02  
SG03  
SG05



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



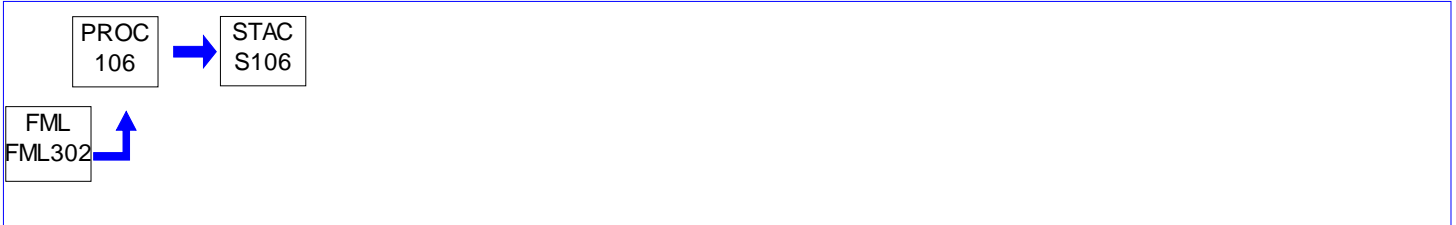
**SECTION D. Source Level Requirements**

Source ID: 106

Source Name: GENERATOR 6

Source Capacity/Throughput: 25.500 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



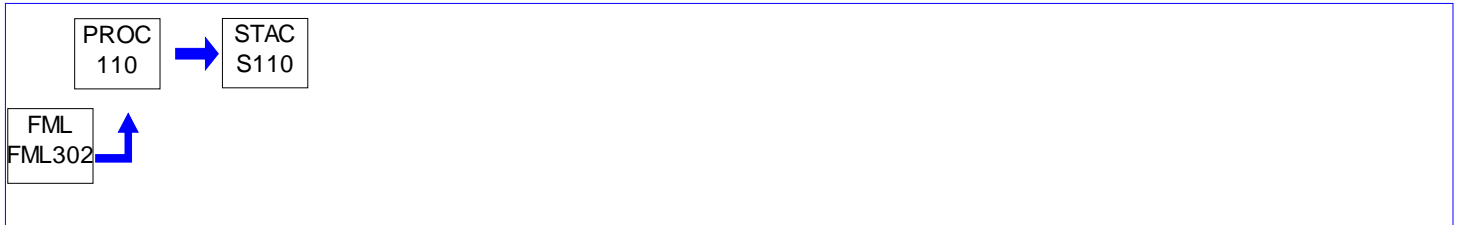
**SECTION D. Source Level Requirements**

Source ID: 110

Source Name: GENERATOR 10

Source Capacity/Throughput: 37.600 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



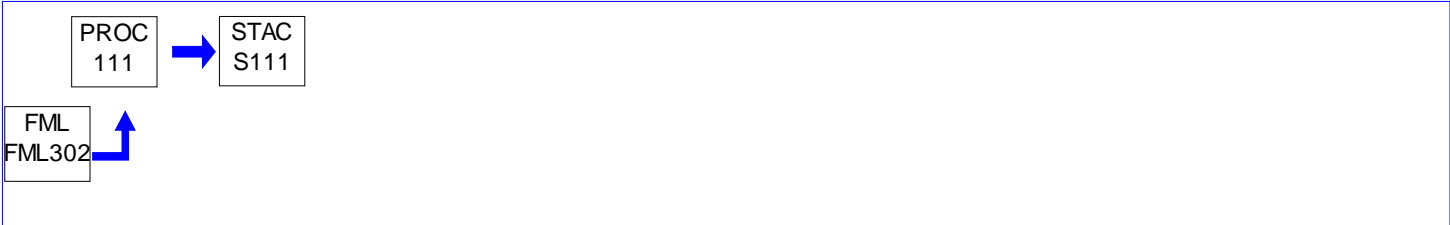
**SECTION D. Source Level Requirements**

Source ID: 111

Source Name: GENERATOR 11

Source Capacity/Throughput: 37.600 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



**SECTION D. Source Level Requirements**

Source ID: 112

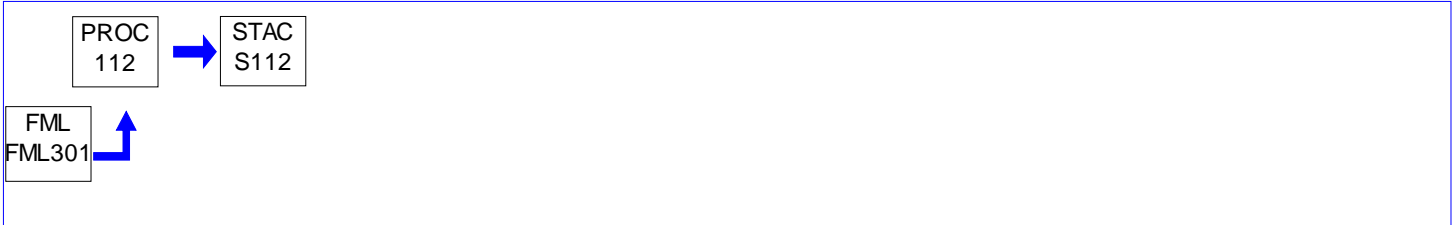
Source Name: GENERATOR 12

Source Capacity/Throughput:

2.900 CF/HR

Natural Gas

Conditions for this source occur in the following groups: SG01



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 113

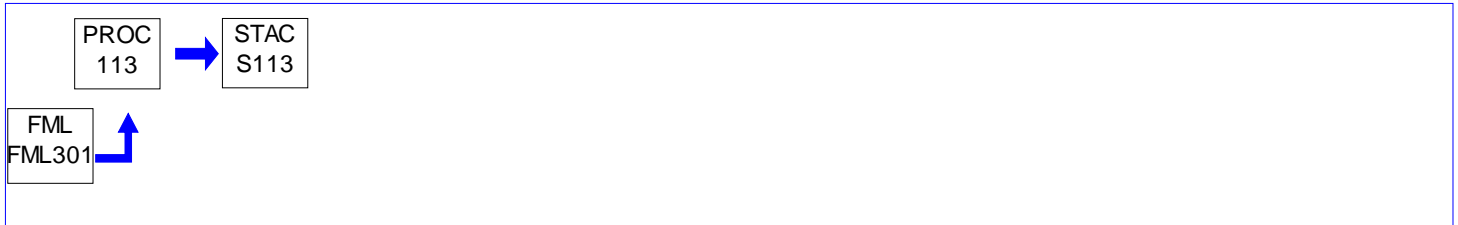
Source Name: GENERATOR 13

Source Capacity/Throughput:

47.400 CF/HR

Natural Gas

Conditions for this source occur in the following groups: SG01

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

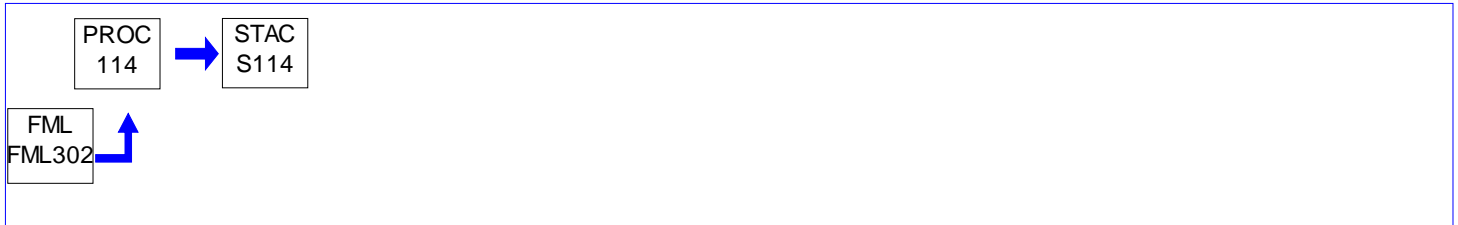
**SECTION D. Source Level Requirements**

Source ID: 114

Source Name: GENERATOR 14

Source Capacity/Throughput: 104.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



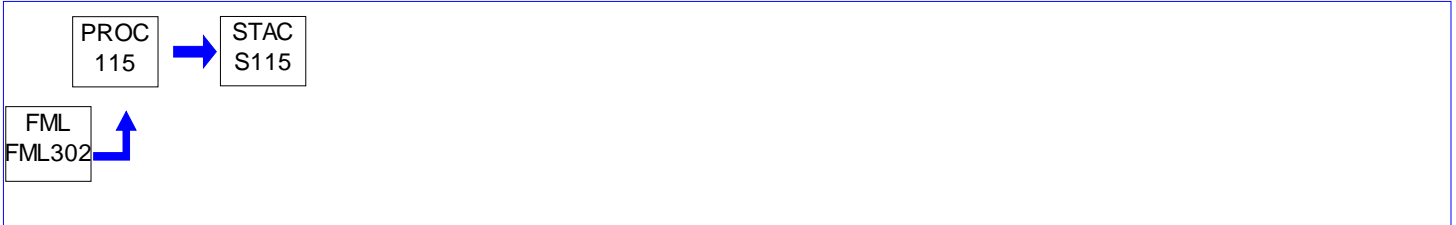
**SECTION D. Source Level Requirements**

Source ID: 115

Source Name: GENERATOR 15

Source Capacity/Throughput: 104.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



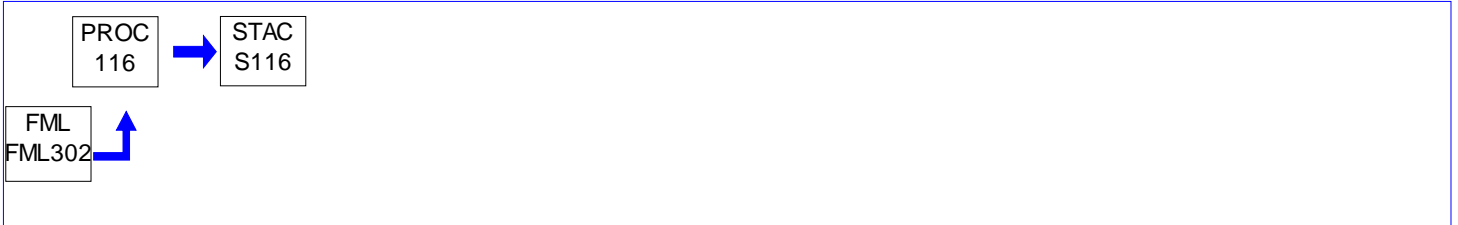
**SECTION D. Source Level Requirements**

Source ID: 116

Source Name: GENERATOR 16

Source Capacity/Throughput: 104.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01



**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 117

Source Name: GENERATOR 17

Source Capacity/Throughput: 110.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01  
SG08**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

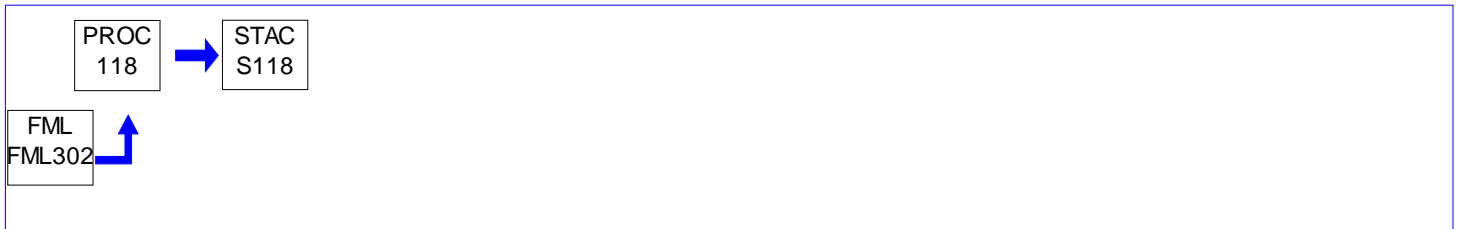


**SECTION D. Source Level Requirements**

Source ID: 118

Source Name: GENERATOR 18

Source Capacity/Throughput: 110.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: SG01  
SG08**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).


**SECTION D. Source Level Requirements**

Source ID: 301

Source Name: 600 GALLON GASOLINE TANK

Source Capacity/Throughput:

Conditions for this source occur in the following groups: SG04

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

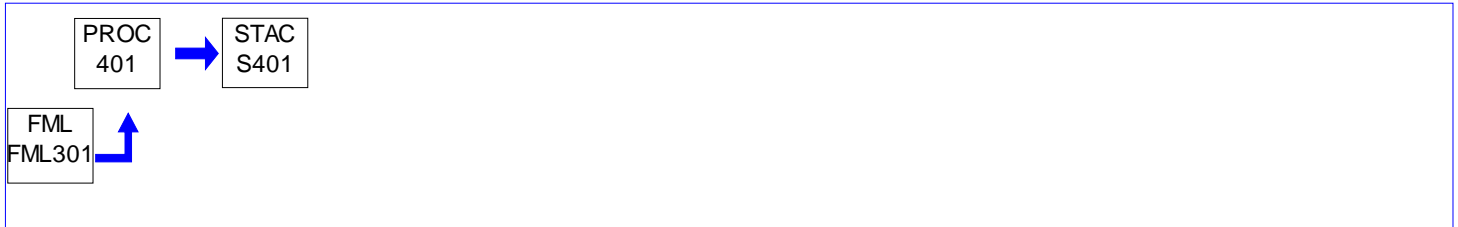
**SECTION D. Source Level Requirements**

Source ID: 401

Source Name: TURBINE #1 - 5 MEGAWATT

Source Capacity/Throughput: 58.150 MMBTU/HR

56.000 MCF/HR Natural Gas

Conditions for this source occur in the following groups: SG07  
SG09**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

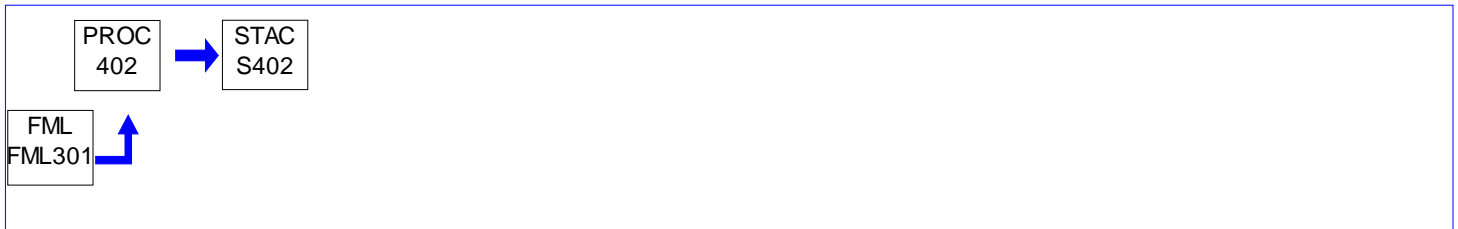
**SECTION D. Source Level Requirements**

Source ID: 402

Source Name: TURBINE #2 - 5 MEGAWATT

Source Capacity/Throughput: 58.150 MMBTU/HR

56.000 MCF/HR Natural Gas

Conditions for this source occur in the following groups: SG07  
SG09**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**

Source ID: 403

Source Name: WASTE HEAT RECOVERY BOILER #1 [NO BURNER]

Source Capacity/Throughput: 23.400 MMBTU/HR

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**

Source ID: 404

Source Name: WASTE HEAT RECOVERY BOILER #2 [NO BURNER]

Source Capacity/Throughput: 23.400 MMBTU/HR

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**


No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**

Source ID: 900

Source Name: COLD CLEANING MACHINES (DEGREASERS)

Source Capacity/Throughput:

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §129.63]****Degreasing operations**

After December 22, 2002, the permittee may not use, sell or offer for sale for use in a cold cleaning machine any solvent with a vapor pressure of 1.0 millimeter of mercury (mm Hg) or greater and containing greater than 5% VOC by weight, measured at 20°C (68°F) containing VOCs.

The above requirement does not apply:

- (i) To cold cleaning machines used in extreme cleaning service.
- (ii) If the owner or operator of the cold cleaning machine demonstrates, and the Department approves in writing, that compliance with this condition will result in unsafe operating conditions.
- (iii) To immersion cold cleaning machines with a freeboard ratio equal to or greater than 0.75.

**Throughput Restriction(s).****# 002 [25 Pa. Code §129.63]****Degreasing operations**

Immersion cold cleaning machines shall have a freeboard ratio of 0.50 or greater.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §129.63]****Degreasing operations**

The permittee shall maintain for at least two (2) years and shall provide to the Department, on request, the following information:

- (i) The name and address of the solvent supplier.
- (ii) The type of solvent including the product or vendor identification number.
- (iii) The vapor pressure of the solvent measured in mm Hg at 20°C (68°F).

An invoice, bill of sale, certificate that corresponds to a number of sales, Material Safety Data Sheet (MSDS), or other appropriate documentation acceptable to the Department that may be used to comply with this section.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.****# 004 [25 Pa. Code §129.63]****Degreasing operations**

For immersion cold cleaning machines and remote reservoir cold cleaning machines, the permittee shall:

Have a permanent, conspicuous label summarizing the operating requirements in Conditions #005 and #006 below. In addition, the label shall include the following discretionary good operating practices:

(A) Cleaned parts should be drained at least 15 seconds or until dripping ceases, whichever is longer. Parts having cavities or blind holes shall be tipped or rotated while the part is draining. During the draining, tipping or rotating, the parts should be positioned so that solvent drains directly back to the cold cleaning machine.

(B) When a pump-agitated solvent bath is used, the agitator should be operated to produce a rolling motion of the solvent with no observable splashing of the solvent against the tank walls or the parts being cleaned.

(C) Work area fans should be located and positioned so that they do not blow across the opening of the degreaser unit.

**# 005 [25 Pa. Code §129.63]****Degreasing operations**

The permittee shall operate the cold cleaning machines in accordance with the following procedures:

(i) Waste solvent shall be collected and stored in closed containers. The closed containers may contain a device that allows pressure relief, but does not allow liquid solvent to drain from the container.

(ii) Flushing of parts using a flexible hose or other flushing device shall be performed only within the cold cleaning machine. The solvent spray shall be a solid fluid stream, not an atomized or shower spray.

(iii) Sponges, fabric, wood, leather, paper products and other absorbent materials may not be cleaned in the cold cleaning machine.

(iv) Air agitated solvent baths may not be used.

(v) Spills during solvent transfer and use of the cold cleaning machine shall be cleaned up immediately.

**# 006 [25 Pa. Code §129.63]****Degreasing operations**

Immersion cold cleaning machines shall be equipped with a cover that shall be closed at all times except during cleaning of parts or the addition or removal of solvent. For remote reservoir cold cleaning machines which drain directly into the solvent storage reservoir, a perforated drain with a diameter of not more than six (6) inches shall constitute an acceptable cover.

**VII. ADDITIONAL REQUIREMENTS.****# 007 [25 Pa. Code §129.63]****Degreasing operations**

The permittee that operates a parts washer or cold cleaning machines that use 2 gallons or more of solvents containing greater than 5% VOC content by weight for the cleaning of metal parts shall comply with the requirements listed in this section.



**SECTION E. Source Group Restrictions.**

Group Name: SG01

Group Description: Generators (State-only Requirements)

Sources included in this group

ID	Name
106	GENERATOR 6
110	GENERATOR 10
111	GENERATOR 11
112	GENERATOR 12
113	GENERATOR 13
114	GENERATOR 14
115	GENERATOR 15
116	GENERATOR 16
117	GENERATOR 17
118	GENERATOR 18

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.13]

**Processes**

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter (PM) from any source in this group in a manner that the concentration of PM in the effluent gas exceeds 0.04 grain per dry standard cubic foot.

# 002 [25 Pa. Code §123.22]

**Combustion units**

The permittee shall not allow the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from any of the combustion units in excess of the rate of 3 pounds per million BTUs of heat input over any 1-hour period.

# 003 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The NO<sub>x</sub> emissions from each Engine-Generator ID #s 114, 115, or 116 shall not exceed 8.5 grams per horsepower-hour (g/hp-hr).

**Fuel Restriction(s).**

# 004 [25 Pa. Code §123.22]

**Combustion units**

The permittee shall not offer for sale, deliver for use, exchange in trade, or permit the use of commercial fuel oil which contains sulfur in excess of 0.3% by weight.

# 005 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The permittee shall operate Source IDs 106, 110, 111, 114, 115, 116, 117 and 118 using No. 2 fuel oil only.

# 006 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The permittee shall operate Source IDs 112, and 113 using natural gas only.

**Operation Hours Restriction(s).**

# 007 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The permittee shall limit the operation of the Engine-Generators Source IDs 114, 115, 116, 117 and 118 to a maximum of 500 hours/year/engine.

**SECTION E. Source Group Restrictions.****# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall limit the operation of the Engine-Generators Source IDs 106, 110, 111, 112, and 113 to a maximum of 200 hours/year/engine.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 009 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of the monthly hours of operation and fuel usage for each unit. The permittee shall retain these records for a minimum of five (5) years. The records shall be made available to the Department upon its request.

**# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The facility shall keep the following records for each Source ID #s 114, 115, 116, 117 and 118 retain these for two years and make them available to the Department when requested:

- (a) Monthly records of running hours, and kilowatt-hours generated.
- (b) Monthly records of No. 2 oil usage combined for the site.
- (c) Fuel Supplier's Certificate with percent sulfur content of No. 2 oil.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 011 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Source ID #s 114, 115, and 116 shall be equipped with a variable ignition-timing device, turbo charger, and utilize a low temperature aftercooler. Source ID #s 117 and 118 shall be equipped with a turbo charger and utilize a low temperature aftercooler.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: SG02

Group Description: Boilers (State-only Requirements)

Sources included in this group

ID	Name
035	BOILER 5
036	BOILER 6
037	BOILER 7
205	R BUILDING BOILER

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee shall not allow the emission into the outdoor atmosphere of particulate matter (PM) from the combustion unit, Source ID 205, in excess of 0.4 pounds per million BTUs of heat input.

**# 002 [25 Pa. Code §123.41]****Limitations**

The permittee shall not allow the emission into the outdoor atmosphere of visible air contaminants in such a manner that the emission exhibits 20% opacity, or greater.

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions of 25 Pa. Code 123.41.]

**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

In order to retain the facility's synthetic minor permit status the permittee shall restrict the fuel usage in the existing boilers to the following:

500 MM scf/yr of natural gas, and  
400,000 gal/yr of No. 2 fuel oil.

This is a combined limit for each fuel for all four boilers as a total.

**Fuel Restriction(s).****# 004 [25 Pa. Code §123.22]****Combustion units**

The maximum allowable sulfur content of No. 2 fuel oil shall be 500 ppm (0.05%) except as stated in 25 PA Code 123.22.

**# 005 [25 Pa. Code §123.22]****Combustion units**

The permittee shall not offer for sale, deliver for use, exchange in trade, or permit the use of commercial fuel oil which contains sulfur in excess of 0.3% by weight.

**# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The combustion units in this group shall only operate on Natural Gas and No. 2 Fuel Oil.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 007 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The permittee shall install and maintain the necessary meters to determine and record the amount of fuel usage.

**SECTION E. Source Group Restrictions.**

Group Name: SG03

Group Description: MACT Subpart JJJJJJ

**Sources included in this group**

ID	Name
035	BOILER 5
036	BOILER 6
037	BOILER 7
205	R BUILDING BOILER

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 001 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

§ 63.11193 Am I subject to this subpart?

You are subject to this subpart if you own or operate an industrial, commercial, or institutional boiler as defined in § 63.11237 that is located at, or is part of, an area source of hazardous air pollutants (HAP), as defined in § 63.2, except as specified in § 63.11195.

§ 63.11194 What is the affected source of this subpart?

(a) This subpart applies to each new, reconstructed, or existing affected source as defined in paragraphs (a)(1) and (2) of this section.

(1) The affected source of this subpart is the collection of all existing industrial, commercial, and institutional boilers within a subcategory, as listed in § 63.11200 and defined in § 63.11237, located at an area source.

(2) The affected source of this subpart is each new or reconstructed industrial, commercial, or institutional boiler within a

**SECTION E. Source Group Restrictions.**

subcategory, as listed in § 63.11200 and as defined in § 63.11237, located at an area source.

(b) An affected source is an existing source if you commenced construction or reconstruction of the affected source on or before June 4, 2010.

(c) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(d) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(e) An existing dual-fuel fired boiler meeting the definition of gas-fired boiler, as defined in § 63.11237, that meets the applicability requirements of this subpart after June 4, 2010 due to a fuel switch from gaseous fuel to solid fossil fuel, biomass, or liquid fuel is considered to be an existing source under this subpart as long as the boiler was designed to accommodate the alternate fuel.

(f) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or part 71 as a result of this subpart. You may, however, be required to obtain a title V permit due to another reason or reasons. See 40 CFR 70.3(a) and (b) or 71.3(a) and (b). Notwithstanding the exemption from title V permitting for area sources under this subpart, you must continue to comply with the provisions of this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

§ 63.11195 Are any boilers not subject to this subpart?

The types of boilers listed in paragraphs (a) through (k) of this section are not subject to this subpart and to any requirements in this subpart.

(a) [NA – NO UNITS PART OF SOURCES SUBJECT TO OTHER PART 63 SUBPART]

(b) [NA – NO CAA SECTION 129 UNITS]

(c) [NA – UNITS DO NOT BURN HAZARDOUS WASTE].

(d) [NA – UNITS ARE NOT R&D]

(e) [NA – UNITS ARE NOT DEFINED AS GAS-FIRED]

(f) [NA – UNITS NOT DEFINED AS HOT WATER HEATERS]

(g) [NA – UNITS NOT USED AS CONTROL DEVICES]

(h) [NA – UNITS DO NOT QUALIFY AS TEMPORARY UNITS]

(i) [NA – UNITS ARE NOT DEFINED AS RESIDENTIAL]

(j) [NA – UNITS ARE NOT DEFINED AS ELECTRIC]

(k) [NA – UNITS ARE NOT EGUs]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11196 What are my compliance dates?

(a) If you own or operate an existing affected boiler, you must achieve compliance with the applicable provisions in this subpart as specified in paragraphs (a)(1) through (3) of this section.

(1) If the existing affected boiler is subject to a work practice or management practice standard of a tune-up, you must achieve compliance with the work practice or management practice standard no later than March 21, 2014.

**SECTION E. Source Group Restrictions.**

(2) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(3) If the existing affected boiler is subject to the energy assessment requirement, you must achieve compliance with the energy assessment requirement no later than March 21, 2014.

(b) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(c) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(d) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Emission Limits, Work Practice Standards, Emission Reduction Measures, and Management Practices

§ 63.11200 What are the subcategories of boilers?

The subcategories of boilers, as defined in § 63.11237 are:

(a) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(b) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(c) Oil.

(d) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(e) [NA - SOURCES IN THIS GROUP  $\geq$  10 MMBTU]

(f) [NA – SOURCES IN THIS GROUP DO NOT HAVE OXYGEN TRIM SYSTEM]

(g) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS LIMITED USE]

[78 FR 7506, Feb. 1, 2013]

§ 63.11201 What standards must I meet?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must comply with each work practice standard, emission reduction measure, and management practice specified in Table 2 to this subpart that applies to your boiler. An energy assessment completed on or after January 1, 2008 that meets or is amended to meet the energy assessment requirements in Table 2 to this subpart satisfies the energy assessment requirement. A facility that operates under an energy management program established through energy management systems compatible with ISO 50001, that includes the affected units, also satisfies the energy assessment requirement.

TABLE 2 REQUIREMENTS:

As stated in § 63.11201, you must comply with the following applicable work practice standards, emission reduction measures, and management practices:

4. If your boiler is in this subcategory: Existing oil-fired boilers with heat input capacity greater than 5 MMBtu/hr that do not meet the definition of seasonal boiler or limited-use boiler, or use an oxygen trim system that maintains an optimum air-to-fuel ratio, you must meet the following: Conduct an initial tune-up as specified in § 63.11214, and conduct a tune-up of the boiler biennially as specified in § 63.11223.

16. If your boiler is in this subcategory: Existing coal-fired, biomass-fired, or oil-fired boilers (units with heat input capacity of

**SECTION E. Source Group Restrictions.**

10 MMBtu/hr and greater), not including limited-use boilers, you must meet the following: must have a one-time energy assessment performed by a qualified energy assessor. An energy assessment completed on or after January 1, 2008, that meets or is amended to meet the energy assessment requirements in this table satisfies the energy assessment requirement. Energy assessor approval and qualification requirements are waived in instances where past or amended energy assessments are used to meet the energy assessment requirements. A facility that operated under an energy management program developed according to the ENERGY STAR guidelines for energy management or compatible with ISO 50001 for at least 1 year between January 1, 2008, and the compliance date specified in §63.11196 that includes the affected units also satisfies the energy assessment requirement. The energy assessment must include the following with extent of the evaluation for items (1) to (4) appropriate for the on-site technical hours listed in §63.11237:

- (1) A visual inspection of the boiler system,
- (2) An evaluation of operating characteristics of the affected boiler systems, specifications of energy use systems, operating and maintenance procedures, and unusual operating constraints,
- (3) An inventory of major energy use systems consuming energy from affected boiler(s) and which are under control of the boiler owner or operator,
- (4) A review of available architectural and engineering plans, facility operation and maintenance procedures and logs, and fuel usage,
- (5) A list of major energy conservation measures that are within the facility's control,
- (6) A list of the energy savings potential of the energy conservation measures identified, and
- (7) A comprehensive report detailing the ways to improve efficiency, the cost of specific improvements, benefits, and the time frame for recouping those investments.

END OF TABLE 2 REQUIREMENTS

(c) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(d) These standards apply at all times the affected boiler is operating, except during periods of startup and shutdown as defined in § 63.11237, during which time you must comply only with Table 2 to this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

General Compliance Requirements

§ 63.11205 What are my general requirements for complying with this subpart?

(a) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Initial Compliance Requirements



**SECTION E. Source Group Restrictions.**

§ 63.11210 What are my initial compliance requirements and by what date must I conduct them?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) For existing affected boilers that have applicable work practice standards, management practices, or emission reduction measures, you must demonstrate initial compliance no later than the compliance date that is specified in § 63.11196 and according to the applicable provisions in § 63.7(a)(2), except as provided in paragraph (j) of this section.

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(e) –(g) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(h) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

(i) For affected boilers that switch fuels or make a physical change to the boiler that results in the applicability of a different subcategory within subpart JJJJJJ or the boiler becoming subject to subpart JJJJJJ, you must demonstrate compliance within 180 days of the effective date of the fuel switch or the physical change. Notification of such changes must be submitted according to § 63.11225(g).

(j) [NA – FACILITY IS MINOR FOR HAP]

(k) [NA – UNITS HAVE OPERATED SINCE 6J EFFECTIVE DATE]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7507, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11211 How do I demonstrate initial compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11212 What stack tests and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11213 What fuel analyses and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11214 How do I demonstrate initial compliance with the work practice standard, emission reduction measures, and management practice?

(a) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(b) If you own or operate an existing or new biomass-fired boiler or an existing or new oil-fired boiler, you must conduct a performance tune-up according to §63.11210(c) or (g), as applicable, and §63.11223(b). If you own or operate an existing biomass-fired boiler or existing oil-fired boiler, you must submit a signed statement in the Notification of Compliance Status report that indicates that you conducted an initial tune-up of the boiler.

(c) If you own or operate an existing affected boiler with a heat input capacity of 10 million Btu per hour or greater, you must submit a signed certification in the Notification of Compliance Status report that an energy assessment of the boiler and its energy use systems was completed according to Table 2 to this subpart and that the assessment is an accurate depiction of your facility at the time of the assessment or that the maximum number of on-site technical hours specified in the definition of energy assessment applicable to the facility has been expended.

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

**SECTION E. Source Group Restrictions.**

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7508, Feb. 1, 2013; 81 FR 63126, Sept. 14, 2016]

Continuous Compliance Requirements

§ 63.11220 When must I conduct subsequent performance tests or fuel analyses?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING OR FUEL ANALYSES]

§ 63.11221 Is there a minimum amount of monitoring data I must obtain?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11222 How do I demonstrate continuous compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11223 How do I demonstrate continuous compliance with the work practice and management practice standards?

(a) For affected sources subject to the work practice standard or the management practices of a tune-up, you must conduct a performance tune-up according to paragraph (b) of this section and keep records as required in § 63.11225(c) to demonstrate continuous compliance. You must conduct the tune-up while burning the type of fuel (or fuels in the case of boilers that routinely burn two types of fuels at the same time) that provided the majority of the heat input to the boiler over the 12 months prior to the tune-up.

(b) Except as specified in paragraphs (c) through (f) of this section, you must conduct a tune-up of the boiler biennially to demonstrate continuous compliance as specified in paragraphs (b)(1) through (7) of this section. Each biennial tune-up must be conducted no more than 25 months after the previous tune-up. For a new or reconstructed boiler, the first biennial tune-up must be no later than 25 months after the initial startup of the new or reconstructed boiler.

(1) As applicable, inspect the burner, and clean or replace any components of the burner as necessary (you may delay the burner inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the burner inspection until the first outage, not to exceed 36 months from the previous inspection.

(2) Inspect the flame pattern, as applicable, and adjust the burner as necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available.

(3) Inspect the system controlling the air-to-fuel ratio, as applicable, and ensure that it is correctly calibrated and functioning properly (you may delay the inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the inspection until the first outage, not to exceed 36 months from the previous inspection.

(4) Optimize total emissions of CO. This optimization should be consistent with the manufacturer's specifications, if available, and with any nitrogen oxide requirement to which the unit is subject.

(5) Measure the concentrations in the effluent stream of CO in parts per million, by volume, and oxygen in volume percent, before and after the adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). Measurements may be taken using a portable CO analyzer.

(6) Maintain on-site and submit, if requested by the Administrator, a report containing the information in paragraphs (b)(6)(i) through (iii) of this section.

(i) The concentrations of CO in the effluent stream in parts per million, by volume, and oxygen in volume percent, measured at high fire or typical operating load, before and after the tune-up of the boiler.

(ii) A description of any corrective actions taken as a part of the tune-up of the boiler.

**SECTION E. Source Group Restrictions.**

(iii) The type and amount of fuel used over the 12 months prior to the tune-up of the boiler, but only if the unit was physically and legally capable of using more than one type of fuel during that period. Units sharing a fuel meter may estimate the fuel use by each unit.

(7) If the unit is not operating on the required date for a tune-up, the tune-up must be conducted within 30 days of startup.

(c) [NA – SOURCES IN THIS GROUP DO NOT HAVE OXYGEN TRIM SYSTEM]

(d) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(e) [NA - SOURCES IN THIS GROUP  $\geq$ 10 MMBTU]

(f) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(g) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7509, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§ 63.11224 What are my monitoring, installation, operation, and maintenance requirements?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(d) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(f) [NA – BLDS NOT USED OR REQUIRED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7510, Feb. 1, 2013]

§ 63.11225 What are my notification, reporting, and recordkeeping requirements?

(a) You must submit the notifications specified in paragraphs (a)(1) through (5) of this section to the administrator.

(1) You must submit all of the notifications in §§ 63.7(b); 63.8(e) and (f); and 63.9(b) through (e), (g), and (h) that apply to you by the dates specified in those sections except as specified in paragraphs (a)(2) and (4) of this section.

(2) An Initial Notification must be submitted no later than January 20, 2014 or within 120 days after the source becomes subject to the standard.

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(4) You must submit the Notification of Compliance Status no later than 120 days after the applicable compliance date specified in §63.11196 unless you own or operate a new boiler subject only to a requirement to conduct a biennial or 5-year tune-up or you must conduct a performance stack test. If you own or operate a new boiler subject to a requirement to conduct a tune-up, you are not required to prepare and submit a Notification of Compliance Status for the tune-up. If you must conduct a performance stack test, you must submit the Notification of Compliance Status within 60 days of completing the performance stack test. You must submit the Notification of Compliance Status in accordance with paragraphs (a)(4)(i) and (vi) of this section. The Notification of Compliance Status must include the information and certification(s) of compliance in paragraphs (a)(4)(i) through (v) of this section, as applicable, and signed by a responsible official.

(i) You must submit the information required in § 63.9(h)(2), except the information listed in § 63.9(h)(2)(i)(B), (D), (E), and (F). If you conduct any performance tests or CMS performance evaluations, you must submit that data as specified in

**SECTION E. Source Group Restrictions.**

paragraph (e) of this section. If you conduct any opacity or visible emission observations, or other monitoring procedures or methods, you must submit that data to the Administrator at the appropriate address listed in § 63.13.

(ii) "This facility complies with the requirements in § 63.11214 to conduct an initial tune-up of the boiler."

(iii) "This facility has had an energy assessment performed according to § 63.11214(c)."

(iv) [NA – BLDS NOT USED OR REQUIRED]

(v) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(vi) The notification must be submitted electronically using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written Notification of Compliance Status must be submitted to the Administrator at the appropriate address listed in § 63.13.

(5) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must prepare, by March 1 of each year, and submit to the delegated authority upon request, an annual compliance certification report for the previous calendar year containing the information specified in paragraphs (b)(1) through (4) of this section. You must submit the report by March 15 if you had any instance described by paragraph (b)(3) of this section. For boilers that are subject only to the energy assessment requirement and/or a requirement to conduct a biennial or 5-year tune-up according to §63.11223(a) and not subject to emission limits or operating limits, you may prepare only a biennial or 5-year compliance report as specified in paragraphs (b)(1) and (2) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with the official's name, title, phone number, email address, and signature, certifying the truth, accuracy and completeness of the notification and a statement of whether the source has complied with all the relevant standards and other requirements of this subpart. Your notification must include the following certification(s) of compliance, as applicable, and signed by a responsible official:

(i) "This facility complies with the requirements in § 63.11223 to conduct a biennial or 5-year tune-up, as applicable, of each boiler."

(ii) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(iii) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(3) If the source experiences any deviations from the applicable requirements during the reporting period, include a description of deviations, the time periods during which the deviations occurred, and the corrective actions taken.

(4) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) You must maintain the records specified in paragraphs (c)(1) through (7) of this section.

(1) As required in § 63.10(b)(2)(xiv), you must keep a copy of each notification and report that you submitted to comply with this subpart and all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted.

(2) You must keep records to document conformance with the work practices, emission reduction measures, and management practices required by § 63.11214 and § 63.11223 as specified in paragraphs (c)(2)(i) through (vi) of this section.

(i) Records must identify each boiler, the date of tune-up, the procedures followed for tune-up, and the manufacturer's specifications to which the boiler was tuned.

**SECTION E. Source Group Restrictions.**

(ii) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(iii) For each boiler required to conduct an energy assessment, you must keep a copy of the energy assessment report.

(iv) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(v) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(vi) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS LIMITED USE]

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO FUEL ANALYSES]

(4) Records of the occurrence and duration of each malfunction of the boiler, or of the associated air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with the general duty to minimize emissions in § 63.11205(a), including corrective actions to restore the malfunctioning boiler, air pollution control, or monitoring equipment to its normal or usual manner of operation.

(6) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(7) [NA – BLDS NOT USED OR REQUIRED]

(d) Your records must be in a form suitable and readily available for expeditious review. You must keep each record for 5 years following the date of each recorded action. You must keep each record on-site or be accessible from a central location by computer or other means that instantly provide access at the site for at least 2 years after the date of each recorded action. You may keep the records off site for the remaining 3 years.

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(f) [NA – SOURCES IN THIS GROUP ARE OIL-FIRED]

(g) If you have switched fuels or made a physical change to the boiler and the fuel switch or change resulted in the applicability of a different subcategory within this subpart, in the boiler becoming subject to this subpart, or in the boiler switching out of this subpart due to a fuel change that results in the boiler meeting the definition of gas-fired boiler, as defined in §63.11237, or you have taken a permit limit that resulted in you becoming subject to this subpart or no longer being subject to this subpart, you must provide notice of the date upon which you switched fuels, made the physical change, or took a permit limit within 30 days of the change. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that have switched fuels, were physically changed, or took a permit limit, and the date of the notice.

(2) The date upon which the fuel switch, physical change, or permit limit occurred.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7511, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§63.11226 [Reserved]

#### Other Requirements and Information

§ 63.11235 What parts of the General Provisions apply to me?

Table 8 to this subpart shows which parts of the General Provisions in §§ 63.1 through 63.15 apply to you.

§ 63.11236 Who implements and enforces this subpart? [INCORPORATED BY REFERENCE]

§ 63.11237 What definitions apply to this subpart? [INCORPORATED BY REFERENCE]

**SECTION E. Source Group Restrictions.****# 002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

Individual sources within this source group that are subject to 40 CFR Part 63 Subpart JJJJJJ shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: SG04

Group Description: MACT Subpart CCCCCC

Sources included in this group

ID	Name
301	600 GALLON GASOLINE TANK

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 001 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.1]****Subpart A--General Provisions****Applicability.**

PART 63—NATIONAL EMISSION STANDARDS FOR HAZARDOUS AIR POLLUTANTS FOR SOURCE CATEGORIES

-----  
 Subpart CCCCCC—National Emission Standards for Hazardous Air Pollutants for Source Category: Gasoline Dispensing Facilities  
 -----

§ 63.11110 What is the purpose of this subpart?

This subpart establishes national emission limitations and management practices for hazardous air pollutants (HAP) emitted from the loading of gasoline storage tanks at gasoline dispensing facilities (GDF). This subpart also establishes requirements to demonstrate compliance with the emission limitations and management practices.

§ 63.11111 Am I subject to the requirements in this subpart?

(a) The affected source to which this subpart applies is each GDF that is located at an area source. The affected source includes each gasoline cargo tank during the delivery of product to a GDF and also includes each storage tank.

(b) If your GDF has a monthly throughput of less than 10,000 gallons of gasoline, you must comply with the requirements in § 63.11116.

**SECTION E. Source Group Restrictions.**

(c) [NA - MONTHLY THRUPUT < 10,000 GALLONS]

(d) [NA - MONTHLY THRUPUT < 10,000 GALLONS]

(e) An affected source shall, upon request by the Administrator, demonstrate that their monthly throughput is less than the 10,000-gallon or the 100,000-gallon threshold level, as applicable. For new or reconstructed affected sources, as specified in § 63.11112(b) and (c), recordkeeping to document monthly throughput must begin upon startup of the affected source. For existing sources, as specified in § 63.11112(d), recordkeeping to document monthly throughput must begin on January 10, 2008. For existing sources that are subject to this subpart only because they load gasoline into fuel tanks other than those in motor vehicles, as defined in § 63.11132, recordkeeping to document monthly throughput must begin on January 24, 2011. Records required under this paragraph shall be kept for a period of 5 years.

(f) If you are an owner or operator of affected sources, as defined in paragraph (a) of this section, you are not required to obtain a permit under 40 CFR part 70 or 40 CFR part 71 as a result of being subject to this subpart. However, you must still apply for and obtain a permit under 40 CFR part 70 or 40 CFR part 71 if you meet one or more of the applicability criteria found in 40 CFR 70.3(a) and (b) or 40 CFR 71.3(a) and (b).

(g) [NA - THIS FACILITY DOES NOT DISPENSE AVIATION GASOLINE]

(h) Monthly throughput is the total volume of gasoline loaded into, or dispensed from, all the gasoline storage tanks located at a single affected GDF. If an area source has two or more GDF at separate locations within the area source, each GDF is treated as a separate affected source.

(i) If your affected source's throughput ever exceeds an applicable throughput threshold, the affected source will remain subject to the requirements for sources above the threshold, even if the affected source throughput later falls below the applicable throughput threshold.

(j) The dispensing of gasoline from a fixed gasoline storage tank at a GDF into a portable gasoline tank for the on-site delivery and subsequent dispensing of the gasoline into the fuel tank of a motor vehicle or other gasoline-fueled engine or equipment used within the area source is only subject to § 63.11116 of this subpart.

(k) [NA - OTHER FEDERAL RULE NOT APPLICABLE]

[73 FR 1945, Jan. 10, 2008, as amended at 76 FR 4181, Jan. 24, 2011]

§ 63.11112 What parts of my affected source does this subpart cover?

(a) The emission sources to which this subpart applies are gasoline storage tanks and associated equipment components in vapor or liquid gasoline service at new, reconstructed, or existing GDF that meet the criteria specified in § 63.11111. Pressure/Vacuum vents on gasoline storage tanks and the equipment necessary to unload product from cargo tanks into the storage tanks at GDF are covered emission sources. The equipment used for the refueling of motor vehicles is not covered by this subpart.

(b) [NA - SOURCE(S) ARE EXISTING]

(c) [NA - SOURCE(S) ARE EXISTING]

(d) An affected source is an existing affected source if it is not new or reconstructed.

§ 63.11113 When do I have to comply with this subpart?

(a) [NA - SOURCE(S) ARE EXISTING]

(b) If you have an existing affected source, you must comply with the standards in this subpart no later than January 10, 2011.

(c) If you have an existing affected source that becomes subject to the control requirements in this subpart because of an



**SECTION E. Source Group Restrictions.**

increase in the monthly throughput, as specified in § 63.11111(c) or § 63.11111(d), you must comply with the standards in this subpart no later than 3 years after the affected source becomes subject to the control requirements in this subpart.

(d) [NA - SOURCE(S) ARE EXISTING]

(e) [NA - MONTHLY THRUPTUT < 10,000 GALLONS]

(f) [NA - NOT SUBJECT TO SUBPART ONLY BECAUSE OF LOADING GASOLINE INTO FUEL TANKS OTHER THAN THOSE IN MOTOR VEHICLES]

[73 FR 1945, Jan. 10, 2008, as amended at 73 FR 35944, June 25, 2008; 76 FR 4181, Jan. 24, 2011]

#### Emission Limitations and Management Practices

§ 63.11115 What are my general duties to minimize emissions?

Each owner or operator of an affected source under this subpart must comply with the requirements of paragraphs (a) and (b) of this section.

(a) You must, at all times, operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) You must keep applicable records and submit reports as specified in § 63.11125(d) and § 63.11126(b).

[76 FR 4182, Jan. 24, 2011]

§ 63.11116 Requirements for facilities with monthly throughput of less than 10,000 gallons of gasoline.

(a) You must not allow gasoline to be handled in a manner that would result in vapor releases to the atmosphere for extended periods of time. Measures to be taken include, but are not limited to, the following:

- (1) Minimize gasoline spills;
- (2) Clean up spills as expeditiously as practicable;
- (3) Cover all open gasoline containers and all gasoline storage tank fill-pipes with a gasketed seal when not in use;
- (4) Minimize gasoline sent to open waste collection systems that collect and transport gasoline to reclamation and recycling devices, such as oil/water separators.

(b) You are not required to submit notifications or reports as specified in § 63.11125, § 63.11126, or subpart A of this part, but you must have records available within 24 hours of a request by the Administrator to document your gasoline throughput.

(c) You must comply with the requirements of this subpart by the applicable dates specified in § 63.11113.

(d) Portable gasoline containers that meet the requirements of 40 CFR part 59, subpart F, are considered acceptable for compliance with paragraph (a)(3) of this section.

[73 FR 1945, Jan. 10, 2008, as amended at 76 FR 4182, Jan. 24, 2011]

§ 63.11117 Requirements for facilities with monthly throughput of 10,000 gallons of gasoline or more.

[NA - MONTHLY THRUPTUT < 10,000 GALLONS]

**SECTION E. Source Group Restrictions.**

§ 63.11118 Requirements for facilities with monthly throughput of 100,000 gallons of gasoline or more.  
[NA - MONTHLY THRUPUT < 10,000 GALLONS]

Testing and Monitoring Requirements

§ 63.11120 What testing and monitoring requirements must I meet?

- (a) [NA - MONTHLY THRUPUT < 10,000 GALLONS]
- (b) [NA - MONTHLY THRUPUT < 10,000 GALLONS: TABLE 1 DOES NOT APPLY]
- (c) [NA - PERFORMANCE TESTING NOT REQUIRED]
- (d) [NA - MONTHLY THRUPUT < 10,000 GALLONS: TABLE 2 DOES NOT APPLY]

[73 FR 1945, Jan. 10, 2008, as amended at 76 FR 4182, Jan. 24, 2011]

Notifications, Records, and Reports

§ 63.11124 What notifications must I submit and when?

- (a) [NA - MONTHLY THRUPUT < 10,000 GALLONS]
- (b) [NA - MONTHLY THRUPUT < 10,000 GALLONS]

[73 FR 1945, Jan. 10, 2008, as amended at 73 FR 12276, Mar. 7, 2008; 76 FR 4182, Jan. 24, 2011]

§ 63.11125 What are my recordkeeping requirements?

- (a) [NA - MONTHLY THRUPUT < 10,000 GALLONS]
- (b) [NA - MONTHLY THRUPUT < 10,000 GALLONS]
- (c) [NA - MONTHLY THRUPUT < 10,000 GALLONS: TABLE 2 DOES NOT APPLY]
- (d) Each owner or operator of an affected source under this subpart shall keep records as specified in paragraphs (d)(1) and (2) of this section.

(1) Records of the occurrence and duration of each malfunction of operation ( i.e., process equipment) or the air pollution control and monitoring equipment.

(2) Records of actions taken during periods of malfunction to minimize emissions in accordance with § 63.11115(a), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation.

[73 FR 1945, Jan. 10, 2008, as amended at 76 FR 4183, Jan. 24, 2011]

§ 63.11126 What are my reporting requirements?

[NA - PER 63.11116(b): MONTHLY THRUPUT < 10,000 GALLONS]

[76 FR 4183, Jan. 24, 2011]

Other Requirements and Information

§ 63.11130 What parts of the General Provisions apply to me?

**SECTION E. Source Group Restrictions.**

Table 3 to this subpart shows which parts of the General Provisions apply to you.

**Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 63 Subpart CCCCCC shall comply with all applicable requirements of the Subpart. 40 CFR 63.13(a) requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: SG05

Group Description: NSPS Subpart Dc

Sources included in this group

ID	Name
035	BOILER 5
036	BOILER 6
037	BOILER 7
205	R BUILDING BOILER

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]  
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units  
Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

**SECTION E. Source Group Restrictions.**

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]

(g) [NA – NOT SUBJECT TO NSPS BBBB]

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO<sub>2</sub>).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO<sub>2</sub> in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) Other fuels-fired affected facilities with heat input capacities between 2.9 and 8.7 MW (10 and 30 MMBtu/h).

(i) The SO<sub>2</sub> emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) [NA – UNIT(S) < 30 MMBTU]

**SECTION E. Source Group Restrictions.**

(d) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(e)(1) [NA – UNIT(S) < 30 MMBTU]

(2) [NA – UNIT(S) < 30 MMBTU]

(3) [NA – UNIT(S) < 30 MMBTU]

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO<sub>2</sub> emissions is not subject to the PM limit in this section.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(b) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(c) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

NOTE: The permittee does NOT use residual oil in these combustion units.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO<sub>2</sub> standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

**SECTION E. Source Group Restrictions.**

(a) - (f) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

(d) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO<sub>2</sub> emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

(1) Calendar dates covered in the reporting period.

(2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) For other fuels:

(i) The name of the supplier of the fuel;

(ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and

(iii) The method used to determine the potential sulfur emissions rate of the fuel.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

**SECTION E. Source Group Restrictions.**

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the SO<sub>2</sub> standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood, distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO<sub>2</sub> standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

**# 002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]**

**Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units  
Applicability and delegation of authority.**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. Copies of all requests, reports and other communications shall be forwarded to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.



**SECTION E. Source Group Restrictions.**

Group Name: SG07

Group Description: NSPS Subpart KKKK

Sources included in this group

ID	Name
401	TURBINE #1 - 5 MEGAWATT
402	TURBINE #2 - 5 MEGAWATT

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4300]****Subpart KKKK - Standards of Performance for Stationary Combustion Turbines****What is the purpose of this subpart?**

§60.4300 What is the purpose of this subpart?

This subpart establishes emission standards and compliance schedules for the control of emissions from stationary combustion turbines that commenced construction, modification or reconstruction after February 18, 2005.

**APPLICABILITY**

§60.4305 Does this subpart apply to my stationary combustion turbine?

(a) If you are the owner or operator of a stationary combustion turbine with a heat input at peak load equal to or greater than 10.7 gigajoules (10 MMBtu) per hour, based on the higher heating value of the fuel, which commenced construction, modification, or reconstruction after February 18, 2005, your turbine is subject to this subpart. Only heat input to the combustion turbine should be included when determining whether or not this subpart is applicable to your turbine. Any additional heat input to associated heat recovery steam generators (HRSG) or duct burners should not be included when determining your peak heat input. However, this subpart does apply to emissions from any associated HRSG and duct burners.

(b) Stationary combustion turbines regulated under this subpart are exempt from the requirements of subpart GG of this

**SECTION E. Source Group Restrictions.**

part. Heat recovery steam generators and duct burners regulated under this subpart are exempted from the requirements of subparts Da, Db, and Dc of this part.

§60.4310 What types of operations are exempt from these standards of performance?

[NA - TURBINES TO NOT MEET EXEMPTIONS]

**EMISSION LIMITS**

§60.4315 What pollutants are regulated by this subpart?

The pollutants regulated by this subpart are nitrogen oxide (NOX) and sulfur dioxide (SO<sub>2</sub>).

§60.4320 What emission limits must I meet for nitrogen oxides (NOX)?

(a) You must meet the emission limits for NOX specified in Table 1 to this subpart.

**TABLE 1 REQUIREMENTS**

Combustion turbine type: New turbine firing natural gas

Combustion turbine heat input at peak load (HHV): 50 MMBtu/h and 850 MMBtu/h

NOX emission standard: 25 ppm at 15 percent O<sub>2</sub> or 150 ng/J of useful output (1.2 lb/MWh).

**END OF TABLE 1 REQUIREMENTS**

(b) [NA - EACH TURBINE IS CONNECTED TO ITS OWN GENERATOR]

§60.4325 What emission limits must I meet for NOX if my turbine burns both natural gas and distillate oil (or some other combination of fuels)?

[NA - UNITS DO NOT BURN OIL]

§60.4330 What emission limits must I meet for sulfur dioxide (SO<sub>2</sub>)?

(a) If your turbine is located in a continental area, you must comply with either paragraph (a)(1), (a)(2), or (a)(3) of this section. If your turbine is located in Alaska, you do not have to comply with the requirements in paragraph (a) of this section until January 1, 2008.

(1) You must not cause to be discharged into the atmosphere from the subject stationary combustion turbine any gases which contain SO<sub>2</sub> in excess of 110 nanograms per Joule (ng/J) (0.90 pounds per megawatt-hour (lb/MWh)) gross output;

(2) You must not burn in the subject stationary combustion turbine any fuel which contains total potential sulfur emissions in excess of 26 ng SO<sub>2</sub>/J (0.060 lb SO<sub>2</sub>/MMBtu) heat input. If your turbine simultaneously fires multiple fuels, each fuel must meet this requirement; or

(3) [NA - UNITS DO NOT BURN BIOGAS]

(b) [NA - NOT LOCATED IN NON-CONTINENTAL AREA]

[71 FR 38497, July 6, 2006, as amended at 74 FR 11861, Mar. 20, 2009]

**GENERAL COMPLIANCE REQUIREMENTS**

§60.4333 What are my general requirements for complying with this subpart?

(a) You must operate and maintain your stationary combustion turbine, air pollution control equipment, and monitoring equipment in a manner consistent with good air pollution control practices for minimizing emissions at all times including

**SECTION E. Source Group Restrictions.**

during startup, shutdown, and malfunction.

(b) [NA - EACH TURBINE HAS ITS OWN HEAT RECOVERY GENERATOR]

**MONITORING**

§60.4335 How do I demonstrate compliance for NOX if I use water or steam injection?

[NA - UNITS DO NOT USE WATER OR STEAM INJECTION]

§60.4340 How do I demonstrate continuous compliance for NOX if I do not use water or steam injection?

(a) If you are not using water or steam injection to control NOX emissions, you must perform annual performance tests in accordance with §60.4400 to demonstrate continuous compliance. If the NOX emission result from the performance test is less than or equal to 75 percent of the NOX emission limit for the turbine, you may reduce the frequency of subsequent performance tests to once every 2 years (no more than 26 calendar months following the previous performance test). If the results of any subsequent performance test exceed 75 percent of the NOX emission limit for the turbine, you must resume annual performance tests.

(b) [NA - CEMS/CPMS OPTIONS NOT CHOSEN]

§60.4345 What are the requirements for the continuous emission monitoring system equipment, if I choose to use this option?

[NA - CEMS OPTION NOT CHOSEN]

§60.4350 How do I use data from the continuous emission monitoring equipment to identify excess emissions?

[NA - CEMS OPTION NOT CHOSEN]

§60.4355 How do I establish and document a proper parameter monitoring plan?

[NA - CPMS OPTION NOT CHOSEN]

§60.4360 How do I determine the total sulfur content of the turbine's combustion fuel?

[NA - PERMITEE USES OPTION IN 60.4365(a)]

§60.4365 How can I be exempted from monitoring the total sulfur content of the fuel?

You may elect not to monitor the total sulfur content of the fuel combusted in the turbine, if the fuel is demonstrated not to exceed potential sulfur emissions of 26 ng SO<sub>2</sub>/J (0.060 lb SO<sub>2</sub>/MMBtu) heat input for units located in continental areas and 180 ng SO<sub>2</sub>/J (0.42 lb SO<sub>2</sub>/MMBtu) heat input for units located in noncontinental areas or a continental area that the Administrator determines does not have access to natural gas and that the removal of sulfur compounds would cause more environmental harm than benefit. You must use one of the following sources of information to make the required demonstration:

(a) The fuel quality characteristics in a current, valid purchase contract, tariff sheet or transportation contract for the fuel, specifying that the maximum total sulfur content for oil use in continental areas is 0.05 weight percent (500 ppmw) or less and 0.4 weight percent (4,000 ppmw) or less for noncontinental areas, the total sulfur content for natural gas use in continental areas is 20 grains of sulfur or less per 100 standard cubic feet and 140 grains of sulfur or less per 100 standard cubic feet for noncontinental areas, has potential sulfur emissions of less than less than 26 ng SO<sub>2</sub>/J (0.060 lb SO<sub>2</sub>/MMBtu) heat input for continental areas and has potential sulfur emissions of less than less than 180 ng SO<sub>2</sub>/J (0.42 lb SO<sub>2</sub>/MMBtu) heat input for noncontinental areas; or

(b) [NA - PERMITEE USES OPTION IN 60.4365(a)]

**SECTION E. Source Group Restrictions.**

§60.4370 How often must I determine the sulfur content of the fuel?

[NA - PERMITEE USES OPTION IN 60.4365(a)]

**REPORTING**

§60.4375 What reports must I submit?

(a) For each affected unit required to continuously monitor parameters or emissions, or to periodically determine the fuel sulfur content under this subpart, you must submit reports of excess emissions and monitor downtime, in accordance with §60.7(c). Excess emissions must be reported for all periods of unit operation, including start-up, shutdown, and malfunction.

(b) For each affected unit that performs annual performance tests in accordance with §60.4340(a), you must submit a written report of the results of each performance test before the close of business on the 60th day following the completion of the performance test.

§60.4380 How are excess emissions and monitor downtime defined for NOX?

[NA - CEMS/CPMS OPTIONS NOT CHOSEN]

§60.4385 How are excess emissions and monitoring downtime defined for SO<sub>2</sub>?

[NA - PERMITEE USES OPTION IN 60.4365(a)]

§60.4390 What are my reporting requirements if I operate an emergency combustion turbine or a research and development turbine?

[NA - NOT AN EMERGENCY OR R&D TURBINE]

§60.4395 When must I submit my reports?

All reports required under §60.7(c) must be postmarked by the 30th day following the end of each 6-month period.

**PERFORMANCE TESTS**

§60.4400 How do I conduct the initial and subsequent performance tests, regarding NOX?

(a) You must conduct an initial performance test, as required in §60.8. Subsequent NOX performance tests shall be conducted on an annual basis (no more than 14 calendar months following the previous performance test).

(1) - (3) [SEE REGULATION FOR TEST METHODS]

(b) The performance test must be done at any load condition within plus or minus 25 percent of 100 percent of peak load. You may perform testing at the highest achievable load point, if at least 75 percent of peak load cannot be achieved in practice. You must conduct three separate test runs for each performance test. The minimum time per run is 20 minutes.

(1) [NA - UNITS DO NOT COMBUST OIL]

(2) [NA - NO DUCT BURNERS]

(3) [NA - UNITS DO NOT USE WATER OR STEAM INJECTION]

(4) Compliance with the applicable emission limit in §60.4320 must be demonstrated at each tested load level. Compliance is achieved if the three-run arithmetic average NOX emission rate at each tested level meets the applicable emission limit in §60.4320.

**SECTION E. Source Group Restrictions.**

(5) [NA - CEMS OPTION NOT CHOSEN]

(6) The ambient temperature must be greater than 0 °F during the performance test.

§60.4405 How do I perform the initial performance test if I have chosen to install a NOX-diluent CEMS?

[NA - CEMS OPTION NOT CHOSEN]

§60.4410 How do I establish a valid parameter range if I have chosen to continuously monitor parameters?

[NA - CPMS OPTION NOT CHOSEN]

§60.4415 How do I conduct the initial and subsequent performance tests for sulfur?

[NA - PERMITEE USES OPTION IN 60.4365(a)]

**# 002 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4300]****Subpart KKKK - Standards of Performance for Stationary Combustion Turbines****What is the purpose of this subpart?**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart KKKK shall comply with all applicable requirements of the Subpart. Copies of all requests, reports and other communications shall be forwarded to both the Department and the EPA. The EPA copies shall be forwarded to:

Director  
Air Protection Division (3AP00)  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: SG08

Group Description: NSPS Subpart IIII

Sources included in this group

ID	Name
117	GENERATOR 17
118	GENERATOR 18

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4200]  
Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines  
Am I subject to this subpart?**

§ 60.4200 Am I subject to this subpart?

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary compression ignition (CI) internal combustion engines (ICE) and other persons as specified in paragraphs (a)(1) through (4) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1) [NA - NOT AN ENGINE MANUFACTURER]

(2) Owners and operators of stationary CI ICE that commence construction after July 11, 2005, where the stationary CI ICE are:

(i) Manufactured after April 1, 2006, and are not fire pump engines, or

(ii) [NA - NOT FIRE PUMP ENGINE(S)]

(3) [NA - NOT MODIFIED OR RECONSTRUCTED]

**SECTION E. Source Group Restrictions.**

(4) The provisions of § 60.4208 of this subpart are applicable to all owners and operators of stationary CI ICE that commence construction after July 11, 2005.

(b) [NA - NOT STATIONARY TEST CELL]

(c) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or 40 CFR part 71, provided you are not required to obtain a permit under 40 CFR 70.3(a) or 40 CFR 71.3(a) for a reason other than your status as an area source under this subpart. Notwithstanding the previous sentence, you must continue to comply with the provisions of this subpart applicable to area sources.

(d) [NA - NO NATIONAL SECURITY EXEMPTION]

(e) [NA - NOT TEMPORARY REPLACEMENT UNIT]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37967, June 28, 2011]

#### Emission Standards for Owners and Operators

§ 60.4204 What emission standards must I meet for non-emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

[NA - UNIT(S) ARE EMERGENCY]

§ 60.4205 What emission standards must I meet for emergency engines if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA - UNIT(S) ARE POST 2007]

(b) Owners and operators of 2007 model year and later emergency stationary CI ICE with a displacement of less than 30 liters per cylinder that are not fire pump engines must comply with the emission standards for new nonroad CI engines in § 60.4202, for all pollutants, for the same model year and maximum engine power for their 2007 model year and later emergency stationary CI ICE.

#### 60.4202(a) REQUIREMENTS:

(a) Stationary CI internal combustion engine manufacturers must certify their 2007 model year and later emergency stationary CI ICE with a maximum engine power less than or equal to 2,237 KW (3,000 HP) and a displacement of less than 10 liters per cylinder that are not fire pump engines to the emission standards specified in paragraphs (a)(1) through (2) of this section.

(1) [NA - UNITS > 50 HP]

(2) For engines with a maximum engine power greater than or equal to 37 KW (50 HP), the certification emission standards for new nonroad CI engines for the same model year and maximum engine power in 40 CFR 89.112 and 40 CFR 89.113 for all pollutants beginning in model year 2007.

NOTE: ACCORDING TO THE CERTIFICATION PAPERWORK, THE UNITS ARE CERTIFIED TO THE 2013 EPA TIER 2 STANDARDS FOR STATIONARY EMERGENCY GENERATORS, AS FOLLOWS"

NOX + NMHC: 4.8 G/HP-HR

CO: 2.6 G/HP-HR

PM: 0.15 G/HP-HR

#### END OF 60.4202(a) REQUIREMENTS:

(c) [NA - NOT FIRE PUMP ENGINE(S)]

**SECTION E. Source Group Restrictions.**

(d) [NA - UNIT(S) ARE < 30 L/CYL]

(e) Owners and operators of emergency stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests in-use must meet the NTE standards as indicated in § 60.4212.

(f) [NA - NOT MODIFIED OR RECONSTRUCTED]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

§ 60.4206 How long must I meet the emission standards if I am an owner or operator of a stationary CI internal combustion engine?

Owners and operators of stationary CI ICE must operate and maintain stationary CI ICE that achieve the emission standards as required in §§ 60.4204 and 60.4205 over the entire life of the engine.

[76 FR 37969, June 28, 2011]

Fuel Requirements for Owners and Operators

§ 60.4207 What fuel requirements must I meet if I am an owner or operator of a stationary CI internal combustion engine subject to this subpart?

(a) Beginning October 1, 2007, owners and operators of stationary CI ICE subject to this subpart that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(a).

(b) Beginning October 1, 2010, owners and operators of stationary CI ICE subject to this subpart with a displacement of less than 30 liters per cylinder that use diesel fuel must use diesel fuel that meets the requirements of 40 CFR 80.510(b) for nonroad diesel fuel, except that any existing diesel fuel purchased (or otherwise obtained) prior to October 1, 2010, may be used until depleted.

(c) [Reserved]

(d) [NA - UNIT(S) ARE < 30 L/CYL]

(e) [NA - NO NATIONAL SECURITY EXEMPTION]

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011; 78 FR 6695, Jan. 30, 2013]

Other Requirements for Owners and Operators

§ 60.4208 What is the deadline for importing or installing stationary CI ICE produced in previous model years?

(a) After December 31, 2008, owners and operators may not install stationary CI ICE (excluding fire pump engines) that do not meet the applicable requirements for 2007 model year engines.

(b) [NA - UNIT(S) >25 HP]

(c) [NA - UNIT(S) ARE EMERGENCY]

(d) [NA - UNIT(S) ARE EMERGENCY]

(e) [NA - UNIT(S) ARE EMERGENCY]

(f) [NA - UNIT(S) ARE EMERGENCY]

(g) [NA - UNIT(S) ARE EMERGENCY]



**SECTION E. Source Group Restrictions.**

(h) In addition to the requirements specified in §§ 60.4201, 60.4202, 60.4204, and 60.4205, it is prohibited to import stationary CI ICE with a displacement of less than 30 liters per cylinder that do not meet the applicable requirements specified in paragraphs (a) through (g) of this section after the dates specified in paragraphs (a) through (g) of this section.

(i) The requirements of this section do not apply to owners or operators of stationary CI ICE that have been modified, reconstructed, and do not apply to engines that were removed from one existing location and reinstalled at a new location.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

§ 60.4209 What are the monitoring requirements if I am an owner or operator of a stationary CI internal combustion engine?

If you are an owner or operator, you must meet the monitoring requirements of this section. In addition, you must also meet the monitoring requirements specified in § 60.4211.

(a) If you are an owner or operator of an emergency stationary CI internal combustion engine that does not meet the standards applicable to non-emergency engines, you must install a non-resettable hour meter prior to startup of the engine.

(b) If you are an owner or operator of a stationary CI internal combustion engine equipped with a diesel particulate filter to comply with the emission standards in § 60.4204, the diesel particulate filter must be installed with a backpressure monitor that notifies the owner or operator when the high backpressure limit of the engine is approached.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37969, June 28, 2011]

#### Compliance Requirements

§ 60.4210 What are my compliance requirements if I am a stationary CI internal combustion engine manufacturer?

[NA - NOT AN ENGINE MANUFACTURER]

§ 60.4211 What are my compliance requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) If you are an owner or operator and must comply with the emission standards specified in this subpart, you must do all of the following, except as permitted under paragraph (g) of this section:

(1) Operate and maintain the stationary CI internal combustion engine and control device according to the manufacturer's emission-related written instructions;

(2) Change only those emission-related settings that are permitted by the manufacturer; and

(3) Meet the requirements of 40 CFR parts 89, 94 and/or 1068, as they apply to you.

(b) [NA – POST-2006 MODEL]

(c) If you are an owner or operator of a 2007 model year and later stationary CI internal combustion engine and must comply with the emission standards specified in §60.4204(b) or §60.4205(b), or if you are an owner or operator of a CI fire pump engine that is manufactured during or after the model year that applies to your fire pump engine power rating in table 3 to this subpart and must comply with the emission standards specified in §60.4205(c), you must comply by purchasing an engine certified to the emission standards in §60.4204(b), or §60.4205(b) or (c), as applicable, for the same model year and maximum (or in the case of fire pumps, NFPA nameplate) engine power. The engine must be installed and configured according to the manufacturer's emission-related specifications, except as permitted in paragraph (g) of this section.

(d) [NA - UNIT IS NOT SUBJECT TO § 60.4204(c) or § 60.4205(d)]

(e) [NA - NOT MODIFIED/RECONSTRUCTED]

**SECTION E. Source Group Restrictions.**

(f) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (f)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (3) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (3) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (f)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii) [VACATED PER COURT ORDER AS OF 5/2/16]

(iii) [VACATED PER COURT ORDER AS OF 5/2/16]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraph (f)(3)(i) of this section, the 50 hours per calendar year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) The 50 hours per year for non-emergency situations can be used to supply power as part of a financial arrangement with another entity if all of the following conditions are met:

(A) The engine is dispatched by the local balancing authority or local transmission and distribution system operator;

(B) The dispatch is intended to mitigate local transmission and/or distribution limitations so as to avert potential voltage collapse or line overloads that could lead to the interruption of power supply in a local area or region.

(C) The dispatch follows reliability, emergency operation or similar protocols that follow specific NERC, regional, state, public utility commission or local standards or guidelines.

(D) The power is provided only to the facility itself or to support the local transmission and distribution system.

(E) The owner or operator identifies and records the entity that dispatches the engine and the specific NERC, regional, state, public utility commission or local standards or guidelines that are being followed for dispatching the engine. The local balancing authority or local transmission and distribution system operator may keep these records on behalf of the engine owner or operator.

(ii) [Reserved]

(g) If you do not install, configure, operate, and maintain your engine and control device according to the manufacturer's emission-related written instructions, or you change emission-related settings in a way that is not permitted by the manufacturer, you must demonstrate compliance as follows:

(1) [NA – UNIT IS > 100 HP]

**SECTION E. Source Group Restrictions.**

(2) If you are an owner or operator of a stationary CI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer.

(3) If you are an owner or operator of a stationary CI internal combustion engine greater than 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test to demonstrate compliance with the applicable emission standards within 1 year of startup, or within 1 year after an engine and control device is no longer installed, configured, operated, and maintained in accordance with the manufacturer's emission-related written instructions, or within 1 year after you change emission-related settings in a way that is not permitted by the manufacturer. You must conduct subsequent performance testing every 8,760 hours of engine operation or 3 years, whichever comes first, thereafter to demonstrate compliance with the applicable emission standards.

(h) The requirements for operators and prohibited acts specified in 40 CFR 1039.665 apply to owners or operators of stationary CI ICE equipped with AECs for qualified emergency situations as allowed by 40 CFR 1039.665.

[71 FR 39172, July 11, 2006, as amended at 76 FR 37970, June 28, 2011; 78 FR 6695, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

#### Testing Requirements for Owners and Operators

§ 60.4212 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of less than 30 liters per cylinder?

Owners and operators of stationary CI ICE with a displacement of less than 30 liters per cylinder who conduct performance tests pursuant to this subpart must do so according to paragraphs (a) through (e) of this section.

[SEE REGULATION FOR DETAILED TEST METHODS]

§ 60.4213 What test methods and other procedures must I use if I am an owner or operator of a stationary CI internal combustion engine with a displacement of greater than or equal to 30 liters per cylinder?

[NA - UNIT(S) ARE < 30 L/CYL]

#### Notification, Reports, and Records for Owners and Operators

§ 60.4214 What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary CI internal combustion engine?

(a) [NA – UNIT IS EMERGENCY]

(b) If the stationary CI internal combustion engine is an emergency stationary internal combustion engine, the owner or operator is not required to submit an initial notification. Starting with the model years in table 5 to this subpart, if the emergency engine does not meet the standards applicable to non-emergency engines in the applicable model year, the owner or operator must keep records of the operation of the engine in emergency and non-emergency service that are recorded through the non-resettable hour meter. The owner must record the time of operation of the engine and the reason the engine was in operation during that time.

(c) If the stationary CI internal combustion engine is equipped with a diesel particulate filter, the owner or operator must keep records of any corrective action taken after the backpressure monitor has notified the owner or operator that the high backpressure limit of the engine is approached.

**SECTION E. Source Group Restrictions.**

(d) If you own or operate an emergency stationary CI ICE with a maximum engine power more than 100 HP that operates or is contractually obligated to be available for more than 15 hours per calendar year for the purposes specified in §60.4211(f)(2)(ii) and (iii) or that operates for the purposes specified in §60.4211(f)(3)(i), you must submit an annual report according to the requirements in paragraphs (d)(1) through (3) of this section.

(1) The report must contain the following information:

(i) Company name and address where the engine is located.

(ii) Date of the report and beginning and ending dates of the reporting period.

(iii) Engine site rating and model year.

(iv) Latitude and longitude of the engine in decimal degrees reported to the fifth decimal place.

(v) Hours operated for the purposes specified in §60.4211(f)(2)(ii) and (iii), including the date, start time, and end time for engine operation for the purposes specified in §60.4211(f)(2)(ii) and (iii).

(vi) Number of hours the engine is contractually obligated to be available for the purposes specified in §60.4211(f)(2)(ii) and (iii).

(vii) Hours spent for operation for the purposes specified in §60.4211(f)(3)(i), including the date, start time, and end time for engine operation for the purposes specified in §60.4211(f)(3)(i). The report must also identify the entity that dispatched the engine and the situation that necessitated the dispatch of the engine.

(2) The first annual report must cover the calendar year 2015 and must be submitted no later than March 31, 2016. Subsequent annual reports for each calendar year must be submitted no later than March 31 of the following calendar year.

(3) The annual report must be submitted electronically using the subpart specific reporting form in the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) ([www.epa.gov/cdx](http://www.epa.gov/cdx)). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written report must be submitted to the Administrator at the appropriate address listed in §60.4.

(e) Owners or operators of stationary CI ICE equipped with AECDs pursuant to the requirements of 40 CFR 1039.665 must report the use of AECDs as required by 40 CFR 1039.665(e).

[71 FR 39172, July 11, 2006, as amended at 78 FR 6696, Jan. 30, 2013; 81 FR 44219, July 7, 2016]

**Special Requirements**

§ 60.4215 What requirements must I meet for engines used in Guam, American Samoa, or the Commonwealth of the Northern Mariana Islands?

[NA - UNIT(S) DO NOT MEET SPECIFIED GEOGRAPHY]

§ 60.4216 What requirements must I meet for engines used in Alaska?

[NA - UNIT(S) DO NOT MEET SPECIFIED GEOGRAPHY]

§ 60.4217 What emission standards must I meet if I am an owner or operator of a stationary internal combustion engine using special fuels?

[NA - UNIT(S) DO NOT USE SPECIAL FUELS]

**General Provisions**

§ 60.4218 What parts of the General Provisions apply to me?

**SECTION E. Source Group Restrictions.**

Table 8 to this subpart shows which parts of the General Provisions in §§ 60.1 through 60.19 apply to you.

**Reporting Addresses & Regulatory Changes**

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart IIII shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Associate Director  
Office of Air Enforcement and Compliance Assistance, 3AP20  
U.S. EPA Region III  
1650 Arch Street  
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: SG09

Group Description: Turbine Group

Sources included in this group

ID	Name
401	TURBINE #1 - 5 MEGAWATT
402	TURBINE #2 - 5 MEGAWATT

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The operation of the turbines shall not result in any malodorous emissions.

**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The natural gas burned in the combustion turbines shall meet the definition of pipeline natural gas as per 40 CFR Part 72.2. Documentation shall be as per Appendix D to 40 Part 75 Section 2.3.1.4 -Documentation that a Fuel is Pipeline Natural Gas.

**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Pursuant to the Best Available Technology (BAT) provision of 25 Pa. Code Section 127.1, the permittee shall limit the emission of VOCs to 5.0 ppmvd, on an hourly basis volume corrected to 15 percent oxygen under normal operation for natural gas firing, unless established otherwise and approved by the Department as a result of the initial stack test.

**II. TESTING REQUIREMENTS.****# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) Pursuant to 25 Pa. Code § 139.3 at least 90 calendar days prior to commencing an emissions testing program, unless otherwise approved in writing by DEP, a test protocol shall be submitted to the Department for review and approval. Unless otherwise approved in writing by DEP, the permittee shall not conduct the test that is the subject of the protocol, until the protocol has been approved by DEP.

(b) Pursuant to 25 Pa. Code § 139.3 at least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the appropriate Regional Office. Notification shall also be sent to the Division of Source Testing and Monitoring. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.

(c) Pursuant to 25 Pa. Code Section 139.53(a)(3) within 15 calendar days after completion of the on-site testing portion of an emission test program, if a complete test report has not yet been submitted, an electronic mail notification shall be sent to the Department's Division of Source Testing and Monitoring and the appropriate Regional Office indicating the completion date of the on-site testing.

(d) Pursuant to 40 CFR Part 60.8(a), 40 CFR Part 61.13(f) and 40 CFR Part 63.7(g) a complete test report shall be submitted to the Department no later than 60 calendar days after completion of the on-site testing portion of an emission test program. For those tests being conducted pursuant to 40 CFR Part 61, a complete test report shall be submitted within 31 days after completion of the test

(e) Pursuant to 25 Pa. Code Section 139.53(b) a complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or non-compliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:

1. A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.

**SECTION E. Source Group Restrictions.**

2. Permit number(s) and condition(s) which are the basis for the evaluation.
3. Summary of results with respect to each applicable permit condition.
4. Statement of compliance or non-compliance with each applicable permit condition.

(f) Pursuant to 25 Pa. Code § 139.3 to all submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.

(g) All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.

(h) Pursuant to 25 Pa. Code Section 139.53(a)(1) and 139.53(a)(3) all submittals, besides notifications, shall be accomplished through PSIMS\*Online available through <https://www.depgreenport.state.pa.us/ecommm/Login.jsp> when it becomes available. If internet submittal cannot be accomplished, one digital copy of each submittal shall be made to each of the following:

Regional Office:

Digital copy: RA-epsctesttesting@pa.gov

Bureau of Air Quality:

Digital copy: RA-epstacktesting@pa.gov

(h)(1) A complete paper copy of each submittal shall be made to PA DEP, Bureau of Air Quality, Division of Source Testing and Monitoring, 400 Market Street, 12th Floor Rachael Carson State Office Building, Harrisburg, PA 17105-8468

(h)(2) A paper copy of (only) the cover letter/page (for both protocols and reports) and summary table (for reports only), of each submittal shall be made to Program Manager, Air Quality Program, PA DEP Southcentral Regional Office, 909 Elmerton Avenue, Harrisburg, PA 17110

(i) The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

**# 005 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The permittee shall, at a minimum, record the following:

- (a) Monthly fuel consumption rate and 12-month rolling total fuel consumption for each combustion turbine.
- (b) Hours of start-up and shutdown for each turbine.
- (c) Monthly hours of operation for each turbine in each mode.

**# 006 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The permittee shall record each start-up and shutdown, including date and times of each event. Emissions during start-up will be calculated based upon the emissions estimates approved by the Department and included in the total 12-month emissions recorded.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.****VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Group TURB 01 consists of two (2) combined heat and power turbines, manufactured by Solar Turbines, Model Centaur 50-6200S, with the capacity to produce 5.0 mega-watts of electricity at a peak load equal to 58.15 MMBtu/hr fired solely on natural gas.

**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Pursuant to Best Available Technology (BAT) requirements of 25 Pa. Code Sections 127.1 and 127.12, sources in Group TURB 01 shall be equipped with Solar, Dry Low Emissions (SoLoNOx), NOx control devices.

**# 009 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

If the permittee selects the option to use continuous emissions monitoring or continuous parameter monitoring as an alternative to annual stack testing, the permittee shall first obtain a permit modification or new plan approval for the change.

**# 010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4]****Subpart A - General Provisions****Address.**

These turbines are subject to Subpart KKKK of the Standards of Performance for Stationary Combustion Turbines and the permittee shall comply with all applicable requirements of this Subpart. 40 CFR Section 60.4 requires submission of copies of all requests, reports, applications, submittals, and other communications to both EPA and the Department.

The EPA copies shall be forwarded to:

Director  
Air Protection Division  
Mail Code 3AP00  
U.S. EPA, Region III  
1650 Arch Street  
Philadelphia, Pa 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager  
Southcentral Region  
PA Department of Environmental Protection  
909 Elmerton Avenue  
Harrisburg, PA 17110





**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this State Only facility.



**SECTION G. Emission Restriction Summary.**

No emission restrictions listed in this section of the permit.



## SECTION H. Miscellaneous.

Information has been gathered from the previous version of Operating Permit No. 06-05096 issued on April 17, 2014 and amended on January 23, 2017. This permit supercedes that permit.

All of the capacity/throughput values listed in Sections A and D are for informational purposes only and are not operation limits unless stated so in conditions in Section D or Section E.

Fuel Material Location - FML 302 consists of the following fuel oil tanks:

- Two above ground 15,000-gallon tanks.
- Two underground 4,000-gallon tanks.
- One underground 30,000-gallon tank.

The following sources and activities are not subject to any specific work practice standards, testing, monitoring, recordkeeping or reporting requirements:

- 5.23 mmBtu/hr natural gas fired Cleaver Brooks Boiler Model # CB 700-125.
- Medical Laboratories.
- Anesthesia usage.
- One 1000-gallon diesel tank for vehicle usage.

The waste heat recovery boilers (no respective burner), DEP Source ID Nos. 403 and 404, are non-fired waste heat recovery boilers, manufactured by Superior Boiler Works, Model WH100, with a capacity of 23.4 MMBtu/hr generated solely from waste heat from dedicated natural gas fired turbines.



\*\*\*\*\* End of Report \*\*\*\*\*

