



COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM

STATE ONLY OPERATING PERMIT

Issue Date: February 5, 2021

Effective Date: June 1, 2021

Expiration Date: May 31, 2026

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 05-03011

Federal Tax Id - Plant Code: 27-1065977-1

Owner Information

Name: BLUE TRIANGLE HARDWOODS LLC
Mailing Address: 156 INDUSTRIAL BLVD
EVERETT, PA 15537-3326

Plant Information

Plant: BLUE TRIANGLE HARDWOOD LLC/EVERETT
Location: 05 Bedford County 05935 West Providence Township
SIC Code: 2421 Manufacturing - Sawmills And Planing Mills, General

Responsible Official

Name: BRAD HERRON
Title: COORDINATOR
Phone: (814) 652 - 9111

Permit Contact Person

Name: TODD HAUZE
Title: BOILER SUPERVISOR
Phone: (814) 652 - 9111

[Signature] _____
WILLIAM R. WEAVER, SOUTH CENTRAL REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)

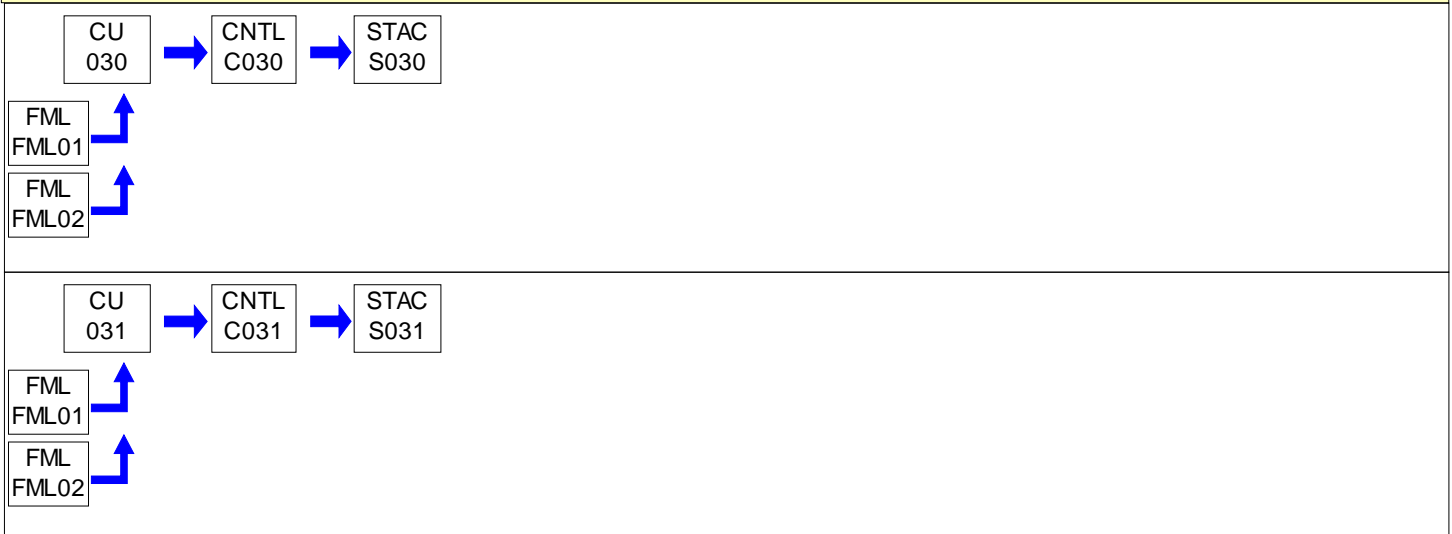
- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

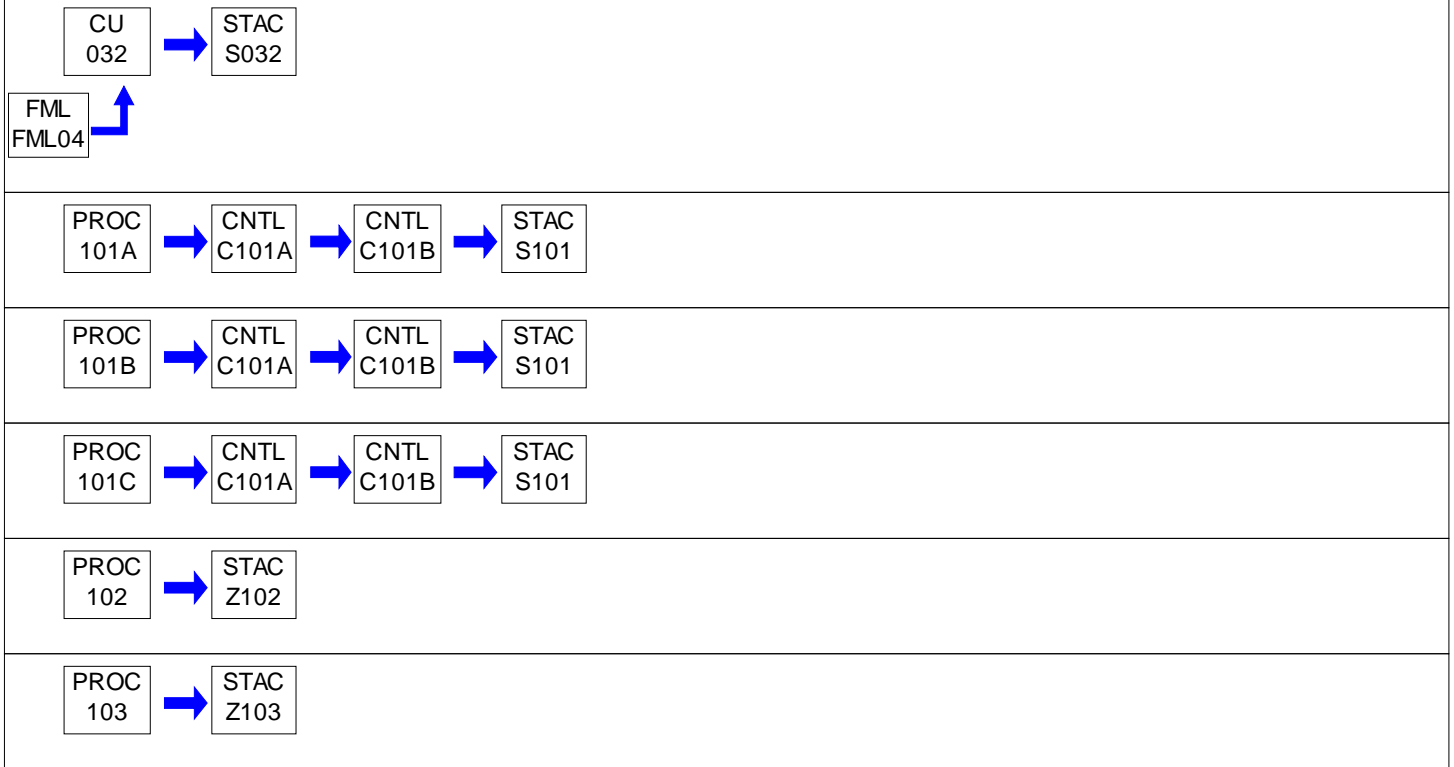
Section G. Emission Restriction Summary

Section H. Miscellaneous

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
030	WOOD FIRED BOILER	11.700 MMBTU/HR	
		3,003.000 Lbs/HR	SAWDUST
031	WOOD FIRED BOILER	17.200 MMBTU/HR	
		4,800.000 Lbs/HR	SAWDUST
032	UNIT 4 (OIL-FIRED BOILER) CLEAVER-BROOKS CB-350	11.700 MMBTU/HR	
		85.000 Gal/HR	#2 Oil
101A	MCI TRIMS SAW	1,330.000 Each/HR	HARDWOOD
101B	NEWMAN S-282 PLANER	1,330.000 Each/HR	HARDWOOD
101C	NEWMAN & WHITNEY KF24 RIP SAW	1,330.000 Each/HR	HARDWOOD
102	COLD CLEANING MACHINE	1.000 Lbs/HR	SOLVENT
103	GASOLINE STORAGE TANK - 10,000 GAL		
C030	MULTICLONE		
C031	MULTICLONE		
C101A	GRADING BUILDING CYCLONE		
C101B	BAGHOUSE		
FML01	SAWDUST		
FML02	PROPANE		
FML04	HEATING OIL SOURCES 032		
S030	BOILER STACK		
S031	BOILER STACK		
S032	BOILER (032) STACK		
S101	GRADING BUILDING STACK		
Z102	FUGITIVE SOLVENT EMISSIONS		
Z103	FUGITIVE GASOLINE EMISSIONS		

PERMIT MAPS

PERMIT MAPS

**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
- (1) For a synthetic minor facility, a fee equal to:
- (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
 - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
 - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

**SECTION B. General State Only Requirements**

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

SECTION B. General State Only Requirements

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11]**Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

No person shall permit the emission into the outdoor atmosphere of any fugitive air contaminant from a source other than the following:

- (a) Construction or demolition of buildings or structures.
- (b) Grading, paving and maintenance of roads and streets.
- (c) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (d) Clearing of land.
- (e) Stockpiling of materials.
- (f) Open burning operations.
- (g) Sources and classes of sources other than those identified above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - 1) the emissions are of minor significance with respect to causing air pollution;
 - 2) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air standard.

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

No person shall emit fugitive particulate matter into the outdoor atmosphere from a source specified in Section C, Condition #001 if the emissions are visible at the point the emissions pass outside the person's property.

003 [25 Pa. Code §123.31]**Limitations**

No person shall permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]**Limitations**

The permittee may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.
- (2) Equal to or greater than 60 % at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The emission limitations of Section 123.41 shall not apply when:

- (1) The presence of uncombined water is the only reason for failure of the emission to meet the limitation;
- (2) The emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions;
- (3) The emission results from sources specified in Section C, Condition #001 (relating to prohibition of certain fugitive emissions).

SECTION C. Site Level Requirements**II. TESTING REQUIREMENTS.****# 006 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The Department reserves the right to require exhaust stack testing of the sources as necessary during the permit term to verify emissions for purposes including permit condition violations, malfunctions, or emission fees.

007 [25 Pa. Code §139.1]**Sampling facilities.**

Upon request by the Department, the permittee shall provide adequate sampling ports, safe sampling, platforms and adequate utilities for the performance by the Department of tests on such source. The Department will set forth, in the request, the time period in which the facilities shall be provided as well as the specifications for such facilities.

III. MONITORING REQUIREMENTS.**# 008 [25 Pa. Code §123.43]****Measuring techniques**

Visible air contaminants may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and certified in EPA Method 9, to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

009 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The permittee shall conduct a monthly inspection around the plant periphery during daylight hours when the plant is in production to detect visible stack emissions, fugitive visible emissions and malodorous emissions as follows:

- (a) Stack emissions in excess of the limits stated in Section C, Condition #004. Visible emissions may be measured according to the methods specified in Section C, Condition #008, or alternately, plant personnel who observe such emissions may report the incidence of visible stack emissions to the Department within two (2) hours of each incident and make arrangements for a certified observer to verify the visible emissions.
- (b) The presence of fugitive visible emissions as stated in Section C, Condition #002.
- (c) The presence of malodorous air emissions beyond the plant boundaries as stated in Section C, Condition #003.

IV. RECORDKEEPING REQUIREMENTS.**# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain records of the monthly inspections conducted in accordance with Section C, Condition #009. At a minimum, these records shall include the following information:

- (1) The name of the company representative conducted each inspection.
- (2) The date and time of each inspection.
- (3) The wind direction during each inspection.
- (4) A description of the emissions and/or malodors and actions taken to mitigate them.

The permittee shall maintain these records for a minimum of five (5) years and shall make them available to Department representative upon request.

011 [25 Pa. Code §135.5]**Recordkeeping**

Source owners or operators shall maintain and make available upon request by the Department records including computerized records that may be necessary to comply with 25 Pa. Code Sections 135.3 and 135.21 (relating to reporting;

**SECTION C. Site Level Requirements**

and emission statements). These may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions. If direct recordkeeping is not possible or practical, sufficient records shall be kept to provide the needed information by indirect means.

V. REPORTING REQUIREMENTS.**# 012 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall report malfunctions to the Department. As defined in 40 CFR Section 60.2 and incorporated by reference in 25 Pa. Code Chapter 122, a malfunction is a sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions. Malfunctions shall be reported as follows:

(a) Malfunctions which pose an imminent danger to public health, safety, welfare and the environment, shall be immediately reported to the Department by telephone. The telephone report of such malfunctions shall occur no later than two hours after discovery of the incident. Telephone reports can be made to the Air Quality Program at 814-946-7294 during normal business hours, or to the Department's Emergency Hotline at any time. The Emergency Hotline phone number is changed/updated periodically. The current Emergency Hotline phone number can be found at <https://www.dep.pa.gov/About/Regional/SouthcentralRegion/Pages/default.aspx>.

(b) Unless otherwise required by this permit, any other malfunction that is not subject to the reporting requirement of subsection (a) above, shall be reported to the Department, in writing, within five (5) days of malfunction discovery.

VI. WORK PRACTICE REQUIREMENTS.**# 013 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

The permittee shall take all reasonable actions to prevent particulate matter from the sources identified in Section C, Condition #001 (a) through (e) from becoming airborne. These actions shall include, but are not limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, materials stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

014 [25 Pa. Code §127.444]**Compliance requirements.**

The permittee shall operate and maintain all sources and any air cleaning devices identified in this operating permit in accordance with the manufacturers' recommendations/specifications, as well as in a manner consistent with good operating practices.

VII. ADDITIONAL REQUIREMENTS.**# 015 [25 Pa. Code §129.14]****Open burning operations**

(a) No person shall conduct open burning of materials, except as noted in 25 Pa. Code Sections 129.14(c) and (d), in such a manner that:

- (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.



SECTION C. Site Level Requirements

- (2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.
 - (3) The emissions interfere with the reasonable enjoyment of life or property.
 - (4) The emissions cause damage to vegetation or property
 - (5) The emissions are or may be deleterious to human or animal health.
- (b) The requirements of Section (a) above, do not apply when the open burning operations result from:
- (1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.
 - (2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.
 - (3) A fire set for the prevention and control of disease or pests, when approved by the Department.
 - (4) A fire set solely for recreational or ceremonial purposes.
 - (5) A fire set solely for cooking food.
- (c) This permit does not constitute authorization to burn solid waste pursuant to Section 610 (3) of the Solid Waste Management Act, 35 P.S. Section 6018.610 (3), or any other provision of the Solid Waste Management Act.

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

**SECTION D. Source Level Requirements**

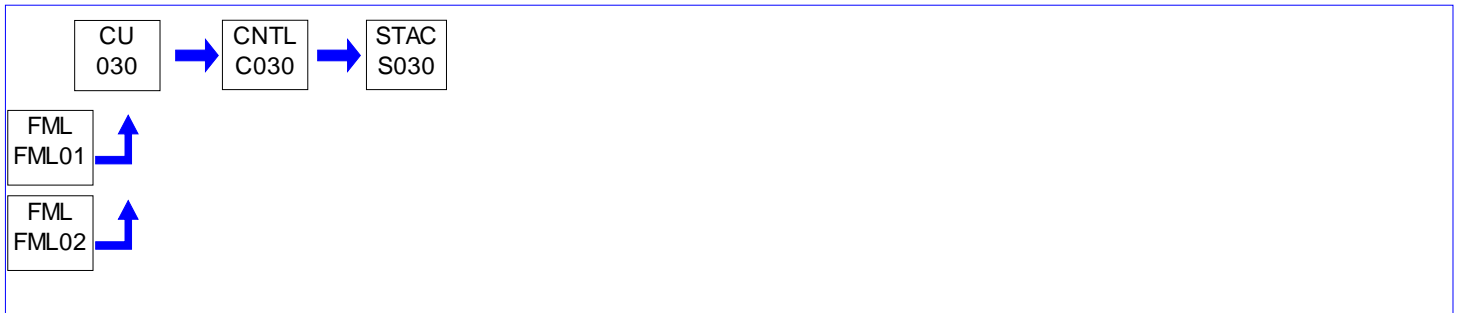
Source ID: 030

Source Name: WOOD FIRED BOILER

Source Capacity/Throughput: 11.700 MMBTU/HR

3,003.000 Lbs/HR

SAWDUST

Conditions for this source occur in the following groups: G01
G02**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



SECTION D. Source Level Requirements

Source ID: 031

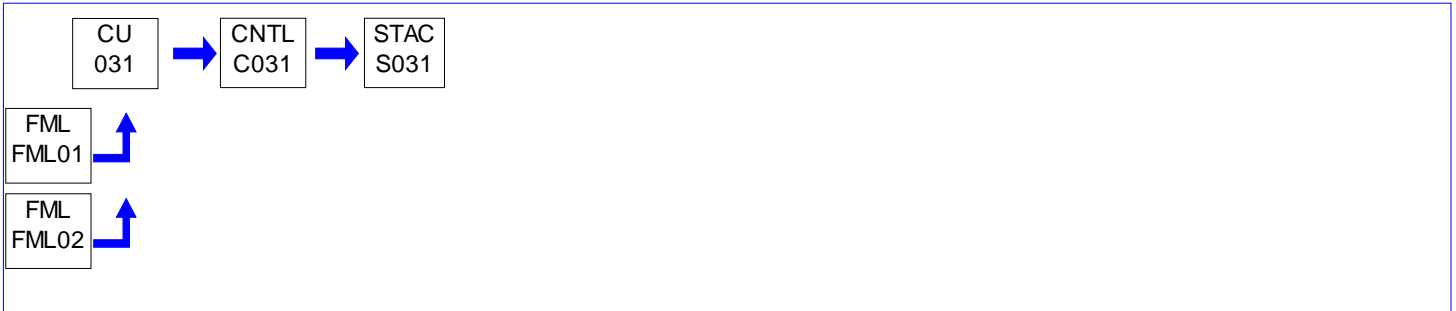
Source Name: WOOD FIRED BOILER

Source Capacity/Throughput: 17.200 MMBTU/HR

4,800.000 Lbs/HR

SAWDUST

Conditions for this source occur in the following groups: G01
G02



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

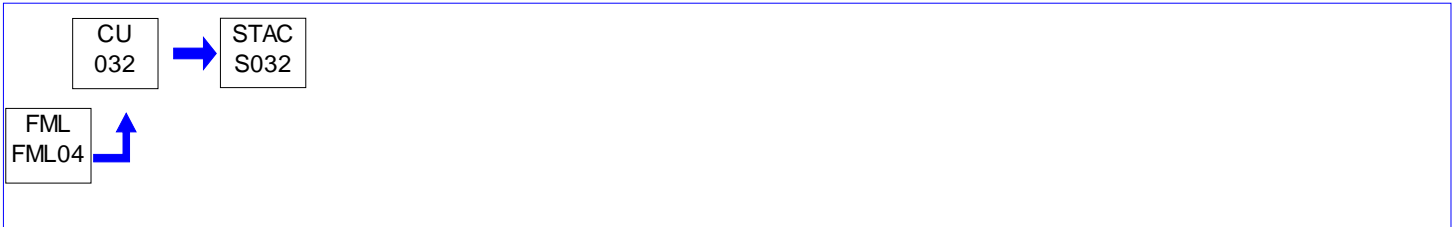
**SECTION D. Source Level Requirements**

Source ID: 032

Source Name: UNIT 4 (OIL-FIRED BOILER) CLEAVER-BROOKS CB-350

Source Capacity/Throughput: 11.700 MMBTU/HR

85.000 Gal/HR #2 Oil

Conditions for this source occur in the following groups: G03
G04**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §123.11]

Combustion units

The permittee shall limit the emissions of particulate matter to 0.4 pounds per million BTU of heat input or less.

002 [25 Pa. Code §123.22]

Combustion unitsA person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is derived from GP1-05-03011A]

The combustion unit(s) constructed after December 2, 1995 shall reduce nitrogen oxides (NO_x) and carbon monoxide (CO) emissions to or below:

- i. 30 ppmdv NO_x at 3% O₂ when firing gas;
- ii. 90 ppmdv for NO_x at 3% O₂ while firing No. 2 oil; and
- iii. 300 ppmdv CO at 3% O₂.

Fuel Restriction(s).

004 [25 Pa. Code §123.22]

Combustion units

Maximum Allowable Sulfur Content Beginning July 1, 2016, Expressed as Parts per Million (ppm) by Weight or Percentage by Weight:

Grades Commercial Fuel Oil (Consistent with ASTM D396)
 No. 2 and lighter oil 500 ppm (0.05%)

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

[Additional authority for this permit condition is derived from GP1-05-03011A]

The combustion unit(s) shall only operate on No. 2 fuel oil.



SECTION D. Source Level Requirements

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

006 [25 Pa. Code §127.441]
Operating permit terms and conditions.
[Additional authority for this permit condition is derived from GP1-05-03011A]
The permittee shall install and maintain the necessary meter(s) to determine and to record amount of fuel usage.

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



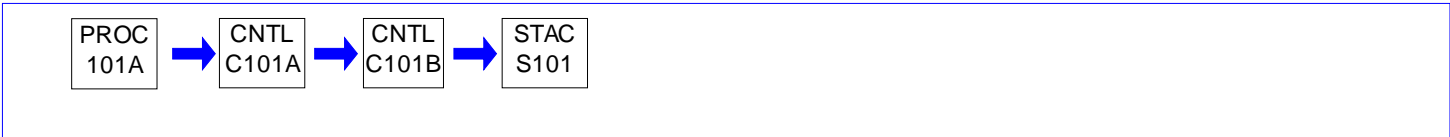
SECTION D. Source Level Requirements

Source ID: 101A

Source Name: MCI TRIM SAW

Source Capacity/Throughput: 1,330.000 Each/HR HARDWOOD

Conditions for this source occur in the following groups: G101



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).



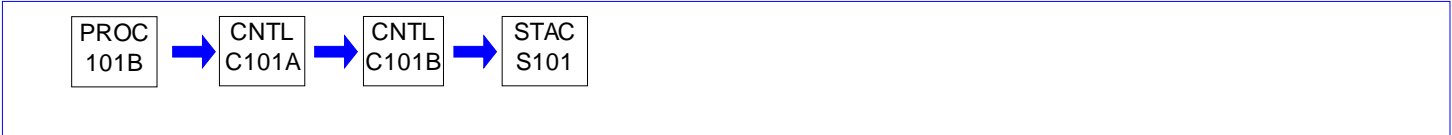
SECTION D. Source Level Requirements

Source ID: 101B

Source Name: NEWMAN S-282 PLANER

Source Capacity/Throughput: 1,330.000 Each/HR HARDWOOD

Conditions for this source occur in the following groups: G101



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).




SECTION D. Source Level Requirements

Source ID: 101C

Source Name: NEWMAN & WHITNEY KF24 RIP SAW

Source Capacity/Throughput: 1,330.000 Each/HR HARDWOOD

Conditions for this source occur in the following groups: G101



I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements) and/or Section E (Source Group Restrictions).

**SECTION D. Source Level Requirements**


Source ID: 102

Source Name: COLD CLEANING MACHINE

Source Capacity/Throughput:

1.000 Lbs/HR

SOLVENT

**I. RESTRICTIONS.****Emission Restriction(s).**

001 [25 Pa. Code §129.63]

Degreasing operations

Degreasing activities shall be conducted in accordance with the applicable requirements of 25 Pa. Code Section 129.63 to include the following:

(a) Source ID 102 units shall not employ any solvent with a vapor pressure of 1.0 millimeter of mercury (mm Hg) or greater and containing greater than 5% VOC by weight, measured at 20°C (68°F) containing VOCs.

(b) This permit condition does not apply.

(1) Source ID 102 units used in extreme cleaning service. Extreme cleaning service is defined as the use of a cold cleaning machine to clean parts used in the manufacture of the following gases or to clean parts exposed to these gases in manufacturing, production, research and development, analytical work, or other similar operations:

- (A) Oxygen in concentrations greater than 23%
- (B) Ozone
- (C) Nitrous oxide
- (D) Fluorine
- (E) Chlorine
- (F) Bromine
- (G) Halogenated compounds

(2) If the permittee demonstrates, and the Department approves in writing, that compliance with this permit condition will result in unsafe operating conditions.

(3) To immersion cold cleaning machines with a freeboard ratio equal to or greater than 0.75.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

002 [25 Pa. Code §129.63]

Degreasing operations

The permittee shall maintain the following records:

- (a) The name and address of the solvent supplier.

**SECTION D. Source Level Requirements**

- (b) The type of solvent including the product or vendor identification number.
- (c) The vapor pressure of the solvent measured in mm Hg at 20°C (68°F).

An invoice, bill of sale, certificate that corresponds to a number of sales, Material Safety Data Sheet (MSDS), or other appropriate documentation acceptable to the Department may be used to comply with this section.

The permittee shall retain these records for a minimum of two (2) years and shall make them available to the Department upon its request.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 003 [25 Pa. Code §129.63]****Degreasing operations**

Each Source ID 102 unit shall have a permanent, conspicuous label summarizing the operating requirements in Condition #004. In addition, the label shall include the following discretionary good operating practices:

- (a) Cleaned parts should be drained at least 15 seconds or until dripping ceases, whichever is longer. Parts having cavities or blind holes shall be tipped or rotated while the part is draining. During the draining, tipping or rotating, the parts should be positioned so that solvent drains directly back to the unit.
- (b) When a pump-agitated solvent bath is used, the agitator should be operated to produce a rolling motion of the solvent with no observable splashing of the solvent against the tank walls or the parts being cleaned.
- (c) Work area fans should be located and positioned so that they do not blow across the opening of the degreaser unit.

004 [25 Pa. Code §129.63]**Degreasing operations**

The permittee shall operate each Source ID 102 unit in accordance with the following procedures:

- (a) Waste solvent shall be collected and stored in closed containers. The closed containers may contain a device that allows pressure relief, but does not allow liquid solvent to drain from the container.
- (b) Flushing of parts using a flexible hose or other flushing device shall be performed only within the unit. The solvent spray shall be a solid fluid stream, not an atomized or shower spray.
- (c) Sponges, fabric, wood, leather, paper products and other absorbent materials may not be cleaned in Source ID 102 units.
- (d) Air-agitated solvent baths may not be used.
- (e) Spills during solvent transfer and use of each Source ID 102 unit shall be cleaned up immediately.

005 [25 Pa. Code §129.63]**Degreasing operations**

Each Source ID 102 unit shall be equipped with one of the following:

- (a) A cover that shall be closed at all times except during cleaning of parts or the addition or removal of solvent.
- (b) A perforated drain with a diameter of not more than six (6) inches, if the unit drains directly into the solvent storage reservoir.

**SECTION D. Source Level Requirements****# 006 [25 Pa. Code §129.63]****Degreasing operations**

Immersion cold cleaning machines shall have a freeboard ratio of 0.50 or greater.

VII. ADDITIONAL REQUIREMENTS.**# 007 [25 Pa. Code §129.63]****Degreasing operations**


The aforementioned permit conditions apply to each Source ID 102 unit so long as the cold cleaning machine uses 2 gallons or more of solvents containing greater than 5% VOC content by weight for the cleaning of metal parts.

**SECTION D. Source Level Requirements**

Source ID: 103

Source Name: GASOLINE STORAGE TANK - 10,000 GAL

Source Capacity/Throughput:

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 001 [25 Pa. Code §129.61]****Small gasoline storage tank control (Stage 1 control)**

(a) This section applies Statewide to stationary gasoline storage tanks with a capacity of greater than 2,000 gallons.

(b) A person may not transfer gasoline from a delivery vessel into a stationary gasoline storage tank unless the displaced vapors from the storage tank are transferred to the dispensing delivery tank through a vapor right return line and unless the receiving tank is equipped with a submerged fill pipe which extends from the filling orifice to within 6 inches of the bottom of the tank. The vapors collected in the dispensing tank shall be disposed of in accordance with § 129.59 or § 129.60(c) (relating to bulk gasoline terminals; and bulk gasoline plants).

(c) The dispensing delivery tank shall remain vapor tight at all times. The delivery tank may be opened after the vapors are disposed of in accordance with § 129.59 or § 129.60(c).

002 [25 Pa. Code §129.62]**General standards for bulk gasoline terminals/plants, and small gasoline storage tanks**

(a) Gasoline may not be spilled or discarded in sewers or stored in open containers or handled in a manner that would result in uncontrolled evaporation to the atmosphere.

(b) An owner or operator of a bulk gasoline plant, bulk gasoline terminal, tank truck or trailer or stationary storage tank to which § 129.59, § 129.60(b) or (c) or § 129.61 (relating to bulk gasoline terminals; bulk gasoline plants; and small gasoline storage tank control (Stage I control)) apply may not permit the transfer of gasoline between the tank truck or trailer and a stationary storage tank unless the following conditions are met:

**SECTION D. Source Level Requirements**

(1) The vapor balance system is in good working order and is designed and operated in a manner that prevents:

(i) Gauge pressure from exceeding 18 inches of H₂O (4500 pascals) and vacuum from exceeding 6 inches of water (1500 pascals) in the gasoline tank truck.

(ii) A reading equal to or greater than 100% of the lower explosive limit—LEL, measured as propane—at 1 inch from points on the perimeter of a potential leak source when measured by the method referenced in § 139.14 (relating to emissions of VOCs) during loading or unloading operations at small gasoline storage tanks, bulk plants and bulk terminals.

(iii) Avoidable liquid leaks during loading or unloading operations at small gasoline storage tanks, bulk plants and bulk terminals.

(2) A truck, vapor balance system or vapor disposal system, if applicable, that exceeds the limits in paragraph (1) is repaired and retested within 15 days.

(3) There are no visually- or audibly-detectable leaks in the tank truck's or trailer's pressure/vacuum relief valves and hatch covers, the truck tanks or storage tanks, or associated vapor and liquid lines during loading or unloading.

(4) The pressure and vacuum relief valves on storage vessels and tank trucks or trailers are set to release at no less than .7 psig (4.8 kilopascals) of pressure or .3 psig (2.1 kilopascals) of vacuum or the highest allowable pressure and vacuum as specified in State or local fire codes, the National Fire Prevention Association guidelines or other National consensus standards acceptable to the Department. Upon demonstration by the owner or operator of an underground small gasoline storage tank that the vapor balance system specified in paragraph (1) will achieve a 90% vapor recovery efficiency without a pressure and vacuum relief valve and that an interlock system, sufficient to ensure connection of the vapor recovery line prior to delivery of the gasoline, will be used—no pressure and vacuum relief valve is required. The vacuum setting on the pressure and vacuum relief valve on an underground storage tank may be set at the lowest vacuum setting which is sufficient to keep the vent closed at zero pressure and vacuum.

(c) - (d) [NA - FACILITY DOES NOT OWN OR OPERATE TANK TRUCKS]

(e) [NA - (c) & (d) DO NOT APPLY]

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: G01

Group Description: Wood Fired Boilers

Sources included in this group

ID	Name
030	WOOD FIRED BOILER
031	WOOD FIRED BOILER

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from any source in group ID G01 in excess of the rate of 0.4 pound per million Btu of heat input.

002 [25 Pa. Code §123.22]**Combustion units**

The Permittee may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from any combustion unit, at any time, in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION E. Source Group Restrictions.**

Group Name: G02

Group Description: 40 CFR Part 63 Subpart JJJJJJ for existing wood-fired boilers rated greater than 10 mmBtu/hr

Sources included in this group

ID	Name
030	WOOD FIRED BOILER
031	WOOD FIRED BOILER

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

§ 63.11193 Am I subject to this subpart?

You are subject to this subpart if you own or operate an industrial, commercial, or institutional boiler as defined in § 63.11237 that is located at, or is part of, an area source of hazardous air pollutants (HAP), as defined in § 63.2, except as specified in § 63.11195.

§ 63.11194 What is the affected source of this subpart?

(a) This subpart applies to each new, reconstructed, or existing affected source as defined in paragraphs (a)(1) and (2) of this section.

(1) The affected source of this subpart is the collection of all existing industrial, commercial, and institutional boilers within a subcategory, as listed in § 63.11200 and defined in § 63.11237, located at an area source.

(2) The affected source of this subpart is each new or reconstructed industrial, commercial, or institutional boiler within a subcategory, as listed in § 63.11200 and as defined in § 63.11237, located at an area source.

**SECTION E. Source Group Restrictions.**

(b) An affected source is an existing source if you commenced construction or reconstruction of the affected source on or before June 4, 2010.

(c) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(d) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(e) An existing dual-fuel fired boiler meeting the definition of gas-fired boiler, as defined in § 63.11237, that meets the applicability requirements of this subpart after June 4, 2010 due to a fuel switch from gaseous fuel to solid fossil fuel, biomass, or liquid fuel is considered to be an existing source under this subpart as long as the boiler was designed to accommodate the alternate fuel.

(f) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or part 71 as a result of this subpart. You may, however, be required to obtain a title V permit due to another reason or reasons. See 40 CFR 70.3(a) and (b) or 71.3(a) and (b). Notwithstanding the exemption from title V permitting for area sources under this subpart, you must continue to comply with the provisions of this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

§ 63.11195 Are any boilers not subject to this subpart?

The types of boilers listed in paragraphs (a) through (k) of this section are not subject to this subpart and to any requirements in this subpart.

(a) [NA – NO UNITS PART OF SOURCES SUBJECT TO OTHER PART 63 SUBPART]

(b) [NA – NO CAA SECTION 129 UNITS]

(c) [NA – UNITS DO NOT BURN HAZARDOUS WASTE].

(d) [NA – UNITS ARE NOT R&D]

(e) [NA – UNITS ARE NOT DEFINED AS GAS-FIRED]

(f) [NA – UNITS NOT DEFINED AS HOT WATER HEATERS]

(g) [NA – UNITS NOT USED AS CONTROL DEVICES]

(h) [NA – UNITS DO NOT QUALIFY AS TEMPORARY UNITS]

(i) [NA – UNITS ARE NOT DEFINED AS RESIDENTIAL]

(j) [NA – UNITS ARE NOT DEFINED AS ELECTRIC]

(k) [NA – UNITS ARE NOT EGUs]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11196 What are my compliance dates?

(a) If you own or operate an existing affected boiler, you must achieve compliance with the applicable provisions in this subpart as specified in paragraphs (a)(1) through (3) of this section.

(1) If the existing affected boiler is subject to a work practice or management practice standard of a tune-up, you must achieve compliance with the work practice or management practice standard no later than March 21, 2014.

(2) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

**SECTION E. Source Group Restrictions.**

(3) If the existing affected boiler is subject to the energy assessment requirement, you must achieve compliance with the energy assessment requirement no later than March 21, 2014.

(b) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(c) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(d) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Emission Limits, Work Practice Standards, Emission Reduction Measures, and Management Practices

§ 63.11200 What are the subcategories of boilers?

The subcategories of boilers, as defined in § 63.11237 are:

(a) [NA - SOURCES IN THIS GROUP ARE BIOMASS, AND ARE NOT SEASONAL OR LIMITED USE]

(b) Biomass.

(c) – (g) [NA - SOURCES IN THIS GROUP ARE BIOMASS, AND ARE NOT SEASONAL OR LIMITED USE]

[78 FR 7506, Feb. 1, 2013]

§ 63.11201 What standards must I meet?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must comply with each work practice standard, emission reduction measure, and management practice specified in Table 2 to this subpart that applies to your boiler. An energy assessment completed on or after January 1, 2008 that meets or is amended to meet the energy assessment requirements in Table 2 to this subpart satisfies the energy assessment requirement. A facility that operates under an energy management program established through energy management systems compatible with ISO 50001, that includes the affected units, also satisfies the energy assessment requirement.

TABLE 2 REQUIREMENTS:

As stated in § 63.11201, you must comply with the following applicable work practice standards, emission reduction measures, and management practices:

6. If your boiler is in this subcategory: Existing biomass-fired boilers that do not meet the definition of seasonal boiler or limited-use boiler, or use an oxygen trim system that maintains an optimum air-to-fuel ratio, you must meet the following: Conduct an initial tune-up as specified in § 63.11214, and conduct a tune-up of the boiler biennially as specified in § 63.11223.

16. If your boiler is in this subcategory: Existing coal-fired, biomass-fired, or oil-fired boilers (units with heat input capacity of 10 MMBtu/hr and greater), not including limited-use boilers, you must meet the following: must have a one-time energy assessment performed by a qualified energy assessor. An energy assessment completed on or after January 1, 2008, that meets or is amended to meet the energy assessment requirements in this table satisfies the energy assessment requirement. Energy assessor approval and qualification requirements are waived in instances where past or amended energy assessments are used to meet the energy assessment requirements. A facility that operated under an energy management program developed according to the ENERGY STAR guidelines for energy management or compatible with ISO 50001 for at least 1 year between January 1, 2008, and the compliance date specified in §63.11196 that includes the affected units also satisfies the energy assessment requirement. The energy assessment must include the following with extent of the evaluation for items (1) to (4) appropriate for the on-site technical hours listed in §63.11237:

**SECTION E. Source Group Restrictions.**

- (1) A visual inspection of the boiler system,
- (2) An evaluation of operating characteristics of the affected boiler systems, specifications of energy use systems, operating and maintenance procedures, and unusual operating constraints,
- (3) An inventory of major energy use systems consuming energy from affected boiler(s) and which are under control of the boiler owner or operator,
- (4) A review of available architectural and engineering plans, facility operation and maintenance procedures and logs, and fuel usage,
- (5) A list of major energy conservation measures that are within the facility's control,
- (6) A list of the energy savings potential of the energy conservation measures identified, and
- (7) A comprehensive report detailing the ways to improve efficiency, the cost of specific improvements, benefits, and the time frame for recouping those investments.

END OF TABLE 2 REQUIREMENTS

(c) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(d) These standards apply at all times the affected boiler is operating, except during periods of startup and shutdown as defined in § 63.11237, during which time you must comply only with Table 2 to this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

General Compliance Requirements

§ 63.11205 What are my general requirements for complying with this subpart?

(a) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Initial Compliance Requirements

§ 63.11210 What are my initial compliance requirements and by what date must I conduct them?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) For existing affected boilers that have applicable work practice standards, management practices, or emission reduction measures, you must demonstrate initial compliance no later than the compliance date that is specified in § 63.11196 and according to the applicable provisions in § 63.7(a)(2), except as provided in paragraph (j) of this section.

**SECTION E. Source Group Restrictions.**

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(e) –(g) [NA – THE SOURCES IN THIS GROUP ARE EXISTING]

(h) [NA – NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

(i) For affected boilers that switch fuels or make a physical change to the boiler that results in the applicability of a different subcategory within subpart JJJJJJ or the boiler becoming subject to subpart JJJJJJ, you must demonstrate compliance within 180 days of the effective date of the fuel switch or the physical change. Notification of such changes must be submitted according to § 63.11225(g).

(j) [NA – FACILITY IS MINOR FOR HAP]

(k) [NA – UNITS HAVE OPERATED SINCE 6J EFFECTIVE DATE]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7507, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11211 How do I demonstrate initial compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11212 What stack tests and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11213 What fuel analyses and procedures must I use for the performance tests?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

§ 63.11214 How do I demonstrate initial compliance with the work practice standard, emission reduction measures, and management practice?

(a) [NA – SOURCES IN THIS GROUP ARE BIOMASS]

(b) If you own or operate an existing or new biomass-fired boiler or an existing or new oil-fired boiler, you must conduct a performance tune-up according to §63.11210(c) or (g), as applicable, and §63.11223(b). If you own or operate an existing biomass-fired boiler or existing oil-fired boiler, you must submit a signed statement in the Notification of Compliance Status report that indicates that you conducted an initial tune-up of the boiler.

(c) If you own or operate an existing affected boiler with a heat input capacity of 10 million Btu per hour or greater, you must submit a signed certification in the Notification of Compliance Status report that an energy assessment of the boiler and its energy use systems was completed according to Table 2 to this subpart and that the assessment is an accurate depiction of your facility at the time of the assessment or that the maximum number of on-site technical hours specified in the definition of energy assessment applicable to the facility has been expended.

(d) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7508, Feb. 1, 2013; 81 FR 63126, Sept. 14, 2016]

Continuous Compliance Requirements

§ 63.11220 When must I conduct subsequent performance tests or fuel analyses?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING OR FUEL ANALYSES]

§ 63.11221 Is there a minimum amount of monitoring data I must obtain?

**SECTION E. Source Group Restrictions.**

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11222 How do I demonstrate continuous compliance with the emission limits?

[NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

§ 63.11223 How do I demonstrate continuous compliance with the work practice and management practice standards?

(a) For affected sources subject to the work practice standard or the management practices of a tune-up, you must conduct a performance tune-up according to paragraph (b) of this section and keep records as required in § 63.11225(c) to demonstrate continuous compliance. You must conduct the tune-up while burning the type of fuel (or fuels in the case of boilers that routinely burn two types of fuels at the same time) that provided the majority of the heat input to the boiler over the 12 months prior to the tune-up.

(b) Except as specified in paragraphs (c) through (f) of this section, you must conduct a tune-up of the boiler biennially to demonstrate continuous compliance as specified in paragraphs (b)(1) through (7) of this section. Each biennial tune-up must be conducted no more than 25 months after the previous tune-up. For a new or reconstructed boiler, the first biennial tune-up must be no later than 25 months after the initial startup of the new or reconstructed boiler.

(1) As applicable, inspect the burner, and clean or replace any components of the burner as necessary (you may delay the burner inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the burner inspection until the first outage, not to exceed 36 months from the previous inspection.

(2) Inspect the flame pattern, as applicable, and adjust the burner as necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available.

(3) Inspect the system controlling the air-to-fuel ratio, as applicable, and ensure that it is correctly calibrated and functioning properly (you may delay the inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the inspection until the first outage, not to exceed 36 months from the previous inspection.

(4) Optimize total emissions of CO. This optimization should be consistent with the manufacturer's specifications, if available, and with any nitrogen oxide requirement to which the unit is subject.

(5) Measure the concentrations in the effluent stream of CO in parts per million, by volume, and oxygen in volume percent, before and after the adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). Measurements may be taken using a portable CO analyzer.

(6) Maintain on-site and submit, if requested by the Administrator, a report containing the information in paragraphs (b)(6)(i) through (iii) of this section.

(i) The concentrations of CO in the effluent stream in parts per million, by volume, and oxygen in volume percent, measured at high fire or typical operating load, before and after the tune-up of the boiler.

(ii) A description of any corrective actions taken as a part of the tune-up of the boiler.

(iii) The type and amount of fuel used over the 12 months prior to the tune-up of the boiler, but only if the unit was physically and legally capable of using more than one type of fuel during that period. Units sharing a fuel meter may estimate the fuel use by each unit.

(7) If the unit is not operating on the required date for a tune-up, the tune-up must be conducted within 30 days of startup.

(c) [NA – NO OXYGEN TRIM SYSTEM]

(d) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

**SECTION E. Source Group Restrictions.**

(e) [NA - SOURCES IN THIS GROUP ARE BIOMASS]

(f) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS LIMITED USE]

(g) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7509, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§ 63.11224 What are my monitoring, installation, operation, and maintenance requirements?

(a) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(d) [NA – SOURCES IN THIS GROUP ARE NOT SUBJECT TO OPERATING LIMITS]

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(f) [NA – BLDS NOT USED OR REQUIRED]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7510, Feb. 1, 2013]

§ 63.11225 What are my notification, reporting, and recordkeeping requirements?

(a) You must submit the notifications specified in paragraphs (a)(1) through (5) of this section to the administrator.

(1) You must submit all of the notifications in §§ 63.7(b); 63.8(e) and (f); and 63.9(b) through (e), (g), and (h) that apply to you by the dates specified in those sections except as specified in paragraphs (a)(2) and (4) of this section.

(2) An Initial Notification must be submitted no later than January 20, 2014 or within 120 days after the source becomes subject to the standard.

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(4) You must submit the Notification of Compliance Status no later than 120 days after the applicable compliance date specified in §63.11196 unless you own or operate a new boiler subject only to a requirement to conduct a biennial or 5-year tune-up or you must conduct a performance stack test. If you own or operate a new boiler subject to a requirement to conduct a tune-up, you are not required to prepare and submit a Notification of Compliance Status for the tune-up. If you must conduct a performance stack test, you must submit the Notification of Compliance Status within 60 days of completing the performance stack test. You must submit the Notification of Compliance Status in accordance with paragraphs (a)(4)(i) and (vi) of this section. The Notification of Compliance Status must include the information and certification(s) of compliance in paragraphs (a)(4)(i) through (v) of this section, as applicable, and signed by a responsible official.

(i) You must submit the information required in § 63.9(h)(2), except the information listed in § 63.9(h)(2)(i)(B), (D), (E), and (F). If you conduct any performance tests or CMS performance evaluations, you must submit that data as specified in paragraph (e) of this section. If you conduct any opacity or visible emission observations, or other monitoring procedures or methods, you must submit that data to the Administrator at the appropriate address listed in § 63.13.

(ii) “This facility complies with the requirements in § 63.11214 to conduct an initial tune-up of the boiler.”

(iii) “This facility has had an energy assessment performed according to § 63.11214(c).”

(iv) [NA – BLDS NOT USED OR REQUIRED]

(v) For units that do not qualify for a statutory exemption as provided in section 129(g)(1) of the Clean Air Act: “No secondary

**SECTION E. Source Group Restrictions.**

materials that are solid waste were combusted in any affected unit.”

(vi) The notification must be submitted electronically using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written Notification of Compliance Status must be submitted to the Administrator at the appropriate address listed in § 63.13.

(5) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(b) You must prepare, by March 1 of each year, and submit to the delegated authority upon request, an annual compliance certification report for the previous calendar year containing the information specified in paragraphs (b)(1) through (4) of this section. You must submit the report by March 15 if you had any instance described by paragraph (b)(3) of this section. For boilers that are subject only to the energy assessment requirement and/or a requirement to conduct a biennial or 5-year tune-up according to §63.11223(a) and not subject to emission limits or operating limits, you may prepare only a biennial or 5-year compliance report as specified in paragraphs (b)(1) and (2) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with the official's name, title, phone number, email address, and signature, certifying the truth, accuracy and completeness of the notification and a statement of whether the source has complied with all the relevant standards and other requirements of this subpart. Your notification must include the following certification(s) of compliance, as applicable, and signed by a responsible official:

(i) “This facility complies with the requirements in § 63.11223 to conduct a biennial or 5-year tune-up, as applicable, of each boiler.”

(ii) For units that do not qualify for a statutory exemption as provided in section 129(g)(1) of the Clean Air Act: “No secondary materials that are solid waste were combusted in any affected unit.”

(iii) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(3) If the source experiences any deviations from the applicable requirements during the reporting period, include a description of deviations, the time periods during which the deviations occurred, and the corrective actions taken.

(4) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(c) You must maintain the records specified in paragraphs (c)(1) through (7) of this section.

(1) As required in § 63.10(b)(2)(xiv), you must keep a copy of each notification and report that you submitted to comply with this subpart and all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted.

(2) You must keep records to document conformance with the work practices, emission reduction measures, and management practices required by § 63.11214 and § 63.11223 as specified in paragraphs (c)(2)(i) through (vi) of this section.

(i) Records must identify each boiler, the date of tune-up, the procedures followed for tune-up, and the manufacturer's specifications to which the boiler was tuned.

(ii) For operating units that combust non-hazardous secondary materials that have been determined not to be solid waste pursuant to § 241.3(b)(1) of this chapter, you must keep a record which documents how the secondary material meets each of the legitimacy criteria under § 241.3(d)(1). If you combust a fuel that has been processed from a discarded non-hazardous secondary material pursuant to § 241.3(b)(4) of this chapter, you must keep records as to how the operations that produced the fuel satisfies the definition of processing in § 241.2 and each of the legitimacy criteria in § 241.3(d)(1) of this chapter. If the fuel received a non-waste determination pursuant to the petition process submitted under § 241.3(c) of this chapter, you must keep a record that documents how the fuel satisfies the requirements of the petition process. For operating units that combust non-hazardous secondary materials as fuel per § 241.4, you must keep records documenting

**SECTION E. Source Group Restrictions.**

that the material is a listed non-waste under § 241.4(a).

(iii) For each boiler required to conduct an energy assessment, you must keep a copy of the energy assessment report.

(iv) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(v) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS SEASONAL]

(vi) [NA – SOURCES IN THIS GROUP ARE NOT DEFINED AS LIMITED USE]

(3) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO FUEL ANALYSES]

(4) Records of the occurrence and duration of each malfunction of the boiler, or of the associated air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with the general duty to minimize emissions in § 63.11205(a), including corrective actions to restore the malfunctioning boiler, air pollution control, or monitoring equipment to its normal or usual manner of operation.

(6) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO EMISSION LIMITS]

(7) [NA – BLDS NOT USED OR REQUIRED]

(d) Your records must be in a form suitable and readily available for expeditious review. You must keep each record for 5 years following the date of each recorded action. You must keep each record on-site or be accessible from a central location by computer or other means that instantly provide access at the site for at least 2 years after the date of each recorded action. You may keep the records off site for the remaining 3 years.

(e) [NA - SOURCES IN THIS GROUP ARE NOT SUBJECT TO PERFORMANCE TESTING]

(f) If you intend to commence or recommence combustion of solid waste, you must provide 30 days prior notice of the date upon which you will commence or recommence combustion of solid waste. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that will commence burning solid waste, and the date of the notice.

(2) The currently applicable subcategory under this subpart.

(3) The date on which you became subject to the currently applicable emission limits.

(4) The date upon which you will commence combusting solid waste.

(g) If you have switched fuels or made a physical change to the boiler and the fuel switch or change resulted in the applicability of a different subcategory within this subpart, in the boiler becoming subject to this subpart, or in the boiler switching out of this subpart due to a fuel change that results in the boiler meeting the definition of gas-fired boiler, as defined in §63.11237, or you have taken a permit limit that resulted in you becoming subject to this subpart or no longer being subject to this subpart, you must provide notice of the date upon which you switched fuels, made the physical change, or took a permit limit within 30 days of the change. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that have switched fuels, were physically changed, or took a permit limit, and the date of the notice.

(2) The date upon which the fuel switch, physical change, or permit limit occurred.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7511, Feb. 1, 2013; 81 FR 63127, Sept. 14, 2016]

§63.11226 [Reserved]

SECTION E. Source Group Restrictions.

Other Requirements and Information

§ 63.11235 What parts of the General Provisions apply to me?

Table 8 to this subpart shows which parts of the General Provisions in §§ 63.1 through 63.15 apply to you.

§ 63.11236 Who implements and enforces this subpart? [INCORPORATED BY REFERENCE]

§ 63.11237 What definitions apply to this subpart? [INCORPORATED BY REFERENCE]

**SECTION E. Source Group Restrictions.**

Group Name: G03

Group Description: 40 CFR Part 63 Subpart JJJJJJ for new # 2 oil fired boilers rated greater than 10 mmBtu/hr

Sources included in this group

ID	Name
032	UNIT 4 (OIL-FIRED BOILER) CLEAVER-BROOKS CB-350

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

§ 63.11193 Am I subject to this subpart?

You are subject to this subpart if you own or operate an industrial, commercial, or institutional boiler as defined in § 63.11237 that is located at, or is part of, an area source of hazardous air pollutants (HAP), as defined in § 63.2, except as specified in § 63.11195.

§ 63.11194 What is the affected source of this subpart?

(a) This subpart applies to each new, reconstructed, or existing affected source as defined in paragraphs (a)(1) and (2) of this section.

(1) [NA - UNIT(S) ARE NEW]

(2) The affected source of this subpart is each new or reconstructed industrial, commercial, or institutional boiler within a subcategory, as listed in § 63.11200 and as defined in § 63.11237, located at an area source.

(b) [NA - UNIT(S) ARE NEW]

**SECTION E. Source Group Restrictions.**

(c) An affected source is a new source if you commenced construction of the affected source after June 4, 2010, and the boiler meets the applicability criteria at the time you commence construction.

(d) [NA - UNIT(S) ARE NOT RECONSTRUCTED]

(e) [NA - UNIT(S) ARE NEW]

(f) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or part 71 as a result of this subpart. You may, however, be required to obtain a title V permit due to another reason or reasons. See 40 CFR 70.3(a) and (b) or 71.3(a) and (b). Notwithstanding the exemption from title V permitting for area sources under this subpart, you must continue to comply with the provisions of this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

§ 63.11195 Are any boilers not subject to this subpart?

The types of boilers listed in paragraphs (a) through (k) of this section are not subject to this subpart and to any requirements in this subpart.

(a) [NA – NO UNITS PART OF SOURCES SUBJECT TO OTHER PART 63 SUBPART]

(b) [NA – NO CAA SECTION 129 UNITS]

(c) [NA – UNITS DO NOT BURN HAZARDOUS WASTE].

(d) [NA – UNITS ARE NOT R&D]

(e) [NA – UNITS ARE NOT DEFINED AS GAS-FIRED]

(f) [NA – UNITS NOT DEFINED AS HOT WATER HEATERS]

(g) [NA – UNITS NOT USED AS CONTROL DEVICES]

(h) [NA – UNITS DO NOT QUALIFY AS TEMPORARY UNITS]

(i) [NA – UNITS ARE NOT DEFINED AS RESIDENTIAL]

(j) [NA – UNITS ARE NOT DEFINED AS ELECTRIC]

(k) [NA – UNITS ARE NOT EGUs]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11196 What are my compliance dates?

(a) [NA - UNIT(S) ARE NEW]

(b) [NA - UNIT(S) BEGAN OPERATING AFTER 5/20/11]

(c) If you start up a new affected source after May 20, 2011, you must achieve compliance with the provisions of this subpart upon startup of your affected source.

(d) [NA - UNIT(S) DO NOT COMBUST SOLID WASTE]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Emission Limits, Work Practice Standards, Emission Reduction Measures, and Management Practices

**SECTION E. Source Group Restrictions.**

§ 63.11200 What are the subcategories of boilers?

The subcategories of boilers, as defined in § 63.11237 are:

- (a) [NA - UNIT(S) ARE OIL-FIRED]
- (b) [NA - UNIT(S) ARE OIL-FIRED]
- (c) Oil.
- (d) [NA - UNIT(S) NOT DEFINED AS SEASONAL]
- (e) [NA - UNIT(S) > 5 MMBTU]
- (f) [NA - UNITS DO NOT HAVE O₂ TRIM SYSTEM]
- (g) [NA - UNIT(S) NOT DEFINED AS LIMITED USE]

[78 FR 7506, Feb. 1, 2013]

§ 63.11201 What standards must I meet?

- (a) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]
- (b) You must comply with each work practice standard, emission reduction measure, and management practice specified in Table 2 to this subpart that applies to your boiler. An energy assessment completed on or after January 1, 2008 that meets or is amended to meet the energy assessment requirements in Table 2 to this subpart satisfies the energy assessment requirement. A facility that operates under an energy management program established through energy management systems compatible with ISO 50001, that includes the affected units, also satisfies the energy assessment requirement.

TABLE 2 REQUIREMENTS

As stated in § 63.11201, you must comply with the following applicable work practice standards, emission reduction measures, and management practices:

5. If your boiler is in this subcategory: New oil-fired boilers with heat input capacity greater than 5 MMBtu/hr that do not meet the definition of seasonal boiler or limited-use boiler, or use an oxygen trim system that maintains an optimum air-to-fuel ratio, then you must meet the following: Conduct a tune-up of the boiler biennially as specified in § 63.11223.

END OF TABLE 2 REQUIREMENTS

- (c) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]
- (d) These standards apply at all times the affected boiler is operating, except during periods of startup and shutdown as defined in § 63.11237, during which time you must comply only with Table 2 to this subpart.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

General Compliance Requirements

§ 63.11205 What are my general requirements for complying with this subpart?

- (a) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are

SECTION E. Source Group Restrictions.

being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(c) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7506, Feb. 1, 2013]

Initial Compliance Requirements

§ 63.11210 What are my initial compliance requirements and by what date must I conduct them?

(a) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(b) [NA - UNIT(S) ARE NEW]

(c) [NA - UNIT(S) ARE NEW]

(d) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(e) For new or reconstructed oil-fired boilers that combust only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM emission limit under this subpart and that do not use a post-combustion technology (except a wet scrubber) to reduce particulate matter (PM) or sulfur dioxide emissions, you are not subject to the PM emission limit in Table 1 of this subpart providing you monitor and record on a monthly basis the type of fuel combusted. If you intend to burn a new type of fuel or fuel mixture that does not meet the requirements of this paragraph, you must conduct a performance test within 60 days of burning the new fuel.

(f) For new or reconstructed affected boilers that have applicable work practice standards or management practices, you are not required to complete an initial performance tune-up, but you are required to complete the applicable biennial or 5-year tune-up as specified in § 63.11223 no later than 25 months or 61 months, respectively, after the initial startup of the new or reconstructed affected source.

(g) [NA - UNIT(S) DO NOT COMBUST SOLID WASTE]

(h) [NA - NSPS 4C AND 4D EXEMPTIONS NOT INVOKED]

(i) For affected boilers that switch fuels or make a physical change to the boiler that results in the applicability of a different subcategory within subpart JJJJJJ or the boiler becoming subject to subpart JJJJJJ, you must demonstrate compliance within 180 days of the effective date of the fuel switch or the physical change. Notification of such changes must be submitted according to § 63.11225(g).

(j) [NA - FACILITY IS AREA HAP SOURCE WITHOUT OIL BOILERS TAKING SM LIMITS]

(k) [NA - UNIT(S) ARE NEW]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7507, Feb. 1, 2013; 81 FR 63125, Sept. 14, 2016]

§ 63.11211 How do I demonstrate initial compliance with the emission limits?

(a) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(b) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(c) [NA - NO HG EMISSION LIMIT]

**SECTION E. Source Group Restrictions.**

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7508, Feb. 1, 2013]

§ 63.11212 What stack tests and procedures must I use for the performance tests?

(a) - (e) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

§ 63.11213 What fuel analyses and procedures must I use for the performance tests?

(a) - (c) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

§ 63.11214 How do I demonstrate initial compliance with the work practice standard, emission reduction measures, and management practice?

(a) [NA - NOT COAL FIRED]

(b) If you own or operate an existing or new biomass-fired boiler or an existing or new oil-fired boiler, you must conduct a performance tune-up according to §63.11210(c) or (g), as applicable, and §63.11223(b). If you own or operate an existing biomass-fired boiler or existing oil-fired boiler, you must submit a signed statement in the Notification of Compliance Status report that indicates that you conducted an initial tune-up of the boiler.

(c) [NA - UNIT(S) ARE NEW]

(d) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7508, Feb. 1, 2013; 81 FR 63126, Sept. 14, 2016]

Continuous Compliance Requirements

§ 63.11220 When must I conduct subsequent performance tests or fuel analyses?

(a) - (d) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

§ 63.11221 Is there a minimum amount of monitoring data I must obtain?

(a) - (d) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

§ 63.11222 How do I demonstrate continuous compliance with the emission limits?

(a) - (b) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

§ 63.11223 How do I demonstrate continuous compliance with the work practice and management practice standards?

(a) For affected sources subject to the work practice standard or the management practices of a tune-up, you must conduct a performance tune-up according to paragraph (b) of this section and keep records as required in § 63.11225(c) to demonstrate continuous compliance. You must conduct the tune-up while burning the type of fuel (or fuels in the case of boilers that routinely burn two types of fuels at the same time) that provided the majority of the heat input to the boiler over the 12 months prior to the tune-up.

(b) Except as specified in paragraphs (c) through (f) of this section, you must conduct a tune-up of the boiler biennially to demonstrate continuous compliance as specified in paragraphs (b)(1) through (7) of this section. Each biennial tune-up must be conducted no more than 25 months after the previous tune-up. For a new or reconstructed boiler, the first biennial tune-up must be no later than 25 months after the initial startup of the new or reconstructed boiler.

(1) As applicable, inspect the burner, and clean or replace any components of the burner as necessary (you may delay the burner inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the burner inspection until the first outage, not to exceed 36 months from the previous inspection.

**SECTION E. Source Group Restrictions.**

(2) Inspect the flame pattern, as applicable, and adjust the burner as necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available.

(3) Inspect the system controlling the air-to-fuel ratio, as applicable, and ensure that it is correctly calibrated and functioning properly (you may delay the inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the inspection until the first outage, not to exceed 36 months from the previous inspection.

(4) Optimize total emissions of CO. This optimization should be consistent with the manufacturer's specifications, if available, and with any nitrogen oxide requirement to which the unit is subject.

(5) Measure the concentrations in the effluent stream of CO in parts per million, by volume, and oxygen in volume percent, before and after the adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). Measurements may be taken using a portable CO analyzer.

(6) Maintain on-site and submit, if requested by the Administrator, a report containing the information in paragraphs (b)(6)(i) through (iii) of this section.

(i) The concentrations of CO in the effluent stream in parts per million, by volume, and oxygen in volume percent, measured at high fire or typical operating load, before and after the tune-up of the boiler.

(ii) A description of any corrective actions taken as a part of the tune-up of the boiler.

(iii) The type and amount of fuel used over the 12 months prior to the tune-up of the boiler, but only if the unit was physically and legally capable of using more than one type of fuel during that period. Units sharing a fuel meter may estimate the fuel use by each unit.

(7) If the unit is not operating on the required date for a tune-up, the tune-up must be conducted within 30 days of startup.

(c) [NA - NO O2 TRIM SYSTEM]

(d) [NA - UNIT(S) NOT DEFINED AS SEASONAL]

(e) [NA - UNIT(S) > 5 MMBTU]

(f) [NA - UNIT(S) NOT LIMITED USE]

(g) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7509, Feb. 1, 2013]

§ 63.11224 What are my monitoring, installation, operation, and maintenance requirements?

(a) [NA - NO CO EMISSION LIMIT]

(b) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(c) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(d) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(e) [NA - NO OPACITY LIMIT]

(f) [NA - NO BAGHOUSE]

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7510, Feb. 1, 2013]

**SECTION E. Source Group Restrictions.**

§ 63.11225 What are my notification, reporting, and recordkeeping requirements?

(a) You must submit the notifications specified in paragraphs (a)(1) through (5) of this section to the administrator.

(1) You must submit all of the notifications in §§ 63.7(b); 63.8(e) and (f); and 63.9(b) through (e), (g), and (h) that apply to you by the dates specified in those sections except as specified in paragraphs (a)(2) and (4) of this section.

(2) An Initial Notification must be submitted no later than January 20, 2014 or within 120 days after the source becomes subject to the standard. [N/A - ALREADY SUBMITTED ON 12/21/2015]

(3) [NA - NO STACK TESTING REQUIRED]

(4) You must submit the Notification of Compliance Status no later than 120 days after the applicable compliance date specified in § 63.11196 unless you must conduct a performance stack test. If you must conduct a performance stack test, you must submit the Notification of Compliance Status within 60 days of completing the performance stack test. You must submit the Notification of Compliance Status in accordance with paragraphs (a)(4)(i) and (vi) of this section. The Notification of Compliance Status must include the information and certification(s) of compliance in paragraphs (a)(4)(i) through (v) of this section, as applicable, and signed by a responsible official.

(i) You must submit the information required in § 63.9(h)(2), except the information listed in § 63.9(h)(2)(i)(B), (D), (E), and (F). If you conduct any performance tests or CMS performance evaluations, you must submit that data as specified in paragraph (e) of this section. If you conduct any opacity or visible emission observations, or other monitoring procedures or methods, you must submit that data to the Administrator at the appropriate address listed in § 63.13.

(ii) "This facility complies with the requirements in § 63.11214 to conduct an initial tune-up of the boiler."

(iii) "This facility has had an energy assessment performed according to § 63.11214(c)."

(iv) For units that install bag leak detection systems: "This facility complies with the requirements in § 63.11224(f)."

(v) For units that do not qualify for a statutory exemption as provided in section 129(g)(1) of the Clean Air Act: "No secondary materials that are solid waste were combusted in any affected unit."

(vi) The notification must be submitted electronically using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written Notification of Compliance Status must be submitted to the Administrator at the appropriate address listed in § 63.13.

(5) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)].

(b) You must prepare, by March 1 of each year, and submit to the delegated authority upon request, an annual compliance certification report for the previous calendar year containing the information specified in paragraphs (b)(1) through (4) of this section. You must submit the report by March 15 if you had any instance described by paragraph (b)(3) of this section. For boilers that are subject only to a requirement to conduct a biennial or 5-year tune-up according to § 63.11223(a) and not subject to emission limits or operating limits, you may prepare only a biennial or 5-year compliance report as specified in paragraphs (b)(1) and (2) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with the official's name, title, phone number, email address, and signature, certifying the truth, accuracy and completeness of the notification and a statement of whether the source has complied with all the relevant standards and other requirements of this subpart. Your notification must include the following certification(s) of compliance, as applicable, and signed by a responsible official:

(i) "This facility complies with the requirements in § 63.11223 to conduct a biennial or 5-year tune-up, as applicable, of each boiler."

**SECTION E. Source Group Restrictions.**

(ii) [NA - UNIT(S) DO NOT BURN SOLID WASTE]

(iii) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)].

(3) If the source experiences any deviations from the applicable requirements during the reporting period, include a description of deviations, the time periods during which the deviations occurred, and the corrective actions taken.

(4) The total fuel use by each affected boiler subject to an emission limit, for each calendar month within the reporting period, including, but not limited to, a description of the fuel, whether the fuel has received a non-waste determination by you or EPA through a petition process to be a non-waste under § 241.3(c), whether the fuel(s) were processed from discarded non-hazardous secondary materials within the meaning of § 241.3, and the total fuel usage amount with units of measure.

(c) You must maintain the records specified in paragraphs (c)(1) through (7) of this section.

(1) As required in § 63.10(b)(2)(xiv), you must keep a copy of each notification and report that you submitted to comply with this subpart and all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted.

(2) You must keep records to document conformance with the work practices, emission reduction measures, and management practices required by § 63.11214 and § 63.11223 as specified in paragraphs (c)(2)(i) through (vi) of this section.

(i) Records must identify each boiler, the date of tune-up, the procedures followed for tune-up, and the manufacturer's specifications to which the boiler was tuned.

(ii) [NA - UNIT(S) DO NOT BURN SOLID WASTE]

(iii) [NA - ENERGY ASSESSMENT NOT REQUIRED FOR NEW BOILERS]

(iv) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(v) [NA - UNIT(S) NOT DEFINED AS SEASONAL]

(vi) [NA - UNIT(S) NOT DEFINED AS LIMITED USE]

(3) [NA - NO HG EMISSION LIMIT]

(4) Records of the occurrence and duration of each malfunction of the boiler, or of the associated air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with the general duty to minimize emissions in § 63.11205(a), including corrective actions to restore the malfunctioning boiler, air pollution control, or monitoring equipment to its normal or usual manner of operation.

(6) [NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

(7) [NA - NO BAGHOUSE]

(d) Your records must be in a form suitable and readily available for expeditious review. You must keep each record for 5 years following the date of each recorded action. You must keep each record on-site or be accessible from a central location by computer or other means that instantly provide access at the site for at least 2 years after the date of each recorded action. You may keep the records off site for the remaining 3 years.

(e)(1) [NA - STACK TESTING AND CEMS NOT REQUIRED]

(f) [NA - UNITS DO NOT BURN SOLID WASTE]

**SECTION E. Source Group Restrictions.**

(g) If you have switched fuels or made a physical change to the boiler and the fuel switch or change resulted in the applicability of a different subcategory within this subpart, in the boiler becoming subject to this subpart, or in the boiler switching out of this subpart due to a fuel change that results in the boiler meeting the definition of gas-fired boiler, as defined in §63.11237, or you have taken a permit limit that resulted in you becoming subject to this subpart or no longer being subject to this subpart, you must provide notice of the date upon which you switched fuels, made the physical change, or took a permit limit within 30 days of the change. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that have switched fuels, were physically changed, or took a permit limit, and the date of the notice.

(2) The date upon which the fuel switch, physical change, or permit limit occurred.

[76 FR 15591, Mar. 21, 2011, as amended at 78 FR 7511, Feb. 1, 2013; 81 FR 63126, Sept. 14, 2016] .

§ 63.11226 Affirmative defense for violation of emission standards during malfunction.

[NA - NO EMISSION LIMITS IF PERMITTEE FOLLOWS REQUIREMENTS IN 63.11210(e)]

Other Requirements and Information

§ 63.11235 What parts of the General Provisions apply to me?

Table 8 to this subpart shows which parts of the General Provisions in §§ 63.1 through 63.15 apply to you.

§ 63.11236 Who implements and enforces this subpart? [INCOPORATED BY REFERENCE]

§ 63.11237 What definitions apply to this subpart? [INCORPORATED BY REFERENCE]

Regulatory Changes:

The boiler is subject to 40 CFR Part 63 Subpart JJJJJJ of the National Emission Standards for Hazardous Air Pollutants for Source Categories and shall comply with all applicable requirements of this Subpart including the applicable portions of the General Provisions as described in 40 CFR Part 63 Subpart A. All notifications, requests, reports and other communications required under the Subpart shall be sent to both the Department and EPA. The EPA copies shall be forwarded to:

Director
Air Protection Division (3AP00)
U.S. EPA Region III
1650 Arch Street
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager
PA Department of Environmental Protection
909 Elmerton Avenue
Harrisburg, PA 17110-8200

In the event that Subpart JJJJJJ is revised by EPA, the permittee shall comply with the revised version of Subpart JJJJJJ, and shall not be required to comply with any provisions in this permit designated as having Subpart JJJJJJ as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised Subpart JJJJJJ.

**SECTION E. Source Group Restrictions.**

Group Name: G04

Group Description: 40 CFR Part 60 Subpart Dc for # 2 oil fired boiler

Sources included in this group

ID	Name
032	UNIT 4 (OIL-FIRED BOILER) CLEAVER-BROOKS CB-350

I. RESTRICTIONS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.

**# 001 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Applicability and delegation of authority.**

§ 60.40c Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, § 60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(d) [NA – UNIT(S) NOT ASSOCIATED WITH COMBUSTION RESEARCH]

(e) [NA – UNIT(S) NOT ASSOCIATED WITH STATIONARY COMBUSTION TURBINE]

(f) [NA – NOT SUBJECT TO NSPS AAAA OR CCCC]

**SECTION E. Source Group Restrictions.**

(g) [NA – NOT SUBJECT TO NSPS BBBBB]

(h) [NA – NOT SUBJECT TO NSPS J OR Ja]

(i) [NA – UNIT(S) ARE NOT TEMPORARY BOILERS]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

§ 60.42c Standard for sulfur dioxide (SO₂).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT COAL FIRED]

(c) [NA – UNIT(S) NOT COAL FIRED]

(d) On and after the date on which the initial performance test is completed or required to be completed under § 60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO₂ in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) [NA – MULTIPLE SIMULTANEOUS FUELS NOT USED]

(f) [NA – UNIT(S) NOT COAL FIRED]

(g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under § 60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) Other fuels-fired affected facilities with heat input capacities between 2.9 and 8.7 MW (10 and 30 MMBtu/h).

(i) The SO₂ emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) [NA – UNIT(S) NOT IN NON-CONTINENTAL AREA]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.43c Standard for particulate matter (PM).

(a) [NA – UNIT(S) NOT COAL FIRED]

(b) [NA – UNIT(S) NOT WOOD FIRED]

(c) [NA – UNIT(S) < 30 MMBTU]

(d) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

**SECTION E. Source Group Restrictions.**

(e)(1) [NA – UNIT(S) < 30 MMBTU]

(2) [NA – UNIT(S) < 30 MMBTU]

(3) [NA – UNIT(S) < 30 MMBTU]

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under § 60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO₂ emissions is not subject to the PM limit in this section.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

§ 60.44c Compliance and performance test methods and procedures for sulfur dioxide.

(a) – (g) [NA - PARAGRAPH (h) APPLIES]

(h) For affected facilities subject to § 60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in § 60.48c(f), as applicable.

(i) [NA – UNIT(S) NOT COAL FIRED]

(j) [NA - PARAGRAPH (h) APPLIES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

§ 60.45c Compliance and performance test methods and procedures for particulate matter.

(a) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(b) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(c) [NA – UNIT(S) NOT SUBJECT TO PM LIMITS]

(d) The owner or operator of an affected facility seeking to demonstrate compliance under § 60.43c(e)(4) shall follow the applicable procedures under § 60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

§ 60.46c Emission monitoring for sulfur dioxide.

(a) – (d) [NA - PARAGRAPH (e) APPLIES]

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to § 60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, as described under § 60.48c(f), as applicable.

(f) [NA - PARAGRAPH (e) APPLIES]

§ 60.47c Emission monitoring for particulate matter.

(a) - (f) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16,

**SECTION E. Source Group Restrictions.**

2012]

§ 60.48c Reporting and recordkeeping requirements.

(a) [NA – STARTUP IS IN THE PAST]

(b) The owner or operator of each affected facility subject to the SO₂ emission limits of § 60.42c, or the PM or opacity limits of § 60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.

(c) [NA – NOT SUBJECT TO PM LIMIT OR OPACITY STANDARD]

(d) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall submit reports to the Administrator.

(e) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under § 60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

(1) Calendar dates covered in the reporting period.

(2) – (10) [NA – FUEL SUPPLIER CERTIFICATION USED]

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in § 60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) [NA – UNIT(S) NOT RESIDUAL OIL FIRED]

(3) [NA – UNIT(S) NOT COAL FIRED]

(4) [N/A - NO OTHER FUELS]

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in § 60.48c(f) to demonstrate compliance with the SO₂ standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel COMBUSTED during each calendar month.

(3) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility or multiple affected facilities located on a contiguous property unit where the only fuels combusted in any steam generating unit (including steam generating units not subject to this subpart) at that property are natural gas, wood,

**SECTION E. Source Group Restrictions.**

distillate oil meeting the most current requirements in § 60.42C to use fuel certification to demonstrate compliance with the SO₂ standard, and/or fuels, excluding coal and residual oil, not subject to an emissions standard (excluding opacity) may elect to record and maintain records of the total amount of each steam generating unit fuel DELIVERED to that property during each calendar month.

(h) [NA – UNIT(S) NO ANNUAL CAPACITY FACTOR]

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period. [SIX MONTHS PERIODS SHALL BE DEFINED AS CALENDAR HALVES]

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

Regulatory Changes

Individual sources within this source group that are subject to 40 CFR Part 60 Subpart Dc shall comply with all applicable requirements of the Subpart. 40 CFR 60.4 requires submission of copies of all requests, reports and other communications to both the Department and the EPA. The EPA copies shall be forwarded to:

Director
Air Protection Division (3AP00)
U.S. EPA Region III
1650 Arch Street
Philadelphia, PA 19103-2029

The Department copies shall be forwarded to:

Regional Air Program Manager
PA Department of Environmental Protection
909 Elmerton Avenue
Harrisburg, PA 17110-8200

In the event that the Federal Subpart that is the subject of this Source Group is revised, the permittee shall comply with the revised version of the subpart, and shall not be required to comply with any provisions in this permit designated as having the subpart as their authority, to the extent that such permit provisions would be inconsistent with the applicable provisions of the revised subpart.

**SECTION E. Source Group Restrictions.**

Group Name: G101

Group Description: Grading Building

Sources included in this group

ID	Name
101A	MCI TRIM SAW
101B	NEWMAN S-282 PLANER
101C	NEWMAN & WHITNEY KF24 RIP SAW

I. RESTRICTIONS.**Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The Permittee may not allow the emission into the outdoor atmosphere of particulate matter from any source in a manner that the particulate matter in the effluent gas exceeds 0.04 grains per dry standard cubic foot.

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.**# 002 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Control devices for sources in source ID 101 shall be operated at all times when the applicable source is in operation.

IV. RECORDKEEPING REQUIREMENTS.**# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

A weekly record should be maintained of the pressure drop readings and gauge performance on control device C101B.

A maintenance log should be maintained of all repairs performed on each fabric filter, including, but not limited to bag change-out.

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 004 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

Operation of any air emissions source is contingent upon proper operation of its associated emissions control system, unless otherwise approved by the Department.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.



SECTION G. Emission Restriction Summary.

No emission restrictions listed in this section of the permit.

**SECTION H. Miscellaneous.**

The following sources and activities are not subject to any specific work practice standards, testing, monitoring, recordkeeping, or reporting requirements:

- Three (3) 1000 gallon propane tanks
- Two (2) motor oil tanks
- Two (2) hydraulic oil tanks
- One (1) 10,000 gallon #2 oil heating tank
- One (1) 10,000 gallon diesel fuel tank
- Green sawdust hopper and overflow bins (boiler fuel storage)
- Dry storage sawdust storage hopper
- Filing room (blade sharpening)
- Two (2) dip tanks
- Mulching operation
- Log debarking Operations
- Sawmill
- Sawmill chipping operation
- One (1) 240-gallon waste oil aboveground tank
- One (1) 500-gallon waste oil/antifreeze mix aboveground tank
- One (1) Clean Burn CB-1750 175,000 Btu/hr waste oil-fired Space Heater (RFD #5402 on 2/18/16)



***** End of Report *****
