



**COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
AIR QUALITY PROGRAM**

STATE ONLY SYNTHETIC MINOR OPERATING PERMIT

Issue Date: December 14, 2022

Effective Date: December 14, 2022

Expiration Date: November 30, 2027

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable unless otherwise designated.

State Only Permit No: 43-00252

Synthetic Minor

Federal Tax Id - Plant Code: 25-1065148-1

Owner Information

Name: GROVE CITY COLL
Mailing Address: 100 CAMPUS DR
GROVE CITY, PA 16127-2101

Plant Information

Plant: GROVE CITY COLL/GROVE CITY
Location: 43 Mercer County 43804 Grove City Borough
SIC Code: 8221 Services - Colleges And Universities

Responsible Official

Name: SUSAN C. GRIMM
Title: INTERIM VP OF OPERATIONS
Phone: (724) 458 - 2984 Email: grimmsc@gcc.edu

Permit Contact Person

Name: SUSAN C. GRIMM
Title: INTERIM VP FOR OPERATIONS
Phone: (724) 458 - 2984 Email: grimmsc@gcc.edu

[Signature] _____
ERIC A. GUSTAFSON, NORTHWEST REGION AIR PROGRAM MANAGER



SECTION A. Table of Contents

Section A. Facility/Source Identification

Table of Contents
Site Inventory List

Section B. General State Only Requirements

- #001 Definitions.
- #002 Operating Permit Duration.
- #003 Permit Renewal.
- #004 Operating Permit Fees under Subchapter I.
- #005 Transfer of Operating Permits.
- #006 Inspection and Entry.
- #007 Compliance Requirements.
- #008 Need to Halt or Reduce Activity Not a Defense.
- #009 Duty to Provide Information.
- #010 Revising an Operating Permit for Cause.
- #011 Operating Permit Modifications
- #012 Severability Clause.
- #013 De Minimis Emission Increases.
- #014 Operational Flexibility.
- #015 Reactivation
- #016 Health Risk-based Emission Standards and Operating Practice Requirements.
- #017 Circumvention.
- #018 Reporting Requirements.
- #019 Sampling, Testing and Monitoring Procedures.
- #020 Recordkeeping.
- #021 Property Rights.
- #022 Alternative Operating Scenarios.
- #023 Reporting
- #024 Report Format

Section C. Site Level State Only Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

Section D. Source Level State Only Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements
- D-VI: Work Practice Standards
- D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

Section E. Source Group Restrictions

- E-I: Restrictions



SECTION A. Table of Contents

- E-II: Testing Requirements
- E-III: Monitoring Requirements
- E-IV: Recordkeeping Requirements
- E-V: Reporting Requirements
- E-VI: Work Practice Standards
- E-VII: Additional Requirements

Section F. Alternative Operating Scenario(s)






- F-I: Restrictions
- F-II: Testing Requirements
- F-III: Monitoring Requirements
- F-IV: Recordkeeping Requirements
- F-V: Reporting Requirements
- F-VI: Work Practice Standards
- F-VII: Additional Requirements

Section G. Emission Restriction Summary

Section H. Miscellaneous

**SECTION A. Site Inventory List**

| Source ID | Source Name | Capacity/Throughput | Fuel/Material |
|-----------|--------------------------------------|---------------------|---------------|
| 031 | BOILER 031 | 20.900 MMBTU/HR | |
| | | 0.800 Tons/HR | Bituminous |
| | | 20.900 MCF/HR | Natural Gas |
| 032 | BOILER 032 | 20.900 MMBTU/HR | |
| | | 20.900 MCF/HR | Natural Gas |
| 033 | BOILER 033 | 20.900 MMBTU/HR | |
| | | 20.900 MCF/HR | Natural Gas |
| | | 149.300 Gal/HR | #2 Oil |
| 034 | BOILER 034 | 21.000 MMBTU/HR | |
| | | 21.000 MCF/HR | Natural Gas |
| | | 149.300 Gal/HR | #2 Oil |
| 035 | MISCELLANEOUS NATURAL GAS COMBUSTION | 10.000 MCF/HR | Natural Gas |
| 101 | MAINTENANCE GARAGE DEGREASER UNIT | N/A | 142 SOLVENT |
| FML01 | COAL | | |
| FML02 | NATURAL GAS | | |
| FML03 | FUEL OIL | | |
| S001 | BOILER 031 STACK | | |
| S002 | BOILER 032 STACK | | |
| S003 | BOILER 033 STACK | | |
| S034 | BOILER 034 STACK | | |
| Z01 | FUGITIVE STACK | | |

PERMIT MAPS



PERMIT MAPS



**SECTION B. General State Only Requirements****#001 [25 Pa. Code § 121.1]****Definitions.**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and in 25 Pa. Code § 121.1.

#002 [25 Pa. Code § 127.446]**Operating Permit Duration.**

- (a) This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit.
- (b) The terms and conditions of the expired permit shall automatically continue pending issuance of a new operating permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit.

#003 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446 & 127.703(b)]**Permit Renewal.**

- (a) The permittee shall submit a timely and complete application for renewal of the operating permit to the appropriate Regional Air Program Manager. The application for renewal of the operating permit shall be submitted at least six (6) months and not more than 18 months before the expiration date of this permit.
- (b) The application for permit renewal shall include the current permit number, a description of any permit revisions that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.
- (c) The permittee shall submit with the renewal application a fee for the processing of the application as specified in 25 Pa. Code § 127.703(b). The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.
- (d) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413.
- (e) The application for renewal of the operating permit shall also include submission of supplemental compliance review forms in accordance with the requirements of 25 Pa. Code § 127.412(b) and § 127.412(j).
- (f) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information as necessary to address any requirements that become applicable to the source after the permittee submits a complete application, but prior to the date the Department takes action on the permit application.

#004 [25 Pa. Code § 127.703]**Operating Permit Fees under Subchapter I.**

- (a) The permittee shall pay the annual operating permit maintenance fee according to the following fee schedule in either paragraph (1) or (2) in accordance with 25 Pa. Code § 127.703(d) on or before December 31 of each year for the next calendar year.
- (1) For a synthetic minor facility, a fee equal to:
- (i) Four thousand dollars (\$4,000) for calendar years 2021—2025.
 - (ii) Five thousand dollars (\$5,000) for calendar years 2026—2030.
 - (iii) Six thousand three hundred dollars (\$6,300) for the calendar years beginning with 2031.

**SECTION B. General State Only Requirements**

(2) For a facility that is not a synthetic minor, a fee equal to:

- (i) Two thousand dollars (\$2,000) for calendar years 2021—2025.
- (ii) Two thousand five hundred dollars (\$2,500) for calendar years 2026—2030.
- (iii) Three thousand one hundred dollars (\$3,100) for the calendar years beginning with 2031.

(b) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#005 [25 Pa. Code §§ 127.450 (a)(4) and 127.464]**Transfer of Operating Permits.**

(a) This operating permit may not be transferred to another person, except in cases of transfer-of-ownership that are documented and approved by the Department.

(b) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership of the source shall be treated as an administrative amendment if the Department determines that no other change in the permit is required and a written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee and a compliance review form has been submitted to, and the permit transfer has been approved by, the Department.

(c) This operating permit is valid only for those specific sources and the specific source locations described in this permit.

#006 [25 Pa. Code § 127.441 and 35 P.S. § 4008]**Inspection and Entry.**

(a) Upon presentation of credentials and other documents as may be required by law, the permittee shall allow the Department or authorized representatives of the Department to perform the following:

(1) Enter at reasonable times upon the permittee's premises where a source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;

(2) Have access to and copy, at reasonable times, any records that are kept under the conditions of this permit;

(3) Inspect at reasonable times, any facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;

(4) Sample or monitor, at reasonable times, any substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act or regulations adopted thereunder including denying the Department access to a source at this facility. Refusal of entry or access may constitute grounds for permit revocation and assessment of criminal and/or civil penalties.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

#007 [25 Pa. Code §§ 127.441 & 127.444]**Compliance Requirements.**

(a) The permittee shall comply with the conditions of this operating permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one or more of the following:

**SECTION B. General State Only Requirements**

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source which is subject to 25 Pa. Code Article III unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued for the source is operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this State-Only permit. Nothing in this sub-condition shall be construed to create an independent affirmative duty upon the permittee to obtain a predetermination from the Department for physical configuration or engineering design detail changes made by the permittee.

#008 [25 Pa. Code § 127.441]**Need to Halt or Reduce Activity Not a Defense.**

It shall not be a defense for the permittee in an enforcement action that it was necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

#009 [25 Pa. Code §§ 127.442(a) & 127.461]**Duty to Provide Information.**

(a) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of each source at the facility.

(b) The permittee shall furnish to the Department, in writing, information that the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to maintain in accordance with this permit.

#010 [25 Pa. Code § 127.461]**Revising an Operating Permit for Cause.**

This operating permit may be terminated, modified, suspended or revoked and reissued if one or more of the following applies:

- (1) The permittee constructs or operates the source subject to the operating permit so that it is in violation of the Air Pollution Control Act, the Clean Air Act, the regulations thereunder, a plan approval, a permit or in a manner that causes air pollution.
- (2) The permittee fails to properly or adequately maintain or repair an air pollution control device or equipment attached to or otherwise made a part of the source.
- (3) The permittee has failed to submit a report required by the operating permit or an applicable regulation.
- (4) The EPA determines that the permit is not in compliance with the Clean Air Act or the regulations thereunder.

#011 [25 Pa. Code §§ 127.450, 127.462, 127.465 & 127.703]**Operating Permit Modifications**

(a) The permittee is authorized to make administrative amendments, minor operating permit modifications and significant operating permit modifications, under this permit, as outlined below:

**SECTION B. General State Only Requirements**

(b) Administrative Amendments. The permittee shall submit the application for administrative operating permit amendments (as defined in 25 Pa. Code § 127.450(a)), according to procedures specified in § 127.450 unless precluded by the Clean Air Act or its regulations.

(c) Minor Operating Permit Modifications. The permittee shall submit the application for minor operating permit modifications (as defined 25 Pa. Code § 121.1) in accordance with 25 Pa. Code § 127.462.

(d) Significant Operating Permit Modifications. The permittee shall submit the application for significant operating permit modifications in accordance with 25 Pa. Code § 127.465.

(e) The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

#012 [25 Pa. Code § 127.441]**Severability Clause.**

The provisions of this permit are severable, and if any provision of this permit is determined by a court of competent jurisdiction to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

#013 [25 Pa. Code § 127.449]**De Minimis Emission Increases.**

(a) This permit authorizes de minimis emission increases in accordance with 25 Pa. Code § 127.449 so long as the permittee provides the Department with seven (7) days prior written notice before commencing any de minimis emissions increase. The written notice shall:

(1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.

(2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

(b) The Department may disapprove or condition de minimis emission increases at any time.

(c) Except as provided below in (d), the permittee is authorized to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

(1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.

(2) One ton of NO_x from a single source during the term of the permit and 5 tons of NO_x at the facility during the term of the permit.

(3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.

(4) Six-tenths of a ton of PM₁₀ from a single source during the term of the permit and 3.0 tons of PM₁₀ at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act, the regulations thereunder or 25 Pa. Code Article III.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) In accordance with § 127.14, the permittee is authorized to install the following minor sources without the need for a plan approval or permit modification:

**SECTION B. General State Only Requirements**

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
 - (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.
 - (3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code §123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.
 - (4) Space heaters which heat by direct heat transfer.
 - (5) Laboratory equipment used exclusively for chemical or physical analysis.
 - (6) Other sources and classes of sources determined to be of minor significance by the Department.
- (e) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:
- (1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (c)(4) and (5) of this permit condition.
 - (2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.
 - (3) Violate any applicable requirement of this permit, the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.
- (f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.
- (g) Except for de minimis emission increases, installation of minor sources made pursuant to this permit condition and Plan Approval Exemptions under 25 Pa. Code § 127.14 (relating to exemptions), the permittee is prohibited from making changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.
- (h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

#014 [25 Pa. Code § 127.3]**Operational Flexibility.**

The permittee is authorized to make changes within the facility in accordance with the regulatory provisions outlined in 25 Pa. Code § 127.3 (relating to operational flexibility) to implement the operational flexibility requirements provisions authorized under Section 6.1(i) of the Air Pollution Control Act and the operational flexibility terms and conditions of this permit. The provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements include the following:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with Federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)

**SECTION B. General State Only Requirements**

(6) Section 127.462 (relating to minor operating permit modifications)

(7) Subchapter H (relating to general plan approvals and general operating permits)

#015 [25 Pa. Code § 127.11]**Reactivation**

(a) The permittee may not reactivate a source that has been out of operation or production for at least one year unless the reactivation is conducted in accordance with a plan approval granted by the Department or in accordance with reactivation and maintenance plans developed and approved by the Department in accordance with 25 Pa. Code § 127.11a(a).

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

#016 [25 Pa. Code § 127.36]**Health Risk-based Emission Standards and Operating Practice Requirements.**

(a) When needed to protect public health, welfare and the environment from emissions of hazardous air pollutants from new and existing sources, the permittee shall comply with the health risk-based emission standards or operating practice requirements imposed by the Department, except as precluded by §§ 6.6(d)(2) and (3) of the Air Pollution Control Act [35 P.S. § 4006.6(d)(2) and (3)].

(b) A person challenging a performance or emission standard established by the Department has the burden to demonstrate that performance or emission standard does not meet the requirements of Section 112 of the Clean Air Act.

#017 [25 Pa. Code § 121.9]**Circumvention.**

No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of 25 Pa. Code Article III, except that with prior approval of the Department, the device or technique may be used for control of malodors.

#018 [25 Pa. Code §§ 127.402(d) & 127.442]**Reporting Requirements.**

(a) The permittee shall comply with the applicable reporting requirements of the Clean Air Act, the regulations thereunder, the Air Pollution Control Act and 25 Pa. Code Article III including Chapters 127, 135 and 139.

(b) The permittee shall submit reports to the Department containing information the Department may prescribe relative to the operation and maintenance of any air contamination source.

(c) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager
PA Department of Environmental Protection
(At the address given in the permit transmittal letter, or otherwise notified)

(d) Any records or information including applications, forms, or reports submitted pursuant to this permit condition shall contain a certification by a responsible official as to truth, accuracy and completeness. The certifications submitted under this permit shall require a responsible official of the facility to certify that based on information and belief formed after reasonable inquiry, the statements and information in the documents are true, accurate and complete.

(e) Any records, reports or information submitted to the Department shall be available to the public except for such

**SECTION B. General State Only Requirements**

records, reports or information which meet the confidentiality requirements of § 4013.2 of the Air Pollution Control Act and §§ 112(d) and 114(c) of the Clean Air Act. The permittee may not request a claim of confidentiality for any emissions data generated for the facility.

#019 [25 Pa. Code §§ 127.441(c) & 135.5]**Sampling, Testing and Monitoring Procedures.**

(a) The permittee shall comply with the monitoring, recordkeeping or reporting requirements of 25 Pa. Code Chapter 139 and the other applicable requirements of 25 Pa. Code Article III and additional requirements related to monitoring, reporting and recordkeeping required by the Clean Air Act and the regulations thereunder including the Compliance Assurance Monitoring requirements of 40 CFR Part 64, where applicable.

(b) Unless alternative methodology is required by the Clean Air Act and regulations adopted thereunder, sampling, testing and monitoring required by or used by the permittee to demonstrate compliance with any applicable regulation or permit condition shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139.

#020 [25 Pa. Code §§ 127.441(c) and 135.5]**Recordkeeping.**

(a) The permittee shall maintain and make available, upon request by the Department, the following records of monitored information:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.
- (5) The results of the analyses.
- (6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of any required monitoring data and supporting information for at least five (5) years from the date of the monitoring, sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions.

#021 [25 Pa. Code § 127.441(a)]**Property Rights.**

This permit does not convey any property rights of any sort, or any exclusive privileges.

#022 [25 Pa. Code § 127.447]**Alternative Operating Scenarios.**

The permittee is authorized to make changes at the facility to implement alternative operating scenarios identified in this permit in accordance with 25 Pa. Code § 127.447.

**SECTION B. General State Only Requirements****#023 [25 Pa. Code §135.3]****Reporting**

(a) If the facility is a Synthetic Minor Facility, the permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator of a Synthetic Minor Facility may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

#024 [25 Pa. Code §135.4]**Report Format**

If applicable, the emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.

**SECTION C. Site Level Requirements****I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.1]****Prohibition of certain fugitive emissions**

No person may permit the emission into the outdoor atmosphere of fugitive air contaminant from a source other than the following:

- (1) Construction or demolition of buildings or structures.
- (2) Grading, paving and maintenance of roads and streets.
- (3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.
- (4) Clearing of land.
- (5) Stockpiling of materials.
- (6) Open burning operations.
- (7) Sources and classes of sources other than those identified above, for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:
 - (i) the emissions are of minor significance with respect to causing air pollution; and
 - (ii) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

002 [25 Pa. Code §123.2]**Fugitive particulate matter**

A person may not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in Condition #001, above, if such emissions are visible at the point the emissions pass outside the person's property.

003 [25 Pa. Code §123.31]**Limitations**

A person may not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

004 [25 Pa. Code §123.41]**Limitations**

A person may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

- (1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.
- (2) Equal to or greater than 60% at any time.

005 [25 Pa. Code §123.42]**Exceptions**

The limitations of 25 PA Code 123.41 (relating to limitations) shall not apply to a visible emission in any of the following instances:

- (1) When the presence of uncombined water is the only reason for failure of the emission to meet the limitations.
- (2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.

**SECTION C. Site Level Requirements**

(3) When the emission results from sources specified in 25 PA Code 123.1(a)(1) -- (9) (relating to prohibition of certain fugitive emissions).

II. TESTING REQUIREMENTS.**# 006 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured using either of the following:

- (1) A device approved by the Department and maintained to provide accurate opacity measurements.
- (2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

(a) The permittee shall, at a minimum, obtain one of the following:

1. A coal analysis of the btu value, moisture, ash, and sulfur content (% by weight), conducted on a representative sample of each shipment received.
2. Written certification from the coal supplier, signed by a responsible official, which certifies the aforesaid fuel characteristics for each shipment delivered to the facility.

(b) The permittee shall, at a minimum, obtain one of the following:

1. A fuel oil analysis of the btu value and sulfur content (% by weight), conducted on each shipment received.
2. Written certification from the fuel oil supplier, signed by a responsible official, which certifies the aforesaid fuel characteristics for each shipment delivered to the facility.

(c) The permittee shall record the fuel characteristics, data source and analysis date of each coal and/or fuel oil shipment and shall maintain all of the testing results and/or certifications for at least five years from the testing or certification date.

(d) The permittee shall maintain monthly records of the following:

1. Coal usage
2. #2 Fuel oil usage
3. Natural gas usage
4. Average sulfur content of the coal

V. REPORTING REQUIREMENTS.**# 008 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall compile and submit a semi-annual compliance certification report to the Department within thirty (30)

**SECTION C. Site Level Requirements**

days of the end of each semi-annual period for all coal and fuel oil shipments received during the preceding six (6) months. This report shall clearly identify all excursions and deviations of the defined fuel characteristics.

009 [25 Pa. Code §135.21]**Emission statements**

a) The owner or operator of each stationary source emitting oxides of nitrogen or VOC's shall provide the Department with a statement, in a form as the Department may prescribe, for classes or categories of sources, showing the actual emissions of oxides of nitrogen and VOCs from that source for each reporting period, a description of the method used to calculate the emissions and the time period over which the calculation is based. The statement shall contain a certification by a company officer or the plant manager that the information contained in the statement is accurate.

b) Annual emission statements are due by March 1 for the preceding calendar year and shall provide data consistent with requirements and guidance developed by the EPA. The guidance document is available from: United States Environmental Protection Agency, 401 M. Street, S.W., Washington, D.C. 20460. The Department may require more frequent submittals if the Department determines that one or more of the following applies:

- (1) A more frequent submission is required by the EPA.
- (2) Analysis of the data on a more frequent basis is necessary to implement the requirements of the act.

VI. WORK PRACTICE REQUIREMENTS.**# 010 [25 Pa. Code §121.7]****Prohibition of air pollution.**

No person may permit air pollution as that term is defined in the act.

011 [25 Pa. Code §123.1]**Prohibition of certain fugitive emissions**

A person responsible for any source specified in Condition #001, above, shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall include, but not be limited to, the following:

- (1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.
- (2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.
- (3) Paving and maintenance of roadways.
- (4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

VII. ADDITIONAL REQUIREMENTS.**# 012 [25 Pa. Code §129.14]****Open burning operations**

- (a) Air basins. No person may permit the open burning of material in an air basin.
- (b) Outside of air basins. No person may permit the open burning of material in an area outside of air basins in a manner that:
 - (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.
 - (2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.

**SECTION C. Site Level Requirements**

(3) The emissions interfere with the reasonable enjoyment of life or property.

(4) The emissions cause damage to vegetation or property.

(5) The emissions are or may be deleterious to human or animal health.

(c) Exceptions: The requirements of subsections (a) and (b) do not apply where the open burning operations result from:

(1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.

(2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.

(3) A fire set for the prevention and control of disease or pests, when approved by the Department.

(4) A fire set in conjunction with the production of agricultural commodities in their unmanufactured state on the premises of the farm operation.

(5) A fire set for the purpose of burning domestic refuse, when the fire is on the premises of a structure occupied solely as a dwelling by two families or less and when the refuse results from the normal occupancy of such structure.

(6) A fire set solely for recreational or ceremonial purposes.

(7) A fire set solely for cooking food.

(d) Clearing and grubbing wastes. The following is applicable to clearing and grubbing wastes:

(1) As used in this subsection the following terms shall have the following meanings:

Air curtain destructor -- A mechanical device which forcefully projects a curtain of air across a pit in which open burning is being conducted so that combustion efficiency is increased and smoke and other particulate matter are contained.

Clearing and grubbing wastes -- Trees, shrubs, and other native vegetation which are cleared from land during or prior to the process of construction. The term does not include demolition wastes and dirt laden roots.

(2) Subsection (a) notwithstanding, clearing and grubbing wastes may be burned in a basin subject to the following requirements:

(i) Air curtain destructors shall be used when burning clearing and grubbing wastes.

(ii) Each proposed use of air curtain destructors shall be reviewed and approved by the Department in writing with respect to equipment arrangement, design and existing environmental conditions prior to commencement of burning. Proposals approved under this subparagraph need not obtain plan approval or operating permits under Chapter 127 (relating to construction modification, reactivation and operation of sources).

(iii) Approval for use of an air curtain destructor at one site may be granted for a specified period not to exceed 3 months, but may be extended for additional limited periods upon further approval by the Department.

(iv) The Department reserves the right to rescind approval granted if a determination by the Department indicates that an air pollution problem exists.

(3) Subsection (b) notwithstanding clearing and grubbing wastes may be burned outside of an air basin, subject to the following limitations:

(i) Upon receipt of a complaint or determination by the Department that an air pollution problem exists, the Department may order that the open burning cease or comply with subsection (b) of this section.

**SECTION C. Site Level Requirements**

(ii) Authorization for open burning under this paragraph does not apply to clearing and grubbing wastes transported from an air basin for disposal outside of an air basin.

(4) During an air pollution episode, open burning is limited by Chapter 137 (relating to air pollution episodes) and shall cease as specified in such chapter.

[This permit does not constitute authorization to burn solid waste pursuant to Section 610(3) of the Solid Waste Management Act, 35 P.S. Section 6018.610(3), or any other provision of the Solid Waste Management Act.]

VIII. COMPLIANCE CERTIFICATION.

No additional compliance certifications exist except as provided in other sections of this permit including Section B (relating to State Only General Requirements).

IX. COMPLIANCE SCHEDULE.

No compliance milestones exist.

**SECTION D. Source Level Requirements**

Source ID: 031

Source Name: BOILER 031

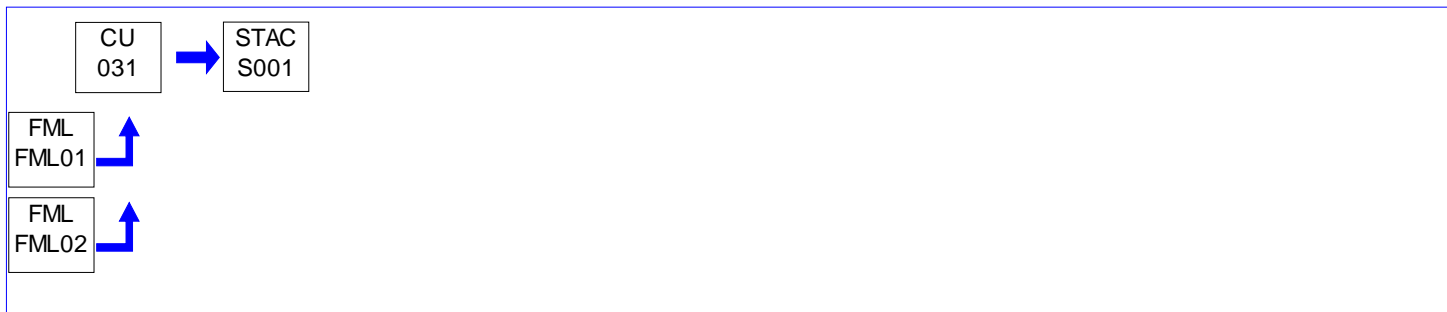
Source Capacity/Throughput: 20.900 MMBTU/HR

0.800 Tons/HR

Bituminous

20.900 MCF/HR

Natural Gas

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas shall conform with the following:

(1) General provision. No person may permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

(2)-(4) Not applicable

(b) - (h) Not applicable

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in: 25 PA Code 123.22(a)(1) SIP Approved SO₂ Limits 40 CFR 52.2020(c)(1)]

003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11201]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What standards must I meet?**

(a) You must comply with each emission limit specified in Table 1 [#6 Existing coal-fired boilers with heat input capacity of 10 mmbtu/hr or greater that do not meet the definition of limit-use boiler - (a) mercury: less than or equal to 2.2e-05 lb per mmbtu of heat input except during periods of startup and shutdown (b) CO: less than or equal to 420 ppm by volume on a dry basis corrected to 3% oxygen (3-run average or 10-day rolling average) except during periods of startup and shutdown] to this subpart that applies to your boiler.

(b) You must comply with each work practice standard, emission reduction measure, and management practice specified in Table 2 [#1. Existing or new coal-fired, new biomass-fired, or new oil-fired boilers (units with heat input capacity of 10 MMBtu/hr or greater) - Minimize the boiler's startup and shutdown periods and conduct startups and shutdowns according to the manufacturer's recommended procedures. If manufacturer's recommended procedures are not available, you must follow recommended procedures for a unit of similar design for which manufacturer's recommended procedures are available. #16. Existing coal-fired, biomass-fired, or oil-fired boilers (units with heat input capacity of 10 MMBtu/hr and

**SECTION D. Source Level Requirements**

greater), not including limited-use boilers - Must have a one-time energy assessment performed by a qualified energy assessor. An energy assessment completed on or after January 1, 2008, that meets or is amended to meet the energy assessment requirements in this table satisfies the energy assessment requirement. Energy assessor approval and qualification requirements are waived in instances where past or amended energy assessments are used to meet the energy assessment requirements. A facility that operated under an energy management program developed according to the ENERGY STAR guidelines for energy management or compatible with ISO 50001 for at least 1 year between January 1, 2008, and the compliance date specified in § 63.11196 that includes the affected units also satisfies the energy assessment requirement. The energy assessment must include the following with extent of the evaluation for items (1) to (4) appropriate for the on-site technical hours listed in § 63.11237: (1) A visual inspection of the boiler system, (2) An evaluation of operating characteristics of the affected boiler systems, specifications of energy use systems, operating and maintenance procedures, and unusual operating constraints, (3) An inventory of major energy use systems consuming energy from affected boiler(s) and which are under control of the boiler owner or operator, (4) A review of available architectural and engineering plans, facility operation and maintenance procedures and logs, and fuel usage, (5) A list of major energy conservation measures that are within the facility's control, (6) A list of the energy savings potential of the energy conservation measures identified, and (7) A comprehensive report detailing the ways to improve efficiency, the cost of specific improvements, benefits, and the time frame for recouping those investments.] to this subpart that applies to your boiler. An energy assessment completed on or after January 1, 2008 that meets or is amended to meet the energy assessment requirements in Table 2 to this subpart satisfies the energy assessment requirement. A facility that operates under an energy management program established through energy management systems compatible with ISO 50001, that includes the affected units, also satisfies the energy assessment requirement.

(c) You must comply with each operating limit specified in Table 3 [#6. Fuel analysis - Maintain the fuel type or fuel mixture (annual average) such that the mercury emission rate calculated according to §63.11211(c) are less than the applicable emission limit for mercury. #7. Performance stack testing - For boilers that demonstrate compliance with a performance stack test, maintain the operating load of each unit such that it does not exceed 110 percent of the average operating load recorded during the most recent performance stack test. #8. Oxygen analyzer system - For boilers subject to a CO emission limit that demonstrate compliance with an oxygen analyzer system as specified in §63.11224(a), maintain the 30-day rolling average oxygen level at or above the minimum oxygen level as defined in §63.11237. This requirement does not apply to units that install an oxygen trim system since these units will set the trim system to the level specified in §63.11224(a)(7).] to this subpart that applies to your boiler.

(d) These standards apply at all times the affected boiler is operating, except during periods of startup and shutdown as defined in §63.11237, during which time you must comply only with Table 2 to this subpart.

Fuel Restriction(s).

004 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The facility shall limit the amount of coal burned in this boiler to 1,408 tons per year based on a 12-month rolling average. During normal operation, the unit shall be fired with natural gas.

II. TESTING REQUIREMENTS.

005 [25 Pa. Code §127.441]

Operating permit terms and conditions.

(a) The permittee shall perform a stack test for SO_x in accordance with 25 PA Code Chapter 139 and US EPA Reference Method 8 or equivalent test procedure on Source 031 within 6 to 12 months of the effective date of the facility operating permit. The permittee shall perform the stack test at rated capacity and when burning only coal. The permittee shall report the results (as SO₂) of this test in units consistent with the emission limitation (lb/mmbtu) and the emission factor used for compliance (lb SO_x times %S per ton coal burned).

(b) The permittee shall perform a stack test for Filterable Particulate in accordance with 25 PA Code Chapter 139 and US EPA Reference Method 5 or equivalent. This test shall be performed within 6 to 12 months of the effective date of the facility operating permit. The permittee shall perform the stack test at rated capacity and when burning only coal. The permittee shall report the results of this test in units consistent with the emission limitation (lb/mmbtu).

**SECTION D. Source Level Requirements**

- (c) [25 Pa. Code § 139.53(a)(3)] At least 90 calendar days prior to commencing an emissions testing program, a test protocol shall be submitted to the Department for review and approval. The test protocol shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.
- (d) [25 Pa. Code § 139.53(a)(3)] At least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the appropriate Regional Office. Notification shall also be sent to the Division of Source Testing and Monitoring. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.
- (e) [25 Pa. Code § 139.53(a)(3)] Within 15 calendar days after completion of the on-site testing portion of an emission test program, if a complete test report has not yet been submitted, notification shall be sent to the Department's Division of Source Testing and Monitoring and the appropriate Regional Office indicating the completion date of the on-site testing.
- (f) [40 CFR Part 60.8(a), 40 CFR Part 61.13(f) and 40 CFR Part 63.7(g)] A complete test report shall be submitted to the Department no later than 60 calendar days after completion of the on-site testing portion of an emission test program. For those tests being conducted pursuant to 40 CFR Part 61, a complete test report shall be submitted within 31 days after completion of the test
- (g) [25 Pa. Code Section 139.53(b)] A complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or non-compliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:
- (a) A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.
 - (b) Permit number(s) and condition(s) which are the basis for the evaluation.
 - (c) Summary of results with respect to each applicable permit condition.
 - (d) Statement of compliance or non-compliance with each applicable permit condition.
- (h) [25 Pa. Code § 139.3] All submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.
- (i) All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.
- (j) [25 Pa. Code Section 139.53(a)(1) and 139.53(a)(3)] The Department requires one electronic copy of all source test submissions (protocols and reports) to be sent to both the appropriate Regional Office and the PSIMS Administrator in Central Office (mail and email addresses are provided below). Do not send submissions to anyone else, except the U.S. EPA, unless specifically directed to do so. To minimize the potential for rescheduling of the test, all protocols must be received at least 90 days prior to testing. Test reports must be received no later than 60 days after the completion of testing, unless a more stringent regulatory requirement applies. Any questions or concerns about source testing submissions can be sent to RA-EPstacktesting@pa.gov and the PSIMS Administrator will address them.

Electronic copies of Protocols and Reports shall be emailed to the following:

Central Office
RA-EPstacktesting@pa.gov

Northwest Region
RA-EPNWstacktesting@pa.gov

Notifications and Supplemental Information shall be submitted to the following:

OnBase Submittal
<http://www.dep.pa.gov/DataandTools/Pages/Application-Form-Upload.aspx>

**SECTION D. Source Level Requirements**

(k) The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

(l) Actions Related to Noncompliance Demonstrated by a Stack Test:

(a) If the results of a stack test, performed as required by this operating permit, exceed the level specified in any condition of this approval, the Permittee shall take appropriate corrective actions. Within 30 days of the Permittee receiving the stack test results, a written description of the corrective actions shall be submitted to the Department. The Permittee shall take appropriate action to minimize emissions from the affected facility while the corrective actions are being implemented. The Department shall notify the Permittee within 30 days, if the corrective actions taken are deficient. Within 30 days of receipt of the notice of deficiency, the Permittee shall submit a description of additional corrective actions to the Department. The Department reserves the authority to use enforcement activities to resolve noncompliant stack tests.

(b) If the results of the required stack test exceed any limit defined in this operating permit, the test was not performed in accordance with the stack test protocol or the source and/or air cleaning device was not operated in accordance with the operating permit, then another stack test shall be performed to determine compliance. Within 120 days of the Permittee receiving the original stack test results, a retest shall be performed. The Department may extend the retesting deadline if the Permittee demonstrates, to the Department's satisfaction, that retesting within 120 days is not practicable. Failure of the second test to demonstrate compliance with the limits in the operating permit, not performing the test in accordance with the stack test protocol or not operating the source and/or air cleaning device in accordance with the operating permit may be grounds for immediate revocation of the operating permit to operate the affected source.

006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11212]

SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources

What stack tests and procedures must I use for the performance tests?

(a) You must conduct all performance tests according to §63.7(c), (d), (f), and (h). You must also develop a site-specific test plan according to the requirements in §63.7(c).

(b) You must conduct each stack test according to the requirements in Table 4 [#2 & #3] to this subpart. Boilers that use a CEMS for carbon monoxide (CO) are exempt from the initial CO performance testing in Table 4 to this subpart and the oxygen concentration operating limit requirement specified in Table 3 to this subpart.

(c) You must conduct performance stack tests at the representative operating load conditions while burning the type of fuel or mixture of fuels that have the highest emissions potential for each regulated pollutant, and you must demonstrate initial compliance and establish your operating limits based on these performance stack tests. For subcategories with more than one emission limit, these requirements could result in the need to conduct more than one performance stack test. Following each performance stack test and until the next performance stack test, you must comply with the operating limit for operating load conditions specified in Table 3 to this subpart.

(d) You must conduct a minimum of three separate test runs for each performance stack test required in this section, as specified in §63.7(e)(3) and in accordance with the provisions in Table 4 to this subpart.

(e) To determine compliance with the emission limits, you must use the F-Factor methodology and equations in sections 12.2 and 12.3 of EPA Method 19 of appendix A-7 to part 60 of this chapter to convert the measured PM concentrations and the measured mercury concentrations that result from the performance test to pounds per million Btu heat input emission rates.

007 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11213]

SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources

What fuel analyses and procedures must I use for the performance tests?

(a) You must conduct fuel analyses according to the procedures in paragraphs (b) and (c) of this section and Table 5 [#1] to this subpart, as applicable. You are not required to conduct fuel analyses for fuels used for only startup, unit shutdown, and transient flame stability purposes. You are required to conduct fuel analyses only for fuels and units that are subject to emission limits for mercury in Table 1 of this subpart.

**SECTION D. Source Level Requirements**

(b) At a minimum, you must obtain three composite fuel samples for each fuel type according to the procedures in Table 5 to this subpart. Each composite sample must consist of a minimum of three samples collected at approximately equal intervals during a test run period.

(c) Determine the concentration of mercury in the fuel in units of pounds per million Btu of each composite sample for each fuel type according to the procedures in Table 5 to this subpart.

008 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11220]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****When must I conduct subsequent performance tests?**

(a) If your boiler has a heat input capacity of 10 million British thermal units per hour or greater, you must conduct all applicable performance (stack) tests according to §63.11212 on a triennial basis, except as specified in paragraphs (b) through (d) of this section. Triennial performance tests must be completed no more than 37 months after the previous performance test.

(b)-(c) Not applicable

(d) If you demonstrate compliance with the mercury emission limit based on fuel analysis, you must conduct a fuel analysis according to §63.11213 for each type of fuel burned as specified in paragraphs (c)(1) and (2) of this section. If you plan to burn a new type of fuel or fuel mixture, you must conduct a fuel analysis before burning the new type of fuel or mixture in your boiler. You must recalculate the mercury emission rate using Equation 1 of §63.11211. The recalculated mercury emission rate must be less than the applicable emission limit.

(1) When demonstrating initial compliance with the mercury emission limit, if the mercury constituents in the fuel or fuel mixture are measured to be equal to or less than half of the mercury emission limit, you do not need to conduct further fuel analysis sampling but must continue to comply with all applicable operating limits and monitoring requirements.

(2) When demonstrating initial compliance with the mercury emission limit, if the mercury constituents in the fuel or fuel mixture are greater than half of the mercury emission limit, you must conduct quarterly sampling.

(e) For existing affected boilers that have not operated since the previous compliance demonstration and more than 3 years have passed since the previous compliance demonstration, you must complete your subsequent compliance demonstration no later than 180 days after the re-start of the affected boiler.

III. MONITORING REQUIREMENTS.**# 009 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11221]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****How do I monitor and collect data to demonstrate continuous compliance?**

(a) You must monitor and collect data according to this section and the site-specific monitoring plan required by §63.11205(c).

(b) You must operate the monitoring system and collect data at all required intervals at all times the affected source is operating and compliance is required, except for periods of monitoring system malfunctions or out-of-control periods (see §63.8(c)(7) of this part), repairs associated with monitoring system malfunctions or out-of-control periods, and required monitoring system quality assurance or quality control activities including, as applicable, calibration checks, required zero and span adjustments, and scheduled CMS maintenance as defined in your site-specific monitoring plan. A monitoring system malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring system to provide valid data. Monitoring system failures that are caused in part by poor maintenance or careless operation are not malfunctions. You are required to complete monitoring system repairs in response to monitoring system malfunctions or out-of-control periods and to return the monitoring system to operation as expeditiously as practicable.

(c) You may not use data collected during monitoring system malfunctions or out-of-control periods, repairs associated with monitoring system malfunctions or out-of-control periods, or required monitoring system quality assurance or quality control

**SECTION D. Source Level Requirements**

activities in calculations used to report emissions or operating levels. Any such periods must be reported according to the requirements in §63.11225. You must use all the data collected during all other periods in assessing the operation of the control device and associated control system.

(d) Except for periods of monitoring system malfunctions or monitoring system out-of-control periods, repairs associated with monitoring system malfunctions or monitoring system out-of-control periods, and required monitoring system quality assurance or quality control activities (including, as applicable, calibration checks, required zero and span adjustments, and scheduled CMS maintenance as defined in your site-specific monitoring plan), failure to collect required data is a deviation of the monitoring requirements.

010 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11224]**SUBPART JJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What are my monitoring, installation, operation, and maintenance requirements?**

(a) If your boiler is subject to a CO emission limit in Table 1 to this subpart, you must either install, operate, and maintain a CEMS for CO and oxygen according to the procedures in paragraphs (a)(1) through (6) of this section, or install, calibrate, operate, and maintain an oxygen analyzer system, as defined in §63.11237, according to the manufacturer's recommendations and paragraphs (a)(7) and (d) of this section, as applicable, by the compliance date specified in §63.11196. Where a certified CO CEMS is used, the CO level shall be monitored at the outlet of the boiler, after any add-on controls or flue gas recirculation system and before release to the atmosphere. Boilers that use a CO CEMS are exempt from the initial CO performance testing and oxygen concentration operating limit requirements specified in §63.11211(a) of this subpart. Oxygen monitors and oxygen trim systems must be installed to monitor oxygen in the boiler flue gas, boiler firebox, or other appropriate intermediate location.

(1) Each CO CEMS must be installed, operated, and maintained according to the applicable procedures under Performance Specification 4, 4A, or 4B at 40 CFR part 60, appendix B, and each oxygen CEMS must be installed, operated, and maintained according to Performance Specification 3 at 40 CFR part 60, appendix B. Both the CO and oxygen CEMS must also be installed, operated, and maintained according to the site-specific monitoring plan developed according to paragraph (c) of this section.

(2) You must conduct a performance evaluation of each CEMS according to the requirements in §63.8(e) and according to Performance Specifications 3 and 4, 4A, or 4B at 40 CFR part 60, appendix B.

(3) Each CEMS must complete a minimum of one cycle of operation (sampling, analyzing, and data recording) every 15 minutes. You must have CEMS data values from a minimum of four successive cycles of operation representing each of the four 15-minute periods in an hour, or at least two 15-minute data values during an hour when CEMS calibration, quality assurance, or maintenance activities are being performed, to have a valid hour of data.

(4) The CEMS data must be reduced as specified in §63.8(g)(2).

(5) You must calculate hourly averages, corrected to 3 percent oxygen, from each hour of CO CEMS data in parts per million CO concentrations and determine the 10-day rolling average of all recorded readings, except as provided in §63.11221(c). Calculate a 10-day rolling average from all of the hourly averages collected for the 10-day operating period using Equation 2 of this section.

Where:

H_{pvi} = the hourly parameter value for hour i

n = the number of valid hourly parameter values collected over 10 boiler operating days

(6) For purposes of collecting CO data, you must operate the CO CEMS as specified in §63.11221(b). For purposes of calculating data averages, you must use all the data collected during all periods in assessing compliance, except that you must exclude certain data as specified in §63.11221(c). Periods when CO data are unavailable may constitute monitoring deviations as specified in §63.11221(d).

**SECTION D. Source Level Requirements**

(7) You must operate the oxygen analyzer system at or above the minimum oxygen level that is established as the operating limit according to Table 6 to this subpart when firing the fuel or fuel mixture utilized during the most recent CO performance stack test. Operation of oxygen trim systems to meet these requirements shall not be done in a manner which compromises furnace safety.

(b)-(f) Not applicable

IV. RECORDKEEPING REQUIREMENTS.**# 011 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252A]

(a) The permittee shall maintain the following:

1. Operating log of steam flow (lbs/hr)
2. Natural gas usage (cf/hr)
3. Coal consumption (lbs/hr)
4. Coal analysis

This condition replaces the following condition from plan approval 43-302-010: The permittee shall maintain the following:

1. Operating log of steam flow (lbs/hr)
2. Fuel oil and natural gas usage (gal/hr and cf/hr)
3. Coal consumption (lbs/hr)
4. Coal analysis]

V. REPORTING REQUIREMENTS.**# 012 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11225]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What are my notification, reporting, and recordkeeping requirements?**

(a) You must submit the notifications specified in paragraphs (a)(1) through (5) of this section to the administrator.

(1) You must submit all of the notifications in §§63.7(b); 63.8(e) and (f); and 63.9(b) through (e), (g), and (h) that apply to you by the dates specified in those sections except as specified in paragraphs (a)(2) and (4) of this section.

(2) An Initial Notification must be submitted no later than January 20, 2014 or within 120 days after the source becomes subject to the standard.

(3) If you are required to conduct a performance stack test you must submit a Notification of Intent to conduct a performance test at least 60 days before the performance stack test is scheduled to begin.

(4) You must submit the Notification of Compliance Status no later than 120 days after the applicable compliance date specified in §63.11196 unless you must conduct a performance stack test. If you must conduct a performance stack test, you must submit the Notification of Compliance Status within 60 days of completing the performance stack test. You must submit the Notification of Compliance Status in accordance with paragraphs (a)(4)(i) and (vi) of this section. The Notification of Compliance Status must include the information and certification(s) of compliance in paragraphs (a)(4)(i) through (v) of this section, as applicable, and signed by a responsible official.

(i) You must submit the information required in §63.9(h)(2), except the information listed in §63.9(h)(2)(i)(B), (D), (E), and (F). If you conduct any performance tests or CMS performance evaluations, you must submit that data as specified in paragraph (e) of this section. If you conduct any opacity or visible emission observations, or other monitoring procedures or methods, you must submit that data to the Administrator at the appropriate address listed in §63.13.

(ii) "This facility complies with the requirements in §63.11214 to conduct an initial tune-up of the boiler."

**SECTION D. Source Level Requirements**

(iii) "This facility has had an energy assessment performed according to §63.11214(c)."

(iv) Not applicable

(v) For units that do not qualify for a statutory exemption as provided in section 129(g)(1) of the Clean Air Act: "No secondary materials that are solid waste were combusted in any affected unit."

(vi) The notification must be submitted electronically using the Compliance and Emissions Data Reporting Interface (CEDRI) that is accessed through EPA's Central Data Exchange (CDX) (www.epa.gov/cdx). However, if the reporting form specific to this subpart is not available in CEDRI at the time that the report is due, the written Notification of Compliance Status must be submitted to the Administrator at the appropriate address listed in §63.13.

(5) If you are using data from a previously conducted emission test to serve as documentation of conformance with the emission standards and operating limits of this subpart, you must include in the Notification of Compliance Status the date of the test and a summary of the results, not a complete test report, relative to this subpart.

(b) You must prepare, by March 1 of each year, and submit to the delegated authority upon request, an annual compliance certification report for the previous calendar year containing the information specified in paragraphs (b)(1) through (4) of this section. You must submit the report by March 15 if you had any instance described by paragraph (b)(3) of this section. For boilers that are subject only to a requirement to conduct a biennial or 5-year tune-up according to §63.11223(a) and not subject to emission limits or operating limits, you may prepare only a biennial or 5-year compliance report as specified in paragraphs (b)(1) and (2) of this section.

(1) Company name and address.

(2) Statement by a responsible official, with the official's name, title, phone number, email address, and signature, certifying the truth, accuracy and completeness of the notification and a statement of whether the source has complied with all the relevant standards and other requirements of this subpart. Your notification must include the following certification(s) of compliance, as applicable, and signed by a responsible official:

(i) "This facility complies with the requirements in §63.11223 to conduct a biennial or 5-year tune-up, as applicable, of each boiler."

(ii) For units that do not qualify for a statutory exemption as provided in section 129(g)(1) of the Clean Air Act: "No secondary materials that are solid waste were combusted in any affected unit."

(iii) "This facility complies with the requirement in §§63.11214(d) and 63.11223(g) to minimize the boiler's time spent during startup and shutdown and to conduct startups and shutdowns according to the manufacturer's recommended procedures or procedures specified for a boiler of similar design if manufacturer's recommended procedures are not available."

(3) If the source experiences any deviations from the applicable requirements during the reporting period, include a description of deviations, the time periods during which the deviations occurred, and the corrective actions taken.

(4) The total fuel use by each affected boiler subject to an emission limit, for each calendar month within the reporting period, including, but not limited to, a description of the fuel, whether the fuel has received a non-waste determination by you or EPA through a petition process to be a non-waste under §241.3(c), whether the fuel(s) were processed from discarded non-hazardous secondary materials within the meaning of §241.3, and the total fuel usage amount with units of measure.

(c) You must maintain the records specified in paragraphs (c)(1) through (7) of this section.

(1) As required in §63.10(b)(2)(xiv), you must keep a copy of each notification and report that you submitted to comply with this subpart and all documentation supporting any Initial Notification or Notification of Compliance Status that you submitted.

(2) You must keep records to document conformance with the work practices, emission reduction measures, and management practices required by §63.11214 and §63.11223 as specified in paragraphs (c)(2)(i) through (vi) of this

**SECTION D. Source Level Requirements**

section.

(i) Records must identify each boiler, the date of tune-up, the procedures followed for tune-up, and the manufacturer's specifications to which the boiler was tuned.

(ii) Not applicable

(iii) For each boiler required to conduct an energy assessment, you must keep a copy of the energy assessment report.

(iv) For each boiler subject to an emission limit in Table 1 to this subpart, you must also keep records of monthly fuel use by each boiler, including the type(s) of fuel and amount(s) used.

(v)-(vi) Not applicable

(3) For sources that demonstrate compliance through fuel analysis, a copy of all calculations and supporting documentation that were done to demonstrate compliance with the mercury emission limits. Supporting documentation should include results of any fuel analyses. You can use the results from one fuel analysis for multiple boilers provided they are all burning the same fuel type.

(4) Records of the occurrence and duration of each malfunction of the boiler, or of the associated air pollution control and monitoring equipment.

(5) Records of actions taken during periods of malfunction to minimize emissions in accordance with the general duty to minimize emissions in §63.11205(a), including corrective actions to restore the malfunctioning boiler, air pollution control, or monitoring equipment to its normal or usual manner of operation.

(6) You must keep the records of all inspection and monitoring data required by §§63.11221 and 63.11222, and the information identified in paragraphs (c)(6)(i) through (vi) of this section for each required inspection or monitoring.

(i) The date, place, and time of the monitoring event.

(ii) Person conducting the monitoring.

(iii) Technique or method used.

(iv) Operating conditions during the activity.

(v) Results, including the date, time, and duration of the period from the time the monitoring indicated a problem to the time that monitoring indicated proper operation.

(vi) Maintenance or corrective action taken (if applicable).

(7) Not applicable

(d) Your records must be in a form suitable and readily available for expeditious review. You must keep each record for 5 years following the date of each recorded action. You must keep each record on-site or be accessible from a central location by computer or other means that instantly provide access at the site for at least 2 years after the date of each recorded action. You may keep the records off site for the remaining 3 years.

(e)(1) Within 60 days after the date of completing each performance test (defined in §63.2) as required by this subpart you must submit the results of the performance tests, including any associated fuel analyses, required by this subpart to EPA's WebFIRE database by using CEDRI that is accessed through EPA's CDX (www.epa.gov/cdx). Performance test data must be submitted in the file format generated through use of EPA's Electronic Reporting Tool (ERT) (see <http://www.epa.gov/ttn/chief/ert/index.html>). Only data collected using test methods on the ERT Web site are subject to this requirement for submitting reports electronically to WebFIRE. Owners or operators who claim that some of the information being submitted for performance tests is confidential business information (CBI) must submit a complete ERT file including

**SECTION D. Source Level Requirements**

information claimed to be CBI on a compact disk or other commonly used electronic storage media (including, but not limited to, flash drives) to EPA. The electronic media must be clearly marked as CBI and mailed to U.S. EPA/OAPQS/CORE CBI Office, Attention: WebFIRE Administrator, MD C404-02, 4930 Old Page Rd., Durham, NC 27703. The same ERT file with the CBI omitted must be submitted to EPA via CDX as described earlier in this paragraph. At the discretion of the delegated authority, you must also submit these reports, including CBI, to the delegated authority in the format specified by the delegated authority. For any performance test conducted using test methods that are not listed on the ERT Web site, the owner or operator shall submit the results of the performance test in paper submissions to the Administrator at the appropriate address listed in §63.13.

(2) Within 60 days after the date of completing each CEMS performance evaluation test as defined in §63.2, you must submit relative accuracy test audit (RATA) data to EPA's CDX by using CEDRI in accordance with paragraph (e)(1) of this section. Only RATA pollutants that can be documented with the ERT (as listed on the ERT Web site) are subject to this requirement. For any performance evaluations with no corresponding RATA pollutants listed on the ERT Web site, the owner or operator shall submit the results of the performance evaluation in paper submissions to the Administrator at the appropriate address listed in §63.13.

(f) Not applicable

(g) If you have switched fuels or made a physical change to the boiler and the fuel switch or change resulted in the applicability of a different subcategory within subpart JJJJJJ, in the boiler becoming subject to subpart JJJJJJ, or in the boiler switching out of subpart JJJJJJ due to a change to 100 percent natural gas, or you have taken a permit limit that resulted in you being subject to subpart JJJJJJ, you must provide notice of the date upon which you switched fuels, made the physical change, or took a permit limit within 30 days of the change. The notification must identify:

(1) The name of the owner or operator of the affected source, the location of the source, the boiler(s) that have switched fuels, were physically changed, or took a permit limit, and the date of the notice.

(2) The date upon which the fuel switch, physical change, or permit limit occurred.

VI. WORK PRACTICE REQUIREMENTS.

013 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The source shall be maintained and operated in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

014 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11205]

SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources**What are my general requirements for complying with this subpart?**

(a) At all times you must operate and maintain any affected source, including associated air pollution control equipment and monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator that may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

(b) You must demonstrate compliance with all applicable emission limits using performance stack testing, fuel analysis, or a continuous monitoring system (CMS), including a continuous emission monitoring system (CEMS), a continuous opacity monitoring system (COMS), or a continuous parameter monitoring system (CPMS), where applicable. You may demonstrate compliance with the applicable mercury emission limit using fuel analysis if the emission rate calculated according to §63.11211(c) is less than the applicable emission limit. Otherwise, you must demonstrate compliance using stack testing.

(c) If you demonstrate compliance with any applicable emission limit through performance stack testing and subsequent compliance with operating limits (including the use of CPMS), with a CEMS, or with a COMS, you must develop a sitespecific

**SECTION D. Source Level Requirements**

monitoring plan according to the requirements in paragraphs (c)(1) through (3) of this section for the use of any CEMS, COMS, or CPMS. This requirement also applies to you if you petition the EPA Administrator for alternative monitoring parameters under §63.8(f).

(1) For each CMS required in this section (including CEMS, COMS, or CPMS), you must develop, and submit to the Administrator for approval upon request, a site-specific monitoring plan that addresses paragraphs (c)(1)(i) through (vi) of this section. You must submit this site-specific monitoring plan, if requested, at least 60 days before your initial performance evaluation of your CMS. This requirement to develop and submit a site-specific monitoring plan does not apply to affected sources with existing CEMS or COMS operated according to the performance specifications under appendix B to part 60 of this chapter and that meet the requirements of §63.11224.

(i) Installation of the CMS sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of control of the exhaust emissions (e.g., on or downstream of the last control device);

(ii) Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems; and

(iii) Performance evaluation procedures and acceptance criteria (e.g., calibrations).

(iv) Ongoing operation and maintenance procedures in accordance with the general requirements of §63.8(c)(1)(ii), (c)(3), and (c)(4)(ii);

(v) Ongoing data quality assurance procedures in accordance with the general requirements of §63.8(d); and

(vi) Ongoing recordkeeping and reporting procedures in accordance with the general requirements of §63.10(c) (as applicable in Table 8 to this subpart), (e)(1), and (e)(2)(i).

(2) You must conduct a performance evaluation of each CMS in accordance with your site-specific monitoring plan.

(3) You must operate and maintain the CMS in continuous operation according to the site-specific monitoring plan.

015 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11210]

SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources

What are my initial compliance requirements and by what date must I conduct them?

(a) You must demonstrate initial compliance with each emission limit specified in Table 1 to this subpart that applies to you by either conducting performance (stack) tests, as applicable, according to §63.11212 and Table 4 to this subpart or, for mercury, conducting fuel analyses, as applicable, according to §63.11213 and Table 5 to this subpart.

(b) For existing affected boilers that have applicable emission limits, you must demonstrate initial compliance with the applicable emission limits no later than 180 days after the compliance date that is specified in §63.11196 and according to the applicable provisions in §63.7(a)(2), except as provided in paragraph (j) of this section.

(c) For existing affected boilers that have applicable work practice standards, management practices, or emission reduction measures, you must demonstrate initial compliance no later than the compliance date that is specified in §63.11196 and according to the applicable provisions in §63.7(a)(2), except as provided in paragraph (j) of this section.

(d)-(h) Not applicable

(i) For affected boilers that switch fuels or make a physical change to the boiler that results in the applicability of a different subcategory within subpart JJJJJJ or the boiler becoming subject to subpart JJJJJJ, you must demonstrate compliance within 180 days of the effective date of the fuel switch or the physical change. Notification of such changes must be submitted according to §63.11225(g).

(j)-(k) Not applicable

**SECTION D. Source Level Requirements****# 016 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11211]****SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****How do I demonstrate initial compliance with the emission limits?**

(a) For affected boilers that demonstrate compliance with any of the emission limits of this subpart through performance (stack) testing, your initial compliance requirements include conducting performance tests according to §63.11212 and Table 4 to this subpart, conducting a fuel analysis for each type of fuel burned in your boiler according to §63.11213 and Table 5 to this subpart, establishing operating limits according to §63.11222, Table 6 to this subpart and paragraph (b) of this section, as applicable, and conducting CMS performance evaluations according to §63.11224. For affected boilers that burn a single type of fuel, you are exempted from the compliance requirements of conducting a fuel analysis for each type of fuel burned in your boiler. For purposes of this subpart, boilers that use a supplemental fuel only for startup, unit shutdown, and transient flame stability purposes still qualify as affected boilers that burn a single type of fuel, and the supplemental fuel is not subject to the fuel analysis requirements under §63.11213 and Table 5 to this subpart.

(b) Not applicable

(c) If you elect to demonstrate compliance with an applicable mercury emission limit through fuel analysis, you must conduct fuel analyses according to §63.11213 and Table 5 to this subpart and follow the procedures in paragraphs (c)(1) through (3) of this section.

(1) If you burn more than one fuel type, you must determine the fuel type, or mixture, you could burn in your boiler that would result in the maximum emission rates of mercury.

(2) You must determine the 90th percentile confidence level fuel mercury concentration of the composite samples analyzed for each fuel type using Equation 1 of this section.

Where:

P90 = 90th percentile confidence level mercury concentration, in pounds per million Btu.

mean = Arithmetic average of the fuel mercury concentration in the fuel samples analyzed according to §63.11213, in units of pounds per million Btu.

SD = Standard deviation of the mercury concentration in the fuel samples analyzed according to §63.11213, in units of pounds per million Btu.

t = t distribution critical value for 90th percentile (0.1) probability for the appropriate degrees of freedom (number of samples minus one) as obtained from a Distribution Critical Value Table.

(3) To demonstrate compliance with the applicable mercury emission limit, the emission rate that you calculate for your boiler using Equation 1 of this section must be less than the applicable mercury emission limit.

017 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11214]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****How do I demonstrate initial compliance with the work practice standard, emission reduction measures, and management practice?**

(a)-(b) Not applicable

(c) If you own or operate an existing affected boiler with a heat input capacity of 10 million Btu per hour or greater, you must submit a signed certification in the Notification of Compliance Status report that an energy assessment of the boiler and its energy use systems was completed according to Table 2 to this subpart and is an accurate depiction of your facility.

(d) If you own or operate a boiler subject to emission limits in Table 1 of this subpart, you must minimize the boiler's startup and shutdown periods following the manufacturer's recommended procedures, if available. If manufacturer's recommended

**SECTION D. Source Level Requirements**

procedures are not available, you must follow recommended procedures for a unit of similar design for which manufacturer's recommended procedures are available. You must submit a signed statement in the Notification of Compliance Status report that indicates that you conducted startups and shutdowns according to the manufacturer's recommended procedures or procedures specified for a boiler of similar design if manufacturer's recommended procedures are not available.

018 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11222]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****How do I demonstrate continuous compliance with the emission limits?**

(a) You must demonstrate continuous compliance with each emission limit and operating limit in Tables 1 and 3 to this subpart that applies to you according to the methods specified in Table 7 [#6. Fuel Pollutant Content - a. Only burning the fuel types and fuel mixtures used to demonstrate compliance with the applicable emission limit according to §63.11213 as applicable; and b. Keeping monthly records of fuel use according to §§63.11222(a)(2) and 63.11225(b)(4). #7. Oxygen content - a. Continuously monitoring the oxygen content of flue gas according to §63.11224 (This requirement does not apply to units that install an oxygen trim system since these units will set the trim system to the level specified in §63.11224(a)(7)); and b. Reducing the data to 30-day rolling averages; and c. Maintaining the 30-day rolling average oxygen content at or above the minimum oxygen level established during the most recent CO performance test. #8. CO emissions - a. Continuously monitoring the CO concentration in the combustion exhaust according to §§63.11224 and 63.11221; and b. Correcting the data to 3 percent oxygen, and reducing the data to 1-hour averages; and c. Reducing the data from the hourly averages to 10-day rolling averages; and d. Maintaining the 10-day rolling average CO concentration at or below the applicable emission limit in Table 1 to this subpart. #9. Boiler operating load - a. Collecting operating load data (fuel feed rate or steam generation data) every 15 minutes; and b. Reducing the data to 30-day rolling averages; and c. Maintaining the 30-day rolling average at or below the operating limit established during the performance test according to §63.11212(c) and Table 6 to this subpart.] to this subpart and to paragraphs (a)(1) through (4) of this section.

(1) Following the date on which the initial compliance demonstration is completed or is required to be completed under §§63.7 and 63.11196, whichever date comes first, you must continuously monitor the operating parameters. Operation above the established maximum, below the established minimum, or outside the allowable range of the operating limits specified in paragraph (a) of this section constitutes a deviation from your operating limits established under this subpart, except during performance tests conducted to determine compliance with the emission and operating limits or to establish new operating limits. Operating limits are confirmed or reestablished during performance tests.

(2) If you have an applicable mercury or PM emission limit, you must keep records of the type and amount of all fuels burned in each boiler during the reporting period to demonstrate that all fuel types and mixtures of fuels burned would result in lower emissions of mercury than the applicable emission limit (if you demonstrate compliance through fuel analysis), or result in lower fuel input of mercury than the maximum values calculated during the last performance stack test (if you demonstrate compliance through performance stack testing).

(3) If you have an applicable mercury emission limit and you plan to burn a new type of fuel, you must determine the mercury concentration for any new fuel type in units of pounds per million Btu, using the procedures in Equation 1 of §63.11211 based on supplier data or your own fuel analysis, and meet the requirements in paragraphs (a)(3)(i) or (ii) of this section.

(i) The recalculated mercury emission rate must be less than the applicable emission limit.

(ii) If the mercury concentration is higher than mercury fuel input during the previous performance test, then you must conduct a new performance test within 60 days of burning the new fuel type or fuel mixture according to the procedures in §63.11212 to demonstrate that the mercury emissions do not exceed the emission limit.

(4) Not applicable

(b) You must report each instance in which you did not meet each emission limit and operating limit in Tables 1 and 3 to this subpart that apply to you. These instances are deviations from the emission limits in this subpart. These deviations must be reported according to the requirements in §63.11225.

**SECTION D. Source Level Requirements****# 019 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11223]****SUBPART JJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****How do I demonstrate continuous compliance with the work practice and management practice standards?**

(a) For affected sources subject to the work practice standard or the management practices of a tune-up, you must conduct a performance tune-up according to paragraph (b) of this section and keep records as required in §63.11225(c) to demonstrate continuous compliance. You must conduct the tune-up while burning the type of fuel (or fuels in the case of boilers that routinely burn two types of fuels at the same time) that provided the majority of the heat input to the boiler over the 12 months prior to the tune-up.

(b) Except as specified in paragraphs (c) through (f) of this section, you must conduct a tune-up of the boiler biennially to demonstrate continuous compliance as specified in paragraphs (b)(1) through (7) of this section. Each biennial tune-up must be conducted no more than 25 months after the previous tune-up. For a new or reconstructed boiler, the first biennial tune-up must be no later than 25 months after the initial startup of the new or reconstructed boiler.

(1) As applicable, inspect the burner, and clean or replace any components of the burner as necessary (you may delay the burner inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the burner inspection until the first outage, not to exceed 36 months from the previous inspection.

(2) Inspect the flame pattern, as applicable, and adjust the burner as necessary to optimize the flame pattern. The adjustment should be consistent with the manufacturer's specifications, if available.

(3) Inspect the system controlling the air-to-fuel ratio, as applicable, and ensure that it is correctly calibrated and functioning properly (you may delay the inspection until the next scheduled unit shutdown, not to exceed 36 months from the previous inspection). Units that produce electricity for sale may delay the inspection until the first outage, not to exceed 36 months from the previous inspection.

(4) Optimize total emissions of CO. This optimization should be consistent with the manufacturer's specifications, if available, and with any nitrogen oxide requirement to which the unit is subject.

(5) Measure the concentrations in the effluent stream of CO in parts per million, by volume, and oxygen in volume percent, before and after the adjustments are made (measurements may be either on a dry or wet basis, as long as it is the same basis before and after the adjustments are made). Measurements may be taken using a portable CO analyzer.

(6) Maintain on-site and submit, if requested by the Administrator, a report containing the information in paragraphs (b)(6)(i) through (iii) of this section.

(i) The concentrations of CO in the effluent stream in parts per million, by volume, and oxygen in volume percent, measured at high fire or typical operating load, before and after the tune-up of the boiler.

(ii) A description of any corrective actions taken as a part of the tune-up of the boiler.

(iii) The type and amount of fuel used over the 12 months prior to the tune-up of the boiler, but only if the unit was physically and legally capable of using more than one type of fuel during that period. Units sharing a fuel meter may estimate the fuel use by each unit.

(7) If the unit is not operating on the required date for a tune-up, the tune-up must be conducted within 30 days of startup.

(c) Boilers with an oxygen trim system that maintains an optimum air-to-fuel ratio that would otherwise be subject to a biennial tune-up must conduct a tune-up of the boiler every 5 years as specified in paragraphs (b)(1) through (7) of this section. Each 5-year tune-up must be conducted no more than 61 months after the previous tune-up. For a new or reconstructed boiler with an oxygen trim system, the first 5-year tune-up must be no later than 61 months after the initial startup. You may delay the burner inspection specified in paragraph (b)(1) of this section and inspection of the system controlling the air-to-fuel ratio specified in paragraph (b)(3) of this section until the next scheduled unit shutdown, but you

**SECTION D. Source Level Requirements**

must inspect each burner and system controlling the air-to-fuel ratio at least once every 72 months.

(d)-(f) Not applicable

(g) If you own or operate a boiler subject to emission limits in Table 1 of this subpart, you must minimize the boiler's startup and shutdown periods following the manufacturer's recommended procedures, if available. If manufacturer's recommended procedures are not available, you must follow recommended procedures for a unit of similar design for which manufacturer's recommended procedures are available. You must submit a signed statement in the Notification of Compliance Status report that indicates that you conducted startups and shutdowns according to the manufacturer's recommended procedures or procedures specified for a boiler of similar design if manufacturer's recommended procedures are not available.

VII. ADDITIONAL REQUIREMENTS.**# 020 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252A]

(a) For purposes of 40 CFR 63 Subpart JJJJJJ, this boiler is considered an existing coal subcategory boiler and is subject to this subpart.

[Plan Approval 43-252A]

(b) Any information required to be submitted as part of this plan approval should be submitted to the attention of Regional Air Program Manager, PADEP, Northwest Regional Office, 230 Chestnut Street, Meadville, PA 16335.

[Plan Approval 43-252A]

(c) Issuance of an Operating Permit is contingent upon satisfactory compliance with the plan approval conditions, upon the source being installed and operated as stated within the application, and upon satisfactory demonstration that the emissions from the source will not be in violation of applicable Rules and Regulations of the Department.

021 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11193]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Am I subject to this subpart?**

You are subject to this subpart if you own or operate an industrial, commercial, or institutional boiler as defined in §63.11237 that is located at, or is part of, an area source of hazardous air pollutants (HAP), as defined in §63.2, except as specified in §63.11195.

022 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11194]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What is the affected source of this subpart?**

(a) This subpart applies to each new, reconstructed, or existing affected source as defined in paragraphs (a)(1) and (2) of this section.

(1) The affected source of this subpart is the collection of all existing industrial, commercial, and institutional boilers within a subcategory, as listed in §63.11200 and defined in §63.11237, located at an area source.

(2) The affected source of this subpart is each new or reconstructed industrial, commercial, or institutional boiler within a subcategory, as listed in §63.11200 and as defined in §63.11237, located at an area source.

(b) An affected source is an existing source if you commenced construction or reconstruction of the affected source on or before June 4, 2010.

(c) An affected source is a new source if you commenced construction of the affected source after June 4, 2010, and the boiler meets the applicability criteria at the time you commence construction.

**SECTION D. Source Level Requirements**

(d) An affected source is a reconstructed source if the boiler meets the reconstruction criteria as defined in §63.2, you commenced reconstruction after June 4, 2010, and the boiler meets the applicability criteria at the time you commence reconstruction.

(e) An existing dual-fuel fired boiler meeting the definition of gas-fired boiler, as defined in §63.11237, that meets the applicability requirements of this subpart after June 4, 2010 due to a fuel switch from gaseous fuel to solid fossil fuel, biomass, or liquid fuel is considered to be an existing source under this subpart as long as the boiler was designed to accommodate the alternate fuel.

(f) If you are an owner or operator of an area source subject to this subpart, you are exempt from the obligation to obtain a permit under 40 CFR part 70 or part 71 as a result of this subpart. You may, however, be required to obtain a title V permit due to another reason or reasons. See 40 CFR 70.3(a) and (b) or 71.3(a) and (b). Notwithstanding the exemption from title V permitting for area sources under this subpart, you must continue to comply with the provisions of this subpart.

023 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11196]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What are my compliance dates?**

(a) If you own or operate an existing affected boiler, you must achieve compliance with the applicable provisions in this subpart as specified in paragraphs (a)(1) through (3) of this section.

(1) If the existing affected boiler is subject to a work practice or management practice standard of a tune-up, you must achieve compliance with the work practice or management practice standard no later than March 21, 2014.

(2) If the existing affected boiler is subject to emission limits, you must achieve compliance with the emission limits no later than March 21, 2014.

(3) If the existing affected boiler is subject to the energy assessment requirement, you must achieve compliance with the energy assessment requirement no later than March 21, 2014.

(b)-(d) Not applicable

024 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11200]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What are the subcategories of boilers?**

The subcategories of boilers, as defined in §63.11237 are:

(a) Coal.

(b)-(g) Not applicable

025 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11235]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****What parts of the General Provisions apply to me?**

Table 8 to this subpart shows which parts of the General Provisions in §§63.1 through 63.15 apply to you.

026 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11236]**SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources****Who implements and enforces this subpart?**

(a) This subpart can be implemented and enforced by EPA or an administrator such as your state, local, or tribal agency. If the EPA Administrator has delegated authority to your state, local, or tribal agency, then that agency has the authority to implement and enforce this subpart. You should contact your EPA Regional Office to find out if implementation and enforcement of this subpart is delegated to your state, local, or tribal agency.

**SECTION D. Source Level Requirements**

(b) In delegating implementation and enforcement authority of this subpart to a state, local, or tribal agency under 40 CFR part 63, subpart E, the authorities contained in paragraphs (c) of this section are retained by the EPA Administrator and are not transferred to the state, local, or tribal agency.

(c) The authorities that cannot be delegated to state, local, or tribal agencies are specified in paragraphs (c)(1) through (5) of this section.

(1) Approval of an alternative non-opacity emission standard and work practice standards in §63.11223(a).

(2) Approval of alternative opacity emission standard under §63.6(h)(9).

(3) Approval of major change to test methods under §63.7(e)(2)(ii) and (f). A "major change to test method" is defined in §63.90.

(4) Approval of a major change to monitoring under §63.8(f). A "major change to monitoring" is defined in §63.90.

(5) Approval of major change to recordkeeping and reporting under §63.10(f). A "major change to recordkeeping/reporting" is defined in §63.90.

027 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.11237]

SUBPART JJJJJJ - National Emission Standards for Hazardous Air Pollutants for Industrial, Commercial, and Institutional Boilers Area Sources

What definitions apply to this subpart?

See 40 CFR 63.11237 for "What definitions apply to this subpart?"

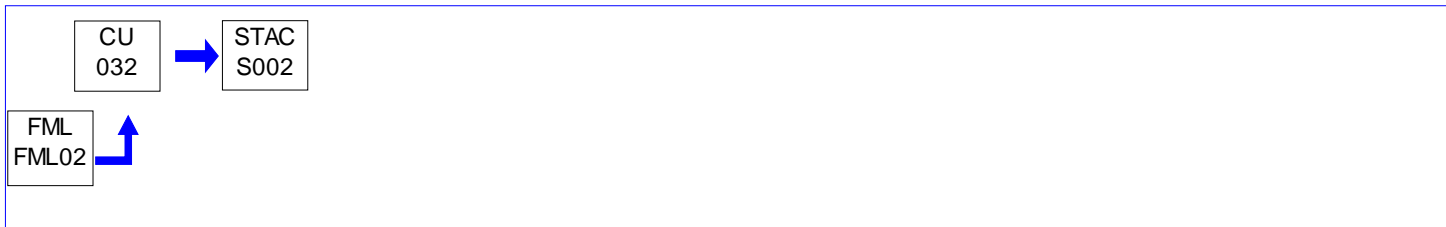
**SECTION D. Source Level Requirements**

Source ID: 032

Source Name: BOILER 032

Source Capacity/Throughput: 20.900 MMBTU/HR

20.900 MCF/HR Natural Gas

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas shall conform with the following:

(1) General provision. No person may permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

(2)-(4) Not applicable.

(b) - (h) Not applicable

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in: 25 PA Code 123.22(a)(1) SIP Approved SO₂ Limits 40 CFR 52.2020(c)(1)]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.**# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252B]

(a) The permittee shall maintain the following:

1. Operating log of steam flow (lbs/hr)

**SECTION D. Source Level Requirements**

2. Natural gas usage (cf/hr)

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.**# 004 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252A]

The permittee shall conduct a tuneup of the boiler within 2 years of plan approval issuance and biennially thereafter. This tuneup shall include, at a minimum, the following:

1. Inspection, adjustment, cleaning or replacement of fuel-burning equipment, including the burners and moving parts necessary for proper operation as specified by the manufacturer.
2. Inspection of the flame pattern or characteristics and adjustments necessary to minimize total emissions of NO_x, and to the extent practicable minimize emissions of CO.
3. Inspection of the air-to-fuel ratio control system and adjustments necessary to ensure proper calibration and operation as specified by the manufacturer.
4. The owner and operator of the adjusted equipment shall record each adjustment conducted under the procedures above in a permanently bound log book or other method approved by the Department. This log shall contain, at a minimum, the following information:
 - (i) The date of the tuning procedure.
 - (ii) The name of the service company and technicians.
 - (iii) The final operating rate or load.
 - (iv) The final CO and NO_x emission rates.
 - (v) The final excess oxygen rate.
 - (vi) Other information required by the applicable operating permit.
5. The owner and operator shall make the annual adjustment in accordance with the EPA document "Combustion Efficiency Optimization Manual for Operators of Oil and Gas-fired Boilers," September 1983 (EPA-340/1-83-023) or equivalent procedures approved in writing by the Department.

005 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The source shall be maintained and operated in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

**SECTION D. Source Level Requirements****VII. ADDITIONAL REQUIREMENTS.**

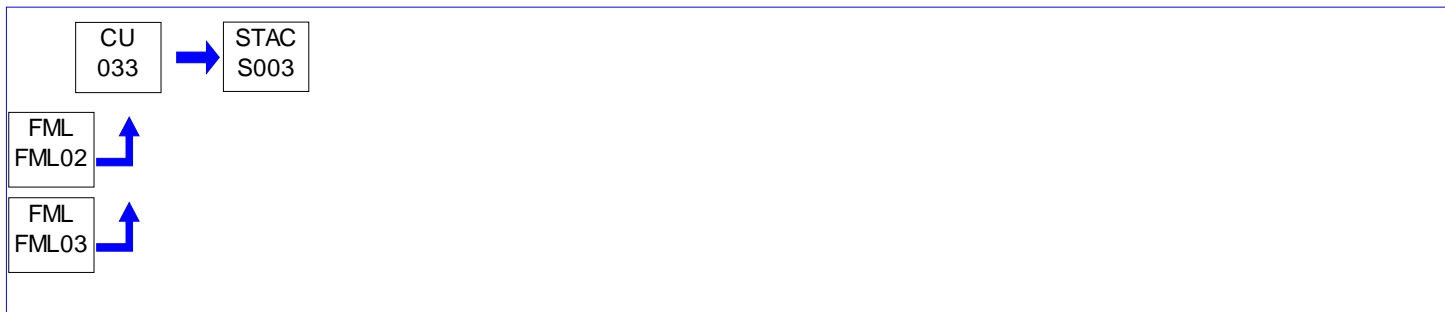
No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**

Source ID: 033

Source Name: BOILER 033

Source Capacity/Throughput: 20.900 MMBTU/HR
 20.900 MCF/HR Natural Gas
 149.300 Gal/HR #2 Oil

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(1) General provision. A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period, except as provided in paragraph (4).

(2) Commercial fuel oil.

(i) Except as specified in subparagraphs (ii) and (iii), a person may not offer for sale, deliver for use, exchange in trade or permit the use of commercial fuel oil in nonair basin areas if the commercial fuel oil contains sulfur in excess of the applicable maximum allowable sulfur content set forth in the following table:

Maximum Allowable Sulfur Content Expressed as Parts per Million (ppm) by Weight or Percentage by Weight

| Grades Commercial Fuel Oil (Consistent with ASTM D396) | Through August 31, 2020 | Beginning September 1, 2020 |
|---|-------------------------|-----------------------------|
| No. 2 and lighter oil | 500 ppm (0.05%) | 15 ppm (0.0015%) |
| No. 4 oil | 2,500 ppm (0.25%) | 2,500 ppm (0.25%) |
| No. 5, No. 6 and heavier oil | 5,000 ppm (0.5%) | 5,000 ppm (0.5%) |

(ii) Commercial fuel oil that was stored in this Commonwealth by the ultimate consumer prior to September 1, 2020, which met the applicable maximum allowable sulfur content for commercial fuel oil through August 31, 2020, in subparagraph (i) at the time it was stored, may be used by the ultimate consumer in this Commonwealth on and after September 1, 2020.

(iii) The Department may temporarily suspend or increase the applicable maximum allowable sulfur content for a commercial fuel oil set forth in subparagraph (i) if the following occur:

**SECTION D. Source Level Requirements**

(A) The Department receives a written request at the address specified in subsection (h) for a suspension or increase on the basis that compliant commercial fuel oil is not reasonably available in a nonair basin area. The request must include the following:

(I) The nonair basin county or counties for which the suspension or increase is requested.

(II) The reason compliant commercial fuel oil is not reasonably available.

(III) The duration of time for which the suspension or increase is requested and the justification for the requested duration.

(B) The Department determines that an insufficient quantity of compliant commercial fuel oil is reasonably available in the nonair basin area and that the circumstances leading to the insufficiency are due to events that could not have been reasonably foreseen or prevented and are not due to lack of prudent planning on the part of the transferor of the commercial fuel oil into or within the specified nonair basin area.

(C) The Department approves the request, in writing, prior to the transferor distributing the noncompliant commercial fuel oil into or within the specified nonair basin area.

(iv) The Department will limit a suspension or increase in the applicable maximum allowable sulfur content granted under subparagraph (iii) to the shortest duration in which adequate supplies of compliant commercial fuel oil can be made reasonably available, but in no case longer than 60 days from the date the Department grants the suspension or increase.

(3)-(4) Not applicable

(b) - (g) Not applicable

(h) Written request. The written request for suspension of or increase in the sulfur content limit on the basis that compliant commercial fuel oil is not reasonably available shall be addressed to the Department of Environmental Protection, Bureau of Air Quality, Chief of the Division of Compliance and Enforcement, P. O. Box 8468, Harrisburg, Pennsylvania 17105-8468.

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in: 25 PA Code 123.22(a)(1) SIP Approved SO₂ Limits 40 CFR 52.2020(c)(1)]

Fuel Restriction(s).

003 [25 Pa. Code §127.12b]

Plan approval terms and conditions.

[Plan Approval 43-252A]

The source shall burn gaseous fuels not combined with any solid fuels and burn liquid fuel only during periods of gas curtailment, gas supply interruption, startups, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year.

Throughput Restriction(s).

004 [25 Pa. Code §127.12b]

Plan approval terms and conditions.

[Plan Approval 43-252B]

Boilers 033 & 034 combined shall not exceed #2 Fuel Oil usage of 210,000 gallons per year based on a consecutive 12-month period.

**SECTION D. Source Level Requirements****II. TESTING REQUIREMENTS.****# 005 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252B]

The permittee shall perform a stack test for SO_x in accordance with 25 PA Code Chapter 139 and US EPA Reference Method 8 or equivalent test procedure with the source at rated capacity and burning only #2 Fuel Oil within 90 days of burning #2 Fuel Oil for greater than a combined total of 48 hours during the 5-year term of the facility operating permit. The permittee shall report the results (as SO₂) of this test in units consistent with the emission limitation (lb/mmbtu) and the emission factor used for compliance (lb SO_x per 1000 gallons #2 Fuel Oil burned).

006 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

1. [25 Pa. Code § 139.53(a)(3)] At least 90 calendar days prior to commencing an emissions testing program, a test protocol shall be submitted to the Department for review and approval. The test protocol shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.
2. [25 Pa. Code § 139.53(a)(3)] At least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the appropriate Regional Office. Notification shall also be sent to the Division of Source Testing and Monitoring. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.
3. [25 Pa. Code § 139.53(a)(3)] Within 15 calendar days after completion of the on-site testing portion of an emission test program, if a complete test report has not yet been submitted, notification shall be sent to the Department's Division of Source Testing and Monitoring and the appropriate Regional Office indicating the completion date of the on-site testing.
4. [40 CFR Part 60.8(a), 40 CFR Part 61.13(f) and 40 CFR Part 63.7(g)] A complete test report shall be submitted to the Department no later than 60 calendar days after completion of the on-site testing portion of an emission test program. For those tests being conducted pursuant to 40 CFR Part 61, a complete test report shall be submitted within 31 days after completion of the test.
5. [25 Pa. Code Section 139.53(b)] A complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or non-compliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:
 - (a) A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.
 - (b) Permit number(s) and condition(s) which are the basis for the evaluation.
 - (c) Summary of results with respect to each applicable permit condition.
 - (d) Statement of compliance or non-compliance with each applicable permit condition.
6. [25 Pa. Code § 139.3] All submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.
7. All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.
8. [25 Pa. Code Section 139.53(a)(1) and 139.53(a)(3)] The Department requires one electronic copy of all source test submissions (protocols and reports) to be sent to both the appropriate Regional Office and the PSIMS Administrator in Central Office (mail and email addresses are provided below). Do not send submissions to anyone else, except the U.S. EPA, unless specifically directed to do so. To minimize the potential for rescheduling of the test, all protocols must be received at least 90 days prior to testing. Test reports must be received no later than 60 days after the completion of testing, unless a more stringent regulatory requirement applies. Any questions or concerns about source testing submissions can be sent to RA-EPstacktesting@pa.gov and the PSIMS Administrator will address them.

**SECTION D. Source Level Requirements**

Electronic copies of Protocols and Reports shall be emailed to the following:

Central Office
RA-EPstacktesting@pa.gov

Northwest Region
RA-EPNWstacktesting@pa.gov

Notifications and Supplemental Information shall be submitted to the following:

OnBase Submittal
<http://www.dep.pa.gov/DataandTools/Pages/Application-Form-Upload.aspx>

9. The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

10. Actions Related to Noncompliance Demonstrated by a Stack Test:

(a) If the results of a stack test, performed as required by this operating permit, exceed the level specified in any condition of this approval, the Permittee shall take appropriate corrective actions. Within 30 days of the Permittee receiving the stack test results, a written description of the corrective actions shall be submitted to the Department. The Permittee shall take appropriate action to minimize emissions from the affected facility while the corrective actions are being implemented. The Department shall notify the Permittee within 30 days, if the corrective actions taken are deficient. Within 30 days of receipt of the notice of deficiency, the Permittee shall submit a description of additional corrective actions to the Department. The Department reserves the authority to use enforcement activities to resolve noncompliant stack tests.

(b) If the results of the required stack test exceed any limit defined in this operating permit, the test was not performed in accordance with the stack test protocol or the source and/or air cleaning device was not operated in accordance with the operating permit, then another stack test shall be performed to determine compliance. Within 120 days of the Permittee receiving the original stack test results, a retest shall be performed. The Department may extend the retesting deadline if the Permittee demonstrates, to the Department's satisfaction, that retesting within 120 days is not practicable. Failure of the second test to demonstrate compliance with the limits in the operating permit, not performing the test in accordance with the stack test protocol or not operating the source and/or air cleaning device in accordance with the operating permit may be grounds for immediate revocation of the operating permit to operate the affected source.

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements****VI. WORK PRACTICE REQUIREMENTS.****# 007 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252A]

The permittee shall conduct a tuneup of the boiler within 2 years of plan approval issuance and biennially thereafter. This tuneup shall include, at a minimum, the following:

1. Inspection, adjustment, cleaning or replacement of fuel-burning equipment, including the burners and moving parts necessary for proper operation as specified by the manufacturer.
2. Inspection of the flame pattern or characteristics and adjustments necessary to minimize total emissions of NO_x, and to the extent practicable minimize emissions of CO.
3. Inspection of the air-to-fuel ratio control system and adjustments necessary to ensure proper calibration and operation as specified by the manufacturer.
4. The owner and operator of the adjusted equipment shall record each adjustment conducted under the procedures above in a permanently bound log book or other method approved by the Department. This log shall contain, at a minimum, the following information:
 - (i) The date of the tuning procedure.
 - (ii) The name of the service company and technicians.
 - (iii) The final operating rate or load.
 - (iv) The final CO and NO_x emission rates.
 - (v) The final excess oxygen rate.
 - (vi) Other information required by the applicable operating permit.
5. The owner and operator shall make the annual adjustment in accordance with the EPA document "Combustion Efficiency Optimization Manual for Operators of Oil and Gas-fired Boilers," September 1983 (EPA-340/1-83-023) or equivalent procedures approved in writing by the Department.

008 [25 Pa. Code §127.441]**Operating permit terms and conditions.**

The source shall be maintained and operated in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

VII. ADDITIONAL REQUIREMENTS.

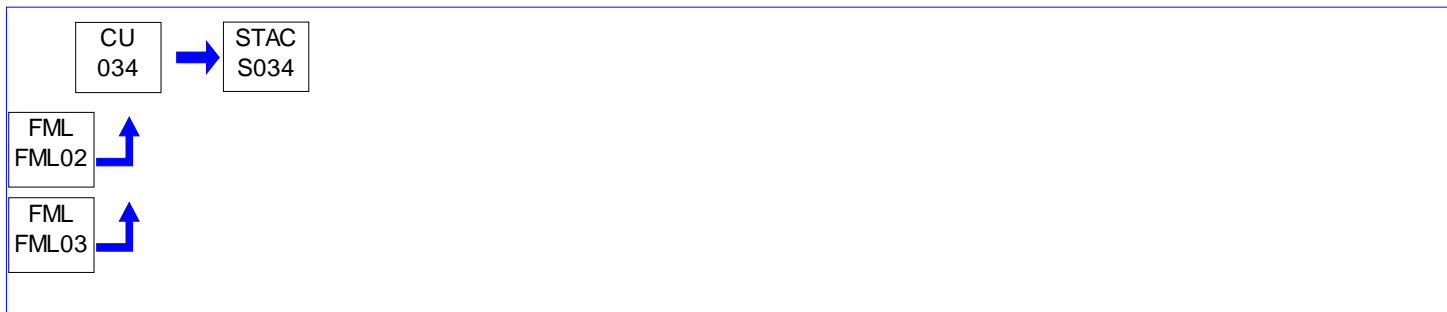
No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**

Source ID: 034

Source Name: BOILER 034

Source Capacity/Throughput: 21.000 MMBTU/HR
 21.000 MCF/HR Natural Gas
 149.300 Gal/HR #2 Oil

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

(a) A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

(2)-(3) Not applicable

(b) Allowable emissions under subsection (a) are graphically indicated in Appendix A.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas must conform with the following:

(1) General provision. A person may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over a 1-hour period, except as provided in paragraph (4).

(2) Commercial fuel oil.

(i) Except as specified in subparagraphs (ii) and (iii), a person may not offer for sale, deliver for use, exchange in trade or permit the use of commercial fuel oil in nonair basin areas if the commercial fuel oil contains sulfur in excess of the applicable maximum allowable sulfur content set forth in the following table:

Maximum Allowable Sulfur Content Expressed as Parts per Million (ppm) by Weight or Percentage by Weight

| Grades Commercial Fuel Oil (Consistent with ASTM D396) | Through August 31, 2020 | Beginning September 1, 2020 |
|---|-------------------------|-----------------------------|
| No. 2 and lighter oil | 500 ppm (0.05%) | 15 ppm (0.0015%) |
| No. 4 oil | 2,500 ppm (0.25%) | 2,500 ppm (0.25%) |
| No. 5, No. 6 and heavier oil | 5,000 ppm (0.5%) | 5,000 ppm (0.5%) |

(ii) Commercial fuel oil that was stored in this Commonwealth by the ultimate consumer prior to September 1, 2020, which met the applicable maximum allowable sulfur content for commercial fuel oil through August 31, 2020, in subparagraph (i) at the time it was stored, may be used by the ultimate consumer in this Commonwealth on and after September 1, 2020.

**SECTION D. Source Level Requirements**

(iii) The Department may temporarily suspend or increase the applicable maximum allowable sulfur content for a commercial fuel oil set forth in subparagraph (i) if the following occur:

(A) The Department receives a written request at the address specified in subsection (h) for a suspension or increase on the basis that compliant commercial fuel oil is not reasonably available in a nonair basin area. The request must include the following:

(I) The nonair basin county or counties for which the suspension or increase is requested.

(II) The reason compliant commercial fuel oil is not reasonably available.

(III) The duration of time for which the suspension or increase is requested and the justification for the requested duration.

(B) The Department determines that an insufficient quantity of compliant commercial fuel oil is reasonably available in the nonair basin area and that the circumstances leading to the insufficiency are due to events that could not have been reasonably foreseen or prevented and are not due to lack of prudent planning on the part of the transferor of the commercial fuel oil into or within the specified nonair basin area.

(C) The Department approves the request, in writing, prior to the transferor distributing the noncompliant commercial fuel oil into or within the specified nonair basin area.

(iv) The Department will limit a suspension or increase in the applicable maximum allowable sulfur content granted under subparagraph (iii) to the shortest duration in which adequate supplies of compliant commercial fuel oil can be made reasonably available, but in no case longer than 60 days from the date the Department grants the suspension or increase.

(3)-(4) Not applicable

(b) - (g) Not applicable

(h) Written request. The written request for suspension of or increase in the sulfur content limit on the basis that compliant commercial fuel oil is not reasonably available shall be addressed to the Department of Environmental Protection, Bureau of Air Quality, Chief of the Division of Compliance and Enforcement, P. O. Box 8468, Harrisburg, Pennsylvania 17105-8468.

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in: 25 PA Code 123.22(a)(1) SIP Approved SO₂ Limits 40 CFR 52.2020(c)(1)]

003 [25 Pa. Code §127.12b]

Plan approval terms and conditions.

[Plan Approval 43-252B]

The source shall be capable of reducing NO_x and CO emissions to or below:

1. NO_x: 30 ppm_{dv} @ 3% O₂ when firing natural gas

2. NO_x: 90 ppm_{dv} @ 3% O₂ when firing fuel oil

3. CO: 300 ppm_{dv} @ 3% O₂

[This condition replaces the following condition from plan approval 43-252A: The source shall be capable of reducing NO_x and CO emissions to or below: 1. NO_x: 30 ppm_{dv} @ 3% O₂; 2. CO: 300 ppm_{dv} @ 3% O₂]

004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.42c]

Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units Standard for sulfur dioxide.

(a)-(c) Not applicable

**SECTION D. Source Level Requirements**

(d) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that combusts oil shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO₂ in excess of 215 ng/J (0.50 lb/MMBtu) heat input from oil; or, as an alternative, no owner or operator of an affected facility that combusts oil shall combust oil in the affected facility that contains greater than 0.5 weight percent sulfur. The percent reduction requirements are not applicable to affected facilities under this paragraph.

(e) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that combusts coal, oil, or coal and oil with any other fuel shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO₂ in excess of the following:

(1) Not applicable

(2) The emission limit determined according to the following formula for any affected facility that combusts coal, oil, or coal and oil with any other fuel:

Where:

Es = SO₂ emission limit, expressed in ng/J or lb/MMBtu heat input;

Ka = 520 ng/J (1.2 lb/MMBtu);

Kb = 260 ng/J (0.60 lb/MMBtu);

Kc = 215 ng/J (0.50 lb/MMBtu);

Ha = Heat input from the combustion of coal, except coal combusted in an affected facility subject to paragraph (b)(2) of this section, in Joules (J) [MMBtu];

Hb = Heat input from the combustion of coal in an affected facility subject to paragraph (b)(2) of this section, in J (MMBtu);
and

Hc = Heat input from the combustion of oil, in J (MMBtu).

(f)-(g) Not applicable

(h) For affected facilities listed under paragraphs (h)(1), (2), (3), or (4) of this section, compliance with the emission limits or fuel oil sulfur limits under this section may be determined based on a certification from the fuel supplier, as described under §60.48c(f), as applicable.

(1) Distillate oil-fired affected facilities with heat input capacities between 2.9 and 29 MW (10 and 100 MMBtu/hr).

(2) Residual oil-fired affected facilities with heat input capacities between 2.9 and 8.7 MW (10 and 30 MMBtu/hr).

(3)-(4) Not applicable

(i) The SO₂ emission limits, fuel oil sulfur limits, and percent reduction requirements under this section apply at all times, including periods of startup, shutdown, and malfunction.

(j) Not applicable

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

**SECTION D. Source Level Requirements****# 005 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.43c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Standard for particulate matter.**

(a)-(d) Not applicable

(e)(1)-(3) Not applicable

(4) An owner or operator of an affected facility that commences construction, reconstruction, or modification after February 28, 2005, and that combusts only oil that contains no more than 0.50 weight percent sulfur or a mixture of 0.50 weight percent sulfur oil with other fuels not subject to a PM standard under §60.43c and not using a post-combustion technology (except a wet scrubber) to reduce PM or SO₂ emissions is not subject to the PM limit in this section.

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 77 FR 9462, Feb. 16, 2012]

Fuel Restriction(s).**# 006 [25 Pa. Code §127.12b]
Plan approval terms and conditions.**

[Plan Approval 43-252B]

(a) The source shall burn gaseous fuels not combined with any solid fuels and burn liquid fuel only during periods of gas curtailment, gas supply interruption, startups, or periodic testing on liquid fuel. Periodic testing of liquid fuel shall not exceed a combined total of 48 hours during any calendar year.

[Plan Approval 43-252B]

(b) The source shall be fired only on gas (natural or liquefied petroleum) or No. 2 commercial fuel oil to which there has been no reclaimed or waste oil or other waste materials added. [This condition replaces the following condition from plan approval 43-252A: The source shall only burn natural gas as a fuel.]

Throughput Restriction(s).**# 007 [25 Pa. Code §127.12b]
Plan approval terms and conditions.**

[Plan Approval 43-252B]

Boilers 033 & 034 combined shall not exceed #2 Fuel Oil usage of 210,000 gallons per year based on a consecutive 12-month period.

II. TESTING REQUIREMENTS.**# 008 [25 Pa. Code §127.12b]
Plan approval terms and conditions.**

[Plan Approval 43-252B]

The permittee shall perform a stack test for SO_x in accordance with 25 PA Code Chapter 139 and US EPA Reference Method 8 or equivalent test procedure with the source at rated capacity and burning only #2 Fuel Oil within 90 days of burning #2 Fuel Oil for greater than a combined total of 48 hours during the 5-year term of the facility operating permit. The permittee shall report the results (as SO₂) of this test in units consistent with the emission limitation (lb/mmbtu) and the emission factor used for compliance (lb SO_x per 1000 gallons #2 Fuel Oil burned).

**# 009 [25 Pa. Code §127.12b]
Plan approval terms and conditions.**

[Plan Approval 43-252A]

(a) No later than 180 days after initial start-up, the permittee shall demonstrate compliance with the emission limitations for NO_x and CO. The demonstration may include either of the following methods:

1. Performance stack testing in accordance with applicable provisions of 25 PA Code Chapter 139 (relating to sampling and

**SECTION D. Source Level Requirements**

testing).

2. Portable analyzers approved by the Department.

3. Recent test data approved by the Department for identical boilers. [Parts (b) - (k) are not applicable]

The testing shall be performed while the aforementioned source is operating at the maximum or normal rated capacity as stated on the application.

(b) [25 Pa. Code § 139.53(a)(3)] At least 90 calendar days prior to commencing an emissions testing program, a test protocol shall be submitted to the Department for review and approval. The test protocol shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.

(c) [25 Pa. Code § 139.53(a)(3)] At least 15 calendar days prior to commencing an emission testing program, notification as to the date and time of testing shall be given to the appropriate Regional Office. Notification shall also be sent to the Division of Source Testing and Monitoring. Notification shall not be made without prior receipt of a protocol acceptance letter from the Department.

(d) [25 Pa. Code § 139.53(a)(3)] Within 15 calendar days after completion of the on-site testing portion of an emission test program, if a complete test report has not yet been submitted, an electronic mail notification shall be sent to the Department's Division of Source Testing and Monitoring and the appropriate Regional Office indicating the completion date of the on-site testing.

(e) [40 CFR Part 60.8(a), 40 CFR Part 61.13(f) and 40 CFR Part 63.7(g)] A complete test report shall be submitted to the Department no later than 60 calendar days after completion of the on-site testing portion of an emission test program. For those tests being conducted pursuant to 40 CFR Part 61, a complete test report shall be submitted within 31 days after completion of the test.

(f) [25 Pa. Code Section 139.53(b)] A complete test report shall include a summary of the emission results on the first page of the report indicating if each pollutant measured is within permitted limits and a statement of compliance or noncompliance with all applicable permit conditions. The summary results will include, at a minimum, the following information:

1. A statement that the owner or operator has reviewed the report from the emissions testing body and agrees with the findings.
2. Permit number(s) and condition(s) which are the basis for the evaluation.
3. Summary of results with respect to each applicable permit condition.
4. Statement of compliance or non-compliance with each applicable permit condition.

(g) [25 Pa. Code § 139.3] All submittals shall meet all applicable requirements specified in the most current version of the Department's Source Testing Manual.

(h) All testing shall be performed in accordance with the provisions of Chapter 139 of the Rules and Regulations of the Department of Environmental Protection.

(i) [25 Pa. Code Section 139.53(a)(1) and 139.53(a)(3)] The Department requires one electronic copy of all source test submissions (protocols and reports) to be sent to both the appropriate Regional Office and the PSIMS Administrator in Central Office (mail and email addresses are provided below). Do not send submissions to anyone else, except the U.S. EPA, unless specifically directed to do so. To minimize the potential for rescheduling of the test, all protocols must be received at least 90 days prior to testing. Test reports must be received no later than 60 days after the completion of testing, unless a more stringent regulatory requirement applies. Any questions or concerns about source testing submissions can be sent to RA-EPstacktesting@pa.gov and the PSIMS Administrator will address them.

**SECTION D. Source Level Requirements**

Electronic copies of Protocols and Reports shall be emailed to the following:

Central Office
RA-EPstacktesting@pa.gov

Northwest Region
RA-EPNWstacktesting@pa.gov

Notifications and Supplemental Information shall be submitted to the following:

OnBase Submittal
<http://www.dep.pa.gov/DataandTools/Pages/Application-Form-Upload.aspx>

(j) The permittee shall ensure all federal reporting requirements contained in the applicable subpart of 40 CFR are followed, including timelines more stringent than those contained herein. In the event of an inconsistency or any conflicting requirements between state and the federal, the most stringent provision, term, condition, method or rule shall be used by default.

(k) Actions Related to Noncompliance Demonstrated by a Stack Test:

1. If the results of a stack test, performed as required by this approval, exceed the level specified in any condition of this approval, the Permittee shall take appropriate corrective actions. Within 30 days of the Permittee receiving the stack test results, a written description of the corrective actions shall be submitted to the Department. The Permittee shall take appropriate action to minimize emissions from the affected facility while the corrective actions are being implemented. The Department shall notify the Permittee within 30 days, if the corrective actions taken are deficient. Within 30 days of receipt of the notice of deficiency, the Permittee shall submit a description of additional corrective actions to the Department. The Department reserves the authority to use enforcement activities to resolve noncompliant stack tests.

2. If the results of the required stack test exceed any limit defined in this plan approval, the test was not performed in accordance with the stack test protocol or the source and/or air cleaning device was not operated in accordance with the plan approval, then another stack test shall be performed to determine compliance. Within 120 days of the Permittee receiving the original stack test results, a retest shall be performed. The Department may extend the retesting deadline if the Permittee demonstrates, to the Department's satisfaction, that retesting within 120 days is not practicable. Failure of the second test to demonstrate compliance with the limits in the plan approval, not performing the test in accordance with the stack test protocol or not operating the source and/or air cleaning device in accordance with the plan approval may be grounds for immediate revocation of the plan approval to operate the affected source.

**# 010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.44c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Compliance and performance test methods and procedures for sulfur dioxide.**

(a)-(f) Not applicable

(g) For oil-fired affected facilities where the owner or operator seeks to demonstrate compliance with the fuel oil sulfur limits under §60.42c based on shipment fuel sampling, the initial performance test shall consist of sampling and analyzing the oil in the initial tank of oil to be fired in the steam generating unit to demonstrate that the oil contains 0.5 weight percent sulfur or less. Thereafter, the owner or operator of the affected facility shall sample the oil in the fuel tank after each new shipment of oil is received, as described under §60.46c(d)(2).

(h) For affected facilities subject to §60.42c(h)(1), (2), or (3) where the owner or operator seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, the performance test shall consist of the certification from the fuel supplier, as described in §60.48c(f), as applicable.

(i)-(j) Not applicable

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

**SECTION D. Source Level Requirements**

**# 011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.45c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Compliance and performance test methods and procedures for particulate matter.**

(a)-(c) Not applicable

(d) The owner or operator of an affected facility seeking to demonstrate compliance under §60.43c(e)(4) shall follow the applicable procedures under §60.48c(f). For residual oil-fired affected facilities, fuel supplier certifications are only allowed for facilities with heat input capacities between 2.9 and 8.7 MW (10 to 30 MMBtu/h).

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

III. MONITORING REQUIREMENTS.

**# 012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.46c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Emission monitoring for sulfur dioxide**

(a)-(d) Not applicable

(e) The monitoring requirements of paragraphs (a) and (d) of this section shall not apply to affected facilities subject to §60.42c(h) (1), (2), or (3) where the owner or operator of the affected facility seeks to demonstrate compliance with the SO₂ standards based on fuel supplier certification, as described under §60.48c(f), as applicable.

(f) Not applicable

**# 013 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.47c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Emission monitoring for particulate matter.**

(a)-(e) Not applicable

(f) An owner or operator of an affected facility that is subject to an opacity standard in §60.43c(c) is not required to operate a COMS provided that the affected facility meets the conditions in either paragraphs (f)(1), (2), or (3) of this section.

(1) The affected facility uses a fabric filter (baghouse) as the primary PM control device and, the owner or operator operates a bag leak detection system to monitor the performance of the fabric filter according to the requirements in section §60.48Da of this part.

(2) The affected facility uses an ESP as the primary PM control device, and the owner or operator uses an ESP predictive model to monitor the performance of the ESP developed in accordance and operated according to the requirements in section §60.48Da of this part.

(3) The affected facility burns only gaseous fuels and/or fuel oils that contain no greater than 0.5 weight percent sulfur, and the owner or operator operates the unit according to a written site-specific monitoring plan approved by the permitting authority. This monitoring plan must include procedures and criteria for establishing and monitoring specific parameters for the affected facility indicative of compliance with the opacity standard. For testing performed as part of this site-specific monitoring plan, the permitting authority may require as an alternative to the notification and reporting requirements specified in §§60.8 and 60.11 that the owner or operator submit any deviations with the excess emissions report required under §60.48c(c).

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011; 77 FR 9463, Feb. 16, 2012]

**SECTION D. Source Level Requirements****IV. RECORDKEEPING REQUIREMENTS.****# 014 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252B]

The permittee shall maintain the following:

1. Operating log of steam flow (lbs/hr)
2. Natural gas usage (cf/hr)
3. Fuel oil usage (gallons/hr)

[This condition replaces the following condition from plan approval 43-252A: The permittee shall maintain the following: 1. Operating log of steam flow (lbs/hr); 2. Natural gas usage (cf/hr)]

V. REPORTING REQUIREMENTS.**# 015 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.48c]****Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units Reporting and recordkeeping requirements.**

(a) The owner or operator of each affected facility shall submit notification of the date of construction or reconstruction and actual startup, as provided by §60.7 of this part. This notification shall include:

- (1) The design heat input capacity of the affected facility and identification of fuels to be combusted in the affected facility.
 - (2) If applicable, a copy of any federally enforceable requirement that limits the annual capacity factor for any fuel or mixture of fuels under §60.42c, or §60.43c.
 - (3) The annual capacity factor at which the owner or operator anticipates operating the affected facility based on all fuels fired and based on each individual fuel fired.
 - (4) Notification if an emerging technology will be used for controlling SO₂ emissions. The Administrator will examine the description of the control device and will determine whether the technology qualifies as an emerging technology. In making this determination, the Administrator may require the owner or operator of the affected facility to submit additional information concerning the control device. The affected facility is subject to the provisions of §60.42c(a) or (b)(1), unless and until this determination is made by the Administrator.
- (b) The owner or operator of each affected facility subject to the SO₂ emission limits of §60.42c, or the PM or opacity limits of §60.43c, shall submit to the Administrator the performance test data from the initial and any subsequent performance tests and, if applicable, the performance evaluation of the CEMS and/or COMS using the applicable performance specifications in appendix B of this part.
- (c) Not applicable
- (d) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under §60.42c shall submit reports to the Administrator.
- (e) The owner or operator of each affected facility subject to the SO₂ emission limits, fuel oil sulfur limits, or percent reduction requirements under §60.42c shall keep records and submit reports as required under paragraph (d) of this section, including the following information, as applicable.

- (1) Calendar dates covered in the reporting period.
- (2)-(10) Not applicable

**SECTION D. Source Level Requirements**

(11) If fuel supplier certification is used to demonstrate compliance, records of fuel supplier certification as described under paragraph (f)(1), (2), (3), or (4) of this section, as applicable. In addition to records of fuel supplier certifications, the report shall include a certified statement signed by the owner or operator of the affected facility that the records of fuel supplier certifications submitted represent all of the fuel combusted during the reporting period.

(f) Fuel supplier certification shall include the following information:

(1) For distillate oil:

(i) The name of the oil supplier;

(ii) A statement from the oil supplier that the oil complies with the specifications under the definition of distillate oil in §60.41c; and

(iii) The sulfur content or maximum sulfur content of the oil.

(2) For residual oil:

(i) The name of the oil supplier;

(ii) The location of the oil when the sample was drawn for analysis to determine the sulfur content of the oil, specifically including whether the oil was sampled as delivered to the affected facility, or whether the sample was drawn from oil in storage at the oil supplier's or oil refiner's facility, or other location;

(iii) The sulfur content of the oil from which the shipment came (or of the shipment itself); and

(iv) The method used to determine the sulfur content of the oil.

(3) Not applicable

(4) For other fuels:

(i) The name of the supplier of the fuel;

(ii) The potential sulfur emissions rate or maximum potential sulfur emissions rate of the fuel in ng/J heat input; and

(iii) The method used to determine the potential sulfur emissions rate of the fuel.

(g)(1) Except as provided under paragraphs (g)(2) and (g)(3) of this section, the owner or operator of each affected facility shall record and maintain records of the amount of each fuel combusted during each operating day.

(2) As an alternative to meeting the requirements of paragraph (g)(1) of this section, the owner or operator of an affected facility that combusts only natural gas, wood, fuels using fuel certification in §60.48c(f) to demonstrate compliance with the SO₂ standard, fuels not subject to an emissions standard (excluding opacity), or a mixture of these fuels may elect to record and maintain records of the amount of each fuel combusted during each calendar month.

(3) Not applicable

(h) Not applicable

(i) All records required under this section shall be maintained by the owner or operator of the affected facility for a period of two years following the date of such record.

(j) The reporting period for the reports required under this subpart is each six-month period. All reports shall be submitted to the Administrator and shall be postmarked by the 30th day following the end of the reporting period.

**SECTION D. Source Level Requirements**

[72 FR 32759, June 13, 2007, as amended at 74 FR 5091, Jan. 28, 2009]

VI. WORK PRACTICE REQUIREMENTS.**# 016 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252A]

(a) The permittee shall install and maintain the necessary meter(s) to determine and to record amount of fuel usage.

[Plan Approval 43-252A]

(b) The source shall be maintained and operated in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

[Plan Approval 43-252A]

(c) The permittee shall conduct a tuneup of the boiler within 2 years of plan approval issuance and biennially thereafter. This tuneup shall include, at a minimum, the following:

1. Inspection, adjustment, cleaning or replacement of fuel-burning equipment, including the burners and moving parts necessary for proper operation as specified by the manufacturer.
2. Inspection of the flame pattern or characteristics and adjustments necessary to minimize total emissions of NO_x, and to the extent practicable minimize emissions of CO.
3. Inspection of the air-to-fuel ratio control system and adjustments necessary to ensure proper calibration and operation as specified by the manufacturer.
4. The owner and operator of the adjusted equipment shall record each adjustment conducted under the procedures above in a permanently bound log book or other method approved by the Department. This log shall contain, at a minimum, the following information:
 - (i) The date of the tuning procedure.
 - (ii) The name of the service company and technicians.
 - (iii) The final operating rate or load.
 - (iv) The final CO and NO_x emission rates.
 - (v) The final excess oxygen rate.
 - (vi) Other information required by the applicable operating permit.
5. The owner and operator shall make the annual adjustment in accordance with the EPA document "Combustion Efficiency Optimization Manual for Operators of Oil and Gas-fired Boilers," September 1983 (EPA-340/1-83-023) or equivalent procedures approved in writing by the Department.

VII. ADDITIONAL REQUIREMENTS.**# 017 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

[Plan Approval 43-252B]

(a) [Reserved]

[Plan Approval 43-252B]

**SECTION D. Source Level Requirements**

(b) For purposes of 40 CFR 63 Subpart JJJJJJ, this boiler is considered a gas-fired boiler and is not subject to this subpart and to any requirements in this subpart.

[Plan Approval 43-252B]

(c) Pursuant to 40 CFR 60.4, the permittee shall submit copies of all requests, reports, applications, submittals, and other communications to both EPA and the appropriate Regional Office of the Department. The EPA copies shall be forwarded to:

United States Environmental Protection Agency
Region III, Air and Radiation Division
Permits Branch (3AD10)
Four Penn Center
1600 John F. Kennedy Boulevard
Philadelphia, Pennsylvania 19103-2852

018 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.40c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Applicability and delegation of authority.

(a) Except as provided in paragraphs (d), (e), (f), and (g) of this section, the affected facility to which this subpart applies is each steam generating unit for which construction, modification, or reconstruction is commenced after June 9, 1989 and that has a maximum design heat input capacity of 29 megawatts (MW) (100 million British thermal units per hour (MMBtu/h)) or less, but greater than or equal to 2.9 MW (10 MMBtu/h).

(b) In delegating implementation and enforcement authority to a State under section 111(c) of the Clean Air Act, §60.48c(a)(4) shall be retained by the Administrator and not transferred to a State.

(c)-(i) Not applicable

[72 FR 32759, June 13, 2007, as amended at 74 FR 5090, Jan. 28, 2009; 77 FR 9461, Feb. 16, 2012]

019 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.41c]
Subpart Dc - Standards of Performance for Small Industrial- Commercial-Institutional Steam Generating Units
Definitions.

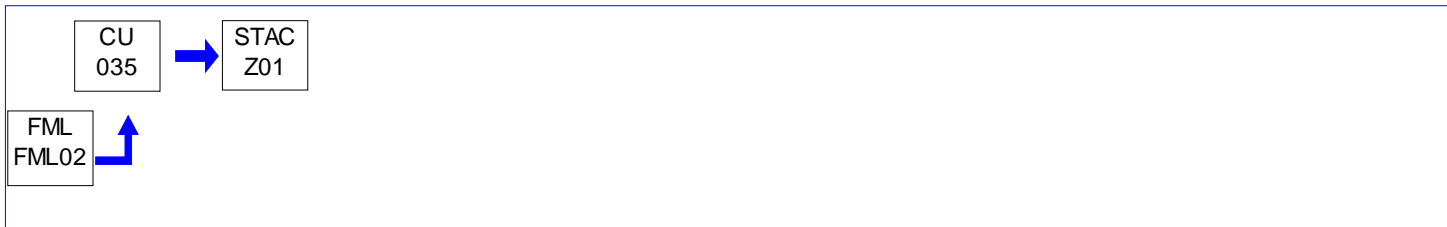
See 40 CFR 60.41c for the definitions that apply to this subpart.

**SECTION D. Source Level Requirements**

Source ID: 035

Source Name: MISCELLANEOUS NATURAL GAS COMBUSTION

Source Capacity/Throughput: 10.000 MCF/HR Natural Gas

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

(a) A person may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of the following:

(1) The rate of 0.4 pound per million Btu of heat input, when the heat input to the combustion unit in millions of Btus per hour is greater than 2.5 but less than 50.

(2) Not applicable

(3) Not applicable

(b) Allowable emissions under subsection (a) are graphically indicated in Appendix A.

002 [25 Pa. Code §123.22]**Combustion units**

(a) Nonair basin areas. Combustion units in nonair basin areas shall conform with the following:

(1) General provision. No person may permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO₂, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

(2)-(4) Not applicable

(b) - (h) Not applicable

[Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in: 25 PA Code 123.22(a)(1) SIP Approved SO₂ Limits 40 CFR 52.2020(c)(1)]

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).



SECTION D. Source Level Requirements

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

003 [25 Pa. Code §127.441]

Operating permit terms and conditions.

The source shall be maintained and operated in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

**SECTION D. Source Level Requirements**


Source ID: 101

Source Name: MAINTENANCE GARAGE DEGREASER UNIT

Source Capacity/Throughput:

N/A

142 SOLVENT

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

II. TESTING REQUIREMENTS.

No additional testing requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

III. MONITORING REQUIREMENTS.

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

IV. RECORDKEEPING REQUIREMENTS.

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

V. REPORTING REQUIREMENTS.

No additional reporting requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VI. WORK PRACTICE REQUIREMENTS.

No additional work practice requirements exist except as provided in other sections of this permit including Section B (State Only General Requirements).

VII. ADDITIONAL REQUIREMENTS.**# 001 [25 Pa. Code §129.63]****Degreasing operations**

(a) Cold cleaning machines. Except for those subject to the Federal National emissions standards for hazardous air pollutants (NESHAP) for halogenated solvent cleaners under 40 CFR Part 63 (relating to National emission standards for hazardous air pollutants for source categories), this subsection applies to cold cleaning machines that use 2 gallons or more of solvents containing greater than 5% VOC content by weight for the cleaning of metal parts.

(1) Immersion cold cleaning machines shall have a freeboard ratio of 0.50 or greater.

(2) Immersion cold cleaning machines and remote reservoir cold cleaning machines shall:

(i) Have a permanent, conspicuous label summarizing the operating requirements in paragraph (3). In addition, the label shall include the following discretionary good operating practices:

(A) Cleaned parts should be drained at least 15 seconds or until dripping ceases, whichever is longer. Parts having

**SECTION D. Source Level Requirements**

cavities or blind holes shall be tipped or rotated while the part is draining. During the draining, tipping or rotating, the parts should be positioned so that solvent drains directly back to the cold cleaning machine.

(B) When a pump-agitated solvent bath is used, the agitator should be operated to produce a rolling motion of the solvent with no observable splashing of the solvent against the tank walls or the parts being cleaned.

(C) Work area fans should be located and positioned so that they do not blow across the opening of the degreaser unit.

(ii) Be equipped with a cover that shall be closed at all times except during cleaning of parts or the addition or removal of solvent. For remote reservoir cold cleaning machines which drain directly into the solvent storage reservoir, a perforated drain with a diameter of not more than 6 inches shall constitute an acceptable cover.

(3) Cold cleaning machines shall be operated in accordance with the following procedures:

(i) Waste solvent shall be collected and stored in closed containers. The closed containers may contain a device that allows pressure relief, but does not allow liquid solvent to drain from the container.

(ii) Flushing of parts using a flexible hose or other flushing device shall be performed only within the cold cleaning machine. The solvent spray shall be a solid fluid stream, not an atomized or shower spray.

(iii) Sponges, fabric, wood, leather, paper products and other absorbent materials may not be cleaned in the cold cleaning machine.

(iv) Air agitated solvent baths may not be used.

(v) Spills during solvent transfer and use of the cold cleaning machine shall be cleaned up immediately.

(4) After December 22, 2002, a person may not use, sell or offer for sale for use in a cold cleaning machine any solvent with a vapor pressure of 1.0 millimeter of mercury (mm Hg) or greater and containing greater than 5% VOC by weight, measured at 20°C (68°F) containing VOCs.

(5) On and after December 22, 2002, a person who sells or offers for sale any solvent containing VOCs for use in a cold cleaning machine shall provide, to the purchaser, the following written information:

(i) The name and address of the solvent supplier.

(ii) The type of solvent including the product or vendor identification number.

(iii) The vapor pressure of the solvent measured in mm hg at 20°C (68°F).

(6) A person who operates a cold cleaning machine shall maintain for at least 2 years and shall provide to the Department, on request, the information specified in paragraph (5). An invoice, bill of sale, certificate that corresponds to a number of sales, Material Safety Data Sheet (MSDS), or other appropriate documentation acceptable to the Department may be used to comply with this section.

(7) Paragraph (4) does not apply:

(i) To cold cleaning machines used in extreme cleaning service.

(ii) If the owner or operator of the cold cleaning machine demonstrates, and the Department approves in writing, that compliance with paragraph (4) will result in unsafe operating conditions.

(iii) To immersion cold cleaning machines with a freeboard ratio equal to or greater than 0.75.

(b)-(e) Not Applicable



SECTION E. Source Group Restrictions.



SECTION F. Alternative Operation Requirements.

No Alternative Operations exist for this State Only facility.

**SECTION G. Emission Restriction Summary.**

| Source Id | Source Descriptor | | |
|-----------------------|--------------------------------------|--|------------------|
| 031 | BOILER 031 | | |
| Emission Limit | | | Pollutant |
| 420.000 | PPMV/MMBTU | dry corrected to 3% oxygen except during periods of startup and shutdown | CO |
| 0.000 | Lbs/MMBTU | 2.2e-05 #/mmbtu heat input except for periods of startup and shutdown | Mercury |
| 4.000 | Lbs/MMBTU | over any 1-hour period | SOX |
| 0.400 | Lbs/MMBTU | | TSP |
| 032 | BOILER 032 | | |
| Emission Limit | | | Pollutant |
| 4.000 | Lbs/MMBTU | over any 1-hour period | SOX |
| 0.400 | Lbs/MMBTU | | TSP |
| 033 | BOILER 033 | | |
| Emission Limit | | | Pollutant |
| 4.000 | Lbs/MMBTU | over any 1-hour period | SOX |
| 0.400 | Lbs/MMBTU | | TSP |
| 034 | BOILER 034 | | |
| Emission Limit | | | Pollutant |
| 300.000 | PPMV | dry @ 3% O2 | CO |
| 30.000 | PPMV | dry @ 3% O2 when firing natural gas | NOX |
| 90.000 | PPMV | dry @ 3% O2 when firing fuel oil | NOX |
| 4.000 | Lbs/MMBTU | over any 1-hour period | SOX |
| 0.400 | Lbs/MMBTU | | TSP |
| 035 | MISCELLANEOUS NATURAL GAS COMBUSTION | | |
| Emission Limit | | | Pollutant |
| 4.000 | Lbs/MMBTU | over any 1-hour period | SOX |
| 0.400 | Lbs/MMBTU | heat input greater than 2.5 mmbtu/hr but less than 50 | TSP |

Site Emission Restriction Summary

| Emission Limit | Pollutant |
|----------------|-----------|
|----------------|-----------|

**SECTION H. Miscellaneous.**

a) The Capacity/Hour numbers listed on Page 4 and provided in Section D of this permit for individual sources are for informational purposes only and are not to be considered enforceable limits. Enforceable emission limits are listed in the Restriction section for each source. They are also summarized for informational purposes only in Section F.

b) Source ID: Department assigned ID number for the source
Source Name: Department assigned name for the source
Capacity: The maximum capacity for the source (not a limit)
Fuel/Material: The fuel/material assigned to SCC for the source
Schematics:
FML: Fuel material location
Comb: Combustion source
Proc: Process
CD: Control device
EP: Emission point

c) For the purpose of this permit, Source 035 (Miscellaneous Natural Gas Combustion) consists of the following:

1. Hot water heaters
2. Building heaters
3. All other natural gas combustion at the facility

d) Emission factors:

1. Bituminous Coal (SCC 1-02-002-06):

- a) 15 lbs PM / ton coal burned; 6.2 lbs PM10/ton coal burned; 3.8 lbs PM 2.5/ton coal burned
- b) 31 * S lbs SO_x / ton coal burned (S = 0.9%)
- c) 9.5 lbs NO_x / ton coal burned
- d) 1.3 lbs VOC / ton coal burned
- e) 11 lbs CO / ton coal burned

2. Distillate Oil (SCC 1-02-005-02):

- a) 2 lbs PM / 1000 gallons #2 fuel oil; 1 lb PM10/1000 gallons #2 fuel oil; 0.25 lbs PM2.5/1000 gallons #2 fuel oil
- b) 142 * S lbs SO_x / 1000 gallons #2 fuel oil (S = 0.05%)
- c) 20 lbs NO_x / 1000 gallons #2 fuel oil
- d) 0.34 lbs VOC / 1000 gallons #2 fuel oil
- e) 5 lbs CO / 1000 gallons #2 fuel oil

3. Natural Gas (SCC 1-02-006-02):

- a) 7.6 lbs PM / mmcf (same factor for PM10 and PM2.5)
- b) 0.6 lbs SO_x / mmcf
- c) 100 lbs NO_x / mmcf for boilers 031, 032, 033, 034; 94 lbs NO_x/mmcf for miscellaneous natural gas fired units
- d) 5.5 lbs VOC / mmcf
- e) 84 lbs CO / mmcf for boilers 031, 032, 033, 034; 40 lbs CO for miscellaneous natural gas fired units

(e) This permit was renewed on July 3, 2012 with an expiration date of June 30, 2017.

(f) This permit was administratively amended on February 20, 2015 to incorporate the change of Responsible Official (RO). The previous RO has left the college. The current RO is Susan Grimm - Director of Environmental Safety. Susan Grimm is also the permit contact.

(g) This permit was renewed on July 21, 2017.

(h) This permit was administratively amended on October 26, 2020 to incorporate the requirements of plan approval 43-252B.



***** End of Report *****
