



**COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
AIR QUALITY PROGRAM**

**TITLE V/STATE OPERATING PERMIT**

Issue Date:	October 29, 2020	Effective Date:	February 18, 2025
Revision Date:	February 18, 2025	Expiration Date:	September 30, 2025
Revision Type:	Modification, Significant		

In accordance with the provisions of the Air Pollution Control Act, the Act of January 8, 1960, P.L. 2119, as amended, and 25 Pa. Code Chapter 127, the Owner, [and Operator if noted] (hereinafter referred to as permittee) identified below is authorized by the Department of Environmental Protection (Department) to operate the air emission source(s) more fully described in this permit. This Facility is subject to all terms and conditions specified in this permit. Nothing in this permit relieves the permittee from its obligations to comply with all applicable Federal, State and Local laws and regulations.

The regulatory or statutory authority for each permit condition is set forth in brackets. All terms and conditions in this permit are federally enforceable applicable requirements unless otherwise designated as "State-Only" or "non-applicable" requirements.

**TITLE V Permit No: 43-00182**

Federal Tax Id - Plant Code: 23-1327437-1

**Owner Information**

Name: ZEKELMAN IND INC  
Mailing Address: ONE COUNCIL AVENUE  
WHEATLAND, PA 16161

**Plant Information**

Plant: WHEATLAND TUBE COUNCIL AVE PLT/WHEATLAND TUBE LLC  
Location: 43 Mercer County 43918 Hermitage City  
SIC Code: 3317 Manufacturing - Steel Pipe And Tubes

**Responsible Official**

Name: NED FEENEY  
Title: GEN MGR  
Phone: (724) 342 - 6851 Email: ned.feeney@zekelman.com

**Permit Contact Person**

Name: ROBERT WERTH  
Title: ENV MGR  
Phone: (773) 346 - 8822 Email: robert.werth@zekelman.com

[Signature] \_\_\_\_\_  
LORI L. MCNABB, NORTHWEST REGION AIR PROGRAM MANAGER



## SECTION A. Table of Contents

### Section A. Facility/Source Identification

Table of Contents  
Site Inventory List

### Section B. General Title V Requirements

- #001 Definitions
- #002 Prohibition of Air Pollution
- #003 Property Rights
- #004 Permit Expiration
- #005 Permit Renewal
- #006 Transfer of Ownership or Operational Control
- #007 Inspection and Entry
- #008 Compliance Requirements
- #009 Need to Halt or Reduce Activity Not a Defense
- #010 Duty to Provide Information
- #011 Reopening and Revising the Title V Permit for Cause
- #012 Reopening a Title V Permit for Cause by EPA
- #013 Operating Permit Application Review by the EPA
- #014 Significant Operating Permit Modifications
- #015 Minor Operating Permit Modifications
- #016 Administrative Operating Permit Amendments
- #017 Severability Clause
- #018 Fee Payment
- #019 Authorization for De Minimis Emission Increases
- #020 Reactivation of Sources
- #021 Circumvention
- #022 Submissions
- #023 Sampling, Testing and Monitoring Procedures
- #024 Recordkeeping Requirements
- #025 Reporting Requirements
- #026 Compliance Certification
- #027 Operational Flexibility
- #028 Risk Management
- #029 Approved Economic Incentives and Emission Trading Programs
- #030 Permit Shield
- #031 Reporting
- #032 Report Format

### Section C. Site Level Title V Requirements

- C-I: Restrictions
- C-II: Testing Requirements
- C-III: Monitoring Requirements
- C-IV: Recordkeeping Requirements
- C-V: Reporting Requirements
- C-VI: Work Practice Standards
- C-VII: Additional Requirements
- C-VIII: Compliance Certification
- C-IX: Compliance Schedule

### Section D. Source Level Title V Requirements

- D-I: Restrictions
- D-II: Testing Requirements
- D-III: Monitoring Requirements
- D-IV: Recordkeeping Requirements
- D-V: Reporting Requirements



## SECTION A. Table of Contents

D-VI: Work Practice Standards  
D-VII: Additional Requirements

Note: These same sub-sections are repeated for each source!

### Section E. Source Group Restrictions

E-I: Restrictions  
E-II: Testing Requirements  
E-III: Monitoring Requirements  
E-IV: Recordkeeping Requirements  
E-V: Reporting Requirements  
E-VI: Work Practice Standards  
E-VII: Additional Requirements

### Section F. Alternative Operating Scenario(s)

F-I: Restrictions  
F-II: Testing Requirements  
F-III: Monitoring Requirements  
F-IV: Recordkeeping Requirements  
F-V: Reporting Requirements  
F-VI: Work Practice Standards  
F-VII: Additional Requirements

### Section G. Emission Restriction Summary

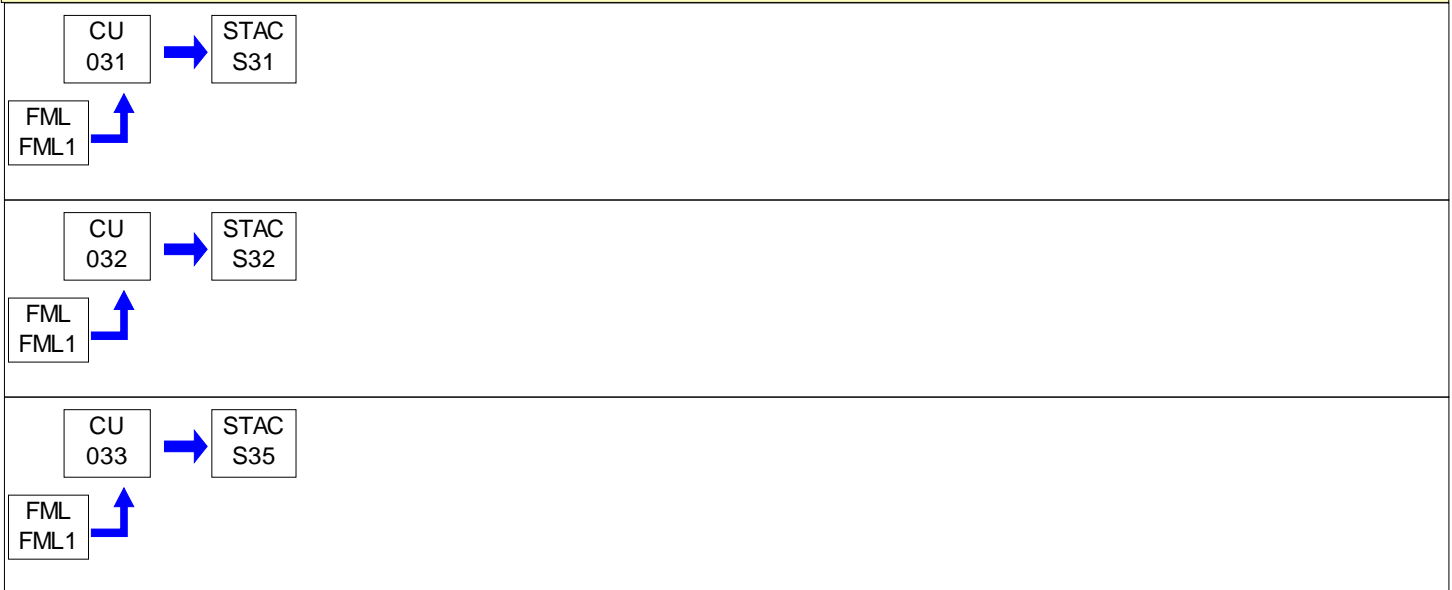
### Section H. Miscellaneous

**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput		Fuel/Material
031	600HP BOILER	25.200	MMBTU/HR	
		24.000	MCF/HR	NATURAL GAS
032	400HP BOILER	16.800	MMBTU/HR	
		16.000	MCF/HR	NATURAL GAS
033	1000HP NAT. GAS FIRED BOILER	42.000	MMBTU/HR	
		42.000	MCF/HR	Natural Gas
101	CONTINUOUS WELD FURNACE	66.000	Tons/HR	STEEL
		100.000	MCF/HR	NATURAL GAS
102	#1 GALVANIZING KETTLE	1.000	Tons/HR	ZINC
103	#2 GALVANIZING KETTLE	0.500	Tons/HR	ZINC
104	FINISHING DEPT. COATING LINE	20.000	Gal/HR	COATING
110	#1 CHROMATE TREATMENT	20.000	Tons/HR	GALV. STEEL PIPE
111	#2 CHROMATE TREATMENT	12.000	Tons/HR	GALV. STEEL PIPE
112	COUPLING DEPT	0.500	Tons/HR	
113	#1 ID BLOW STATION	12.000	Tons/HR	GAL. STEEL PIPE
114	#2 ID BLOW STATION	12.000	Tons/HR	GALV. STEEL PIPE
115	#1 PM THREADER	0.300	Gal/HR	COATING
120	CONDUIT LINE ZINC METALLIZER	25.000	Lbs/HR	ZINC
121	CONDUIT THREADER	0.050	Gal/HR	COATING
133	#1 GALVANIZING FURNACE	12.000	Tons/HR	GALV. STEEL PIPE
			N/A	Natural Gas
134	#2 GALVANIZING FURNACE		N/A	Natural Gas
		12.000	Tons/HR	GALV. STEEL PIPE
137	MISC HEATERS	26.260	MCF/HR	Natural Gas
138	MISC. PARTS WASHERS		N/A	
140	LIME SILO		N/A	LIME
143	ONE WASTE OIL SPACE HEATER	0.350	MMBTU/HR	
		2.000	Gal/HR	Reclaimed Oil
144	NATURAL GAS FUELED EMERGENCY GENERATORS (116 HP AND 450 HP)	19,285.000	CF/HR	NATURAL GAS
145	SULFURIC ACID PICKLING	24.120	Tons/HR	STEEL
146	100KW NATURAL GAS EMERGENCY GENERATOR (134 HP)	19,285.000	CF/HR	Natural Gas
C103	#2 GALVANIZING SCRUBBER			
C113	#1 ID BLOW STATION BAGHOUSE			
C113A	#1 ID BLOW STATION CYCLONE			
C114	#2 ID BLOW STATION BAGHOUSE			
C114A	#2 ID BLOW STATION CYCLONE			
C120	CARTRIDGE DUST COLLECTOR, CONDUIT LINE ZINC METALLIZER			
C140	LIME SILO DUST COLLECTOR			
FML1	NATURAL GAS PIPELINE			

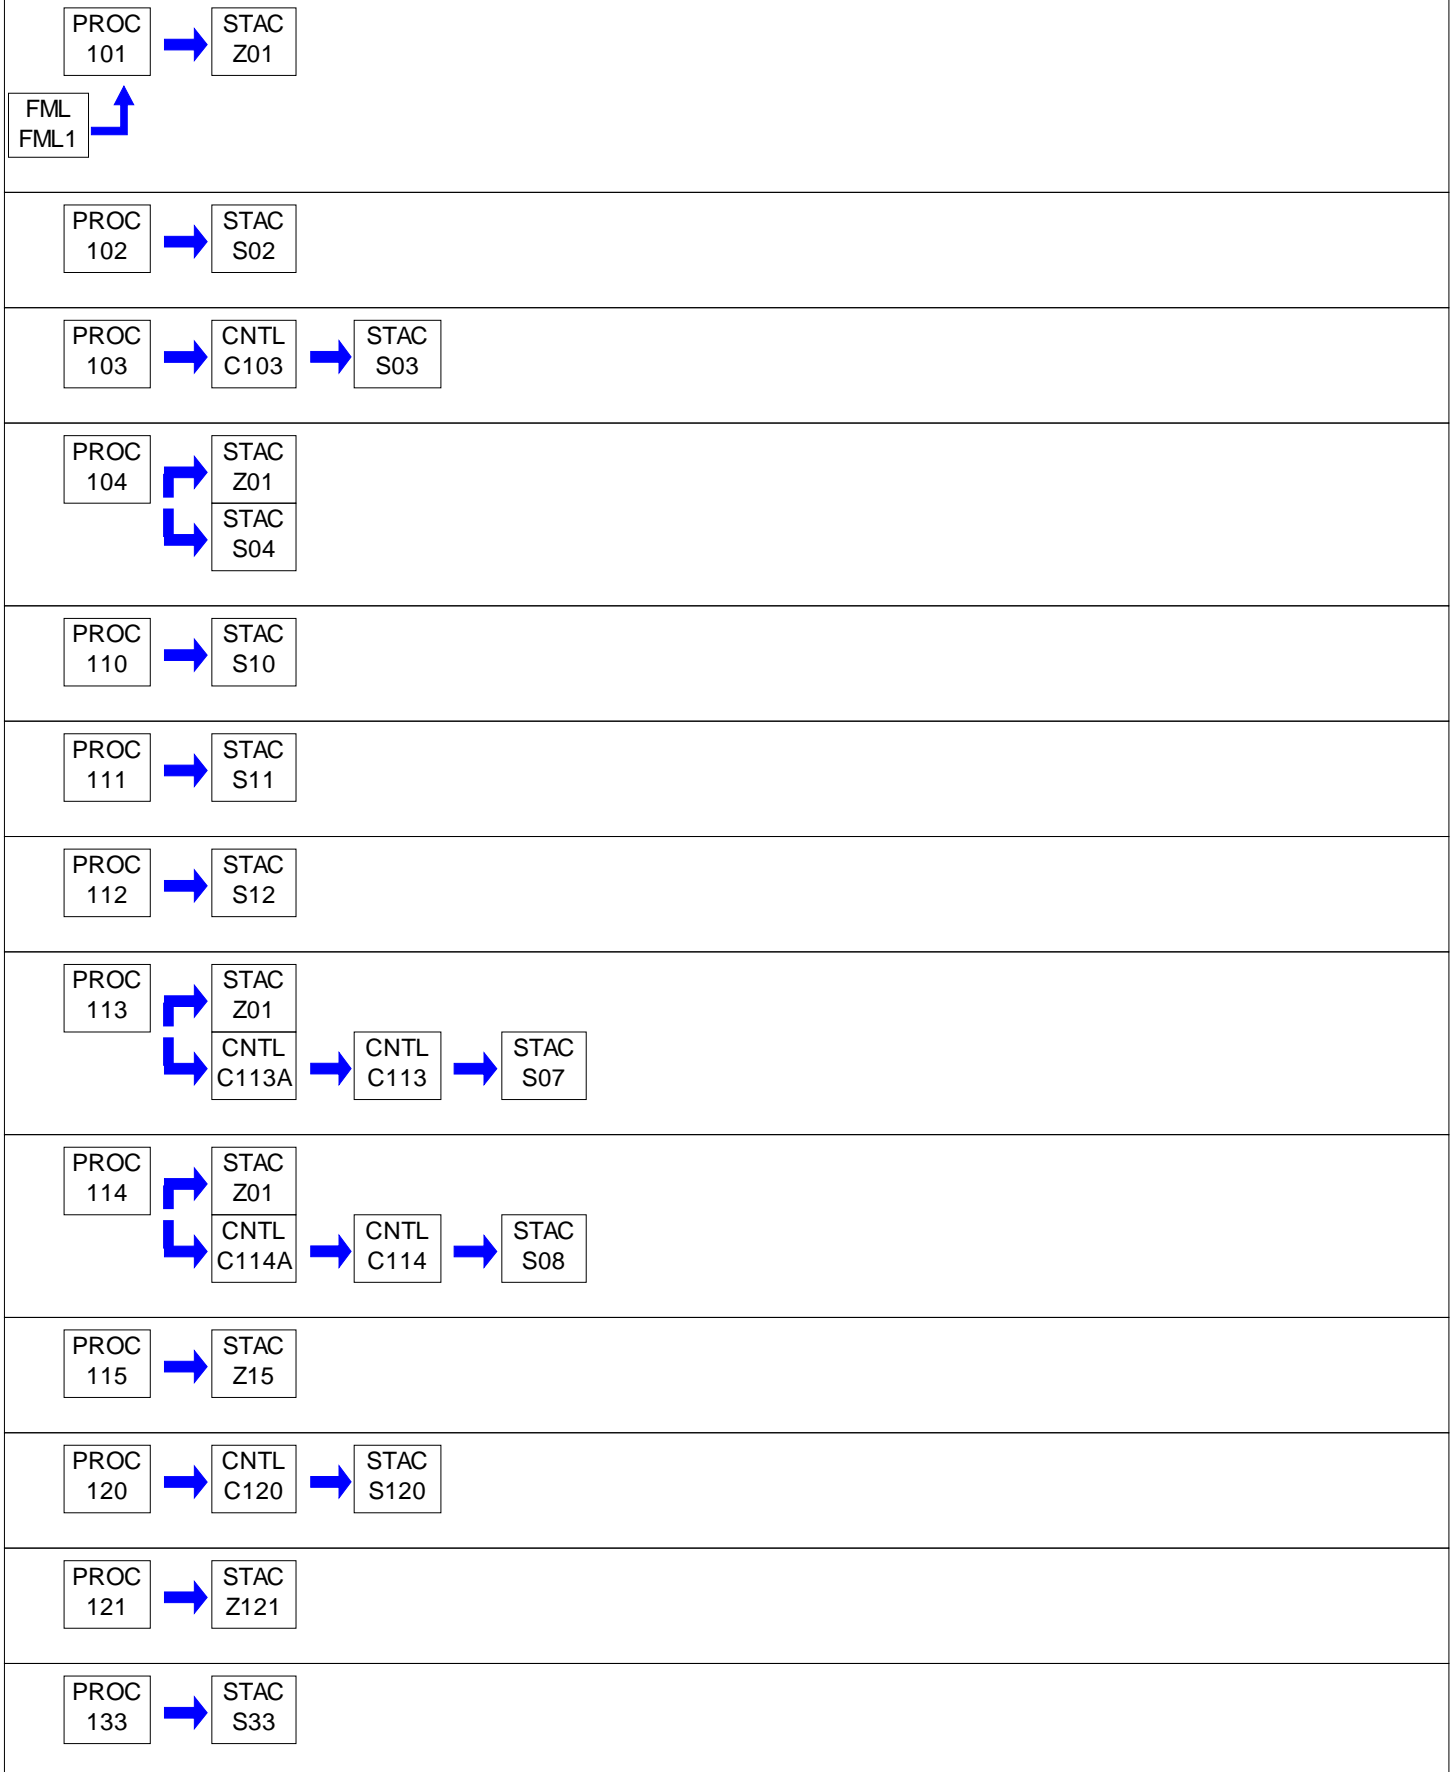
**SECTION A. Site Inventory List**

Source ID	Source Name	Capacity/Throughput	Fuel/Material
S02	#1 KETTLE LINE STACK		
S03	#2 KETTLE LINE STACK		
S04	FINISHING COATING LINE S.		
S07	#1 GALV DUST CLLCTR STK		
S08	#2 GALV DUST COLLECTOR SK		
S10	#1 CHROMIUM TREAT STK		
S11	#2 CHROMATE EXHAUST		
S12	COUPLING DEPT STK		
S120	STACK, CONDUIT LINE ZINC METALLIZER, DUST COLLECTOR		
S143	STACK FROM WASTE OIL SPACE HEATER		
S144	STACK FROM EMERGENCY GENERATORS (2)		
S146	100 KW EMERGENCY GENERATOR STACK		
S31	600HP BOILER STACK		
S32	400HP BOILER STACK		
S33	#1 GALVANIZING FURN STK		
S34	#2 GALVANIZING FURN STK		
S35	1000 HP BOILER STACK		
Z01	ROOF MONITOR		
Z09	PARTS WASHER FUGITIVE		
Z121	FACE THREADER		
Z140	LIME SILO EXHAUST		
Z15	#1 PM THREADER		

**PERMIT MAPS**



## PERMIT MAPS



**PERMIT MAPS**

PROC  
134 → STAC  
S34

PROC  
137 → STAC  
Z01

PROC  
138 → STAC  
Z09

PROC  
140 → CNTL  
C140 → STAC  
Z140

PROC  
143 → STAC  
S143

PROC  
144 → STAC  
S144

PROC  
145 → STAC  
Z01

PROC  
146 → STAC  
S146

**SECTION B. General Title V Requirements****#001 [25 Pa. Code § 121.1]****Definitions**

Words and terms that are not otherwise defined in this permit shall have the meanings set forth in Section 3 of the Air Pollution Control Act (35 P.S. § 4003) and 25 Pa. Code § 121.1.

**#002 [25 Pa. Code § 121.7]****Prohibition of Air Pollution**

No person may permit air pollution as that term is defined in the act.

**#003 [25 Pa. Code § 127.512(c)(4)]****Property Rights**

This permit does not convey property rights of any sort, or any exclusive privileges.

**#004 [25 Pa. Code § 127.446(a) and (c)]****Permit Expiration**

This operating permit is issued for a fixed term of five (5) years and shall expire on the date specified on Page 1 of this permit. The terms and conditions of the expired permit shall automatically continue pending issuance of a new Title V permit, provided the permittee has submitted a timely and complete application and paid applicable fees required under 25 Pa. Code Chapter 127, Subchapter I and the Department is unable, through no fault of the permittee, to issue or deny a new permit before the expiration of the previous permit. An application is complete if it contains sufficient information to begin processing the application, has the applicable sections completed and has been signed by a responsible official.

**#005 [25 Pa. Code §§ 127.412, 127.413, 127.414, 127.446(e), 127.503 & 127.704(b)]****Permit Renewal**

(a) An application for the renewal of the Title V permit shall be submitted to the Department at least six (6) months, and not more than 18 months, before the expiration date of this permit. The renewal application is timely if a complete application is submitted to the Department's Regional Air Manager within the timeframe specified in this permit condition.

(b) The application for permit renewal shall include the current permit number, the appropriate permit renewal fee, a description of any permit revisions and off-permit changes that occurred during the permit term, and any applicable requirements that were promulgated and not incorporated into the permit during the permit term. The fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" and submitted with the fee form to the respective regional office.

(c) The renewal application shall also include submission of proof that the local municipality and county, in which the facility is located, have been notified in accordance with 25 Pa. Code § 127.413. The application for renewal of the Title V permit shall also include submission of compliance review forms which have been used by the permittee to update information submitted in accordance with either 25 Pa. Code § 127.412(b) or § 127.412(j).

(d) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information during the permit renewal process. The permittee shall also promptly provide additional information as necessary to address any requirements that become applicable to the source after the date a complete renewal application was submitted but prior to release of a draft permit.

**#006 [25 Pa. Code §§ 127.450(a)(4) & 127.464(a)]****Transfer of Ownership or Operational Control**

(a) In accordance with 25 Pa. Code § 127.450(a)(4), a change in ownership or operational control of the source shall be treated as an administrative amendment if:

- (1) The Department determines that no other change in the permit is necessary;
- (2) A written agreement has been submitted to the Department identifying the specific date of the transfer of permit responsibility, coverage and liability between the current and the new permittee; and,
- (3) A compliance review form has been submitted to the Department and the permit transfer has been approved by



**SECTION B. General Title V Requirements**

the Department.

(b) In accordance with 25 Pa. Code § 127.464(a), this permit may not be transferred to another person except in cases of transfer-of-ownership which are documented and approved to the satisfaction of the Department.

**#007 [25 Pa. Code § 127.513, 35 P.S. § 4008 and § 114 of the CAA]****Inspection and Entry**

(a) Upon presentation of credentials and other documents as may be required by law for inspection and entry purposes, the permittee shall allow the Department of Environmental Protection or authorized representatives of the Department to perform the following:

- (1) Enter at reasonable times upon the permittee's premises where a Title V source is located or emissions related activity is conducted, or where records are kept under the conditions of this permit;
- (2) Have access to and copy or remove, at reasonable times, records that are kept under the conditions of this permit;
- (3) Inspect at reasonable times, facilities, equipment including monitoring and air pollution control equipment, practices, or operations regulated or required under this permit;
- (4) Sample or monitor, at reasonable times, substances or parameters, for the purpose of assuring compliance with the permit or applicable requirements as authorized by the Clean Air Act, the Air Pollution Control Act, or the regulations promulgated under the Acts.

(b) Pursuant to 35 P.S. § 4008, no person shall hinder, obstruct, prevent or interfere with the Department or its personnel in the performance of any duty authorized under the Air Pollution Control Act.

(c) Nothing in this permit condition shall limit the ability of the EPA to inspect or enter the premises of the permittee in accordance with Section 114 or other applicable provisions of the Clean Air Act.

**#008 [25 Pa. Code §§ 127.25, 127.444, & 127.512(c)(1)]****Compliance Requirements**

(a) The permittee shall comply with the conditions of this permit. Noncompliance with this permit constitutes a violation of the Clean Air Act and the Air Pollution Control Act and is grounds for one (1) or more of the following:

- (1) Enforcement action
- (2) Permit termination, revocation and reissuance or modification
- (3) Denial of a permit renewal application

(b) A person may not cause or permit the operation of a source, which is subject to 25 Pa. Code Article III, unless the source(s) and air cleaning devices identified in the application for the plan approval and operating permit and the plan approval issued to the source are operated and maintained in accordance with specifications in the applications and the conditions in the plan approval and operating permit issued by the Department. A person may not cause or permit the operation of an air contamination source subject to 25 Pa. Code Chapter 127 in a manner inconsistent with good operating practices.

(c) For purposes of Sub-condition (b) of this permit condition, the specifications in applications for plan approvals and operating permits are the physical configurations and engineering design details which the Department determines are essential for the permittee's compliance with the applicable requirements in this Title V permit.

**#009 [25 Pa. Code § 127.512(c)(2)]****Need to Halt or Reduce Activity Not a Defense**

It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

**SECTION B. General Title V Requirements****#010 [25 Pa. Code §§ 127.411(d) & 127.512(c)(5)]****Duty to Provide Information**

(a) The permittee shall furnish to the Department, within a reasonable time, information that the Department may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit, or to determine compliance with the permit.

(b) Upon request, the permittee shall also furnish to the Department copies of records that the permittee is required to keep by this permit, or for information claimed to be confidential, the permittee may furnish such records directly to the Administrator of EPA along with a claim of confidentiality.

**#011 [25 Pa. Code §§ 127.463, 127.512(c)(3) & 127.542]****Reopening and Revising the Title V Permit for Cause**

(a) This Title V permit may be modified, revoked, reopened and reissued or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or of a notification of planned changes or anticipated noncompliance does not stay a permit condition.

(b) This permit may be reopened, revised and reissued prior to expiration of the permit under one or more of the following circumstances:

(1) Additional applicable requirements under the Clean Air Act or the Air Pollution Control Act become applicable to a Title V facility with a remaining permit term of three (3) or more years prior to the expiration date of this permit. The Department will revise the permit as expeditiously as practicable but not later than 18 months after promulgation of the applicable standards or regulations. No such revision is required if the effective date of the requirement is later than the expiration date of this permit, unless the original permit or its terms and conditions has been extended.

(2) Additional requirements, including excess emissions requirements, become applicable to an affected source under the acid rain program. Upon approval by the Administrator of EPA, excess emissions offset plans for an affected source shall be incorporated into the permit.

(3) The Department or the EPA determines that this permit contains a material mistake or inaccurate statements were made in establishing the emissions standards or other terms or conditions of this permit.

(4) The Department or the Administrator of EPA determines that the permit must be revised or revoked to assure compliance with the applicable requirements.

(c) Proceedings to revise this permit shall follow the same procedures which apply to initial permit issuance and shall affect only those parts of this permit for which cause to revise exists. The revision shall be made as expeditiously as practicable.

(d) Regardless of whether a revision is made in accordance with (b)(1) above, the permittee shall meet the applicable standards or regulations promulgated under the Clean Air Act within the time frame required by standards or regulations.

**#012 [25 Pa. Code § 127.543]****Reopening a Title V Permit for Cause by EPA**

As required by the Clean Air Act and regulations adopted thereunder, this permit may be modified, reopened and reissued, revoked or terminated for cause by EPA in accordance with procedures specified in 25 Pa. Code § 127.543.

**#013 [25 Pa. Code § 127.522(a)]****Operating Permit Application Review by the EPA**

The applicant may be required by the Department to provide a copy of the permit application, including the compliance plan, directly to the Administrator of the EPA. Copies of title V permit applications to EPA, pursuant to 25 PA Code §127.522(a), shall be submitted, if required, to the following EPA e-mail box:

R3\_Air\_Apps\_and\_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

**SECTION B. General Title V Requirements****#014 [25 Pa. Code § 127.541]****Significant Operating Permit Modifications**

When permit modifications during the term of this permit do not qualify as minor permit modifications or administrative amendments, the permittee shall submit an application for significant Title V permit modifications in accordance with 25 Pa. Code § 127.541. Notifications to EPA, pursuant to 25 PA Code §127.522(a), if required, shall be submitted, to the following EPA e-mail box:

R3\_Air\_Apps\_and\_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

**#015 [25 Pa. Code §§ 121.1 & 127.462]****Minor Operating Permit Modifications**

The permittee may make minor operating permit modifications (as defined in 25 Pa. Code §121.1), on an expedited basis, in accordance with 25 Pa. Code §127.462 (relating to minor operating permit modifications). Notifications to EPA, pursuant to 25 PA Code §127.462(c), if required, shall be submitted, to the following EPA e-mail box:

R3\_Air\_Apps\_and\_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

**#016 [25 Pa. Code § 127.450]****Administrative Operating Permit Amendments**

(a) The permittee may request administrative operating permit amendments, as defined in 25 Pa. Code §127.450(a). Copies of request for administrative permit amendment to EPA, pursuant to 25 PA Code §127.450(c)(1), if required, shall be submitted to the following EPA e-mail box:

R3\_Air\_Apps\_and\_Notices@epa.gov

Please place the following in the subject line: TV [permit number], [Facility Name].

(b) Upon final action by the Department granting a request for an administrative operating permit amendment covered under §127.450(a)(5), the permit shield provisions in 25 Pa. Code § 127.516 (relating to permit shield) shall apply to administrative permit amendments incorporated in this Title V Permit in accordance with §127.450(c), unless precluded by the Clean Air Act or the regulations thereunder.

**#017 [25 Pa. Code § 127.512(b)]****Severability Clause**

The provisions of this permit are severable, and if any provision of this permit is determined by the Environmental Hearing Board or a court of competent jurisdiction, or US EPA to be invalid or unenforceable, such a determination will not affect the remaining provisions of this permit.

**#018 [25 Pa. Code §§ 127.704, 127.705 & 127.707]****Fee Payment**

(a) The permittee shall pay fees to the Department in accordance with the applicable fee schedules in 25 Pa. Code Chapter 127, Subchapter I (relating to plan approval and operating permit fees). The applicable fees shall be made payable to "The Commonwealth of Pennsylvania Clean Air Fund" with the permit number clearly indicated and submitted to the respective regional office.

(b) Emission Fees. The permittee shall, on or before September 1st of each year, pay applicable annual Title V emission fees for emissions occurring in the previous calendar year as specified in 25 Pa. Code § 127.705. The permittee is not required to pay an emission fee for emissions of more than 4,000 tons of each regulated pollutant emitted from the facility.

(c) As used in this permit condition, the term "regulated pollutant" is defined as a VOC, each pollutant regulated under Sections 111 and 112 of the Clean Air Act and each pollutant for which a National Ambient Air Quality Standard has been promulgated, except that carbon monoxide is excluded.

**SECTION B. General Title V Requirements**

(d) Late Payment. Late payment of emission fees will subject the permittee to the penalties prescribed in 25 Pa. Code § 127.707 and may result in the suspension or termination of the Title V permit. The permittee shall pay a penalty of fifty percent (50%) of the fee amount, plus interest on the fee amount computed in accordance with 26 U.S.C.A. § 6621(a)(2) from the date the emission fee should have been paid in accordance with the time frame specified in 25 Pa. Code § 127.705(c).

(e) The permittee shall pay an annual operating permit maintenance fee according to the following fee schedule established in 25 Pa. Code § 127.704(d) on or before December 31 of each year for the next calendar year.

- (1) Eight thousand dollars (\$8,000) for calendar years 2021—2025.
- (2) Ten thousand dollars (\$10,000) for calendar years 2026—2030.
- (3) Twelve thousand five hundred dollars (\$12,500) for the calendar years beginning with 2031.

**#019 [25 Pa. Code §§ 127.14(b) & 127.449]****Authorization for De Minimis Emission Increases**

(a) This permit authorizes de minimis emission increases from a new or existing source in accordance with 25 Pa. Code §§ 127.14 and 127.449 without the need for a plan approval or prior issuance of a permit modification. The permittee shall provide the Department with seven (7) days prior written notice before commencing any de minimis emissions increase that would result from either: (1) a physical change of minor significance under § 127.14(c)(1); or (2) the construction, installation, modification or reactivation of an air contamination source. The written notice shall:

- (1) Identify and describe the pollutants that will be emitted as a result of the de minimis emissions increase.
- (2) Provide emission rates expressed in tons per year and in terms necessary to establish compliance consistent with any applicable requirement.

The Department may disapprove or condition de minimis emission increases at any time.

(b) Except as provided below in (c) and (d) of this permit condition, the permittee is authorized during the term of this permit to make de minimis emission increases (expressed in tons per year) up to the following amounts without the need for a plan approval or prior issuance of a permit modification:

- (1) Four tons of carbon monoxide from a single source during the term of the permit and 20 tons of carbon monoxide at the facility during the term of the permit.
- (2) One ton of NO<sub>x</sub> from a single source during the term of the permit and 5 tons of NO<sub>x</sub> at the facility during the term of the permit.
- (3) One and six-tenths tons of the oxides of sulfur from a single source during the term of the permit and 8.0 tons of oxides of sulfur at the facility during the term of the permit.
- (4) Six-tenths of a ton of PM<sub>10</sub> from a single source during the term of the permit and 3.0 tons of PM<sub>10</sub> at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act or 25 Pa. Code Article III.
- (5) One ton of VOCs from a single source during the term of the permit and 5.0 tons of VOCs at the facility during the term of the permit. This shall include emissions of a pollutant regulated under Section 112 of the Clean Air Act unless precluded by the Clean Air Act or 25 Pa. Code Article III.

(c) In accordance with § 127.14, the permittee may install the following minor sources without the need for a plan approval:

- (1) Air conditioning or ventilation systems not designed to remove pollutants generated or released from other sources.
- (2) Combustion units rated at 2,500,000 or less Btu per hour of heat input.

**SECTION B. General Title V Requirements**

(3) Combustion units with a rated capacity of less than 10,000,000 Btu per hour heat input fueled by natural gas supplied by a public utility, liquefied petroleum gas or by commercial fuel oils which are No. 2 or lighter, viscosity less than or equal to 5.82 c St, and which meet the sulfur content requirements of 25 Pa. Code § 123.22 (relating to combustion units). For purposes of this permit, commercial fuel oil shall be virgin oil which has no reprocessed, recycled or waste material added.

(4) Space heaters which heat by direct heat transfer.

(5) Laboratory equipment used exclusively for chemical or physical analysis.

(6) Other sources and classes of sources determined to be of minor significance by the Department.

(d) This permit does not authorize de minimis emission increases if the emissions increase would cause one or more of the following:

(1) Increase the emissions of a pollutant regulated under Section 112 of the Clean Air Act except as authorized in Subparagraphs (b)(4) and (5) of this permit condition.

(2) Subject the facility to the prevention of significant deterioration requirements in 25 Pa. Code Chapter 127, Subchapter D and/or the new source review requirements in Subchapter E.

(3) Violate any applicable requirement of the Air Pollution Control Act, the Clean Air Act, or the regulations promulgated under either of the acts.

(4) Changes which are modifications under any provision of Title I of the Clean Air Act and emission increases which would exceed the allowable emissions level (expressed as a rate of emissions or in terms of total emissions) under the Title V permit.

(e) Unless precluded by the Clean Air Act or the regulations thereunder, the permit shield described in 25 Pa. Code § 127.516 (relating to permit shield) shall extend to the changes made under 25 Pa. Code § 127.449 (relating to de minimis emission increases).

(f) Emissions authorized under this permit condition shall be included in the monitoring, recordkeeping and reporting requirements of this permit.

(g) Except for de minimis emission increases allowed under this permit, 25 Pa. Code § 127.449, or sources and physical changes meeting the requirements of 25 Pa. Code § 127.14, the permittee is prohibited from making physical changes or engaging in activities that are not specifically authorized under this permit without first applying for a plan approval. In accordance with § 127.14(b), a plan approval is not required for the construction, modification, reactivation, or installation of the sources creating the de minimis emissions increase.

(h) The permittee may not meet de minimis emission threshold levels by offsetting emission increases or decreases at the same source.

**#020 [25 Pa. Code §§ 127.11a & 127.215]****Reactivation of Sources**

(a) The permittee may reactivate a source at the facility that has been out of operation or production for at least one year, but less than or equal to five (5) years, if the source is reactivated in accordance with the requirements of 25 Pa. Code §§ 127.11a and 127.215. The reactivated source will not be considered a new source.

(b) A source which has been out of operation or production for more than five (5) years but less than 10 years may be reactivated and will not be considered a new source if the permittee satisfies the conditions specified in 25 Pa. Code § 127.11a(b).

**#021 [25 Pa. Code §§ 121.9 & 127.216]****Circumvention**

(a) The owner of this Title V facility, or any other person, may not circumvent the new source review requirements of 25 Pa. Code Chapter 127, Subchapter E by causing or allowing a pattern of ownership or development, including the

**SECTION B. General Title V Requirements**

phasing, staging, delaying or engaging in incremental construction, over a geographic area of a facility which, except for the pattern of ownership or development, would otherwise require a permit or submission of a plan approval application.

(b) No person may permit the use of a device, stack height which exceeds good engineering practice stack height, dispersion technique or other technique which, without resulting in reduction of the total amount of air contaminants emitted, conceals or dilutes an emission of air contaminants which would otherwise be in violation of this permit, the Air Pollution Control Act or the regulations promulgated thereunder, except that with prior approval of the Department, the device or technique may be used for control of malodors.

**#022 [25 Pa. Code §§ 127.402(d) & 127.513(1)]****Submissions**

(a) Reports, test data, monitoring data, notifications and requests for renewal of the permit shall be submitted to the:

Regional Air Program Manager  
PA Department of Environmental Protection  
(At the address given on the permit transmittal letter, or otherwise notified)

(b) Any report or notification for the EPA Administrator or EPA Region III should be addressed to:

Enforcement & Compliance Assurance Division  
Air, RCRA and Toxics Branch (3ED21)  
Four Penn Center  
1600 John F. Kennedy Boulevard  
Philadelphia, PA 19103-2852

The Title V compliance certification shall be emailed to EPA at R3\_APD\_Permits@epa.gov.

(c) An application, form, report or compliance certification submitted pursuant to this permit condition shall contain certification by a responsible official as to truth, accuracy, and completeness as required under 25 Pa. Code § 127.402(d). Unless otherwise required by the Clean Air Act or regulations adopted thereunder, this certification and any other certification required pursuant to this permit shall state that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate and complete.

**#023 [25 Pa. Code §§ 127.441(c) & 127.463(e); Chapter 139; & 114(a)(3), 504(b) of the CAA]****Sampling, Testing and Monitoring Procedures**

(a) The permittee shall perform the emissions monitoring and analysis procedures or test methods for applicable requirements of this Title V permit. In addition to the sampling, testing and monitoring procedures specified in this permit, the Permittee shall comply with any additional applicable requirements promulgated under the Clean Air Act after permit issuance regardless of whether the permit is revised.

(b) The sampling, testing and monitoring required under the applicable requirements of this permit, shall be conducted in accordance with the requirements of 25 Pa. Code Chapter 139 unless alternative methodology is required by the Clean Air Act (including §§ 114(a)(3) and 504(b)) and regulations adopted thereunder.

**#024 [25 Pa. Code §§ 127.511 & Chapter 135]****Recordkeeping Requirements**

(a) The permittee shall maintain and make available, upon request by the Department, records of required monitoring information that include the following:

- (1) The date, place (as defined in the permit) and time of sampling or measurements.
- (2) The dates the analyses were performed.
- (3) The company or entity that performed the analyses.
- (4) The analytical techniques or methods used.

**SECTION B. General Title V Requirements**

(5) The results of the analyses.

(6) The operating conditions as existing at the time of sampling or measurement.

(b) The permittee shall retain records of the required monitoring data and supporting information for at least five (5) years from the date of the monitoring sample, measurement, report or application. Supporting information includes the calibration data and maintenance records and original strip-chart recordings for continuous monitoring instrumentation, and copies of reports required by the permit.

(c) The permittee shall maintain and make available to the Department upon request, records including computerized records that may be necessary to comply with the reporting, recordkeeping and emission statement requirements in 25 Pa. Code Chapter 135 (relating to reporting of sources). In accordance with 25 Pa. Code Chapter 135, § 135.5, such records may include records of production, fuel usage, maintenance of production or pollution control equipment or other information determined by the Department to be necessary for identification and quantification of potential and actual air contaminant emissions. If direct recordkeeping is not possible or practical, sufficient records shall be kept to provide the needed information by indirect means.

**#025 [25 Pa. Code §§ 127.411(d), 127.442, 127.463(e) & 127.511(c)]****Reporting Requirements**

(a) The permittee shall comply with the reporting requirements for the applicable requirements specified in this Title V permit. In addition to the reporting requirements specified herein, the permittee shall comply with any additional applicable reporting requirements promulgated under the Clean Air Act after permit issuance regardless of whether the permit is revised.

(b) Pursuant to 25 Pa. Code § 127.511(c), the permittee shall submit reports of required monitoring at least every six (6) months unless otherwise specified in this permit. Instances of deviations (as defined in 25 Pa. Code § 121.1) from permit requirements shall be clearly identified in the reports. The reporting of deviations shall include the probable cause of the deviations and corrective actions or preventative measures taken, except that sources with continuous emission monitoring systems shall report according to the protocol established and approved by the Department for the source. The required reports shall be certified by a responsible official.

(c) Every report submitted to the Department under this permit condition shall comply with the submission procedures specified in Section B, Condition #022(c) of this permit.

(d) Any records, reports or information obtained by the Department or referred to in a public hearing shall be made available to the public by the Department except for such records, reports or information for which the permittee has shown cause that the documents should be considered confidential and protected from disclosure to the public under Section 4013.2 of the Air Pollution Control Act and consistent with Sections 112(d) and 114(c) of the Clean Air Act and 25 Pa. Code § 127.411(d). The permittee may not request a claim of confidentiality for any emissions data generated for the Title V facility.

**#026 [25 Pa. Code § 127.513]****Compliance Certification**

(a) One year after the date of issuance of the Title V permit, and each year thereafter, unless specified elsewhere in the permit, the permittee shall submit to the Department and EPA Region III a certificate of compliance with the terms and conditions in this permit, for the previous year, including the emission limitations, standards or work practices. This certification shall include:

- (1) The identification of each term or condition of the permit that is the basis of the certification.
- (2) The compliance status.
- (3) The methods used for determining the compliance status of the source, currently and over the reporting period.
- (4) Whether compliance was continuous or intermittent.

(b) The compliance certification shall be postmarked or hand-delivered no later than thirty days after each anniversary of the date of issuance of this Title V Operating Permit, or on the submittal date specified elsewhere in the permit, to the Department in accordance with the submission requirements specified in Section B, Condition #022 of this permit. The Title V compliance certification shall be emailed to EPA at R3\_APD\_Permits@epa.gov.

**SECTION B. General Title V Requirements****#027 [25 Pa. Code § 127.3]****Operational Flexibility**

The permittee is authorized to make changes within the Title V facility in accordance with the following provisions in 25 Pa. Code Chapter 127 which implement the operational flexibility requirements of Section 502(b)(10) of the Clean Air Act and Section 6.1(i) of the Air Pollution Control Act:

- (1) Section 127.14 (relating to exemptions)
- (2) Section 127.447 (relating to alternative operating scenarios)
- (3) Section 127.448 (relating to emissions trading at facilities with federally enforceable emissions caps)
- (4) Section 127.449 (relating to de minimis emission increases)
- (5) Section 127.450 (relating to administrative operating permit amendments)
- (6) Section 127.462 (relating to minor operating permit amendments)
- (7) Subchapter H (relating to general plan approvals and operating permits)

**#028 [25 Pa. Code §§ 127.441(d), 127.512(i) and 40 CFR Part 68]****Risk Management**

(a) If required by Section 112(r) of the Clean Air Act, the permittee shall develop and implement an accidental release program consistent with requirements of the Clean Air Act, 40 CFR Part 68 (relating to chemical accident prevention provisions) and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act (P.L. 106-40).

(b) The permittee shall prepare and implement a Risk Management Plan (RMP) which meets the requirements of Section 112(r) of the Clean Air Act, 40 CFR Part 68 and the Federal Chemical Safety Information, Site Security and Fuels Regulatory Relief Act when a regulated substance listed in 40 CFR § 68.130 is present in a process in more than the listed threshold quantity at the Title V facility. The permittee shall submit the RMP to the federal Environmental Protection Agency according to the following schedule and requirements:

- (1) The permittee shall submit the first RMP to a central point specified by EPA no later than the latest of the following:
  - (i) Three years after the date on which a regulated substance is first listed under § 68.130; or,
  - (ii) The date on which a regulated substance is first present above a threshold quantity in a process.

(2) The permittee shall submit any additional relevant information requested by the Department or EPA concerning the RMP and shall make subsequent submissions of RMPs in accordance with 40 CFR § 68.190.

(3) The permittee shall certify that the RMP is accurate and complete in accordance with the requirements of 40 CFR Part 68, including a checklist addressing the required elements of a complete RMP.

(c) As used in this permit condition, the term "process" shall be as defined in 40 CFR § 68.3. The term "process" means any activity involving a regulated substance including any use, storage, manufacturing, handling, or on-site movement of such substances or any combination of these activities. For purposes of this definition, any group of vessels that are interconnected, or separate vessels that are located such that a regulated substance could be involved in a potential release, shall be considered a single process.

(d) If the Title V facility is subject to 40 CFR Part 68, as part of the certification required under this permit, the permittee shall:

- (1) Submit a compliance schedule for satisfying the requirements of 40 CFR Part 68 by the date specified in 40 CFR § 68.10(a); or,
- (2) Certify that the Title V facility is in compliance with all requirements of 40 CFR Part 68 including the registration and submission of the RMP.



**SECTION B. General Title V Requirements**

(e) If the Title V facility is subject to 40 CFR Part 68, the permittee shall maintain records supporting the implementation of an accidental release program for five (5) years in accordance with 40 CFR § 68.200.

(f) When the Title V facility is subject to the accidental release program requirements of Section 112(r) of the Clean Air Act and 40 CFR Part 68, appropriate enforcement action will be taken by the Department if:

(1) The permittee fails to register and submit the RMP or a revised plan pursuant to 40 CFR Part 68.

(2) The permittee fails to submit a compliance schedule or include a statement in the compliance certification required under Section B, Condition #026 of this permit that the Title V facility is in compliance with the requirements of Section 112(r) of the Clean Air Act, 40 CFR Part 68, and 25 Pa. Code § 127.512(i).

**#029 [25 Pa. Code § 127.512(e)]****Approved Economic Incentives and Emission Trading Programs**

No permit revision shall be required under approved economic incentives, marketable permits, emissions trading and other similar programs or processes for changes that are provided for in this Title V permit.

**#030 [25 Pa. Code §§ 127.516, 127.450(d), 127.449(f) & 127.462(g)]****Permit Shield**

(a) The permittee's compliance with the conditions of this permit shall be deemed in compliance with applicable requirements (as defined in 25 Pa. Code § 121.1) as of the date of permit issuance if either of the following applies:

(1) The applicable requirements are included and are specifically identified in this permit.

(2) The Department specifically identifies in the permit other requirements that are not applicable to the permitted facility or source.

(b) Nothing in 25 Pa. Code § 127.516 or the Title V permit shall alter or affect the following:

(1) The provisions of Section 303 of the Clean Air Act, including the authority of the Administrator of the EPA provided thereunder.

(2) The liability of the permittee for a violation of an applicable requirement prior to the time of permit issuance.

(3) The applicable requirements of the acid rain program, consistent with Section 408(a) of the Clean Air Act.

(4) The ability of the EPA to obtain information from the permittee under Section 114 of the Clean Air Act.

(c) Unless precluded by the Clean Air Act or regulations thereunder, final action by the Department incorporating a significant permit modification in this Title V Permit shall be covered by the permit shield at the time that the permit containing the significant modification is issued.

**#031 [25 Pa. Code §135.3]****Reporting**

(a) The permittee shall submit by March 1 of each year an annual emissions report for the preceding calendar year. The report shall include information for all active previously reported sources, new sources which were first operated during the preceding calendar year, and sources modified during the same period which were not previously reported. All air emissions from the facility should be estimated and reported.

(b) A source owner or operator may request an extension of time from the Department for the filing of an annual emissions report, and the Department may grant the extension for reasonable cause.

**#032 [25 Pa. Code §135.4]****Report Format**

Emissions reports shall contain sufficient information to enable the Department to complete its emission inventory. Emissions reports shall be made by the source owner or operator in a format specified by the Department.



## SECTION C. Site Level Requirements

### I. RESTRICTIONS.

#### Emission Restriction(s).

##### # 001 [25 Pa. Code §123.1]

##### Prohibition of certain fugitive emissions

(a) No person may permit the emission into the outdoor atmosphere of fugitive air contaminant from a source other than the following:

(1) Construction or demolition of buildings or structures.

(2) Grading, paving and maintenance of roads and streets.

(3) Use of roads and streets. Emissions from material in or on trucks, railroad cars and other vehicular equipment are not considered as emissions from use of roads and streets.

(4) Clearing of land.

(5) Stockpiling of materials.

(6) Open burning operations.

(7) Not applicable

(8) Not applicable

(9) Sources and classes of sources other than those identified in paragraphs (1)-(8), for which the operator has obtained a determination from the Department that fugitive emissions from the source, after appropriate control, meet the following requirements:

(i) the emissions are of minor significance with respect to causing air pollution; and

(ii) the emissions are not preventing or interfering with the attainment or maintenance of any ambient air quality standard.

(b) An application form for requesting a determination under either subsection (a)(9) or 129.15(c) is available from the Department. In reviewing these applications, the Department may require the applicant to supply information including, but not limited to, a description of proposed control measures, characteristics of emissions, quantity of emissions, and ambient air quality data and analysis showing the impact of the source on ambient air quality. The applicant shall be required to demonstrate that the requirements of subsections (a)(9) and (c) and 123.2 (relating to fugitive particulate matter) or of the requirements of 129.15(c) have been satisfied. Upon such demonstration, the Department will issue a determination, in writing, either as an operating permit condition, for those sources subject to permit requirements under the act, or as an order containing appropriate conditions and limitations.

(c) A person responsible for any source specified in subsections (a)(1) -- (7) or (9) shall take all reasonable actions to prevent particulate matter from becoming airborne. These actions shall include, but not be limited to, the following:

(1) Use, where possible, of water or chemicals for control of dust in the demolition of buildings or structures, construction operations, the grading of roads, or the clearing of land.

(2) Application of asphalt, oil, water or suitable chemicals on dirt roads, material stockpiles and other surfaces which may give rise to airborne dusts.

(3) Paving and maintenance of roadways.

(4) Prompt removal of earth or other material from paved streets onto which earth or other material has been transported by trucking or earth moving equipment, erosion by water, or other means.

(d) Not applicable

**SECTION C. Site Level Requirements****# 002 [25 Pa. Code §123.2]****Fugitive particulate matter**

A person may not permit fugitive particulate matter to be emitted into the outdoor atmosphere from a source specified in 123.1(a)(1) -- (9) (relating to prohibition of certain fugitive emissions) if such emissions are visible at the point the emissions pass outside the person's property.

**# 003 [25 Pa. Code §123.31]****Limitations**

(a) Not applicable

(b) A person may not permit the emission into the outdoor atmosphere of any malodorous air contaminants from any source in such a manner that the malodors are detectable outside the property of the person on whose land the source is being operated.

(c) Not applicable

**# 004 [25 Pa. Code §123.41]****Limitations**

A person may not permit the emission into the outdoor atmosphere of visible air contaminants in such a manner that the opacity of the emission is either of the following:

(1) Equal to or greater than 20% for a period or periods aggregating more than three minutes in any 1 hour.

(2) Equal to or greater than 60% at any time.

**# 005 [25 Pa. Code §123.42]****Exceptions**

The limitations of 123.41 (relating to limitations) shall not apply to a visible emission in any of the following instances:

(1) when the presence of uncombined water is the only reason for failure of the emission to meet the limitations.

(2) When the emission results from the operation of equipment used solely to train and test persons in observing the opacity of visible emissions.

(3) When the emission results from sources specified in 123.1(a)(1) -- (9) (relating to prohibition of certain fugitive emissions).

(4) Not applicable

**# 006 [25 Pa. Code §123.43]****Measuring techniques**

Visible emissions may be measured using either of the following:

(1) A device approved by the Department and maintained to provide accurate opacity measurements.

(2) Observers, trained and qualified to measure plume opacity with the naked eye or with the aid of any devices approved by the Department.

**# 007 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee may not emit total plant wide VOC emissions in an amount greater than 327.61 ton/yr based on any consecutive 12-month rolling period.

[ Authority for this condition is also derived in 25 Pa. Code Section 129.91 ]

**SECTION C. Site Level Requirements****II. TESTING REQUIREMENTS.****# 008 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The Department reserves the right to require exhaust stack testing of any source as necessary to verify emissions for purposes including determining the correct emission fee, malfunctions, or determining compliance with any applicable requirement.

**III. MONITORING REQUIREMENTS.****# 009 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

(a) The permittee shall conduct weekly monitoring of the facility property, while the plant is in operation, to observe for the presence of fugitive emissions and visible emissions being emitted into the outdoor atmosphere.

(b) All detected fugitive emissions and visible emissions shall be reported to the shift supervisor.

**IV. RECORDKEEPING REQUIREMENTS.****# 010 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain following:

1. VOC content of coatings and materials used will be determined.
2. Usage and emissions of VOC containing coatings, materials and clean-up solvents will be totaled on a monthly basis.
3. The monthly VOC total shall be added to the previous 11 months to determine the current consecutive 12-month totals.

[Authority for this condition is also derived in 25 Pa. Code Section 129.95.]

**# 011 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

(a) The permittee shall maintain a record of the weekly monitoring conducted to determine the presence of fugitive emissions and visible emissions.

(b) This recordkeeping shall contain a listing or notation of any and all sources of fugitive emissions and visible emissions, the cause of the fugitive emissions and visible emissions, duration of the emissions and the corrective action taken to abate the deviation and prevent future occurrences.

**# 012 [25 Pa. Code §127.512]****Operating permit terms and conditions.**

The permittee can modify the mixture of pollutants regulated under Section 112 of the Clean Air Act (42 U.S.C.A. 7412) which are VOC or PM10 so long as the emission limitations of this permit are not violated. The permittee shall keep a log which identifies the mixture of pollutants regulated under section 112 and report the changes in the mixture of pollutants regulated under Section 112 with the next report required to be provided to the Department.

**V. REPORTING REQUIREMENTS.****# 013 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) The owner or operator shall notify the Department by telephone within twenty-four (24) hours of the discovery of any malfunction which results in, or may possibly be resulting in, the emission of air contaminants in excess of any applicable limitation specified herein. Following the telephone notification, a written notice must also be submitted to DEP as specified below.

**SECTION C. Site Level Requirements**

1) If the owner or operator is unable to provide notification by telephone to the appropriate Regional Office within twenty-four (24) hours of discovery of a malfunction due to a weekend or holiday, the notification shall be made to the Department by no later than 4 p.m. on the first business day for the Department following the weekend or holiday.

2) Any malfunction that poses an imminent danger to the public health, safety, welfare, or environment shall be reported by telephone to the Department and the County Emergency Management Agency immediately after the discovery of an incident. The owner or operator shall submit a written report of instances of such malfunctions to the Department within three (3) business days of the telephone report.

3) Unless otherwise required by this plan approval, any other malfunctions shall be reported to the Department, in writing, within five (5) business days of malfunction discovery.

[Plan Approval 43-0182E]

**# 014 [25 Pa. Code §135.21]****Emission statements**

(a) The owner or operator of each stationary source emitting oxides of nitrogen or VOC's shall provide the Department with a statement, in a form as the Department may prescribe, for classes or categories of sources, showing the actual emissions of oxides of nitrogen and VOCs from that source for each reporting period, a description of the method used to calculate the emissions and the time period over which the calculation is based. The statement shall contain a certification by a company officer or the plant manager that the information contained in the statement is accurate.

(b) Annual emission statements are due by March 1 for the preceding calendar year beginning with March 1, 1993, for calendar year 1992 and shall provide data consistent with requirements and guidance developed by the EPA. The guidance document is available from: United States Environmental Protection Agency, 401 M. Street, S.W., Washington, D.C. 20460. The Department may require more frequent submittals if the Department determines that one or more of the following applies:

- (1) A more frequent submission is required by the EPA.
- (2) Analysis of the data on a more frequent basis is necessary to implement the requirements of the act.

**VI. WORK PRACTICE REQUIREMENTS.****# 015 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

- a) No source may operate unless its' associated control device is operating without malfunction.
- b) All reasonable actions, as determined by the Department, shall be taken to prevent fugitive particulate matter emissions.
- c) No fugitive air contaminant emissions shall be generated as a result of removing collected dust from a control device or as a result of subsequently handling the collected dust on-site following its removal from a control device.

[Plan Approval 43-00182E]

**# 016 [25 Pa. Code §129.14]****Open burning operations**

- (a) Not applicable
- (b) Outside of air basins. No person may permit the open burning of material in an area outside of air basins in a manner that:
  - (1) The emissions are visible, at any time, at the point such emissions pass outside the property of the person on whose land the open burning is being conducted.

**SECTION C. Site Level Requirements**

(2) Malodorous air contaminants from the open burning are detectable outside the property of the person on whose land the open burning is being conducted.

(3) The emissions interfere with the reasonable enjoyment of life or property.

(4) The emissions cause damage to vegetation or property.

(5) The emissions are or may be deleterious to human or animal health.

(c) Exceptions: The requirements of subsections (a) and (b) do not apply where the open burning operations result from:

(1) A fire set to prevent or abate a fire hazard, when approved by the Department and set by or under the supervision of a public officer.

(2) A fire set for the purpose of instructing personnel in fire fighting, when approved by the Department.

(3) A fire set for the prevention and control of disease or pests, when approved by the Department.

(4) Not applicable

(5) Not applicable

(6) A fire set solely for recreational or ceremonial purposes.

(7) A fire set solely for cooking food.

(d) Clearing and grubbing wastes. The following is applicable to clearing and grubbing wastes:

(1) As used in this subsection the following terms shall have the following meanings:

Air curtain destructor -- A mechanical device which forcefully projects a curtain of air across a pit in which open burning is being conducted so that combustion efficiency is increased and smoke and other particulate matter are contained.

Clearing and grubbing wastes -- Trees, shrubs, and other native vegetation which are cleared from land during or prior to the process of construction. The term does not include demolition wastes and dirt laden roots.

(2) Not applicable

(3) Subsection (b) notwithstanding clearing and grubbing wastes may be burned outside of an air basin, subject to the following limitations:

(i) Upon receipt of a complaint or determination by the Department that an air pollution problem exists, the Department may order that the open burning cease or comply with subsection (b) of this section.

(ii) Authorization for open burning under this paragraph does not apply to clearing and grubbing wastes transported from an air basin for disposal outside of an air basin.

(4) During an air pollution episode, open burning is limited by Chapter 137 (relating to air pollution episodes) and shall cease as specified in such chapter.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**SECTION C. Site Level Requirements****VIII. COMPLIANCE CERTIFICATION.**

The permittee shall submit within thirty days of 12/31/2010 a certificate of compliance with all permit terms and conditions set forth in this Title V permit as required under condition #026 of section B of this permit, and annually thereafter.

**IX. COMPLIANCE SCHEDULE.**

No compliance milestones exist.

**\*\*\* Permit Shield In Effect \*\*\***

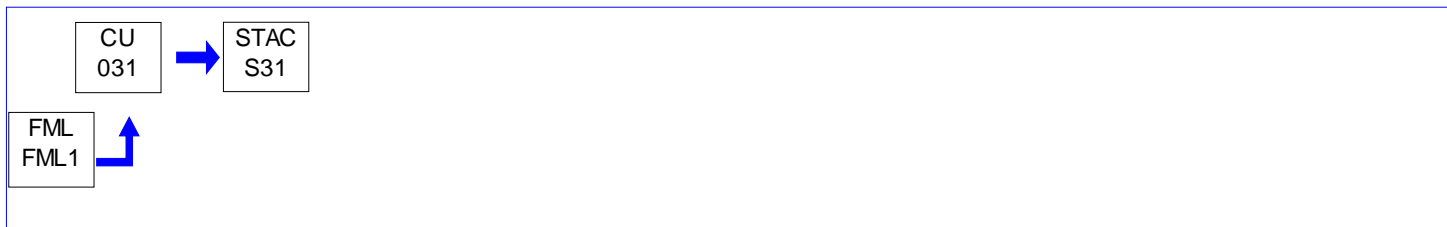
**SECTION D. Source Level Requirements**

Source ID: 031

Source Name: 600HP BOILER

Source Capacity/Throughput: 25.200 MMBTU/HR  
24.000 MCF/HR NATURAL GAS

Conditions for this source occur in the following groups: 1 BOILER PM & SOX EMISSION RESTRICTIONS  
8 VOC 129.96(C)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g) Not applicable.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source



**SECTION D. Source Level Requirements**

claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(i) The owner or operator of a combustion unit or process heater subject to § 129.112(b) shall record each adjustment conducted under the procedures in § 129.112(b). This record must contain, at a minimum:

- (1) The date of the tuning procedure.
- (2) The name of the service company and the technician performing the procedure.
- (3) The final operating rate or load.
- (4) The final NOx and CO emission rates.
- (5) The final excess oxygen rate.
- (6) Other information required by the applicable operating permit.

(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.****# 002 [25 Pa. Code §129.112]****Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(b) The owner and operator of a source listed in this subsection that is located at a major NOx emitting facility or major VOC emitting facility subject to § 129.111 shall comply with the applicable presumptive RACT requirements in paragraph (1) and recordkeeping and reporting requirements in paragraph (2).

(1) The owner or operator of a:

(i) Combustion unit or process heater with a rated heat input equal to or greater than 20 million Btu/hour and less than 50 million Btu/hour shall conduct a biennial tune-up in accordance with the procedures in 40 CFR 63.11223 (relating to how do I demonstrate continuous compliance with the work practice and management practice standards?).

(A) Each biennial tune-up shall occur not less than 3 months and not more than 24 months after the date of the previous tune-up.

(B) The biennial tune-up must include, at a minimum, the following:

(I) Inspection and cleaning or replacement of fuel-burning equipment, including the burners and components, as necessary, for proper operation as specified by the manufacturer.

(II) Inspection of the flame pattern and adjustment of the burner, as necessary, to optimize the flame pattern to minimize total emissions of NOx and, to the extent possible, emissions of CO.

**SECTION D. Source Level Requirements**

(III) Inspection and adjustment, as necessary, of the air-to-fuel ratio control system to ensure proper calibration and operation as specified by the manufacturer.

(ii) Not applicable.

(2) The applicable recordkeeping and reporting requirements of § 129.115(f) and (i) (relating to written notification, compliance demonstration and recordkeeping and reporting requirements).

(3) Compliance with the applicable presumptive RACT requirements in paragraph (1) and recordkeeping and reporting requirements in paragraph (2) assures compliance with the provisions in § 129.93(b)(2), (3), (4) and (5) and 129.97(b)(1), (2) and (3) (relating to presumptive RACT emissions limitations; and presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 032

Source Name: 400HP BOILER

Source Capacity/Throughput: 16.800 MMBTU/HR  
16.000 MCF/HR NATURAL GAS

Conditions for this source occur in the following groups: 1 BOILER PM & SOX EMISSION RESTRICTIONS  
8 VOC 129.96(C)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g) Not applicable.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source

**SECTION D. Source Level Requirements**

claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 002 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NOx emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1)-(3) Not applicable.

(4) A boiler or other combustion source with an individual rated gross heat input less than 20 million Btu/ hour.

(5)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 033

Source Name: 1000HP NAT. GAS FIRED BOILER

Source Capacity/Throughput: 42.000 MMBTU/HR

42.000 MCF/HR Natural Gas

Conditions for this source occur in the following groups: 1 BOILER PM &amp; SOX EMISSION RESTRICTIONS

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.622]****Compliance with general plan approvals and general operating permit conditions.**

The permittee may not permit to emit Nitrogen Oxides exceeding 30 ppmvd NO<sub>x</sub> at 3% O<sub>2</sub> when firing gas and CO exceeding 400 ppmvd CO at 3% O<sub>2</sub>.

**# 002 [25 Pa. Code §129.97]****Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule.**

The permittee shall limit the emissions of VOC from this source to less than 2.7 tons per year on a 12-month rolling total basis.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.****# 003 [25 Pa. Code §127.622]****Compliance with general plan approvals and general operating permit conditions.**

The permittee shall install and maintain the necessary meter to determine and to record amount of fuel usage.

**IV. RECORDKEEPING REQUIREMENTS.****# 004 [25 Pa. Code §127.622]****Compliance with general plan approvals and general operating permit conditions.**

The permittee shall maintain monthly fuel consumption records in accordance with 40 CFR 60.48c(g).

[Compliance with this streamlined permit conditions assures compliance with the requirement found in 40 CFR 60.48c(g)]

**# 005 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

**SECTION D. Source Level Requirements**

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g)-(h) Not applicable.

(i) The owner or operator of a combustion unit or process heater subject to § 129.112(b) shall record each adjustment conducted under the procedures in § 129.112(b). This record must contain, at a minimum:

(1) The date of the tuning procedure.

(2) The name of the service company and the technician performing the procedure.

(3) The final operating rate or load.

(4) The final NO<sub>x</sub> and CO emission rates.

(5) The final excess oxygen rate.

(6) Other information required by the applicable operating permit.

(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 006 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(b) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall comply with the applicable presumptive RACT requirements in paragraph (1) and recordkeeping and reporting requirements in paragraph (2).

(1) The owner or operator of a:

(i) Combustion unit or process heater with a rated heat input equal to or greater than 20 million Btu/hour and less than 50 million Btu/hour shall conduct a biennial tune-up in accordance with the procedures in 40 CFR 63.11223 (relating to how do I demonstrate continuous compliance with the work practice and management practice standards?).

(A) Each biennial tune-up shall occur not less than 3 months and not more than 24 months after the date of the previous tune-up.

**SECTION D. Source Level Requirements**

(B) The biennial tune-up must include, at a minimum, the following:

(I) Inspection and cleaning or replacement of fuel-burning equipment, including the burners and components, as necessary, for proper operation as specified by the manufacturer.

(II) Inspection of the flame pattern and adjustment of the burner, as necessary, to optimize the flame pattern to minimize total emissions of NO<sub>x</sub> and, to the extent possible, emissions of CO.

(III) Inspection and adjustment, as necessary, of the air-to-fuel ratio control system to ensure proper calibration and operation as specified by the manufacturer.

(ii) Not applicable.

(2) The applicable recordkeeping and reporting requirements of § 129.115(f) and (i) (relating to written notification, compliance demonstration and recordkeeping and reporting requirements).

(3) Compliance with the applicable presumptive RACT requirements in paragraph (1) and recordkeeping and reporting requirements in paragraph (2) assures compliance with the provisions in § § 129.93(b)(2), (3), (4) and (5) and 129.97(b)(1), (2) and (3) (relating to presumptive RACT emissions limitations; and presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule).

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1) Not applicable.

(2) A VOC air contamination source that has the potential to emit less than 2.7 TPY of VOC.

(3)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

**# 007 [25 Pa. Code §127.622]**

**Compliance with general plan approvals and general operating permit conditions.**

The permittee shall include the installation of low NO<sub>x</sub> burners, flue gas recirculation (FGR), combinations of these or other measures capable of meeting the emission limitations described in condition #003.

**\*\*\* Permit Shield in Effect. \*\*\***

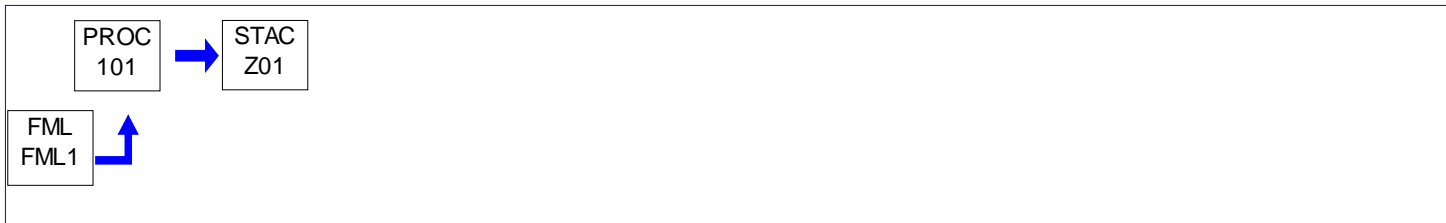
**SECTION D. Source Level Requirements**

Source ID: 101

Source Name: CONTINUOUS WELD FURNACE

Source Capacity/Throughput: 66.000 Tons/HR STEEL  
100.000 MCF/HR NATURAL GAS

Conditions for this source occur in the following groups: 9 SOURCE 101 ALT RACT II &amp; RACT III

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from any process in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**# 002 [25 Pa. Code §123.21]****General**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**# 003 [25 Pa. Code §129.97]****Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule.**

The permittee shall limit the emissions of VOC from this source to less than 2.7 tons per year on a 12-month rolling total basis.

**Fuel Restriction(s).****# 004 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall use only natural gas as a fuel for this source.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).



**SECTION D. Source Level Requirements****IV. RECORDKEEPING REQUIREMENTS.****# 005 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.****# 006 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain this source in accordance with the manufacturer's specification and good air pollution control practice.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***


**SECTION D. Source Level Requirements**

Source ID: 102

Source Name: #1 GALVANIZING KETTLE

Source Capacity/Throughput: 1.000 Tons/HR ZINC

Conditions for this source occur in the following groups: 10 SOURCE 102 ALT RACT II & RACT III  
4 GALVANIZING/BLOWDOWN PM RESTR

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***


**SECTION D. Source Level Requirements**

Source ID: 103

Source Name: #2 GALVANIZING KETTLE

Source Capacity/Throughput: 0.500 Tons/HR ZINC

Conditions for this source occur in the following groups: 11 SOURCE 103 ALT RACT II & RACT III  
4 GALVANIZING/BLOWDOWN PM RESTR

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

[Authorization from Plan Approval PA 43-182D]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The permittee shall monitor the following a minimum of once per day that the source and control device are in operation:

1. Pressure drop across the scrubber;
2. Scrubber liquid pressure and flow rate; and
3. Scrubber liquid pH.

[Authorization from Plan Approval PA 43-182D]

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

(a) Sufficient data shall be recorded, in a format approved by the Department, so that compliance with the conditions in this Operating Permit can be determined. All required records shall be maintained on site for a minimum of five (5) years, and shall be made available to Department personnel upon request.

(b) The permittee shall maintain a record of all preventative maintenance inspections of the control device. These records shall, at a minimum, contain the dates of the inspections, any problems or defects, the actions taken to correct the problems or defects, and any routine maintenance performed.

(c) The permittee shall maintain records of the operational inspections. These records shall, at a minimum, contain the following:

1. Pressure drop across the scrubber;
2. Scrubber liquid pressure and flow rate; and

**SECTION D. Source Level Requirements**

3. Scrubber liquid pH.

[Authorization from Plan Approval PA 43-182D]

**# 004 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

[Additional authority for the following requirements is provided by the FIRST MODIFICATION TO CONSENT ORDER AND AGREEMENT DATED JANUARY 4, 2021.]

Wheatland Tube shall maintain records of the preventative maintenance actions for Source ID C103, containing the dates of the actions performed, any problems or defects, the actions taken to correct the problems or defects, and any routine maintenance performed.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 005 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

(a) The permittee shall perform a weekly operational inspection of the control device.

(b) The permittee shall maintain and operate the source and control device in accordance with the manufacturer's specifications and in accordance with good air pollution control practices.

(c) The permittee shall operate the control device at all times that the source is in operation.

(d) The approved operating ranges for the scrubber are:

1. The scrubber pressure drop range shall be 9-14 inches of water
2. The scrubber liquid Inlet flow rate shall be 40 gallons per minute or greater. The scrubber liquid Upper flow rate shall be 40 gallons per minute or greater.
3. The scrubber liquid pH shall be 6-10.

[Authorization from Plan Approval PA 43-182D]

**# 006 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

The venturi scrubber pump shall operate at all times Source ID 103 operates. If the pump should be shutoff, for any reason, Source ID 103 shall not operate.

**# 007 [25 Pa. Code §127.441]**

**Operating permit terms and conditions.**

[Additional authority for the following requirements is provided by the FIRST MODIFICATION TO CONSENT ORDER AND AGREEMENT DATED JANUARY 4, 2021.]

Wheatland Tube shall perform the following preventative maintenance actions on Source ID C103:

Demist the scrubber three times per week.

Clean the scrubber each month including, but no limited to:

1. Remove the header pipe, dip in caustic, inspect pipe and spray tips prior to installation.
2. Remove header with nozzles at the 3" union, dip in caustic, inspect pipe and spray nozzles prior to installation.
3. Grease the main exhaust fan.



## SECTION D. Source Level Requirements

Clean the scrubber media and clean the scrubber every 6 months including, but not limited to:

1. Vacuum out the sump prior to cleaning.
2. Remove the media.
3. Pressure wash the interior of the scrubber from top to bottom.
4. Remove the head pipe, dip in caustic, inspect pipe and spray tips prior to installation.
5. Remove header pipe with nozzles at the 3" union, dip in caustic, inspect pipe and nozzle prior to installation.
6. Replace existing scrubber media with new scrubber media.
7. Vacuum out the sump.

### VII. ADDITIONAL REQUIREMENTS.

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 104


Source Name: FINISHING DEPT. COATING LINE

Source Capacity/Throughput:

20.000 Gal/HR

COATING

Conditions for this source occur in the following groups: 2 VOC LIMITS

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**


Source ID: 110

Source Name: #1 CHROMATE TREATMENT

Source Capacity/Throughput:

20.000 Tons/HR

GALV. STEEL PIPE

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.13]

**Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from any process in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**


Source ID: 111

Source Name: #2 CHROMATE TREATMENT

Source Capacity/Throughput:

12.000 Tons/HR

GALV. STEEL PIPE

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.13]

**Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from any process in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***




**SECTION D. Source Level Requirements**

Source ID: 112

Source Name: COUPLING DEPT

Source Capacity/Throughput:

0.500 Tons/HR

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.13]

**Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from any process .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

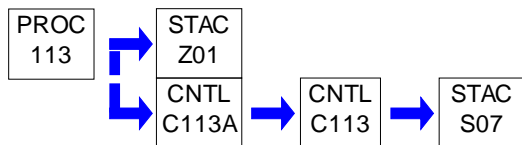
Source ID: 113

Source Name: #1 ID BLOW STATION

Source Capacity/Throughput:

12.000 Tons/HR

GAL. STEEL PIPE

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

- (a) Not applicable
- (b) Not applicable
- (c) For processes not listed in subsection (b)(1), including but not limited to, coke oven battery waste heat stacks and autogeneous zinc coker waste heat stacks, the following shall apply:
  - (1) Prohibited emissions. No person may permit the emission into the outdoor atmosphere of particulate matter from any process not listed in subsection (b)(1) in a manner that the concentration of particulate matter in the effluent gas exceeds any of the following:
    - (i) .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.
    - (ii) Not applicable
    - (iii) Not applicable
  - (2) Allowable emissions. Allowable emissions under this subsection are graphically indicated in Appendix C.
- (d) Not applicable

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The company shall monitor the pressure drop across the control device(s) at least once per day when the source is in operation.

[From: Plan approval # 43-182A, condition # 003]

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The company shall record sufficient data so that compliance with conditions of this Plan Approval can be determined.

**SECTION D. Source Level Requirements**

Records shall be kept for a minimum of five (5) years and shall be made available to the Department upon request.

(a) The permittee shall maintain a record of all preventive maintenance inspections of the control device. These records shall, at a minimum, contain the dates of the inspections, any problems or defects, the actions taken to correct the problem or defects, any routine maintenance performed, and the pressure drop across the control device.

(b) The permittee shall maintain a record of the date(s) of all control device bag replacements.

[Authorization from Plan Approval PA 43-182C]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

(a) The permittee shall install, maintain, and operate, at a convenient location, a magnehelic gauge, or equivalent, to measure pressure drop across the fabric collector.

(b) The permittee shall keep a minimum of 69 replacement bags for the fabric collector on site at all times.

(c) The permittee shall perform a monthly preventive maintenance inspection of the control device(s).

(d) The permittee shall operate the control device(s) at all times that this source is in operation.

(e) During the first 14 operational days following a bag replacement, the permittee shall maintain the pressure drop across the fabric collector at all times between 1.2" and 8" water, gauge when the source and control device are in operation.

(f) At all other times, the permittee shall maintain the pressure drop across the fabric collector between 2" and 8" water, gauge when the source and control device are in operation. If this range must be modified to allow for correct operation of the control device, such changes shall be submitted to and approved by the Department.

(g) The permittee shall install, maintain, and operate this source and the control device in accordance with the manufacturer's specifications and good air pollution control practices.

[Authorization from Plan Approval PA 43-182C]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

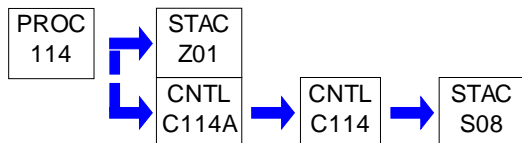
**SECTION D. Source Level Requirements**

Source ID: 114

Source Name: #2 ID BLOW STATION

Source Capacity/Throughput: 12.000 Tons/HR GALV.STEEL PIPE

Conditions for this source occur in the following groups: 3 BLOWDOWN REQUIREMENTS  
4 GALVANIZING/BLOWDOWN PM RESTR

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from this source in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

[Authorization from Plan Approval PA 43-182C]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The company shall monitor the pressure drop across the control device(s) at least once per day when the source is in operation.

[Authorization from Plan Approval PA 43-182C]

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The company shall record sufficient data so that compliance with conditions of this Operating Permit can be determined. Records shall be kept for a minimum of five (5) years and shall be made available to the Department upon request.

(a) The permittee shall maintain a record of all preventive maintenance inspections of the control device. These records shall, at a minimum, contain the dates of the inspections, any problems or defects, the actions taken to correct the problem or defects, any routine maintenance performed, and the pressure drop across the control device.

(b) The permittee shall maintain a record of the date(s) of all control device bag replacements.

[Authorization from Plan Approval PA 43-182C]

**SECTION D. Source Level Requirements****V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

- (a) The permittee shall install, maintain, and operate, at a convenient location, a magnehelic gauge, or equivalent, to measure pressure drop across the fabric collector.
- (b) The permittee shall keep a minimum of 56 replacement bags for the fabric collector on site at all times.
- (c) The permittee shall perform a monthly preventive maintenance inspection of the control device(s).
- (d) The permittee shall operate the control device(s) at all times that this source is in operation.
- (e) During the first 14 operational days following a bag replacement, the permittee shall maintain the pressure drop across the fabric collector at all times between 1.2" and 8" water, gauge when the source and control device are in operation.
- (f) At all other times, the permittee shall maintain the pressure drop across the fabric collector between 2" and 8" water, gauge when the source and control device are in operation. If this range must be modified to allow for correct operation of the control device, such changes shall be submitted to and approved by the Department.
- (g) The permittee shall install, maintain, and operate this source and the control device in accordance with the manufacturer's specifications and good air pollution control practices.

[Authorization from Plan Approval PA 43-182C]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 115


Source Name: #1 PM THREADER

Source Capacity/Throughput:

0.300 Gal/HR

COATING

Conditions for this source occur in the following groups: 7 THREADER VOC REQ5

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**


Source ID: 120

Source Name: CONDUIT LINE ZINC METALLIZER

Source Capacity/Throughput:

25.000 Lbs/HR

ZINC

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) The filterable particulate matter emissions in the exhaust of the control device shall not exceed 0.01 grains per dry standard cubic foot of effluent gas.

b) There shall be no visible air contaminant emissions from the exhaust of the control device.

[Plan Approval 43-0182E]

**II. TESTING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) The Department reserves the right to require testing in the future if it deems testing is warranted. This decision shall be made at the Department's sole discretion.

[Plan Approval 43-0182E]

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) All logs and required records shall be maintained on site for a minimum of five years and shall be made available to the Department upon request.

b) The permittee shall record the following operational data from the control device (these records may be done with strip charts recorders, data acquisition systems, or manual log entries):

(1) Pressure differential - daily defined as once per calendar day

Manual log entries shall include the following:

(1) Time and date of observation

(2) Name, title, and signature of the person making the observation

(3) Any corrective action taken as result of the observation

c) The permittee shall maintain a quarterly inventory of the number of spare filter cartridges onsite.

d) The total monthly amount of zinc consumed by this source shall be maintained.

**SECTION D. Source Level Requirements**

- e) The total monthly amount of zinc removed from the control device shall be maintained.
- f) All maintenance and inspections performed on the source shall be recorded in a log. This record shall, at a minimum, include:
- (1) Time and date of maintenance / inspections
  - (2) Name, title, and signature of the person performing the maintenance / inspections
  - (3) A detailed description of the maintenance / inspections
  - (4) Any corrective action taken as result of the maintenance / inspections

[Plan Approval 43-0182E]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

- a) All gauges employed shall have a scale such that the expected normal reading shall be no less than twenty percent (20%) of full scale and be accurate within plus or minus two percent (+/- 2%) of full scale reading. The permittee shall maintain and operate the following:
- (1) A magnehelic gauge or equivalent to measure the pressure differential across the filter media.
- b) The permittee shall maintain and operate the source and control device in accordance with the manufacturer's specifications and in accordance with good air pollution control practices. The manufacturer's operational and maintenance literature shall be maintained onsite.
- c) The permittee shall perform preventative maintenance inspection of the control device including, but not limited to, the following:
- (1) A quarterly visual inspection of the control device interior for dislodged cartridges, filter media wear, and dust build-up inside the control device.
  - (2) A weekly visible inspection of the control device effluent for the presence of visible emissions.
  - (3) A daily reading and recording of the pressure differential across the filter media.
  - (4) All other maintenance activities which shall be performed on the control device at the frequency recommended by the manufacturer.
- d) The owner or operator shall keep sufficient quantity of spare cartridges, at a minimum of 20% of the total number of cartridges, on hand for immediate replacement.

[Plan Approval 43-0182E]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***



**SECTION D. Source Level Requirements**


Source ID: 121

Source Name: CONDUIT THREADER

Source Capacity/Throughput:

0.050 Gal/HR

COATING

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The permittee shall not use steel gard oil or equivalent which has a VOC content of greater than 10.34 lbs VOC per gallon.

[Plan Approval 43-0182E]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

The permittee shall keep the following record of VOC content in the steel gard oil.

- (a) The gallons of steel gard oil or equivalent used per month.
- (b) VOC content of steel gard oil or equivalent.
- (c) Material safety data sheets or other certification from the manufacturer of VOC content in the steel gard oil or equivalent.

[Plan Approval 43-0182E]

**# 003 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent

**SECTION D. Source Level Requirements**

with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1) Not applicable.

(2) A VOC air contamination source that has the potential to emit less than 2.7 TPY of VOC.

(3)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***


**SECTION D. Source Level Requirements**

Source ID: 133

Source Name: #1 GALVANIZING FURNACE

Source Capacity/Throughput:	12.000 Tons/HR	GALV. STEEL PIPE
	N/A	Natural Gas

Conditions for this source occur in the following groups: 6 GALVANIZING FURNACE REQS  
8 VOC 129.96(C)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g) Not applicable.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air

**SECTION D. Source Level Requirements**

contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 002 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1)-(3) Not applicable.

(4) A boiler or other combustion source with an individual rated gross heat input less than 20 million Btu/ hour.

(5)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 134

Source Name: #2 GALVANIZING FURNACE

Source Capacity/Throughput:


N/A

Natural Gas

12.000 Tons/HR

GALV. STEEL PIPE

Conditions for this source occur in the following groups: 6 GALVANIZING FURNACE REQS  
8 VOC 129.96(C)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

(g) Not applicable.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air

**SECTION D. Source Level Requirements**

contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 002 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1)-(3) Not applicable.

(4) A boiler or other combustion source with an individual rated gross heat input less than 20 million Btu/ hour.

(5)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 137


Source Name: MISC HEATERS

Source Capacity/Throughput:

26.260 MCF/HR

Natural Gas

Conditions for this source occur in the following groups: 8 VOC 129.96(C)

**I. RESTRICTIONS.****Fuel Restriction(s).**

# 001 [25 Pa. Code §127.511]

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall use only natural gas for this source.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.**

# 002 [25 Pa. Code §127.511]

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall keep a record of natural gas consumption per month. The present month consumption shall be added with previous 11 month period to get 12-month rolling total.

# 003 [25 Pa. Code §129.115]

**Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating permit or plan approval for the air contamination source.

**SECTION D. Source Level Requirements**

(g) Not applicable.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1)-(3) Not applicable.

(4) A boiler or other combustion source with an individual rated gross heat input less than 20 million Btu/ hour.

(5)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***




**SECTION D. Source Level Requirements**

Source ID: 138

Source Name: MISC. PARTS WASHERS

Source Capacity/Throughput:

N/A

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain a record of the VOC emissions from all parts washers, using a volatile organic solvent, on a monthly basis. This monthly VOC total shall be added to the monthly total for the entire facility to demonstrate compliance with the facility wide VOC limit.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 002 [25 Pa. Code §129.63]****Degreasing operations**

(a) Cold cleaning machines. Except for those subject to the Federal National emissions standards for hazardous air pollutants (NESHAP) for halogenated solvent cleaners under 40 CFR Part 63 (relating to National emission standards for hazardous air pollutants for source categories), this subsection applies to cold cleaning machines that use 2 gallons or more of solvents containing greater than 5% VOC content by weight for the cleaning of metal parts.

(1) Immersion cold cleaning machines shall have a freeboard ratio of 0.50 or greater.

(2) Immersion cold cleaning machines and remote reservoir cold cleaning machines shall:

(i) Have a permanent, conspicuous label summarizing the operating requirements in paragraph (3). In addition, the label shall include the following discretionary good operating practices:

(A) Cleaned parts should be drained at least 15 seconds or until dripping ceases, whichever is longer. Parts having cavities or blind holes shall be tipped or rotated while the part is draining. During the draining, tipping or rotating, the parts should be positioned so that solvent drains directly back to the cold cleaning machine.

**SECTION D. Source Level Requirements**

(B) When a pump-agitated solvent bath is used, the agitator should be operated to produce a rolling motion of the solvent with no observable splashing of the solvent against the tank walls or the parts being cleaned.

(C) Work area fans should be located and positioned so that they do not blow across the opening of the degreaser unit.

(ii) Be equipped with a cover that shall be closed at all times except during cleaning of parts or the addition or removal of solvent. For remote reservoir cold cleaning machines which drain directly into the solvent storage reservoir, a perforated drain with a diameter of not more than 6 inches shall constitute an acceptable cover.

(3) Cold cleaning machines shall be operated in accordance with the following procedures:

(i) Waste solvent shall be collected and stored in closed containers. The closed containers may contain a device that allows pressure relief, but does not allow liquid solvent to drain from the container.

(ii) Flushing of parts using a flexible hose or other flushing device shall be performed only within the cold cleaning machine. The solvent spray shall be a solid fluid stream, not an atomized or shower spray.

(iii) Sponges, fabric, wood, leather, paper products and other absorbent materials may not be cleaned in the cold cleaning machine.

(iv) Air agitated solvent baths may not be used.

(v) Spills during solvent transfer and use of the cold cleaning machine shall be cleaned up immediately.

(4) After December 22, 2002, a person may not use, sell or offer for sale for use in a cold cleaning machine any solvent with a vapor pressure of 1.0 millimeter of mercury (mm Hg) or greater and containing greater than 5% VOC by weight, measured at 20°C (68°F) containing VOCs.

(5) On and after December 22, 2002, a person who sells or offers for sale any solvent containing VOCs for use in a cold cleaning machine shall provide, to the purchaser, the following written information:

(i) The name and address of the solvent supplier.

(ii) The type of solvent including the product or vendor identification number.

(iii) The vapor pressure of the solvent measured in mm hg at 20°C (68°F).

(6) A person who operates a cold cleaning machine shall maintain for at least 2 years and shall provide to the Department, on request, the information specified in paragraph (5). An invoice, bill of sale, certificate that corresponds to a number of sales, Material Safety Data Sheet (MSDS), or other appropriate documentation acceptable to the Department may be used to comply with this section.

(7) Paragraph (4) does not apply:

(i) To cold cleaning machines used in extreme cleaning service.

(ii) If the owner or operator of the cold cleaning machine demonstrates, and the Department approves in writing, that compliance with paragraph (4) will result in unsafe operating conditions.

(iii) To immersion cold cleaning machines with a freeboard ratio equal to or greater than 0.75.

(b) -(e) : Not Applicable.

**SECTION D. Source Level Requirements****VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**


Source ID: 140

Source Name: LIME SILO

Source Capacity/Throughput:

N/A

LIME

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §123.13]

**Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from this process in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

# 002 [25 Pa. Code §127.511]

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain a record of all preventive maintenance inspections of the control device. These records shall, at a minimum, contain the dates of the inspections, any problems or defects, the actions taken to correct the problem or defects, and any routine maintenance performed.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

# 003 [25 Pa. Code §127.511]

**Monitoring and related recordkeeping and reporting requirements.**

(a) The permittee shall perform a preventive maintenance inspection of the control devices when the source and control device are in operation.

(b) The permittee shall perform a visible emission observation when the source and control device are in operation to monitor for the presence of any opacity from the stack. If any opacity is observed, the facility shall investigate the cause of the opacity and record the corrective actions taken.

(c) The permittee shall operate the control devices at all times that this source is in operation.

**SECTION D. Source Level Requirements**

(d) The permittee shall maintain and operate these sources and the control devices in accordance with the manufacturer's specifications.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 143


Source Name: ONE WASTE OIL SPACE HEATER

Source Capacity/Throughput: 0.350 MMBTU/HR

2.000 Gal/HR

Reclaimed Oil

Conditions for this source occur in the following groups: 8 VOC 129.96(C)

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

No person may permit the emission into the outdoor atmosphere of particulate matter from any process in a manner that the concentration of particulate matter in the effluent gas exceeds 0.04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**# 002 [25 Pa. Code §123.21]****General**

No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(f) Not applicable.

(g) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable NO<sub>x</sub> emission rate threshold specified in § 129.114(b) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

**SECTION D. Source Level Requirements**

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §127.511]**

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain and operate this equipment in accordance with the manufacturer's specifications/and good operating practices.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***


**SECTION D. Source Level Requirements**

Source ID: 144

Source Name: NATURAL GAS FUELED EMERGENCY GENERATORS (116 HP AND 450 HP)

Source Capacity/Throughput: 19,285.000 CF/HR NATURAL GAS

Conditions for this source occur in the following groups: 5 PART 63 SUBPART ZZZZ

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

(a)-(b) Not applicable.

(c) For processes not listed in subsection (b)(1), including but not limited to, coke oven battery waste heat stacks and autogeneous zinc coker waste heat stacks, the following shall apply:

(1) Prohibited emissions. No person may permit the emission into the outdoor atmosphere of particulate matter from any process not listed in subsection (b)(1) in a manner that the concentration of particulate matter in the effluent gas exceeds any of the following:

(i) .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

(ii)-(iii) Not applicable.

(2) Not applicable.

(d) Not applicable.

**# 002 [25 Pa. Code §123.21]****General**

(a) This section applies to sources except those subject to other provisions of this article, with respect to the control of sulfur compound emissions.

(b) No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).



**SECTION D. Source Level Requirements****IV. RECORDKEEPING REQUIREMENTS.****# 003 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall maintain a record of NOx emission from 450 HP emergency generator in terms of tons per year in ozone season and 12-month rolling total.

**# 004 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(f) Not applicable.

(g) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable NOx emission rate threshold specified in § 129.114(b) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.****# 005 [25 Pa. Code §127.441]****Operating permit terms and conditions.**

The permittee shall keep the NOx emission record for 450 HP emergency generator engine in terms of tons per year in ozone season and 12-month rolling total at site for reporting.

**VI. WORK PRACTICE REQUIREMENTS.****# 006 [25 Pa. Code §129.97]****Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule.**

(c) The owner and operator of a source specified in this subsection, which is located at a major NOx emitting facility or major VOC emitting facility subject to § 129.96 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

(1) - (4) Not applicable.

(5) A stationary internal combustion engine rated at less than 500 bhp (gross).

(6) - (8) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements) and/or Section E (Source Group Restrictions).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**


Source ID: 145

Source Name: SULFURIC ACID PICKLING

Source Capacity/Throughput:

24.120 Tons/HR

STEEL

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §129.97]****Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule.**

The permittee shall limit the emissions of VOC from this source to less than 2.7 tons per year on a 12-month rolling total basis.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [25 Pa. Code §129.100]****Compliance demonstration and recordkeeping requirements.**

The facility shall keep a record of the quantity of Activol used each year to ensure the maximum quantity does not exceed 1,925 gallons per year which was used to calculate the potential VOC emissions of less than 2.7 TPY. The facility shall also keep the calculation provided with the RACT 2 Presumptive Minor Permit Modification to demonstrate compliance with the 2.7 TPY limit.

**# 003 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(e) Not applicable.

(f) The owner and operator of an air contamination source subject to this section and § § 129.111—129.114 shall keep records to demonstrate compliance with § § 129.111—129.114 and submit reports to the Department or appropriate approved local air pollution control agency in accordance with the applicable regulations in 25 Pa. Code, Part I, Subpart C, Article III (relating to air resources) and as specified in the operating permit or plan approval for the air contamination source as follows:

(1) The records shall include sufficient data and calculations to demonstrate that the requirements of § § 129.111—129.114 are met.

(2) Data or information required to determine compliance shall be recorded and maintained in a time frame consistent with the averaging period of the requirement.

(3) The records necessary to determine compliance shall be reported to the Department or appropriate approved local air pollution control agency on a schedule specified in the applicable regulation or as otherwise specified in the operating

**SECTION D. Source Level Requirements**

permit or plan approval for the air contamination source.

(g)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 004 [25 Pa. Code §129.112]**

**Presumptive RACT requirements, RACT emission limitations and petition for alternative compliance schedule**

(c) The owner and operator of a source listed in this subsection that is located at a major NO<sub>x</sub> emitting facility or major VOC emitting facility subject to § 129.111 shall install, maintain and operate the source in accordance with the manufacturer's specifications and with good operating practices:

- (1) Not applicable.
- (2) A VOC air contamination source that has the potential to emit less than 2.7 TPY of VOC.
- (3)-(11) Not applicable.

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).


**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION D. Source Level Requirements**

Source ID: 146

Source Name: 100KW NATURAL GAS EMERGENCY GENERATOR (134 HP)

Source Capacity/Throughput: 19,285.000 CF/HR Natural Gas

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

(a)-(b) Not applicable.

(c) For processes not listed in subsection (b)(1), including but not limited to, coke oven battery waste heat stacks and autogeneous zinc coker waste heat stacks, the following shall apply:

(1) Prohibited emissions. No person may permit the emission into the outdoor atmosphere of particulate matter from any process not listed in subsection (b)(1) in a manner that the concentration of particulate matter in the effluent gas exceeds any of the following:

(i) .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

(ii)-(iii) Not applicable.

(2) Not applicable.

(d) Not applicable.

**# 002 [25 Pa. Code §123.21]****General**

(a) This section applies to sources except those subject to other provisions of this article, with respect to the control of sulfur compound emissions.

(b) No person may permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**# 003 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4233]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What emission standards must I meet if I am an owner or operator of a stationary SI internal combustion engine?**

(a)-(d) Not applicable.

(e) Owners and operators of stationary SI ICE with a maximum engine power greater than or equal to 75 KW (100 HP) (except gasoline and rich burn engines that use LPG) must comply with the emission standards in Table 1 to this subpart for their stationary SI ICE. (omitted non applicable language)

(f)-(g) Not applicable.

(h) Owners and operators of stationary SI ICE that are required to meet standards that reference 40 CFR 1048.101 must, if testing their engines in use, meet the standards in that section applicable to field testing, except as indicated in paragraph (e) of this section.

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37973, June 28, 2011]

**SECTION D. Source Level Requirements**

-----  
 Table 1 to Subpart JJJJ of Part 60—NO<sub>x</sub>, CO, and VOC Emission Standards for Stationary Non-Emergency SI Engines =100 HP (Except Gasoline and Rich Burn LPG), Stationary SI Landfill/Digester Gas Engines, and Stationary Emergency Engines >25 HP

Emergency Engines equal to or great than 130 HP must meet Emission Standards(a):

Emissions	g/HP-hr	ppmvd at 15% O <sub>2</sub>
NO <sub>x</sub>	2.0	160
CO	4.0	540
VOC(d)	1.0	86

(a) Owners and operators of stationary non-certified SI engines may choose to comply with the emission standards in units of either g/HP-hr or ppmvd at 15 percent O<sub>2</sub>.

(b)-(c) Not applicable.

(d) For purposes of this subpart, when calculating emissions of volatile organic compounds, emissions of formaldehyde should not be included.

[76 FR 37975, June 28, 2011]

**II. TESTING REQUIREMENTS.**

**# 004 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4244]  
 Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines  
 What test methods and other procedures must I use if I am an owner or operator of a stationary SI internal combustion engine?**

Owners and operators of stationary SI ICE who conduct performance tests must follow the procedures in paragraphs (a) through (f) of this section.

(a) Each performance test must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and according to the requirements in §60.8 and under the specific conditions that are specified by Table 2 to this subpart.

(b) You may not conduct performance tests during periods of startup, shutdown, or malfunction, as specified in §60.8(c). If your stationary SI internal combustion engine is non-operational, you do not need to startup the engine solely to conduct a performance test; however, you must conduct the performance test immediately upon startup of the engine.

(c) You must conduct three separate test runs for each performance test required in this section, as specified in §60.8(f). Each test run must be conducted within 10 percent of 100 percent peak (or the highest achievable) load and last at least 1 hour.

(d) To determine compliance with the NO<sub>x</sub> mass per unit output emission limitation, convert the concentration of NO<sub>x</sub> in the engine exhaust using Equation 1 of this section:

[See 40 CFR §60.4244 for equation, factors, and units]

(e) To determine compliance with the CO mass per unit output emission limitation, convert the concentration of CO in the engine exhaust using Equation 2 of this section:

[See 40 CFR §60.4244 for equation, factors, and units]

(f) For purposes of this subpart, when calculating emissions of VOC, emissions of formaldehyde should not be included. To determine compliance with the VOC mass per unit output emission limitation, convert the concentration of VOC in the

**SECTION D. Source Level Requirements**

engine exhaust using Equation 3 of this section:

[See 40 CFR §60.4244 for equation, factors, and units]

(g) If the owner/operator chooses to measure VOC emissions using either Method 18 of 40 CFR part 60, appendix A, or Method 320 of 40 CFR part 63, appendix A, then it has the option of correcting the measured VOC emissions to account for the potential differences in measured values between these methods and Method 25A. The results from Method 18 and Method 320 can be corrected for response factor differences using Equations 4 and 5 of this section. The corrected VOC concentration can then be placed on a propane basis using Equation 6 of this section.

[See 40 CFR §60.4244 for equation, factors, and units]

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 005 [25 Pa. Code §129.115]****Written notification, compliance demonstration and recordkeeping and reporting requirements**

(a) [Notification received December 27, 2022]

(b)-(f) Not applicable.

(g) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable NO<sub>x</sub> emission rate threshold specified in § 129.114(b) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(h) Beginning with the compliance date specified in § 129.112(a), the owner or operator of an air contamination source claiming that the air contamination source is exempt from the applicable VOC emission rate threshold specified in § 129.114(c) and the requirements of § 129.112 based on the air contamination source's potential to emit shall maintain records that demonstrate to the Department or appropriate approved local air pollution control agency that the air contamination source is not subject to the specified emission rate threshold.

(i)-(j) Not applicable.

(k) The records shall be retained by the owner or operator for 5 years and made available to the Department or appropriate approved local air pollution control agency upon receipt of a written request from the Department or appropriate approved local air pollution control agency.

**# 006 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4245]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What are my notification, reporting, and recordkeeping requirements if I am an owner or operator of a stationary SI internal combustion engine?**

Owners or operators of stationary SI ICE must meet the following notification, reporting and recordkeeping requirements.

(a) Owners and operators of all stationary SI ICE must keep records of the information in paragraphs (a)(1) through (4) of this section.

(1) All notifications submitted to comply with this subpart and all documentation supporting any notification.

(2) Maintenance conducted on the engine.

**SECTION D. Source Level Requirements**

(3) If the stationary SI internal combustion engine is a certified engine, documentation from the manufacturer that the engine is certified to meet the emission standards and information as required in 40 CFR parts 90, 1048, 1054, and 1060, as applicable.

(4) If the stationary SI internal combustion engine is not a certified engine or is a certified engine operating in a non-certified manner and subject to §60.4243(a)(2), documentation that the engine meets the emission standards.

(b)-(c) Not applicable.

(d) Owners and operators of stationary SI ICE that are subject to performance testing must submit a copy of each performance test as conducted in §60.4244 within 60 days after the test has been completed. Performance test reports using EPA Method 18, EPA Method 320, or ASTM D6348-03 (incorporated by reference—see 40 CFR 60.17) to measure VOC require reporting of all QA/QC data. For Method 18, report results from sections 8.4 and 11.1.1.4; for Method 320, report results from sections 8.6.2, 9.0, and 13.0; and for ASTM D6348-03 report results of all QA/QC procedures in Annexes 1-7.

(e) Not applicable.

[73 FR 3591, Jan. 18, 2008, as amended at 73 FR 59177, Oct. 8, 2008; 78 FR 6697, Jan. 30, 2013; 81 FR 59809, Aug. 30, 2016]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 007 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4243]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What are my compliance requirements if I am an owner or operator of a stationary SI internal combustion engine?**

(a) If you are an owner or operator of a stationary SI internal combustion engine that is manufactured after July 1, 2008, and must comply with the emission standards specified in §60.4233(a) through (c), you must comply by purchasing an engine certified to the emission standards in §60.4231(a) through (c), as applicable, for the same engine class and maximum engine power. In addition, you must meet one of the requirements specified in (a)(1) and (2) of this section.

(1) If you operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, you must keep records of conducted maintenance to demonstrate compliance, but no performance testing is required if you are an owner or operator. You must also meet the requirements as specified in 40 CFR part 1068, subparts A through D, as they apply to you. If you adjust engine settings according to and consistent with the manufacturer's instructions, your stationary SI internal combustion engine will not be considered out of compliance.

(2) If you do not operate and maintain the certified stationary SI internal combustion engine and control device according to the manufacturer's emission-related written instructions, your engine will be considered a non-certified engine, and you must demonstrate compliance according to (a)(2)(i) through (iii) of this section, as appropriate.

(i) Not applicable.

(ii) If you are an owner or operator of a stationary SI internal combustion engine greater than or equal to 100 HP and less than or equal to 500 HP, you must keep a maintenance plan and records of conducted maintenance and must, to the extent practicable, maintain and operate the engine in a manner consistent with good air pollution control practice for minimizing emissions. In addition, you must conduct an initial performance test within 1 year of engine startup to demonstrate compliance.

(iii) Not applicable.

**SECTION D. Source Level Requirements**

(b) If you are an owner or operator of a stationary SI internal combustion engine and must comply with the emission standards specified in §60.4233(d) or (e), you must demonstrate compliance according to one of the methods specified in paragraphs (b)(1) and (2) of this section.

(1) Purchasing an engine certified according to procedures specified in this subpart, for the same model year and demonstrating compliance according to one of the methods specified in paragraph (a) of this section.

(2) Not applicable.

(c) Not applicable.

(d) If you own or operate an emergency stationary ICE, you must operate the emergency stationary ICE according to the requirements in paragraphs (d)(1) through (3) of this section. In order for the engine to be considered an emergency stationary ICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (d)(1) through (3) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (d)(1) through (3) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary ICE in emergency situations.

(2) You may operate your emergency stationary ICE for any combination of the purposes specified in paragraphs (d)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraph (d)(3) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (d)(2).

(i) Emergency stationary ICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency ICE beyond 100 hours per calendar year.

(ii)-(iii) [VACATED]

(3) Emergency stationary ICE may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (d)(2) of this section. Except as provided in paragraph (d)(3)(i) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) Not applicable.

(ii) [Reserved]

(e) Not applicable.

(f) If you are an owner or operator of a stationary SI internal combustion engine that is less than or equal to 500 HP and you purchase a non-certified engine or you do not operate and maintain your certified stationary SI internal combustion engine and control device according to the manufacturer's written emission-related instructions, you are required to perform initial performance testing as indicated in this section, but you are not required to conduct subsequent performance testing unless the stationary engine is rebuilt or undergoes major repair or maintenance. A rebuilt stationary SI ICE means an engine that has been rebuilt as that term is defined in 40 CFR 94.11(a).

(g) It is expected that air-to-fuel ratio controllers will be used with the operation of three-way catalysts/non-selective catalytic



**SECTION D. Source Level Requirements**

reduction. The AFR controller must be maintained and operated appropriately in order to ensure proper operation of the engine and control device to minimize emissions at all times.

(h)-(i) Not applicable.

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37974, June 28, 2011; 78 FR 6697, Jan. 30, 2013]

**VII. ADDITIONAL REQUIREMENTS.****# 008 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4230]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****Am I subject to this subpart?**

(a) The provisions of this subpart are applicable to manufacturers, owners, and operators of stationary spark ignition (SI) internal combustion engines (ICE) as specified in paragraphs (a)(1) through (6) of this section. For the purposes of this subpart, the date that construction commences is the date the engine is ordered by the owner or operator.

(1)-(3) Not applicable.

(4) Owners and operators of stationary SI ICE that commence construction after June 12, 2006, where the stationary SI ICE are manufactured:

(i)-(iii) Not applicable.

(iv) on or after January 1, 2009, for emergency engines with a maximum engine power greater than 19 KW (25 HP).

(5) Not applicable.

(b)-(f) Not applicable.

[73 FR 3591, Jan. 18, 2008, as amended at 76 FR 37972, June 28, 2011]

**# 009 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4234]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****How long must I meet the emission standards if I am an owner or operator of a stationary SI internal combustion engine?**

Owners and operators of stationary SI ICE must operate and maintain stationary SI ICE that achieve the emission standards as required in §60.4233 over the entire life of the engine.

**# 010 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4236]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What is the deadline for importing or installing stationary SI ICE produced in the previous model year?**

(a) After July 1, 2010, owners and operators may not install stationary SI ICE with a maximum engine power of less than 500 HP that do not meet the applicable requirements in §60.4233.

(b) Not applicable.

(c) For emergency stationary SI ICE with a maximum engine power of greater than 19 KW (25 HP), owners and operators may not install engines that do not meet the applicable requirements in §60.4233 after January 1, 2011.

(d)-(e) Not applicable.

**# 011 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4237]****Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines****What are the monitoring requirements if I am an owner or operator of an emergency stationary SI internal combustion engine?**

(a) Not applicable.

**SECTION D. Source Level Requirements**

(b) Starting on January 1, 2011, if the emergency stationary SI internal combustion engine that is greater than or equal to 130 HP and less than 500 HP that was built on or after January 1, 2011, does not meet the standards applicable to non-emergency engines, the owner or operator must install a non-resettable hour meter.

(c) Not applicable.

**# 012 [40 CFR Part 60 Standards of Performance for New Stationary Sources §40 CFR 60.4246]  
Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines  
What parts of the General Provisions apply to me?**

Table 3 to this subpart shows which parts of the General Provisions in §§60.1 through 60.19 apply to you.

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 1 BOILER PM &amp; SOX EMISSION RESTRICTIONS

Group Description: BOILERS / GALVANIZING FURNACES

Sources included in this group

ID	Name
031	600HP BOILER
032	400HP BOILER
033	1000HP NAT. GAS FIRED BOILER

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.11]****Combustion units**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from a combustion unit in excess of 0.4 pound per million Btu of heat input.

**# 002 [25 Pa. Code §123.22]****Combustion units**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides, expressed as SO<sub>2</sub>, from a combustion unit in excess of the rate of 4 pounds per million Btu of heat input over any 1-hour period.

[ Compliance with the requirement specified in this streamlined permit condition assures compliance with the provisions in(40 CFR section 50.2020(c)(1))

**Fuel Restriction(s).****# 003 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall use only natural gas as a combustion fuel.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 004 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain and operate this equipment in accordance with the manufacturer's specifications/and good operating practices.

**SECTION E. Source Group Restrictions.****VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 10 SOURCE 102 ALT RACT II & RACT III

Group Description: Source 102 (#1 Galvanizing Kettle) Alternate RACT II and RACT III requirements amended from §

Sources included in this group

ID	Name
102	#1 GALVANIZING KETTLE

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

Emissions of NO<sub>x</sub> from Source 102 shall not exceed:

- 1) 3.97 lb/hr
- 2) 17.41 tpy (in any 12 consecutive month period).

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) All maintenance (i.e., routing and/or preventative maintenance, repairs, adjustments, parts replacements, calibrations, etc.) and inspections performed shall be recorded in a log. These records shall contain, at a minimum, the following:

- 1) The date of the maintenance/inspection.
- 2) The type of maintenance/inspection performed.
- 3) A detailed description of the maintenance/inspection.
- 4) Name, title, and initials of the individual performing the maintenance/inspection.

b) The owner or operator of the facility shall keep records which clearly verify compliance with this source's emission restrictions. The owner or operator shall perform monthly calculations to demonstrate compliance with the emission restrictions of this source. These calculations shall include the twelve (12) month rolling total emissions of NO<sub>x</sub> (tpy).

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) The owner or operator shall perform an annual source inspection and a burner tune up (occurring at a minimum of once in any consecutive 12 month period).

**SECTION E. Source Group Restrictions.**

b) All burners shall undergo maintenance as needed to ensure proper tuning and air-fuel ratios. The burners shall be inspected monthly at a minimum.

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 11 SOURCE 103 ALT RACT II &amp; RACT III

Group Description: Source 103 (#2 Galvanizing Kettle) Alternate RACT II and RACT III requirements amended from p

Sources included in this group

ID	Name
103	#2 GALVANIZING KETTLE

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

Emissions of NOx from Source 102 shall not exceed:

- a) 6.01 pounds per hour.
- b) 26.32 tons per year (in any 12 consecutive month period).

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) All maintenance (i.e., routing and/or preventative maintenance, repairs, adjustments, parts replacements, calibrations, etc.) and inspections performed shall be recorded in a log. These records shall contain, at a minimum, the following:

- 1) The date of the maintenance/inspection.
- 2) The type of maintenance/inspection performed.
- 3) A detailed description of the maintenance/inspection.
- 4) Name, title, and initials of the individual performing the maintenance/inspection.

b) The owner or operator of the facility shall keep records which clearly verify compliance with this source's emission restrictions. The owner or operator shall perform monthly calculations to demonstrate compliance with the emission restrictions of this source. These calculations shall include the twelve (12) month rolling total emissions of NOx (tpy).

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 003 [25 Pa. Code §127.12b]****Plan approval terms and conditions.**

a) The owner or operator shall perform an annual source inspection and a burner tune up (occurring at a minimum of once in any consecutive 12 month period).

b) All burners shall undergo maintenance as needed to ensure proper tuning and air-fuel ratios. The burners shall be

**SECTION E. Source Group Restrictions.**

inspected monthly at a minimum.

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***



**SECTION E. Source Group Restrictions.**

Group Name: 2 VOC LIMITS

Group Description: Coating line (Dip Coating)

Sources included in this group

ID	Name
104	FINISHING DEPT. COATING LINE

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §129.52]****Surface coating processes**

(a) A person may not cause or permit the emission into the outdoor atmosphere of VOCs from a surface coating process unless the weight of VOC per gallon of coating solids applied, is equal to or less than 6.67 for air dried coating operation. The VOC content expressed in units of weight of VOC per volume of coating solids, shall be calculated on a 30-day rolling average using the equation in Appendix "A1" of this permit.

(b) The solvents methyl chloroform (1,1,1-trichloroethane) and methylene chloride are exempt from control under this section and § 129.67 (relating to graphic arts systems). A surface coating process which seeks to comply with this section through the use of an exempt solvent may not be included in any alternative standards.

(c) The VOC standards in Table I do not apply to a coating used exclusively for determining product quality and commercial acceptance, touch-up and repair and other small quantity coatings if the coating meets the following criteria:

(1) The quantity of coating used does not exceed 50 gallons per year for a single coating and a total of 200 gallons per year for all coatings combined for the facility.

(2) The owner or operator of the facility requests, in writing, and the Department approves, in writing, the exemption prior to use of the coating.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [25 Pa. Code §129.52]****Surface coating processes**

(a) A facility, regardless of the facility's annual emission rate, which contains surface coating processes shall maintain records sufficient to demonstrate compliance with this section. At a minimum, a facility shall maintain daily records of:

(1) The following parameters for each coating, thinner and other component as supplied:

(i) The coating, thinner or component name and identification number.

(ii) The volume used.

(iii) The mix ratio.

(iv) The density or specific gravity.

(v) The weight percent of total volatiles, water, solids and exempt solvents.

**SECTION E. Source Group Restrictions.**

- (vi) The volume percent of solids for Table I surface coating process categories 1-10.
- (2) The VOC content of each coating, thinner and other component as supplied.
- (3) The VOC content of each as applied coating.
- (b) The records shall be maintained for 5 years and shall be submitted to the Department on a schedule reasonably prescribed by the Department.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 3 BLOWDOWN REQUIREMENTS

Group Description: Blowdown Stations

Sources included in this group

ID	Name
114	#2 ID BLOW STATION

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.****# 001 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain a record of all preventive maintenance inspections of the control device(s). These records shall, at a minimum, contain the dates of the inspections, any potential problems and defects, the actions taken to correct the problem or defect, any routine maintenance performed, the pressure drop across the rotoclone, and the water flow rate in the rotoclone.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 002 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

- (a) The permittee shall maintain the rotoclone and cyclone in accordance with the manufacturer's specifications
- (b) The permittee shall perform weekly preventive maintenance inspections of the control devices and check the pressure drop of the rotoclone.
- (c) The permittee shall maintain a water flow gauge for flow rate measurement of water to rotoclone.
- (d) The permittee shall install and maintain a manometer or similar device to measure the pressure drop across the rotoclone.
- (e) The permittee shall maintain the pressure drop across the control devices from 5" to 15" of water column when the source and control device are in operation..

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 4 GALVANIZING/BLOWDOWN PM RESTR

Group Description: Kettle and, Blow station

**Sources included in this group**

ID	Name
102	#1 GALVANIZING KETTLE
103	#2 GALVANIZING KETTLE
114	#2 ID BLOW STATION

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter in a manner that the concentration of particulate matter in the effluent gas exceeds .04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 5 PART 63 SUBPART ZZZZ

Group Description: 40 CFR Part 63 Subpart ZZZZ for emergency generators

Sources included in this group

ID	Name
144	NATURAL GAS FUELED EMERGENCY GENERATORS (116 HP AND 450 HP)

**I. RESTRICTIONS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.****# 001 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6625]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What are my monitoring, installation, operation, and maintenance requirements?**

(a) - (d): Not applicable.

(e) If you own or operate any of the following stationary RICE, you must operate and maintain the stationary RICE and after-treatment control device (if any) according to the manufacturer's emission-related written instructions or develop your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with good air pollution control practice for minimizing emissions:

(1) - (2): Not applicable.

(3) An existing emergency or black start stationary RICE located at an area source of HAP emissions;

(4) - (10): Not applicable.

(f) If you own or operate an existing emergency stationary RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions or an existing emergency stationary RICE located at an area source of HAP emissions, you must install a non-resettable hour meter if one is not already installed.

(g) Not applicable.

(h) If you operate a new, reconstructed, or existing stationary engine, you must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes, after which time the emission standards applicable to all times other than startup in Tables 1a, 2a, 2c, and 2d to this subpart apply.

(i) Not applicable.

(j) If you own or operate a stationary SI engine that is subject to the work, operation or management practices in items 6, 7, or 8 of Table 2c to this subpart or in items 5, 6, 7, 9, or 11 of Table 2d to this subpart, you have the option of utilizing an oil analysis program in order to extend the specified oil change requirement in Tables 2c and 2d to this subpart. The oil analysis must be performed at the same frequency specified for changing the oil in Table 2c or 2d to this subpart. The analysis program must at a minimum analyze the following three parameters: Total Acid Number, viscosity, and percent water content. The condemning limits for these parameters are as follows: Total Acid Number increases by more than 3.0 milligrams of potassium hydroxide (KOH) per gram from Total Acid Number of the oil when new; viscosity of the oil has changed by more than 20 percent from the viscosity of the oil when new; or percent water content (by volume) is greater than 0.5. If all of these condemning limits are not exceeded, the engine owner or operator is not required to change the oil. If any of the limits are exceeded, the engine owner or operator must change the oil within 2 business days of receiving the results

**SECTION E. Source Group Restrictions.**

of the analysis; if the engine is not in operation when the results of the analysis are received, the engine owner or operator must change the oil within 2 business days or before commencing operation, whichever is later. The owner or operator must keep records of the parameters that are analyzed as part of the program, the results of the analysis, and the oil changes for the engine. The analysis program must be part of the maintenance plan for the engine.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010; 76 FR 12866, Mar. 9, 2011; 78 FR 6703, Jan. 30, 2013]

**IV. RECORDKEEPING REQUIREMENTS.****# 002 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6655]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What records must I keep?**

(a) - (c): Not applicable.

(d) You must keep the records required in Table 6 of this subpart to show continuous compliance with each emission or operating limitation that applies to you.

(e) You must keep records of the maintenance conducted on the stationary RICE in order to demonstrate that you operated and maintained the stationary RICE and after-treatment control device (if any) according to your own maintenance plan if you own or operate any of the following stationary RICE;

(1) Not applicable.

(2) An existing stationary emergency RICE.

(3) Not applicable.

(f) If you own or operate any of the stationary RICE in paragraphs (f)(1) through (2) of this section, you must keep records of the hours of operation of the engine that is recorded through the non-resettable hour meter. The owner or operator must document how many hours are spent for emergency operation, including what classified the operation as emergency and how many hours are spent for non-emergency operation. If the engine is used for the purposes specified in § 63.6640(f)(2)(ii) or (iii) or § 63.6640(f)(4)(ii), the owner or operator must keep records of the notification of the emergency situation, and the date, start time, and end time of engine operation for these purposes.

(1) Not applicable.

(2) An existing emergency stationary RICE located at an area source of HAP emissions that does not meet the standards applicable to non-emergency engines.

[69 FR 33506, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 78 FR 6706, Jan. 30, 2013]

**# 003 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6660]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****In what form and how long must I keep my records?**

(a) Your records must be in a form suitable and readily available for expeditious review according to § 63.10(b)(1).

(b) As specified in § 63.10(b)(1), you must keep each record for 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record.

(c) You must keep each record readily accessible in hard copy or electronic form for at least 5 years after the date of each occurrence, measurement, maintenance, corrective action, report, or record, according to § 63.10(b)(1).

**SECTION E. Source Group Restrictions.**

[69 FR 33506, June 15, 2004, as amended at 75 FR 9678, Mar. 3, 2010]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.****# 004 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63 Subpart ZZZZ Table 2d]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****Requirements for Existing Stationary RICE Located at Area Sources of HAP Emissions**

As stated in §§63.6603 and 63.6640, you must comply with the following requirements for existing stationary RICE located at area sources of HAP emissions:

For each . . . You must meet the following requirement, except during periods of startup . . .

1. - 4. : Not applicable

5. For Each: Emergency stationary SI RICE; black start stationary SI RICE; non-emergency, non-black start 4SLB stationary RICE > 500 HP that operate 24 hours or less per calendar year; non-emergency, non-black start 4SRB stationary RICE > 500 HP that operate 24 hours or less per calendar year.

You must meet the following requirement, except during periods of start up .....2 a. Change oil and filter every 500 hours of operation or annually, whichever comes first; 1

b. Inspect spark plugs every 1,000 hours of operation or annually, whichever comes first; and

c. Inspect all hoses and belts every 500 hours of operation or annually, whichever comes first, and replace as necessary.

6. - 13: Not applicable.

1. Sources have the option to utilize an oil analysis program as described in § 63.6625(i) in order to extend the specified oil change requirement in Table 2d of this subpart.

2. If an emergency engine is operating during an emergency and it is not possible to shut down the engine in order to perform the management practice requirements on the schedule required in Table 2d of this subpart, or if performing the management practice on the required schedule would otherwise pose an unacceptable risk under Federal, State, or local law, the management practice can be delayed until the emergency is over or the unacceptable risk under Federal, State, or local law has abated. The management practice should be performed as soon as practicable after the emergency has ended or the unacceptable risk under Federal, State, or local law has abated. Sources must report any failure to perform the management practice on the schedule required and the Federal, State or local law under which the risk was deemed unacceptable.

[75 FR page 9688, Mar. 3, 2010; 75 FR page 51595, Aug. 20, 2010]

**# 005 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63 Subpart ZZZZ Table 6]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****Table 6 to Subpart ZZZZ of Part 63.-- Continuous Compliance With Emission Limitations and Operating Limitations**

As stated in §63.6640, you must continuously comply with the emissions and operating limitations as required by the

**SECTION E. Source Group Restrictions.**

following:

For each: Existing emergency RICE located at an area source of HAP.

Complying with the requirement to.....

a. Work Management Practices

You must demonstrate continuous compliance by .....

i. Operating and maintaining the stationary RICE according to the manufacturer's emission related operation and maintenance instructions or

ii) Develop and follow your own maintenance plan which must provide to the extent practicable for the maintenance and operation of the engine in a manner consistent with air pollution control practice for minimizing emissions.

**# 006 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6580]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**What is the purpose of subpart ZZZZ?**

Subpart ZZZZ establishes national emission limitations and operating limitations for hazardous air pollutants (HAP) emitted from stationary reciprocating internal combustion engines (RICE) located at major and area sources of HAP emissions. This subpart also establishes requirements to demonstrate initial and continuous compliance with the emission limitations and operating limitations.

[73 FR 3603, Jan. 18, 2008]

**# 007 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6585]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**Am I subject to this subpart?**

You are subject to this subpart if you own or operate a stationary RICE at a major or area source of HAP emissions, except if the stationary RICE is being tested at a stationary RICE test cell/stand.

(a) A stationary RICE is any internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work and which is not mobile. Stationary RICE differ from mobile RICE in that a stationary RICE is not a non-road engine as defined at 40 CFR 1068.30, and is not used to propel a motor vehicle or a vehicle used solely for competition.

(b) Not applicable.

(c) An area source of HAP emissions is a source that is not a major source.

(d) - (f) Not applicable.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3603, Jan. 2008; 78 FR 6700, Jan. 30, 2013]

**# 008 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6590]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**What parts of my plant does this subpart cover?**

This subpart applies to each affected source.

(a) Affected source. An affected source is any existing, new, or reconstructed stationary RICE located at a major or area source of HAP emissions, excluding stationary RICE being tested at a stationary RICE test cell/stand.



**SECTION E. Source Group Restrictions.**

(1) Existing stationary RICE.

(i) - (ii) : Not applicable.

(iii) For stationary RICE located at an area source of HAP emissions, a stationary RICE is existing if you commenced construction or reconstruction of the stationary RICE before June 12, 2006.

(iv) Not applicable.

(2) - (3): Not applicable.

(b) - (c): Not applicable.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9674, Mar. 3, 2010; 75 FR 37733, June 30, 2010; 75 FR 51588, Aug. 20, 2010; 78 FR 6700, Jan. 30, 2013]

**# 009 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6595]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**When do I have to comply with this subpart?**

(a) Affected sources. ----- If you have an existing stationary SI RICE with a site rating of less than or equal to 500 brake HP located at a major source of HAP emissions, or an existing stationary SI RICE located at an area source of HAP emissions, you must comply with the applicable emission limitations, operating limitations, and other requirements no later than October 19, 2013.

(2)- (7): Not applicable.

(b) - (c): Not applicable.

[69 FR 33506, June 15, 2004, as amended at 73 FR 3604, Jan. 18, 2008; 75 FR 9675, Mar. 3, 2010; 75 FR 51589, Aug. 20, 2010; 78 FR 6701, Jan. 30, 2013]

**# 010 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6603]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**What emission limitations, operating limitations, and other requirements must I meet if I own or operate an existing stationary RICE located at an area source of HAP emissions?**

(a) If you own or operate an existing stationary RICE located at an area source of HAP emissions, you must comply with the requirements in Table 2d to this subpart and the operating limitations in Table 2b to this subpart that apply to you.

(b) - (f): Not applicable

[75 FR 9675, Mar. 3, 2010, as amended at 75 FR 51589, Aug. 20, 2010; 76 FR 12866, Mar. 9, 2011; 78 FR 6701, Jan. 30, 2013]

**# 011 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6605]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**What are my general requirements for complying with this subpart?**

(a) You must be in compliance with the emission limitations, operating limitations, and other requirements in this subpart that apply to you at all times.

(b) At all times you must operate and maintain any affected source, including associated air pollution control equipment and

**SECTION E. Source Group Restrictions.**

monitoring equipment, in a manner consistent with safety and good air pollution control practices for minimizing emissions. The general duty to minimize emissions does not require you to make any further efforts to reduce emissions if levels required by this standard have been achieved. Determination of whether such operation and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures, review of operation and maintenance records, and inspection of the source.

[75 FR 9675, Mar. 3, 2010, as amended at 78 FR 6702, Jan. 30, 2013]

**# 012 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6640]**

**Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines**

**How do I demonstrate continuous compliance with the emission limitations, operating limitations, and other requirements?**

(a) You must demonstrate continuous compliance with each emission limitation, operating limitation, and other requirements in Tables 1a and 1b, Tables 2a and 2b, Table 2c, and Table 2d to this subpart that apply to you according to methods specified in Table 6 to this subpart.

(b) - (e): Not applicable.

(f) If you own or operate an emergency stationary RICE, you must operate the emergency stationary RICE according to the requirements in paragraphs (f)(1) through (4) of this section. In order for the engine to be considered an emergency stationary RICE under this subpart, any operation other than emergency operation, maintenance and testing, emergency demand response, and operation in non-emergency situations for 50 hours per year, as described in paragraphs (f)(1) through (4) of this section, is prohibited. If you do not operate the engine according to the requirements in paragraphs (f)(1) through (4) of this section, the engine will not be considered an emergency engine under this subpart and must meet all requirements for non-emergency engines.

(1) There is no time limit on the use of emergency stationary RICE in emergency situations.

(2) You may operate your emergency stationary RICE for any combination of the purposes specified in paragraphs (f)(2)(i) through (iii) of this section for a maximum of 100 hours per calendar year. Any operation for non-emergency situations as allowed by paragraphs (f)(3) and (4) of this section counts as part of the 100 hours per calendar year allowed by this paragraph (f)(2).

(i) Emergency stationary RICE may be operated for maintenance checks and readiness testing, provided that the tests are recommended by federal, state or local government, the manufacturer, the vendor, the regional transmission organization or equivalent balancing authority and transmission operator, or the insurance company associated with the engine. The owner or operator may petition the Administrator for approval of additional hours to be used for maintenance checks and readiness testing, but a petition is not required if the owner or operator maintains records indicating that federal, state, or local standards require maintenance and testing of emergency RICE beyond 100 hours per calendar year.

(ii) - (iii) : Not applicable.

(3) Not applicable.

(4) Emergency stationary RICE located at area sources of HAP may be operated for up to 50 hours per calendar year in non-emergency situations. The 50 hours of operation in non-emergency situations are counted as part of the 100 hours per calendar year for maintenance and testing and emergency demand response provided in paragraph (f)(2) of this section. Except as provided in paragraphs (f)(4)(i) and (ii) of this section, the 50 hours per year for non-emergency situations cannot be used for peak shaving or non-emergency demand response, or to generate income for a facility to an electric grid or otherwise supply power as part of a financial arrangement with another entity.

(i) - (ii): Not applicable.

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3606, Jan. 18, 2008; 75 FR 9676, Mar. 3, 2010; 75 FR 51591, Aug. 20, 2010; 78 FR 6704, Jan. 30, 2013]

**SECTION E. Source Group Restrictions.****# 013 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6665]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What parts of the General Provisions apply to me?**

Table 8 to this subpart shows which parts of the General Provisions in §§ 63.1 through 63.15 apply to you.

[75 FR 9678, Mar. 3, 2010]

**# 014 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6670]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****Who implements and enforces this subpart?**

(a) This subpart is implemented and enforced by the U.S. EPA, or a delegated authority such as your State, local, or tribal agency. If the U.S. EPA Administrator has delegated authority to your State, local, or tribal agency, then that agency (as well as the U.S. EPA) has the authority to implement and enforce this subpart. You should contact your U.S. EPA Regional Office to find out whether this subpart is delegated to your State, local, or tribal agency.

(b) In delegating implementation and enforcement authority of this subpart to a State, local, or tribal agency under 40 CFR part 63, subpart E, the authorities contained in paragraph (c) of this section are retained by the Administrator of the U.S. EPA and are not transferred to the State, local, or tribal agency.

(c) The authorities that will not be delegated to State, local, or tribal agencies are:

- (1) Approval of alternatives to the non-opacity emission limitations and operating limitations in § 63.6600 under § 63.6(g).
- (2) Approval of major alternatives to test methods under § 63.7(e)(2)(ii) and (f) and as defined in § 63.90.
- (3) Approval of major alternatives to monitoring under § 63.8(f) and as defined in § 63.90.
- (4) Approval of major alternatives to recordkeeping and reporting under § 63.10(f) and as defined in § 63.90.
- (5) Approval of a performance test which was conducted prior to the effective date of the rule, as specified in § 63.6610(b).

**# 015 [40 CFR Part 63 NESHAPS for Source Categories §40 CFR 63.6675]****Subpart ZZZZ - National Emissions Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines****What definitions apply to this subpart?**

Terms used in this subpart are defined in the Clean Air Act (CAA); in 40 CFR 63.2, the General Provisions of this part; and in this section as follows:

Alaska Railbelt Grid means the service areas of the six regulated public utilities that extend from Fairbanks to Anchorage and the Kenai Peninsula. These utilities are Golden Valley Electric Association; Chugach Electric Association; Matanuska Electric Association; Homer Electric Association; Anchorage Municipal Light & Power; and the City of Seward Electric System.

Area source means any stationary source of HAP that is not a major source as defined in part 63.

Associated equipment as used in this subpart and as referred to in section 112(n)(4) of the CAA, means equipment associated with an oil or natural gas exploration or production well, and includes all equipment from the well bore to the point of custody transfer, except glycol dehydration units, storage vessels with potential for flash emissions, combustion turbines, and stationary RICE.

**SECTION E. Source Group Restrictions.**

Backup power for renewable energy means an engine that provides backup power to a facility that generates electricity from renewable energy resources, as that term is defined in Alaska Statute 42.45.045(l)(5) (incorporated by reference, see § 63.14).

Black start engine means an engine whose only purpose is to start up a combustion turbine.

CAA means the Clean Air Act (42 U.S.C. 7401 et seq., as amended by Public Law 101-549, 104 Stat. 2399).

Commercial emergency stationary RICE means an emergency stationary RICE used in commercial establishments such as office buildings, hotels, stores, telecommunications facilities, restaurants, financial institutions such as banks, doctor's offices, and sports and performing arts facilities.

Compression ignition means relating to a type of stationary internal combustion engine that is not a spark ignition engine.

Custody transfer means the transfer of hydrocarbon liquids or natural gas: After processing and/or treatment in the producing operations, or from storage vessels or automatic transfer facilities or other such equipment, including product loading racks, to pipelines or any other forms of transportation. For the purposes of this subpart, the point at which such liquids or natural gas enters a natural gas processing plant is a point of custody transfer.

Deviation means any instance in which an affected source subject to this subpart, or an owner or operator of such a source:

- (1) Fails to meet any requirement or obligation established by this subpart, including but not limited to any emission limitation or operating limitation;
- (2) Fails to meet any term or condition that is adopted to implement an applicable requirement in this subpart and that is included in the operating permit for any affected source required to obtain such a permit; or
- (3) Fails to meet any emission limitation or operating limitation in this subpart during malfunction, regardless of whether or not such failure is permitted by this subpart.
- (4) Fails to satisfy the general duty to minimize emissions established by § 63.6(e)(1)(i).

Diesel engine means any stationary RICE in which a high boiling point liquid fuel injected into the combustion chamber ignites when the air charge has been compressed to a temperature sufficiently high for auto-ignition. This process is also known as compression ignition.

Diesel fuel means any liquid obtained from the distillation of petroleum with a boiling point of approximately 150 to 360 degrees Celsius. One commonly used form is fuel oil number 2. Diesel fuel also includes any non-distillate fuel with comparable physical and chemical properties ( e.g. biodiesel) that is suitable for use in compression ignition engines.

Digester gas means any gaseous by-product of wastewater treatment typically formed through the anaerobic decomposition of organic waste materials and composed principally of methane and CO<sub>2</sub> .

Dual-fuel engine means any stationary RICE in which a liquid fuel (typically diesel fuel) is used for compression ignition and gaseous fuel (typically natural gas) is used as the primary fuel.

Emergency stationary RICE means any stationary reciprocating internal combustion engine that meets all of the criteria in paragraphs (1) through (3) of this definition. All emergency stationary RICE must comply with the requirements specified in § 63.6640(f) in order to be considered emergency stationary RICE. If the engine does not comply with the requirements specified in § 63.6640(f), then it is not considered to be an emergency stationary RICE under this subpart.

- (1) The stationary RICE is operated to provide electrical power or mechanical work during an emergency situation. Examples include stationary RICE used to produce power for critical networks or equipment (including power supplied to portions of a facility) when electric power from the local utility (or the normal power source, if the facility runs on its own power production) is interrupted, or stationary RICE used to pump water in the case of fire or flood, etc.
- (2) The stationary RICE is operated under limited circumstances for situations not included in paragraph (1) of this

**SECTION E. Source Group Restrictions.**

definition, as specified in § 63.6640(f).

(3) The stationary RICE operates as part of a financial arrangement with another entity in situations not included in paragraph (1) of this definition only as allowed in § 63.6640(f)(2)(ii) or (iii) and § 63.6640(f)(4)(i) or (ii).

Engine startup means the time from initial start until applied load and engine and associated equipment reaches steady state or normal operation. For stationary engine with catalytic controls, engine startup means the time from initial start until applied load and engine and associated equipment, including the catalyst, reaches steady state or normal operation.

Four-stroke engine means any type of engine which completes the power cycle in two crankshaft revolutions, with intake and compression strokes in the first revolution and power and exhaust strokes in the second revolution.

Gaseous fuel means a material used for combustion which is in the gaseous state at standard atmospheric temperature and pressure conditions.

Gasoline means any fuel sold in any State for use in motor vehicles and motor vehicle engines, or nonroad or stationary engines, and commonly or commercially known or sold as gasoline.

Glycol dehydration unit means a device in which a liquid glycol (including, but not limited to, ethylene glycol, diethylene glycol, or triethylene glycol) absorbent directly contacts a natural gas stream and absorbs water in a contact tower or absorption column (absorber). The glycol contacts and absorbs water vapor and other gas stream constituents from the natural gas and becomes "rich" glycol. This glycol is then regenerated in the glycol dehydration unit reboiler. The "lean" glycol is then recycled.

Hazardous air pollutants (HAP) means any air pollutants listed in or pursuant to section 112(b) of the CAA.

Institutional emergency stationary RICE means an emergency stationary RICE used in institutional establishments such as medical centers, nursing homes, research centers, institutions of higher education, correctional facilities, elementary and secondary schools, libraries, religious establishments, police stations, and fire stations.

ISO standard day conditions means 288 degrees Kelvin (15 degrees Celsius), 60 percent relative humidity and 101.3 kilopascals pressure.

Landfill gas means a gaseous by-product of the land application of municipal refuse typically formed through the anaerobic decomposition of waste materials and composed principally of methane and CO<sub>2</sub>.

Lean burn engine means any two-stroke or four-stroke spark ignited engine that does not meet the definition of a rich burn engine.

Limited use stationary RICE means any stationary RICE that operates less than 100 hours per year.

Liquefied petroleum gas means any liquefied hydrocarbon gas obtained as a by-product in petroleum refining of natural gas production.

Liquid fuel means any fuel in liquid form at standard temperature and pressure, including but not limited to diesel, residual/crude oil, kerosene/naphtha (jet fuel), and gasoline.

Major Source, as used in this subpart, shall have the same meaning as in § 63.2, except that:

(1) Emissions from any oil or gas exploration or production well (with its associated equipment (as defined in this section)) and emissions from any pipeline compressor station or pump station shall not be aggregated with emissions from other similar units, to determine whether such emission points or stations are major sources, even when emission points are in a contiguous area or under common control;

(2) For oil and gas production facilities, emissions from processes, operations, or equipment that are not part of the same oil and gas production facility, as defined in § 63.1271 of subpart HHH of this part, shall not be aggregated;

**SECTION E. Source Group Restrictions.**

(3) For production field facilities, only HAP emissions from glycol dehydration units, storage vessel with the potential for flash emissions, combustion turbines and reciprocating internal combustion engines shall be aggregated for a major source determination; and

(4) Emissions from processes, operations, and equipment that are not part of the same natural gas transmission and storage facility, as defined in § 63.1271 of subpart HHH of this part, shall not be aggregated.

Malfunction means any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner which causes, or has the potential to cause, the emission limitations in an applicable standard to be exceeded. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.

Natural gas means a naturally occurring mixture of hydrocarbon and non-hydrocarbon gases found in geologic formations beneath the Earth's surface, of which the principal constituent is methane. Natural gas may be field or pipeline quality.

Non-selective catalytic reduction (NSCR) means an add-on catalytic nitrogen oxides (NOX) control device for rich burn engines that, in a two-step reaction, promotes the conversion of excess oxygen, NOX, CO, and volatile organic compounds (VOC) into CO<sub>2</sub>, nitrogen, and water.

Oil and gas production facility as used in this subpart means any grouping of equipment where hydrocarbon liquids are processed, upgraded (i.e., remove impurities or other constituents to meet contract specifications), or stored prior to the point of custody transfer; or where natural gas is processed, upgraded, or stored prior to entering the natural gas transmission and storage source category. For purposes of a major source determination, facility (including a building, structure, or installation) means oil and natural gas production and processing equipment that is located within the boundaries of an individual surface site as defined in this section. Equipment that is part of a facility will typically be located within close proximity to other equipment located at the same facility. Pieces of production equipment or groupings of equipment located on different oil and gas leases, mineral fee tracts, lease tracts, subsurface or surface unit areas, surface fee tracts, surface lease tracts, or separate surface sites, whether or not connected by a road, waterway, power line or pipeline, shall not be considered part of the same facility. Examples of facilities in the oil and natural gas production source category include, but are not limited to, well sites, satellite tank batteries, central tank batteries, a compressor station that transports natural gas to a natural gas processing plant, and natural gas processing plants.

Oxidation catalyst means an add-on catalytic control device that controls CO and VOC by oxidation.

Peaking unit or engine means any standby engine intended for use during periods of high demand that are not emergencies.

Percent load means the fractional power of an engine compared to its maximum manufacturer's design capacity at engine site conditions. Percent load may range between 0 percent to above 100 percent.

Potential to emit means the maximum capacity of a stationary source to emit a pollutant under its physical and operational design. Any physical or operational limitation on the capacity of the stationary source to emit a pollutant, including air pollution control equipment and restrictions on hours of operation or on the type or amount of material combusted, stored, or processed, shall be treated as part of its design if the limitation or the effect it would have on emissions is federally enforceable. For oil and natural gas production facilities subject to subpart HH of this part, the potential to emit provisions in § 63.760(a) may be used. For natural gas transmission and storage facilities subject to subpart HHH of this part, the maximum annual facility gas throughput for storage facilities may be determined according to § 63.1270(a)(1) and the maximum annual throughput for transmission facilities may be determined according to § 63.1270(a)(2).

Production field facility means those oil and gas production facilities located prior to the point of custody transfer.

Production well means any hole drilled in the earth from which crude oil, condensate, or field natural gas is extracted.

Propane means a colorless gas derived from petroleum and natural gas, with the molecular structure C<sub>3</sub>H<sub>8</sub>.

Remote stationary RICE means stationary RICE meeting any of the following criteria:

**SECTION E. Source Group Restrictions.**

(1) Stationary RICE located in an offshore area that is beyond the line of ordinary low water along that portion of the coast of the United States that is in direct contact with the open seas and beyond the line marking the seaward limit of inland waters.

(2) Stationary RICE located on a pipeline segment that meets both of the criteria in paragraphs (2)(i) and (ii) of this definition.

(i) A pipeline segment with 10 or fewer buildings intended for human occupancy and no buildings with four or more stories within 220 yards (200 meters) on either side of the centerline of any continuous 1-mile (1.6 kilometers) length of pipeline. Each separate dwelling unit in a multiple dwelling unit building is counted as a separate building intended for human occupancy.

(ii) The pipeline segment does not lie within 100 yards (91 meters) of either a building or a small, well-defined outside area (such as a playground, recreation area, outdoor theater, or other place of public assembly) that is occupied by 20 or more persons on at least 5 days a week for 10 weeks in any 12-month period. The days and weeks need not be consecutive. The building or area is considered occupied for a full day if it is occupied for any portion of the day.

(iii) For purposes of this paragraph (2), the term pipeline segment means all parts of those physical facilities through which gas moves in transportation, including but not limited to pipe, valves, and other appurtenance attached to pipe, compressor units, metering stations, regulator stations, delivery stations, holders, and fabricated assemblies. Stationary RICE located within 50 yards (46 meters) of the pipeline segment providing power for equipment on a pipeline segment are part of the pipeline segment. Transportation of gas means the gathering, transmission, or distribution of gas by pipeline, or the storage of gas. A building is intended for human occupancy if its primary use is for a purpose involving the presence of humans.

(3) Stationary RICE that are not located on gas pipelines and that have 5 or fewer buildings intended for human occupancy and no buildings with four or more stories within a 0.25 mile radius around the engine. A building is intended for human occupancy if its primary use is for a purpose involving the presence of humans.

Residential emergency stationary RICE means an emergency stationary RICE used in residential establishments such as homes or apartment buildings.

Responsible official means responsible official as defined in 40 CFR 70.2.

Rich burn engine means any four-stroke spark ignited engine where the manufacturer's recommended operating air/fuel ratio divided by the stoichiometric air/fuel ratio at full load conditions is less than or equal to 1.1. Engines originally manufactured as rich burn engines, but modified prior to December 19, 2002 with passive emission control technology for NOX (such as pre-combustion chambers) will be considered lean burn engines. Also, existing engines where there are no manufacturer's recommendations regarding air/fuel ratio will be considered a rich burn engine if the excess oxygen content of the exhaust at full load conditions is less than or equal to 2 percent.

Site-rated HP means the maximum manufacturer's design capacity at engine site conditions.

Spark ignition means relating to either: A gasoline-fueled engine; or any other type of engine with a spark plug (or other sparking device) and with operating characteristics significantly similar to the theoretical Otto combustion cycle. Spark ignition engines usually use a throttle to regulate intake air flow to control power during normal operation. Dual-fuel engines in which a liquid fuel (typically diesel fuel) is used for CI and gaseous fuel (typically natural gas) is used as the primary fuel at an annual average ratio of less than 2 parts diesel fuel to 100 parts total fuel on an energy equivalent basis are spark ignition engines.

Stationary reciprocating internal combustion engine (RICE) means any reciprocating internal combustion engine which uses reciprocating motion to convert heat energy into mechanical work and which is not mobile. Stationary RICE differ from mobile RICE in that a stationary RICE is not a non-road engine as defined at 40 CFR 1068.30, and is not used to propel a motor vehicle or a vehicle used solely for competition.

Stationary RICE test cell/stand means an engine test cell/stand, as defined in subpart P of this part, that tests stationary RICE.

**SECTION E. Source Group Restrictions.**

Stoichiometric means the theoretical air-to-fuel ratio required for complete combustion.

Storage vessel with the potential for flash emissions means any storage vessel that contains a hydrocarbon liquid with a stock tank gas-to-oil ratio equal to or greater than 0.31 cubic meters per liter and an American Petroleum Institute gravity equal to or greater than 40 degrees and an actual annual average hydrocarbon liquid throughput equal to or greater than 79,500 liters per day. Flash emissions occur when dissolved hydrocarbons in the fluid evolve from solution when the fluid pressure is reduced.

Subpart means 40 CFR part 63, subpart ZZZZ.

Surface site means any combination of one or more graded pad sites, gravel pad sites, foundations, platforms, or the immediate physical location upon which equipment is physically affixed.

Two-stroke engine means a type of engine which completes the power cycle in single crankshaft revolution by combining the intake and compression operations into one stroke and the power and exhaust operations into a second stroke. This system requires auxiliary scavenging and inherently runs lean of stoichiometric.

[69 FR 33506, June 15, 2004, as amended at 71 FR 20467, Apr. 20, 2006; 73 FR 3607, Jan. 18, 2008; 75 FR 9679, Mar. 3, 2010; 75 FR 51592, Aug. 20, 2010; 76 FR 12867, Mar. 9, 2011; 78 FR 6706, Jan. 30, 2013]

\*\*\* **Permit Shield in Effect.** \*\*\*



**SECTION E. Source Group Restrictions.**

Group Name: 6 GALVANIZING FURNACE REQS

Group Description: Galvanizing furnace

**Sources included in this group**

ID	Name
133	#1 GALVANIZING FURNACE
134	#2 GALVANIZING FURNACE

**I. RESTRICTIONS.****Emission Restriction(s).****# 001 [25 Pa. Code §123.13]****Processes**

The permittee may not permit the emission into the outdoor atmosphere of particulate matter from any process 0.04 grain per dry standard cubic foot, when the effluent gas volume is less than 150,000 dry standard cubic feet per minute.

**# 002 [25 Pa. Code §123.21]****General**

The permittee may not permit the emission into the outdoor atmosphere of sulfur oxides from a source in a manner that the concentration of the sulfur oxides, expressed as SO<sub>2</sub>, in the effluent gas exceeds 500 parts per million, by volume, dry basis.

**Fuel Restriction(s).****# 003 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall use only Natural gas as a combustion fuel.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

No additional record keeping requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.****# 004 [25 Pa. Code §127.511]****Monitoring and related recordkeeping and reporting requirements.**

The permittee shall maintain this source in accordance with manufacturer's specifications and good air pollution control practice.

**SECTION E. Source Group Restrictions.****VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 7 THREADER VOC REQS

Group Description: PM Threaders

Sources included in this group

ID	Name
115	#1 PM THREADER

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The permittee shall not use steel gard oil or equivalent which has a VOC content of greater than 10.34 lbs VOC per gallon.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

# 002 [25 Pa. Code §127.511]

**Monitoring and related recordkeeping and reporting requirements.**

The permittee shall keep the following record of VOC content in the steel gard oil.

- (a) The gallons of steel gard oil or equivalent used per month.
- (b) VOC content of steel gard oil or equivalent.
- (c) Material safety data sheets or other certification from the manufacturer of VOC content in the steel gard oil or equivalent.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 8 VOC 129.96(C)

Group Description: VOC restriction &lt; 1 TPY for 129.96(c)

**Sources included in this group**

ID	Name
031	600HP BOILER
032	400HP BOILER
133	#1 GALVANIZING FURNACE
134	#2 GALVANIZING FURNACE
137	MISC HEATERS
143	ONE WASTE OIL SPACE HEATER

**I. RESTRICTIONS.****Emission Restriction(s).**

# 001 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

[Additional authority for this permit condition is derived from 25 Pa. Code Sections 129.96(c)]

This source shall not emit volatile organic compounds greater than or equal to 1 ton in any 12-consecutive month period.

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

# 002 [25 Pa. Code §127.441]

**Operating permit terms and conditions.**

The facility shall keep a record of the VOC Potential emissions that demonstrate that each of the sources in this group is less than 1 TPY. The emissions for each of the sources are based on the AP-42 emission factor in Table 1-4.2 (5.5 lb VOC/mmscf gas) and Table 1.11-3 (1.0 lb VOC/1,000 gal of oil) and the capacity of each source.

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

No additional work practice requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION E. Source Group Restrictions.**

Group Name: 9 SOURCE 101 ALT RACT II & RACT III

Group Description: Source 101 Alternate RACT II and RACT III requirements amended from plan approval.

Sources included in this group

ID	Name
101	CONTINUOUS WELD FURNACE

**I. RESTRICTIONS.****Emission Restriction(s).**

**# 001 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

Emissions of NOx from Source 101 shall not exceed 47.18 tons in any 12 consecutive month period.

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**II. TESTING REQUIREMENTS.**

No additional testing requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**III. MONITORING REQUIREMENTS.**

No additional monitoring requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**IV. RECORDKEEPING REQUIREMENTS.**

**# 002 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

a) All maintenance (i.e., routine and/or preventative maintenance, repairs, adjustments, parts replacement, calibrations, etc.) and inspections performed shall be recorded in a log. These records shall contain, at a minimum, the following:

- 1) The date of the maintenance/inspection.
- 2) The type of maintenance/inspection performed.
- 3) A detailed description of the maintenance/inspection.
- 4) Name, title, and initials of the individual performing the maintenance/inspection.

b) The owner or operator of the facility shall keep records which clearly verify compliance with this source's emission restrictions. The owner or operator shall perform monthly calculations to demonstrate compliance with emission restrictions of this source. These calculations shall include the twelve (12) month rolling total emissions of NOx (tpy). Calculating actual emissions shall be based on the natural gas usage and approved emission factor of 100 lb NOx/10x6 scf.

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**V. REPORTING REQUIREMENTS.**

No additional reporting requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**VI. WORK PRACTICE REQUIREMENTS.**

**# 003 [25 Pa. Code §127.12b]**

**Plan approval terms and conditions.**

a) The permittee shall perform an extended annual shutdown of the Continuous Weld Furnace (Source 101) for major overhaul and maintenance (occurring at a minimum of once in any consecutive 12 month period) which shall include the following at a minimum:

**SECTION E. Source Group Restrictions.**

- 1) Burner adjustment/tuning.
- 2) refractory repair/replacement, and
- 3) refractory re-alignment.

b) The independent oxygen supply used by the furnace shall be continuously maintained to ensure optimum combustion efficiency. The oxygen supply shall be inspected daily at a minimum.

c) All burners shall undergo maintenance as needed to ensure proper tuning and air-fuel ratios. The burners shall be inspected monthly at a minimum.

[Additional authorization for this requirement is based on 25 Pa. Code Section 129.99 and 129.114]

**VII. ADDITIONAL REQUIREMENTS.**

No additional requirements exist except as provided in other sections of this permit including Section B (Title V General Requirements).

**\*\*\* Permit Shield in Effect. \*\*\***

**SECTION F. Alternative Operation Requirements.**

No Alternative Operations exist for this Title V facility.

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description		
031	600HP BOILER		
<b>Emission Limit</b>		<b>Pollutant</b>	
4.000	Lbs/MMBTU	Of heat input	SOX
0.400	Lbs/MMBTU	Heat input	TSP
1.000	Tons/Yr		VOC
032	400HP BOILER		
<b>Emission Limit</b>		<b>Pollutant</b>	
4.000	Lbs/MMBTU	Of heat input	SOX
0.400	Lbs/MMBTU	Heat input	TSP
1.000	Tons/Yr		VOC
033	1000HP NAT. GAS FIRED BOILER		
<b>Emission Limit</b>		<b>Pollutant</b>	
4.000	Lbs/MMBTU	Of heat input	SOX
0.400	Lbs/MMBTU	Heat input	TSP
2.700	Tons/Yr	on a 12-month rolling sum basis	VOC
101	CONTINUOUS WELD FURNACE		
<b>Emission Limit</b>		<b>Pollutant</b>	
47.180	Tons/Yr	(in any 12 consecutive month period).	NOX
500.000	PPMV	By volume, dry basis	SOX
0.040	gr/DRY FT3		TSP
2.700	Tons/Yr		VOC
102	#1 GALVANIZING KETTLE		
<b>Emission Limit</b>		<b>Pollutant</b>	
0.040	gr/DRY FT3		TSP
103	#2 GALVANIZING KETTLE		
<b>Emission Limit</b>		<b>Pollutant</b>	
3.970	Lbs/Hr		NOX
17.410	Tons/Yr	(in any 12 consecutive month period).	NOX
0.040	gr/DRY FT3		TSP
104	FINISHING DEPT. COATING LINE		
<b>Emission Limit</b>		<b>Pollutant</b>	
6.670	Lbs/Gal	Of coating solids.	VOC
110	#1 CHROMATE TREATMENT		
<b>Emission Limit</b>		<b>Pollutant</b>	
0.040	gr/DRY FT3		TSP



**SECTION G. Emission Restriction Summary.**

Source Id	Source Description			Emission Limit	Pollutant
111	#2 CHROMATE TREATMENT			0.040 gr/DRY FT3	TSP
112	COUPLING DEPT			0.040 gr/DRY FT3	TSP
113	#1 ID BLOW STATION			0.040 gr/DRY FT3	TSP
114	#2 ID BLOW STATION			0.040 gr/DRY FT3	TSP
115	#1 PM THREADER			10.340 Lbs/Gal	VOC
120	CONDUIT LINE ZINC METALLIZER			0.010 gr/DRY FT3	Filterable Only TSP
121	CONDUIT THREADER			10.340 Lb/Gal	VOC
133	#1 GALVANIZING FURNACE			500.000 PPMV	Dry basis, by volume SOX
				0.040 gr/DRY FT3	TSP
				1.000 Tons/Yr	VOC
134	#2 GALVANIZING FURNACE			500.000 PPMV	Dry basis, by volume SOX
				0.040 gr/DRY FT3	TSP
				1.000 Tons/Yr	VOC
137	MISC HEATERS			1.000 Tons/Yr	VOC

**SECTION G. Emission Restriction Summary.**

Source Id	Source Description
140	LIME SILO
<b>Emission Limit</b>	
0.040	gr/DRY FT3
<b>Pollutant</b>	
TSP	
143	ONE WASTE OIL SPACE HEATER
<b>Emission Limit</b>	
0.040	gr/DRY FT3
<b>Pollutant</b>	
SOX	
0.040	gr/DRY FT3
<b>Pollutant</b>	
TSP	
1.000	Tons/Yr
<b>Pollutant</b>	
VOC	
144	NATURAL GAS FUELED EMERGENCY GENERATORS (116 HP AND 450 HP)
<b>Emission Limit</b>	
500.000	PPMV dry basis
<b>Pollutant</b>	
SOX	
0.040	gr/DRY FT3
<b>Pollutant</b>	
TSP	
145	SULFURIC ACID PICKLING
<b>Emission Limit</b>	
2.700	Tons/Yr
<b>Pollutant</b>	
VOC	
146	100KW NATURAL GAS EMERGENCY GENERATOR (134 HP)
<b>Emission Limit</b>	
4.000	GRAMS/HP-Hr
<b>Pollutant</b>	
CO	
540.000	PPMV at 15% O2
<b>Pollutant</b>	
CO	
2.000	GRAMS/HP-Hr
<b>Pollutant</b>	
NOX	
160.000	PPMV at 15% O2
<b>Pollutant</b>	
NOX	
500.000	PPMV dry basis
<b>Pollutant</b>	
SOX	
0.040	gr/DRY FT3
<b>Pollutant</b>	
TSP	
1.000	GRAMS/HP-Hr
<b>Pollutant</b>	
VOC	
86.000	PPMV at 15% O2
<b>Pollutant</b>	
VOC	

**Site Emission Restriction Summary**

Emission Limit	Pollutant
----------------	-----------

**SECTION H. Miscellaneous.**

(a) There are no applicable emission limitation, testing, monitoring, reporting, recordkeeping, work practice and additional requirements for the following sources:

1. Endwelder ( ID No. 117 & 217)
2. Laboratory Hoods.
3. Stencil Ink usage
4. Superheaters #1,#2.
5. [Reserved]
6. 23 HP gasoline-powered portable welder.
7. Four Zinc recycling furnaces of 308,000 BTU/Hr heat input (each).
8. Pipe Cutting Saw

(b) All solvent used to flush and clean coating lines is an integral part of the surface coating process and is an allowable practice under this permit provided the emissions from the solvent usage is included with the total VOC emissions from each coating line.

(c) Source ID # 138: Misc. Parts washers consists of following solvent degreasers:

- (1) 80 Gallons solvent parts washer in Fab Shop.
- (2) 80 Gallons Mobil Equipment Garage solvent parts washer.
- (3) 80 Gallons Coupling Department solvent parts washer in Coupling Department
- (4) 40 Gallons solvent parts washer in threading floor.
- (5) 40 Gallons solvent parts washer in Slitter.
- (6) 40 Gallons solvent parts washer in Slitter.
- (7) 60 Gallons parts washer in Electrical shop.
- (8) 80 Gallons parts washer in Electrical shop.
- (9) 16 gallons parts washer in Machine shop.
- (10) 80 Gallons parts washer in Machine shop.
- (11) 30 Gallon parts washer in Low bay.
- (12) 40 Gallons parts washer in Testing Departments.

(d) Source ID #144: The facility has included 2 natural gas powered emergency generators as follows:

- 1.) Generac Standby Generator  
Model # G70/2472-0  
Test Run Time: Weekly - 20 minutes  
HP - 116 hp  
Install Date: October 15, 1986
- 2.) Kohler Power Systems  
Model # 275RZD  
Test Run Time: Weekly - 20 minutes  
HP - 450 hp  
Install Date: May 12, 2000

(e) This permit was renewed on July 1, 2010.

(f) This permit was renewed on June 9, 2015.

(g) Source 102, 103, 110, 111, 112, 113, 114, and 140 do not emit VOC and therefore these sources are not subject to RACT 2 per 129.96(a).

(h) Source 110, 111, 112, 113, 114, 140, and sulfuric acid pickling do not emit NOx and therefore these sources are not subject to

**SECTION H. Miscellaneous.**

RACT 2 per 129.96(a).

(i) Source 104, 106, 115, and 138 are exempt from RACT 2 per 129.96(a) because they are subject to requirements of 129.52.

(j) Source 105 (Double Random Coating Line) and Source 116 (#2 PM Threader) have been decommissioned or removed from the facility.

(k) This permit was administratively amended on April 24, 2017 to include the presumptive RACT 2 requirements.

(l) This permit was administratively amended on March 26, 2019, through a major modification that allowed for alternate RACT II requirements to be included in the facility Title V Operating Permit. This action addressed NOx emissions for sources 101, 102 and 103.

(m) This permit was administratively amended on March 20, 2020 to incorporate the requirements of plan approval 43-0182E.

(n) The Department authorized the installation and operation of two duct collectors to improve the indoor air quality from the tube blowout operations through RFD on February 7, 2017. The facility currently has two Mair Research Robo Vent Fusion Self Cleaning Cartridge Collectors rated at 4,000 cfm @ 10" S.P. The facility awaits manufacturer installation. The units are authorized to vent inside the building.

(o) This permit was administratively amended on October 18, 2021 to incorporate plan approval 43-182D and requirements of the First Modification of the Consent Order And Agreement Dated 1/4/2021 which was entered into September 30, 2021 between the DEP and the facility.

(p) This permit was modified on February 18, 2025 to incorporate RACT III applicability.



\*\*\*\*\* End of Report \*\*\*\*\*

---