

Application Type Renewal
Facility Type Municipal
Major / Minor Major

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Application No. PA0026085
APS ID 957773
Authorization ID 1211198

Applicant and Facility Information

Applicant Name	<u>Upper Merion Sanitary And Stormwater Authority</u>	Facility Name	<u>U Merion-Matsunk STP</u>
Applicant Address	<u>175 W Valley Forge Road</u> <u>King Of Prussia, PA 19406-1851</u>	Facility Address	<u>600 Mccoys Lane</u> <u>Swedeland, PA 19406</u>
Applicant Contact	<u>Anthony Hamaday</u>	Facility Contact	<u>Robert Mckernan</u>
Applicant Phone		Facility Phone	<u>(610) 275-0688</u>
Client ID	<u>72994</u>	Site ID	<u>449536</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Upper Merion Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Montgomery</u>
Date Application Received	<u>December 20, 2017</u>	EPA Waived?	<u>No</u>
Date Application Accepted	<u>May 8, 2018</u>	If No, Reason	<u>Major Sewage, Pretreatment</u>
Purpose of Application	<u>Permit Renewal.</u>		

Summary of Review


The PA Department of Environmental Protection (PADEP/Department) received an NPDES permit renewal application for Matsunk WPCC (facility) from Upper Merion Municipal Utility Authority (new name is Upper Merion Sanitary and Stormwater Authority, UMSSA) on December 20, 2017. The permit was drafted on September 8, 2018 and redrafted on October 27, 2018 and January 8, 2021. The redraft on July 2021 was as a result of a revision of a governing SOP. The updated SOP was reviewed and necessary changes are made in the draft permit and fact sheet. The facility is a Major Facility with design flow of 5.5 MGD and HDC of 6.88 MGD. The treated effluent discharges through Outfall 002 into a culvert to Schuylkill River, WWF/MF at RMI 22.26. The existing permit expired on June 30, 2018. The terms and conditions were automatically extended since the renewal application was received at least 180 days prior to permit expiration date. Renewal NPDES permit applications under Clean Water program are not covered by PADEP's PDG per 021-2100-001. This fact sheet is developed in accordance with 40 CFR §124.56.

Changes in the permit: TDS limit, total Copper limit with schedule, DO limit updated, TN monitoring, Dry and Wet weather PCB sampling, and E. Coli monitoring

Sludge use and disposal description and location(s): Sludge is handled through gravity thickener units prior to being dewatered by a rotary press that was installed in April 2014. The dewatered cake is stabilized with lime prior to being hauled to one of two Waste Management owned landfills. The landfills are Tullytown, PA Resource Recovery Facility and GROWS North landfill in Morrisville, PA.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
√		Reza H. Chowdhury, E.I.T. / Project Manager 	June 29, 2021
X		Pravin Patel Pravin C. Patel, P.E. / Environmental Engineer Manager	06/30/2021

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	002	Design Flow (MGD)	5.5
Latitude	40° 5' 38"	Longitude	-75° 19' 42"
Quad Name	Norristown	Quad Code	1843
Wastewater Description: Sewage Effluent			
Receiving Waters	Schuylkill River* (WWF, MF)	Stream Code	00833
NHD Com ID	133228925	RMI	22.26
Drainage Area	1770 mi ²	Yield (cfs/mi ²)	0.153
Q ₇₋₁₀ Flow (cfs)	271	Q ₇₋₁₀ Basis	Please see below
Elevation (ft)	42.85	Slope (ft/ft)	
Watershed No.	3-F	Chapter 93 Class.	WWF, MF
Existing Use	WWF/MF	Existing Use Qualifier	
Exceptions to Use	None	Exceptions to Criteria	N/A
Assessment Status	Impaired		
Cause(s) of Impairment	PCB		
Source(s) of Impairment			
TMDL Status	Finalized on 04/07/2007	Name	Schuylkill River PCB TMDL
Background/Ambient Data		Data Source	
pH (SU)	7.0		Default per 391-2000-013
Temperature (°C)	25		Default per 391-2000-013 for WWF
Hardness (mg/L)	212.67		Application Data
Other:			
Nearest Downstream Public Water Supply Intake	City of Philadelphia Queen Lane		
PWS Waters	Schuylkill River	Flow at Intake (cfs)	
PWS RMI	12.59	Distance from Outfall (mi)	≈ 9.67 miles

* The facility discharges directly into Frog Run (Pa Stream Code 00942) at RMI 0.4 mi. However, since Frog Run is essentially a culvert between the point of discharge and the Schuylkill River, the point of first use has been determined to be the Schuylkill River.

Changes Since Last Permit Issuance: None

Other Comments:

Streamflow:

Streamflow will be correlated with the USGS's web-based GIS application (<https://streamstats.usgs.gov/ss/>) accessed on October 22, 2020. Q₇₋₁₀ and Q₃₀₋₁₀ values at Outfall 002 were found to be 271 cfs and 326 cfs respectively. The drainage area at Outfall 002 was found to be 1770 mi² from StreamStats.

$$Q_{7-10} \text{ runoff rate} = 271 \text{ cfs} / 1770 \text{ mi}^2 = 0.153 \text{ cfs/mi}^2$$

$$Q_{30-10}/Q_{7-10} = 326 \text{ cfs}/271 \text{ cfs} = 1.2$$

Default Q₁₋₁₀: Q₇₋₁₀ of 0.64 from 391-2000-007 will be used in modeling, if needed.

DEP's SOP (BPMPM-PMT-033, revised Oct 1, 2020) section II.B.4 states that where a facility is eligible for technology based limits of CBOD₅ exceeding 25 mg/l, application managers will evaluate a WQBEL for CBOD₅ as follows:

- a. Model the discharge using Toxics Management Spreadsheet (TMS)
- b. Multiply the acute partial mix factor by the Q₇₋₁₀ of the receiving waters

- c. Run the WQM 7.0 model using the adjusted Q_{7-10} and apply the WQBEL in the permit, if less than the technology-based limits
- d. Establish the average monthly concentration limit for TSS at the same concentration as for $CBOD_5$ using BPJ, if the $CBOD_5$ limit is a WQBEL

The attached TMS model suggested a PMFa of 6.5%. A partial mixing factor, according to DEP's technical guidance (391-2000-011), is used to describe the fractional portion of the stream that mixes with the discharge at the criteria compliance times. The partial mix factor is a value between 0 and 1; 1 representing complete mixing and less than 1 represents there is incomplete mixing between the discharge and the stream. Therefore, the revised Q_{7-10} will be **271 * 0.065 or 17.62 cfs**.

PWS Intake:

The nearest downstream public water supply is City of Philadelphia at Queen Lane intake, on Schuylkill River at RMI 12.59. Its approximately 9.67 miles downstream of Outfall 002.

Wastewater Characteristics:

A median pH of 7.0 from daily DMR during dry months July through September for the year 2020 and a default temperature of 20°C (per 391-2000-013) will be used for modeling, if needed. The application data indicated an average Total Hardness of 210 mg/l out of 3 samples.

Background data:

There is currently no nearby StreamGage or WQN stations from Outfall 002. In absence of site-specific temperature data, a default temperature of 25°C and default pH of 7.0 (per 391-2000-013, WWF) will be used in modeling, if needed. The application data indicated stream hardness of 212.67 mg/l.

303d Listed Streams:

Schuylkill River is impaired for Fish Consumption and Aquatic Life due to PCB but supporting Potable Water Use. A TMDL has been finalized by EPA on 04/07/2007 for PCB.

Schuylkill River PCB TMDL:

During the previous permit cycle, the permittee collected one wet weather and one dry weather sample and analyzed for PCBs using Method 1668A. The results were: 10,673 pg/l (WW 04/08/2014); 1,404 pg/l (DW 05/2014)

The PCB results indicate that there are PCB concentrations that are above natural background and statewide surface water criteria levels. Based on the concentration of PCBs and volume of wastewater, this facility is considered a less significant source of PCBs.

The facility is required to develop and implement a PCB PMP (Pollution Minimization Plan). PCB sampling using Analytical Method 1668A is required to provide a baseline PCB level and to show progress towards achieving the instream PCB criteria of 64 pg/l. Guidelines developed by DRBC for the Delaware River TMDL recommends 1/year dry and wet weather sampling using method 1668A for POTWs influenced by wet weather. The facility is also required to submit annual PMP reports.

Antidegradation (93.4):

The effluent limits for this discharge have been developed to ensure that existing in-stream water uses and the level of water quality necessary to protect the existing uses are maintained and protected. The receiving streams are designated as Warm Water Fishes (WWF) and Migratory Fishes (MF.) No High Quality stream or Exceptional Value water is impacted by this discharge, therefore, no Antidegradation Analysis is performed for the discharge.

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>003</u>	Design Flow (MGD)	<u>0</u>
Latitude	<u>40° 5' 41"</u>	Longitude	<u>-75° 19' 43"</u>
Quad Name	<u>Norristown</u>	Quad Code	<u>1843</u>
Wastewater Description:	<u>Stormwater</u>		

Changes Since Last Permit Issuance: None
Other Comments:

Per Phase II stormwater regulations, major POTWs are required to have a permit for the discharge of stormwater. Therefore, stormwater monitoring requirements are included in Part A and Part C of the permit for this outfall.

Treatment Facility Summary				
Treatment Facility Name: Matsunk STP				
WQM Permit No.	Issuance Date			
4620403	08/06/2020			
4620402	08/19/2020			
4619409	02/30/2020			
4609407 A-1	08/15/2013			
4612405	08/27/2012			
4609407	01/19/2010			
WQG02460821	11/10/2008			
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Trickling Filter With Settling	Gas Chlorine	5.5
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
6.88	11400	Not Overloaded		

Changes Since Last Permit Issuance: None

Treatment Plant Description

Matsunk WPCC is a 5.5 MGD Major Sewer Facility (MASF2) located in Upper Merion Township, Montgomery County which discharges treated sewage through outfall 002 into a culvert to Schuylkill River in watershed 3-F. This is a trickling filter, alternative to secondary treatment facility and chlorine disinfection system. The treatment train consists of influent screening and grit removal, off-line flow equalization, primary clarifier, secondary biological treatment through oxidation towers and RBCs for advanced organic and ammonia treatment, secondary clarifier, and disinfection by sodium hypochlorite. The effluent is dechlorinated using sodium bisulfite.

The facility receives flows mostly from Upper Merion Township and small contributions from few other townships as listed in the next page.

Municipalities served	Flow contribution (%)	Type of Sewer System	
		Separate (%)	Combined (%)
Upper Merion Township	±95	100	0
Tredyffrin Township	4.0	100	0
Radnor Township	<0.5	100	0
West Conshohocken Township	<0.5	100	0

Per the renewal application, there is no significant or categorical industrial facility that discharges into the collection system.

Per PADEP's most recent inspection on September 29, 2020, the treatment train consists of the following treatment units:

- Three primary clarifiers

- Four trickling filters
- Twenty Rotating Biological Contactors
- Four secondary clarifiers
- Two chlorine contact tanks
- One grit removal
- One influent screen
- Two sludge thickeners

Sodium Hypochlorite is used at a maximum rate of 33.3 GPH and Sodium Bisulfite is used at maximum rate of 2.1 GPH.

Pre-treatment Program implementation:

Facilities greater than 5.0 MGD or less than 5.0 MGD with categorical and significant industrial users are required to develop or implement an EPA administered pre-treatment program. The facility is implementing an approved pretreatment program for which most recent local limits were approved by EPA in March 2017. The Part C of the permit will require continuation of the pre-treatment program implementation.

Biosolids Management:

Sludge is handled through gravity thickener units prior to being dewatered by a rotary press that was installed in April 2014. The dewatered cake is stabilized with lime prior to being hauled to one of two Waste Management owned landfills. The landfills are Tullytown, PA Resource Recovery Facility and GROWS North landfill in Morrisville, PA.

Summary of Inspections:

09/29/2020: RTPT conducted. No violation noted. Secondary clarifier #4 was repaired. Final effluent looked very good. No sign of matting or ponding on the trickling filters.

04/20/2020: RTPT conducted. No violation noted. The cause of overflow was due to residents flushing wipes. Final effluent looked great.

12/19/2019: CEI conducted. No violation identified. A new sludge press was installed. Overall, the treatment plant seemed to be operating well. Final effluent looked clear and receiving stream looked good as well.

05/14/2019: RTPT conducted. No violation identified.

01/17/2019: CEI conducted. No violation noted. Effluent looked clear and the receiving stream looked good as well. Overall, the treatment plant seemed operating well.

08/01/2018: CEI conducted. No violation noted. Effluent looked clear and the receiving stream looked good as well. Overall, the treatment plant seemed operating well.

05/18/2017: CEI conducted. No violation noted. Effluent looked clear and the receiving stream looked good as well. Overall, the treatment plant seemed operating well.

09/29/2016: CEI conducted. No violation noted. Effluent looked clear and the receiving stream looked good as well. Overall, the treatment plant seemed operating well.

Compliance History

DMR Data for Outfall 002 (from May 1, 2020 to April 30, 2021)

Parameter	APR-21	MAR-21	FEB-21	JAN-21	DEC-20	NOV-20	OCT-20	SEP-20	AUG-20	JUL-20	JUN-20	MAY-20
Flow (MGD) Average Monthly	3.234	3.97	3.395	3.132	3.535	2.805	2.678	2.748	3.408	3.023	2.969	3.125
Flow (MGD) Daily Maximum	3.993	6.416	6.296	4.296	6.385	5.904	4.547	3.102	7.68	3.403	4.074	3.909
pH (S.U.) Minimum	7.3	7.3	7.2	7.3	7.3	6.7	6.7	6.8	6.7	6.5	6.7	6.6
pH (S.U.) Maximum	8.1	7.7	7.6	7.7	7.6	7.9	7.4	8.0	7.3	7.1	7.2	7.7
DO (mg/L) Minimum	8.1	9.3	8.9	9.8	9.3	8.6	8.2	8.6	8.1	8.4	8.7	9.1
TRC (mg/L) Average Monthly	< 0.1	< 0.1	< 0.1	< 0.2	< 0.2	< 0.1	< 0.2	< 0.1	< 0.3	0.2	< 0.2	< 0.2
TRC (mg/L) Instantaneous Maximum	0.52	0.38	0.39	0.9	0.5	0.37	0.57	0.41	0.91	0.32	0.85	0.47
CBOD5 (lbs/day) Average Monthly	190	205	< 150	< 104	< 115	< 68	< 64	< 61	< 76	< 65	< 70	< 91
CBOD5 (lbs/day) Raw Sewage Influent Average Monthly	4117	3955	3962	3236	3072	2786	3400	3358	3817	2850	3322	3863
CBOD5 (lbs/day) Weekly Average	199	285	185	114	159	75	91	< 70	< 104	< 90	< 77	< 124
CBOD5 (mg/L) Average Monthly	7	6	< 5	< 4	< 4	< 3	< 3	< 3	< 3	< 3	< 3	< 3
CBOD5 (mg/L) Raw Sewage Influent Average Monthly	154	121	143	127	108	120	154	152	135	115	134	149
CBOD5 (mg/L) Weekly Average	7.9	7.6	6	4.2	4.8	3.4	3.7	< 3.1	< 3.3	< 4	< 2.9	< 4.4
BOD5 (lbs/day) Raw Sewage Influent Average Monthly	4080	4239	4319	5174	3869	5204	4792	3898	5525	4431	3682	4145
BOD5 (mg/L) Raw Sewage Influent Average Monthly	149	129	177	194	136	182	209	175	216	168	155	161
TSS (lbs/day) Average Monthly	372	< 423	< 253	< 211	377	223	< 179	173	256	187	230	255

**NPDES Permit Fact Sheet
U Merion-Matsunk STP**

NPDES Permit No. PA0026085

TSS (lbs/day) Raw Sewage Influent Average Monthly	3426	2990	3209	3316	3070	3575	3942	3786	4667	3760	3697	3994
TSS (lbs/day) Weekly Average	462	597	342	234	502	248	387	202	369	228	267	287
TSS (mg/L) Average Monthly	14	< 13	< 9	< 8	12	10	< 8	8	9	8	9	10
TSS (mg/L) Raw Sewage Influent Average Monthly	128	91	113	129	108	155	177	165	159	149	149	155
TSS (mg/L) Weekly Average	16	18	11	8	16	11	16	9	10	9	11	11
Fecal Coliform (CFU/100 ml) Geometric Mean	< 7	< 10	< 7	< 9	< 17	< 19	< 13	< 10	< 9	< 6	< 5	< 6
Fecal Coliform (CFU/100 ml) Instantaneous Maximum	31	290	52	133	100	239	94	82	290	320	40	192
Ammonia (lbs/day) Average Monthly	< 4	< 6	< 4	< 19	< 24	< 3	< 13	< 2	< 3	< 3	< 5	< 3
Ammonia (mg/L) Average Monthly	< 0.14	< 0.17	< 0.16	< 0.72	< 0.78	< 0.14	< 0.59	< 0.1	< 0.11	< 0.11	< 0.19	< 0.11
Total Phosphorus (lbs/day) Average Monthly	71	98	63	82	65	73	94	82	89	116	76	93
Total Phosphorus (mg/L) Average Monthly	2.5	1.83	2.96	2.49	2.41	3.2	4.44	3.98	3.61	3.9	3.3	3.29

DMR Data for Outfall 003 (from May 1, 2020 to April 30, 2021)

Parameter	APR-21	MAR-21	FEB-21	JAN-21	DEC-20	NOV-20	OCT-20	SEP-20	AUG-20	JUL-20	JUN-20	MAY-20
pH (S.U.) Annual Average					7.2							
CBOD5 (mg/L) Annual Average					16.7							
COD (mg/L) Annual Average					102							
TSS (mg/L) Annual Average					11							
Oil and Grease (mg/L) Annual Average					< 5							

**NPDES Permit Fact Sheet
U Merion-Matsunk STP**

NPDES Permit No. PA0026085

Fecal Coliform (CFU/100 ml) Annual Average					11600							
TKN (mg/L) Annual Average					1.87							
Total Phosphorus (mg/L) Annual Average					0.24							
Dissolved Iron (mg/L) Annual Average					0.04							

Compliance History: No eDMR violation was noted in last 12 months.

DRAFT

Existing Effluent Limitations and Monitoring Requirements

The table below summarizes effluent limitations and monitoring requirements specified in the existing final NPDES (amended) permit that was in effect between July 1, 2014 to June 30, 2018.

For Outfall 002:

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day)		Concentrations (mg/L)				Minimum Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Recorded
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	4.0	XXX	XXX	XXX	1/day	Grab
Total Residual Chlorine	XXX	XXX	XXX	0.5	XXX	1.2	1/day	Grab
CBOD5 Influent	Report	XXX	XXX	Report	XXX	XXX	1/day	24-Hr Composite
CBOD5 May 1 - Oct 31	1,033	1,549	XXX	18	27	36	1/day	24-Hr Composite
CBOD5 Nov 1 - Apr 30	1,434	2,180	XXX	25	38	50	1/day	24-Hr Composite
BOD5 Influent	Report	XXX	XXX	Report	XXX	XXX	1/week	24-Hr Composite
Total Suspended Solids Influent	Report	XXX	XXX	Report	XXX	XXX	1/day	24-Hr Composite
Total Suspended Solids	1,721	2,582	XXX	30	45	60	1/day	24-Hr Composite
Fecal Coliform (CFU/100 ml)	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	1/day	Grab
Ammonia-Nitrogen May 1 - Oct 31	344	XXX	XXX	6.0	XXX	12.0	1/day	24-Hr Composite
Ammonia-Nitrogen Nov 1 - Apr 30	1,033	XXX	XXX	18.0	XXX	36.0	1/day	24-Hr Composite
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	1/month	24-Hr Composite

For Outfall 003:

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day)		Concentrations (mg/L)				Minimum Measurement Frequency	Required Sample Type
	Average Monthly		Minimum	Annual Average		Instant. Maximum		
pH (S.U.)	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
CBOD5	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Chemical Oxygen Demand	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Total Suspended Solids	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Oil and Grease	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Fecal Coliform (CFU/100 ml)	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Total Kjeldahl Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Dissolved Iron	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab

Development of Effluent Limitations

Outfall No. <u>002</u>	Design Flow (MGD) <u>5.5</u>
Latitude <u>40° 5' 38"</u>	Longitude <u>-75° 19' 42"</u>
Wastewater Description: <u>Sewage Effluent</u>	

Technology-Based Limitations

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Fecal Coliform	200 / 100 ml	Geo Mean	DRBC	92a.47(a)(5)
Fecal Coliform	1,000 / 100 ml	IMAX	DRBC	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Comments: These standards apply, subject to Water Quality Analysis and BPJ where applicable.

Water Quality-Based Limitations

Water Quality-Based Limitations

WQM 7.0:

WQM 7.0 version 1.0b is a water quality model designed to assist DEP to determine appropriate effluent limits for CBOD₅, NH₃-N and DO. The model simulates two basic processes. In the NH₃-N module, the model simulates the mixing and degradation of NH₃-N in the stream and compares calculated instream NH₃-N concentrations to NH₃-N water quality criteria. In the D.O. module, the model simulates the mixing and consumption of D.O. in the stream due to the degradation of CBOD₅ and NH₃-N and compares calculated instream D.O. concentrations to D.O. water quality criteria. Since WQM 7.0 assumes immediate and complete mix between the discharge and stream flow, Q₇₋₁₀ was adjusted, as shown on page 3, to examine allowable wasteload allocations under appropriate mixing conditions. The model was utilized for this permit renewal by using adjusted Q₇₋₁₀ and historic background water quality levels of the river. In addition, due to proximity, several other upstream and downstream dischargers are included in the multiple discharge scenario. The following data were used in the attached computer model of the stream:

- Discharge pH 7.0 (median Jul-Sep, 2020, DMR data)
- Discharge Temperature 20°C (Default per 391-2000-013)
- Discharge Hardness 210 mg/l (Application data)
- Stream pH 7.0 (Default per 391-2000-013)
- Stream Temperature 25°C (Default per 391-2000-013, WWF)
- Stream Hardness 212.67 mg/l (Application data)

The following nodes were considered in modeling:

Node 1: Norristown STP (PA0027421) Outfall 001 at Schuylkill River (00833)
Elevation: 49 ft (USGS National Map viewer, 11/13/2019)

Drainage Area: 1766 mi² (StreamStat Version 3.0, 11/13/2019)
River Mile Index: 23.4 (PA DEP eMapPA)
Low Flow Yield: 0.125 cfs/mi²
Discharge Flow: 9.75 MGD

Node 2: ENPWJSA STP (PA0026816) Outfall 001 at Schuylkill River (00833)
Elevation: 48 ft (USGS National Map viewer, 11/13/2019)
Drainage Area: 1766.1 mi² (StreamStat Version 3.0, 11/13/2019)
River Mile Index: 22.94 (PA DEP eMapPA)
Low Flow Yield: 0.125 cfs/mi²
Discharge Flow: 8.1 MGD

Node 3: Bridgeport WWTP Outfall 001 at Schuylkill River (00833)
Elevation: 43.79 ft (USGS National Map viewer, 11/13/2019)
Drainage Area: 1769.9 mi² (StreamStat Version 3.0, 11/13/2019)
River Mile Index: 22.79 (PA DEP eMapPA)
Low Flow Yield: 0.125 cfs/mi²
Discharge Flow: 0.9 MGD

Node 4: Matsunk STP Outfall 002 at Schuylkill River (00833)
Elevation: 42.85 ft (USGS National Map viewer, 06/25/2021)
Drainage Area: 1770.0 mi² (StreamStat Version 3.0, 06/25/2021)
River Mile Index: 22.26 (PA DEP eMapPA)
Low Flow Yield: 0.153 cfs/mi²
Discharge Flow: 5.5 MGD

Node 5: At the Plymouth Dam on Schuylkill River (00833)
Elevation: 39.59 ft (USGS National Map viewer, 11/13/2019)
Drainage Area: 1770.1 mi² (StreamStat Version 3.0, 11/13/2019)
River Mile Index: 21.22 (PA DEP eMapPA)
Low Flow Yield: 0.153 cfs/mi²
Discharge Flow: 0.0 MGD

Node 6: At RMI 21.025
Elevation: 38.74 ft (USGS National Map viewer, 06/29/2021)
Drainage Area: 1780 mi² (StreamStat Version 3.0, 06/28/2021)
River Mile Index: 21.025 (PA DEP eMapPA)
Low Flow Yield: 0.15 cfs/mi²
Discharge Flow: 0.0 MGD

Ammonia (NH₃-N), Carbonaceous Biochemical Oxygen Demand (CBOD₅), & Dissolved Oxygen (DO):

WQM 7.0 version 1.0b is a water quality model designed to assist DEP to determine appropriate effluent limits for CBOD₅, NH₃-N and DO. The model simulates two basic processes. In the NH₃-N module, the model simulates the mixing and degradation of NH₃-N in the stream and compares calculated instream NH₃-N concentrations to NH₃-N water quality criteria. In the D.O. module, the model simulates the mixing and consumption of D.O. in the stream due to the degradation of CBOD₅ and NH₃-N and compares calculated instream D.O. concentrations to D.O. water quality criteria. The model was utilized for this permit renewal by using Q₇₋₁₀ and current background water quality levels of the stream.

NH₃-N:

WQM 7.0 suggested NH₃-N limit of 6.0 mg/l as monthly average and 12.0 mg/l as IMAX limit during summer to protect water quality standards. These values are the same as existing permitted limits. Recent DMR data show that the plant is meeting the permit limits. The average monthly mass loading is calculated to be 344 lbs./day. The existing winter season limits of 18.0 mg/l as average monthly and 36.0 mg/l as IMAX limit will be carried over in this renewal. Winter average monthly mass limit was calculated as 1033 lbs./day.

CBOD₅:

The WQM 7.0 model suggests a monthly average CBOD₅ limit of 18 mg/l. The average monthly and average weekly mass loadings were calculated as 1033 lbs/day and 1549 lbs/day respectively. The current permit has seasonal limit for CBOD₅ which will be carried over in this renewal. Seasonal limit for CBOD₅ is allowed in PADEP's guidance (391-2000-003). The mass limit for winter season is calculated to be 1434 lbs./day as monthly average and 2180 lbs./day as weekly average. Minimum monitoring frequency will remain the same as 1/day, 24-hr composite sampling.

Dissolved Oxygen (DO):

The existing permit has a minimum DO of 4.0 mg/l. Per Pa Code 25 Ch.93.7, a minimum DO of 5.0 is required for WWF. This is also supported by WQM 7.0 output.

Toxics:

Based on the available data, PADEP utilizes Toxics Management Spreadsheet (TMS) to (1) evaluate reasonable potential for toxic pollutants to cause or contribute to an excursion above the water quality standards and (2) develop WQBELs for those such toxic pollutants (i.e., 40 CFR § 122.44(d)(1)(i)). It is noteworthy that some of these pollutants that may be reported as "non-detect", but still exceeded the criteria, were determined to be candidates for modeling because the method detection levels used to analyze those pollutants were higher than target QLs and/or the most stringent Chapter 93 criteria. The model then recommended the appropriate action for the Pollutants of Concerns based on the following logic:

1. In general, establish limits in the draft permit where the effluent concentration determined in B.1 or B.2 equals or exceeds 50% of the WQBEL (i.e., RP is demonstrated). Use the average monthly, maximum daily and instantaneous maximum (IMAX) limits for the permit as recommended by the TMS (or, if appropriate, use a multiplier of 2 times the average monthly limit for the maximum daily limit and 2.5 times the average monthly limit for IMAX).
2. For non-conservative pollutants, in general, establish monitoring requirements where the effluent concentration determined in B.1 or B.2 is between 25% - 50% of the WQBEL.
3. For conservative pollutants, in general, establish monitoring requirements where the effluent concentration determined in B.1 or B.2 is between 10% - 50% of the WQBEL.

NOTE 4 – If the effluent concentration determined in B.1 or B.2 is "non-detect" at or below the target quantitation limit (TQL) for the pollutant as specified in the TMS and permit application, the pollutant may be eliminated as a candidate for WQBELs or monitoring requirements unless 1) a more sensitive analytical method is available for the pollutant under 40 CFR Part 136 where the quantitation limit for the method is less than the applicable water quality criterion and 2) a detection at the more sensitive method may lead to a determination that an effluent limitation is necessary, considering available dilution at design conditions.

NOTE 5 – If the effluent concentration determined in B.1 or B.2 is a detection below the TQL but above or equal to the applicable water quality criterion, WQBELs or monitoring may be established for the pollutant.

4. Application managers may, on a site- and pollutant-specific basis, deviate from these guidelines where there is specific rationale that is documented in the fact sheet.

Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			
Total Dissolved Solids (PWS)	Report	Report	Report	Report	Report	mg/L	N/A	N/A	Special Monitoring Applies
Chloride (PWS)	Report	Report	Report	Report	Report	mg/L	N/A	N/A	Special Monitoring Applies
Bromide	Report	Report	Report	Report	Report	mg/L	N/A	N/A	Special Monitoring Applies
Sulfate (PWS)	Report	Report	Report	Report	Report	mg/L	N/A	N/A	Special Monitoring Applies
Total Copper	2.05	2.71	44.7	59.1	112	µg/L	44.7	AFC	Discharge Conc ≥ 50% WQBEL (RP)
Total Zinc	Report	Report	Report	Report	Report	µg/L	451	AFC	Discharge Conc > 10% WQBEL (no RP)
1,4-Dioxane	Report	Report	Report	Report	Report	µg/L	N/A	N/A	Special Monitoring Applies
Benzo(a)Anthracene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
Benzo(a)Pyrene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
3,4-Benzofluoranthene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
Benzo(k)Fluoranthene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
Chrysene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
Dibenzo(a,h)Anthracene	0.014	0.022	0.3	0.47	0.76	µg/L	0.3	CRL	Discharge Conc ≥ 50% WQBEL (RP)
Indeno(1,2,3-cd)Pyrene	0.003	0.004	0.059	0.091	0.15	µg/L	0.059	THH	Discharge Conc ≥ 50% WQBEL (RP)
Phenanthrene	0.45	0.71	9.88	15.4	24.7	µg/L	9.88	AFC	Discharge Conc ≥ 50% WQBEL (RP)

Each of the parameters are discussed below:

TDS and its constituents:

TMS suggests monitoring for TDS and its constituents if there is PWS concern. The nearest downstream PWS is approximately 10 miles for which this discharge apparently poses no threat. The facility has an approved DRBC docket (D-1987-013 CP-3) issued on September 13, 2018. The Docket requires TDS limit of 1,000 mg/l quarterly. Therefore, a TDS limit of 1,000 mg/l with quarterly monitoring will be placed in the permit.

Total Copper: The application provided three sample results for Total Copper. On PADEP's request, US EPA provided additional 28 sample results from pretreatment effluent data for the reporting period between 2013-2019. All data were plugged into PADEP's TOXCONC to determine AMEC and daily CoV values. TOXCONC calculated an AMEC of 52.0268 ug/l and CoV of 0.2714. These values were utilized in TMS. As shown in the below table, TMS suggests AML of 29.5 ug/l, MDL of 39.1 ug/l, IMAX of 73.8 ug/l, calculated mass AML of 1.69 lbs./day, and mass MDL of 2.24 lbs./day. Since this is a new parameter, PADEP provided the permittee with a Pre-Draft survey. The permittee returned the pre-draft survey which indicated that the permittee is not aware of the source of the pollutant, suspected the source to be from domestic plumbing systems, haven't conducted any studies regarding the control or treatment of the pollutant, doesn't believe it can achieve the proposed WQBEL now, indicated their plant do not treat the pollutant, and uncertain about the estimated date by which it can achieve the proposed WQBEL. Therefore, PADEP followed the instructions illustrated in the SOP titled "Establishing Water Quality-Based Effluent Limitations (WQBELs) and Permit Conditions for Toxic Pollutants in NPDES Permits for Existing Discharges" (SOP No. BCW-PMT-037, revised May 20, 2021). Per the SOP, PADEP has made the following determination:

1. a compliance schedule will be placed in the permit with monitoring requirements for first three years of the permit term and proposed WQBELs for remaining two years, since the permittee indicated that they are uncertain when compliance could be achieved with final WQBEL.
2. Some of the values used in the TMS spreadsheet are default values in absence of site-specific data. Those values are identified in this fact sheet pages 2, 3, and 11. The permittee is required to conduct site specific data collection to refine the accuracy of the WQBEL for the default or model-driven input values. A special Part C condition will be added in the Part C of the draft permit.
3. Since the source of toxic pollutant is unknown or are suspected, the permittee will be required to conduct a Toxics Reduction Evaluation (TRE) to investigate and control the source(s) of the pollutant subject to final WQBEL. The permittee suspected the domestic plumbing system be the source of Copper. Therefore, the TRE study must include a Corrosion Control Feasibility Study.

1,4-Dioxane: TMS initially suggests monitoring for 1,4-Dioxane. No monitoring was suggested when the updated model was utilized.

Semi-volatiles:

TMS suggested monitoring for all eight semi-volatiles as listed above. However, the QL (5 ug/l) used by the lab is higher than PADEP's TQL (2.5 ug/l) and all three results for each semi-volatiles came as non-detect. Therefore, it is still unclear if they are actually a pollutant of concern or not. Per the response on pre-draft survey, the permittee agreed to provide four additional test results for each of the semi-volatiles using PADEP's TQL. The sampling will be 24-hr composite, 1 week apart. PADEP received retest results on January 4, 2021 and TMS was again utilized. TMS determined that no limits or monitoring is needed for any of the semi-volatiles.

The updated TMS output table is provided below:

Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			
Total Copper	1.35	1.79	29.5	39.1	73.8	µg/L	29.5	AFC	Discharge Conc ≥ 50% WQBEL (RP)
Total Zinc	Report	Report	Report	Report	Report	µg/L	311	AFC	Discharge Conc > 10% WQBEL (no RP)

Whole Effluent Toxicity Testing (WETT):

The permittee provided four WETT sample results with the application dated March 2017, April 2016, May 2015, and October 2014. The tests in 2014, 2015, and 2016 were conducted by QC laboratories or Eurofins QC, Inc. The Department has determined that WET tests analyzed by QC Laboratories or Eurofins QC prior to February 2017 are unreliable and are considered invalid due to technical issues. As a result, the application didn't include four valid WET tests required to perform a reasonable potential analysis. However, the permittee provided annual WETT results for the year 2018 and 2019 that added to three valid tests. 2020 WET test results were received on January 4, 2021. PADEP utilized the WETT Analysis Spreadsheet to determine RP and update the dilution series. The updated TIWCC was calculated to be 6% to evaluate the test results for a stream flow of 271 cfs, discharge flow of 5.5 MGD, and PMF_c of 0.453. The WET tests are discussed in detail on pages 15-16 of this report.

Additional Considerations

Fecal Coliform:

The recent coliform guidance in 25 Pa. code § 92a.47.(a)(4) requires a summer technology limit of 200/100 ml as a geometric mean and an instantaneous maximum not greater than 1,000/100ml and § 92a.47.(a)(5) requires a winter limit of 2,000/100ml as a geometric mean and an instantaneous maximum not greater than 10,000/100ml. Delaware River Basin Commission's (DRBC's) Water Quality Regulations at Section 4.30.4.A requires that during winter season from October through April, the instantaneous maximum concentration of fecal coliform organisms shall not be greater than 1,000 per 100 milliliters in more than 10 percent of the samples tested. Therefore, the summer limit is governed by DEP's regulation while winter limit is governed by DRBC's regulation.

E. Coli:

DEP's SOP titled "Establishing Effluent Limitations for Individual Sewage Permits (BCW-PMT-033, revised March 24, 2021) recommends monthly E. Coli monitoring for all major sewage dischargers. This requirement will be applied from this permit term.

pH:

The TBEL for pH is above 6.0 and below 9.0 S.U. (40 CFR §133.102(c) and Pa Code 25 § 95.2(1)) which are existing limits and will be carried over.

Total Suspended Solids (TSS):

There is no water quality criterion for TSS. The existing limits of 30 mg/L average monthly, 45 mg/l average weekly, and 60 mg/L instantaneous maximum will remain in the permit based on the minimum level of effluent quality attainable by secondary treatment, 25 Pa. Code § 92a.47 and 40CFR 133.102(b). The mass based average monthly and weekly average limits are calculated to be 1376.1 lbs./day and 2064.15 lbs./day respectively, which are rounded down to 1375 lbs./day and 2060 lbs./day, respectively (362-0400-001).

Total Residual Chlorine (TRC):

The attached computer printout utilizes the equation and calculations as presented in the Department's 2003 Implementation Guidance for Total Residual Chlorine (TRC) (ID#391-2000-015) for developing chlorine limitations. The attached printout indicates that a water quality limit of 0.5 mg/l would be needed to prevent toxicity concerns at the discharge point for Outfall 002. The Instantaneous Maximum (IMAX) limit is 1.6 mg/l. The existing permit has AML limit of 0.5 mg/l and IMAX limit of 1.2 mg/l. The IMAX is a little more stringent and will be carried over due to anti-backsliding policy. DMR data from October 2019 to September 2020 indicates that the plant is discharging below the existing limits. The minimum monitoring frequency is 1/day.

Flow and Influent BOD₅, CBOD₅, and TSS Monitoring Requirement:

The requirement to monitor the volume of effluent will remain in the draft permit per 40 CFR § 122.44(i)(1)(ii). Influent BOD₅ and TSS monitoring requirements are established in the permit per the requirements set in Pa Code 25 Chapter 94. To show compliance with percentage removal efficiency of CBOD₅, reporting for influent CBOD₅ will remain in the permit.

Best Professional Judgement (BPJ):

Total Phosphorus:

Existing monthly monitoring requirement will be carried over in this renewal.

Monitoring Frequency and Sample Types:

Otherwise specified above, the monitoring frequency and sample type of compliance monitoring for existing parameters are recommended by DEP's SOP and Permit Writers Manual and/or on a case-by-case basis using best professional judgment (BPJ).

Total Nitrogen:

PADEP's SOP BCW-PMT-033 suggests monitoring requirement, at a minimum, for facilities with design flow greater than 2,000 GPD. This requirement is applied for all facilities meeting the flow criteria.

Mass-based limits calculation:

The mass-based limits for NH₃-N, CBOD₅, TSS, and Total Copper were calculated based on maximum monthly flow (hydraulic design flow) instead of average annual design flow. The reason behind this exception is that the permittee indicated a comprehensive discussion in November 2000 with PADEP which included permittee's proactive program of addressing I&I issues by expending the WWTF to process higher flows and agreements with other municipalities in light of hydraulic flow. PADEP conducted a document search in 2013 regarding this issue and confirmed that hydraulic design flow was agreed upon to use in mass calculation. In 2013, USEPA recommended to add the following footnote in the Part A of the permit "The effluent limits for Outfall 002 were determined using an annual average discharge rate of 5.5 million gallons per day and maximum monthly discharge rate of 6.88 million gallons per day."

Anti-Backsliding

The proposed limits are at least as stringent as are in existing permit, unless otherwise stated; therefore, anti-backsliding is not applicable.

Development of Effluent Limitations

Outfall No.	003	Design Flow (MGD)	0
Latitude	40° 5' 39.00"	Longitude	-75° 19' 43.00"
Wastewater Description: Stormwater			

Outfall 003 is a stormwater only outfall. Per Phase II stormwater regulations, major POTWs are required to have a permit for the discharge of stormwater. Therefore, stormwater monitoring requirements are included in Part A and Part C of the permit for this outfall. The existing monitoring requirements will be carried over in this renewal.

Whole Effluent Toxicity (WET)

For Outfall 002, Acute Chronic WET Testing was completed:

- For the permit renewal application (4 tests).
- Quarterly throughout the permit term.
- Quarterly throughout the permit term and a TIE/TRE was conducted.

Other:

The dilution series used for the tests was: 100%, 60%, 30%, 2%, and 1%. The Target Instream Waste Concentration (TIWC) to be used for analysis of the results is: 2%.

Summary of Four Most Recent Test Results

(NOTE – Enter results into one table, depending on which data analysis method was used).

TST Data Analysis

(NOTE – In lieu of recording information below, the application manager may attach the DEP WET Analysis Spreadsheet).

Test Date	Ceriodaphnia Results (Pass/Fail)		Pimephales Results (Pass/Fail)	
	Survival	Reproduction	Survival	Growth
4/4/2017	Pass	Pass	Pass	Pass
11/6/2018	Pass	Pass	Pass	Pass
11/5/2019	Pass	Pass	Pass	Pass
12/08/2020	Pass	Pass	Pass	Pass

* A “passing” result is that in which the replicate data for the TIWC is not statistically significant from the control condition. This is exhibited when the calculated t value (“T-Test Result”) is greater than the critical t value. A “failing” result is exhibited when the calculated t value (“T-Test Result”) is less than the critical t value.

Is there reasonable potential for an excursion above water quality standards based on the results of these tests? (NOTE – In general, reasonable potential is determined anytime there is at least one test failure in the previous four tests).

YES NO

Comments: None

Evaluation of Test Type, IWC and Dilution Series for Renewed Permit

Acute Partial Mix Factor (PMFa): **0.065**

Chronic Partial Mix Factor (PMFc): **0.453**

1. Determine IWC – Acute (IWCa):

$$(Q_d \times 1.547) / ((Q_{7-10} \times PMFa) + (Q_d \times 1.547))$$

$$[(5.5 \text{ MGD} \times 1.547) / ((271 \text{ cfs} \times 0.065) + (5.5 \text{ MGD} \times 1.547))] \times 100 = \mathbf{32.57\%}$$

Is IWCa < 1%? YES NO **(YES - Acute Tests Required OR NO - Chronic Tests Required)**

If the discharge is to the tidal portion of the Delaware River, indicate how the type of test was determined:

Type of Test for Permit Renewal: Chronic

2a. Determine Target IWCa (If Acute Tests Required)

$$TIWCa = IWCa / 0.3 = \mathbf{\text{span style="background-color: yellow; border: 1px solid black; padding: 0 20px;"> }} \%$$

2b. Determine Target IWCa (If Chronic Tests Required)

$$(Q_d \times 1.547) / (Q_{7-10} \times PMFc) + (Q_d \times 1.547)$$

$$[(5.5 \text{ MGD} \times 1.547) / ((271 \text{ cfs} \times 0.453) + (5.5 \text{ MGD} \times 1.547))] \times 100 = \mathbf{6.48\%}$$

3. Determine Dilution Series

(NOTE – check Attachment C of WET SOP for dilution series based on TIWCa or TIWCc, whichever applies).

Dilution Series = 100%, 60%, 30%, 6%, and 3%.

WET Limits

Has reasonable potential been determined? YES NO

Will WET limits be established in the permit? YES NO

If WET limits will be established, identify the species and the limit values for the permit (TU).

N/A

If WET limits will not be established, but reasonable potential was determined, indicate the rationale for not establishing WET limits:

N/A

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 002, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Recorded
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.5	XXX	1.2	1/day	Grab
CBOD5 Nov 1 - Apr 30	1434	2180	XXX	25.0	38.0 Wkly Avg	50	1/day	24-Hr Composite
CBOD5 May 1 - Oct 31	1033	1549	XXX	18.0	27.0 Wkly Avg	36	1/day	24-Hr Composite
BOD5 Raw Sewage Influent	Report	XXX	XXX	Report	45.0 XXX	XXX	1/week	24-Hr Composite
TSS	1721	2582	XXX	30.0	30.0 Wkly Avg	60	1/day	24-Hr Composite
TSS Raw Sewage Influent	Report	XXX	XXX	Report	XXX	XXX	1/day	24-Hr Composite
Total Copper (interim)	Report	Report Daily Max	XXX	Report	Report Daily Max	XXX	1/week	24-Hr Composite
Total Copper (final)	1.69	2.24 Daily Max	XXX	0.0295	0.0391 Daily Max	0.0738	1/week	24-Hr Composite
Total Dissolved Solids	Report Avg Qrtly	XXX	XXX	1000.0 Avg Qrtly	XXX	XXX	1/quarter	24-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	1/day	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	1/day	Grab

Outfall 002, Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	XXX	Report	1/month	Grab
Total Nitrogen	Report	XXX	XXX	Report	XXX	XXX	1/month	24-Hr Composite
Ammonia Nov 1 - Apr 30	1033	XXX	XXX	18.0	XXX	36	1/day	24-Hr Composite
Ammonia May 1 - Oct 31	344	XXX	XXX	6.0	XXX	12	1/day	24-Hr Composite
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	1/month	24-Hr Composite
PCBs (Dry Weather) (pg/L)	XXX	XXX	XXX	XXX	Report	XXX	1/year	24-Hr Composite
PCBs (Wet Weather) (pg/L)	XXX	XXX	XXX	XXX	Report	XXX	1/year	24-Hr Composite
Chronic WET - Ceriodaphnia Survival (TUc)	XXX	XXX	XXX	XXX	Report	XXX	See permit	24-Hr Composite
Chronic WET - Ceriodaphnia Reproduction (TUc)	XXX	XXX	XXX	XXX	Report	XXX	See permit	24-Hr Composite
Chronic WET - Pimephales Survival (TUc)	XXX	XXX	XXX	XXX	Report	XXX	See permit	24-Hr Composite
Chronic WET - Pimephales Growth (TUc)	XXX	XXX	XXX	XXX	Report	XXX	See permit	24-Hr Composite

Compliance Sampling Location: At Outfall 002

Other Comments: None

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the “NPDES Permit Writer’s Manual” (362-0400-001), SOPs and/or BPJ.

Outfall 003, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
pH (S.U.)	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
CBOD5	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
COD	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
TSS	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Oil and Grease	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
TKN	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab
Dissolved Iron	XXX	XXX	XXX	Report	XXX	XXX	1/year	Grab

Compliance Sampling Location: At Outfall 003

Other Comments: None

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input checked="" type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [redacted])
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 362-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 362-2000-003, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 362-2000-008, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 362-2183-003, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 362-2183-004, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 385-2000-011, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 391-2000-002, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 391-2000-003, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 391-2000-006, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 391-2000-007, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 391-2000-008, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 391-2000-010, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 391-2000-011, 5/2004.
<input checked="" type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 391-2000-013, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 391-2000-014, 4/2008.
<input checked="" type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 391-2000-015, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 391-2000-017, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 391-2000-018, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 391-2000-019, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 391-2000-021, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 391-2000-022, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 391-2000-023, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 391-2000-024, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 391-3200-013, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: BCW-PMT-037
<input type="checkbox"/>	Other: [redacted]

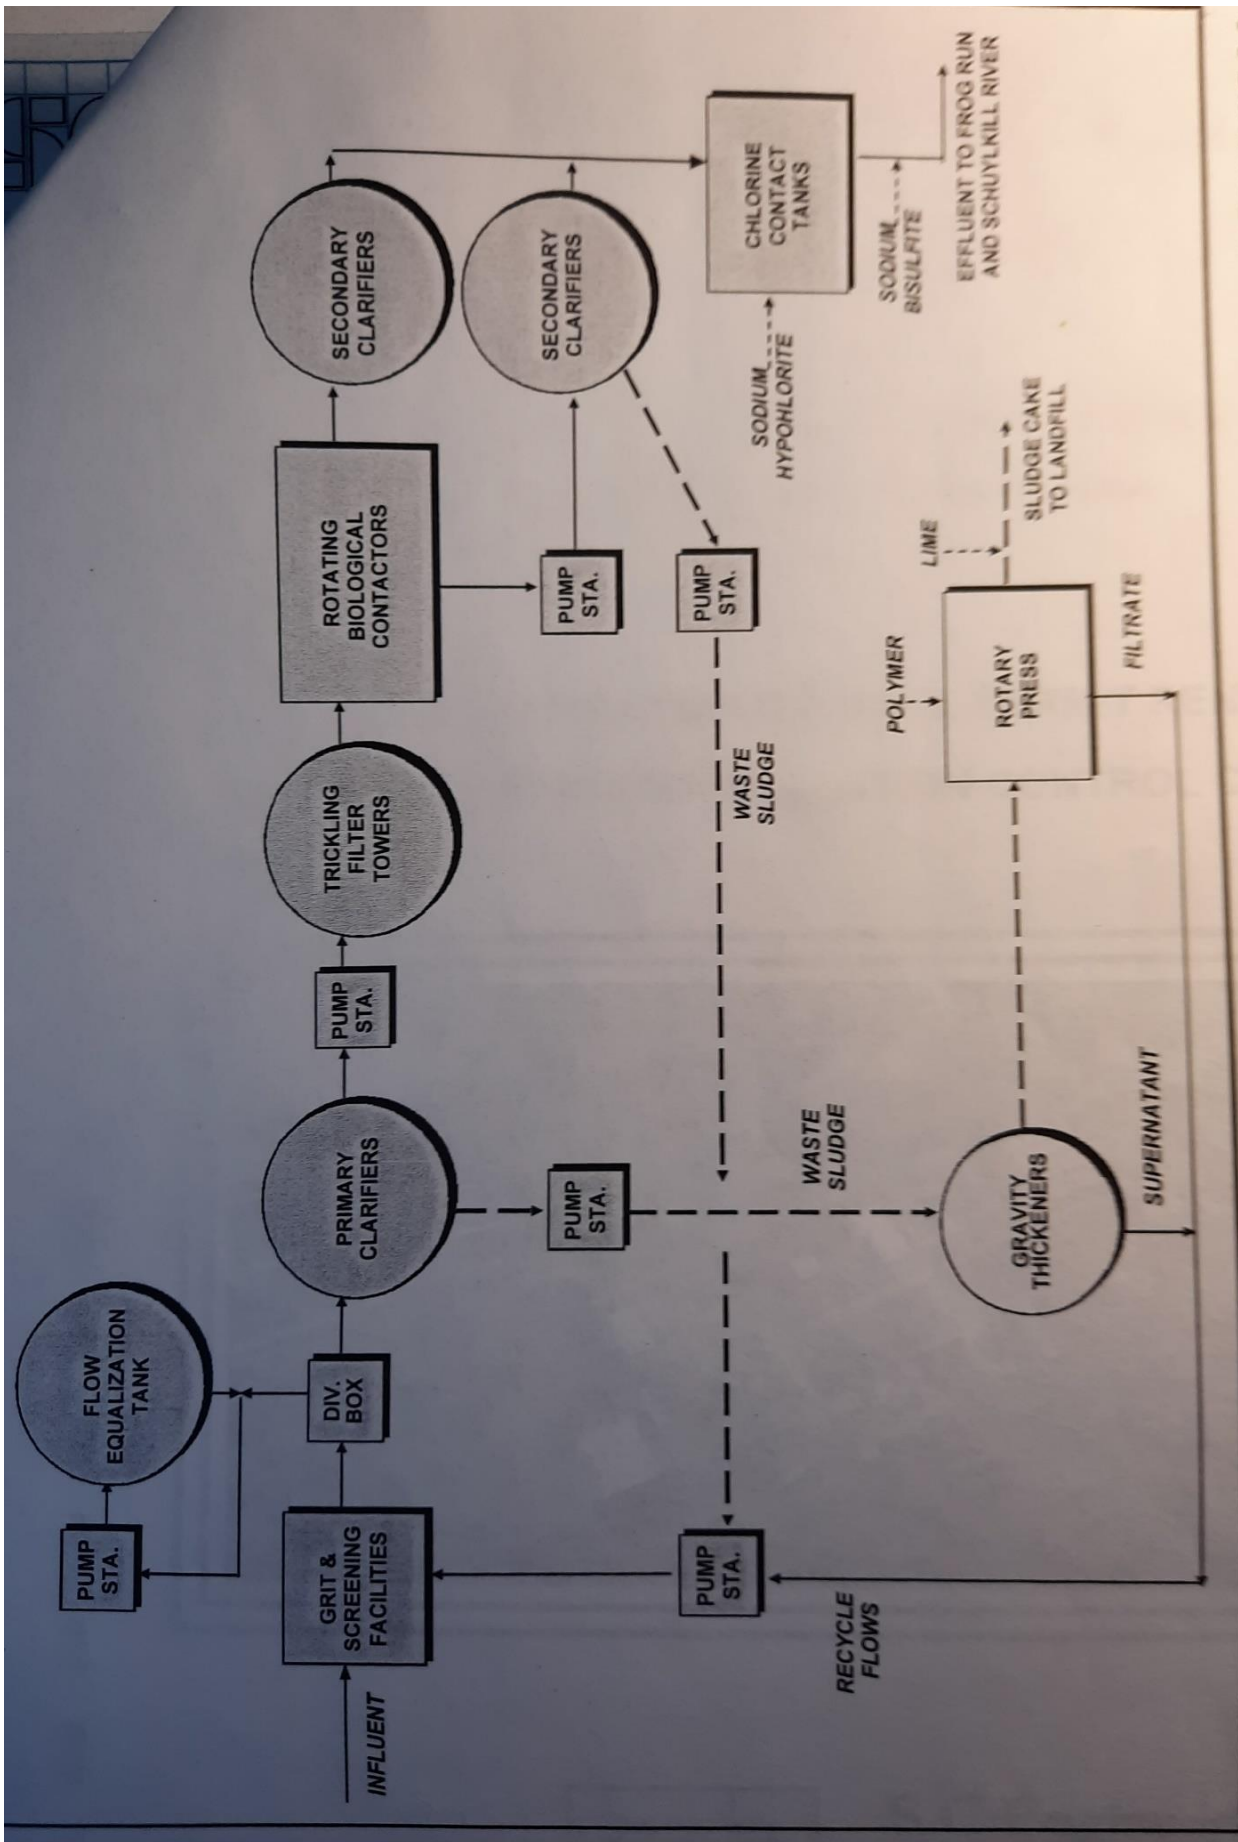


FIGURE 1: MATSUNK W.P.C.G. PROCESS DIAGRAM

——— WASTEWATER FLOW
 - - - - - SLUDGE LINES
 ······ CHEMICAL FEEDS
LEGEND :

TRC_CALC

TRC EVALUATION					
Input appropriate values in A3:A9 and D3:D9					
271	= Q stream (cfs)		0.5	= CV Daily	
5.5	= Q discharge (MGD)		0.5	= CV Hourly	
30	= no. samples		1	= AFC_Partial Mix Factor	
0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor	
0	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)	
0.5	= BAT/BPJ Value		720	= CFC_Criteria Compliance Time (min)	
0	= % Factor of Safety (FOS)			= Decay Coefficient (K)	
Source	Reference	AFC Calculations		Reference	CFC Calculations
TRC	1.3.2.iii	WLA_afc = 10.179		1.3.2.iii	WLA_cfc = 9.917
PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373		5.1c	LTAMULT_cfc = 0.581
PENTOXSD TRG	5.1b	LTA_afc = 3.793		5.1d	LTA_cfc = 5.765
Source	Effluent Limit Calculations				
PENTOXSD TRG	5.1f	AML_MULT = 1.231			
PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.500		BAT/BPJ	
		INST MAX LIMIT (mg/l) = 1.635			
WLA_afc	$(.019/e^{-(k^*AFC_tc)}) + [(AFC_Yc^*Qs^*.019/Qd^*e^{-(k^*AFC_tc)}) \dots + Xd + (AFC_Yc^*Qs^*Xs/Qd)]^{(1-FOS/100)}$				
LTAMULT_afc	$EXP((0.5^*LN(cvh^*2+1))-2.326^*LN(cvh^*2+1)^0.5)$				
LTA_afc	wla_afc^*LTAMULT_afc				
WLA_cfc	$(.011/e^{-(k^*CFC_tc)}) + [(CFC_Yc^*Qs^*.011/Qd^*e^{-(k^*CFC_tc)}) \dots + Xd + (CFC_Yc^*Qs^*Xs/Qd)]^{(1-FOS/100)}$				
LTAMULT_cfc	$EXP((0.5^*LN(cvd^*2/no_samples+1))-2.326^*LN(cvd^*2/no_samples+1)^0.5)$				
LTA_cfc	wla_cfc^*LTAMULT_cfc				
AML_MULT	$EXP(2.326^*LN((cvd^*2/no_samples+1)^0.5)-0.5^*LN(cvd^*2/no_samples+1))$				
AVG MON LIMIT	MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)^*AML_MULT)				
INST MAX LIMIT	1.5^*((av_mon_limit/AML_MULT)/LTAMULT_afc)				

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
03F	833	SCHUYLKILL RIVER	23.400	49.00	1766.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	pH	Stream Temp	pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.125	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Norristown STP	PA0027421	9.7500	9.7500	9.7500	0.000	20.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	20.00	2.00	0.00	1.50
Dissolved Oxygen	4.00	8.24	0.00	0.00
NH3-N	10.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
03F	833	SCHUYLKILL RIVER	22.940	48.00	1766.10	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	pH	Stream Temp	pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.125	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
ENPWJSA	PA0026816	8.1000	8.1000	8.1000	0.000	20.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	20.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	12.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
03F	833	SCHUYLKILL RIVER	22.790	43.79	1769.90	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	pH	Stream Temp	pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.125	11.72	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.50	20.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Bridgeport STP	PA0020397	0.9000	0.9000	0.9000	0.000	20.00	7.30

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	20.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
03F	833	SCHUYLKILL RIVER	22.260	42.85	1770.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Tributary pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.153	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Matsunk STP	PA0028085	5.5000	5.5000	5.5000	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	18.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	6.00	0.00	0.00	0.70

Input Data WQM 7.0

	SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
	03F	833	SCHUYLKILL RIVER	21.220	39.59	1770.10	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data												
Design Cond.	LFY (cfsm)	Trib Flow (cfs)	Stream Flow (cfs)	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary		Stream	
									Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.125	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data							
Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	0.00	7.00

Parameter Data				
Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
03F	833	SCHUYLKILL RIVER	21.025	38.74	1780.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY (cfsm)	Trib Flow (cfs)	Stream Flow (cfs)	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary Temp (°C)	pH	Stream Temp (°C)	pH
	Q7-10	0.153	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

WQM 7.0 Hydrodynamic Outputs

<u>SWP Basin</u>		<u>Stream Code</u>				<u>Stream Name</u>						
03F		833				SCHUYLKILL RIVER						
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis Flow	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
	(cfs)	(cfs)	(cfs)	(cfs)	(ft/ft)	(ft)	(ft)		(fps)	(days)	(°C)	
Q7-10 Flow												
23.400	220.75	0.00	220.75	15.0833	0.00041	1.177	275.77	234.21	0.73	0.039	20.00	7.00
22.940	220.76	0.00	220.76	27.614	0.00532	1.217	237.23	195	0.86	0.011	20.00	7.00
22.790	232.48	0.00	232.48	29.0063	0.00034	1.181	291.17	246.64	0.76	0.043	20.00	7.01
22.260	232.50	0.00	232.50	37.5148	0.00059	1.168	289.36	247.82	0.80	0.080	20.16	7.01
21.220	232.51	0.00	232.51	37.5148	0.00083	1.163	285.36	245.41	0.81	0.015	20.16	7.01
Q1-10 Flow												
23.400	141.28	0.00	141.28	15.0833	0.00041	NA	NA	NA	0.58	0.049	20.00	7.00
22.940	141.29	0.00	141.29	27.614	0.00532	NA	NA	NA	0.69	0.013	20.00	7.00
22.790	148.79	0.00	148.79	29.0063	0.00034	NA	NA	NA	0.61	0.053	20.00	7.01
22.260	148.80	0.00	148.80	37.5148	0.00059	NA	NA	NA	0.65	0.098	20.23	7.01
21.220	148.81	0.00	148.81	37.5148	0.00083	NA	NA	NA	0.66	0.018	20.23	7.01
Q30-10 Flow												
23.400	264.90	0.00	264.90	15.0833	0.00041	NA	NA	NA	0.80	0.035	20.00	7.00
22.940	264.92	0.00	264.92	27.614	0.00532	NA	NA	NA	0.94	0.010	20.00	7.00
22.790	278.98	0.00	278.98	29.0063	0.00034	NA	NA	NA	0.83	0.039	20.00	7.01
22.260	279.00	0.00	279.00	37.5148	0.00059	NA	NA	NA	0.87	0.073	20.13	7.01
21.220	279.01	0.00	279.01	37.5148	0.00083	NA	NA	NA	0.89	0.013	20.13	7.01

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.2	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		

WQM 7.0 Wasteload Allocations

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>
03F	833	SCHUYLKILL RIVER

NH3-N Acute Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
23.400	Norristown STP	9.67	20	9.67	20	0	0
22.940	ENPWJSA	9.67	24	9.67	24	0	0
22.790	Bridgeport STP	9.58	40	9.58	40	0	0
22.260	Matsunk STP	9.39	12	9.42	12	0	0
21.220		NA	NA	9.42	NA	NA	NA

NH3-N Chronic Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
23.400	Norristown STP	1.92	10	1.92	10	0	0
22.940	ENPWJSA	1.92	12	1.92	12	0	0
22.790	Bridgeport STP	1.9	20	1.9	20	0	0
22.260	Matsunk STP	1.88	6	1.88	6	0	0
21.220		NA	NA	1.88	NA	NA	NA

Dissolved Oxygen Allocations

RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
23.40	Norristown STP	20	20	10	10	4	4	0	0
22.94	ENPWJSA	20	20	12	12	5	5	0	0
22.79	Bridgeport STP	25	25	20	20	5	5	0	0
22.26	Matsunk STP	18	18	6	6	5	5	0	0
21.22		NA	NA	NA	NA	NA	NA	NA	NA

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>			
03F	833	SCHUYLKILL RIVER			
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>	
22.790	18.750	20.000		7.015	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>	
291.169	1.181	246.644		0.761	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>	
3.93	0.809	1.23		0.700	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>	
7.920	1.192	Tsvoglou		5	
<u>Reach Travel Time (days)</u>					
0.043					
	<u>Subreach Results</u>				
	<u>TravTime</u>	<u>CBOD5</u>	<u>NH3-N</u>	<u>D.O.</u>	
	(days)	(mg/L)	(mg/L)	(mg/L)	
	0.004	3.91	1.23	7.89	
	0.009	3.90	1.23	7.86	
	0.013	3.89	1.22	7.83	
	0.017	3.87	1.22	7.80	
	0.021	3.86	1.22	7.77	
	0.026	3.85	1.21	7.74	
	0.030	3.83	1.21	7.71	
	0.034	3.82	1.21	7.68	
	0.038	3.81	1.20	7.65	
	0.043	3.79	1.20	7.63	
<hr/>					
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>	
22.260	24.250	20.158		7.014	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>	
289.362	1.168	247.818		0.799	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>	
4.24	0.869	1.35		0.709	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>	
7.543	2.221	Tsvoglou		5	
<u>Reach Travel Time (days)</u>					
0.080					
	<u>Subreach Results</u>				
	<u>TravTime</u>	<u>CBOD5</u>	<u>NH3-N</u>	<u>D.O.</u>	
	(days)	(mg/L)	(mg/L)	(mg/L)	
	0.008	4.21	1.34	7.49	
	0.016	4.18	1.33	7.44	
	0.024	4.15	1.33	7.40	
	0.032	4.12	1.32	7.35	
	0.040	4.10	1.31	7.31	
	0.048	4.07	1.30	7.26	
	0.056	4.04	1.30	7.22	
	0.064	4.01	1.29	7.18	
	0.072	3.98	1.28	7.14	
	0.080	3.96	1.28	7.10	

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
03F	833	SCHUYLKILL RIVER		
<u>RM</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>
21.220	24.250	20.158		7.014
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>
285.358	1.183	245.408		0.814
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>
3.96	0.843	1.28		0.709
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>
7.099	3.148	Tsivoglou		5
<u>Reach Travel Time (days)</u>	<u>Subreach Results</u>			
0.015	<u>TravTime (days)</u>	<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.001	3.95	1.27	7.10
	0.003	3.95	1.27	7.09
	0.004	3.94	1.27	7.09
	0.006	3.94	1.27	7.08
	0.007	3.93	1.27	7.08
	0.009	3.93	1.27	7.08
	0.010	3.92	1.27	7.07
	0.012	3.92	1.26	7.07
	0.013	3.91	1.26	7.06
	0.015	3.91	1.26	7.06

WQM 7.0 Effluent Limits

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>					
03F	833	SCHUYLKILL RIVER					
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
23.400	Norristown STP	PA0027421	9.750	CBOD5	20		
				NH3-N	10	20	
				Dissolved Oxygen			4
22.940	ENPWJSA	PA0026816	8.100	CBOD5	20		
				NH3-N	12	24	
				Dissolved Oxygen			5
22.790	Bridgeport STP	PA0020397	0.900	CBOD5	25		
				NH3-N	20	40	
				Dissolved Oxygen			5
22.260	Matsunk STP	PA0026085	5.500	CBOD5	18		
				NH3-N	6	12	
				Dissolved Oxygen			5

Discharge Information

Instructions **Discharge** Stream

Facility: **Matsunk WWTF** NPDES Permit No.: **PA0026085** Outfall No.: **002**

Evaluation Type: **Major Sewage / Industrial Waste** Wastewater Description: **Treated sewage**

Discharge Characteristics								
Design Flow (MGD)*	Hardness (mg/l)*	pH (SU)*	Partial Mix Factors (PMFs)				Complete Mix Times (min)	
			AFC	CFC	THH	CRL	Q ₇₋₁₀	Q _h
5.5	217	7						

Discharge Pollutant	Units	Max Discharge Conc	0 if left blank		0.5 if left blank		0 if left blank			1 if left blank	
			Trib Conc	Stream Conc	Daily CV	Hourly CV	Stream CV	Fate Coeff	FOS	Criteria Mod	Chem Transl
Group 1											
Total Dissolved Solids (PWS)	mg/L	609									
Chloride (PWS)	mg/L	200									
Bromide	mg/L	0.22									
Sulfate (PWS)	mg/L	5.6									
Fluoride (PWS)	mg/L										
Group 2											
Total Aluminum	µg/L	80									
Total Antimony	µg/L	2									
Total Arsenic	µg/L	1									
Total Barium	µg/L	89									
Total Beryllium	µg/L	< 1									
Total Boron	µg/L	300									
Total Cadmium	µg/L	< 0.1									
Total Chromium (III)	µg/L	3.4									
Hexavalent Chromium	µg/L	< 0.25									
Total Cobalt	µg/L	0.6									
Total Copper	µg/L	52.0268			0.2714						
Free Cyanide	µg/L	3									
Total Cyanide	µg/L	3									
Dissolved Iron	µg/L	180									
Total Iron	µg/L	200									
Total Lead	µg/L	< 1									
Total Manganese	µg/L	31									
Total Mercury	µg/L	< 0.2									
Total Nickel	µg/L	5.2									
Total Phenols (Phenolics) (PWS)	µg/L	38									
Total Selenium	µg/L	2									
Total Silver	µg/L	< 0.1									
Total Thallium	µg/L	< 1									
Total Zinc	µg/L	58									
Total Molybdenum	µg/L	2									
Acrolein	µg/L	< 2									
Acrylamide	µg/L	<									
Acrylonitrile	µg/L	< 2									
Benzene	µg/L	< 0.5									
Bromoform	µg/L	< 0.5									



Stream / Surface Water Information

Matsunk WWTF, NPDES Permit No. PA0026085, Outfall 002

Instructions Discharge **Stream**

Receiving Surface Water Name: Schuylkill River

No. Reaches to Model: 1

- Statewide Criteria
- Great Lakes Criteria
- ORSANCO Criteria

Location	Stream Code*	RMI*	Elevation (ft)*	DA (mi ²)*	Slope (ft/ft)	PWS Withdrawal (MGD)	Apply Fish Criteria*
Point of Discharge	000833	22.26	42.85	1770			Yes
End of Reach 1	000833	21.025	38.74	1780			Yes

Q₇₋₁₀

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	22.26	0.153										100	7		
End of Reach 1	21.025	0.153													

Q_h

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness	pH	Hardness	pH
Point of Discharge	22.26														
End of Reach 1	21.025														

Model Results

Matsunk WWTF, NPDES Permit No. PA0026085, Outfall 002

Instructions

Results

RETURN TO INPUTS

SAVE AS PDF

PRINT

All

Inputs

Results

Limits

Hydrodynamics

Wasteload Allocations

AFC

CCT (min):

PMF:

Analysis Hardness (mg/l):

Analysis pH:

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A	
Chloride (PWS)	0	0		0	N/A	N/A	N/A	
Sulfate (PWS)	0	0		0	N/A	N/A	N/A	
Total Aluminum	0	0		0	750	750	2,312	
Total Antimony	0	0		0	1,100	1,100	3,391	
Total Arsenic	0	0		0	340	340	1,048	Chem Translator of 1 applied
Total Barium	0	0		0	21,000	21,000	64,728	
Total Boron	0	0		0	8,100	8,100	24,966	
Total Cadmium	0	0		0	2.753	2.96	9.12	Chem Translator of 0.931 applied
Total Chromium (III)	0	0		0	741.566	2,347	7,233	Chem Translator of 0.316 applied
Hexavalent Chromium	0	0		0	18	18.3	50.2	Chem Translator of 0.982 applied
Total Cobalt	0	0		0	95	95.0	293	
Total Copper	0	0		0	18.199	19.0	58.4	Chem Translator of 0.96 applied
Free Cyanide	0	0		0	22	22.0	67.8	
Dissolved Iron	0	0		0	N/A	N/A	N/A	
Total Iron	0	0		0	N/A	N/A	N/A	
Total Lead	0	0		0	91.510	123	379	Chem Translator of 0.744 applied
Total Manganese	0	0		0	N/A	N/A	N/A	
Total Mercury	0	0		0	1.400	1.65	5.08	Chem Translator of 0.85 applied
Total Nickel	0	0		0	614.742	616	1,899	Chem Translator of 0.998 applied
Total Phenols (Phenolics) (PWS)	0	0		0	N/A	N/A	N/A	
Total Selenium	0	0		0	N/A	N/A	N/A	Chem Translator of 0.922 applied
Total Silver	0	0		0	5.595	6.58	20.3	Chem Translator of 0.85 applied
Total Thallium	0	0		0	65	65.0	200	
Total Zinc	0	0		0	153.909	157	485	Chem Translator of 0.978 applied
Acrolein	0	0		0	3	3.0	9.25	

Acrylonitrile	0	0		0	650	650	2,003
Benzene	0	0		0	640	640	1,973
Bromoform	0	0		0	1,800	1,800	5,548
Carbon Tetrachloride	0	0		0	2,800	2,800	8,630
Chlorobenzene	0	0		0	1,200	1,200	3,699
Chlorodibromomethane	0	0		0	N/A	N/A	N/A
2-Chloroethyl Vinyl Ether	0	0		0	18,000	18,000	55,481
Chloroform	0	0		0	1,900	1,900	5,856
Dichlorobromomethane	0	0		0	N/A	N/A	N/A
1,2-Dichloroethane	0	0		0	15,000	15,000	46,234
1,1-Dichloroethylene	0	0		0	7,500	7,500	23,117
1,2-Dichloropropane	0	0		0	11,000	11,000	33,905
1,3-Dichloropropylene	0	0		0	310	310	956
Ethylbenzene	0	0		0	2,900	2,900	8,939
Methyl Bromide	0	0		0	550	550	1,695
Methyl Chloride	0	0		0	28,000	28,000	86,304
Methylene Chloride	0	0		0	12,000	12,000	36,987
1,1,2,2-Tetrachloroethane	0	0		0	1,000	1,000	3,082
Tetrachloroethylene	0	0		0	700	700	2,158
Toluene	0	0		0	1,700	1,700	5,240
1,2-trans-Dichloroethylene	0	0		0	6,800	6,800	20,959
1,1,1-Trichloroethane	0	0		0	3,000	3,000	9,247
1,1,2-Trichloroethane	0	0		0	3,400	3,400	10,480
Trichloroethylene	0	0		0	2,300	2,300	7,089
Vinyl Chloride	0	0		0	N/A	N/A	N/A
2-Chlorophenol	0	0		0	560	560	1,726
2,4-Dichlorophenol	0	0		0	1,700	1,700	5,240
2,4-Dimethylphenol	0	0		0	660	660	2,034
4,6-Dinitro-o-Cresol	0	0		0	80	80.0	247
2,4-Dinitrophenol	0	0		0	660	660	2,034
2-Nitrophenol	0	0		0	8,000	8,000	24,658
4-Nitrophenol	0	0		0	2,300	2,300	7,089
Pentachlorophenol	0	0		0	8.723	8.72	26.9
Phenol	0	0		0	N/A	N/A	N/A
2,4,6-Trichlorophenol	0	0		0	460	460	1,418
Acenaphthene	0	0		0	83	83.0	256
Anthracene	0	0		0	N/A	N/A	N/A
Benzidine	0	0		0	300	300	925
Benzo(a)Anthracene	0	0		0	0.5	0.5	1.54
Benzo(a)Pyrene	0	0		0	N/A	N/A	N/A
3,4-Benzofluoranthene	0	0		0	N/A	N/A	N/A
Benzo(k)Fluoranthene	0	0		0	N/A	N/A	N/A
Bis(2-Chloroethyl)Ether	0	0		0	30,000	30,000	92,468
Bis(2-Ethylhexyl)Phthalate	0	0		0	4,500	4,500	13,870
4-Bromophenyl Phenyl Ether	0	0		0	270	270	832
Butyl Benzyl Phthalate	0	0		0	140	140	432
2-Chloronaphthalene	0	0		0	N/A	N/A	N/A
Chrysene	0	0		0	N/A	N/A	N/A

Dibenzo(a,h)Anthracene	0	0		0	N/A	N/A	N/A	
1,2-Dichlorobenzene	0	0		0	820	820	2,527	
1,3-Dichlorobenzene	0	0		0	350	350	1,079	
1,4-Dichlorobenzene	0	0		0	730	730	2,250	
3,3-Dichlorobenzidine	0	0		0	N/A	N/A	N/A	
Diethyl Phthalate	0	0		0	4,000	4,000	12,329	
Dimethyl Phthalate	0	0		0	2,500	2,500	7,706	
Di-n-Butyl Phthalate	0	0		0	110	110	339	
2,4-Dinitrotoluene	0	0		0	1,600	1,600	4,932	
2,6-Dinitrotoluene	0	0		0	990	990	3,051	
1,2-Diphenylhydrazine	0	0		0	15	15.0	46.2	
Fluoranthene	0	0		0	200	200	616	
Fluorene	0	0		0	N/A	N/A	N/A	
Hexachlorobenzene	0	0		0	N/A	N/A	N/A	
Hexachlorobutadiene	0	0		0	10	10.0	30.8	
Hexachlorocyclopentadiene	0	0		0	5	5.0	15.4	
Hexachloroethane	0	0		0	60	60.0	185	
Indeno(1,2,3-cd)Pyrene	0	0		0	N/A	N/A	N/A	
Isophorone	0	0		0	10,000	10,000	30,823	
Naphthalene	0	0		0	140	140	432	
Nitrobenzene	0	0		0	4,000	4,000	12,329	
n-Nitrosodimethylamine	0	0		0	17,000	17,000	52,399	
n-Nitrosodi-n-Propylamine	0	0		0	N/A	N/A	N/A	
n-Nitrosodiphenylamine	0	0		0	300	300	925	
Phenanthrene	0	0		0	5	5.0	15.4	
Pyrene	0	0		0	N/A	N/A	N/A	
1,2,4-Trichlorobenzene	0	0		0	130	130	401	

 CFC

 CCT (min):

 PMF:

 Analysis Hardness (mg/l):

 Analysis pH:

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A	
Chloride (PWS)	0	0		0	N/A	N/A	N/A	
Sulfate (PWS)	0	0		0	N/A	N/A	N/A	
Total Aluminum	0	0		0	N/A	N/A	N/A	
Total Antimony	0	0		0	220	220	3,394	
Total Arsenic	0	0		0	150	150	2,314	Chem Translator of 1 applied
Total Barium	0	0		0	4,100	4,100	63,248	
Total Boron	0	0		0	1,600	1,600	24,682	
Total Cadmium	0	0		0	0.259	0.29	4.41	Chem Translator of 0.906 applied
Total Chromium (III)	0	0		0	78.688	91.5	1,411	Chem Translator of 0.86 applied
Hexavalent Chromium	0	0		0	10	10.4	160	Chem Translator of 0.962 applied
Total Cobalt	0	0		0	19	19.0	293	
Total Copper	0	0		0	9.533	9.93	153	Chem Translator of 0.96 applied
Free Cyanide	0	0		0	5.2	5.2	80.2	
Dissolved Iron	0	0		0	N/A	N/A	N/A	

Total Iron	0	0		0	1,500	1,500	49,242	WQC = 30 day average; PMF = 1
Total Lead	0	0		0	2.725	3.49	53.9	Chem Translator of 0.78 applied
Total Manganese	0	0		0	N/A	N/A	N/A	
Total Mercury	0	0		0	0.770	0.91	14.0	Chem Translator of 0.85 applied
Total Nickel	0	0		0	55.325	55.5	856	Chem Translator of 0.997 applied
Total Phenols (Phenolics) (PWS)	0	0		0	N/A	N/A	N/A	
Total Selenium	0	0		0	4.800	4.99	77.0	Chem Translator of 0.922 applied
Total Silver	0	0		0	N/A	N/A	N/A	Chem Translator of 1 applied
Total Thallium	0	0		0	13	13.0	201	
Total Zinc	0	0		0	125.688	127	1,966	Chem Translator of 0.986 applied
Acrolein	0	0		0	3	3.0	46.3	
Acrylonitrile	0	0		0	130	130	2,005	
Benzene	0	0		0	130	130	2,005	
Bromoform	0	0		0	370	370	5,708	
Carbon Tetrachloride	0	0		0	560	560	8,639	
Chlorobenzene	0	0		0	240	240	3,702	
Chlorodibromomethane	0	0		0	N/A	N/A	N/A	
2-Chloroethyl Vinyl Ether	0	0		0	3,500	3,500	53,993	
Chloroform	0	0		0	390	390	6,016	
Dichlorobromomethane	0	0		0	N/A	N/A	N/A	
1,2-Dichloroethane	0	0		0	3,100	3,100	47,822	
1,1-Dichloroethylene	0	0		0	1,500	1,500	23,140	
1,2-Dichloropropane	0	0		0	2,200	2,200	33,938	
1,3-Dichloropropylene	0	0		0	61	61.0	941	
Ethylbenzene	0	0		0	580	580	8,947	
Methyl Bromide	0	0		0	110	110	1,697	
Methyl Chloride	0	0		0	5,500	5,500	84,845	
Methylene Chloride	0	0		0	2,400	2,400	37,023	
1,1,2,2-Tetrachloroethane	0	0		0	210	210	3,240	
Tetrachloroethylene	0	0		0	140	140	2,160	
Toluene	0	0		0	330	330	5,091	
1,2-trans-Dichloroethylene	0	0		0	1,400	1,400	21,597	
1,1,1-Trichloroethane	0	0		0	610	610	9,410	
1,1,2-Trichloroethane	0	0		0	680	680	10,490	
Trichloroethylene	0	0		0	450	450	6,942	
Vinyl Chloride	0	0		0	N/A	N/A	N/A	
2-Chlorophenol	0	0		0	110	110	1,697	
2,4-Dichlorophenol	0	0		0	340	340	5,245	
2,4-Dimethylphenol	0	0		0	130	130	2,005	
4,6-Dinitro-o-Cresol	0	0		0	16	16.0	247	
2,4-Dinitrophenol	0	0		0	130	130	2,005	
2-Nitrophenol	0	0		0	1,600	1,600	24,682	
4-Nitrophenol	0	0		0	470	470	7,250	
Pentachlorophenol	0	0		0	6.693	6.69	103	
Phenol	0	0		0	N/A	N/A	N/A	

2,4,6-Trichlorophenol	0	0		0	91	91.0	1,404
Acenaphthene	0	0		0	17	17.0	262
Anthracene	0	0		0	N/A	N/A	N/A
Benzdine	0	0		0	59	59.0	910
Benzo(a)Anthracene	0	0		0	0.1	0.1	1.54
Benzo(a)Pyrene	0	0		0	N/A	N/A	N/A
3,4-Benzofluoranthene	0	0		0	N/A	N/A	N/A
Benzo(k)Fluoranthene	0	0		0	N/A	N/A	N/A
Bis(2-Chloroethyl)Ether	0	0		0	6,000	6,000	92,559
Bis(2-Ethylhexyl)Phthalate	0	0		0	910	910	14,038
4-Bromophenyl Phenyl Ether	0	0		0	54	54.0	833
Butyl Benzyl Phthalate	0	0		0	35	35.0	540
2-Chloronaphthalene	0	0		0	N/A	N/A	N/A
Chrysene	0	0		0	N/A	N/A	N/A
Dibenzo(a,h)Anthracene	0	0		0	N/A	N/A	N/A
1,2-Dichlorobenzene	0	0		0	160	160	2,468
1,3-Dichlorobenzene	0	0		0	69	69.0	1,064
1,4-Dichlorobenzene	0	0		0	150	150	2,314
3,3-Dichlorobenzidine	0	0		0	N/A	N/A	N/A
Diethyl Phthalate	0	0		0	800	800	12,341
Dimethyl Phthalate	0	0		0	500	500	7,713
Di-n-Butyl Phthalate	0	0		0	21	21.0	324
2,4-Dinitrotoluene	0	0		0	320	320	4,936
2,6-Dinitrotoluene	0	0		0	200	200	3,085
1,2-Diphenylhydrazine	0	0		0	3	3.0	46.3
Fluoranthene	0	0		0	40	40.0	617
Fluorene	0	0		0	N/A	N/A	N/A
Hexachlorobenzene	0	0		0	N/A	N/A	N/A
Hexachlorobutadiene	0	0		0	2	2.0	30.9
Hexachlorocyclopentadiene	0	0		0	1	1.0	15.4
Hexachloroethane	0	0		0	12	12.0	185
Indeno(1,2,3-cd)Pyrene	0	0		0	N/A	N/A	N/A
Isophorone	0	0		0	2,100	2,100	32,396
Naphthalene	0	0		0	43	43.0	663
Nitrobenzene	0	0		0	810	810	12,495
n-Nitrosodimethylamine	0	0		0	3,400	3,400	52,450
n-Nitrosodi-n-Propylamine	0	0		0	N/A	N/A	N/A
n-Nitrosodiphenylamine	0	0		0	59	59.0	910
Phenanthrene	0	0		0	1	1.0	15.4
Pyrene	0	0		0	N/A	N/A	N/A
1,2,4-Trichlorobenzene	0	0		0	26	26.0	401

 THH

 CCT (min):

 PMF:

 Analysis Hardness (mg/l):

 Analysis pH:

Pollutants	Stream Conc	Stream	Trib Conc	Fate	WQC	WQ Obj	WLA (µg/l)	Comments
------------	-------------	--------	-----------	------	-----	--------	------------	----------

Parameter	Conc (µg/L)	CV	(µg/L)	Coef	(µg/L)	(µg/L)	MCR (µg/L)	Comments
Total Dissolved Solids (PWS)	0	0		0	500,000	500,000	N/A	
Chloride (PWS)	0	0		0	250,000	250,000	N/A	
Sulfate (PWS)	0	0		0	250,000	250,000	N/A	
Total Aluminum	0	0		0	N/A	N/A	N/A	
Total Antimony	0	0		0	5.6	5.6	86.4	
Total Arsenic	0	0		0	10	10.0	154	
Total Barium	0	0		0	2,400	2,400	37,023	
Total Boron	0	0		0	3,100	3,100	47,822	
Total Cadmium	0	0		0	N/A	N/A	N/A	
Total Chromium (III)	0	0		0	N/A	N/A	N/A	
Hexavalent Chromium	0	0		0	N/A	N/A	N/A	
Total Cobalt	0	0		0	N/A	N/A	N/A	
Total Copper	0	0		0	N/A	N/A	N/A	
Free Cyanide	0	0		0	4	4.0	61.7	
Dissolved Iron	0	0		0	300	300	4,628	
Total Iron	0	0		0	N/A	N/A	N/A	
Total Lead	0	0		0	N/A	N/A	N/A	
Total Manganese	0	0		0	1,000	1,000	15,426	
Total Mercury	0	0		0	0.050	0.05	0.77	
Total Nickel	0	0		0	610	610	9,410	
Total Phenols (Phenolics) (PWS)	0	0		0	5	5.0	N/A	
Total Selenium	0	0		0	N/A	N/A	N/A	
Total Silver	0	0		0	N/A	N/A	N/A	
Total Thallium	0	0		0	0.24	0.24	3.7	
Total Zinc	0	0		0	N/A	N/A	N/A	
Acrolein	0	0		0	3	3.0	46.3	
Acrylonitrile	0	0		0	N/A	N/A	N/A	
Benzene	0	0		0	N/A	N/A	N/A	
Bromoform	0	0		0	N/A	N/A	N/A	
Carbon Tetrachloride	0	0		0	N/A	N/A	N/A	
Chlorobenzene	0	0		0	100	100.0	1,543	
Chlorodibromomethane	0	0		0	N/A	N/A	N/A	
2-Chloroethyl Vinyl Ether	0	0		0	N/A	N/A	N/A	
Chloroform	0	0		0	N/A	N/A	N/A	
Dichlorobromomethane	0	0		0	N/A	N/A	N/A	
1,2-Dichloroethane	0	0		0	N/A	N/A	N/A	
1,1-Dichloroethylene	0	0		0	33	33.0	509	
1,2-Dichloropropane	0	0		0	N/A	N/A	N/A	
1,3-Dichloropropylene	0	0		0	N/A	N/A	N/A	
Ethylbenzene	0	0		0	68	68.0	1,049	
Methyl Bromide	0	0		0	100	100.0	1,543	
Methyl Chloride	0	0		0	N/A	N/A	N/A	
Methylene Chloride	0	0		0	N/A	N/A	N/A	
1,1,2,2-Tetrachloroethane	0	0		0	N/A	N/A	N/A	

Tetrachloroethylene	0	0		0	N/A	N/A	N/A
Toluene	0	0		0	57	57.0	879
1,2-trans-Dichloroethylene	0	0		0	100	100.0	1,543
1,1,1-Trichloroethane	0	0		0	10,000	10,000	154,284
1,1,2-Trichloroethane	0	0		0	N/A	N/A	N/A
Trichloroethylene	0	0		0	N/A	N/A	N/A
Vinyl Chloride	0	0		0	N/A	N/A	N/A
2-Chlorophenol	0	0		0	30	30.0	463
2,4-Dichlorophenol	0	0		0	10	10.0	154
2,4-Dimethylphenol	0	0		0	100	100.0	1,543
4,6-Dinitro-o-Cresol	0	0		0	2	2.0	30.9
2,4-Dinitrophenol	0	0		0	10	10.0	154
2-Nitrophenol	0	0		0	N/A	N/A	N/A
4-Nitrophenol	0	0		0	N/A	N/A	N/A
Pentachlorophenol	0	0		0	N/A	N/A	N/A
Phenol	0	0		0	4,000	4,000	61,708
2,4,6-Trichlorophenol	0	0		0	N/A	N/A	N/A
Acenaphthene	0	0		0	70	70.0	1,080
Anthracene	0	0		0	300	300	4,628
Benzdine	0	0		0	N/A	N/A	N/A
Benzo(a)Anthracene	0	0		0	N/A	N/A	N/A
Benzo(a)Pyrene	0	0		0	N/A	N/A	N/A
3,4-Benzofluoranthene	0	0		0	N/A	N/A	N/A
Benzo(k)Fluoranthene	0	0		0	N/A	N/A	N/A
Bis(2-Chloroethyl)Ether	0	0		0	N/A	N/A	N/A
Bis(2-Ethylhexyl)Phthalate	0	0		0	N/A	N/A	N/A
4-Bromophenyl Phenyl Ether	0	0		0	N/A	N/A	N/A
Butyl Benzyl Phthalate	0	0		0	0.1	0.1	1.54
2-Chloronaphthalene	0	0		0	800	800	12,341
Chrysene	0	0		0	N/A	N/A	N/A
Dibenzo(a,h)Anthracene	0	0		0	N/A	N/A	N/A
1,2-Dichlorobenzene	0	0		0	1,000	1,000	15,426
1,3-Dichlorobenzene	0	0		0	7	7.0	108
1,4-Dichlorobenzene	0	0		0	300	300	4,628
3,3-Dichlorobenzidine	0	0		0	N/A	N/A	N/A
Diethyl Phthalate	0	0		0	600	600	9,256
Dimethyl Phthalate	0	0		0	2,000	2,000	30,853
Di-n-Butyl Phthalate	0	0		0	20	20.0	309
2,4-Dinitrotoluene	0	0		0	N/A	N/A	N/A
2,6-Dinitrotoluene	0	0		0	N/A	N/A	N/A
1,2-Diphenylhydrazine	0	0		0	N/A	N/A	N/A
Fluoranthene	0	0		0	20	20.0	309
Fluorene	0	0		0	50	50.0	771
Hexachlorobenzene	0	0		0	N/A	N/A	N/A
Hexachlorobutadiene	0	0		0	N/A	N/A	N/A

Hexachlorocyclopentadiene	0	0		0	4	4.0	61.7	
Hexachloroethane	0	0		0	N/A	N/A	N/A	
Indeno(1,2,3-cd)Pyrene	0	0		0	N/A	N/A	N/A	
Isophorone	0	0		0	34	34.0	524	
Naphthalene	0	0		0	N/A	N/A	N/A	
Nitrobenzene	0	0		0	10	10.0	154	
n-Nitrosodimethylamine	0	0		0	N/A	N/A	N/A	
n-Nitrosodi-n-Propylamine	0	0		0	N/A	N/A	N/A	
n-Nitrosodiphenylamine	0	0		0	N/A	N/A	N/A	
Phenanthrene	0	0		0	N/A	N/A	N/A	
Pyrene	0	0		0	20	20.0	309	
1,2,4-Trichlorobenzene	0	0		0	0.07	0.07	1.08	

 CRL

 CCT (min):

 PMF:

 Analysis Hardness (mg/l):

 Analysis pH:

Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A	
Chloride (PWS)	0	0		0	N/A	N/A	N/A	
Sulfate (PWS)	0	0		0	N/A	N/A	N/A	
Total Aluminum	0	0		0	N/A	N/A	N/A	
Total Antimony	0	0		0	N/A	N/A	N/A	
Total Arsenic	0	0		0	N/A	N/A	N/A	
Total Barium	0	0		0	N/A	N/A	N/A	
Total Boron	0	0		0	N/A	N/A	N/A	
Total Cadmium	0	0		0	N/A	N/A	N/A	
Total Chromium (III)	0	0		0	N/A	N/A	N/A	
Hexavalent Chromium	0	0		0	N/A	N/A	N/A	
Total Cobalt	0	0		0	N/A	N/A	N/A	
Total Copper	0	0		0	N/A	N/A	N/A	
Free Cyanide	0	0		0	N/A	N/A	N/A	
Dissolved Iron	0	0		0	N/A	N/A	N/A	
Total Iron	0	0		0	N/A	N/A	N/A	
Total Lead	0	0		0	N/A	N/A	N/A	
Total Manganese	0	0		0	N/A	N/A	N/A	
Total Mercury	0	0		0	N/A	N/A	N/A	
Total Nickel	0	0		0	N/A	N/A	N/A	
Total Phenols (Phenolics) (PWS)	0	0		0	N/A	N/A	N/A	
Total Selenium	0	0		0	N/A	N/A	N/A	
Total Silver	0	0		0	N/A	N/A	N/A	
Total Thallium	0	0		0	N/A	N/A	N/A	
Total Zinc	0	0		0	N/A	N/A	N/A	
Acrolein	0	0		0	N/A	N/A	N/A	
Acrylonitrile	0	0		0	0.06	0.06	4.79	
Benzene	0	0		0	0.58	0.58	46.3	

Bromoform	0	0		0	7	7.0	559	
Carbon Tetrachloride	0	0		0	0.4	0.4	32.0	
Chlorobenzene	0	0		0	N/A	N/A	N/A	
Chlorodibromomethane	0	0		0	0.8	0.8	63.9	
2-Chloroethyl Vinyl Ether	0	0		0	N/A	N/A	N/A	
Chloroform	0	0		0	5.7	5.7	455	
Dichlorobromomethane	0	0		0	0.95	0.95	75.9	
1,2-Dichloroethane	0	0		0	9.9	9.9	791	
1,1-Dichloroethylene	0	0		0	N/A	N/A	N/A	
1,2-Dichloropropane	0	0		0	0.9	0.9	71.9	
1,3-Dichloropropylene	0	0		0	0.27	0.27	21.6	
Ethylbenzene	0	0		0	N/A	N/A	N/A	
Methyl Bromide	0	0		0	N/A	N/A	N/A	
Methyl Chloride	0	0		0	N/A	N/A	N/A	
Methylene Chloride	0	0		0	20	20.0	1,598	
1,1,2,2-Tetrachloroethane	0	0		0	0.2	0.2	16.0	
Tetrachloroethylene	0	0		0	10	10.0	799	
Toluene	0	0		0	N/A	N/A	N/A	
1,2-trans-Dichloroethylene	0	0		0	N/A	N/A	N/A	
1,1,1-Trichloroethane	0	0		0	N/A	N/A	N/A	
1,1,2-Trichloroethane	0	0		0	0.55	0.55	43.9	
Trichloroethylene	0	0		0	0.6	0.6	47.9	
Vinyl Chloride	0	0		0	0.02	0.02	1.6	
2-Chlorophenol	0	0		0	N/A	N/A	N/A	
2,4-Dichlorophenol	0	0		0	N/A	N/A	N/A	
2,4-Dimethylphenol	0	0		0	N/A	N/A	N/A	
4,6-Dinitro-o-Cresol	0	0		0	N/A	N/A	N/A	
2,4-Dinitrophenol	0	0		0	N/A	N/A	N/A	
2-Nitrophenol	0	0		0	N/A	N/A	N/A	
4-Nitrophenol	0	0		0	N/A	N/A	N/A	
Pentachlorophenol	0	0		0	0.030	0.03	2.4	
Phenol	0	0		0	N/A	N/A	N/A	
2,4,6-Trichlorophenol	0	0		0	1.5	1.5	120	
Acenaphthene	0	0		0	N/A	N/A	N/A	
Anthracene	0	0		0	N/A	N/A	N/A	
Benzdine	0	0		0	0.0001	0.0001	0.008	
Benzo(a)Anthracene	0	0		0	0.001	0.001	0.08	
Benzo(a)Pyrene	0	0		0	0.0001	0.0001	0.008	
3,4-Benzofluoranthene	0	0		0	0.001	0.001	0.08	
Benzo(k)Fluoranthene	0	0		0	0.01	0.01	0.8	
Bis(2-Chloroethyl)Ether	0	0		0	0.03	0.03	2.4	
Bis(2-Ethylhexyl)Phthalate	0	0		0	0.32	0.32	25.6	
4-Bromophenyl Phenyl Ether	0	0		0	N/A	N/A	N/A	
Butyl Benzyl Phthalate	0	0		0	N/A	N/A	N/A	
2-Chloronaphthalene	0	0		0	N/A	N/A	N/A	

Chrysene	0	0		0	0.12	0.12	9.59	
Dibenzo(a,h)Anthracene	0	0		0	0.0001	0.0001	0.008	
1,2-Dichlorobenzene	0	0		0	N/A	N/A	N/A	
1,3-Dichlorobenzene	0	0		0	N/A	N/A	N/A	
1,4-Dichlorobenzene	0	0		0	N/A	N/A	N/A	
3,3-Dichlorobenzidine	0	0		0	0.05	0.05	3.99	
Diethyl Phthalate	0	0		0	N/A	N/A	N/A	
Dimethyl Phthalate	0	0		0	N/A	N/A	N/A	
Di-n-Butyl Phthalate	0	0		0	N/A	N/A	N/A	
2,4-Dinitrotoluene	0	0		0	0.05	0.05	3.99	
2,6-Dinitrotoluene	0	0		0	0.05	0.05	3.99	
1,2-Diphenylhydrazine	0	0		0	0.03	0.03	2.4	
Fluoranthene	0	0		0	N/A	N/A	N/A	
Fluorene	0	0		0	N/A	N/A	N/A	
Hexachlorobenzene	0	0		0	0.00008	0.00008	0.006	
Hexachlorobutadiene	0	0		0	0.01	0.01	0.8	
Hexachlorocyclopentadiene	0	0		0	N/A	N/A	N/A	
Hexachloroethane	0	0		0	0.1	0.1	7.99	
Indeno(1,2,3-cd)Pyrene	0	0		0	0.001	0.001	0.08	
Isophorone	0	0		0	N/A	N/A	N/A	
Naphthalene	0	0		0	N/A	N/A	N/A	
Nitrobenzene	0	0		0	N/A	N/A	N/A	
n-Nitrosodimethylamine	0	0		0	0.0007	0.0007	0.056	
n-Nitrosodi-n-Propylamine	0	0		0	0.005	0.005	0.4	
n-Nitrosodiphenylamine	0	0		0	3.3	3.3	264	
Phenanthrene	0	0		0	N/A	N/A	N/A	
Pyrene	0	0		0	N/A	N/A	N/A	
1,2,4-Trichlorobenzene	0	0		0	N/A	N/A	N/A	

Recommended WQBELs & Monitoring Requirements

No. Samples/Month: **4**

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			
Total Copper	1.35	1.79	29.5	39.1	73.8	µg/L	29.5	AFC	Discharge Conc ≥ 50% WQBEL (RP)
Total Zinc	Report	Report	Report	Report	Report	µg/L	311	AFC	Discharge Conc > 10% WQBEL (no RP)

Other Pollutants without Limits or Monitoring

The following pollutants do not require effluent limits or monitoring based on water quality because reasonable potential to exceed water quality criteria was not determined and the discharge concentration was less than thresholds for monitoring, or the pollutant was not detected and a sufficiently sensitive analytical method was used (e.g., ≤ Target QL).

Pollutants	Governing	Units	Comments


Parameter	WQBEL	Units	Comments
Total Dissolved Solids (PWS)	N/A	N/A	PWS Not Applicable
Chloride (PWS)	N/A	N/A	PWS Not Applicable
Bromide	N/A	N/A	No WQS
Sulfate (PWS)	N/A	N/A	PWS Not Applicable
Total Aluminum	1,482	µg/L	Discharge Conc ≤ 10% WQBEL
Total Antimony	86.4	µg/L	Discharge Conc ≤ 10% WQBEL
Total Arsenic	154	µg/L	Discharge Conc ≤ 10% WQBEL
Total Barium	37,023	µg/L	Discharge Conc ≤ 10% WQBEL
Total Beryllium	N/A	N/A	No WQS
Total Boron	16,002	µg/L	Discharge Conc ≤ 10% WQBEL
Total Cadmium	4.41	µg/L	Discharge Conc < TQL
Total Chromium (III)	1,411	µg/L	Discharge Conc ≤ 10% WQBEL
Hexavalent Chromium	32.2	µg/L	Discharge Conc < TQL
Total Cobalt	188	µg/L	Discharge Conc ≤ 10% WQBEL
Free Cyanide	43.5	µg/L	Discharge Conc ≤ 25% WQBEL
Total Cyanide	N/A	N/A	No WQS
Dissolved Iron	4,628	µg/L	Discharge Conc ≤ 10% WQBEL
Total Iron	49,242	µg/L	Discharge Conc ≤ 10% WQBEL
Total Lead	53.9	µg/L	Discharge Conc < TQL
Total Manganese	15,426	µg/L	Discharge Conc ≤ 10% WQBEL
Total Mercury	0.77	µg/L	Discharge Conc < TQL
Total Nickel	856	µg/L	Discharge Conc ≤ 10% WQBEL
Total Phenols (Phenolics) (PWS)		µg/L	PWS Not Applicable
Total Selenium	77.0	µg/L	Discharge Conc ≤ 10% WQBEL
Total Silver	13.0	µg/L	Discharge Conc < TQL
Total Thallium	3.7	µg/L	Discharge Conc < TQL
Total Molybdenum	N/A	N/A	No WQS
Acrolein	5.93	µg/L	Discharge Conc < TQL
Acrylonitrile	4.79	µg/L	Discharge Conc < TQL
Benzene	46.3	µg/L	Discharge Conc < TQL
Bromoform	559	µg/L	Discharge Conc < TQL
Carbon Tetrachloride	32.0	µg/L	Discharge Conc < TQL
Chlorobenzene	1,543	µg/L	Discharge Conc ≤ 25% WQBEL
Chlorodibromomethane	63.9	µg/L	Discharge Conc < TQL
Chloroethane	N/A	N/A	No WQS
2-Chloroethyl Vinyl Ether	35,561	µg/L	Discharge Conc ≤ 25% WQBEL
Chloroform	455	µg/L	Discharge Conc ≤ 25% WQBEL
Dichlorobromomethane	75.9	µg/L	Discharge Conc < TQL
1,1-Dichloroethane	N/A	N/A	No WQS
1,2-Dichloroethane	791	µg/L	Discharge Conc < TQL
1,1-Dichloroethylene	509	µg/L	Discharge Conc < TQL
1,2-Dichloropropane	71.9	µg/L	Discharge Conc < TQL
1,3-Dichloropropylene	21.6	µg/L	Discharge Conc < TQL
1,4-Dioxane	N/A	N/A	No WQS

Ethylbenzene	1,049	µg/L	Discharge Conc < TQL
Methyl Bromide	1,087	µg/L	Discharge Conc < TQL
Methyl Chloride	55,317	µg/L	Discharge Conc < TQL
Methylene Chloride	1,598	µg/L	Discharge Conc < TQL
1,1,2,2-Tetrachloroethane	16.0	µg/L	Discharge Conc < TQL
Tetrachloroethylene	799	µg/L	Discharge Conc < TQL
Toluene	879	µg/L	Discharge Conc < TQL
1,2-trans-Dichloroethylene	1,543	µg/L	Discharge Conc < TQL
1,1,1-Trichloroethane	5,927	µg/L	Discharge Conc < TQL
1,1,2-Trichloroethane	43.9	µg/L	Discharge Conc < TQL
Trichloroethylene	47.9	µg/L	Discharge Conc < TQL
Vinyl Chloride	1.6	µg/L	Discharge Conc < TQL
2-Chlorophenol	463	µg/L	Discharge Conc < TQL
2,4-Dichlorophenol	154	µg/L	Discharge Conc < TQL
2,4-Dimethylphenol	1,304	µg/L	Discharge Conc < TQL
4,6-Dinitro-o-Cresol	30.9	µg/L	Discharge Conc < TQL
2,4-Dinitrophenol	154	µg/L	Discharge Conc < TQL
2-Nitrophenol	15,805	µg/L	Discharge Conc < TQL
4-Nitrophenol	4,544	µg/L	Discharge Conc < TQL
Pentachlorophenol	2.4	µg/L	Discharge Conc < TQL
Phenol	61,706	µg/L	Discharge Conc < TQL
2,4,6-Trichlorophenol	120	µg/L	Discharge Conc < TQL
Acenaphthene	164	µg/L	Discharge Conc ≤ 25% WQBEL
Acenaphthylene	N/A	N/A	No WQS
Anthracene	4,628	µg/L	Discharge Conc ≤ 25% WQBEL
Benzidine	0.008	µg/L	Discharge Conc < TQL
Benzo(a)Anthracene	0.08	µg/L	Discharge Conc < TQL
Benzo(a)Pyrene	0.008	µg/L	Discharge Conc < TQL
3,4-Benzofluoranthene	0.08	µg/L	Discharge Conc < TQL
Benzo(ghi)Perylene	N/A	N/A	No WQS
Benzo(k)Fluoranthene	0.8	µg/L	Discharge Conc < TQL
Bis(2-Chloroethoxy)Methane	N/A	N/A	No WQS
Bis(2-Chloroethyl)Ether	2.4	µg/L	Discharge Conc < TQL
Bis(2-Ethylhexyl)Phthalate	25.6	µg/L	Discharge Conc < TQL
4-Bromophenyl Phenyl Ether	533	µg/L	Discharge Conc < TQL
Butyl Benzyl Phthalate	1.54	µg/L	Discharge Conc < TQL
2-Chloronaphthalene	12,341	µg/L	Discharge Conc < TQL
4-Chlorophenyl Phenyl Ether	N/A	N/A	No WQS
Chrysene	9.59	µg/L	Discharge Conc < TQL
Dibenzo(a,h)Anthracene	0.008	µg/L	Discharge Conc < TQL
1,2-Dichlorobenzene	1,620	µg/L	Discharge Conc < TQL
1,3-Dichlorobenzene	108	µg/L	Discharge Conc < TQL
1,4-Dichlorobenzene	1,442	µg/L	Discharge Conc < TQL
3,3-Dichlorobenzidine	3.99	µg/L	Discharge Conc < TQL
Diethyl Phthalate	7,902	µg/L	Discharge Conc < TQL

Dimethyl Phthalate	4,939	µg/L	Discharge Conc < TQL
Di-n-Butyl Phthalate	217	µg/L	Discharge Conc < TQL
2,4-Dinitrotoluene	3.99	µg/L	Discharge Conc < TQL
2,6-Dinitrotoluene	3.99	µg/L	Discharge Conc < TQL
Di-n-Octyl Phthalate	N/A	N/A	No WQS
1,2-Diphenylhydrazine	2.4	µg/L	Discharge Conc < TQL
Fluoranthene	309	µg/L	Discharge Conc ≤ 25% WQBEL
Fluorene	771	µg/L	Discharge Conc ≤ 25% WQBEL
Hexachlorobenzene	0.006	µg/L	Discharge Conc < TQL
Hexachlorobutadiene	0.8	µg/L	Discharge Conc < TQL
Hexachlorocyclopentadiene	9.88	µg/L	Discharge Conc < TQL
Hexachloroethane	7.99	µg/L	Discharge Conc < TQL
Indeno(1,2,3-cd)Pyrene	0.08	µg/L	Discharge Conc < TQL
Isophorone	524	µg/L	Discharge Conc < TQL
Naphthalene	277	µg/L	Discharge Conc < TQL
Nitrobenzene	154	µg/L	Discharge Conc < TQL
n-Nitrosodimethylamine	0.056	µg/L	Discharge Conc < TQL
n-Nitrosodi-n-Propylamine	0.4	µg/L	Discharge Conc < TQL
n-Nitrosodiphenylamine	264	µg/L	Discharge Conc < TQL
Phenanthrene	9.88	µg/L	Discharge Conc < TQL
Pyrene	309	µg/L	Discharge Conc ≤ 25% WQBEL
1,2,4-Trichlorobenzene	1.08	µg/L	Discharge Conc < TQL

PA0026085 at 002

Region ID: PA
 Workspace ID: PA20210625143240665000
 Clicked Point (Latitude, Longitude): 40.09143, -75.32145
 Time: 2021-06-25 10:33:02 -0400

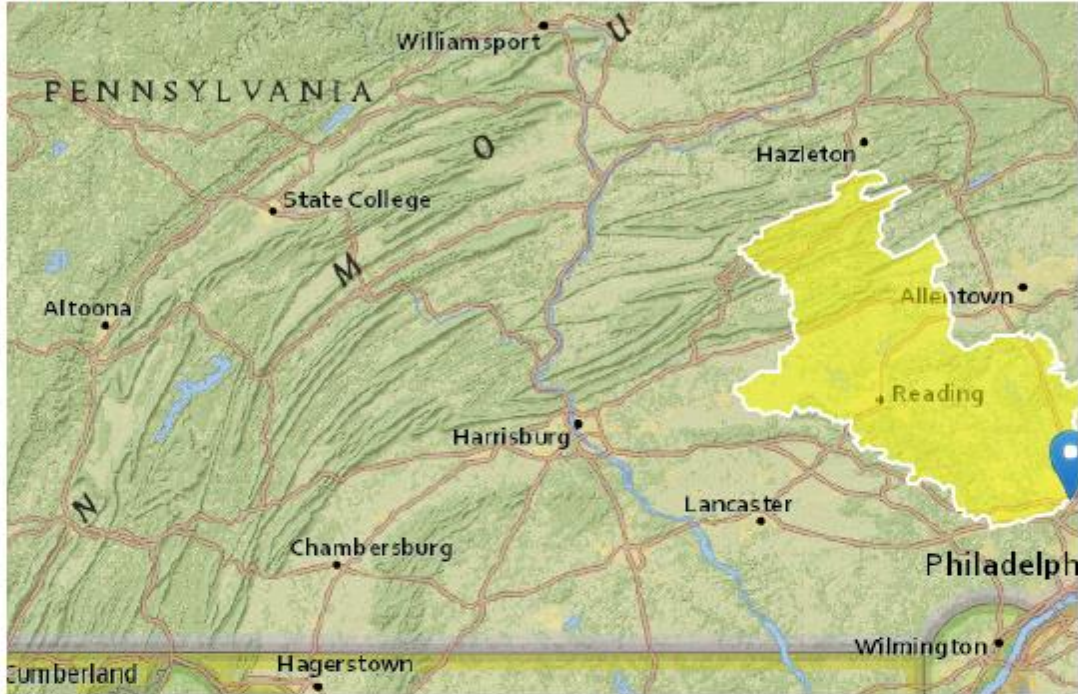

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	1770	square miles
BSLOPD	Mean basin slope measured in degrees	5.5196	degrees
ROCKDEP	Depth to rock	4.5	feet
URBAN	Percentage of basin with urban development	10.0528	percent
PRECIP	Mean Annual Precipitation	46	inches

Parameter Code	Parameter Description	Value	Unit
STRDEN	Stream Density -- total length of streams divided by drainage area	1.5	miles per square mile
CARBON	Percentage of area of carbonate rock	13.84	percent

Low-Flow Statistics Parameters [48.9 Percent (866 square miles) Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	1770	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	5.5196	degrees	1.7	6.4
ROCKDEP	Depth to Rock	4.5	feet	4.13	5.21
URBAN	Percent Urban	10.0528	percent	0	89

Low-Flow Statistics Parameters [51.1 Percent (905 square miles) Low Flow Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	1770	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	46	inches	35	50.4
STRDEN	Stream Density	1.5	miles per square mile	0.51	3.1
ROCKDEP	Depth to Rock	4.5	feet	3.32	5.65
CARBON	Percent Carbonate	13.84	percent	0	99

Low-Flow Statistics Disclaimers [48.9 Percent (866 square miles) Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report [48.9 Percent (866 square miles) Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	434	ft ³ /s
30 Day 2 Year Low Flow	536	ft ³ /s
7 Day 10 Year Low Flow	271	ft ³ /s
30 Day 10 Year Low Flow	326	ft ³ /s
90 Day 10 Year Low Flow	436	ft ³ /s

Low-Flow Statistics Disclaimers [51.1 Percent (905 square miles) Low Flow Region 2]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report [51.1 Percent (905 square miles) Low Flow Region 2]

Statistic	Value	Unit
7 Day 2 Year Low Flow	666	ft ³ /s
30 Day 2 Year Low Flow	782	ft ³ /s
7 Day 10 Year Low Flow	447	ft ³ /s
30 Day 10 Year Low Flow	524	ft ³ /s
90 Day 10 Year Low Flow	637	ft ³ /s


Low-Flow Statistics Flow Report [Area-Averaged]

Statistic	Value	Unit
7 Day 2 Year Low Flow	553	ft ³ /s
30 Day 2 Year Low Flow	662	ft ³ /s
7 Day 10 Year Low Flow	361	ft ³ /s
30 Day 10 Year Low Flow	427	ft ³ /s
90 Day 10 Year Low Flow	539	ft ³ /s

Low-Flow Statistics Citations

PA0026085 at node 2

Region ID: PA
Workspace ID: PA20210628134523958000
Clicked Point (Latitude, Longitude): 40.07400, -75.31471
Time: 2021-06-28 09:45:43 -0400

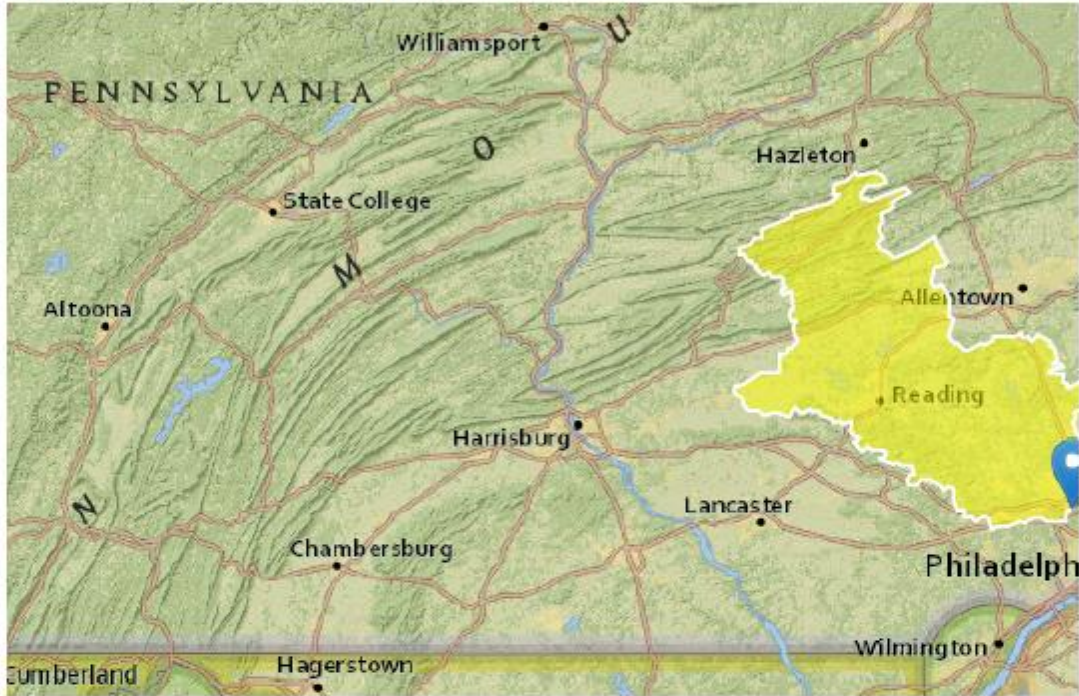

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	1780	square miles
BSLOPD	Mean basin slope measured in degrees	5.5181	degrees
ROCKDEP	Depth to rock	4.5	feet
URBAN	Percentage of basin with urban development	10.3511	percent
PRECIP	Mean Annual Precipitation	46	inches

Parameter Code	Parameter Description	Value	Unit
STRDEN	Stream Density -- total length of streams divided by drainage area	1.5	miles per square mile
CARBON	Percentage of area of carbonate rock	13.93	percent

Low-Flow Statistics Parameters [49.1 Percent (874 square miles) Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	1780	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	5.5181	degrees	1.7	6.4
ROCKDEP	Depth to Rock	4.5	feet	4.13	5.21
URBAN	Percent Urban	10.3511	percent	0	89

Low-Flow Statistics Parameters [50.9 Percent (905 square miles) Low Flow Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	1780	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	46	inches	35	50.4
STRDEN	Stream Density	1.5	miles per square mile	0.51	3.1
ROCKDEP	Depth to Rock	4.5	feet	3.32	5.65
CARBON	Percent Carbonate	13.93	percent	0	99

Low-Flow Statistics Disclaimers [49.1 Percent (874 square miles) Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report [49.1 Percent (874 square miles) Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	439	ft ³ /s
30 Day 2 Year Low Flow	542	ft ³ /s
7 Day 10 Year Low Flow	274	ft ³ /s
30 Day 10 Year Low Flow	330	ft ³ /s
90 Day 10 Year Low Flow	442	ft ³ /s

Low-Flow Statistics Disclaimers [50.9 Percent (905 square miles) Low Flow Region 2]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report [50.9 Percent (905 square miles) Low Flow Region 2]

Statistic	Value	Unit
7 Day 2 Year Low Flow	671	ft ³ /s
30 Day 2 Year Low Flow	787	ft ³ /s
7 Day 10 Year Low Flow	451	ft ³ /s
30 Day 10 Year Low Flow	528	ft ³ /s
90 Day 10 Year Low Flow	641	ft ³ /s

Low-Flow Statistics Flow Report [Area-Averaged]

Statistic	Value	Unit
7 Day 2 Year Low Flow	557	ft ³ /s
30 Day 2 Year Low Flow	667	ft ³ /s
7 Day 10 Year Low Flow	364	ft ³ /s
30 Day 10 Year Low Flow	431	ft ³ /s
90 Day 10 Year Low Flow	543	ft ³ /s

Low-Flow Statistics Citations

DEP Whole Effluent Toxicity (WET) Analysis Spreadsheet

Type of Test
 Species Tested
 Endpoint
 TIWC (decimal)
 No. Per Replicate
 TST b value
 TST alpha value

Facility Name

Permit No.

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="4/3/2017"/>	
1	1	1
2	1	1
3	1	1
4	1	1
5	1	1
6	1	1
7	0	1
8	1	1
9	1	1
10	1	1
11		
12		
13		
14		
15		

Mean
 Std Dev.
 # Replicates

T-Test Result
 Deg. of Freedom
 Critical T Value
 Pass or Fail

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="11/6/2018"/>	
1	1	1
2	1	1
3	1	1
4	1	1
5	1	0
6	1	1
7	1	1
8	0	1
9	1	1
10	1	1
11		
12		
13		
14		
15		

Mean
 Std Dev.
 # Replicates

T-Test Result
 Deg. of Freedom
 Critical T Value
 Pass or Fail

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="11/4/2019"/>	
1	1	1
2	1	1
3	1	1
4	1	1
5	1	1
6	1	1
7	1	1
8	1	1
9	1	1
10	1	1
11		
12		
13		
14		
15		

Mean
 Std Dev.
 # Replicates

T-Test Result
 Deg. of Freedom
 Critical T Value
 Pass or Fail

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="12/8/2020"/>	
1	1	1
2	1	1
3	1	1
4	1	1
5	1	1
6	1	1
7	1	1
8	1	1
9	1	1
10	1	1
11		
12		
13		
14		
15		

Mean
 Std Dev.
 # Replicates

T-Test Result
 Deg. of Freedom
 Critical T Value
 Pass or Fail

DEP Whole Effluent Toxicity (WET) Analysis Spreadsheet

Type of Test
 Species Tested
 Endpoint
 TIWC (decimal)
 No. Per Replicate
 TST b value
 TST alpha value

Facility Name
 Permit No.

Replicate No.	Test Completion Date	
	Control	TIWC
1	34	39
2	36	39
3	32	39
4	44	38
5	19	38
6	29	40
7	9	38
8	30	42
9	37	33
10	32	38
11		
12		
13		
14		
15		

Mean 30.200 38.400
 Std Dev. 9.818 2.271
 # Replicates 10 10

T-Test Result 6.4634
 Deg. of Freedom 15
 Critical T Value 0.8662
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
1	32	26
2	36	34
3	36	33
4	28	34
5	36	0
6	35	35
7	30	37
8	0	26
9	40	34
10	41	39
11		
12		
13		
14		
15		

Mean 31.400 29.800
 Std Dev. 11.749 11.272
 # Replicates 10 10

T-Test Result 1.3813
 Deg. of Freedom 16
 Critical T Value 0.8647
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
1	26	33
2	27	36
3	22	29
4	28	40
5	39	35
6	27	32
7	35	30
8	30	19
9	33	38
10	34	34
11		
12		
13		
14		
15		

Mean 30.100 32.600
 Std Dev. 5.087 5.854
 # Replicates 10 10

T-Test Result 4.5370
 Deg. of Freedom 16
 Critical T Value 0.8647
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
1	38	40
2	40	38
3	36	39
4	35	35
5	38	36
6	34	41
7	38	36
8	38	36
9	26	44
10	34	34
11		
12		
13		
14		
15		

Mean 35.700 37.900
 Std Dev. 3.945 3.107
 # Replicates 10 10

T-Test Result 8.1988
 Deg. of Freedom 17
 Critical T Value 0.8633
 Pass or Fail **PASS**

DEP Whole Effluent Toxicity (WET) Analysis Spreadsheet

Type of Test
 Species Tested
 Endpoint
 TIWC (decimal)
 No. Per Replicate
 TST b value
 TST alpha value

Facility Name

Permit No.

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="4/4/2017"/>	
1	10	10
2	10	10
3	9	10
4	10	10
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 9.750 10.000
 Std Dev. 0.500 0.000
 # Replicates 4 4

T-Test Result 12.5523
 Deg. of Freedom 3
 Critical T Value 0.7649
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="11/6/2018"/>	
1	10	9
2	10	9
3	10	9
4	10	10
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 10.000 9.250
 Std Dev. 0.000 0.500
 # Replicates 4 4

T-Test Result 5.6643
 Deg. of Freedom 3
 Critical T Value 0.7649
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="11/5/2019"/>	
1	10	10
2	10	9
3	10	10
4	10	10
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 10.000 9.750
 Std Dev. 0.000 0.500
 # Replicates 4 4

T-Test Result 7.6643
 Deg. of Freedom 3
 Critical T Value 0.7649
 Pass or Fail **PASS**

Replicate No.	Test Completion Date	
	Control	TIWC
	<input type="text" value="12/8/2020"/>	
1	10	10
2	10	10
3	10	10
4	10	10
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 10.000 10.000
 Std Dev. 0.000 0.000
 # Replicates 4 4

T-Test Result 5.6643
 Deg. of Freedom 3
 Critical T Value 0.7649
 Pass or Fail **PASS**

DEP Whole Effluent Toxicity (WET) Analysis Spreadsheet

Type of Test
 Species Tested
 Endpoint
 TIWC (decimal)
 No. Per Replicate
 TST b value
 TST alpha value

Facility Name
 Permit No.

Test Completion Date		
Replicate	4/4/2017	
No.	Control	TIWC
1	0.378	0.412
2	0.361	0.474
3	0.379	0.452
4	0.368	0.374
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 0.371 0.428
 Std Dev. 0.008 0.044
 # Replicates 4 4

T-Test Result 6.7229
 Deg. of Freedom 3
 Critical T Value 0.7649
 Pass or Fail **PASS**

Test Completion Date		
Replicate	11/6/2018	
No.	Control	TIWC
1	0.531	0.444
2	0.503	0.447
3	0.53	0.497
4	0.472	0.524
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 0.509 0.478
 Std Dev. 0.028 0.039
 # Replicates 4 4

T-Test Result 4.3391
 Deg. of Freedom 5
 Critical T Value 0.7267
 Pass or Fail **PASS**

Test Completion Date		
Replicate	11/5/2019	
No.	Control	TIWC
1	0.36	0.437
2	0.356	0.398
3	0.464	0.407
4	0.401	0.382
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 0.395 0.406
 Std Dev. 0.050 0.023
 # Replicates 4 4

T-Test Result 4.9644
 Deg. of Freedom 5
 Critical T Value 0.7267
 Pass or Fail **PASS**

Test Completion Date		
Replicate	12/8/2020	
No.	Control	TIWC
1	0.411	0.463
2	0.466	0.354
3	0.489	0.428
4	0.388	0.429
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Mean 0.439 0.419
 Std Dev. 0.047 0.046
 # Replicates 4 4

T-Test Result 3.0953
 Deg. of Freedom 5
 Critical T Value 0.7267
 Pass or Fail **PASS**

WET Summary and Evaluation

Facility Name	Matsunk WPCC
Permit No.	PA0026085
Design Flow (MGD)	5.5
Q ₇₋₁₀ Flow (cfs)	271
PMF _a	0.065
PMF _c	0.453

Species	Endpoint	Test Results (Pass/Fail)			
		Test Date	Test Date	Test Date	Test Date
Ceriodaphnia	Survival	4/3/17	11/6/18	11/4/19	12/8/20
		PASS	PASS	PASS	PASS

Species	Endpoint	Test Results (Pass/Fail)			
		Test Date	Test Date	Test Date	Test Date
Ceriodaphnia	Reproduction	4/3/17	11/6/18	11/4/19	12/8/20
		PASS	PASS	PASS	PASS

Species	Endpoint	Test Results (Pass/Fail)			
		Test Date	Test Date	Test Date	Test Date
Pimephales	Survival	4/4/17	11/6/18	11/5/19	12/8/20
		PASS	PASS	PASS	PASS

Species	Endpoint	Test Results (Pass/Fail)			
		Test Date	Test Date	Test Date	Test Date
Pimephales	Growth	4/4/17	11/6/18	11/5/19	12/8/20
		PASS	PASS	PASS	PASS

Reasonable Potential? NO

Permit Recommendations

Test Type Chronic
 TIWC 6 % Effluent
 Dilution Series 3, 6, 30, 60, 100 % Effluent
 Permit Limit None
 Permit Limit Species