



**AUTHORIZATION TO DISCHARGE UNDER THE
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM
DISCHARGE REQUIREMENTS FOR PUBLICLY OWNED
TREATMENT WORKS (POTWs)**

**NPDES PERMIT NO: PA0028461
Amendment No. 2**

In compliance with the provisions of the Clean Water Act, 33 U.S.C. Section 1251 *et seq.* ("the Act") and Pennsylvania's Clean Streams Law, as amended, 35 P.S. Section 691.1 *et seq.*,

**Borough of Mifflinburg
120 North 3rd Street
Mifflinburg, PA 17844-1134**

is authorized to discharge from a facility known as **Mifflinburg Borough Wastewater Treatment Plant**, located in **Mifflinburg Borough, Union County**, to **Buffalo Creek** in Watershed(s) **10-C** in accordance with effluent limitations, monitoring requirements and other conditions set forth in Parts A, B and C hereof.

THIS PERMIT SHALL BECOME EFFECTIVE ON 11/1/2011

THIS PERMIT SHALL EXPIRE AT MIDNIGHT ON 10/31/2016

The authority granted by this permit is subject to the following further qualifications:

1. If there is a conflict between the application, its supporting documents and/or amendments and the terms and conditions of this permit, the terms and conditions shall apply.
2. Failure to comply with the terms, conditions or effluent limitations of this permit is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or for denial of a permit renewal application. 40 CFR 122.41(a)
3. A complete application for renewal of this permit, or notice of intent to cease discharging by the expiration date, must be submitted to DEP at least 180 days prior to the above expiration date (unless permission has been granted by DEP for submission at a later date), using the appropriate NPDES permit application form. 40 CFR 122.41(b), 122.21(d)

In the event that a timely and complete application for renewal has been submitted and DEP is unable, through no fault of the permittee, to reissue the permit before the above expiration date, the terms and conditions of this permit, including submission of the Discharge Monitoring Reports (DMRs), will be automatically continued and will remain fully effective and enforceable against the discharger until DEP takes final action on the pending permit application. 25 Pa. Code 92a.7(b), (c)

4. This NPDES permit does not constitute authorization to construct or make modifications to wastewater treatment facilities necessary to meet the terms and conditions of this permit.

DATE PERMIT ISSUED 10/3/2011
DATE PERMIT AMENDMENT ISSUED 8/19/2014

ISSUED BY /s/
Thomas M. Randis
Clean Water Program Manager
Northcentral Regional Office

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 55' 33.80", Longitude 77° 2' 36.30", River Mile Index 14.3, Stream Code 18920

Discharging to Buffalo Creek

which receives wastewater from Mifflinburg Borough Wastewater Treatment Plant

1. The permittee is authorized to discharge during the period from Permit Effective Date through December 31, 2011.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements, Footnotes and Supplemental Information).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Metered
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	4.0	XXX	XXX	XXX	1/day	Grab
CBOD5 May 1 - Oct 31	99	140	XXX	8.5	12	17	2/week	24-Hr Composite
CBOD5 Nov 1 - Apr 30	292	467	XXX	25	40	50	2/week	24-Hr Composite
Total Suspended Solids	350	525	XXX	30	45	60	2/week	24-Hr Composite
Fecal Coliform (CFU/100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/week	Grab
Fecal Coliform (CFU/100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/week	Grab
UV Intensity (%)	XXX	XXX	Report	XXX	XXX	XXX	Continuous	Metered

Outfall 001, Continued (from Permit Effective Date through December 31, 2011)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Ammonia-Nitrogen May 1 - Oct 31	30	45	XXX	2.6	3.9	5.2	2/week	24-Hr Composite
Ammonia-Nitrogen Nov 1 - Apr 30	91	128	XXX	7.8	11	15	2/week	24-Hr Composite
Chronic toxicity (Ceriodaphnia) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	Report Max	XXX	1/year	Composite ⁽³⁾
Chronic toxicity (Pimephales) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	Report Max	XXX	1/ year	Composite ⁽³⁾

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. B. For Outfall 001, Latitude 40° 55' 33.80", Longitude 77° 2' 36.30", River Mile Index 14.3, Stream Code 18920

Discharging to Buffalo Creek

which receives wastewater from Mifflinburg Borough Wastewater Treatment Plant

1. The permittee is authorized to discharge during the period from January 1, 2012 through August 31, 2014.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements, Footnotes and Supplemental Information).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Metered
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	4.0	XXX	XXX	XXX	1/day	Grab
CBOD5 May 1 - Oct 31	99	140	XXX	8.5	12	17	2/week	24-Hr Composite
CBOD5 Nov 1 - Apr 30	292	467	XXX	25	40	50	2/week	24-Hr Composite
Total Suspended Solids	350	525	XXX	30	45	60	2/week	24-Hr Composite
Fecal Coliform (CFU/100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/week	Grab
Fecal Coliform (CFU/100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/week	Grab
Ammonia-Nitrogen May 1 - Oct 31	30	45	XXX	2.6	3.9	5.2	2/week	24-Hr Composite

Outfall 001, Continued (from January 1, 2012 through August 31, 2014)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Ammonia-Nitrogen Nov 1 - Apr 30	91	128	XXX	7.8	11	15	2/week	24-Hr Composite
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	1/month	Calculation
UV Dosage (mjoules/cm ²)	XXX	XXX	Report	XXX	XXX	XXX	Continuous	Metered
Chronic toxicity (Ceriodaphnia) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	Report Max	XXX	1/year	Composite ⁽³⁾
Chronic toxicity (Pimephales) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	Report Max	XXX	1/year	Composite ⁽³⁾

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. C. For Outfall 001, Latitude 40° 55' 33.80", Longitude 77° 2' 36.30", River Mile Index 14.3, Stream Code 18920

Discharging to Buffalo Creek

which receives wastewater from Mifflinburg Borough Wastewater Treatment Plant

1. The permittee is authorized to discharge during the period from September 1, 2014 through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements, Footnotes and Supplemental Information).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Metered
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	4.0	XXX	XXX	XXX	1/day	Grab
CBOD5 May 1 - Oct 31	99	140	XXX	8.5	12	17	2/week	24-Hr Composite
CBOD5 Nov 1 - Apr 30	292	467	XXX	25	40	50	2/week	24-Hr Composite
Total Suspended Solids	350	525	XXX	30	45	60	2/week	24-Hr Composite
Fecal Coliform (CFU/100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/week	Grab
Fecal Coliform (CFU/100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/week	Grab
Ammonia-Nitrogen May 1 - Oct 31	30	45	XXX	2.6	3.9	5.2	2/week	24-Hr Composite

Outfall 001, Continued (from September 1, 2014 through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Ammonia-Nitrogen Nov 1 - Apr 30	91	128	XXX	7.8	11	15	2/week	24-Hr Composite
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	1/month	Calculation
UV Dosage (mjoules/cm ²)	XXX	XXX	Report	XXX	XXX	XXX	Continuous	Metered
Chronic toxicity (Ceriodaphnia) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	2.21 Max	XXX	1/year	Composite ⁽³⁾
Chronic toxicity (Pimephales) ⁽⁴⁾ (TUc)	XXX	XXX	XXX	XXX	2.21 Max	XXX	1/year	Composite ⁽³⁾

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

**PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS
(Continued)**Additional Requirements

1. The discharger may not discharge floating materials, scum, sheen, or substances that result in deposits in the receiving water. Except as provided for in the permit, the discharger may not discharge foam, oil, grease, or substances that produce an observable change in the color, taste, odor, or turbidity of the receiving water. 25 Pa. Code 92a.41(c)
2. Except as otherwise specified in this permit, on a concentration basis, the monthly average percent removal of BOD5 or CBOD5, and TSS, must be at least 85% for POTW facilities. 25 Pa. Code 92a.47(a)(3)

Footnotes

- (1) When sampling to determine compliance with mass effluent limitations, the discharge flow at the time of sampling must be measured and recorded.
- (2) This is the minimum number of sampling events required. Permittees are encouraged, and it may be advantageous in demonstrating compliance, to perform more than the minimum number of sampling events.
- (3) For each chronic testing event, three 24-hour flow proportioned, composite samples shall be collected over a seven day exposure period. The samples shall be collected at a frequency of not greater than every two hours and flow proportioned. The samples must be collected at the NPDES permit sampling point.
- (4) See Part C IV and V

Supplemental Information

If the permit requires reporting of average weekly limitations use the following guideline. If the "maximum average concentration" and the "maximum average mass loading" does not occur within the same week, both the highest weekly average concentration and the highest weekly average mass load should be reported, regardless of whether they both occur during the same calendar week.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. D. For Outfall 001, Latitude 40° 55' 33.80", Longitude 77° 2' 36.30", River Mile Index 14.3, Stream Code 18920

Discharging to Buffalo Creek

which receives wastewater from Mifflinburg Borough Wastewater Treatment Plant

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements, Footnotes and Supplemental Information).

Parameter ⁽¹⁾	Effluent Limitations					Monitoring Requirements	
	Mass Units (lbs)		Concentrations (mg/L)			Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Monthly	Annual	Minimum	Monthly Average	Maximum		
Ammonia---N	Report	Report		Report		2/week	24-Hr Composite
Kjeldahl---N	Report			Report		1/week	24-Hr Composite
Nitrate-Nitrite as N	Report			Report		1/week	24-Hr Composite
Total Nitrogen	Report	Report		Report		1/month	Calculation
Total Phosphorus	Report	Report		Report		1/month	Calculation
Net Total Nitrogen	Report	25,570				1/month	Calculation
Net Total Phosphorus	Report	3,409				1/month	Calculation

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Footnotes:

(1) See Part C for Chesapeake Bay Requirements.

(2) This is the minimum number of sampling events required. Permittees are encouraged, and it may be advantageous in demonstrating compliance, to perform more than the minimum number of sampling events required.

II. DEFINITIONS

At Outfall (XXX) means a sampling location in outfall line XXX below the last point at which wastes are added to outfall line (XXX), or where otherwise specified.

Average refers to the use of an arithmetic mean, unless otherwise specified in this permit. 40 CFR 122.41(l)(4)(iii)

Best Management Practices (BMPs) means schedules of activities, prohibitions of practices, maintenance procedures and other management practices to prevent or reduce the pollution to surface waters of the Commonwealth. BMPs also include treatment requirements, operating procedures and practices to control plant site runoff, spillage or leaks, sludge or waste disposal, or drainage from raw material storage. 25 Pa. Code 92a.2

Bypass means the intentional diversion of waste streams from any portion of a treatment facility. 40 CFR 122.41(m)(1)(i)

Calendar Week is defined as the seven consecutive days from Sunday through Saturday, unless the permittee has been given permission by DEP to provide weekly data as Monday through Friday based on showing excellent performance of the facility and a history of compliance. In cases when the week falls in two separate months, the month with the most days in that week shall be the month for reporting.

Clean Water Act means the Federal Water Pollution Control Act, as amended. (33 U.S.C.A. §§1251 to 1387).

Composite Sample (for all except GC/MS volatile organic analysis) means a combination of individual samples (at least eight for a 24-hour period or four for an 8-hour period) of at least 100 milliliters (mL) each obtained at spaced time intervals during the compositing period. The composite must be flow-proportional; either the volume of each individual sample is proportional to discharge flow rates, or the sampling interval is proportional to the flow rates over the time period used to produce the composite. EPA Form 2C

Composite Sample (for GC/MS volatile organic analysis) consists of at least four aliquots or grab samples collected during the sampling event (not necessarily flow proportioned). The samples must be combined in the laboratory immediately before analysis and then one analysis is performed. EPA Form 2C

Daily Average Temperature means the average of all temperature measurements made, or the mean value plot of the record of a continuous automated temperature recording instrument, either during a calendar day or during the operating day if flows are of a shorter duration.

Daily Discharge means the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in units of mass, the "daily discharge" is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the "daily discharge" is calculated as the average measurement of the pollutant over the day. 25 Pa. Code 92a.2 and 40 CFR 122.2

Daily Maximum Discharge Limitation means the highest allowable "daily discharge."

Discharge Monitoring Report (DMR) means the DEP or EPA supplied form(s) for the reporting of self-monitoring results by the permittee. 40 CFR 122.2

Estimated Flow means any method of liquid volume measurement based on a technical evaluation of the sources contributing to the discharge including, but not limited to, pump capabilities, water meters and batch discharge volumes.

Geometric Mean means the average of a set of n sample results given by the nth root of their product.

Grab Sample means an individual sample of at least 100 mL collected at a randomly selected time over a period not to exceed 15 minutes. EPA Form 2C

Hazardous Substance means any substance designated under 40 CFR Part 116 pursuant to Section 311 of the Clean Water Act. 40 CFR 122.2

Immersion Stabilization (i-s) means a calibrated device is immersed in the wastewater until the reading is stabilized.

Indirect Discharger means a non-domestic discharger introducing pollutants to a Publicly Owned Treatment Works (POTW) or other treatment works. 25 Pa. Code 92a.2 and 40 CFR 122.2

Industrial User means a source of Indirect Discharge. 40 CFR 403.3

Instantaneous Maximum Effluent Limitation means the highest allowable discharge of a concentration or mass of a substance at any one time as measured by a grab sample. 25 Pa. Code 92a.2

Measured Flow means any method of liquid volume measurement, the accuracy of which has been previously demonstrated in engineering practice, or for which a relationship to absolute volume has been obtained.

Monthly Average Discharge Limitation means the highest allowable average of "daily discharges" over a calendar month, calculated as the sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month.

Municipality means a city, town, borough, county, township, school district, institution, authority or other public body created by or pursuant to State law and having jurisdiction over disposal of sewage, industrial wastes, or other wastes. 25 Pa. Code 92a.2

Publicly Owned Treatment Works (POTW) means a treatment works as defined by §212 of the Clean Water Act, owned by a state or municipality. The term includes any devices and systems used in the storage, treatment, recycling and reclamation of municipal sewage or industrial wastes of a liquid nature. The term also includes sewers, pipes or other conveyances if they convey wastewater to a POTW providing treatment. The term also means the municipality as defined in section 502(4) of the Clean Water Act, which has jurisdiction over the indirect discharges to and the discharges from such a treatment works. 25 Pa Code 92a.2 and 40 CFR 122.2

Severe Property Damage means substantial physical damage to property, damage to the treatment facilities that causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. 40 CFR 122.41(m)(1)(ii)

Stormwater means the runoff from precipitation, snow melt runoff, and surface runoff and drainage. 25 Pa. Code 92a.2

Stormwater Associated With Industrial Activity means the discharge from any conveyance that is used for collecting and conveying stormwater and that is directly related to manufacturing, processing or raw materials storage areas at an industrial plant, and as defined at 40 CFR §122.26(b)(14) (i) – (ix) and (xi) and 25 Pa. Code 92a.2

Toxic Pollutant means those pollutants, or combinations of pollutants, including disease-causing agents, which after discharge and upon exposure, ingestion, inhalation or assimilation into any organism, either directly from the environment or indirectly by ingestion through food chains may, on the basis of information available to DEP cause death, disease, behavioral abnormalities, cancer, genetic mutations, physiological malfunctions, including malfunctions in reproduction, or physical deformations in these organisms or their offspring. 25 Pa. Code 92a.2

Weekly Average Discharge Limitation means the highest allowable average of "daily discharges" over a calendar week, calculated as the sum of all "daily discharges" measured during a calendar week divided by the number of "daily discharges" measured during that week.

III. SELF-MONITORING, REPORTING AND RECORDKEEPING

A. Representative Sampling 40 CFR 122.4(j)(1)

1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
2. Records Retention 40 CFR 122.41(j)(2)

Except for records of monitoring information required by this permit related to the permittee's sludge use and disposal activities which shall be retained for a period of at least 5 years, all records of monitoring activities and results (including all original strip chart recordings for continuous monitoring instrumentation and calibration and maintenance records), copies of all reports required by this permit, and records of all data used to complete the application for this permit shall be retained by the permittee for 3 years from the date of the sample measurement, report or application. The 3-year period shall be extended as requested by DEP or the EPA Regional Administrator.

3. Recording of Results 40 CFR 122.41(j)(3)

For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:

- a. The exact place, date and time of sampling or measurements.
- b. The person(s) who performed the sampling or measurements.
- c. The date(s) the analyses were performed.
- d. The person(s) who performed the analyses.
- e. The analytical techniques or methods used; and the associated detection level.
- f. The results of such analyses.

4. Test Procedures 40 CFR 122.41(j)(4)

Facilities that test or analyze environmental samples used to demonstrate compliance with this permit shall be in compliance with laboratory accreditation requirements of Act 90 of 2002 (27 Pa. C.S. §§4101-4113) and 25 Pa. Code Chapter 252, relating to environmental laboratory accreditation. Unless otherwise specified in this permit, the test procedures for the analysis of pollutants shall be those approved under 40 CFR Part 136 (or in the case of sludge use or disposal, approved under 40 CFR Part 136, unless otherwise specified in 40 CFR Part 503 or Subpart J of 25 Pa. Code Chapter 271), or alternate test procedures approved pursuant to those parts, unless other test procedures have been specified in this permit.

5. Quality/Assurance/Control

In an effort to assure accurate self-monitoring analyses results:

- a. The permittee, or its designated laboratory, shall participate in the periodic scheduled quality assurance inspections conducted by DEP and EPA. 40 CFR 122.41(e), 122.41(i)(3)
- b. The permittee, or its designated laboratory, shall develop and implement a program to assure the quality and accurateness of the analyses performed to satisfy the requirements of this permit, in accordance with 40 CFR Part 136. 40 CFR 122.41(j)(4)

B. Reporting of Monitoring Results

1. The permittee shall effectively monitor the operation and efficiency of all wastewater treatment and control facilities, and the quantity and quality of the discharge(s) as specified in this permit. 40 CFR 122.41(e) and 40 CFR 122.44(i)(1)

2. Unless instructed otherwise in Part C of this permit, properly completed DMR(s) must be received by the agency(ies) below within 28 days after the end of each reporting period. The permittee shall complete all Supplemental Reporting forms (Supplemental DMRs) provided by DEP in this permit (or an approved equivalent), and submit the signed, completed forms as an attachment to the DMR(s). If the permittee elects to use DEP's electronic DMR (eDMR) system, one electronic submission may be made for DMRs and Supplemental DMRs. If paper forms are used, the completed forms shall be mailed to:

Department of Environmental Protection
 Water Management Program
 208 West Third Street, Suite 101
 Williamsport, PA 17701-6448

NPDES Enforcement Branch (3WP42)
 Office of Permits & Enforcement
 Water Protection Division
 U.S. EPA - Region III
 1650 Arch Street
 Philadelphia, PA 19103-2029

3. If the permittee elects to begin using DEP's eDMR system to submit DMRs required by the permit, the permittee shall, to assure continuity of business operations, continue using the eDMR system to submit all DMRs and Supplemental Reports required by the permit, unless the following steps are completed to discontinue use of eDMR:
 - a. The permittee shall submit written notification to the regional office that issued the permit that it intends to discontinue use of eDMR. The notification shall be signed by a principal executive officer or authorized agent of the permittee.
 - b. The permittee shall continue using eDMR until the permittee receives written notification from DEP's Central Office that the facility has been removed from the eDMR system, and electronic report submissions are no longer expected.
4. The completed DMR Form shall be signed and certified by either of the following applicable persons, as defined in 25 Pa. Code 92a.22:
 - For a corporation - by a principal executive officer of at least the level of vice president, or an authorized representative, if the representative is responsible for the overall operation of the facility from which the discharge described in the NPDES form originates.
 - For a partnership or sole proprietorship - by a general partner or the proprietor, respectively.
 - For a municipality, state, federal or other public agency - by a principal executive officer or ranking elected official.

If signed by a person other than the above, written notification of delegation of DMR signatory authority must be submitted to DEP in advance of or along with the relevant DMR form. 40 CFR 122.22(b)

5. If the permittee monitors any pollutant at monitoring points as designated by this permit, using analytical methods described in Part A III.A.4. herein, more frequently than the permit requires, the results of this monitoring shall be incorporated, as appropriate, into the calculations used to report self-monitoring data on the DMR. 40 CFR 122.41(l)(4)(ii)

C. Reporting Requirements

1. Planned Changes 40 CFR 122.41(l)(1) - The permittee shall give notice to DEP as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required when:
 - a. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR §122.29(b).

- b. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are not subject to effluent limitations in this permit.
- c. The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.

2. Anticipated Noncompliance

The permittee shall give advance notice to DEP of any planned changes in the permitted facility or activity that may result in noncompliance with permit requirements. 40 CFR 122.41(l)(2)

3. Unanticipated Noncompliance or Potential Pollution Reporting

- a. Immediate Reporting - The permittee shall immediately report any incident causing or threatening pollution in accordance with the requirements of 25 Pa. Code Sections 91.33 and 92a.41(b).
 - (i) If, because of an accident, other activity or incident a toxic substance or another substance which would endanger users downstream from the discharge, or would otherwise result in pollution or create a danger of pollution or would damage property, the permittee shall immediately notify DEP by telephone of the location and nature of the danger. Oral notification to the Department is required as soon as possible, but no later than 4 hours after the permittee becomes aware of the incident causing or threatening pollution.
 - (ii) If reasonably possible to do so, the permittee shall immediately notify downstream users of the waters of the Commonwealth to which the substance was discharged. Such notice shall include the location and nature of the danger.
 - (iii) The permittee shall immediately take or cause to be taken steps necessary to prevent injury to property and downstream users of the waters from pollution or a danger of pollution and, in addition, within 15 days from the incident, shall remove the residual substances contained thereon or therein from the ground and from the affected waters of this Commonwealth to the extent required by applicable law.
- b. The permittee shall report any noncompliance which may endanger health or the environment in accordance with the requirements of 40 CFR 122.41(l)(6). These requirements include the following obligations:
 - (i) 24 Hour Reporting - The permittee shall orally report any noncompliance with this permit which may endanger health or the environment within 24 hours from the time the permittee becomes aware of the circumstances. The following shall be included as information which must be reported within 24 hours under this paragraph:
 - (1) Any unanticipated bypass which exceeds any effluent limitation in the permit;
 - (2) Any upset which exceeds any effluent limitation in the permit; and
 - (3) Violation of the maximum daily discharge limitation for any of the pollutants listed in the permit as being subject to the 24-hour reporting requirement. Note see 40 CFR 122.44(g)
 - (ii) Written Report - A written submission shall also be provided within 5 days of the time the permittee becomes aware of any noncompliance which may endanger health or the environment. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the

noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.

- (iii) Waiver of Written Report - DEP may waive the written report on a case-by-case basis if the associated oral report has been received within 24 hours from the time the permittee becomes aware of the circumstances which may endanger health or the environment. Unless such a waiver is expressly granted by DEP, the permittee shall submit a written report in accordance with this paragraph. 40 CFR 122.41(l)(6)(iii).

4. Other Noncompliance

The permittee shall report all instances of noncompliance not reported under paragraph C.3 of this section or specific requirements of compliance schedules, at the time DMRs are submitted. The reports shall contain the information listed in paragraph C.3.b.(ii) of this section. 40 CFR 122.41(l)(7)

PART B

I. MANAGEMENT REQUIREMENTS

A. Compliance Schedules 25 Pa. Code 92a.51 and 40 CFR 122.47(a)

1. The permittee shall achieve compliance with the terms and conditions of this permit within the time frames specified in this permit.
2. The permittee shall submit reports of compliance or noncompliance, or progress reports as applicable, for any interim and final requirements contained in this permit. Such reports shall be submitted no later than 14 days following the applicable schedule date or compliance deadline. 40 CFR 122.47(a)(4)

B. Permit Modification, Termination, or Revocation and Reissuance

1. This permit may be modified, terminated, or revoked and reissued during its term in accordance with Title 25 Pa. Code 92a.72 and 40 CFR 122.41(f).
2. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition. 40 CFR 122.41(f)
3. In the absence of DEP action to modify or revoke and reissue this permit, the permittee shall comply with effluent standards or prohibitions established under Section 307(a) of the Clean Water Act for toxic pollutants within the time specified in the regulations that establish those standards or prohibitions. 40 CFR 122.41(a)(1)

C. Duty to Provide Information

1. The permittee shall furnish to DEP, within a reasonable time, any information which DEP may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit. 40 CFR 122.41(h)
2. The permittee shall furnish to DEP, upon request, copies of records required to be kept by this permit. 40 CFR 122.41(h)
3. Other Information - Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to DEP, it shall promptly submit the correct and complete facts or information. 40 CFR 122.41(l)(8)
4. Facility expansions, production increases, process modifications, or any change of wastestream, that may result in an increase of pollutants that have the potential to exceed ELGs or violate effluent limitations specified in the permit, or that may result in a new discharge, or a discharge of new or increased pollutants for which no effluent limitation has been issued, must be approved in writing by the Department before the permittee may commence the new or increased discharge, or change of wastestream. The Department will determine if a permittee will be required to submit a new permit application and obtain a new or amended permit before commencing the new or increased discharge, or change of wastestream. 25 Pa. Code 92a.24(a)
5. The permittee shall provide the following information in the annual Municipal Wasteload Management Report, required under the provisions of Title 25 Pa. Code Chapter 94 unless a more stringent time period is required by law, regulation or permit condition in which case the more stringent time period will apply.
 - a. A new introduction of pollutants into the POTW from an indirect discharger which would be subject to Sections 301 and 306 of the Clean Water Act if it were directly discharging pollutants. 40 CFR 122.42(b)(1)

- b. A substantial change in the volume or character of pollutants being introduced into the POTW by an indirect discharger introducing pollutants into the POTW at the time of issuance of this permit. 40 CFR 122.42(b)(2)
- c. Information on the quality and quantity of the effluent introduced into the POTW by an industrial user or an indirect discharger and the anticipated impact of the change in the quality and quantity of effluent to be discharged from the POTW. 40 CFR 122.42(b)(3)
- d. The identity of the any indirect discharger served by the POTW which are subject to pretreatment standards adopted under Section 307(b) of the Clean Water Act; the POTW shall also specify the total volume of discharge and estimate concentration of each pollutant discharged into the POTW by the indirect discharger.
- e. The POTW shall require indirect dischargers to the treatment works subject to pretreatment standards adopted under Section 307(b) of the Clean Water Act to comply with the reporting requirements of Sections 204(b), 307, and 308 of the Clean Water Act and regulations thereunder.

D. Proper Operation and Maintenance

- 1. The permittee shall employ operators certified in compliance with the Water and Wastewater Systems Operators Certification Act (63 P.S. §§1001-1015.1).
- 2. The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the terms and conditions of this permit. Proper operation and maintenance includes, but is not limited to, adequate laboratory controls including appropriate quality assurance procedures. This provision also includes the operation of backup or auxiliary facilities or similar systems that are installed by the permittee, only when necessary to achieve compliance with the terms and conditions of this permit. 40 CFR 122.41(e)

E. Duty to Mitigate

The permittee shall take all reasonable steps to minimize or prevent any discharge, sludge use or disposal in violation of this permit that has a reasonable likelihood of adversely affecting human health or the environment. 40 CFR 122.41(d)

F. Bypassing

- 1. Bypassing Not Exceeding Permit Limitations - The permittee may allow a bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions in paragraphs two, three and four of this section. 40 CFR 122.41(m)(2)
- 2. Other Bypassing - In all other situations, bypassing is prohibited and DEP may take enforcement action against the permittee for bypass unless:
 - a. A bypass is unavoidable to prevent loss of life, personal injury or "severe property damage." 40 CFR 122.41(m)(4)(i)(A)
 - b. There are no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate backup equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance. 40 CFR 122.41(m)(4)(i)(B)
 - c. The permittee submitted the necessary notice required in F.4.a. and b. below. 40 CFR 122.41(m)(4)(i)(C)

3. DEP may approve an anticipated bypass, after considering its adverse effects, if DEP determines that it will meet the conditions listed in F.2. above. 40 CFR 122.41(m)(4)(ii)
4. Notice
 - a. Anticipated Bypass – If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible, at least 10 days before the bypass. 40 CFR 122.41(m)(3)(i)
 - b. Unanticipated Bypass
 - (i) The permittee shall submit immediate notice of an unanticipated bypass causing or threatening pollution. The notice shall be in accordance with Part A III.C.3.a.
 - (ii) The permittee shall submit oral notice of any other unanticipated bypass within 24 hours, regardless of whether the bypass may endanger health or the environment or whether the bypass exceeds effluent limitations. The notice shall be in accordance with Part A III.C.3.b.

II. PENALTIES AND LIABILITY

A. Violations of Permit Conditions

Any person violating Sections 301, 302, 306, 307, 308, 318 or 405 of the Clean Water Act or any permit condition or limitation implementing such sections in a permit issued under Section 402 of the Act is subject to civil, administrative and/or criminal penalties as set forth in 40 CFR §122.41(a)(2).

Any person or municipality, who violates any provision of this permit; any rule, regulation or order of DEP; or any condition or limitation of any permit issued pursuant to the Clean Streams Law, is subject to criminal and/or civil penalties as set forth in Sections 602, 603 and 605 of the Clean Streams Law.

B. Falsifying Information

Any person who does any of the following:

- Falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit, or
- Knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit (including monitoring reports or reports of compliance or noncompliance)

Shall, upon conviction, be punished by a fine and/or imprisonment as set forth in *18 Pa.C.S.A § 4904* and 40 CFR §122.41(j)(5) and (k)(2).

C. Liability

Nothing in this permit shall be construed to relieve the permittee from civil or criminal penalties for noncompliance pursuant to Section 309 of the Clean Water Act or Sections 602, 603 or 605 of the Clean Streams Law.

Nothing in this permit shall be construed to preclude the institution of any legal action or to relieve the permittee from any responsibilities, liabilities or penalties to which the permittee is or may be subject to under the Clean Water Act and the Clean Streams Law.

D. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for the permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit. 40 CFR 122.41(c)

III. OTHER RESPONSIBILITIES

A. Right of Entry

Pursuant to Sections 5(b) and 305 of Pennsylvania's Clean Streams Law, and Title 25 Pa. Code Chapter 92a and 40 CFR §122.41(i), the permittee shall allow authorized representatives of DEP and EPA, upon the presentation of credentials and other documents as may be required by law:

1. To enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this permit; 40 CFR 122.41(i)(1)
2. To have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit; 40 CFR 122.41(i)(2)
3. To inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices or operations regulated or required under this permit; and 40 CFR 122.41(i)(3)
4. To sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Clean Water Act or the Clean Streams Law, any substances or parameters at any location. 40 CFR 122.41(i)(4)

B. Transfer of Permits

1. Transfers by modification. Except as provided in paragraph 2 of this section, a permit may be transferred by the permittee to a new owner or operator only if this permit has been modified or revoked and reissued, or a minor modification made to identify the new permittee and incorporate such other requirements as may be necessary under the Clean Water Act. 40 CFR 122.61(a)
2. Automatic transfers. As an alternative to transfers under paragraph 1 of this section, any NPDES permit may be automatically transferred to a new permittee if:
 - a. The current permittee notifies DEP at least 30 days in advance of the proposed transfer date in paragraph 2.b. of this section; 40 CFR 122.61(b)(1)
 - b. The notice includes the appropriate DEP transfer form signed by the existing and new permittees containing a specific date for transfer of permit responsibility, coverage and liability between them; 40 CFR 122.61(b)(2)
 - c. DEP does not notify the existing permittee and the proposed new permittee of its intent to modify or revoke and reissue this permit, the transfer is effective on the date specified in the agreement mentioned in paragraph 2.b. of this section; and 40 CFR 122.61(b)(3)
 - d. The new permittee is in compliance with existing DEP issued permits, regulations, orders and schedules of compliance, or that has demonstrated any noncompliance with the existing permits has been resolved by an appropriate compliance action or by the terms and conditions of the permit (including compliance schedules set forth in the permit), consistent with 25 Pa. Code 92a.51 (relating to schedules of compliance) and other appropriate DEP regulations. 25 Pa. Code 92a.71
3. In the event DEP does not approve transfer of this permit, the new owner or controller must submit a new permit application.

C. Property Rights

The issuance of this permit does not convey any property rights of any sort, or any exclusive privilege. 40 CFR 122.41(g)

D. Duty to Reapply

If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for a new permit. 40 CFR 122.21(d)

E. Other Laws

The issuance of this permit does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations.

IV. ANNUAL FEE

Permittees shall pay an annual fee in accordance with 25 Pa. Code § 92a.62. Annual fee amounts are specified in the following schedule and are due on each anniversary of the effective date of the most recent new or reissued permit. All flows identified in the schedule are annual average design flows. 25 Pa. Code 92a.62

Small Flow Treatment Facility (SRSTP or SFTF)	\$0
Minor Sewage Facility < 0.05 MGD (million gallons per day)	\$250
Minor Sewage Facility ≥ 0.05 and < 1 MGD	\$500
Minor Sewage Facility with CSO (Combined Sewer Overflow)	\$750
Major Sewage Facility ≥ and < 5 MGD	\$1,250
Major Sewage Facility ≥ 5 MGD	\$2,500
Major Sewage Facility with CSO	\$5,000

As of the effective date of this permit, the facility covered by the permit is classified in the following fee category: **Major Sewage Facility ≥1 and <5 MGD.**

Invoices for annual fees will be mailed to permittees approximately three months prior to the due date. In the event that an invoice is not received, the permittee is nonetheless responsible for payment. Throughout a five year permit term, permittees will pay four annual fees followed by a permit renewal application fee in the last year of permit coverage. Permittees may contact the DEP at 717-787-6744 with questions related to annual fees.

Payment for annual fees shall be remitted to DEP at the address below by the anniversary date. Checks should be made payable to the Commonwealth of Pennsylvania.

PA Department of Environmental Protection
Bureau of Water Standards and Facility Regulation
Re: Chapter 92a Annual Fee
P.O. Box 8466
Harrisburg, PA 17105-8466

PART C**I. CHESAPEAKE BAY SCHEDULE**

- A. **Timing For Effective Dates Of Effluent Limitations.** The following schedule applies to effluent limitations in this permit:

<u>Provision Containing Effluent Limitation</u>	<u>Effective Date</u>
Part A I.A.2	Permit Effective Date through December 31, 2010
Part A I.B.2	January 1, 2012 through August 31, 2014
Part A I.C.2	September 1, 2014 through Permit Expiration
Part A.I.D.2	Permit Effective Date through Permit Expiration Date

The permittee shall achieve compliance with all other terms and conditions of this permit upon the effective date of the permit, unless otherwise specified.

- B. **Compliance Schedule.** The permittee shall be in compliance with effluent limitations for Nitrogen and Phosphorus contained in Part A I.D.2, or terminate this discharge, in accordance with the following schedule:

<u>Activity</u>	<u>Due Date</u>
1. Submit Update to Act 537 Sewage Facilities Plan	Completed
2. Submit WQM Part II Permit Application	Completed
3. Award Contract for Construction or Begin Implementation	Completed
4. Construction or Implementation Progress Report(s)	Completed
5. Issue Certification of Substantial Completion (Plant Fully Operational)	Completed
6. Compliance with effluent limitations	September 30, 2012

- C. No later than 14 calendar days following the date identified in the above schedule of compliance, the permittee shall submit to the Department a written notice of compliance or non-compliance with the specific schedule requirement(s) to:

Department of Environmental Protection
 Northcentral Regional Office
 Water Management Program
 Attn: Compliance Specialist
 208 W Third Street Suite 101
 Williamsport, PA 17701-6448

- D. Each notice of non-compliance, at a minimum, shall include the following information:
1. A description of the noncompliance.
 2. A description of any actions taken or proposed by the permittee to comply with the elapsed schedule requirement.
 3. A description of any factors which tend to explain or mitigate the noncompliance.

4. An estimate of the date that compliance with the elapsed schedule requirement will be achieved and an assessment of the probability that the next scheduled requirement will be met on time.
 5. A revised schedule of compliance for Department approval.
- E. The permittee should contact the compliance specialist indicated in the event of anticipated non-compliance with any of a compliance schedule activities listed, seven (7) days prior to the due date of the activity.

II. CHESAPEAKE BAY NUTRIENT REQUIREMENTS

A. General

1. The Net Total Nitrogen and Net Total Phosphorus mass load effluent limitations in Part A I.B and Part A I.C are required in order to meet the downstream water quality standards of the State of Maryland, as required by 25 Pa. Code Chapter 92a, the federal Clean Water Act and implementing regulations. These effluent limitations do not reflect credits applied or sold or offsets applied, during this permit cycle.
2. The Total Nitrogen and Total Phosphorus Mass Loads (actual mass loads being discharged) shall be reported on the enclosed monthly Supplemental Discharge Monitoring Reports ("Supplemental DMRs"). The total mass loads will not equal the net mass loads if credits are applied or sold, or if offsets are applied. The mass loads for compliance purposes are "Net Total Nitrogen" and "Net Total Phosphorus" reported as pounds per year on the Annual Nutrient Summary form (3800-FM-WSFR0447). Instructions for tracking credits and offsets can be found in Part C II.C.10 – Tracking Offsets and Credits. The number of credits purchased can be determined by viewing the Department's Nutrient Trading Website at <http://www.dep.state.pa.us> Keyword "Nutrient Trading". The number of credits applied or sold, or offsets applied may change during the compliance year and subsequent trading period.
3. The Definitions in paragraph B apply to terms used in Part A and in the Supplemental DMR forms.
4. The Annual Nutrient Summary form shall be submitted no later than November 28th following the end of a compliance year for determination of compliance with the Net Total Nitrogen and Net Total Phosphorus annual mass load effluent limits.
5. The facility shall utilize DEP's electronic Discharge Monitoring Report (eDMR) system to submit DMR data and Supplemental DMR forms. This is required to assist DEP with nutrient credit certification and verification, and compliance assessment. Unless the permittee is already using the eDMR system, within 30 days of permit issuance, the permittee shall submit the necessary Registration and Trading Partner Agreement forms to participate in eDMR, and begin using eDMR for submission of DMR data and Supplemental DMR forms when DEP notifies the permittee to begin doing so. The eDMR website is <http://www.dep.state.pa.us/edmr>. Use of eDMR shall continue unless the requirements of Part A III.B.3 are met.

B. Definitions

1. Monthly Total Mass Load (lbs) = The sum of the actual daily discharge loads (lb/d) divided by the number of samples per month multiplied by the number of days in the month. Daily discharge load (lb/d) = Daily flow (MGD) on the day of sampling, multiplied by that day's sample concentration (mg/l) multiplied by 8.34.
2. Annual Total Mass Load (lbs) = The sum of the Monthly Total Mass Loads for one year beginning October 1st and ending September 30th.
3. Total Nitrogen = Kjeldahl-N plus Nitrate-Nitrite as N.

4. Compliance Year = The year long period starting October 1 and ending September 30. The compliance year will be named for the year in which it ends. Example: The period of October 1, 2010 through September 30, 2011 is compliance year 2011.
5. Truing period = the time allowed at the end of each compliance year for any entity to come into compliance through the application of credits towards the Annual Net Mass Loads. This truing period will start on October 1st and end on November 28th of the same calendar year. During this period, compliance for the specified year may be achieved by using registered credits that were generated during that compliance year. Example: Credits that are used to achieve compliance in compliance year 2011 must have been generated during compliance year 2011.

6. Monthly Net Mass Load

For Total Nitrogen:

Monthly Net Mass Load = Monthly Total Mass Load + (Total Credits sold during the month / 0.941 (TN delivery ratio for facility)) – (Total Credits applied during the month / 0.941 (TN delivery ratio for facility)) – Offsets applied

For Total Phosphorus:

Monthly Net Mass Load = Monthly Total Mass Load + (Total Credits sold during the month / 0.436 (TP delivery ratio for facility)) – (Total Credits applied during the month / 0.436 (TP delivery ratio for facility)) – Offsets applied

7. Annual Net Mass Load (lb/year) = The sum of the Monthly Net Mass Loads for one year beginning October 1st and ending September 30th.
8. Certification: Written approval by the Department for the use of proposed or implemented activities to generate credits and/or offsets. Certifications are based on at least (1) a credit or offset proposal to be submitted describing the qualifying activities that will reduce the nutrient loadings delivered to the Chesapeake Bay, (2) the calculation to quantify the pounds of reductions expected and (3) a verification plan that, when implemented, ensures that the qualifying nutrient reduction activities have taken place.
9. Verification: Implementation of the verification plan contained in a certified credit or offset proposal as required by the Department. Verification plans require annual submittal of documentation to the Department that demonstrates that the qualifying nutrient reduction activities have taken place for the applicable compliance year.
10. Registration: Approval by the Department of the use of credits or offsets in a permit. Registration will not occur until credits have been certified and verified, and for credits a trading contract has been submitted to the Department. The Department will register credits on an annual basis for use during the compliance year in which the qualifying nutrient reduction activities have taken place, and provide such credits with an annual registry number for reporting and tracking purposes.

C. Nutrient Credits and Offsets

1. Credit = The unit of compliance that corresponds with a pound of reduction of TP, TN or sediment as recognized by the Department which, when registered by the Department, may be used to comply with effluent limits.
2. Offset = Verb - The act of reducing the aggregate production of nutrients from an action or activity by use of a complimentary action, activity or technology on that site or directly related to the activity. Noun - The load in pounds of nitrogen or phosphorus created by an action, activity or technology that is available to apply against the proposed load to be generated. Offsets are not the same as credits as they cannot be directly bought, sold or transferred between owners, projects, or properties.

3. The permittee is authorized to apply nitrogen and phosphorus credits to this permit in order to comply with the Net Total Nitrogen and Net Total Phosphorus annual mass load effluent limits, when the credits are recognized by the Department through a trading program administered by the Department pursuant to "Final Trading of Nutrient and Sediment Reduction Credits – Policy and Guidelines," including all Attachments and Appendices.
4. Credits may be applied to the compliance obligations of this permit up until November 28 of the calendar year at the end of the current compliance period (e.g., if the period is the 12 months following 9/30/2010, credits may be applied up until 11/28/2011).
5. Whenever credits are applied or sold the permittee shall report the following, using Supplemental DMR forms:
 - The registry number and trade effective dates.
 - The type (nitrogen, phosphorus) and the number of credits purchased or sold of each.
6. Any time a contract expires during the term of this permit, the Department must be notified 30 days prior to the expiration date, and the permittee shall provide either a new contract or a discussion on how compliance with this permit will be achieved.
7. All credit transactions must be on the DEP's Trading website which can be viewed at www.dep.state.pa.us Keyword "Nutrient Trading".
8. Offsets approved by DEP are to be reported and used in calculating the Monthly Net Mass Loads.
9. All credits must be certified by the Department and verified for the year in which they are used for compliance with this permit.
10. Tracking Offsets and Credits:
 - a. Credits – the use of credits shall be tracked on Supplemental DMR forms provided with this permit. As identified on the forms entitled Monthly Nitrogen Budget (3800-FM-WSFR0445) and Monthly Phosphorus Budget (3800-FM-WSFR0446), the forms shall be submitted when a credit transaction occurs. Additionally, the form entitled Annual Nutrient Summary (3800-FM-WSFR0447) shall be submitted at the end of each compliance year. Credits are only for the compliance year in which they are used and must be reported each year.
 - b. Offsets – the use of offsets shall be tracked on Supplemental DMR forms provided with this permit. As identified on the forms entitled Monthly Nitrogen Budget and Monthly Phosphorus Budget, the forms shall be submitted when offsets are claimed. Additionally, the Annual Nutrient Summary shall be submitted at the end of each compliance year. Some offsets will be deemed as permanent and can be claimed each year. Offsets must be reported each year during the permit cycle. Offsets deemed to be permanent can be used to adjust cap loads in future permits.

If an offset is approved during the compliance year, the offset generated shall be divided by twelve and applied to each monthly net mass load after the offset is approved. For example, 40 homes formerly utilizing on-lot systems are placed on public sanitary sewer service. The nitrogen offset of 25 lbs/year per home would be applicable. The offsets are approved in May of the compliance year, so the offset would be applied as follows:

$$(40 \text{ homes} \times 25 \text{ lbs / home}) / 12 \text{ months} = 83 \text{ lbs/month}$$

For each month following approval of the offset, 83 lbs of nitrogen will be applied as an offset each month to the Monthly Net Mass Load.

D. Offsets Granted by Connection of Retired On-Lot Systems

The permittee is responsible for maintaining records that show that the on-lot systems existed or were put in place prior to January 1, 2003, and eliminated by connecting the dwellings to the sewage conveyance system after January 1, 2003. These records must verify that the on-lot system existed or was put in place prior to January 1, 2003, when the on-lot system was taken out of service, and when the dwelling was connected to the sewage conveyance system. These records must be maintained by the permittee as long as the offsets are counted toward the permittee's cap load. The permittee must make these records available for public inspection.

III. OTHER REQUIREMENTS

- A. The approval herein given is specifically made contingent upon the permittee acquiring all necessary property rights by easement or otherwise, providing for the satisfactory construction, operation, maintenance and replacement of all sewers or sewerage structures associated with the herein approved discharge in, along, or across private property, with full rights of ingress, egress and regress.
- B. If, in the opinion of the Department, by reason of change in the character of wastes or increased load upon the treatment facilities, or changed use or condition of the receiving body of water, or otherwise, the said effluent ceases to be satisfactory or the treatment facilities shall have created public nuisance, then upon notice by the Department the right herein granted to discharge such effluent shall cease and become null and void unless within the time specified by the Department, the permittee shall adopt such remedial measures as will produce an effluent which, in the opinion of the Department, will be satisfactory for discharge into the said receiving body of water.
- C. Collected screenings, slurries, sludges, and other solids shall be handled and disposed of in compliance with 25 Pa. Code, and in a manner equivalent to the requirements indicated in Chapters 271, 273, 275, 283, and 285 (relating to permits and requirements for landfilling, land application, incineration, and storage of sewage sludge), Federal Regulation 40 CFR 257, Pennsylvania Clean Streams Law, Pennsylvania Solid Waste Management Act of 1980, and the Federal Clean Water Act and its amendments.

The permittee is responsible to obtain or assure that contracted agents have all necessary permits and approvals for the handling, storage, transport and disposal of solid waste materials generated as a result of wastewater treatment.

- D. No storm water from pavements, area ways, roofs, foundation drains or other sources shall be admitted to the sanitary sewers associated with the herein approved discharge.

IV. WHOLE EFFLUENT TOXICITY (WET)

A. General Requirements

1. The permittee shall conduct Chronic WET tests as specified in this section. The permittee shall collect discharge samples and perform WET tests to generate chronic survival and reproduction data for the cladoceran, *Ceriodaphnia dubia* and chronic survival and growth data for the fathead minnow, *Pimephales promelas*.
2. Samples shall be collected at Outfall 001 in accordance with paragraph E.
3. The permittee shall perform testing using the following dilution series: 11%, 23%, 45%, 73%, and 100% effluent, with a control, where 45% is the facility-specific Target In-Stream Waste Concentration (TIWC).
4. The determination of whether a test endpoint passes or fails shall be made using DEP's WET Analysis Spreadsheet (available at www.depweb.state.pa.us/wett) by comparing replicate data for the control with replicate data for the TIWC dilution or any dilution greater than the TIWC.

5. The permittee shall submit only valid WET test results to DEP.

B. Test Frequency and Reporting

1. WET testing shall be conducted annually, at a minimum, during the period January 1 – December 31. Annual WET tests must be completed at least 6 months apart, and shall start in the year the permit becomes effective if the permit effective date is prior to October 1.
2. A complete WET test report shall be submitted to the DEP regional office that issued the permit within 45 days of test completion. A complete WET test report submission shall include the information contained in paragraph H, below. The permittee shall continue annual WET monitoring, at a minimum, during the permit renewal review period and during any period of administrative extension of this permit.
3. If a test failure is determined for any endpoint during annual monitoring, the permittee shall initiate a re-test for the species with the failure within 45 days of test completion. All endpoints for the species shall be evaluated in the re-test. The results of the re-test shall be submitted to the DEP regional office that issued the permit.
4. If a passing result is determined for all endpoints in a re-test, the permittee may resume annual monitoring.
4. If there is a failure for one or more endpoints in a re-test, the permittee shall initiate or continue quarterly WET testing for both species until there are four consecutive passing results for all endpoints. The results of all tests shall be submitted to the DEP regional office that issued the permit. In addition, the permittee shall initiate a Phase I Toxicity Reduction Evaluation (TRE) as specified in paragraph C, below.
5. The permittee must report the results of each test endpoint that has a WET limit in Part A of this permit on the Discharge Monitoring Report (DMR). Test results shall be reported on the DMR in terms of acute or chronic Toxicity Units (TU_a or TU_c), where TU_a is used for acute tests and TU_c is used for chronic tests. If DEP's WET Analysis Spreadsheet indicates a passing result for an endpoint, report the value obtained from the expression "1/TIWC", which is equivalent to the permit limit. If the Spreadsheet indicates a failure, report the value obtained from the expression "> 1/TIWC". If a dilution higher than the TIWC dilution is used for the comparison with the control, report the value obtained from the expression "1/dilution". For example, an acute test endpoint failure at a TIWC dilution of 50% would be reported as "> 2.0 TU_a" (1/0.5).
6. The permittee shall attach the WET Analysis Spreadsheet for the latest four consecutive WET tests to the NPDES permit renewal application that is submitted to DEP at least 180 days prior to the permit expiration date.

C. Phase I Toxicity Reduction Evaluation (TRE)

1. The Phase I TRE trigger is one WET endpoint failure followed by a re-test that confirms the failure for the same species. When the TRE process is triggered, quarterly WET testing shall be initiated for both species until there are four consecutive passing results for all endpoints. The Phase I TRE may include a Toxicity Identification Evaluation (TIE) if the permittee cannot immediately identify the possible causes of the effluent toxicity and the possible sources of the causative agents.
2. The permittee shall, within one year following the Phase I TRE trigger, submit a Phase I TRE report to the DEP regional office that issued the permit. The Phase I TRE shall be conducted in accordance with EPA's guidance, "Toxicity Reduction Evaluation for Municipal Wastewater Treatment Plants" (EPA/833B-99/002), "Generalized Methodology for Conducting Industrial Toxicity Reduction Evaluations" (EPA/600/2-88/070), and other relevant EPA guidance, as applicable. If a TIE is conducted as part of the Phase I TRE, it shall conform to EPA's guidance, "Methods for Aquatic Toxicity Identification Evaluations Phase I" (EPA/600/6-91/003), "Phase II" (EPA/600/R-92/080), "Phase III" (EPA/600/R-92/081) and other relevant EPA guidance. The Phase I TRE report shall be


submitted with the fourth quarterly WET test report that is completed following the Phase I TRE trigger. The TRE shall include all activities undertaken to identify the cause(s) and source(s) of toxicity and any control efforts.

3. If all four quarterly WET tests produce passing results for all endpoints during the Phase I TRE process, performance of a Phase II TRE is not required, and annual WET testing in accordance with paragraph B.1 may resume.
4. If the four WET tests produce at least one failing result during the Phase I TRE process, the permittee shall continue quarterly WETT monitoring for both species and initiate a Phase II TRE in accordance with paragraph D. In this case, the Phase I TRE must include a schedule for completion of the Phase II TRE. The schedule must include interim milestones and a final completion date not to exceed two years from the initiation of the Phase II TRE. The permittee shall implement the Phase II TRE in accordance with the schedule unless DEP issues written approval to modify the schedule or cease performance of the Phase II TRE.
5. Re-tests during the TRE process are required for invalid tests but are optional and at the discretion of the permittee for valid tests. The results of all re-tests must be submitted to the DEP regional office that issued the permit along with the required elements in paragraph H.

D. Phase II Toxicity Reduction Evaluation (TRE)

1. The Phase II TRE trigger is one WET endpoint failure during performance of the Phase I TRE. A Phase II TRE, if required, shall conform to EPA's guidance, "Toxicity Reduction Evaluation for Municipal Wastewater Treatment Plants" (EPA/833B-99/002), "Generalized Methodology for Conducting Industrial Toxicity Reduction Evaluations" (EPA/600/2-88/070), and other relevant EPA guidance, as applicable. A Phase II TRE evaluates the possible control options to reduce or eliminate the effluent toxicity and the implementation of controls.
2. Once initiated, the Phase II TRE must continue until the source(s) of toxicity are controlled as evidenced by four consecutive WET test passing results for all endpoints, and a final TRE report must be submitted on or before the date specified in the schedule, unless otherwise approved by DEP in writing.
3. If four consecutive quarterly WET tests produce passing results for all endpoints during the Phase II TRE process, annual WET testing in accordance with paragraph B.1 may be initiated or resume.

An overview of the process described in paragraphs B, C and D is presented below:

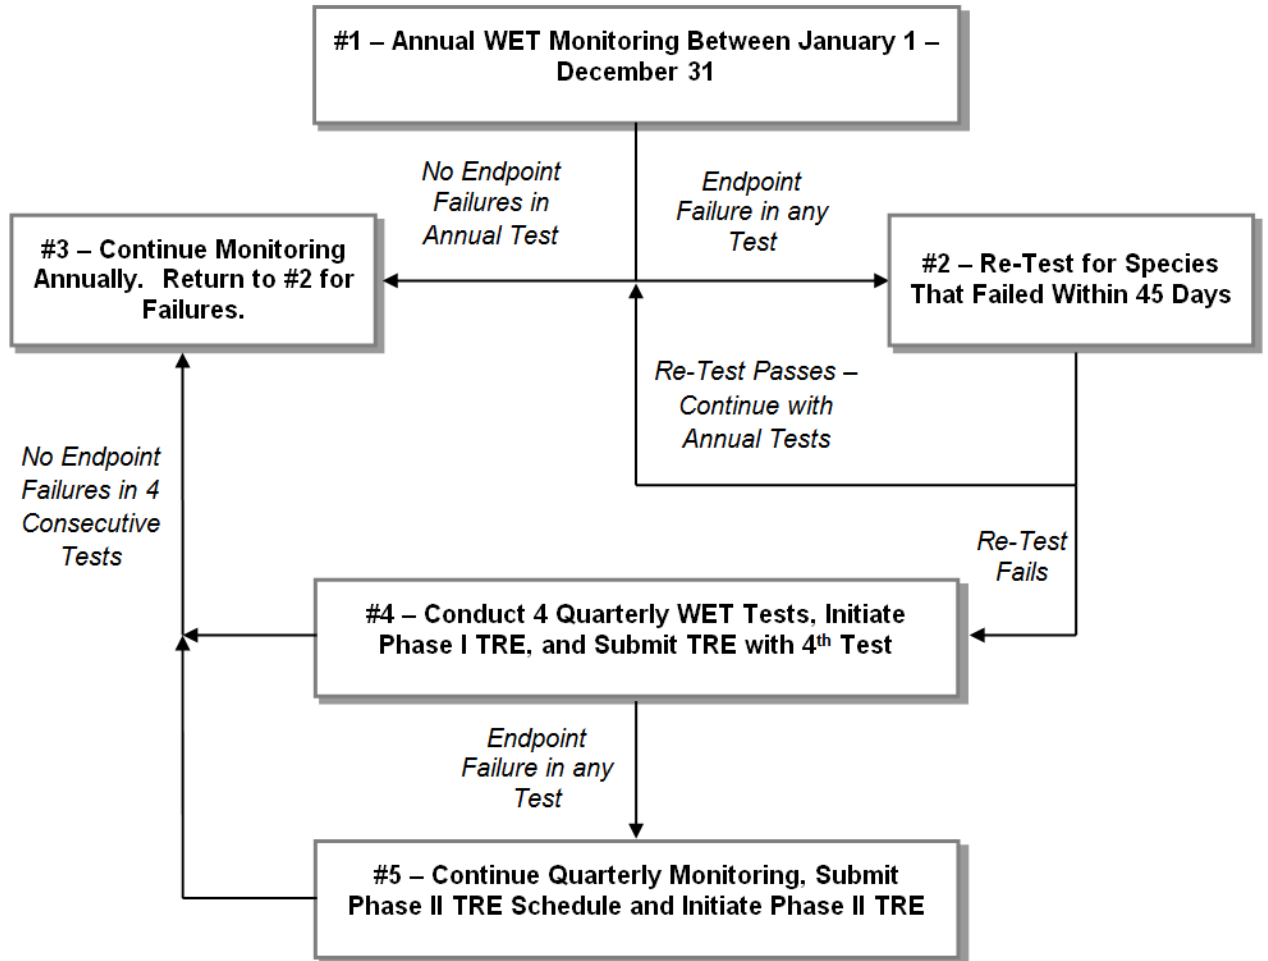

E. Sample Collection

For each acute testing event, a 24-hour flow-proportioned composite sample shall be collected. For each chronic testing event, three 24-hour flow-proportioned, composite samples shall be collected over a seven day exposure period. The samples must be collected at a frequency of not greater than every two hours and must be flow-proportioned. The samples must be collected at the permit compliance sampling location. Samples must be analyzed within 36 hours from the end of the compositing period and must be placed on ice and held at $\leq 6^{\circ}\text{C}$. Refer to the sample handling and preservation regulations set forth in 40 CFR 136, 25 Pa. Code Chapter 252, The NELAC Institute (TNI) Standard, and the appropriate EPA methods.

F. Test Conditions and Methods

Laboratories must be accredited by the DEP Laboratory Accreditation Program in order to perform and report WET tests for NPDES permit compliance. Laboratories must be either State or NELAP accredited.

1. Acute tests shall be completed in accordance with EPA's "Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms" (EPA-821-R-02-012, latest edition). Forty eight (48) hour static non-renewal tests shall be used.
2. Chronic tests shall be completed in accordance with EPA's "Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms" (EPA-821-R-02-013, latest edition). Seven (7) day tests shall be used with renewal every 24 hours.

3. The quality assurance and control (QA/QC) requirements and test acceptability standards specified in EPA's test methods and the requirements set forth in 25 Pa Code Chapter 252 or the TNI Standard must be followed.
4. If the permittee or its accredited laboratory determines that QA/QC requirements and/or test acceptability standards have not been met, a re-test shall be initiated within 45 days. Original test data must be maintained by the laboratory and be submitted to DEP upon request. The justification for a re-test must be clearly documented and kept on file with the sample results.

G. Chemical Analyses

Chemical analyses must follow the requirements of the EPA methods and applicable State and/or Federal regulations.

1. Chemical analysis on effluent samples shall include pH, Conductivity, Total Alkalinity, Total Hardness, Total Residual Chlorine, Total Ammonia (Unionized Ammonia), Dissolved Oxygen and temperature. Chemical analyses as described in the EPA Methods (above) shall be performed for each sampling event, including each new batch of dilution water and each testing event.
2. In addition to the chemical analyses required above, those parameters listed in Part A of the NPDES permit for the outfall(s) tested shall be analyzed concurrently with the WET test by using the method(s) specified in the permit.

H. WET Report Elements

WET test reports that are submitted to DEP must include the requirements identified in 25 Pa. Code § 252.401(j)(1) – (15) or in the TNI Standard, or equivalent, as well as the following information:

1. A general test description, including the origin and age of test organisms, dates and results of reference toxicant tests, light and temperature regimes, and other documentation that QA and test acceptability criteria as specified in EPA's methods and DEP's QA Summaries have been met.
2. A description of sample collection procedures and sampling location.
3. Name(s) of individual(s) collecting and transporting samples, including sample renewals, and the date(s) and time(s) of sample collection.
4. All chemical and physical data including laboratory quantitation limits and observations made on the species. The hardness shall be reported for each test condition.
5. Copies of raw data sheets and/or bench sheets with data entries and signatures.
6. When effluents are dechlorinated, dechlorination procedures must be described and if applicable a thiosulfate control used in addition to the normal dilution water control. If the thiosulfate control results are significantly different from the normal control, as determined using DEP's WET Analysis Spreadsheet, the thiosulfate control shall be used in the spreadsheet for comparison with the TIWC condition. The WET report must specify which control was used to determine whether the test result is pass or fail.
7. A description of all observations or test conditions that may have affected the test outcome.
8. Control charts for the species tested regarding age, temperature test range, mortality data and all reference toxicant tests.
9. A completed WET test summary report (3800-FM-BPNPSM0485).
10. A DEP WET Analysis Spreadsheet printout that provides control and TIWC replicate data and displays the outcome of the test (pass or fail) for each endpoint tested.

WETT reports shall be submitted to the DEP regional office that issued the permit and, for discharges to the Delaware River basin, the Delaware River Basin Commission (DRBC).

V. SOLIDS MANAGEMENT

- A. The permittee shall manage and properly dispose of sewage sludge and/or biosolids, produced by the system, by balancing the amount of solids maintained within the treatment system. The permittee shall develop a scheduled sludge wasting rate that maintains an appropriate mass balance for the specific treatment process type and system loadings and maintains compliance with permit effluent conditions. Holding excess sludge within clarifiers or in the disinfection process is not acceptable. The permittee shall compute and set the wasting rate and time so as to maintain an appropriate balance of sludge in the system. Seasonal variations shall be considered in developing sludge wasting rates.
- B. The permittee shall submit the Supplemental Reports entitled, "Supplemental Report – Sewage Sludge/Biosolids Production and Disposal" (Form No. 3800-FM-WSFR0438) and "Supplemental Report – Influent & Process Control" (Form No. 3800-FM-WSFR0436), as attachments to the DMR on a monthly basis. When applicable, the permittee shall submit the Supplemental Reports entitled, "Supplemental Report – Hauled In Municipal Wastes" (Form No. 3800-FM-WSFR0437) and "Supplemental Report – Hauled In Residual Wastes" (Form No. 3800-FMWSFR0450), as attachments to the DMR.
- C. By March 31 of each year, the permittee shall submit a "Sewage Sludge Management Inventory" that summarizes the amount of sewage sludge and/or biosolids produced and wasted during the calendar year from the system. The "Sewage Sludge Management Inventory" may be submitted with the Municipal Wasteload Management Report required by Chapter 94. This summary shall include the expected sewage sludge production (estimated using the methodology described in the U.S. EPA handbook, "Improving POTW Performance Using the Composite Correction Approach" (EPA-625/6-84-008), compared with the actual amount disposed during the year. Sludge quantities shall be expressed as dry weight in addition to gallons or other appropriate units.