

Application Type Renewal
 Facility Type Non-Municipal
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Application No. PA0038318
 APS ID 10672
 Authorization ID 1265756

Applicant and Facility Information

Applicant Name	<u>Pequea Valley School District</u>	Facility Name	<u>Salisbury Elementary WWTP</u>
Applicant Address	<u>166 South New Holland Rd., PO Box 130 Kinzers, PA 17535-0130</u>	Facility Address	<u>422 School Lane Gap, PA 17527</u>
Applicant Contact	<u>Gavin Scalyer</u>	Facility Contact	<u>Gavin Scalyer</u>
Applicant Phone	<u>(717) 768-5513</u>	Facility Phone	<u>(717) 768-5513</u>
Client ID	<u>108</u>	Site ID	<u>452076</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Salisbury Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Lancaster</u>
Date Application Received	<u>March 19, 2019</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>March 21, 2019</u>	If No, Reason	<u></u>
Purpose of Application	<u>NPDES Renewal.</u>		

Summary of Review

Pequea Valley School District has applied to the Pennsylvania Department of Environmental Protection (DEP) for reissuance of its National Pollutant Discharge Elimination System (NPDES) permit. The permit was issued on September 19, 2014 and became effective on October 1, 2014, authorizing discharge of treated sewage from the existing wastewater treatment plant (WWTP) located in Salisbury Township, Lancaster County into Pequea Creek. The existing permit expiration date was September 30, 2019, and the permit has been administratively extended since that time.

Changes in this renewal: No changes were made to the effluent limitations.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Supplemental information is attached to this fact sheet.

Approve	Deny	Signatures	Date
		Benjamin R. Lockwood / Environmental Engineering Specialist	April 14, 2020
		Daniel W. Martin, P.E. / Environmental Engineer Manager	
		Maria D. Bebenek, P.E. / Program Manager	

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.009
Latitude	40° 1' 8.8"	Longitude	76° 0' 28.4"
Quad Name	New Holland	Quad Code	1837
Wastewater Description: Sewage Effluent			
Receiving Waters	Pequea Creek	Stream Code	07450
NHD Com ID	57463423	RMI	39.9
Drainage Area	27.9 mi ²	Yield (cfs/mi ²)	0.132
Q ₇₋₁₀ Flow (cfs)	3.69	Q ₇₋₁₀ Basis	USGS PA StreamStats
Elevation (ft)	395	Slope (ft/ft)	
Watershed No.	7-K	Chapter 93 Class.	WWF, MF
Existing Use	N/A	Existing Use Qualifier	N/A
Exceptions to Use	N/A	Exceptions to Criteria	N/A
Assessment Status	Impaired		
Cause(s) of Impairment	Pathogens, Siltation, Nutrients, Organic Enrichment, Habitat Alterations, Siltation		
Source(s) of Impairment	Source Unknown, Habitat Modification – Other than Hydromodification, Agriculture, Agriculture, Habitat Modification – Other than Hydromodification, Agriculture		
TMDL Status	Final, 04/09/2001	Name	Pequea Creek TMDL
Nearest Downstream Public Water Supply Intake	Chester Water Authority		
PWS Waters	Susquehanna River	Flow at Intake (cfs)	
PWS RMI		Distance from Outfall (mi)	53

Changes Since Last Permit Issuance: USGS PA StreamStats is showing a drainage area of 27.9 mi² and a Q₇₋₁₀ flow of 3.69 cfs.

Other Comments: None

Treatment Facility Summary				
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Activated Sludge	Hypochlorite	0.009
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.009		Not Overloaded		

Changes Since Last Permit Issuance: None

Other Comments: The WWTP process is as follows: Comminutor – Aeration Tank – Settling Tank – Chlorine Contact Tank – Outfall 001 to Pequea Creek.

Compliance History	
Summary of DMRs:	A summary of the past 12-month DMR effluent data is presented on the next page of this fact sheet.
Summary of Inspections:	<p>4/18/2016: A routine inspection was conducted by Sheena Ripple, DEP Water Quality Specialist. The clarifiers had large bulking sludge. She noted that the WWTP had an air leak a couple of week prior to the inspection, which had been repaired. The lack of air had impacted the bugs, causing poor settling sludge. It was planned to pump out the aeration unit and reseed the WWTP. The effluent was turbid. Grab samples and field readings were collected.</p> <p>6/3/2016: A follow up inspection was conducted by Sheena Ripple. Samples were taken on 5/31/2016, and the water had a high TRC value. On 6/3/16, the effluent was resampled and the TRC was 0.03 mg/l. There were no violations.</p> <p>10/11/2018: A routine inspection was conducted by Tracy Tomtishen, DEP Water Quality Specialist. The inspection was in response to recent TSS violations. A walk through of the WWTP was conducted. The first clarifier influent baffle had a partial layer of solids and the second baffle had a complete layer of solids. Several large accumulations of popping sludge were evident as well as surface scum. The clarifier effluent trough had an accumulation of solids present. The clarifier effluent appeared clear. The effluent from the chlorine contact tank appeared slightly cloudy. Field results were all within permit limits.</p> <p>11/19/2018: A Notice of Violation (NOV) was issued due to violations reported on past DMRs, specifically pH, TSS, CBOD₅, and Fecal Coliform.</p> <p>11/18/2019: A routine inspection was conducted by Tracy Tomtishen. The clarifier effluent trough had a light accumulation of solids present. The clarifier effluent appeared clear. The effluent from the chlorine contact tank appeared slightly cloudy. Field samples were collected. The TRC result was > 2.20 mg/l, which was an IMAX violation. A return visit was conducted on 12/17/2019. The TRC results on this date were 0.00 mg/l.</p>

Other Comments: There are no open violations associated with this facility.

Compliance History

DMR Data for Outfall 001 (from March 1, 2019 to February 29, 2020)

Parameter	FEB-20	JAN-20	DEC-19	NOV-19	OCT-19	SEP-19	AUG-19	JUL-19	JUN-19	MAY-19	APR-19	MAR-19
Flow (MGD) Average Monthly	0.001945	0.001755	0.001721	0.001940	0.001493	0.002044	0.001229	0.001010	0.000961	0.001746	0.001689	0.001990
Flow (MGD) Daily Maximum	0.00420	0.00380	0.00521	0.00422	0.00327	0.00848	0.00393	0.00470	0.00269	0.0056	0.00374	0.00475
pH (S.U.) Minimum	7.69	7.63	7.17	7.76	7.69	7.77	7.84	7.78	7.76	7.80	7.08	7.65
pH (S.U.) Maximum	8.90	8.94	8.79	8.68	8.50	8.50	8.84	8.85	8.66	8.94	8.62	8.45
DO (mg/L) Minimum	5.0	7.4	7.0	8.0	7.4	7.9	7.4	7.5	8.0	7.5	8.0	8.0
TRC (mg/L) Average Monthly	< 0.01	< 0.01	0.0004	0.0004	< 0.01	< 0.01	0.0014	< 0.01	0.0004	< 0.001	< 0.01	< 0.01
TRC (mg/L) Instantaneous Maximum	< 0.01	< 0.01	0.01	0.01	< 0.01	< 0.01	0.02	< 0.01	0.01	< 0.01	< 0.01	< 0.01
CBOD5 (mg/L) Average Monthly	2.95	< 4.85	< 2	< 2.25	< 2	< 2.65	< 2	3.8	< 3	6	< 2	3.5
TSS (mg/L) Average Monthly	11	18.5	9	20.5	15	14.5	22	11	13	1.5	2	19
Fecal Coliform (CFU/100 ml) Geometric Mean	< 2	< 2	< 124.9	< 2	< 2	< 2	< 18.1	< 4.7	< 2	10.2	< 2	< 3.7
Fecal Coliform (CFU/100 ml) Instantaneous Maximum	< 2	< 2	7800	< 2	< 2	< 2	164	11	< 2	13	< 2	7
Nitrate-Nitrite (mg/L) Average Monthly	70.6	56.4	80.7	78.0	70.8	53.1	14.5	57.8	62.1	66.5	78.7	79.1
Nitrate-Nitrite (lbs) Total Monthly	25.18	54.63	37.34	35.2	30.33	35.01	4.88	13.75	6.77	42.12	40.16	60.17
Total Nitrogen (mg/L) Average Monthly	71.45	57.31	82.18	79.65	71.91	54.12	15.66	59.17	63.09	67.41	79.7	80.69
Total Nitrogen (lbs) Total Monthly	25.52	55.52	38.04	35.96	30.81	35.73	5.27	14.11	6.90	42.69	40.71	61.35
Ammonia (mg/L) Average Monthly	< 0.19	< 0.16	< 0.1	< 0.15	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	0.88	< 0.1
TKN (mg/L) Average Monthly	0.9	0.91	1.48	1.65	1.11	1.07	1.16	1.37	1.04	0.96	1.05	1.59
TKN (lbs) Total Monthly	0.339	0.880	0.689	0.745	0.474	0.730	0.405	0.355	0.120	0.568	0.546	1.167

**NPDES Permit Fact Sheet
Salisbury Elementary WWTP**

NPDES Permit No. PA0038318

Total Phosphorus (mg/L) Average Monthly	13.25	12.3	11.6	12.70	11.4	9.68	4.47	11.6	10.08	9.83	13.40	9.41
Total Phosphorus (lbs) Total Monthly	4.824	11.886	5.368	5.728	4.885	6.419	1.554	2.843	1.123	6.702	6.822	7.598
Total Phosphorus (lbs) Total Annual						57.48						

Existing Effluent Limitations and Monitoring Requirements

The tables below summarize the effluent limits and monitoring requirements implemented in the existing NPDES permit.

Outfall 001

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day)		Concentrations (mg/L)				Minimum Measurement Frequency	Required Sample Type
	Average Monthly	Total Annual	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
CBOD5	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
TSS	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/month	Grab
Ammonia-N	XXX	XXX	XXX	Report	XXX	Report	2/month	8-Hr Composite
TKN (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Nitrate-Nitrite (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Total Phosphorus (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Phosphorus (lbs/year)	XXX	274	XXX	XXX	XXX	XXX	1/year	Calculation

Compliance Sampling Location: Outfall 001

Development of Effluent Limitations

Outfall No. <u>001</u>	Design Flow (MGD) <u>.009</u>
Latitude <u>40° 1' 8.8"</u>	Longitude <u>76° 0' 28.4"</u>
Wastewater Description: <u>Sewage Effluent</u>	

Technology-Based Limitations

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Water Quality-Based Limitations

Pursuant to 40 CFR § 122.44(d)(1)(i), more stringent requirements should be considered when pollutants are discharged at the levels which have the reasonable potential to cause or contribute to excursions above water quality standards.

WQM 7.0 ver. 1.0b is a water quality model designed to assist DEP in determining appropriate water quality based effluent limits (WQBELs) for carbonaceous biochemical oxygen demand (CBOD₅), ammonia (NH₃-N), and dissolved oxygen (D.O.). The model simulates two basic processes: In the NH₃-N module, the model simulates the mixing and degradation of NH₃-N in the stream and compares calculated instream NH₃-N concentrations to NH₃-N water quality criteria. In the D.O. module, the model simulates the mixing and consumption of D.O. in the stream due to the degradation of CBOD₅ and NH₃-N and compares calculated instream D.O. concentrations to D.O. water quality criteria. The model then determines the highest pollutant loadings that the stream can assimilate while still meeting water quality criteria under design conditions. DEP's Technical Guidance No. 391-2000-007 provides the technical methods contained in WQM 7.0 for determining wasteload allocations and for determining recommended NPDES effluent limits for point source discharges.

The model was utilized for this permit application. The flow data used to run the model was acquired from USGS PA StreamStats and is included in an attachment. Default stream pH and temperature inputs were used for this model run. The model output indicated a CBOD₅ average monthly limit of 25 mg/l, an NH₃-N average monthly limit of 25 mg/l, and a D.O. minimum limit of 5.0 mg/l were protective of water quality. The CBOD₅ limit is the same as the existing limit, which will remain in the permit. Per DEP's SOP No. BCW-PMT-033, for existing discharges, if WQM modeling results indicate that an average monthly limit of 25 mg/l is acceptable, a year-round monitoring requirement for ammonia-nitrogen should be established at a minimum, which is consistent with the existing permit limits.

There are no industrial/commercial users contributing industrial wastewater to the system and Pequea Valley School District does not currently have an EPA-approved pretreatment program. Accordingly, evaluating reasonable potential of toxic pollutants is not necessary as effluent levels of toxic pollutants are expected to be insignificant.

Best Professional Judgement (BPJ) Limitations

Dissolved Oxygen

A minimum D.O. limit of 5.0 mg/L is a D.O. water quality criterion found in 25 Pa. Code § 93.7(a). This limit is included in the existing NPDES permit. This limit will remain in the permit to ensure that the facility continues to achieve compliance with DEP water quality standards.

Total Residual Chlorine

The attached computer printout utilizes the equations and calculations as presented in the Department's May 1, 2003 Implementation Guidance for Total Residual Chlorine (TRC) (ID No. 391-2000-015) for developing chlorine limitations. The Guidance references Chapter 92, Section 92.2d (3) which establishes a standard BAT limit of 0.5 mg/l unless a facility-specific BAT has been developed. The attached printout indicates that a water quality limit of 0.5 mg/l would be needed to prevent toxicity concerns. It is recommended that a TRC limit of 0.5 mg/l monthly average and 1.6 mg/l instantaneous maximum be applied this permit cycle, the same as the existing limit.

Additional Considerations

Chesapeake Bay Total Maximum Daily Load (TMDL)

DEP developed a strategy to comply with the EPA and Chesapeake Bay Foundation requirements by reducing point source loadings of Total Nitrogen (TN) and Total Phosphorus (TP). This strategy can be located in the *Pennsylvania Chesapeake Watershed Implementation Plan* (WIP), dated January 11, 2011. Subsequently, an update to the WIP was published as the Phase 2 WIP. As part of the Phase 2 WIP, a *Phase 2 Watershed Implementation Plan Wastewater Supplement* (Phase 2 Supplement) was developed, providing an update on TMDL implementation for point sources and DEP's current implementation strategy for wastewater. A new update to the WIP was published as the Phase 3 WIP in August 2019. As part of the Phase 3 WIP, a *Phase 3 Watershed Implementation Plan Wastewater Supplement* (Phase 3 Supplement) was developed, and was most recently revised on December 17, 2019, and is the basis for the development of any Chesapeake Bay related permit parameters. Sewage discharges have been prioritized based on their design flow to the Bay. The highest priority (Phases 1, 2, and 3) dischargers will receive annual Cap Loads based on their design flow on August 29, 2005 and concentrations of 6 mg/l TN and 0.8 mg/l TP. These limits may be achieved through a combination of treatment technology, credits, or offsets. For Phase 4 and 5 facilities, Cap Loads are not currently being implemented for renewed or amended permits for facilities that do not increase design flow.

This facility is considered a Phase 5 non-significant discharger with a design flow less than 0.2 MGD but greater than 0.002 MGD. According to DEP's latest-revised Phase 3 Supplement, issuance of permits with monitoring and reporting for TN and TP is recommended for any Phase 5 non-significant sewage facilities (i.e., facilities with average annual design flows on August 29, 2005 less than 0.2 MGD but greater than 0.002 MGD). Furthermore, DEP's SOP No. BCW-PMT-033 states that in general, at a minimum, monitoring for TN and TP should be included in new and reissued permits for sewage discharges with design flows > 2,000 gpd. Therefore, TN and TP monitoring will be included in the renewed permit, which is consistent with the existing permit.

Pequea Creek TMDL

A TMDL exists for Pequea Creek for phosphorus and sediment. The TMDL was completed and approved on April 9, 2001 and was revised in 2006. The TMDL established a TP mass loading of 274 lbs/year for this facility. This limit will remain in the permit.

Anti-Degradation (93.4)

The effluent limits for this discharge have been developed to ensure that existing instream water uses and the level of water quality necessary to protect the existing uses are maintained and protected. No High Quality Waters are impacted by this discharge. No Exceptional Value Waters are impacted by this discharge.

303d Listed Streams

The discharge is located on a stream segment that is designated on the 303(d) list as impaired. There is a recreational impairment for pathogens due to an unknown source. There is an aquatic life impairment for habitat modification – other

than hydromodification due to siltation and habitat alterations; agriculture due to nutrients, organic enrichment, and siltation. The permit contains monitoring requirements for nutrients and will not contribute to the other impairments.

Class A Wild Trout Fisheries

No Class A Wild Trout Fisheries are impacted by this discharge.

Anti-Backsliding

Pursuant to 40 CFR § 122.44(l)(1), all proposed permit requirements addressed in this fact sheet are at least as stringent as the requirements implemented in the existing NPDES permit unless any exceptions addressed by DEP in this fact sheet.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day)		Concentrations (mg/L)				Minimum Measurement Frequency	Required Sample Type
	Average Monthly	Total Annual	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
CBOD5	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
TSS	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/month	Grab
Ammonia-N	XXX	XXX	XXX	Report	XXX	Report	2/month	8-Hr Composite
TKN (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Nitrate-Nitrite (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Total Phosphorus (lbs/mo)	Report Total Mo	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Phosphorus (lbs/year)	XXX	274	XXX	XXX	XXX	XXX	1/year	Calculation

Compliance Sampling Location: Outfall 001

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	PENTOXSD for Windows Model (see Attachment [redacted])
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Toxics Screening Analysis Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input checked="" type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 362-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 362-2000-003, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 362-2000-008, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 362-2183-003, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 362-2183-004, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 385-2000-011, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 391-2000-002, 4/97.
<input checked="" type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 391-2000-003, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 391-2000-006, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 391-2000-007, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 391-2000-008, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 391-2000-010, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 391-2000-011, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 391-2000-013, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 391-2000-014, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 391-2000-015, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 391-2000-017, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 391-2000-018, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 391-2000-019, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 391-2000-021, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 391-2000-022, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 391-2000-023, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 391-2000-024, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 391-3200-013, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input type="checkbox"/>	SOP: [redacted]
<input type="checkbox"/>	Other: [redacted]

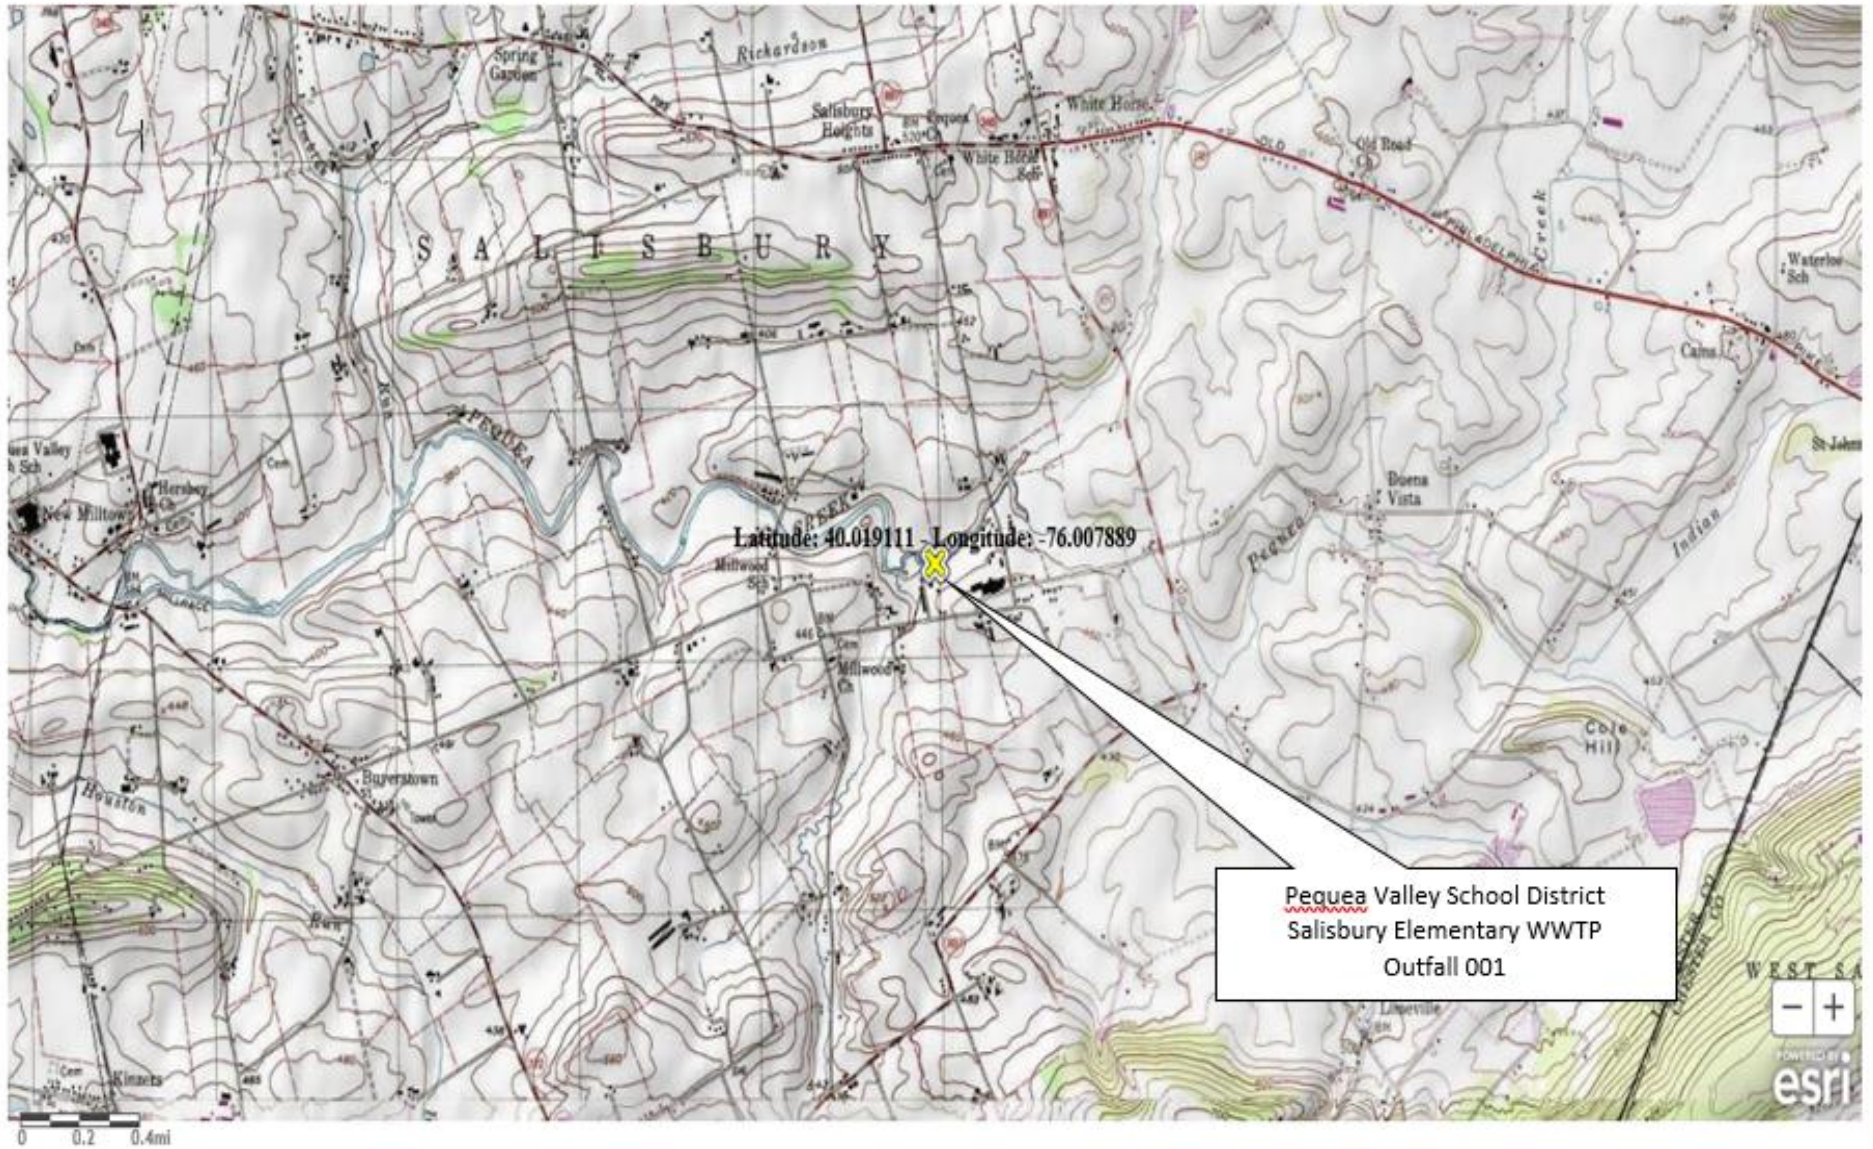

Salisbury Elementary WWTP PA0038318

Outfall 001

Region ID: PA
Workspace ID: PA20200320140848364000
Clicked Point (Latitude, Longitude): 40.01933, -76.00809
Time: 2020-03-20 10:09:06 -0400



Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	27.9	square miles
BSLOPD	Mean basin slope measured in degrees	3.9	degrees
ROCKDEP	Depth to rock	5.3	feet

Parameter Code	Parameter Description	Value	Unit
URBAN	Percentage of basin with urban development	1	percent

Low-Flow Statistics Parameters_[Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	27.9	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	3.9	degrees	1.7	6.4
ROCKDEP	Depth to Rock	5.3	feet	4.13	5.21
URBAN	Percent Urban	1	percent	0	89

Low-Flow Statistics Disclaimers_[Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report_[Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	7.26	ft ³ /s
30 Day 2 Year Low Flow	9.09	ft ³ /s
7 Day 10 Year Low Flow	3.69	ft ³ /s
30 Day 10 Year Low Flow	4.64	ft ³ /s
90 Day 10 Year Low Flow	7.13	ft ³ /s

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.


USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.3.11

Salisbury Elementary WWTP PA0038318

Downstream Pt.

Region ID: PA
Workspace ID: PA20200320141209971000
Clicked Point (Latitude, Longitude): 40.02150, -76.04209
Time: 2020-03-20 10:12:28 -0400

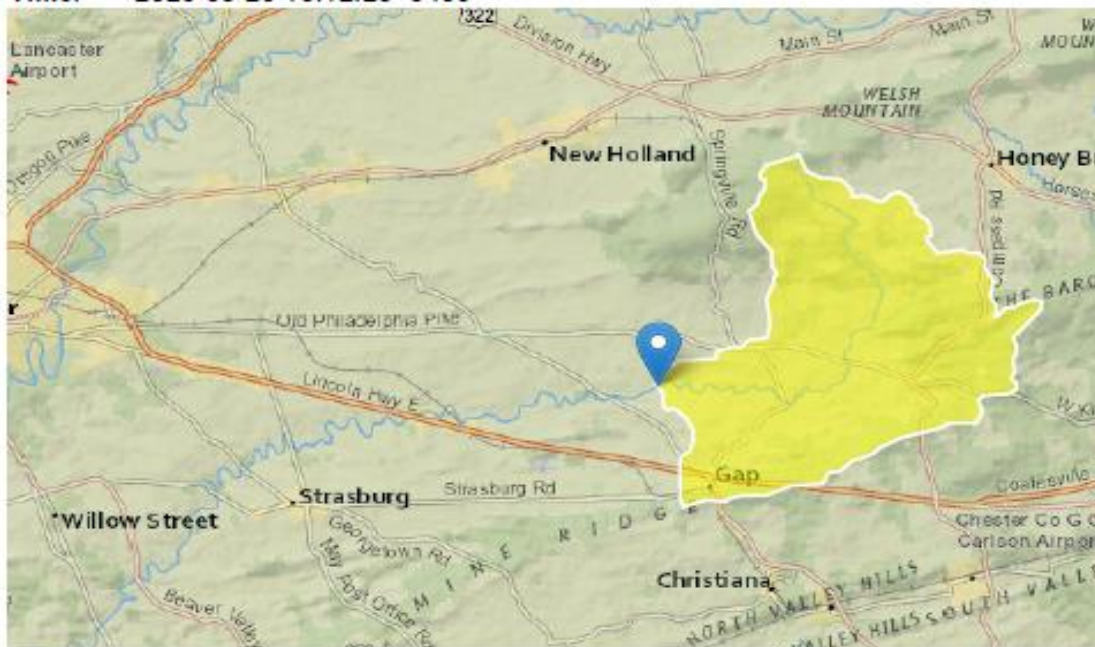

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	33.6	square miles
BSLOPD	Mean basin slope measured in degrees	3.8	degrees
ROCKDEP	Depth to rock	5.3	feet

Parameter Code	Parameter Description	Value	Unit
URBAN	Percentage of basin with urban development	2	percent

Low-Flow Statistics Parameters^[Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	33.6	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	3.8	degrees	1.7	6.4
ROCKDEP	Depth to Rock	5.3	feet	4.13	5.21
URBAN	Percent Urban	2	percent	0	89

Low-Flow Statistics Disclaimers^[Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors

Low-Flow Statistics Flow Report^[Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	8.64	ft ³ /s
30 Day 2 Year Low Flow	10.9	ft ³ /s
7 Day 10 Year Low Flow	4.41	ft ³ /s
30 Day 10 Year Low Flow	5.56	ft ³ /s
90 Day 10 Year Low Flow	8.6	ft ³ /s

Low-Flow Statistics Citations

Stuckey, M.H.,2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.3.11

Permit No. PA0038318

	A	B	C	D	E	F	G	H
1	TRC EVALUATION							
2	Input appropriate values in A3:A9 and D3:D9							
3	3.69	= Q stream (cfs)		0.5	= CV Daily			
4	0.009	= Q discharge (MGD)		0.5	= CV Hourly			
5	30	= no. samples		1	= AFC_Partial Mix Factor			
6	0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor			
7	0	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)			
8	0.5	= BAT/BJ Value		720	= CFC_Criteria Compliance Time (min)			
9	0	= % Factor of Safety (FOS)			=Decay Coefficient (K)			
10	Source	Reference	AFC Calculations		Reference	CFC Calculations		
11	TRC	1.3.2.iii	WLA afc = 84.563		1.3.2.iii	WLA cfc = 82.435		
12	PENTOXSD TRG	5.1a	LTAMULT afc = 0.373		5.1c	LTAMULT cfc = 0.581		
13	PENTOXSD TRG	5.1b	LTA_afc= 31.510		5.1d	LTA_cfc = 47.924		
14								
15	Source		Effluent Limit Calculations					
16	PENTOXSD TRG	5.1f	AML MULT = 1.231					
17	PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.500		BAT/BJ			
18			INST MAX LIMIT (mg/l) = 1.635					
19								
20								
21								
22	WLA afc	(.019/e(-k*AFC_tc)) + [(AFC_Yc*Qs*.019/Qd*e(-k*AFC_tc))...						
23		...+ Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)						
24	LTAMULT afc	EXP((0.5*LN(cvh^2+1))-2.326*LN(cvh^2+1)^0.5)						
25	LTA_afc	wla_afc*LTAMULT_afc						
26								
27	WLA_cfc	(.011/e(-k*CFC_tc) + [(CFC_Yc*Qs*.011/Qd*e(-k*CFC_tc))...						
28		...+ Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)						
29	LTAMULT_cfc	EXP((0.5*LN(cvd^2/no_samples+1))-2.326*LN(cvd^2/no_samples+1)^0.5)						
30	LTA_cfc	wla_cfc*LTAMULT_cfc						
31								
32	AML MULT	EXP(2.326*LN((cvd^2/no_samples+1)^0.5)-0.5*LN(cvd^2/no_samples+1))						
33	AVG MON LIMIT	MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)*AML_MULT)						
34	INST MAX LIMIT	1.5*((av_mon_limit/AML_MULT)/LTAMULT_afc)						
35								
36								
37								
38								
39								
40								
41		(0.011/EXP(-K*CFC_tc/1440))+(((CFC_Yc*Qs*0.011)/(1.547*Qd))....						
42	*EXP(-K*CFC_tc/1440))+Xd+(CFC_Yc*Qs*Xs/1.547*Qd)]*(1-FOS/100)						
43								
44								
45								
46								
47								
48								

Permit No. PA0038318

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	7450	PEQUEA CREEK	39.900	395.00	27.90	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.100	0.00	3.69	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data							
Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Sallsbury Elem	PA0038318	0.0090	0.0090	0.0090	0.000	25.00	7.00

Parameter Data					
Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)	
CBOD5	25.00	2.00	0.00	1.50	
Dissolved Oxygen	5.00	8.24	0.00	0.00	
NH3-N	25.00	0.00	0.00	0.70	

Permit No. PA0038318

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	7450	PEQUEA CREEK	37.090	375.00	33.60	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY (cfsm)	Trib Flow (cfs)	Stream Flow (cfs)	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary		Stream	
									Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.100	0.00	4.41	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Permit No. PA0038318

WQM 7.0 Hydrodynamic Outputs

	<u>SWP Basin</u>		<u>Stream Code</u>			<u>Stream Name</u>						
	07K		7450			PEQUEA CREEK						
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis Flow	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
	(cfs)	(cfs)	(cfs)	(cfs)	(ft/ft)	(ft)	(ft)		(fps)	(days)	(°C)	
Q7-10 Flow												
39.900	3.69	0.00	3.69	.0139	0.00135	.656	29.95	45.69	0.19	0.910	20.02	7.00
Q1-10 Flow												
39.900	2.36	0.00	2.36	.0139	0.00135	NA	NA	NA	0.15	1.168	20.03	7.00
Q30-10 Flow												
39.900	5.02	0.00	5.02	.0139	0.00135	NA	NA	NA	0.22	0.767	20.01	7.00

Permit No. PA0038318

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		

Permit No. PA0038318

WQM 7.0 Wasteload Allocations

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>
07K	7450	PEQUEA CREEK

NH3-N Acute Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
39.900	Salisbury Elem	9.65	50	9.65	50	0	0

NH3-N Chronic Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
39.900	Salisbury Elem	1.92	25	1.92	25	0	0

Dissolved Oxygen Allocations

RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
39.90	Salisbury Elem	25	25	25	25	5	5	0	0

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07K	7450	PEQUEA CREEK		
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>
39.900	0.009	20.019		7.000
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>
29.953	0.656	45.667		0.189
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>
2.09	0.037	0.09		0.701
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>
8.231	2.417	Tsivoglou		5
<u>Reach Travel Time (days)</u>				
0.910				
	<u>TravTime (days)</u>	<u>Subreach Results</u>		
		<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.091	2.08	0.09	8.24
	0.182	2.07	0.08	8.24
	0.273	2.07	0.08	8.24
	0.364	2.06	0.07	8.24
	0.455	2.05	0.07	8.24
	0.546	2.04	0.06	8.24
	0.637	2.04	0.06	8.24
	0.728	2.03	0.06	8.24
	0.819	2.02	0.05	8.24
	0.910	2.02	0.05	8.24

Permit No. PA0038318

WQM 7.0 Effluent Limits

<u>SWP Basin</u>		<u>Stream Code</u>		<u>Stream Name</u>			
07K		7450		PEQUEA CREEK			
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
39.900	Salisbury Elem	PA0038318	0.009	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5