

Application Type Renewal  
Facility Type Non-Municipal  
Major / Minor Minor

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SEWAGE**

Application No. PA0080683  
APS ID 275243  
Authorization ID 1434527

**Applicant and Facility Information**

Applicant Name	<u>Millers Skyview Sales Inc.</u>	Facility Name	<u>Millers Skyview MHP</u>
Applicant Address	<u>200 Ridge Road</u> <u>Etters, PA 17319-9110</u>	Facility Address	<u>300 Ridge Road</u> <u>Etters, PA 17319-9659</u>
Applicant Contact	<u>Edward Miller</u>	Facility Contact	<u>Edward Miller</u>
Applicant Phone	<u>(717) 439-3533</u>	Facility Phone	<u>(717) 439-3433</u>
Client ID	<u>44953</u>	Site ID	<u>449950</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Newberry Township</u>
Connection Status	<u>No Limitations</u>	County	<u>York</u>
Date Application Received	<u>March 28, 2023</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>April 7, 2023</u>	If No, Reason	<u></u>
Purpose of Application	<u>Renewal of existing NPDES Permit</u>		

**Summary of Review**

Miller's Skyview Sales (MSS) has applied to the Pennsylvania Department of Environmental Protection (DEP) for reissuance of its NPDES permit. The permit was last reissued to LHMC on October 29, 2018. The permit expired on October 31, 2023 but the terms and conditions of the permit have been administratively extended since that time.

Based on the review outlined in this fact sheet, it is recommended that the permit be drafted and a notice of the draft permit be published in the *Pennsylvania Bulletin* for public comments for 30 days. A file review of documents associated with the discharge or permittee may be available at the PA DEP southcentral regional office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file reviews, contact the SCRO file review coordinator at 717.705.4700.

Sludge use and disposal description and location(s): Hauled offsite by Young's Sanitary Septic Service.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
x		Aaron Baar Aaron Baar / Project Manager	May 9, 2024
x		Maria D. Bebenek for Daniel W. Martin, P.E. / Environmental Engineer Manager	May 22, 2024

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.025
Latitude	40° 8' 26.67"	Longitude	-76° 49' 43.80"
Quad Name	Steelton	Quad Code	1731
Wastewater Description: Sewage Effluent			
Receiving Waters	Unnamed Tributary of Bennett Run (WWF)	Stream Code	8475
NHD Com ID	57463549	RMI	1.13
Drainage Area	0.43 sq mi	Yield (cfs/mi <sup>2</sup> )	0.236
Q <sub>7-10</sub> Flow (cfs)	0.0585	Q <sub>7-10</sub> Basis	USGS StreamStats
Elevation (ft)	507.40	Slope (ft/ft)	
Watershed No.	7-F	Chapter 93 Class.	WWF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Assessed use – recreational (impaired)		
Cause(s) of Impairment	UNK		
Source(s) of Impairment	Pathogens		
TMDL Status	Pending	Name	
Nearest Downstream Public Water Supply Intake	Wrightsville Water Supply Co		
PWS Waters	Susquehanna River	Flow at Intake (cfs)	UNK
PWS RMI	28.51 mi	Distance from Outfall (mi)	27 mi

Changes Since Last Permit Issuance: No changes since the last issuance of the last NPDES permit renewal.

**Drainage Area**

The discharge is to UNT to Bennet Run at RMI 1.13. A drainage area upstream of the discharge is determined to be 0.43 sq.mi. according to USGS PA StreamStats available at <https://streamstats.usgs.gov/ss/>.

**Stream Flow**

According to StreamStats, the watershed has a Q<sub>7-10</sub> of 0.0585 cfs. This information was used to obtain a LFY, a chronic 30-day (Q<sub>30-10</sub>) and acute (Q<sub>1-10</sub>) exposure stream flows for the discharge point as follows (Guidance No. 391-2000-023).

$$\begin{aligned}
 Q_{7-10} &= 0.0585 \text{ cfs} \\
 Q_{30-10} &= 1.36 * 0.0585 \text{ cfs} = 0.07956 \text{ cfs} \\
 Q_{1-10} &= 0.64 * 0.0585 \text{ cfs} = 0.03744 \text{ cfs} \\
 LFY &= 0.0585 \text{ cfs}/0.043 \text{ mi}^2 = 0.136 \text{ cfs/mi}^2
 \end{aligned}$$

**UNT to Bennet Run**

25 Pa Code §93.9 classifies the receiving water, UNT to Bennet Run, with a WWF Existing Use designation. No special protection waters are impacted by this discharge. The discharge is in a stream segment listed as not attaining use in the 2024 Integrated Report; the source of the impairment has been identified as pathogens (source unknown). Effluent limits for this discharge have been developed to ensure that existing in-stream water uses and the level of water quality necessary to protect the existing uses are maintained and protected.

**Local Watershed Total Maximum Daily Loads (TMDLs)**

According to PA's 2024 Integrated Water Quality Monitoring and Assessment Report, UNT to Bennet Run in the vicinity of the point of discharge is impaired for recreation (pathogens). The impairment is listed as Category 5 in

the 2024 integrated report, indicating that UNT to Bennet Run is impaired for one or more uses by a pollutant that require the development of a TMDL. A TMDL for this waterway has not been developed to date.

*Public Water Supply Intake*

The nearest downstream public water supply intake is the Wrightsville Water Supply Co intake located on the Susquehanna River approximately 27 miles from the discharge. Considering the distance and nature, the discharge is not expected to significantly affect the water supply.

*Class A Wild Trout Streams*

The receiving stream is not a Class A Wild Trout stream; therefore, no Class A Wild Trout Fishery is impacted by this discharge.

<b>Treatment Facility Summary</b>				
<b>Treatment Facility Name:</b> Skyview MHP				
<b>WQM Permit No.</b>	<b>Issuance Date</b>			
6789421	September 19, 1989			
<b>Waste Type</b>	<b>Degree of Treatment</b>	<b>Process Type</b>	<b>Disinfection</b>	<b>Avg Annual Flow (MGD)</b>
Sewage	Secondary	Activated Sludge	Hypochlorite	0.025
<b>Hydraulic Capacity (MGD)</b>	<b>Organic Capacity (lbs/day)</b>	<b>Load Status</b>	<b>Biosolids Treatment</b>	<b>Biosolids Use/Disposal</b>
0.025	Not specified in permit	Not Overloaded	Aerobic Digestion	Other WWTP

MSS owns and operates the sanitary wastewater treatment facility located in Newberry Township, York County. The facility only serves the Skyview MHP, all wastes are residential in nature, and all sewer systems are 100% separated. With having both annual average design flow and hydraulic design capacity of 0.025 MGD, this facility utilizes an extended aeration system consisting of a grease trap (1), EQ tank (1), aeration tank (4), clarifier (2), chlorine contact tank, dichlorination tank and outfall structure to the UNT to Bennett Run. The facility utilizes a sludge holding tank. An unidentified form of chlorine is used for disinfection, an unidentified compound is used for de-chlorination, and alum is used for phosphorus precipitation.

<b>Compliance History</b>	
<b>Summary of DMRs:</b>	DMR results for the past year are presented below.
<b>Summary of Inspections:</b>	Since the last renewal of the facility's NPDES permit, the following inspections have been logged:  November 16, 2019: A CEI was conducted by Austen Randecker. No violations were noted, but operational recommendations were made regarding the use of composite samplers, and maintaining a repair and maintenance log.

Other Comments: As of May 9, 2024, there are no open violations associated with this facility.

Existing Effluent Limitations and Monitoring Requirements

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.04	XXX	0.12	1/day	Grab
CBOD5	XXX	XXX	XXX	25.0	XXX	Report	2/month	24-Hr Composite
TSS	XXX	XXX	XXX	30.0	XXX	60	2/month	24-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
Nitrate-Nitrite	XXX	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite
Nitrate-Nitrite (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Total Nitrogen (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Ammonia Nov 1 - Apr 30	XXX	XXX	XXX	2.5	XXX	5	2/month	24-Hr Composite
Ammonia May 1 - Oct 31	XXX	XXX	XXX	1.0	XXX	2.5	2/month	24-Hr Composite
Ammonia (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
TKN	XXX	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite
TKN (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Maximum	Instant. Maximum		
Total Phosphorus (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation

Compliance Sampling Location: Outfall 001

**Compliance History**

DMR Data for Outfall 001 (from March 1, 2023 to February 29, 2024)

Parameter	FEB-24	JAN-24	DEC-23	NOV-23	OCT-23	SEP-23	AUG-23	JUL-23	JUN-23	MAY-23	APR-23	MAR-23
Flow (MGD) Average Monthly	0.021	0.022	0.022	0.018	0.015	0.013	0.013	0.014	0.015	0.017	0.019	0.022
Flow (MGD) Daily Maximum	0.026	0.024	0.023	0.023	0.017	0.015	0.014	0.016	0.017	0.02	0.021	0.027
pH (S.U.) Instantaneous Minimum	7.3	7.3	7.2	7.3	7.1	7.1	7.2	7.2	7.1	7.2	7.3	7.3
pH (S.U.) Instantaneous Maximum	7.5	7.4	7.4	7.4	7.4	7.6	7.4	7.4	7.7	7.5	7.6	7.5
DO (mg/L) Instantaneous Minimum	7.2	7.4	7.4	7.2	6.6	6.0	6.0	6.0	6.2	6.6	6.8	6.8
TRC (mg/L) Average Monthly	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.02	< 0.02	< 0.03
TRC (mg/L) Instantaneous Maximum	0.05	0.09	0.08	0.07	0.07	0.06	0.05	0.07	0.06	0.06	0.04	0.06
CBOD5 (mg/L) Average Monthly	< 2.4	< 2.4	< 2.4	< 2.7	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4
CBOD5 (mg/L) Instantaneous Maximum	< 2.4	< 2.4	< 2.4	3	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4	< 2.4
TSS (mg/L) Average Monthly	1	1	2	2	4	4	2	2	2	4	2	1

**NPDES Permit Fact Sheet  
Millers Skyview MHP**

**NPDES Permit No. PA0080683**

Fecal Coliform (No./100 ml) Geometric Mean	30	56	22	257	448	448	68	24	8	15	12	20
Fecal Coliform (No./100 ml) Instantaneous Maximum	102	68	30	866	1120	1120	179	53	12	43	15	43
Nitrate-Nitrite (mg/L) Average Monthly	16	11.4	15	29	22	22	22	12.9	11.6	3.6	5.7	11.2
Nitrate-Nitrite (lbs) Total Monthly	83	67	88	132	85	68	74	44	45	18	29	63
Total Nitrogen (mg/L) Average Monthly	16	11.82	15	29	< 22	22	22	12.9	12.5	4.68	6.3	11.67
Total Nitrogen (lbs) Total Monthly	86	71	90	135	1.94	70	75	45	49	22	33	67
Total Nitrogen (lbs) Total Annual						773						
Ammonia (mg/L) Average Monthly	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10
Ammonia (mg/L) Instantaneous Maximum	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	0.11	< 0.10	0.12	< 0.10	< 0.10
Ammonia (lbs) Total Monthly	0.508	0.569	0.569	0.450	0.388	0.325	0.336	0.370	0.375	0.483	0.475	0.543
Ammonia (lbs) Total Annual						5.54						
TKN (mg/L) Average Monthly	< 0.50	< 0.67	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	1	1.03	< 0.9	< 0.72
TKN (lbs) Total Monthly	2.54	3.81	2.84	2.25	1.94	1.63	1.68	1.68	3.56	5	4	3.88
Total Phosphorus (lbs/day) Average Monthly	0.683	0.495	0.477	0.900	0.425	0.477	1650	0.596	0.813	0.709	0.824	0.701
Total Phosphorus (mg/L) Average Monthly	3.9	2.7	2.6	6.1	3.4	3.4	6	5.5	6.5	5	5.2	4
Total Phosphorus (lbs) Total Monthly	20	15	15	27	13	14	20	18	24	22	0.824	21.7
Total Phosphorus (lbs) Total Annual						252						

**Compliance History**

**Effluent Violations for Outfall 001, from: April 1, 2023 To: February 29, 2024**

Parameter	Date	SBC	DMR Value	Units	Limit Value	Units
Fecal Coliform	09/30/23	Geo Mean	448	No./100 ml	200	No./100 ml
Fecal Coliform	09/30/23	IMAX	1120	No./100 ml	1000	No./100 ml

Other Comments: The cause of the 9/30/23 exceedances is not available on WMS. No Non-Compliance Form appears to be in the Department's records.



**Development of Effluent Limitations**

<b>Outfall No.</b> <u>001</u>	<b>Design Flow (MGD)</b> <u>.025</u>
<b>Latitude</b> <u>40° 8' 36.56"</u>	<b>Longitude</b> <u>-76° 49' 48.45"</u>
<b>Wastewater Description:</b> <u>Sewage Effluent</u>	

**Technology-Based Limitations**

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD <sub>5</sub>	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Comments: These standards apply, subject to water quality analysis and BPJ where applicable.

**Water Quality-Based Limitations**

*CBOD<sub>5</sub>, NH<sub>3</sub>-N and Dissolved Oxygen (DO)*

WQM 7.0 version 1.0b is a water quality model designed to assist DEP to determine appropriate permit requirements for CBOD<sub>5</sub>, NH<sub>3</sub>-N and DO. DEP's guidance no. 391-2000-007 provides the technical methods contained in WQM 7.0 for conducting wasteload allocation and for determining recommended NPDES effluent limits for point source discharges. The model was utilized, and the model output indicated that existing TBEL of 25 mg/L for CBOD<sub>5</sub> is still appropriate. The output also indicated that the existing winter and summer WQBELs for NH<sub>3</sub>-N could be higher given current low-flow conditions in the receiving water, but due to anti-backsliding provisions the existing limits will be left intact.

A peak instantaneous limit of 50 mg CBOD<sub>5</sub>/L has been added in accordance with SOP No. BCW-PMT-033 *Establishing Effluent Limitations for Individual Sewage Permits*.

The model also indicates that the existing DO limit of 5.0 mg/L is still protective of water quality.

**Toxics**

DEP's NPDES permit application for minor sewage facilities (less than 0.1 MGD) does not require sampling for heavy metals including Total Copper, Total Lead, and Total Zinc unless the facility receives commercial or industrial wastewater.

**Best Professional Judgment (BPJ) Limitations**

*Total Phosphorus & Total Nitrogen*

DEP's SOP no. BPNPSM-PMT-033 (Establishing Effluent Limitations for Individual Sewage Permits) recommends monitoring requirements for Total Phosphorus and Total Nitrogen for all sewage facilities. Therefore, a routine monitoring for TKN, Nitrate-Nitrite, and TN are recommended to be continued in this permit. Sampling frequency for TKN, Nitrate-Nitrite, TN, and TP are currently required 2/month. No change is proposed in this renewal.

*Total Residual Chlorine*

Since chlorine is used for disinfection, Total Residual Chlorine (TRC) effluent levels must be regulated in accordance with 25 Pa Code §92a.48(b). DEP's TRC\_CALC worksheet is utilized to determine if the existing BAT TBEL is still appropriate. The worksheet indicates that existing limits of 0.04 mg/L (average monthly) and 0.12 mg/L (IMAX) are still protective of water quality.

**Additional Considerations**

*Flow Monitoring*

The requirement to monitor the volume of effluent will remain in the draft permit per 40 CFR § 122.44(i)(1)(ii).

*E. Coli Monitoring*

In conformity with the Department's *Establishing Effluent Limitations for Individual Sewage Permits* (SOP No. BCW-PMT-033) and as authorized by § 92a.61 of the PA Code, annual E. Coli monitoring has been proposed in this permit. The collection method will be via grab sample.

*Chesapeake Bay TMDL*

The Department formulated a strategy in April 2007, to comply with the EPA's and Chesapeake Bay Foundation's requirements to reduce point source loadings of Total Nitrogen (TN) and Total Phosphorus (TP) to the Bay. In the Strategy, sewage dischargers have been prioritized by Central Office based on their delivered TN loadings to the Bay. The highest priority (Phases 1, 2, and 3) dischargers received annual loading caps based on their design flow on August 29, 2005 and concentrations of 6 mg/l TN and 0.8 mg/l TP. Phase 4 (0.2 -0.4mgd) and Phase 5 (below 0.2mgd) facilities were required to monitor and report TN and TP during permit renewal at a monitoring frequency following Table 6-3 of DEP's Technical Guidance for Development and Specification of effluent Limitations (No. 362-0400-001).

EPA published the Chesapeake Bay Total Maximum Daily Load (TMDL) in December of 2010. Despite extensive restoration efforts during the past 25 years, the TMDL was prompted by insufficient progress and continued poor water quality in the Chesapeake Bay and its tidal tributaries.

In order to address the TMDL, Pennsylvania developed, in addition to the Bay Strategy, a Chesapeake Watershed Implementation Plan (WIP) Phase 1 in January 2011, Phase 2 in March 2012 and Phase 3 in December 2019. In accordance with the Phase 3 WIP, re-issuing permits for significant dischargers follow the same phased approach formulated in the original Bay strategy, whilst Phase 4 and Phase 5 will be required to monitor and report TN and TP during permit renewal.

The Phase 3 WIP categorizes this facility as a phase 5 non-significant sewage facility that has a design flow less than 0.2 MGD but greater than 0.002 MGD. The WIP recommends monitoring and reporting for Total Nitrogen and Total Phosphorus throughout the permit term at a frequency no less than annual. As discussed previously, twice monthly testing of these pollutants is proposed in this permit.

*Monitoring Frequency and Sample Type*

Unless discussed otherwise above, the permit's monitoring frequency and sample type for all parameters will remain unchanged from the last permit renewal.

*Antidegradation Requirements*

All effluent limitations and monitoring requirements have been developed to ensure that existing instream water uses and the level of water quality necessary to protect the existing uses are maintained and protected.

*Anti-backsliding Requirement*

All effluent limits proposed in this fact sheet are as stringent as effluent limits specified in the existing permit renewal. This approach is in accordance with 40 CFR §122.44(l)(1).

*Annual Fees*

An annual fee clause was added to the permit in accordance with 25 Pa. Code § 92a.62. The facility covered by the permit is classified in the Minor Sewage Facility <0.05 MGD fee category, which has an annual fee of \$500.

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (386-0400-001), SOPs and/or BPJ.

**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.04	XXX	0.12	1/day	Grab
CBOD5	XXX	XXX	XXX	25.0	XXX	50	2/month	24-Hr Composite
TSS	XXX	XXX	XXX	30.0	XXX	60	2/month	24-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	XXX	Report	1/year	Grab
Nitrate-Nitrite	XXX	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite
Nitrate-Nitrite (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/month	Calculation
Total Nitrogen (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Ammonia Nov 1 - Apr 30	Report	XXX	XXX	2.5	XXX	5	2/month	24-Hr Composite

Outfall 001 , Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Maximum	Instant. Maximum		
Ammonia May 1 - Oct 31	Report	XXX	XXX	1.0	XXX	2.5	2/month	24-Hr Composite
Ammonia (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
TKN	XXX	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite
TKN (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	2/month	24-Hr Composite
Total Phosphorus (lbs)	Report Total Mo	XXX	XXX	XXX	XXX	XXX	1/month	Calculation

Compliance Sampling Location: Outfall 001


Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [redacted])
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input checked="" type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input checked="" type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input type="checkbox"/>	SOP: [redacted]
<input type="checkbox"/>	Other: [redacted]



TRC EVALUATION				
Input appropriate values in B4:B8 and E4:E7				
0.0617	= Q stream (cfs)	0.5	= CV Daily	
0.025	= Q discharge (MGD)	0.5	= CV Hourly	
30	= no. samples	1	= AFC_Partial Mix Factor	
0.3	= Chlorine Demand of Stream	1	= CFC_Partial Mix Factor	
0	= Chlorine Demand of Discharge	15	= AFC_Criteria Compliance Time (min)	
0.5	= BAT/BPJ Value	720	= CFC_Criteria Compliance Time (min)	
0	= % Factor of Safety (FOS)		=Decay Coefficient (K)	
Source	Reference	AFC Calculations		CFC Calculations
TRC	1.3.2.iii	WLA_afc = 0.528		1.3.2.iii WLA_cfc = 0.507
PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373		5.1c LTAMULT_cfc = 0.581
PENTOXSD TRG	5.1b	LTA_afc = 0.197		5.1d LTA_cfc = 0.295
Source	Effluent Limit Calculations			
PENTOXSD TRG	5.1f	AML_MULT = 1.231		
PENTOXSD TRG	5.1g	AVG_MON_LIMIT (mg/l) = 0.242		AFC
		INST_MAX_LIMIT (mg/l) = 0.792		
WLA_afc	$(.019/e^{-k \cdot AFC\_tc}) + [(AFC\_Yc \cdot Qs \cdot .019 / Qd \cdot e^{-k \cdot AFC\_tc}) \dots + Xd + (AFC\_Yc \cdot Qs \cdot Xs / Qd)] \cdot (1 - FOS / 100)$			
LTAMULT_afc	$EXP((0.5 \cdot LN(cvh^2 + 1)) - 2.326 \cdot LN(cvh^2 + 1)^{0.5})$			
LTA_afc	wla_afc * LTAMULT_afc			
WLA_cfc	$(.011/e^{-k \cdot CFC\_tc}) + [(CFC\_Yc \cdot Qs \cdot .011 / Qd \cdot e^{-k \cdot CFC\_tc}) \dots + Xd + (CFC\_Yc \cdot Qs \cdot Xs / Qd)] \cdot (1 - FOS / 100)$			
LTAMULT_cfc	$EXP((0.5 \cdot LN(cvd^2 / no\_samples + 1)) - 2.326 \cdot LN(cvd^2 / no\_samples + 1)^{0.5})$			
LTA_cfc	wla_cfc * LTAMULT_cfc			
AML_MULT	$EXP(2.326 \cdot LN((cvd^2 / no\_samples + 1)^{0.5}) - 0.5 \cdot LN(cvd^2 / no\_samples + 1))$			
AVG_MON_LIMIT	MIN(BAT_BPJ, MIN(LTA_afc, LTA_cfc) * AML_MULT)			
INST_MAX_LIMIT	1.5 * ((av_mon_limit / AML_MULT) / LTAMULT_afc)			

### StreamStats Report

Region ID: PA  
 Workspace ID: PA20240508133348284000  
 Clicked Point (Latitude, Longitude): 40.14125, -76.82782  
 Time: 2024-05-08 09:34:10 -0400

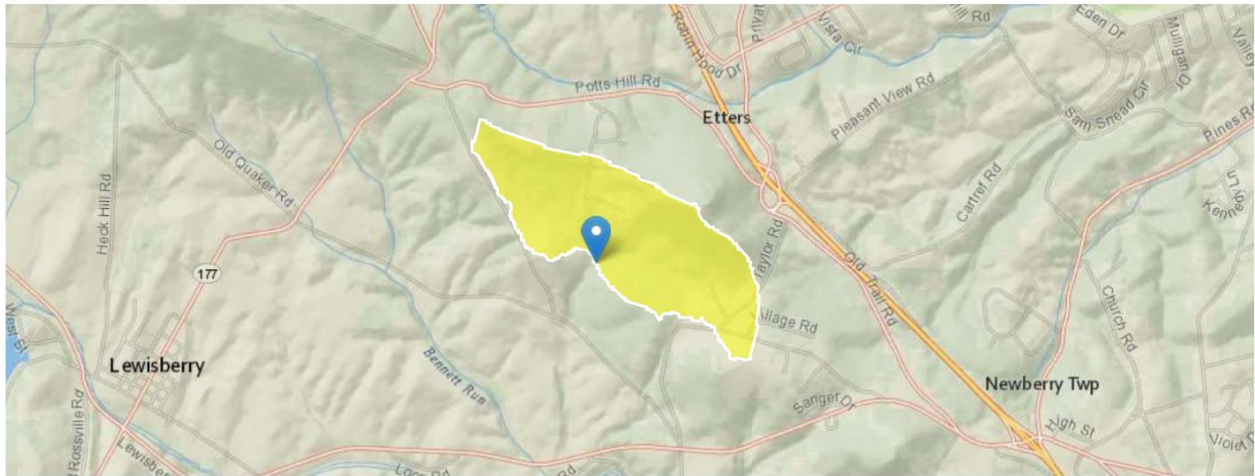

Collapse All

#### Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
BSLOPD	Mean basin slope measured in degrees	5.9417	degrees
DRNAREA	Area that drains to a point on a stream	0.43	square miles
ROCKDEP	Depth to rock	4.9	feet
URBAN	Percentage of basin with urban development	0	percent



➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.43	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	5.9417	degrees	1.7	6.4
ROCKDEP	Depth to Rock	4.9	feet	4.13	5.21
URBAN	Percent Urban	0	percent	0	89

Low-Flow Statistics Disclaimers [Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.13	ft <sup>3</sup> /s
30 Day 2 Year Low Flow	0.16	ft <sup>3</sup> /s
7 Day 10 Year Low Flow	0.0585	ft <sup>3</sup> /s
30 Day 10 Year Low Flow	0.0759	ft <sup>3</sup> /s
90 Day 10 Year Low Flow	0.108	ft <sup>3</sup> /s

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)


USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

StreamStats Report

Region ID: PA  
 Workspace ID: PA20240508133137555000  
 Clicked Point (Latitude, Longitude): 40.12925, -76.83031  
 Time: 2024-05-08 09:32:01 -0400

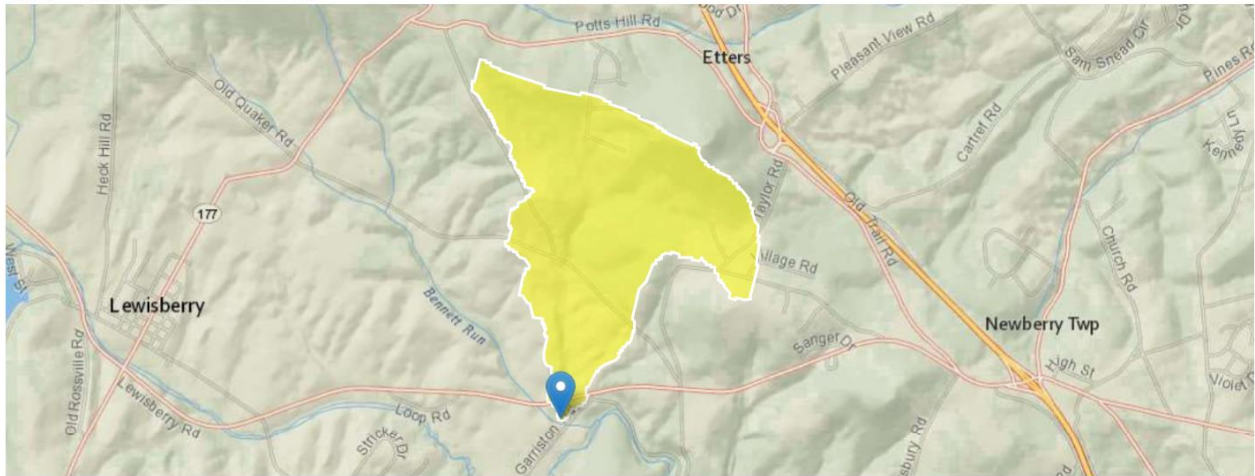

Collapse All

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
BSLOPD	Mean basin slope measured in degrees	5.6754	degrees
DRNAREA	Area that drains to a point on a stream	0.72	square miles
ROCKDEP	Depth to rock	4.6	feet
URBAN	Percentage of basin with urban development	0	percent

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.72	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	5.6754	degrees	1.7	6.4
ROCKDEP	Depth to Rock	4.6	feet	4.13	5.21
URBAN	Percent Urban	0	percent	0	89

Low-Flow Statistics Disclaimers [Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.157	ft <sup>3</sup> /s
30 Day 2 Year Low Flow	0.202	ft <sup>3</sup> /s
7 Day 10 Year Low Flow	0.0672	ft <sup>3</sup> /s
30 Day 10 Year Low Flow	0.0914	ft <sup>3</sup> /s
90 Day 10 Year Low Flow	0.138	ft <sup>3</sup> /s

*Low-Flow Statistics Citations*

**Stuckey, M.H.,2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)**

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

**WQM 7.0 Effluent Limits**

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>					
07F	8475	Trib 08475 of Bennett Run					
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
0.230	Millers Skyview	PA0080683	0.025	CBOD5	25		
				NH3-N	4.18	8.36	
				Dissolved Oxygen			5

**WQM 7.0 Wasteload Allocations**

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>
07F	8475	Trib 08475 of Bennett Run

**NH3-N Acute Allocations**

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
0.230	Millers Skyview	11.07	21.79	11.07	21.79	0	0

**NH3-N Chronic Allocations**

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
0.230	Millers Skyview	1.37	4.18	1.37	4.18	0	0

**Dissolved Oxygen Allocations**

RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
0.23	Millers Skyview	25	25	4.18	4.18	5	5	0	0

**WQM 7.0 D.O.Simulation**

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07F	8475	Trib 08475 of Bennett Run		
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
0.230	0.025	25.000	7.000	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
2.735	0.406	6.741	0.088	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
11.15	1.315	1.66	1.029	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
6.952	25.346	Owens	6	
<u>Reach Travel Time (days)</u>	<b>Subreach Results</b>			
0.160	<u>TravTime (days)</u>	<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.016	10.86	1.64	6.97
	0.032	10.58	1.61	6.99
	0.048	10.30	1.58	7.01
	0.064	10.03	1.56	7.04
	0.080	9.77	1.53	7.07
	0.096	9.52	1.51	7.09
	0.112	9.27	1.48	7.12
	0.128	9.03	1.46	7.15
	0.144	8.79	1.43	7.18
	0.160	8.56	1.41	7.21

### WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	6		

**WQM 7.0 Hydrodynamic Outputs**

<u>SWP Basin</u>		<u>Stream Code</u>				<u>Stream Name</u>						
07F		8475				Trib 08475 of Bennett Run						
RMI	Stream Flow (cfs)	PWS With (cfs)	Net Stream Flow (cfs)	Disc Analysis Flow (cfs)	Reach Slope (ft/ft)	Depth (ft)	Width (ft)	W/D Ratio	Velocity (fps)	Reach Trav Time (days)	Analysis Temp (°C)	Analysis pH
<b>Q7-10 Flow</b>												
0.230	0.06	0.00	0.06	.0387	0.09503	.406	2.74	6.74	0.09	0.160	25.00	7.00
<b>Q1-10 Flow</b>												
0.230	0.04	0.00	0.04	.0387	0.09503	NA	NA	NA	0.08	0.183	25.00	7.00
<b>Q30-10 Flow</b>												
0.230	0.08	0.00	0.08	.0387	0.09503	NA	NA	NA	0.10	0.143	25.00	7.00



**Input Data WQM 7.0**

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07F	8475	Trib 08475 of Bennett Run	0.230	507.40	0.43	0.00000	0.00	<input checked="" type="checkbox"/>

**Stream Data**

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Tributary pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.100	0.00	0.06	0.000	0.000	0.0	0.00	0.00	25.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

**Discharge Data**

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Millers Skyview	PA0080683	0.0250	0.0250	0.0250	0.000	25.00	7.00

**Parameter Data**

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

**Input Data WQM 7.0**

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07F	8475	Trib 08475 of Bennett Run	<b>0.001</b>	392.50	0.72	0.00000	0.00	<input checked="" type="checkbox"/>

**Stream Data**

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Tributary pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
<b>Q7-10</b>	0.100	0.00	0.07	0.000	0.000	0.0	0.00	0.00	25.00	7.00	0.00	0.00
<b>Q1-10</b>		0.00	0.00	0.000	0.000							
<b>Q30-10</b>		0.00	0.00	0.000	0.000							

**Discharge Data**

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	0.00	7.00

**Parameter Data**

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70