

Application Type Renewal
 Facility Type Non-Municipal
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Application No. PA0081116
 APS ID 274664
 Authorization ID 1456746

Applicant and Facility Information

Applicant Name	<u>Solanco School District</u>	Facility Name	<u>Solanco High School</u>
Applicant Address	<u>121 S Hess Street</u> <u>Quarryville, PA 17566</u>	Facility Address	<u>585 Solanco Road</u> <u>Quarryville, PA 17566</u>
Applicant Contact	<u>Bruce Bennett</u>	Facility Contact	<u>Bruce Bennett</u>
Applicant Phone	<u>(717) 940-6138</u>	Facility Phone	<u>(717) 940-6138</u>
Client ID	<u>40172</u>	Site ID	<u>450332</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>East Drumore Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Lancaster</u>
Date Application Received	<u>September 28, 2023</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>October 5, 2023</u>	If No, Reason	<u></u>
Purpose of Application	<u>NPDES Renewal.</u>		

Summary of Review

Solanco School District has applied to the Pennsylvania Department of Environmental Protection (DEP) for reissuance of its National Pollutant Discharge Elimination System (NPDES) permit. The existing permit was issued May 21, 2019, and became effective on June 1, 2019, authorizing discharge of treated sewage from the facility into UNT to Stewarts Run. The existing permit expiration date was May 31, 2024, and the permit has been administratively extended since that time.

Per the previous fact sheet, this facility is a 0.02 mgd treatment facility that discharges to an intermittent ditch with the point of first use being a spring 150 ft. downstream from the outfall pipe. The UNT 7052 of Stewarts is the closest receiving surface water. The site was initially inspected on August 29, 1989. In March 1997, due to highway reconstruction, the outfall was modified to discharge to the highway's storm drain, which runs along the highway for about 1,200 ft. until reaching a road culvert. The culvert directs the flow into a farmer's pasture where it joins the same UNT that it had discharged to before. Groundwater flow from this culvert is believed to be intermittent and combines about 150 ft. away with another ditch which also contains a possible intermittent spring. The combination of these flows will be considered as an unnamed tributary (UNT) which continues to flow for about 200 ft. through the pasture to UNT to Stewart's Run and 3,500 ft. more to Stewart Run.

Changes in this renewal: E. Coli monitoring has been added to the permit. More stringent ammonia-nitrogen limits have been added to the permit.

Sludge use and disposal description and location(s): Sludge holding tank with offsite disposal.

Supplemental information for this facility is provided at the end of this fact sheet.

Public Participation

Approve	Deny	Signatures	Date
X		Benjamin R. Lockwood Benjamin R. Lockwood / Environmental Engineering Specialist	March 26, 2024
X		Maria D. Bebenek for Daniel W. Martin, P.E. / Environmental Engineer Manager	April 15, 2024

Summary of Review

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.02</u>
Latitude	<u>39° 51' 42.70"</u>	Longitude	<u>-76° 9' 3.18"</u>
Quad Name	<u></u>	Quad Code	<u></u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Unnamed Tributary to Stewart Run (HQ-CWF, MF)</u>	Stream Code	<u>7052</u>
NHD Com ID	<u>57468709</u>	RMI	<u>0.7</u>
Drainage Area	<u>0.52 mi²</u>	Yield (cfs/mi ²)	<u>0.035</u>
Q ₇₋₁₀ Flow (cfs)	<u>0.0183</u>	Q ₇₋₁₀ Basis	<u>USGS PA StreamStats</u>
Elevation (ft)	<u>557</u>	Slope (ft/ft)	<u></u>
Watershed No.	<u>7-K</u>	Chapter 93 Class.	<u>HQ-CWF, MF</u>
Existing Use	<u>N/A</u>	Existing Use Qualifier	<u>N/A</u>
Exceptions to Use	<u>N/A</u>	Exceptions to Criteria	<u>N/A</u>
Assessment Status	<u>Impaired</u>		
Cause(s) of Impairment	<u>Siltation</u>		
Source(s) of Impairment	<u>Agriculture</u>		
TMDL Status	<u>Tentative</u>	Name	<u>Octoraro Creek Watershed TMDL</u>
Nearest Downstream Public Water Supply Intake	<u>Chester Water Authority</u>		
PWS Waters	<u>Octoraro Reservoir</u>	Flow at Intake (cfs)	<u></u>
PWS RMI	<u>21</u>	Distance from Outfall (mi)	<u>9</u>

Changes Since Last Permit Issuance: USGS PA StreamStats provided a drainage area of 0.52 mi² and a Q₇₋₁₀ flow of 0.0183 cfs at the point of discharge.

Other Comments: None

Treatment Facility Summary				
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	SBR	Ultraviolet	0.02
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.02		Not Overloaded	Holding Tank	Other WWTP

Changes Since Last Permit Issuance: The treatment facility consists of: An equalization tank, a sequencing batch reactor, two sand filters, ultraviolet disinfection, Outfall 001 to UNT to Stewarts Run

Other Comments: None

Compliance History	
Summary of DMRs:	A summary of past DMR effluent data is presented on the next page of this fact sheet.
Summary of Inspections:	<p>4/15/2020: An administrative inspection was conducted. Bruce Bennett had contacted DEP regarding concerns related to monitoring flow.</p> <p>4/30/2020: An administrative inspection was conducted. All treatment units were operable, and there were no outstanding issues at the time of inspection.</p> <p>11/3/2021: A routine inspection was conducted. No discharge was occurring during inspection. Field sampling results were within permitted limits. No other issues were noted. The receiving stormwater drain appeared clear.</p>

Other Comments: There are no open violations for this Applicant for the Clean Water Program.

Compliance History

DMR Data for Outfall 001 (from February 1, 2023 to January 31, 2024)

Parameter	JAN-24	DEC-23	NOV-23	OCT-23	SEP-23	AUG-23	JUL-23	JUN-23	MAY-23	APR-23	MAR-23	FEB-23
Flow (MGD) Average Monthly	0.007	0.008	0.007	0.009	0.01	0.007	0.0047	0.01	0.02	0.02	0.007	0.007
Flow (MGD) Daily Maximum	0.02	0.03	0.02	0.02	0.003	0.01	0.01	0.09	0.1	0.09	0.02	0.01
pH (S.U.) Instantaneous Minimum	6.3	6.2	6.0	6.5	6.4	6.7	6.7	6.6	6.5	6.5	6.5	6.5
pH (S.U.) Instantaneous Maximum	8.1	7.6	7.1	7.0	7.0	7.3	7.6	7.2	7.0	7.1	7.2	7.0
DO (mg/L) Instantaneous Minimum	7.2	7.6	7.8	7.1	6.9	6.6	7.0	7.5	7.8	8.5	9.7	9.6
CBOD5 (mg/L) Average Monthly	< 2.0	< 2.5	< 2.7	< 2.0	< 2.0	< 2.0	< 2.3	3.1	3.2	5.2	2.5	3.0
TSS (mg/L) Average Monthly	< 5.0	< 5.0	< 5.5	< 5.0	< 6.0	< 5.0	7.5	6.0	< 5.0	< 8.5	< 5.0	< 5.0
Fecal Coliform (No./100 ml) Geometric Mean	< 1.0	0.20	< 1	< 1.0	< 1	< 1.0	< 1	< 1	< 3.0	< 1	< 1	< 1
Fecal Coliform (No./100 ml) Instantaneous Maximum	< 1.0	411	< 1	< 1.0	1	< 1.0	< 1	< 1	10	< 1	2	< 1
UV Intensity (mW/cm ²) Instantaneous Minimum	2.2	1.8	2.0	3.6	6.3	0.3	0.3	0.2	0.2	0.2	0.3	0.3
Nitrate-Nitrite (lbs/day) Annual Average		55.6										
Nitrate-Nitrite (mg/L) Annual Average		55.6										
Total Nitrogen (lbs/day) Annual Average		< 56.6										
Total Nitrogen (mg/L) Annual Average		< 56.6										

**NPDES Permit Fact Sheet
Solanco High School**

NPDES Permit No. PA0081116

Ammonia (lbs/mo) Total Monthly	< 0.9	< 0.4	< 0.2	< 0.3	< 0.3	0.4	0.4	< 0.3	2	1	< 0.2	< 0.2
Ammonia (mg/L) Average Monthly	< 0.7	< 0.3	< 0.1	< 0.1	< 0.008	< 0.1	0.2	< 0.2	0.1	< 0.1	< 0.4	< 0.1
TKN (lbs/day) Annual Average		< 1.0										
TKN (mg/L) Annual Average		< 1.0										
Total Phosphorus (lbs/day) Annual Average		6.7										
Total Phosphorus (mg/L) Annual Average		6.7										

Existing Effluent Limitations and Monitoring Requirements

Outfall 001

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Instantaneous Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	5.0	XXX	XXX	XXX	1/day	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5)	XXX	XXX	XXX	10.0	XXX	20	2/month	24-Hr Composite
Total Suspended Solids	XXX	XXX	XXX	10.0	XXX	20	2/month	24-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
Ultraviolet light intensity (mW/cm ²)	XXX	XXX	Report	XXX	XXX	XXX	1/day	Recorded
Nitrate-Nitrite as N	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite
Total Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	Calculation
Ammonia-Nitrogen (lbs/mo) Nov 1 - Apr 30	Report Total Mo	XXX	XXX	9.0	XXX	18	2/month	24-Hr Composite
Ammonia-Nitrogen (lbs/mo) May 1 - Oct 31	Report Total Mo	XXX	XXX	3.0	XXX	6	2/month	24-Hr Composite
Total Kjeldahl Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite
Total Phosphorus	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Development of Effluent Limitations

Outfall No.	001	Design Flow (MGD)	.02
Latitude	39° 51' 42.7"	Longitude	76° 9' 3.18"
Wastewater Description: Sewage Effluent			

Technology-Based Limitations

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Water Quality-Based Limitations

CBOD₅, NH₃-N

Pursuant to 40 CFR § 122.44(d)(1)(i), more stringent requirements should be considered when pollutants are discharged at the levels which have the reasonable potential to cause or contribute to excursions above water quality standards.

WQM 7.0 ver. 1.1b is a water quality model designed to assist DEP in determining appropriate water quality based effluent limits (WQBELs) for carbonaceous biochemical oxygen demand (CBOD₅), ammonia (NH₃-N) and dissolved oxygen (D.O.). DEP's Technical Guidance No. 391-2000-007 provides the technical methods contained in WQM 7.0 for determining wasteload allocations and for determining recommended NPDES effluent limits for point source discharges. The model was utilized for this permit renewal. The model output indicated a CBOD₅ average monthly limit of 25 mg/l, an NH₃-N average monthly limit of 2.8 mg/l, and a D.O. minimum limit of 5.0 mg/l were protective of water quality. The flow data used to run the model was acquired from USGS PA StreamStats and is included as an attachment. The existing CBOD₅ limit of 10 mg/l is more stringent and will remain in the permit. The NH₃-N limit of 2.8 mg/l is more stringent, and will be included in the renewal permit.

There are no industrial/commercial users contributing industrial wastewater to the system and Solanco School District does not currently have an EPA-approved pretreatment program. Accordingly, evaluating reasonable potential of toxic pollutants is not necessary as effluent levels of toxic pollutants are expected to be insignificant.

Additional Considerations

Chesapeake Bay Total Maximum Daily Load (TMDL)

DEP developed a strategy to comply with the EPA and Chesapeake Bay Foundation requirements by reducing point source loadings of Total Nitrogen (TN) and Total Phosphorus (TP). This strategy can be located in the *Pennsylvania Chesapeake Watershed Implementation Plan (WIP)*, dated January 11, 2011. Subsequently, an update to the WIP was published as the Phase 2 WIP. As part of the Phase 2 WIP, a *Phase 2 Watershed Implementation Plan Wastewater Supplement (Phase 2 Supplement)* was developed, providing an update on TMDL implementation for point sources and DEP's current implementation strategy for wastewater. A new update to the WIP was published as the Phase 3 WIP in August 2019. As

part of the Phase 3 WIP, a *Phase 3 Watershed Implementation Plan Wastewater Supplement* (Phase 3 Supplement) was developed, and was most recently revised on December 17, 2019, and is the basis for the development of any Chesapeake Bay related permit parameters. Sewage discharges have been prioritized based on their design flow to the Bay. The highest priority (Phases 1, 2, and 3) dischargers will receive annual Cap Loads based on their design flow on August 29, 2005 and concentrations of 6 mg/l TN and 0.8 mg/l TP. These limits may be achieved through a combination of treatment technology, credits, or offsets. For Phase 4 and 5 facilities, Cap Loads are not currently being implemented for renewed or amended permits for facilities that do not increase design flow.

This facility is considered a Phase 5 non-significant facility with a design flow less than 0.2 MGD but greater than 0.002 MGD. According to the Phase 3 WIP, TN and TP monitoring is recommended for this facility, which is consistent with the existing permit.

Octoraro Creek TMDL

There is a draft TMDL for the Octoraro Creek watershed for nutrients and siltation. This facility may be subject to effluent limitations in the future when the TMDL is finalized.

Dissolved Oxygen

A minimum D.O. limit of 5.0 mg/L is a D.O. water quality criterion found in 25 Pa. Code § 93.7(a). This limit is included in the existing NPDES permit based BPJ. It is still recommended to include this limit in the draft permit to ensure that the facility continues to achieve compliance with DEP water quality standards.

Fecal Coliform

PA Code § 92a.47.(a)(4) requires a monthly average limit of 200/100 mL as a geometric mean and an instantaneous maximum limit not greater than 1,000/100 mL from May through September for fecal coliform. PA Code § 92a.47.(a)(5) requires a monthly average limit of 2,000/100 mL as a geometric mean and an instantaneous maximum limit not greater than 10,000/100 mL from October through April for fecal coliform. This is consistent with the existing permit limits.

E. Coli

PA Code § 92a.61 requires IMAX reporting of E. Coli. Per DEP's SOP No. BCW-PMT-033, sewage dischargers with a design flow of 0.002 – 0.05 mgd will include E. Coli monitoring with a frequency of 1/year. This parameter has been added to the renewal permit.

Ultraviolet (UV) Monitoring

DEP's SOP No. BPNPSM-PMT-033 recommends at a minimum, routine monitoring of UV transmittance, dosage, or intensity when the facility is utilizing a UV disinfection system. The monitoring should occur at the same frequency as would be used for TRC. Presumably, this recommendation was implemented as a part of the proper operation and maintenance requirement specified in Part B of the NPDES permit, requesting permittees to demonstrate the effectiveness of UV disinfection system. The existing permit contains a monitoring requirement for UV intensity, which is consistent with this recommendation.

Sampling Frequency & Sample Type

The monitoring requirements were established based on BPJ and/or Table 6-3 of DEP's Technical Guidance No. 362-0400-001.

Anti-Degradation

The effluent limits for this discharge have been developed to ensure that existing instream water uses and the level of water quality necessary to protect the existing uses are maintained and protected. No High Quality Waters are impacted by this discharge. No Exceptional Value Waters are impacted by this discharge.

303(d) Listed Streams

The discharge is located on a stream segment that is designated on the 303(d) list as impaired. There is an aquatic life impairment for siltation due to agriculture.

Class A Wild Trout Fisheries

No Class A Wild Trout Fisheries are impacted by this discharge.

Anti-Backsliding

Pursuant to 40 CFR § 122.44(l)(1), all proposed permit requirements addressed in this fact sheet are at least as stringent as the requirements implemented in the existing NPDES permit unless any exceptions are addressed by DEP in this fact sheet.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (386-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Instantaneous Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	5.0	XXX	XXX	XXX	1/day	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20	2/month	24-Hr Composite
TSS	XXX	XXX	XXX	10.0	XXX	20	2/month	24-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	XXX	Report	1/year	Grab
UV Intensity (mW/cm ²)	XXX	XXX	Report	XXX	XXX	XXX	1/day	Recorded
Nitrate-Nitrite	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite
Total Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	Calculation
Ammonia (lbs/mo) Nov 1 - Apr 30	Report Total Mo	XXX	XXX	8.4	XXX	16.8	2/month	24-Hr Composite
Ammonia (lbs/mo) May 1 - Oct 31	Report Total Mo	XXX	XXX	2.8	XXX	5.6	2/month	24-Hr Composite
TKN	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite


Outfall 001 , Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Instantaneous Minimum	Average Monthly	Maximum	Instant. Maximum		
Total Phosphorus	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	1/year	24-Hr Composite

Compliance Sampling Location: Outfall 001


Other Comments: None

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input checked="" type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input checked="" type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: BCW-PMT-033
<input type="checkbox"/>	Other: [redacted]

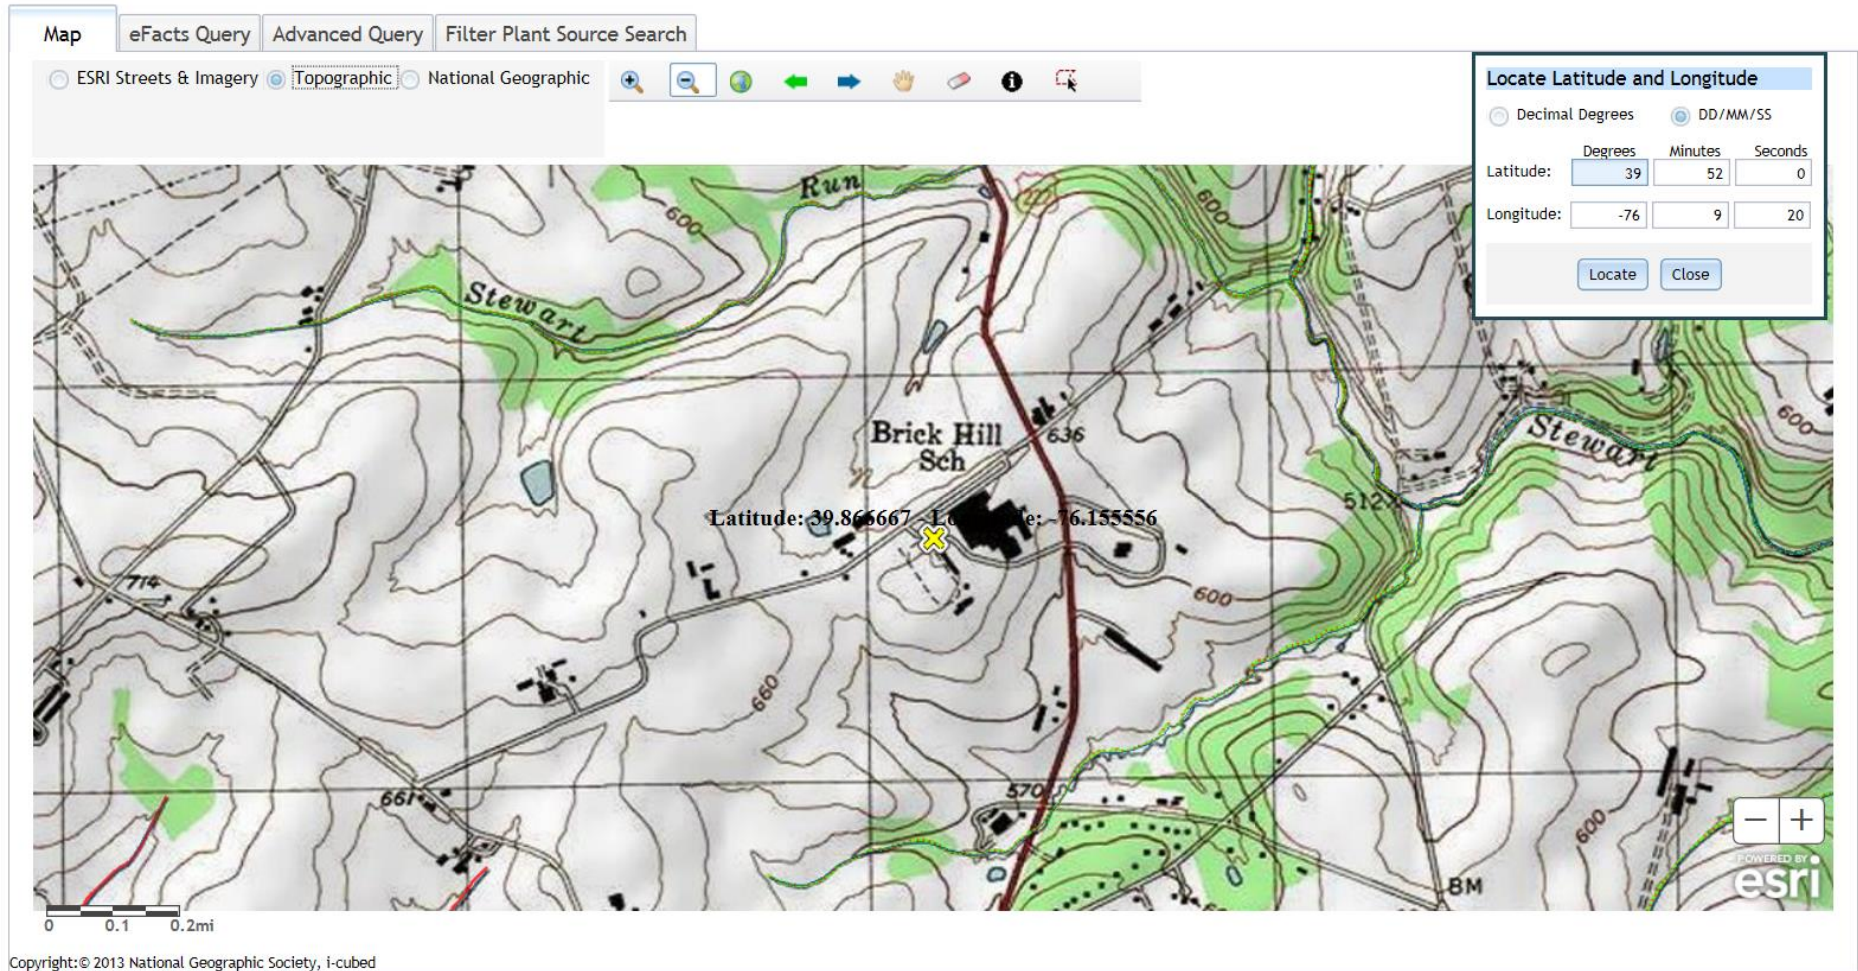

Solanco High School PA0081116 Outfall 001

Region ID: PA
 Workspace ID: PA20240326152130779000
 Clicked Point (Latitude, Longitude): 39.86172, -76.15120
 Time: 2024-03-26 11:21:56 -0400

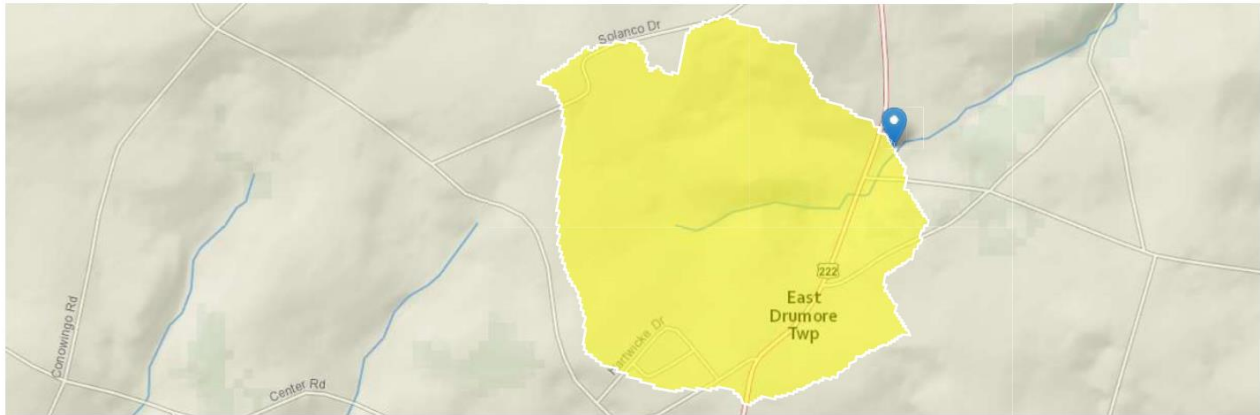

[-] Collapse All

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
BSLOPD	Mean basin slope measured in degrees	2.4001	degrees
DRNAREA	Area that drains to a point on a stream	0.52	square miles
ROCKDEP	Depth to rock	5	feet
URBAN	Percentage of basin with urban development	0.1327	percent

Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	0.52	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	2.4001	degrees	1.7	6.4
ROCKDEP	Depth to Rock	5	feet	4.13	5.21
URBAN	Percent Urban	0.1327	percent	0	89

Low-Flow Statistics Disclaimers [Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.0545	ft ³ /s
30 Day 2 Year Low Flow	0.0811	ft ³ /s
7 Day 10 Year Low Flow	0.0183	ft ³ /s
30 Day 10 Year Low Flow	0.0289	ft ³ /s
90 Day 10 Year Low Flow	0.0628	ft ³ /s

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.


USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.19.4
StreamStats Services Version: 1.2.22
NSS Services Version: 2.2.1

Solonco School District PA0081116 RMI = 0.0

Region ID: PA
Workspace ID: PA20240326152341113000
Clicked Point (Latitude, Longitude): 39.86718, -76.14135
Time: 2024-03-26 11:24:03 -0400

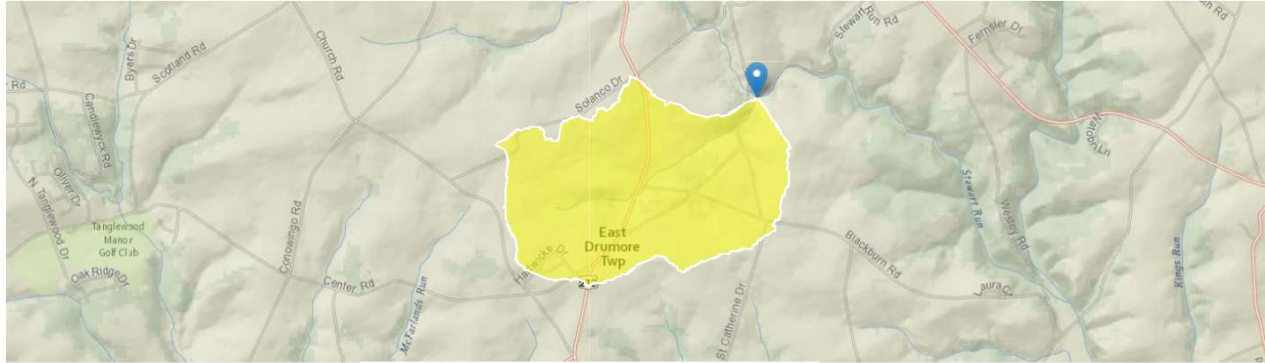

Collapse All

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
BSLOPD	Mean basin slope measured in degrees	2.9664	degrees
DRNAREA	Area that drains to a point on a stream	1.07	square miles
ROCKDEP	Depth to rock	5	feet
URBAN	Percentage of basin with urban development	0.3885	percent

Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 1]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	1.07	square miles	4.78	1150
BSLOPD	Mean Basin Slope degrees	2.9664	degrees	1.7	6.4
ROCKDEP	Depth to Rock	5	feet	4.13	5.21
URBAN	Percent Urban	0.3885	percent	0	89

Low-Flow Statistics Disclaimers [Low Flow Region 1]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 1]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.148	ft ³ /s
30 Day 2 Year Low Flow	0.209	ft ³ /s
7 Day 10 Year Low Flow	0.0555	ft ³ /s
30 Day 10 Year Low Flow	0.0824	ft ³ /s
90 Day 10 Year Low Flow	0.159	ft ³ /s

Low Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material, nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.19.4
StreamStats Services Version: 1.2.22
NSS Services Version: 2.2.1

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	7052	Trib 07052 to Stewart Run	0.700	557.00	0.52	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Tributary pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.100	0.00	0.02	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Solanco High	PA0081116	0.0200	0.0200	0.0200	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	7052	Trib 07052 to Stewart Run	0.000	501.00	1.07	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Tributary pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.100	0.00	0.06	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	3.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

WQM 7.0 Hydrodynamic Outputs

<u>SWP Basin</u>		<u>Stream Code</u>				<u>Stream Name</u>						
07K		7052				Trib 07052 to Stewart Run						
RMI	Stream Flow (cfs)	PWS With (cfs)	Net Stream Flow (cfs)	Disc Analysis Flow (cfs)	Reach Slope (ft/ft)	Depth (ft)	Width (ft)	W/D Ratio	Velocity (fps)	Reach Trav Time (days)	Analysis Temp (°C)	Analysis pH
Q7-10 Flow												
0.700	0.02	0.00	0.02	.0309	0.01515	.312	3.2	10.25	0.05	0.868	23.14	7.00
Q1-10 Flow												
0.700	0.01	0.00	0.01	.0309	0.01515	NA	NA	NA	0.05	0.941	23.63	7.00
Q30-10 Flow												
0.700	0.02	0.00	0.02	.0309	0.01515	NA	NA	NA	0.05	0.809	22.77	7.00

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		

WQM 7.0 Wasteload Allocations

SWP Basin **Stream Code** **Stream Name**
07K 7052 Trib 07052 to Stewart Run

NH3-N Acute Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
0.700	Solanco High	12.41	17.11	12.41	17.11	0	0

NH3-N Chronic Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
0.700	Solanco High	1.58	2.85	1.58	2.85	0	0

Dissolved Oxygen Allocations

RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
0.70	Solanco High	25	25	2.85	2.85	5	5	0	0

WQM 7.0 D.O.Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07K	7052	Trib 07052 to Stewart Run		
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
0.700	0.020	23.142	7.000	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
3.201	0.312	10.252	0.049	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
16.45	1.354	1.79	0.891	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
6.205	26.796	Owens	5	
<u>Reach Travel Time (days)</u>	Subreach Results			
0.868	<u>TravTime (days)</u>	<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.087	14.36	1.66	6.99
	0.174	12.54	1.53	7.24
	0.260	10.95	1.42	7.41
	0.347	9.56	1.31	7.56
	0.434	8.34	1.22	7.68
	0.521	7.29	1.12	7.79
	0.608	6.36	1.04	7.79
	0.695	5.55	0.96	7.79
	0.781	4.85	0.89	7.79
	0.868	4.23	0.83	7.79

WQM 7.0 Effluent Limits

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>					
07K	7052	Trib 07052 to Stewart Run					
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
0.700	Solanco High	PA0081116	0.020	CBOD5	25		
				NH3-N	2.85	5.7	
				Dissolved Oxygen			5