



Application Type

Renewal

Facility Type

Non-Municipal

Major / Minor

Minor

Application No.

PA0082571

APS ID

20031

Authorization ID

1515081

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SEWAGE**

**Applicant and Facility Information**

Applicant Name	<b>West Penn District Grace Brethren Men Inc.</b>	Facility Name	<b>Camp Mantowagan</b>
Applicant Address	2671 Camp Lane, PO Box 95	Facility Address	2671 Camp Lane, PO Box 95
	Saxton, PA 16678-0095		Saxton, PA 16678
Applicant Contact	Lee Strappello	Facility Contact	Lee Strappello
Applicant Phone	(814) 658-3815	Facility Phone	(814) 658-3815
Client ID	43844	Site ID	452667
Ch 94 Load Status	Not Overloaded	Municipality	Todd Township
Connection Status		County	Huntingdon
Date Application Received	February 3, 2025	EPA Waived?	Yes
Date Application Accepted	February 7, 2025	If No, Reason	
Purpose of Application	NPDES permit renewal.		

**Summary of Review**

Camp Mantowagan facility is owned and operated by West Penn District Grace Brethren Men, Inc. in Todd Township, Huntingdon County. The facility is a church bible camp which normally operates during the summer months which is the only time a discharge can be expected. Some weekend retreats are also possible during the year.

West Penn District Grace Brethren Men, Inc. has applied to the Pennsylvania Department of Environmental Protection (DEP) for reissuance of its NPDES permit. The permit was last reissued on August 25, 2020, and became effective on September 1, 2020. The permit expires on August 31, 2025.

The facility has a design flow capacity of 0.007 MGD, and discharges to an ephemeral swale that empties into Tatman Run (HQ-CWF, MF). The discharge to a HQ stream is justified, since the outfall pre-dates the HQ classification of the stream. In 1993, it was determined by the aquatic biologists that the point of first use is at the confluence of the swale with Tatman Run. The discharge is to an ephemeral swale; however, since a new or expanding discharge is not proposed, the *Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers*, revised April 12, 2008, will not be considered.

Sludge use and disposal description and location(s): N/A because sludge hauling by Smith's Septic Service.

Changes from the previous permit: The E. Coli monitoring and report requirements will be added to the proposed permit.

Based on the review outline in this fact sheet, it is recommended that the permit be drafted and published in the Pennsylvania Bulletin for public comments for 30 days.

Approve	Deny	Signatures	Date
X		Hilaryle Hilary H. Le / Environmental Engineering Specialist	August 8, 2025
x		Maria D. Bebenek for Daniel W. Martin, P.E. / Environmental Engineer Manager	September 18, 2025

**Discharge, Receiving Waters and Water Supply Information**

Outfall No.	001	Design Flow (MGD)	0.007
Latitude	40° 15' 49.56"	Longitude	-78° 10' 54.19"
Quad Name	Entriken	Quad Code	
Wastewater Description:	Sewage Effluent		

Receiving Waters	Tatman Run (HQ-CWF, MF)	Stream Code	13653
NHD Com ID	65841673	RMI	4.5
Drainage Area	0.41 mi. <sup>2</sup>	Yield (cfs/mi <sup>2</sup> )	See comments below
Q <sub>7-10</sub> Flow (cfs)	See comments below	Q <sub>7-10</sub> Basis	USGS StreamStats
Elevation (ft)	1298.3	Slope (ft/ft)	
Watershed No.	11-D	Chapter 93 Class.	HQ-CWF, MF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment			
Source(s) of Impairment			
TMDL Status		Name	

Nearest Downstream Public Water Supply Intake	U. S. Army Corps. Of Engineers – Raystown Lake		
PWS Waters	Raystown Branch Juniata River	Flow at Intake (cfs)	
PWS RMI	5.5 miles	Distance from Outfall (mi)	Approximate 27 miles

Changes Since Last Permit Issuance:

**Drainage Area**

The discharge is to Tatman Run at RMI 4.5 miles. A drainage area upstream of the discharge is estimated to be 0.41 mi.<sup>2</sup>, according to USGS PA StreamStats available at <https://streamstats.usgs.gov/ss/>.

**Stream Flow**

There is no gage station on Tatman Run to accurately determine Q<sub>7-10</sub> flow. Therefore, Streamflow will be correlated with past streamflow records taken from the nearby USGS gage station on the Raystown Branch Juniata River, Huntingdon county. The Q<sub>7-10</sub> is 143 cfs and the drainage area is 991 mi.<sup>2</sup> (according to USGS PA StreamStats available at <https://streamstats.usgs.gov/ss/>) which results in a Q<sub>7-10</sub> low flow yield of 0.14 cfs/mi.<sup>2</sup>. This information is used to obtain a chronic or 30-day (Q<sub>30-10</sub>), and an acute or 1-day (Q<sub>1-10</sub>) exposure stream flow for the discharge point as follows (Guidance No. 391-2000-023):

$$\begin{aligned}
 \text{Low Flow Yield} &= 143 \text{ cfs} / 991 \text{ mi.}^2 \approx 0.14 \text{ cfs/mi.}^2 \\
 \text{Q}_{7-10} \text{ discharge} &= 0.14 \text{ cfs/mi.}^2 \times \text{D.A discharge} = 0.14 \text{ cfs/mi.}^2 \times 0.41 \text{ mi.}^2 = 0.06 \text{ cfs} \\
 \text{Q}_{30-10} &= 1.36 * 0.06 \text{ cfs} \approx 0.08 \text{ cfs} \\
 \text{Q}_{1-10} &= 0.64 * 0.06 \text{ cfs} \approx 0.04 \text{ cfs}
 \end{aligned}$$

**Tatman Run**

Under 25 Pa Code § 93.9n, the Tatman Run is designated as High Quality-Cold Water & Migratory Fishes during the permit cycle. Integrated Report 2024, Tatman Run, assessment unit ID 6983, is not impaired. A TMDL currently does not exist for this stream segment, therefore, no TMDL has been taken into consideration during this review.

**Public Water Supply:**

The nearest downstream public water supply intake is the U.S. Army Corps of Engineers on the Raystown Branch Juniata River, approximately 27 miles from the point of discharge. Given the nature and dilution, the discharge is not expected to impact the water supply.

Treatment Facility Summary				
<b>Treatment Facility Name:</b> Camp Mantowagan				
<b>WQM Permit No.</b>	<b>Issuance Date</b>			
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Septic Tank Sand Filter	Hypochlorite	
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.007		Not Overloaded	Anaerobic Digestion	Combination of methods

Changes Since Last Permit Issuance:

Other Comments:

The process consists of 3 septic tanks, 3 media filters, one chlorine contact tank, discharge.

Chlorine is used for disinfection.

Compliance History	
<b>Summary of DMRs:</b>	DMRs reported last 12 months are summarized in the next page.
<b>Summary of Inspections:</b>	7/31/2024: Mr. Clark, DEP WQS, conducted a compliance evaluation inspection. The discharge was clear. The field test results indicated in permit limits. There were no violations indicate during inspection.
<b>Other Comments:</b>	There are currently no open violations associated with the permittee or the facility.

Other Comments: 

Compliance History

DMR Data for Outfall 001 (from July 1, 2024 to June 30, 2025)

Parameter	JUN-25	MAY-25	APR-25	MAR-25	FEB-25	JAN-25	DEC-24	NOV-24	OCT-24	SEP-24	AUG-24	JUL-24
Flow (MGD) Average Monthly	0.0028										0.0027	0.004
Flow (MGD) Daily Maximum	0.007										0.006	0.007
pH (S.U.) Daily Minimum	6.1										7.1	7.0
pH (S.U.) Instantaneous Maximum	6.9										7.5	7.3
DO (mg/L) Daily Minimum	5.45										6.58	5.61
TRC (mg/L) Average Monthly	0.27										0.39	0.62
TRC (mg/L) Instantaneous Maximum	0.50										0.61	1.40
CBOD5 (mg/L) Average Monthly	11										< 3	< 3
TSS (mg/L) Average Monthly	< 4										< 2	< 2
Fecal Coliform (No./100 ml) Geometric Mean	< 29										< 2	< 49
Fecal Coliform (No./100 ml) Instantaneous Maximum	866.4										< 4	2419.6
Nitrate-Nitrite (mg/L) Average Monthly	45.98										< 49.09	65.52
Total Nitrogen (mg/L) Average Monthly	53.102										< 49.59	66.02
Ammonia (mg/L) Average Monthly	15.6										0.8	< 0.4
TKN (mg/L) Average Monthly	7.127										< 2.8	< 0.5
Total Phosphorus (mg/L) Average Monthly	1.59										2.06	2.07

Existing Effluent Limitations and Monitoring Requirements

Outfall 001

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	1/day	Estimate
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
D.O.	XXX	XXX	5.0	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.44	XXX	1.45	1/day	Grab
CBOD <sub>5</sub>	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
TSS	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/month	Grab
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/month	Grab
Ammonia May 1 - Oct 31	XXX	XXX	XXX	9	XXX	18	2/month	8-Hr Composite
Ammonia Nov 1 - Apr 30	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
TKN	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Nitrate-Nitrite	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	2/month	Calculation

**Development of Effluent Limitations**

Outfall No. 001  
Latitude 40° 15' 49.56"  
Wastewater Description: Sewage Effluent

Design Flow (MGD) 0.007  
Longitude -78° 10' 54.19"

**Technology-Based Limitations**

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD <sub>5</sub>	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Comments:

**Water Quality-Based Limitations**

**Ammonia (NH<sub>3</sub>-N):**

NH<sub>3</sub>N calculations are based on the Department's Implementation Guidance of Section 93.7 Ammonia Criteria, dated 11/4/97 (ID No. 391-2000-013). The following data is necessary to determine the in-stream NH<sub>3</sub>-N criteria used in the attached WQM 7.0 computer model of the stream:

\* Discharge pH = 7.0 (Default)  
\* Discharge Temperature = 20°C (Default)  
\* Stream pH = 7.0 (Default)  
\* Stream Temperature = 20°C (Default for CWF)  
\* Background NH<sub>3</sub>-N = 0 mg/L (Default)

Analysis Results WQM 7.0

Hydrodynamics NH3-N Allocations D.O. Allocations D.O. Simulation Effluent Limitations

RMI	Discharge Name	Permit Number	Disc Flow (mgd)
4.50	West Penn Dist.	PA0082571	0.0070
Parameter	Effluent Limit 30 Day Average (mg/L)	Effluent Limit Maximum (mg/L)	Effluent Limit Minimum (mg/L)
CBOD5	25		
NH3-N	15.49	30.98	5
Dissolved Oxygen			

Record: 1 of 1 < Back Next > No Filter Search

Print Archive Cancel

The attached printout of the WQM 7.0 data indicates that at a discharge of 0.007 MGD, limits of 15.49mg/L NH<sub>3</sub>-N as a monthly average and 30.98 mg/L NH<sub>3</sub>-N instantaneous maximum (IMAX) are necessary to protect the aquatic life from toxicity effects. The more stringent existing summer limits 9.0 mg/L for monthly average & 18.0 mg/L for IMAX will remain in the proposed permit.

Also, the NH<sub>3</sub>-N winter effluent limit will be 25.0 for average monthly and 50.0 for IMAX will remain in the proposed permit. Past DMR data showed that the discharge consistently contains NH<sub>3</sub>-N levels less than 6.0 mg/L. Additionally, the facility has consistently been achieving concentrations well below these limits.

**Dissolved Oxygen (D.O.):**

A minimum D.O. of 5.0 mg/L is required per 25 Pa. Code § 93.7. This is consistent with the previous permit and current Department criteria.

**Carbonaceous Biochemical Oxygen Demand (CBOD<sub>5</sub>):**

The attached computer printout of the WQM 7.0 stream model indicates that a monthly average limit of 25.0 mg/L, or secondary treatment, is adequate to protect the water quality of the stream. However, the existing limits of 25 mg/L monthly average, and 50.0 mg/L instantaneous maximum (IMAX) will remain in the proposed permit as per guidance document 391-2000-014. Recent DMRs and inspection reports show that the facility has been consistently achieving these limits.

**Total Suspended Solids (TSS):**

The existing technology-based limits of 30.0 mg/L average monthly, and 60.0 mg/L instantaneous maximum will remain in the proposed permit based on the minimum level of effluent quality attainable by secondary treatment based on 25 Pa. Code § 92a.47. Recent DMRs and inspection reports show that the facility has been consistently achieving these limits.

**pH:**

The effluent discharge pH should remain above 6 and below 9 standard units according to 25 Pa Code § 95.2(1).

**Fecal Coliform:**

The recent coliform guidance in 25 Pa. Code § 92a.47.(a)(4) requires a summer technology limit of 200/100 ml as a geometric mean and an instantaneous maximum not greater than 1,000/100 ml and 25 Pa Code § 92a.47.(a)(5) requires a winter limit of 2,000/100 ml as a geometric mean and an instantaneous maximum not greater than 10,000/100 ml.

**E. Coli:**

As recommended by DEP's SOP No. BCW-PMT-033, version 2.0 revised February 5, 2024, a routine monitoring for E. Coli will be included in the proposed permit under 25 Pa. Code § 92a.61. This requirement applies to all sewage dischargers greater than 0.002 MGD in their new and reissued permits. A monitoring frequency of 1/year will be included in the permit to be consistent with the recommendation from this SOP.

**Chesapeake Bay Strategy:**

The Department formulated a strategy to comply with the EPA and Chesapeake Bay Foundation requirements by reducing point source loadings of Total Nitrogen (TN) and Total Phosphorus (TP). Sewage discharges have been prioritized by Central Office based on their delivered TN loadings to the Bay. The highest priority (Phases I, II, and III) dischargers will receive annual loading caps based on their design flow on August 29, 2005 and concentrations of 6 mg/L TN and 0.8 mg/L TP. These limits may be achieved through a combination of treatment technology, credits, or offsets. Phase IV (0.2 -0.4 MGD) will be required to monitor and report TN and TP during permit renewal monthly and Phase V (below 0.2 MGD) will monitor during current permit renewal once a year. However, any facility in Phases IV and V that undergoes expansion is subjected to cap load right away. This plant is classified as a phase V, and will be required to monitor and report for Total Phosphorus, Nitrate-Nitrite as N, Total Kjeldahl Nitrogen, and Total Nitrogen. Two per month monitoring frequency for discharge will remain in the proposed permit.

**Stormwater:**

There is no stormwater outfall associated with this facility.

**Toxic:**

This is a minor sewage facility receiving domestic wastewater only and the current application does not require sampling of toxic pollutants (or heavy metals) for those facilities with design flows less than 0.1 MGD. Therefore, no reasonable potential analysis for toxic pollutants has been performed for this permit renewal.

**Total Residual Chlorine (TRC):**

The attached TRC Excel Spreadsheet calculator, which uses the equations and calculations from the Department's May 1, 2003 Implementation Guidance for Total Residual Chlorine (ID No. 391-2000-015), the monthly average limit of 0.5

mg/L and an instantaneous maximum limit of 1.6 mg/L. The more stringent existing permit limits of 0.44 mg/L average monthly and 1.45 mg/L instantaneous maximum will remain in the proposed permit. Past DMRs reports showed that the facility has been consistently achieving these limits.

TRC EVALUATION							
Input appropriate values in A3:A9 and D3:D9							
0.06	= Q stream (cfs)	0.5	= CV Daily				
0.007	= Q discharge (MGD)	0.5	= CV Hourly				
30	= no. samples	1	= AFC_Partial Mix Factor				
0.3	= Chlorine Demand of Stream	1	= CFC_Partial Mix Factor				
0	= Chlorine Demand of Discharge	15	= AFC_Criteria Compliance Time (min)				
0.5	= BAT/BPJ Value	720	= CFC_Criteria Compliance Time (min)				
0	= % Factor of Safety (FOS)		= Decay Coefficient (K)				
Source	Reference	AFC Calculations	Reference	CFC Calculations			
TRC	1.3.2.iii	WLA_afc = 1.786	1.3.2.iii	WLA_cfc = 1.734			
PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373	5.1c	LTAMULT_cfc = 0.581			
PENTOXSD TRG	5.1b	LTA_afc = 0.666	5.1d	LTA_cfc = 1.008			
Source	Effluent Limit Calculations						
PENTOXSD TRG	5.1f	AML MULT = 1.231					
PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.500		BAT/BPJ			
		INST MAX LIMIT (mg/l) = 1.635					
WLA_afc	$(.019/e(-k*AFC_tc)) + [(AFC_Yc*Qs*.019/Qd*e(-k*AFC_tc))... \\ ... + Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$						
LTAMULT_afc	$\text{EXP}((0.5*\text{LN}(\text{cvh}^2+1))-2.326*\text{LN}(\text{cvh}^2+1)^0.5)$						
LTA_afc	wla_afc*LTAMULT_afc						
WLA_cfc	$(.011/e(-k*CFC_tc)) + [(CFC_Yc*Qs*.011/Qd*e(-k*CFC_tc))... \\ ... + Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$						
LTAMULT_cfc	$\text{EXP}((0.5*\text{LN}(\text{cvd}^2/\text{no\_samples}+1))-2.326*\text{LN}(\text{cvd}^2/\text{no\_samples}+1)^0.5)$						
LTA_cfc	wla_cfc*LTAMULT_cfc						
AML MULT	$\text{EXP}(2.326*\text{LN}((\text{cvd}^2/\text{no\_samples}+1)^0.5)-0.5*\text{LN}(\text{cvd}^2/\text{no\_samples}+1))$						
AVG MON LIMIT	MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)*AML_MULT)						
INST MAX LIMIT	$1.5*((\text{av\_mon\_limit}/\text{AML\_MULT})/\text{LTAMULT\_afc})$						

#### Antidegradation (93.4):

The effluent limits for this discharge have been developed to ensure that the existing instream water used and the level of water quality necessary to protect the existing uses are maintained and protected. The basin is classified as a HQ-CWF. The discharge pre-dates the Chapter 93 designation of HQ-CWF and is not expected to impact the stream.

#### 303d Listed Streams:

The discharge is not located on a 303d listed stream segment.

#### Class A Wild Trout Fisheries:

No Class A Wild Trout Fisheries are impacted by this discharge.

\* Discharge pH = 7.0 (Default)  
\* Discharge Temperature = 20°C (Default)  
\* Stream pH = 7.0 (Default)  
\* Stream Temperature = 20°C (Default for CWF)  
\* Background NH<sub>3</sub>-N = 0 mg/L (Default)

Node 1: Outfall 001 on Tatman Run (13653)

Elevation: 1298.3 ft (USGS National Map Viewer)  
Drainage Area: 0.41 mi.<sup>2</sup> (USGS PA StreamStats)  
River Mile Index: 4.5 (PA DEP eMapPA)  
Low Flow Yield: 0.14 cfs/mi.<sup>2</sup>  
Discharge Flow: 0.007 MGD (NPDES Application)

Node 2: Just before confluence Trib. 13670 to Tatman Run

Elevation: 1232.26 ft (USGS National Map Viewer)  
Drainage Area: 1.3 mi.<sup>2</sup> (USGS PA StreamStats)  
River Mile Index: 3.9 (PA DEP eMapPA)  
Low Flow Yield: 0.14 cfs/mi.<sup>2</sup>  
Discharge Flow: 0.000 MGD

Analysis Results WQM 7.0

Hydrodynamics NH3-N Allocations D.O. Allocations D.O. Simulation Effluent Limitations

RMI	Discharge Name	Permit Number Disc Flow (mgd)		
		30 Day Average	Maximum	Minimum
4.50	West Penn Dist.	PA0082571	0.0070	
Parameter	Effluent Limit (mg/L)	Effluent Limit (mg/L)	Effluent Limit (mg/L)	
CBOD5	25			
NH3-N	15.49	30.98		
Dissolved Oxygen			5	

Record: < Back 1 of 1 Next > No Filter Search

Print < Back Next > Archive Cancel

NPDES Permit Fact Sheet  
Camp Mantowagan

NPDES Permit No. PA0082571

rptEffLimits

**WQM 7.0 Effluent Limits**

SWP Basin	Stream Code	Stream Name
11D	13463	TATMAN RUN

RM#	Name	Permit Number	Disc. P. (mg/L)	Parameter	Eff. Unit	30-day Avg. (mg/L)	Eff. Limit Maximum (mg/L)	Eff. Limit Minimum (mg/L)
4,500	West Penn Dist.	PA0082571	0.007	CBOD5	25			
				NH3N	15.49	30.96		
				Dissolved Oxygen	5			

Wednesday, August 6, 2025 Version 1.1 Page 1 of 1

rpt\_WLA

**WQM 7.0 Wasteload Allocations**

SWP Basin	Stream Code	Stream Name
11D	13463	TATMAN RUN

NH3-N Acute Allocations						
RM#	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach
4,500	West Penn Dist.	16.76	50	16.16	50	0

NH3-N Chronic Allocations						
RM#	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach
4,500	West Penn Dist.	1.69	15.49	1.69	15.49	0

Dissolved Oxygen Allocations						
RM#	Discharge Name	CBOD5 Baseline Multiple (mg/L)	NH3N Baseline Multiple (mg/L)	Dissolved Oxygen Baseline Multiple (mg/L)	CBOD5 Critical Reach	Percent Reduction
4,500	West Penn Dist.	25	25	5	5	0

Wednesday, August 6, 2025 Version 1.1 Page 1 of 1

rptDOSim

**WQM 7.0 D.O. Simulation**

SWP Basin	Stream Code	Stream Name
11D	13463	TATMAN RUN

RM#	Total Discharge Flow (mg/s)	Analysis Temperature (°C)	Available DO
4,500		20.000	7.000
Reach Width (ft)	Reach Depth (ft)	Reach WDRatio	Reach Velocity (fts)
3,201	0.333		0.061
Reach CBOD5 (mg/L)	Reach Kc (1/day)	Reach NH3-N (mg/L)	Reach Rn (1/day)
5,65	0.900	2.66	0.700
Reach DO (mg/L)	Reach Rn (1/day)	Kr Equation	Reach DO Goal (mg/L)
7.726	26.268	Over	5
Reach Travel Time (days)			
0.072			
Substrate Results			
	Time	CBOD5 (mg/L)	NH3-N (mg/L)
	(days)	(mg/L)	(mg/L)
0.057	5.36	2.36	0.24
0.115	5.08	2.27	0.24
0.172	4.89	2.18	0.24
0.229	4.69	2.09	0.24
0.287	4.49	2.01	0.24
0.344	4.29	1.93	0.24
0.401	3.99	1.85	0.24
0.458	3.70	1.76	0.24
0.516	3.39	1.71	0.24
0.573	3.00	1.65	0.24

Wednesday, August 6, 2025 Version 1.1 Page 1 of 1

rptModelSpecs

**WQM 7.0 Modeling Specifications**

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flow:
WIA Method	EMPR	<input checked="" type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	<input type="checkbox"/>
D.O. Saturation	90.00%	<input checked="" type="checkbox"/>
D.O. Goal	5	<input checked="" type="checkbox"/>

Wednesday, August 6, 2025 Version 1.1 Page 1 of 1

NPDES Permit Fact Sheet  
Camp Mantowagan

NPDES Permit No. PA0082571

**rptHydro**

**WQM 7.0 Hydrodynamic Outputs**

SWP Basin		Stream Code		Stream Name		WQM 7.0 Hydrodynamic Outputs									
SWP	Basin	Stream	Code	Reach	Slope	Depth	Width	WD	Velocity	Reach	Trav	Analysis	Temp	Analysis	pH
Flow	(dL/s)	Flow	(cfs)	Flow	(ft)	(ft)	(ft)	Ratio	(fps)	Time	(days)	(°C)	(°C)	(°C)	(°C)
<b>Q7-10 Flow</b>	4,000	0.00	0.06	.0108	0.02085	333	3.2	9.61	0.06	0.573	20.00	7.00			
<b>Q1-10 Flow</b>	4,000	0.00	0.06	.0108	0.02085	NA	NA	NA	0.05	0.701	20.00	7.00			
<b>Q30-10 Flow</b>	4,000	0.08	0.00	0.08	.0108	0.02085	NA	NA	NA	0.07	0.691	20.00	7.00		

Wednesday, August 6, 2025      Version 1.1      Page 1 of 1

**rptGeneral**

**Input Data WQM 7.0**

SWP Basin		Stream Code		Stream Name		RIM	Elevation	Drainage	Slope	PWS	Apply
SWP	Basin	Stream	Code	Reach	Slope	(ft)	(ft)	Area	(ft)	Withdrawal	FC
	11D	13003	TATMAN RUN			3,900	298.30	0.41	0.000000	0.00	<input checked="" type="checkbox"/>
<b>Stream Data</b>											
Design	LFY	Trib	Stream	Rich	Rich	WD	Rich	Rich	Tributary	Stream	
Cond.	(ctus)	Flow	Flow	Trav	Velocity	Ratio	Width	Depth	pH	pH	
	(cfs)	(ft/s)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)	(°C)	
Q7-10	0.140	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	7.00	7.00	
Q1-10	0.00	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	7.00	7.00	
Q30-10	0.00	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	7.00	7.00	

**Discharge Data**

Name	Permit Number	Existing Disc. Flow (m³/d)	Permitted Disc. Flow (m³/d)	Disc. Flow Input (m³/d)	Release Factor	Disc. Temp (°C)	Disc. pH
West Penn Data	PA0082571	0.0000	0.0070	0.0070	0.0000	20.00	7.00

**Parameter Data**

Parameter Name	Disc. Conc. (mg/L)	Trib. Conc. (mg/L)	Stream Conc. (mg/L)	Fate Coef. (1/day)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NOX-N	25.00	0.00	0.00	0.70

Wednesday, August 6, 2025      Version 1.1      Page 1 of 2

**rptGeneral**

**Input Data WQM 7.0**

SWP Basin		Stream Code		Stream Name		RIM	Elevation	Drainage	Slope	PWS	Apply
SWP	Basin	Stream	Code	Reach	Slope	(ft)	(ft)	Area	(ft)	Withdrawal	FC
	11D	13003	TATMAN RUN			3,900	298.26	1.00	0.000000	0.00	<input checked="" type="checkbox"/>
<b>Stream Data</b>											
Design	LFY	Trib	Stream	Rich	Rich	WD	Rich	Rich	Tributary	Stream	
Cond.	(ctus)	Flow	Flow	Trav	Velocity	Ratio	Width	Depth	pH	pH	
	(cfs)	(ft/s)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)	(°C)	
Q7-10	0.140	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	20.00	7.00	
Q1-10	0.00	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	20.00	7.00	
Q30-10	0.00	0.00	0.00	0.0000	0.0000	0.0	0.00	0.00	20.00	7.00	

**Discharge Data**

Name	Permit Number	Existing Disc. Flow (m³/d)	Permitted Disc. Flow (m³/d)	Disc. Flow Input (m³/d)	Release Factor	Disc. Temp (°C)	Disc. pH
West Penn Data	PA0082571	0.0000	0.0000	0.0000	0.0000	25.00	7.00

**Parameter Data**

Parameter Name	Disc. Conc. (mg/L)	Trib. Conc. (mg/L)	Stream Conc. (mg/L)	Fate Coef. (1/day)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NOX-N	25.00	0.00	0.00	0.70

Wednesday, August 6, 2025      Version 1.1      Page 2 of 2

11



**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (386-0400-001), SOPs and/or BPJ.

**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/day	Estimate
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
D.O.	XXX	XXX	5.0	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.44	XXX	1.45	1/day	Grab
CBOD <sub>5</sub>	XXX	XXX	XXX	25.0	XXX	50.0	2/month	8-Hr Composite
TSS	XXX	XXX	XXX	30.0	XXX	60.0	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2,000 Geo Mean	XXX	10,000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1,000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	XXX	Report	1/year	Grab
Ammonia Nov 1 - Apr 30	XXX	XXX	XXX	25.0	XXX	50.0	2/month	8-Hr Composite
Ammonia May 1 - Oct 31	XXX	XXX	XXX	9.0	XXX	18.0	2/month	8-Hr Composite
TKN	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Nitrate-Nitrite	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	2/month	Calculation
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	2/month	8-Hr Composite

Compliance Sampling Location: 

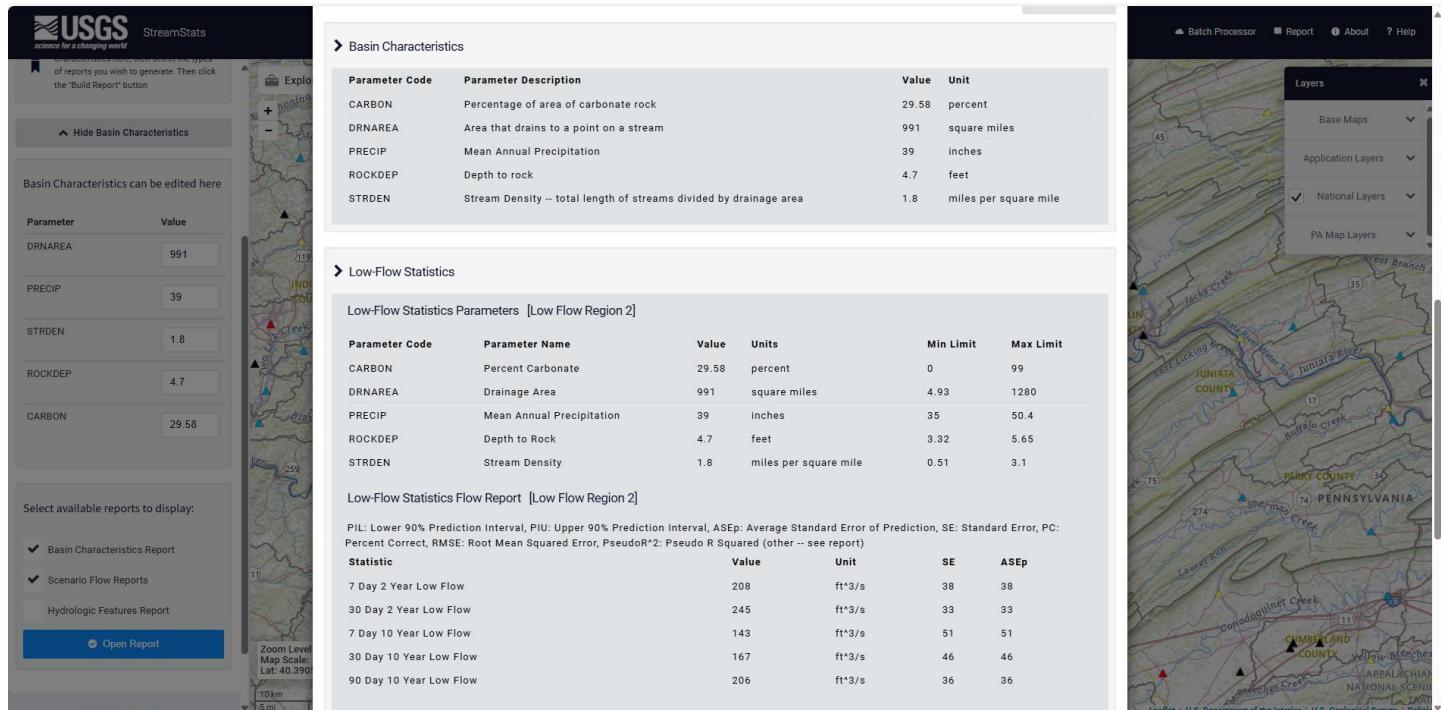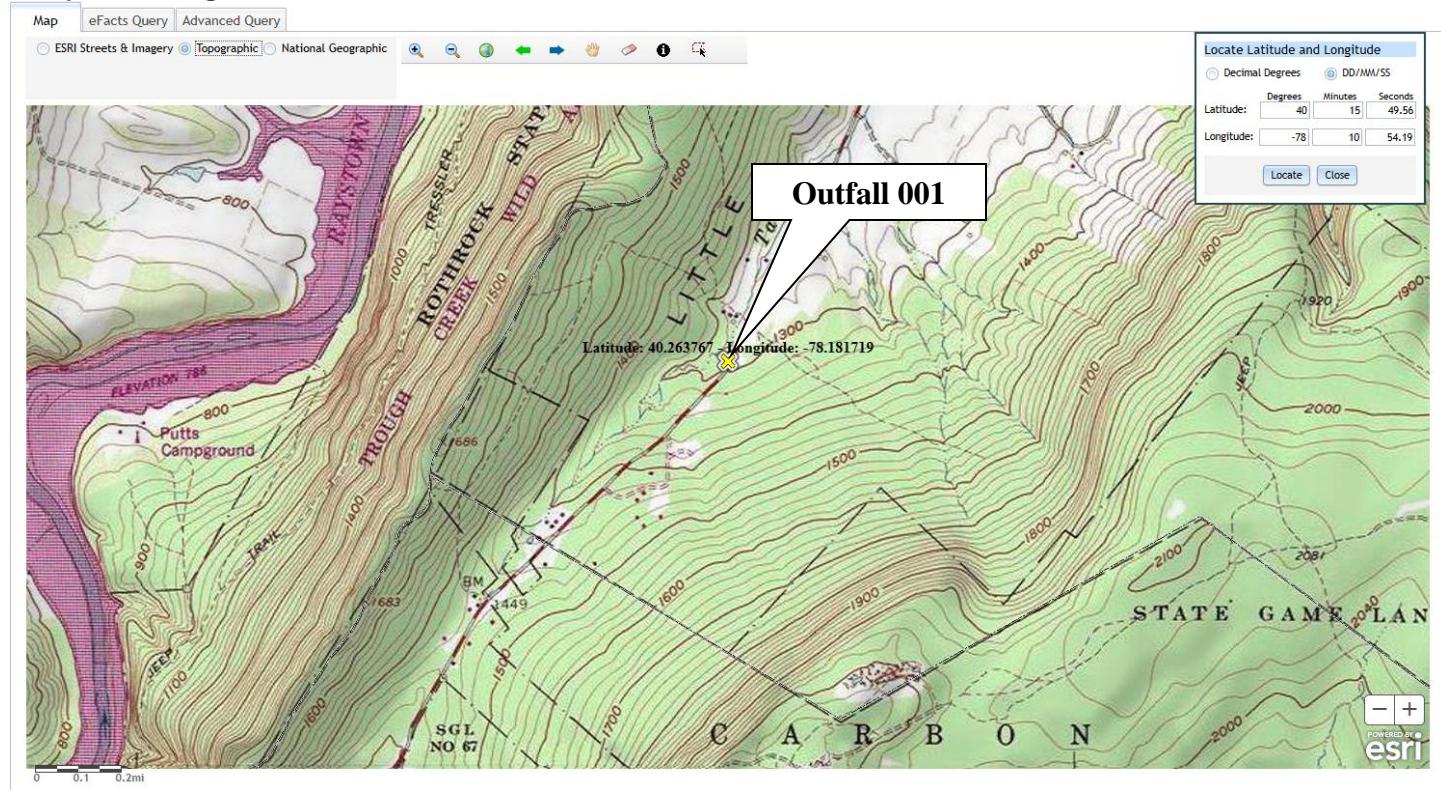

# NPDES Permit Fact Sheet

## Camp Mantowagan

NPDES Permit No. PA0082571



StreamStats  
science for a changing world

SELECT A STATE / REGION  
Pennsylvania

IDENTIFY A STUDY AREA  
Basin Delineated

SELECT SCENARIOS

BUILD A REPORT Report Built

Step 1: You can modify computed basin characteristics here, then select the types of reports you wish to generate. Then click the "Build Report" button

Show Basin Characteristics

Select available reports to display:

- Basin Characteristics Report
- Scenario Flow Reports
- Hydrologic Features Report

Open Report

POWERED BY WIM

USGS Home Contact USGS Search USGS  
Accessibility FOIA Privacy Policy & Notices

Zoom Level: Map Scale: Lat: 40.2516  
100 m 500 ft

**Basin Characteristics**

Parameter Code	Parameter Description	Value	Unit
CARBON	Percentage of area of carbonate rock	0	percent
DRNAREA	Area that drains to a point on a stream	0.41	square miles
PRECIP	Mean Annual Precipitation	39	inches
ROCKDEP	Depth to rock	4.1	feet
STRDEN	Stream Density -- total length of streams divided by drainage area	0.89	miles per square mile

**Low-Flow Statistics**

Low-Flow Statistics Parameters [Low Flow Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
CARBON	Percent Carbonate	0	percent	0	99
DRNAREA	Drainage Area	0.41	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	39	inches	35	50.4
ROCKDEP	Depth to Rock	4.1	feet	3.32	5.65
STRDEN	Stream Density	0.89	miles per square mile	0.51	3.1

Low-Flow Statistics Disclaimers [Low Flow Region 2]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 2]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.0397	ft^3/s
30 Day 2 Year Low Flow	0.058	ft^3/s
7 Day 10 Year Low Flow	0.0141	ft^3/s
30 Day 10 Year Low Flow	0.0212	ft^3/s
90 Day 10 Year Low Flow	0.041	ft^3/s





StreamStats  
science for a changing world

SELECT A STATE / REGION  
Pennsylvania

IDENTIFY A STUDY AREA  
Basin Delineated

SELECT SCENARIOS

BUILD A REPORT Report Built

Step 1: You can modify computed basin characteristics here, then select the types of reports you wish to generate. Then click the "Build Report" button

Show Basin Characteristics

Select available reports to display:

- Basin Characteristics Report
- Scenario Flow Reports
- Hydrologic Features Report

Open Report

POWERED BY WIM

USGS Home Contact USGS Search USGS  
Accessibility FOIA Privacy Policy & Notices

Zoom Level: Map Scale: Lat: 40.2572  
300 m 1000 ft

**Basin Characteristics**

Parameter Code	Parameter Description	Value	Unit
CARBON	Percentage of area of carbonate rock	0	percent
DRNAREA	Area that drains to a point on a stream	1.3	square miles
PRECIP	Mean Annual Precipitation	39	inches
ROCKDEP	Depth to Rock	4.1	feet
STRDEN	Stream Density -- total length of streams divided by drainage area	1.06	miles per square mile

**Low-Flow Statistics**

Low-Flow Statistics Parameters [Low Flow Region 2]


Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
CARBON	Percent Carbonate	0	percent	0	99
DRNAREA	Drainage Area	1.3	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	39	inches	35	50.4
ROCKDEP	Depth to Rock	4.1	feet	3.32	5.65
STRDEN	Stream Density	1.06	miles per square mile	0.51	3.1

Low-Flow Statistics Disclaimers [Low Flow Region 2]

One or more of the parameters is outside the suggested range. Estimates were extrapolated with unknown errors.

Low-Flow Statistics Flow Report [Low Flow Region 2]

Statistic	Value	Unit
7 Day 2 Year Low Flow	0.121	ft^3/s
30 Day 2 Year Low Flow	0.174	ft^3/s
7 Day 10 Year Low Flow	0.0452	ft^3/s
30 Day 10 Year Low Flow	0.067	ft^3/s
90 Day 10 Year Low Flow	0.125	ft^3/s

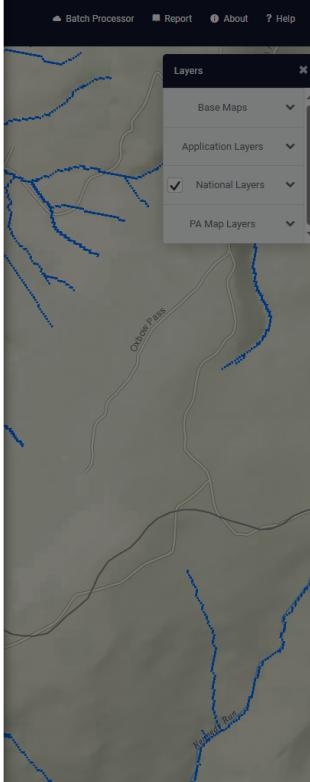

14

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [REDACTED])
<input type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [REDACTED])
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input checked="" type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input checked="" type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input checked="" type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: BCW-PMT-033
<input type="checkbox"/>	Other: [REDACTED]