



Application Type

Renewal

Facility Type

Non-Municipal

Major / Minor

Minor

Application No.

PA0084051

APS ID

982190

Authorization ID

1501228

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Applicant and Facility Information

Applicant Name	<u>Creekview Farms MHP</u>	Facility Name	<u>Creekview Farms MHP</u>
Applicant Address	<u>280 Airy View Road</u>	Facility Address	<u>Meadow Lane</u>
	<u>Shermans Dale, PA 17090-8504</u>		<u>Shermans Dale, PA 17090-8504</u>
Applicant Contact	<u>Charles Lupfer</u>	Facility Contact	<u>Charles Lupfer</u>
Applicant Phone	<u>(717) 422-2104</u>	Facility Phone	<u>(717) 422-2104</u>
Client ID	<u>346714</u>	Site ID	<u>251592</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Carroll Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Perry</u>
Date Application Received	<u>September 30, 2024</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>October 22, 2024</u>	If No, Reason	
Purpose of Application	<u>This is an application for NPDES renewal.</u>		

Approve	Deny	Signatures	Date
X		Nicholas Hong, P.E. / Environmental Engineer Nick Hong (via electronic signature)	November 4, 2024
		Daniel W. Martin, P.E. / Environmental Engineer Manager	
		Maria D. Bebenek, P.E. / Environmental Program Manager	

Summary of Review

The application submitted by the applicant requests a NPDES renewal permit for the Creekview Farms MHP located at Meadow Lane, Shermans Dale, PA 17090 in Perry County, municipality of Carroll Township. The existing permit became effective on April 1, 2020 and expires(d) on March 30, 2025. The application for renewal was received by DEP Southcentral Regional Office (SCRO) on September 30, 2024.

The purpose of this Fact Sheet is to present the basis of information used for establishing the proposed NPDES permit effluent limitations. The Fact Sheet includes a description of the facility, a description of the facility's receiving waters, a description of the facility's receiving waters attainment/non-attainment assessment status, and a description of any changes to the proposed monitoring/sampling frequency. Section 6 provides the justification for the proposed NPDES effluent limits derived from technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), total maximum daily loading (TMDL), antidegradation, anti-backsliding, and/or whole effluent toxicity (WET). A brief summary of the outlined descriptions has been included in the Summary of Review section.

The subject facility is a 0.10 MGD treatment facility. The applicant does not anticipate any proposed upgrades to the treatment facility in the next five years. The NPDES application has been processed as a Minor Sewage Facility (Level 2) due to the type of sewage and the design flow rate for the facility. The applicant disclosed the Act 14 requirement to Perry County Planning Commission and Carroll Township Planning Commission and the notice was received by the parties on September 6, 2024 and September 9, 2024. A planning approval letter was not necessary as the facility is neither new or expanding.

Utilizing the DEP's web-based Emap-PA information system, the receiving waters has been determined to be Sherman Creek. The sequence of receiving streams that the Sherman Creek discharges into are the Susquehanna River which eventually drains into the Chesapeake Bay. The subject site is subject to the Chesapeake Bay implementation requirements. The receiving water has protected water usage for warm water fishes (WWF) and migratory fishes (MF). No Class A Wild Trout fisheries are impacted by this discharge. The presence of high quality and/or exceptional value surface waters triggers the need for an additional evaluation of anti-degradation requirements.

The Sherman Creek is a Category 2 and 5 stream listed in the 2024 Integrated List of All Waters (formerly 303d Listed Streams). This stream is an attaining stream that supports aquatic life and fish consumption. The receiving waters is impaired for recreational uses. The receiving waters is not subject to a total maximum daily load (TMDL) plan to improve water quality in the subject facility's watershed.

The existing permit and proposed permit differ as follows:

- **Due to the EPA triennial review, monitoring for E. Coli shall be required.**

Sludge use and disposal description and location(s): Biosolids/sewage sludge disposed at Central Region Water in Harrisburg, Dauphin County

The proposed permit will expire five (5) years from the effective date.

Based on the review in this report, it is recommended that the permit be drafted. DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Any additional information or public review of documents associated with the discharge or facility may be available at PA DEP Southcentral Regional Office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file review, contact the SCRO File Review Coordinator at 717.705.4700.

1.0 Applicant

1.1 General Information

This fact sheet summarizes PA Department of Environmental Protection's review for the NPDES renewal for the following subject facility.

Facility Name: Creekview Farms MHP
NPDES Permit #: PA0084051
Physical Address: Meadow Lane
Shermans Dale, PA 17090
Mailing Address: 280 Airy View Road
Shermans Dale, PA 17090
Contact: Scott Lupfer
Owner
(717) 422-2104
slupfer@comcast.net
Consultant: Max Stoner
Sr. Project Leader
JHA Companies
(717) 731-1579
mstoner@jhacompanies.com

1.2 Permit History

Permit submittal included the following information.

- NPDES Application
- Flow Diagrams
- Influent Sample Data
- Effluent Sample Data

2.0 Treatment Facility Summary

2.1.1 Site location

The physical address for the facility is Meadow Lane, Shermans Dale, PA 17090. A topographical and an aerial photograph of the facility are depicted as Figure 1 and Figure 2.

Figure 1: Topographical map of the subject facility


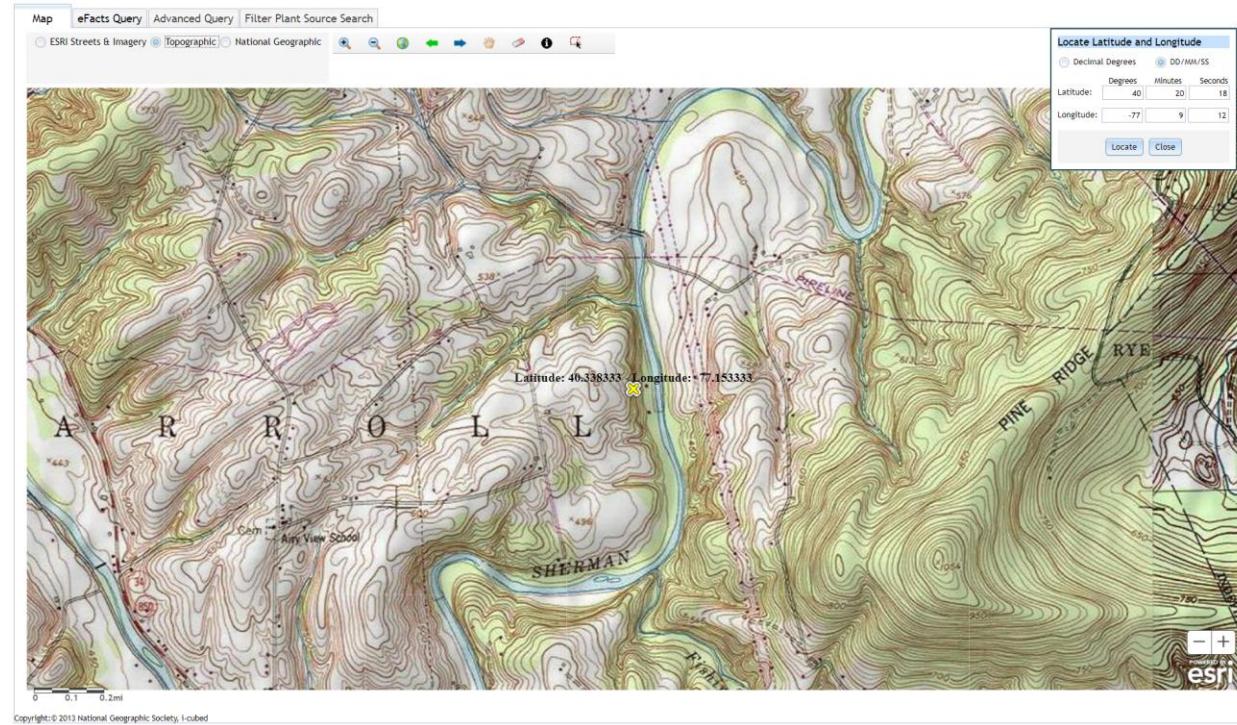


Figure 2: Aerial Photograph of the subject facility

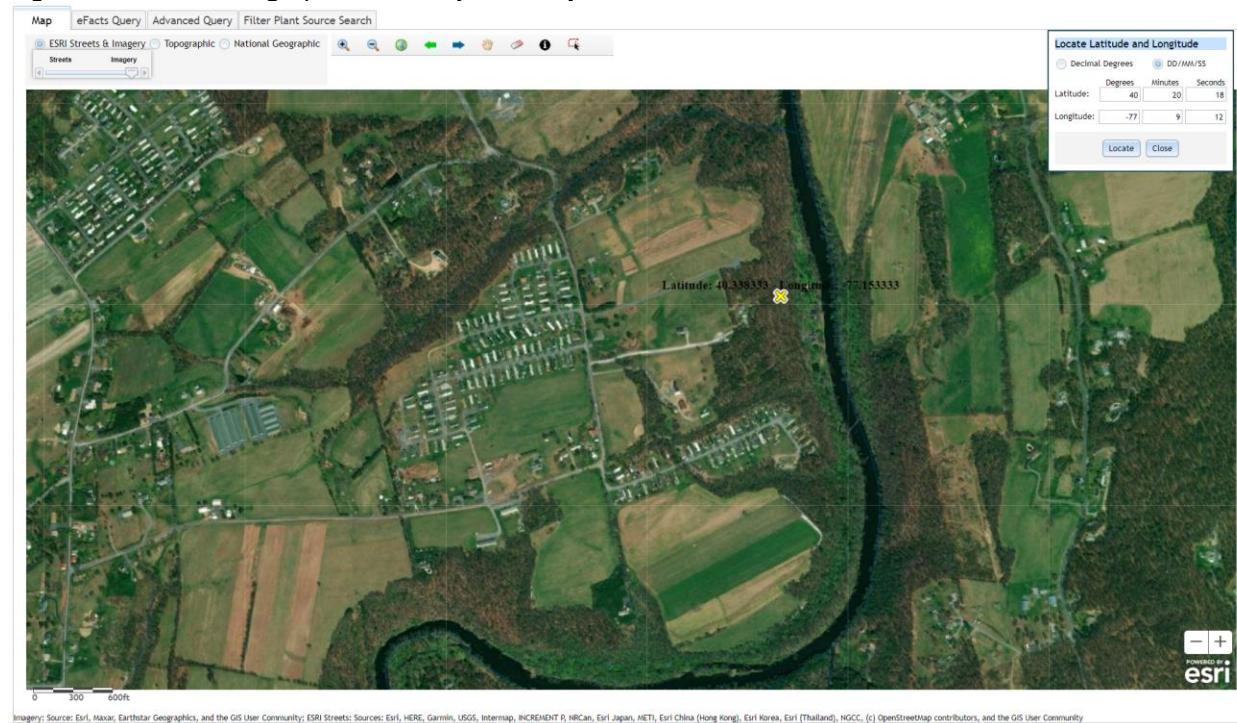

2.2 Description of Wastewater Treatment Process

The subject facility is a 0.10 MGD design flow facility. The subject facility treats wastewater using. The subject facility treats wastewater using an equalization basin(s), an aeration basin(s), a clarifier(s), and a chlorine contact tank prior to discharge thorough the outfall. The facility is being evaluated for flow, pH, dissolved oxygen, TRC, CBOD5, TSS, fecal coliform, nitrogen species, and phosphorus. The existing permits limits for the facility is summarized in Section 2.4.

The treatment process is summarized in the table.

Treatment Facility Summary				
Treatment Facility Name: Creekview MHP				
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Extended Aeration	Hypochlorite	0.1
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.1		Not Overloaded		

2.3 Facility Outfall Information

The facility has the following outfall information for wastewater.

Outfall No. 001
Latitude 40° 20' 18.00"
Wastewater Description: Sewage Effluent

Design Flow (MGD) .1
Longitude -77° 9' 12.00"

The subject facility outfall is within the vicinity of another sewage/wastewater outfall. The upstream outfall is Village Square Plaza Mall (PA0084417) which is about 2 miles from the subject facility.

2.3.1 Operational Considerations- Chemical Additives

Chemical additives are chemical products introduced into a waste stream that is used for cleaning, disinfecting, or maintenance and which may be detected in effluent discharged to waters of the Commonwealth. Chemicals excluded are those used for neutralization of waste streams, the production of goods, and treatment of wastewater.

The subject facility utilizes the following chemicals as part of their treatment process.

- Hydrated lime for pH elevation

2.4 Existing NPDES Permits Limits

The existing NPDES permit limits are summarized in the table.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 20' 18.00", Longitude 77° 9' 12.00", River Mile Index 11.7, Stream Code 10991

Receiving Waters: Sherman Creek (WWF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from April 1, 2020 through March 31, 2025.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
Total Residual Chlorine (TRC)	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5)	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
Biochemical Oxygen Demand (BOD5)								8-Hr Composite
Raw Sewage Influent	Report	Report	XXX	Report	Report	XXX	2/month	8-Hr Composite
Total Suspended Solids	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Total Suspended Solids Raw Sewage Influent	Report	Report	XXX	Report	Report	XXX	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
Nitrate-Nitrite as N	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite

Outfall 001, Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Total Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	Calculation
Ammonia-Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite
Total Kjeldahl Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite
Total Phosphorus	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

3.0 Facility NPDES Compliance History

3.1 Summary of Inspections

A summary of the most recent inspections during the existing permit review cycle is as follows.

The DEP inspector noted the following during the inspection.

05/14/2020:

- The purpose of the inspection was to follow-up on the facility during the COVID-19 related restrictions. The wastewater treatment facility as currently operating normal with all treatment units online. No significant operational changes were made to the treatment facility. Mr. White stated that no recent bypasses, SSOs, or sampling issues have occurred since the last inspection. The facility had spare parts on hand. Since the last inspection, Mr. White stated that the blower timers were repaired and now fully functional. Mr. White stated that there were no changes in staffing or outstanding issues.

03/29/2022:

- Determine the facility's sludge storage capacity
- Submit the sludge production/disposal supplemental form with each month's DMR submission whether or not sludge was removed from the facility

3.2 Summary of DMR Data

A review of approximately 1-year of DMR data shows that the monthly average flow data for the facility below the design capacity of the treatment system. The maximum average flow data for the DMR reviewed was 0.0277 MGD in March 2024. The design capacity of the treatment system is 0.1 MGD.

The off-site laboratory used for the analysis of the parameters was the Carlisle Region Water Pollution Control Facility located at 54 North Middlesex Road, Carlisle, PA 17013.

DMR Data for Outfall 001 (from September 1, 2023 to August 31, 2024)

Parameter	AUG-24	JUL-24	JUN-24	MAY-24	APR-24	MAR-24	FEB-24	JAN-24	DEC-23	NOV-23	OCT-23	SEP-23
Flow (MGD) Average Monthly	0.0213	0.0182	0.0200	0.0266	0.0267	0.0277	0.0222	0.0264	0.0241	0.0190	0.0196	0.0221
Flow (MGD) Daily Maximum	0.0515	0.0235	0.0344	0.0454	0.0828	0.0708	0.0379	0.0563	0.0638	0.0387	0.0313	0.0514
pH (S.U.) Instantaneous Minimum	6.5	6.5	6.4	6.6	6.7	6.7	6.4	6.5	6.7	6.5	6.6	6.7
pH (S.U.) Instantaneous Maximum	7.2	7.1	7.2	7.3	7.4	7.3	7.4	7.4	7.2	7.0	7.1	7.5
DO (mg/L) Instantaneous Minimum	6.4	5.3	6.4	7.0	6.9	8.9	8.9	6.4	9.0	8.7	7.4	7.0
TRC (mg/L) Average Monthly	0.27	0.32	0.28	0.30	0.32	0.26	0.29	0.28	0.30	0.31	0.32	0.24
TRC (mg/L) Instantaneous Maximum	0.48	0.58	0.62	0.62	0.64	0.42	0.42	0.44	0.42	0.78	0.46	0.39
CBOD5 (mg/L) Average Monthly	< 3.0	< 4.9	< 3.3	< 3.4	< 3.2	5.7	5.3	< 3.0	3.9	< 3.0	< 3.0	< 3.0
BOD5 (lbs/day) Raw Sewage Influent Average Monthly	41	52	31	42	38	40	55	36	51	38	39	30
BOD5 (lbs/day) Raw Sewage Influent Daily Maximum	45	68	33	56	39	45	57	39	64	47	45	32
BOD5 (mg/L) Raw Sewage Influent Average Monthly	267	334	204	177	274	216	297	255	249	267	276	213
BOD5 (mg/L) Raw Sewage Influent Daily Maximum	312	440	222	192	326	240	300	270	258	312	336	222
TSS (lbs/day) Raw Sewage Influent Average Monthly	48	46	40	59	45	45	48	31	52	45	40	39

NPDES Permit Fact Sheet
Creekview Farms MHP

NPDES Permit No. PA0084051

TSS (lbs/day) Raw Sewage Influent Daily Maximum	63	54	42	63	47	53	49	36	72	52	44	41
TSS (mg/L) Average Monthly	< 2.2	< 2.2	< 2.6	3.9	13.4	7.2	5.6	< 5.0	3.9	4.6	2.9	< 2.0
TSS (mg/L) Raw Sewage Influent Average Monthly	300	296	260	264	326	241	257	220	248	318	282	279
TSS (mg/L) Raw Sewage Influent Daily Maximum	312	348	280	312	392	282	270	250	290	344	324	282
Fecal Coliform (No./100 ml) Geometric Mean	4	4	< 1	13	< 3	12	6	7	21	29	43	8
Fecal Coliform (No./100 ml) Instantaneous Maximum	4	3	1	26	1	87	12	9	31	180	326	9
Nitrate-Nitrite (lbs/day) Annual Average										238.1		
Nitrate-Nitrite (mg/L) Annual Average										3.76		
Total Nitrogen (lbs/day) Annual Average										595.8		
Total Nitrogen (mg/L) Annual Average										9.41		
Ammonia (lbs/day) Annual Average										277.3		
Ammonia (mg/L) Annual Average										4.38		
TKN (lbs/day) Annual Average										359.6		
TKN (mg/L) Annual Average										5.68		
Total Phosphorus (lbs/day) Annual Average										330.5		
Total Phosphorus (mg/L) Annual Average										5.22		

3.3 Non-Compliance

3.3.1 Non-Compliance- NPDES Effluent

A summary of the non-compliance to the permit limits for the existing permit cycle is as follows.

From the DMR data beginning in April 1, 2020 to October 29, 2024, the following were observed effluent non-compliances.

Summary of Non-Compliance with NPDES Effluent Limits									
Beginning April 1, 2020 and ending October 29, 2024									
NON_COMPLIANCE_DATE	NON_COMPLIANCE_TYPE_DESC	NON_COMPLIANCE_CATEGORY_DESC	PARAMETER	SAMPLE_VALUE	VIOLATION_CONDITION	PERMIT_VALUE	UNIT_OF_MEASURE	STAT_BASE_CODE	FACILITY_COMMENTS
9/21/2020	Violation of permit condition	Effluent	Dissolved Oxygen	3.8	<	5.0	mg/L	Instantaneous Minimum	A blower had failed.
6/26/2023	Violation of permit condition	Effluent	Fecal Coliform	>139	>	1000	No./100 ml	Instantaneous Maximum	Lab advised of a Fecal count of >2420, five days after the 5-17-23 sample collection. A second sample was collected on 5-23-23 with a result of 8. Chlorine residuals were fine, a Geometric Mean of these two samples are >139.
6/26/2023	Violation of permit condition	Effluent	Fecal Coliform	>27	>	200	No./100 ml	Geometric Mean	Three samples were collected. 5-10-23 was <1, 5-17-23 was >2420 and 5-23-23 was 8. Geometric Mean for the month was reported as >27.

3.3.2 Non-Compliance- Enforcement Actions

A summary of the non-compliance enforcement actions for the current permit cycle is as follows:

Beginning in April 1, 2020 to October 29, 2024, there were no observed enforcement actions.

3.4 Summary of Biosolids Disposal

A summary of the biosolids disposed of from the facility is as follows.

2023			
Sewage Sludge / Biosolids Production Information			
Hauled Off-Site			
2023	Gallons	% Solids	Dry Tons
January	2,000	2.5	0.2
February	12,000	2.5	1.25
March	2,000	2.5	0.21
April	12,000	2.5	1.25
May	4,000	2.5	0.42
June	8,000	2.5	0.83
July	2,000	2.5	0.2
August			
September			
October			
November			
December	6,000	2.5	0.63
Notes:			
Biosolids/sewage sludge disposed at Central Region Water in Harrisburg, Dauphin County			

3.5 Open Violations

No open violations existed as of October 2024.

4.0 Receiving Waters and Water Supply Information Detail Summary

4.1 Receiving Waters

The receiving waters has been determined to be Sherman Creek. The sequence of receiving streams that the Sherman Creek discharges into are the Susquehanna River which eventually drains into the Chesapeake Bay.

4.2 Public Water Supply (PWS) Intake

The closest PWS to the subject facility is Suez Water (PWS ID #7220015) located approximately 20 miles downstream of the subject facility on the Susquehanna River. Based upon the distance and the flow rate of the facility, the PWS should not be impacted.

4.3 Class A Wild Trout Streams

Class A Wild Trout Streams are waters that support a population of naturally produced trout of sufficient size and abundance to support long-term and rewarding sport fishery. DEP classifies these waters as high-quality coldwater fisheries.

The information obtained from EMAP suggests that no Class A Wild Trout Fishery will be impacted by this discharge.

4.4 2024 Integrated List of All Waters (303d Listed Streams)

Section 303(d) of the Clean Water Act requires States to list all impaired surface waters not supporting uses even after appropriate and required water pollution control technologies have been applied. The 303(d) list includes the reason for impairment which may be one or more point sources (i.e. industrial or sewage discharges) or non-point sources (i.e.

abandoned mine lands or agricultural runoff and the pollutant causing the impairment such as metals, pH, mercury or siltation).

States or the U.S. Environmental Protection Agency (EPA) must determine the conditions that would return the water to a condition that meets water quality standards. As a follow-up to listing, the state or EPA must develop a Total Maximum Daily Load (TMDL) for each waterbody on the list. A TMDL identifies allowable pollutant loads to a waterbody from both point and non-point sources that will prevent a violation of water quality standards. A TMDL also includes a margin of safety to ensure protection of the water.

The water quality status of Pennsylvania's waters uses a five-part categorization (lists) of waters per their attainment use status. The categories represent varying levels of attainment, ranging from Category 1, where all designated water uses are met to Category 5 where impairment by pollutants requires a TMDL for water quality protection.

The receiving waters is listed in the 2024 Pennsylvania Integrated Water Quality Monitoring and Assessment Report as a Category 2 and 5 waterbody. The surface waters is an attaining stream that supports aquatic life and fish consumption. The receiving stream is impaired for recreational uses. The designated use has been classified as protected waters for warm water fishes (WWF) and migratory fishes (MF).

4.5 Low Flow Stream Conditions

Water quality modeling estimates are based upon conservative data inputs. The data are typically estimated using either a stream gauge or through USGS web based StreamStats program. The NPDES effluent limits are based upon the combined flows from both the stream and the facility discharge.

A conservative approach to estimate the impact of the facility discharge using values which minimize the total combined volume of the stream and the facility discharge. The volumetric flow rate for the stream is based upon the seven-day, 10-year low flow (Q710) which is the lowest estimated flow rate of the stream during a 7 consecutive day period that occurs once in 10 -year time period. The facility discharge is based upon a known design capacity of the subject facility.

The closest WQN station to the subject facility is the Susquehanna River at Harrisburg, PA (WQN202). This WQN station is located approximately 25 miles downstream of the subject facility.

The closest gauge station to the subject facility is the Sherman Creek at Shermans Dale, PA (USGS station number 1568000). This gauge station is located approximately 2 miles upstream of the subject facility.

For WQM modeling, pH and stream water temperature data from the water quality network station was used. pH was estimated to be 8.25 and the stream water temperature was estimated to be 23.75 C.

The hardness of the stream was estimated from the water quality network to be 109 mg/l CaCO₃.

The low flow yield and the Q710 for the subject facility was estimated as shown below.

Gauge Station Data		
USGS Station Number	1568000	
Station Name	Sherman Creek at Shermans Dale, PA	
Q710	15.5	ft ³ /sec
Drainage Area (DA)	207	mi ²

Calculations

The low flow yield of the gauge station is:

$$\text{Low Flow Yield (LFY)} = \text{Q710} / \text{DA}$$

$$\text{LFY} = (15.5 \text{ ft}^3/\text{sec} / 207 \text{ mi}^2)$$

$$\text{LFY} =$$

$$0.0749$$

$$\text{ft}^3/\text{sec}/\text{mi}^2$$

The low flow at the subject site is based upon the DA of 219 mi²

$$\text{Q710} = (\text{LFY@gauge station})(\text{DA@Subject Site})$$

$$\text{Q710} = (0.0749 \text{ ft}^3/\text{sec}/\text{mi}^2)(219 \text{ mi}^2)$$

$$\text{Q710} =$$

$$16.399$$

$$\text{ft}^3/\text{sec}$$

4.6 Summary of Discharge, Receiving Waters and Water Supply Information

Outfall No.	001	Design Flow (MGD)	.1
Latitude	40° 20' 18.72"	Longitude	-77° 9' 7.70"
Quad Name		Quad Code	
Wastewater Description:	Sewage Effluent		
Receiving Waters	Sherman Creek (WWF)	Stream Code	10991
NHD Com ID	56401955	RMI	11.7
Drainage Area	219	Yield (cfs/mi ²)	0.0749
Q ₇₋₁₀ Flow (cfs)	16.3	Q ₇₋₁₀ Basis	StreamStats/streamgauge
Elevation (ft)	408	Slope (ft/ft)	
Watershed No.	7-A	Chapter 93 Class.	WWF, MF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Attaining Use(s) supports aquatic life and fish consumption; Impaired for recreational uses		
Cause(s) of Impairment	Pathogens		
Source(s) of Impairment	Agriculture		
TMDL Status	Not appl.	Name	
Background/Ambient Data		Data Source	
pH (SU)	8.25	WQN202; median July to Oct	
Temperature (°C)	23.75	WQN202; median July to Oct	
Hardness (mg/L)	109	WQN202; Historical median	
Other:			
Nearest Downstream Public Water Supply Intake	Suez Water		
PWS Waters	Susquehanna River	Flow at Intake (cfs)	
PWS RMI	76	Distance from Outfall (mi)	20

5.0: Overview of Presiding Water Quality Standards

5.1 General

There are at least six (6) different policies which determines the effluent performance limits for the NPDES permit. The policies are technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), antidegradation, total maximum daily loading (TMDL), anti-backsliding, and whole effluent toxicity (WET). The effluent performance limitations enforced are the selected permit limits that is most protective to the designated use of the receiving waters. An overview of each of the policies that are applicable to the subject facility has been presented in Section 6.

5.2.1 Technology-Based Limitations

TBEL treatment requirements under section 301(b) of the Act represent the minimum level of control that must be imposed in a permit issued under section 402 of the Act (40 CFR 125.3). Available TBEL requirements for the state of Pennsylvania are itemized in PA Code 25, Chapter 92a.47.

The presiding sources for the basis for the effluent limitations are governed by either federal or state regulation. The reference sources for each of the parameters is itemized in the tables. The following technology-based limitations apply, subject to water quality analysis and best professional judgement (BPJ) where applicable:

Parameter	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

5.3 Water Quality-Based Limitations

WQBEL are based on the need to attain or maintain the water quality criteria and to assure protection of designated and existing uses (PA Code 25, Chapter 92a.2). The subject facility that is typically enforced is the more stringent limit of either the TBEL or the WQBEL.

Determination of WQBEL is calculated by spreadsheet analysis or by a computer modeling program developed by DEP. DEP permit engineers utilize the following computing programs for WQBEL permit limitations: (1) MS Excel worksheet for Total Residual Chlorine (TRC); (2) WQM 7.0 for Windows Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen Version 1.1 (WQM Model) and (3) Toxics using DEP Toxics Management Spreadsheet for Toxics pollutants.

The modeling point nodes utilized for this facility are summarized below.

General Data 1	(Modeling Point #1)	(Modeling Point #2)	(Modeling Point #3)	Units
Stream Code	10991	10991	10991	
River Mile Index	11.7	9.21	13.77	miles
Elevation	408	392	423	feet
Latitude	40.338333	40.353411	40.32276	
Longitude	-77.153333	-77.134656	-77.169933	
Drainage Area	219	222	207	sq miles
Low Flow Yield	0.074879227	0.074879227	0.074879227	cfs/sq mile

5.3.1 Water Quality Modeling 7.0

The WQM Model is a computer model that is used to determine NPDES discharge effluent limitations for Carbonaceous BOD (CBOD5), Ammonia Nitrogen (NH₃-N), and Dissolved Oxygen (DO) for single and multiple point source discharges scenarios. WQM Model is a complete-mix model which means that the discharge flow and the stream flow are assumed to instantly and completely mixed at the discharge node.

WQM recommends effluent limits for DO, CBOD5, and NH₃-N in mg/l for the discharge(s) in the simulation.

Four types of limits may be recommended. The limits are

- (a) a *minimum concentration for DO in the discharge as 30-day average*;
- (b) a *30-day average concentration for CBOD5 in the discharge*;
- (c) a *30-day average concentration for the NH₃-N in the discharge*;
- (d) *24-hour average concentration for NH₃-N in the discharge*.

The WQM Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

The applicable WQM Effluent Limit Type are discussed in Section 6 under the corresponding parameter which is either DO, CBOD, or ammonia-nitrogen.

5.3.2 Toxics Modeling

The Toxics Management Spreadsheet model is a computer model that is used to determine effluent limitations for toxics (and other substances) for single discharge wasteload allocations. This computer model uses a mass-balance water quality analysis that includes consideration for mixing, first-order decay, and other factors used to determine recommended water quality-based effluent limits. Toxics Management Spreadsheet does not assume that all discharges completely mix with the stream. The point of compliance with water quality criteria are established using criteria compliance times (CCTs). The available CCTs are either acute fish criterion (AFC), chronic fish criterion (CFC), or human health criteria (THH & CRL).

Acute Fish Criterion (AFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 15 minutes travel time downstream of the current discharge) or the complete mix time whichever comes first. AFC is evaluated at Q710 conditions.

Chronic Fish Criterion (CFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CFC is evaluated at Q710 conditions.

Threshold Human Health (THH) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the estimated travel time downstream to the nearest potable water supply intake whichever comes first. THH is evaluated at Q710 conditions.

Cancer Risk Level (CRL) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CRL is evaluated at Qh (harmonic mean or normal flow) conditions.

The Toxics Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

5.3.2.1 Determining if NPDES Permit Will Require Monitoring/Limits in the Proposed Permit for Toxic Pollutants

To determine if Toxics modeling is necessary, DEP has developed a Toxics Management Spreadsheet to identify toxics of concern. Toxic pollutants whose maximum concentrations as reported in the permit application or on DMRs are greater than the most stringent applicable water quality criterion are pollutants of concern. A Reasonable Potential Analysis was utilized to determine (a) if the toxic parameters modeled would require monitoring or (b) if permit limitations would be required for the parameters. The toxics reviewed for reasonable potential were the following pollutants: TDS, chloride, bromide, and sulfate.

The NPDES application collected one sample for TDS, chloride, bromide, and sulfate.

Based upon the SOP- Establishing Water Quality-Based Effluent Limitations (WQBELs) and Permit Conditions for Toxic Pollutants (Revised January 10, 2019), monitoring and/or limits will be established as follows.

- (a) When reasonable potential is demonstrated, establish limits where the maximum reported concentration equals or exceeds 50% of the WQBEL.
- (b) For non-conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 25% - 50% of the WQBEL.
- (c) For conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 10% - 50% of the WQBEL.

Applicable monitoring or permit limits for toxics are summarized in Section 6.

The Toxics Management Spreadsheet output has been included in Attachment B.

5.3.3 Whole Effluent Toxicity (WET)

The facility is not subject to WET.

5.4 Total Maximum Daily Loading (TMDL)

5.4.1 TMDL

The goal of the Clean Water Act (CWA), which governs water pollution, is to ensure that all of the Nation's waters are clean and healthy enough to support aquatic life and recreation. To achieve this goal, the CWA created programs designed to regulate and reduce the amount of pollution entering United States waters. Section 303(d) of the CWA requires states to assess their waterbodies to identify those not meeting water quality standards. If a waterbody is not meeting standards, it is listed as impaired and reported to the U.S. Environmental Protection Agency. The state then develops a plan to clean up the impaired waterbody. This plan includes the development of a Total Maximum Daily Load (TMDL) for the pollutant(s) that were found to be the cause of the water quality violations. A Total Maximum Daily Load (TMDL) calculates the maximum amount of a specific pollutant that a waterbody can receive and still meet water quality standards.

A TMDL for a given pollutant and waterbody is composed of the sum of individual wasteload allocations (WLAs) for point sources and load allocations (LAs) for nonpoint sources and natural background levels. In addition, the TMDL must include an implicit or explicit margin of safety (MOS) to account for the uncertainty in the relationship between pollutant loads and the quality of the receiving waterbody. The TMDL components are illustrated using the following equation:

$$\text{TMDL} = \sum \text{WLAs} + \sum \text{LAs} + \text{MOS}$$

Pennsylvania has committed to restoring all impaired waters by developing TMDLs and TMDL alternatives for all impaired waterbodies. The TMDL serves as the starting point or planning tool for restoring water quality.

5.4.1.1 Local TMDL

The subject facility does not discharge into a local TMDL.

5.4.1.2 Chesapeake Bay TMDL Requirement

The Chesapeake Bay Watershed is a large ecosystem that encompasses approximately 64,000 square miles in Maryland, Delaware, Virginia, West Virginia, Pennsylvania, New York and the District of Columbia. An ecosystem is composed of interrelated parts that interact with each other to form a whole. All of the plants and animals in an ecosystem depend on each other in some way. Every living thing needs a healthy ecosystem to survive. Human activities affect the Chesapeake Bay ecosystem by adding pollution, using resources and changing the character of the land.

Most of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the federal Water Pollution Control Act ("Clean Water Act"), 33 U.S.C. § 1313(d). While the Chesapeake Bay is outside the boundaries of Pennsylvania, more than half of the State lies within the watershed. Two major rivers in Pennsylvania are part of the Chesapeake Bay Watershed. They are (a) the Susquehanna River and (b) the Potomac River. These two rivers total 40 percent of the entire Chesapeake Bay watershed.

The overall management approach needed for reducing nitrogen, phosphorus and sediment are provided in the Bay TMDL document and the Phase I, II, and III WIPs which is described in the Bay TMDL document and Executive Order 13508.

The Bay TMDL is a comprehensive pollution reduction effort in the Chesapeake Bay watershed identifying the necessary pollution reductions of nitrogen, phosphorus and sediment across the seven Bay watershed jurisdictions of Delaware, Maryland, New York, Pennsylvania, Virginia, West Virginia and the District of Columbia to meet applicable water quality standards in the Bay and its tidal waters.

The Watershed Implementation Plans (WIPs) provides objectives for how the jurisdictions in partnership with federal and local governments will achieve the Bay TMDL's nutrient and sediment allocations.

Phase 3 WIP provides an update on Chesapeake Bay TMDL implementation activities for point sources and DEP's current implementation strategy for wastewater. The latest revision of the supplement was September 13, 2021.

The Chesapeake Bay TMDL (Appendix Q) categorizes point sources into four sectors:

- Sector A- significant sewage dischargers;
- Sector B- significant industrial waste (IW) dischargers;
- Sector C- non-significant dischargers (both sewage and IW facilities); and
- Sector D- combined sewer overflows (CSOs).

All sectors contain a listing of individual facilities with NPDES permits that were believed to be discharging at the time the TMDL was published (2010). All sectors with the exception of the non-significant dischargers have individual wasteload allocations (WLAs) for TN and TP assigned to specific facilities. Non-significant dischargers have a bulk or aggregate allocation for TN and TP based on the facilities in that sector that were believed to be discharging at that time and their estimated nutrient loads.

Cap Loads will be established in permits as Net Annual TN and TP loads (lbs/yr) that apply during the period of October 1 – September 30. For facilities that have received Cap Loads in any other form, the Cap Loads will be modified accordingly when the permits are renewed.

Offsets have been incorporated into Cap Loads in several permits issued to date. From this point forward, permits will be issued with the WLAs as Cap Loads and will identify Offsets separately to facilitate nutrient trading activities and compliance with the TMDL.

Based upon the supplement the subject facility has been categorized as a Sector C discharger. The supplement defines Sector C as a non-significant dischargers include sewage facilities (Phase 4 facilities: ≥ 0.2 MGD and < 0.4 MGD and Phase 5 facilities: > 0.002 MGD and < 0.2 MGD), small flow/single residence sewage treatment facilities (≤ 0.002 MGD), and non-significant IW facilities, all of which may be covered by statewide General Permits or may have individual NPDES permits.

At this time, there are approximately 850 Phase 4 and 5 sewage facilities, approximately 715 small flow sewage treatment facilities covered by a statewide General Permit, and approximately 300 non-significant IW facilities.

For Phase 5 sewage facilities with individual permits (average annual design flow on August 29, 2005 > 0.002 MGD and < 0.2 MGD), DEP will issue individual permits with monitoring and reporting for TN and TP throughout the permit term at a frequency no less than annually, unless 1) the facility has already conducted at least two years of nutrient monitoring and 2) a summary of the monitoring results are included in the next permit's fact sheet. If, however, Phase 5 facilities choose to expand, the renewed or amended permits will contain Cap Loads based on the lesser of a) existing TN/TP concentrations at current design average annual flow or b) 7,306 lbs/yr TN and 974 lbs/yr TP.

If no data are available to determine existing concentrations for expanding Phase 4 or 5 facilities, default concentrations of 25 mg/l TN and 4 mg/l TP may be used (these are the average estimated concentrations of all non-significant sewage facilities).

DEP will not issue permits to existing Phase 4 and 5 facilities containing Cap Loads unless it is done on a broad scale or unless the facilities are expanding.

For new Phase 4 and 5 sewage discharges, in general DEP will issue new permits containing Cap Loads of "0" and new facilities will be expected to purchase credits and/or apply offsets to achieve compliance, with the exception of small flow and single residence facilities.

Due to the Chesapeake Bay WIP, this facility is subject to Sector C monitoring requirements. Monitoring for nitrogen and phosphorus shall be at least 2x/yr.

5.5 Anti-Degradation Requirement

Chapter 93.4a of the PA regulations requires that surface water of the Commonwealth of Pennsylvania may not be degraded below levels that protect the existing uses. The regulations specifically state that *Existing instream water uses and the level of water quality necessary to protect the existing uses shall be maintained and protected*. Antidegradation requirements are implemented through DEP's guidance manual entitled Water Quality Antidegradation Implementation Guidance (Document #391-0300-02).

The policy requires DEP to protect the existing uses of all surface waters and the existing quality of High Quality (HQ) and Exceptional Value (EV) Waters. Existing uses are protected when DEP makes a final decision on any permit or approval for an activity that may affect a protected use. Existing uses are protected based upon DEP's evaluation of the best available information (which satisfies DEP protocols and Quality Assurance/Quality Control (QA/QC) procedures) that indicates the protected use of the waterbody.

For a new, additional, or increased point source discharge to an HQ or EV water, the person proposing the discharge is required to utilize a nondischarge alternative that is cost-effective and environmentally sound when compared with the cost of the proposed discharge. If a nondischarge alternative is not cost-effective and environmentally sound, the person must use the best available combination of treatment, pollution prevention, and wastewater reuse technologies and assure that any discharge is nondegrading. In the case of HQ waters, DEP may find that after satisfaction of intergovernmental coordination and public participation requirements lower water quality is necessary to accommodate important economic or social development in the area in which the waters are located. In addition, DEP will assure that cost-effective and reasonable best management practices for nonpoint source control in HQ and EV waters are achieved.

The subject facility's discharge will be to a special protection waters. Sherman Creek was designated as a HQ stream from UNT 11098 to the mouth of the river on March 24, 2017. The facility falls within this stream segment. The facility existed in the 1990s. Thus, it predates the HQ designation. The permit conditions are imposed to protect existing instream water quality and uses.

5.6 Anti-Backsliding

Anti-backsliding is a federal regulation which prohibits a permit from being renewed, reissued, or modified containing effluent limitations which are less stringent than the comparable effluent limitations in the previous permit (40 CFR 122.1.1 and 40 CFR 122.1.2). A review of the existing permit limitations with the proposed permit limitations confirm that the facility is

consistent with anti-backsliding requirements. The facility has proposed effluent limitations that are as stringent as the existing permit.

6.0 NPDES Parameter Details

The basis for the proposed sampling and their monitoring frequency that will appear in the permit for each individual parameter are itemized in this Section. The final limits are the more stringent of technology based effluent treatment (TBEL) requirements, water quality based (WQBEL) limits, TMDL, antidegradation, anti-degradation, or WET.

The reader will find in this section:

- a) a justification of recommended permit monitoring requirements and limitations for each parameter in the proposed NPDES permit;
- b) a summary of changes from the existing NPDES permit to the proposed permit; and
- c) a summary of the proposed NPDES effluent limits.

6.1 Recommended Monitoring Requirements and Effluent Limitations

A summary of the recommended monitoring requirements and effluent limitations are itemized in the tables. The tables are categorized by (a) Conventional Pollutants and Disinfection, (b) Nitrogen Species and Phosphorus, (c) Toxics, and (d) Non-Conventional Pollutants, and (e) Chapter 92a.61 targeted parameters

6.1.1 Conventional Pollutants and Disinfection

Summary of Proposed NPDES Parameter Details for Conventional Pollutants and Disinfection Creekview MHP; PA0084051

Parameter	Permit Limitation Required by ¹ :	Recommendation	
pH (S.U.)	TBEL	Monitoring:	The monitoring frequency shall be daily as a grab sample (Table 6-3).
		Effluent Limit:	Effluent limits may range from pH = 6.0 to 9.0
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 95.2(1).
Dissolved Oxygen	BPJ	Monitoring:	The monitoring frequency shall be daily as a grab sample (Table 6-3).
		Effluent Limit:	Effluent limits shall be greater than 5.0 mg/l.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by best professional judgement.
CBOD	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	Effluent limits shall not exceed 25 mg/l as an average monthly.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(1). WQM modeling indicates that the TBEL is more stringent than the WQBEL. Thus, the permit limit is confined to TBEL.
TSS	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	Effluent limits shall not exceed 30 mg/l as an average monthly.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(1). While there is no WQM modeling for this parameter, the permit limit for TSS is generally assigned similar effluent limits as CBOD or BOD.
TRC	TBEL	Monitoring:	The monitoring frequency shall be on a daily basis as a grab sample (Table 6-3).
		Effluent Limit:	The average monthly limit should not exceed 0.5 mg/l and/or 1.6 mg/l as an instantaneous maximum.
		Rationale:	Chlorine in both combined (chloramine) and free form is extremely toxic to freshwater fish and other forms of aquatic life (Implementation Guidance Total Residual Chlorine 1). The TRC effluent limitations to be imposed on a discharger shall be the more stringent of either the WQBEL or TBEL requirements and shall be expressed in the NPDES permit as an average monthly and instantaneous maximum effluent concentration (Implementation Guidance Total Residual Chlorine 4). Based on the stream flow rate (lowest 7-day flow rate in 10 years) and the design flow rate of the subject facility calculated by the TRC Evaluation worksheet, the TBEL is more stringent than the WQBEL. The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.48(b)(2)
Fecal Coliform	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as a grab sample (Table 6-3).
		Effluent Limit:	Summer effluent limits shall not exceed 200 No./100 mL as a geometric mean. Winter effluent limits shall not exceed 2000 No./100 mL as a geometric mean.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(4) and 92a.47(a)(5).

Notes:

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other
2 Monitoring frequency based on flow rate of 0.1 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementation Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

6.1.2 Nitrogen Species and Phosphorus

Summary of Proposed NPDES Parameter Details for Nitrogen Species and Phosphorus

Creekview MHP; PA0084051

Parameter	Permit Limitation Required by ¹ :	Recommendation	
Ammonia-Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/yr as an 8-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/yr.
Nitrate-Nitrite as N	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/yr as an 8-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/yr.
Total Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/yr as a calculation.
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/yr.
TKN	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/yr as an 8-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/yr.
Total Phosphorus	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/yr as an 8-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/yr.

Notes:

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other
2 Monitoring frequency based on flow rate of 0.1 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

6.1.3.1 Implementation of Regulation- Chapter 92a.61

Chapter 92a.61 provides provisions to DEP to monitor for pollutants that may have an impact on the quality of waters of the Commonwealth.

Based upon DEP policy directives the following pollutants shall be monitored:

- Consistent with DEP Management directives issued on March 22, 2021 and in conjunction with EPA's 2017 Triennial Review, monitoring for E. Coli shall be required. The monitoring frequency is based upon flow rate.

Creekview MHP; PA0084051		
Parameter	Permit Limitation Required by ¹ :	Recommendation
E. Coli	SOP; Chapter 92a.61	<p>Monitoring: The monitoring frequency shall be 1x/quarter as a grab sample (SOP).</p> <p>Effluent Limit: No effluent requirements.</p> <p>Rationale: Consistent with the SOP- Establishing Effluent Limitations for Individual Sewage Permits (Revised February 5, 2024) and under the authority of Chapter 92a.61, the facility will be required to monitor for E.Coli.</p>

Notes:

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other
2 Monitoring frequency based on flow rate of 0.1 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent

4 Water Quality Antidegradation Implementation Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

6.2 Summary of Changes From Existing Permit to Proposed Permit

A summary of how the proposed NPDES permit differs from the existing NPDES permit is summarized as follows.

- Due to the EPA triennial review, monitoring for E. coli shall be required.

6.3.1 Summary of Proposed NPDES Effluent Limits

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

The proposed NPDES effluent limitations are summarized in the table below.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 20' 18.00", Longitude 77° 9' 12.00", River Mile Index 11.7, Stream Code 10991

Receiving Waters: Sherman Creek (WWF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
Total Residual Chlorine (TRC)	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5)	XXX	XXX	XXX	25	XXX	50	2/month	8-Hr Composite
Biochemical Oxygen Demand (BOD5)								8-Hr Composite
Raw Sewage Influent	Report	Report	XXX	Report	Report	XXX	2/month	8-Hr Composite
Total Suspended Solids	XXX	XXX	XXX	30	XXX	60	2/month	8-Hr Composite
Total Suspended Solids Raw Sewage Influent	Report	Report	XXX	Report	Report	XXX	2/month	8-Hr Composite
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	Report	XXX	1/quarter	Grab

Outfall 001, Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Nitrate-Nitrite as N	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite
Total Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	Calculation
Ammonia-Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite
Total Kjeldahl Nitrogen	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite
Total Phosphorus	Report Annl Avg	XXX	XXX	Report Annl Avg	XXX	XXX	2/year	8-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

6.3.2 Summary of Proposed Permit Part C Conditions

The subject facility has the following Part C conditions.

- Chlorine Minimization
- Hauled-in Waste Restrictions
- Chesapeake Bay Nutrient Definitions
- Solids Management for Non-Lagoon Treatment Systems

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [REDACTED])
<input checked="" type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	TRC Model Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: [REDACTED]
<input type="checkbox"/>	Other: [REDACTED]

Attachment A

Stream Stats/Gauge Data

14 Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania

Table 1. List of U.S. Geological Survey streamgage locations in and near Pennsylvania with updated streamflow statistics.—Continued
[Latitude and Longitude in decimal degrees; mi², square miles]

Streamgage number	Streamgage name	Latitude	Longitude	Drainage area (mi ²)	Regulated ¹
01561000	Brush Creek at Gapsville, Pa.	39.956	-78.254	36.8	N
01562000	Raystown Branch Juniata River at Saxton, Pa.	40.216	-78.265	756	N
01562500	Great Trough Creek near Marklesburg, Pa.	40.350	-78.130	84.6	N
01563200	Raystown Branch Juniata River below Rays Dam nr Huntingdon, Pa.	40.429	-77.991	960	Y
01563500	Juniata River at Mapleton Depot, Pa.	40.392	-77.935	2,030	Y
01564500	Aughwick Creek near Three Springs, Pa.	40.213	-77.925	205	N
01565000	Kishacoquillas Creek at Reedsville, Pa.	40.655	-77.583	164	N
01565700	Little Lost Creek at Oakland Mills, Pa.	40.605	-77.311	6.52	N
01566000	Tuscarora Creek near Port Royal, Pa.	40.515	-77.419	214	N
01566500	Cocolamus Creek near Millerstown, Pa.	40.566	-77.118	57.2	N
01567000	Juniata River at Newport, Pa.	40.478	-77.129	3,354	Y
01567500	Bixler Run near Loysville, Pa.	40.371	-77.402	15.0	N
01568000	Sherman Creek at Shermans Dale, Pa.	40.323	-77.169	207	N
01568500	Clark Creek near Carsonville, Pa.	40.460	-76.751	22.5	LF
01569000	Stony Creek nr Dauphin, Pa.	40.380	-76.907	33.2	N
01569800	Letort Spring Run near Carlisle, Pa.	40.235	-77.139	21.6	N
01570000	Conodoguinet Creek near Hogestown, Pa.	40.252	-77.021	470	LF
01570500	Susquehanna River at Harrisburg, Pa.	40.255	-76.886	24,100	Y
01571000	Paxton Creek near Penbrook, Pa.	40.308	-76.850	11.2	N
01571500	Yellow Breeches Creek near Camp Hill, Pa.	40.225	-76.898	213	N
01572000	Lower Little Swatara Creek at Pine Grove, Pa.	40.538	-76.377	34.3	N
01572025	Swatara Creek near Pine Grove, Pa.	40.533	-76.402	116	N
01572190	Swatara Creek near Inwood, Pa.	40.479	-76.531	167	N
01573000	Swatara Creek at Harper Tavern, Pa.	40.403	-76.577	337	N
01573086	Beck Creek near Cleona, Pa.	40.323	-76.483	7.87	N
01573160	Quittapahilla Creek near Bellegrove, Pa.	40.343	-76.562	74.2	N
01573500	Manada Creek at Manada Gap, Pa.	40.397	-76.709	13.5	N
01573560	Swatara Creek near Hershey, Pa.	40.298	-76.668	483	N
01574000	West Conewago Creek near Manchester, Pa.	40.082	-76.720	510	N
01574500	Codorus Creek at Spring Grove, Pa.	39.879	-76.853	75.5	Y
01575000	South Branch Codorus Creek near York, Pa.	39.921	-76.749	117	Y
01575500	Codorus Creek near York, Pa.	39.946	-76.755	222	Y
01576000	Susquehanna River at Marietta, Pa.	40.055	-76.531	25,990	Y
01576085	Little Conestoga Creek near Churchtown, Pa.	40.145	-75.989	5.82	N
01576500	Conestoga River at Lancaster, Pa.	40.050	-76.277	324	N
01576754	Conestoga River at Conestoga, Pa.	39.946	-76.368	470	N
01578310	Susquehanna River at Conowingo, Md.	39.658	-76.174	27,100	Y
01578400	Bowery Run near Quarryville, Pa.	39.895	-76.114	5.98	N
01580000	Deer Creek at Rocks, Md.	39.630	-76.403	94.4	N
01581500	Bynum Run at Bel Air, Md.	39.541	-76.330	8.52	N
01581700	Winters Run near Benson, Md.	39.520	-76.373	34.8	N
01582000	Little Falls at Blue Mount, Md.	39.604	-76.620	52.9	N
01582500	Gunpowder Falls at Glencoe, Md.	39.550	-76.636	160	Y
01583000	Slade Run near Glyndon, Md.	39.495	-76.795	2.09	N
01583100	Piney Run at Dover, Md.	39.521	-76.767	12.3	N

Table 2. Selected low-flow statistics for streamgage locations in and near Pennsylvania.—Continued

[ft³/s; cubic feet per second; —, statistic not computed; <, less than]

Streamgage number	Period of record used in analysis ¹	Number of years used in analysis	1-day, 10-year (ft ³ /s)	7-day, 10-year (ft ³ /s)	7-day, 2-year (ft ³ /s)	30-day, 10-year (ft ³ /s)	30-day, 2-year (ft ³ /s)	90-day, 10-year (ft ³ /s)
01565000	1941–2008	37	17.6	18.6	28.6	20.3	32.4	24.4
01565700	1965–1981	17	.4	.4	.9	.5	1.1	.8
01566000	1913–2008	52	4.3	7.9	18.8	12.4	25.6	19.2
01566500	1932–1958	27	1.7	2.4	4.0	3.2	5.7	4.9
01567000	² 1974–2008	35	504	534	725	589	857	727
01567000	³ 1901–1972	72	311	367	571	439	704	547
01567500	1955–2008	54	2.0	2.2	3.3	2.6	3.8	3.1
01568000	1931–2008	78	12.7	15.5	25.5	19.2	32.0	26.0
01568500	² 1943–1997	55	1.8	2.3	4.3	2.7	5.0	3.1
01569000	1939–1974	14	2.6	4.0	7.4	5.1	9.4	7.8
01569800	1978–2008	31	15.9	17.0	24.4	18.4	26.1	20.3
01570000	³ 1913–1969	35	—	63.1	110	76.1	124	95.3
01570000	² 1971–2008	38	63.1	69.3	109	78.3	125	97.8
01570500	³ 1901–1972	72	2,310	2,440	4,000	2,830	4,950	3,850
01570500	² 1974–2008	35	3,020	3,200	5,180	3,690	6,490	4,960
01571000	1941–1995	16	.1	.2	.6	.3	1.2	.8
01571500	1911–2008	62	81.6	86.8	115	94.0	124	105
01572000	1921–1984	14	2.1	2.3	4.8	3.0	6.5	4.5
01572025	1990–2008	17	15.2	16.4	26.7	18.5	34.6	27.7
01572190	1990–2008	17	19.1	20.5	36.2	23.9	45.8	35.3
01573000	1920–2008	89	18.0	22.0	52.0	30.8	69.2	50.9
01573086	1965–1981	17	.5	.6	2.6	.8	3.3	1.1
01573160	1977–1994	18	26.9	29.6	46.4	33.6	51.9	39.5
01573500	1939–1958	20	1.3	1.4	2.5	1.8	3.2	2.6
01573560	1977–2008	30	50.3	62.0	104	76.9	131	108
01574000	1930–2008	79	8.0	11.1	32.0	17.7	47.0	33.9
01574500	² 1968–2008	41	14.2	24.0	35.9	29.4	42.0	33.3
01574500	³ 1930–1966	34	2.3	7.1	11.5	9.3	14.8	12.7
01575000	² 1973–1995	23	.7	1.4	6.7	3.2	12.0	9.3
01575000	³ 1929–1971	43	.1	.6	10.3	2.3	15.0	6.1
01575500	² 1948–1996	49	12.1	18.7	41.3	23.9	50.0	33.8
01576000	³ 1933–1972	40	2,100	2,420	4,160	2,960	5,130	4,100
01576000	² 1974–2008	35	2,990	3,270	5,680	3,980	7,180	5,540
01576085	1984–1995	12	.4	.5	.8	.7	1.2	1.2
01576500	1931–2008	78	27.2	38.6	79.4	49.1	97.3	66.1
01576754	1986–2008	23	74.2	84.9	151	106	189	147
⁴ 01578310	1969–2008	40	549	2,820	5,650	4,190	7,380	6,140
01578400	1964–1981	18	1.4	1.5	2.7	1.9	3.2	2.5
⁴ 01580000	1928–2008	81	19.7	22.8	48.1	28.1	51.8	35.4
⁴ 01581500	1946–2008	28	.2	.3	1.2	.8	1.7	1.5
⁴ 01581700	1969–2008	40	4.7	5.5	17.5	8.1	18.3	12.0
⁴ 01582000	1946–2008	63	11.3	12.5	25.0	15.5	28.0	20.3
⁴ 01582500	1979–2008	27	41.2	43.9	78.8	53.8	90.6	74.1
⁴ 01583000	1949–1981	33	.3	.3	.7	.3	1.0	.6
⁴ 01583100	1984–2008	15	2.1	2.4	5.5	3.2	6.0	4.2


StreamStats Report

Region ID: PA

Workspace ID: PA20241029143619469000

Clicked Point (Latitude, Longitude): 40.33845, -77.15213

Time: 2024-10-29 10:36:51 -0400

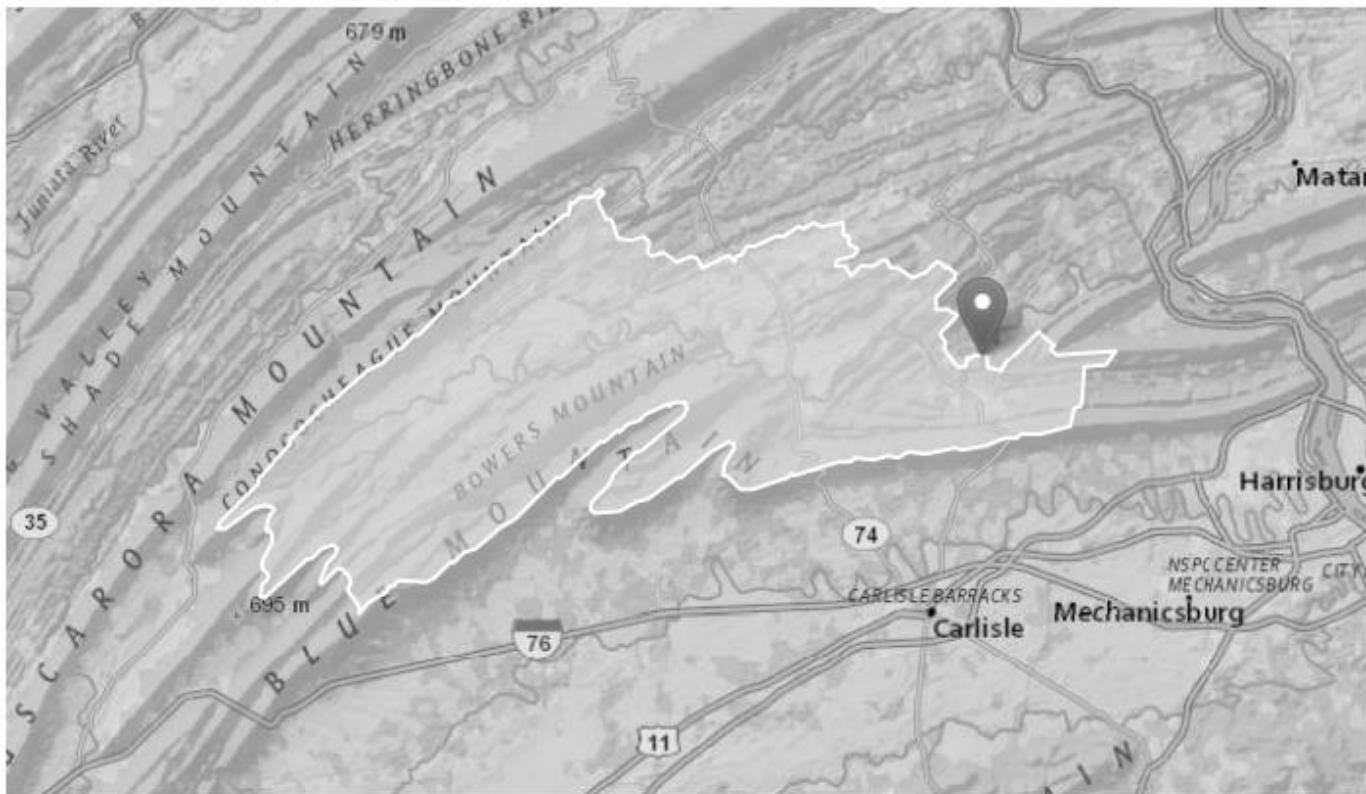

Creekview Farms MHP PA0084051 Modeling Point #1 October 2024

 [Collapse All](#)

➤ Basin Characteristics

Parameter	Code	Parameter Description	Value	Unit
CARBON		Percentage of area of carbonate rock	10.91	percent
DRNAREA		Area that drains to a point on a stream	219	square miles
PRECIP		Mean Annual Precipitation	40	inches
ROCKDEP		Depth to rock	4.8	feet

Parameter Code	Parameter Description	Value	Unit
STRDEN	Stream Density -- total length of streams divided by drainage area	1.89	miles per square mile

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	219	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	40	inches	35	50.4
STRDEN	Stream Density	1.89	miles per square mile	0.51	3.1
ROCKDEP	Depth to Rock	4.8	feet	3.32	5.65
CARBON	Percent Carbonate	10.91	percent	0	99

Low-Flow Statistics Flow Report [Low Flow Region 2]

PIL: Lower 90% Prediction Interval, PIU: Upper 90% Prediction Interval, ASEp: Average Standard Error of Prediction, SE: Standard Error, PC: Percent Correct, RMSE: Root Mean Squared Error, PseudoR²: Pseudo R Squared (other -- see report)

Statistic	Value	Unit	SE	ASEp
7 Day 2 Year Low Flow	34.5	ft ³ /s	38	38
30 Day 2 Year Low Flow	42.8	ft ³ /s	33	33
7 Day 10 Year Low Flow	21.1	ft ³ /s	51	51
30 Day 10 Year Low Flow	25.8	ft ³ /s	46	46
90 Day 10 Year Low Flow	34.8	ft ³ /s	36	36

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.24.0

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1


StreamStats Report

Region ID: PA

Workspace ID: PA20241029144329424000

Clicked Point (Latitude, Longitude): 40.35341, -77.13469

Time: 2024-10-29 10:44:04 -0400

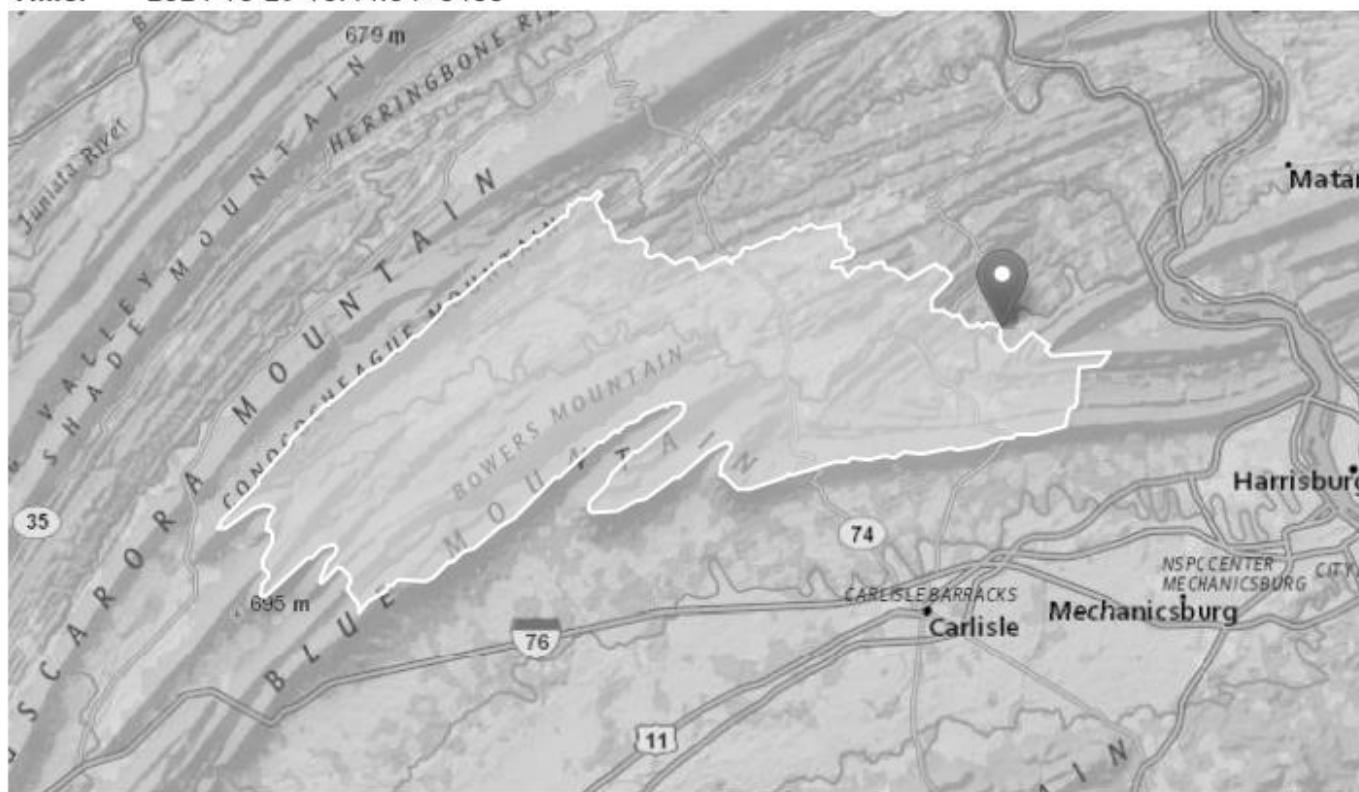

Creekview Farms MHP PA0084051 Modeling Point #2 October 2024

[Collapse All](#)

➤ Basin Characteristics

Parameter	Code	Parameter Description	Value	Unit
CARBON		Percentage of area of carbonate rock	10.73	percent
DRNAREA		Area that drains to a point on a stream	222	square miles
PRECIP		Mean Annual Precipitation	40	inches
ROCKDEP		Depth to rock	4.7	feet

Parameter Code	Parameter Description	Value	Unit
STRDEN	Stream Density -- total length of streams divided by drainage area	1.89	miles per square mile

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 2]

Parameter Code	Parameter Name	Value	Units	Min Limit	Max Limit
DRNAREA	Drainage Area	222	square miles	4.93	1280
PRECIP	Mean Annual Precipitation	40	inches	35	50.4
STRDEN	Stream Density	1.89	miles per square mile	0.51	3.1
ROCKDEP	Depth to Rock	4.7	feet	3.32	5.65
CARBON	Percent Carbonate	10.73	percent	0	99

Low-Flow Statistics Flow Report [Low Flow Region 2]

PIL: Lower 90% Prediction Interval, PIU: Upper 90% Prediction Interval, ASEp: Average Standard Error of Prediction, SE: Standard Error, PC: Percent Correct, RMSE: Root Mean Squared Error, PseudoR²: Pseudo R Squared (other -- see report)

Statistic	Value	Unit	SE	ASEp
7 Day 2 Year Low Flow	33.6	ft ³ /s	38	38
30 Day 2 Year Low Flow	42.1	ft ³ /s	33	33
7 Day 10 Year Low Flow	20	ft ³ /s	51	51
30 Day 10 Year Low Flow	24.8	ft ³ /s	46	46
90 Day 10 Year Low Flow	34	ft ³ /s	36	36

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.24.0

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1


StreamStats Report

Region ID: PA

Workspace ID: PA20241029154802842000

Clicked Point (Latitude, Longitude): 40.32261, -77.16999

Time: 2024-10-29 11:48:41 -0400

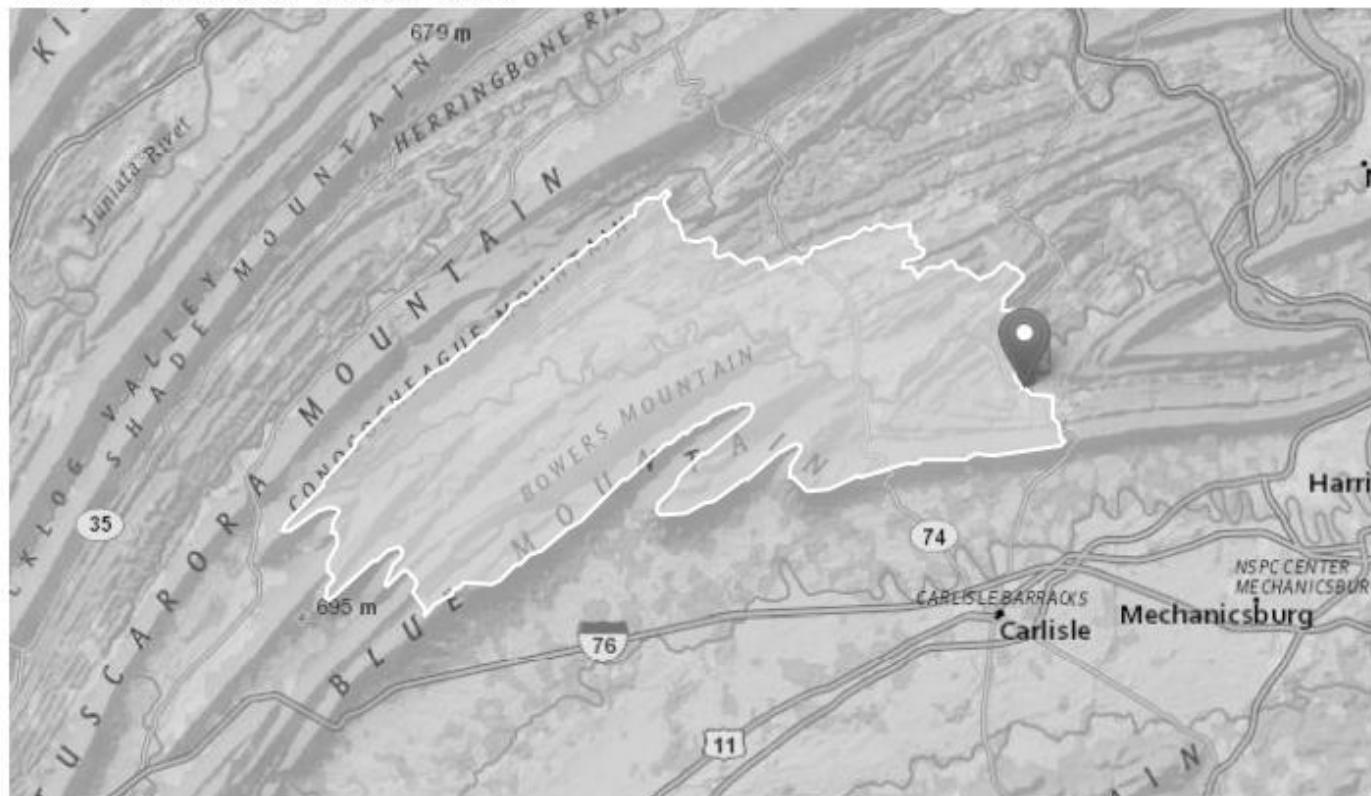

Creekview MHP PA0084051 Modeling Point #3 October 2024

[Collapse All](#)

► Basin Characteristics

Parameter	Code	Parameter Description	Value	Unit
CARBON		Percentage of area of carbonate rock	11.44	percent
DRNAREA		Area that drains to a point on a stream	207	square miles
PRECIP		Mean Annual Precipitation	40	inches
ROCKDEP		Depth to rock	4.8	feet

Parameter	Code	Parameter Description	Value	Unit
	STRDEN	Stream Density -- total length of streams divided by drainage area	1.9	miles per square mile

➤ Low-Flow Statistics

Low-Flow Statistics Parameters [Low Flow Region 2]

Parameter	Code	Parameter Name	Value	Units	Min Limit	Max Limit
	DRNAREA	Drainage Area	207	square miles	4.93	1280
	PRECIP	Mean Annual Precipitation	40	inches	35	50.4
	STRDEN	Stream Density	1.9	miles per square mile	0.51	3.1
	ROCKDEP	Depth to Rock	4.8	feet	3.32	5.65
	CARBON	Percent Carbonate	11.44	percent	0	99

Low-Flow Statistics Flow Report [Low Flow Region 2]

PIL: Lower 90% Prediction Interval, PIU: Upper 90% Prediction Interval, ASEp: Average Standard Error of Prediction, SE: Standard Error, PC: Percent Correct, RMSE: Root Mean Squared Error, PseudoR²: Pseudo R Squared (other -- see report)

Statistic	Value	Unit	SE	ASEp
7 Day 2 Year Low Flow	32.5	ft ³ /s	38	38
30 Day 2 Year Low Flow	40.3	ft ³ /s	33	33
7 Day 10 Year Low Flow	19.8	ft ³ /s	51	51
30 Day 10 Year Low Flow	24.3	ft ³ /s	46	46
90 Day 10 Year Low Flow	32.7	ft ³ /s	36	36

Low-Flow Statistics Citations

Stuckey, M.H., 2006, Low-flow, base-flow, and mean-flow regression equations for Pennsylvania streams: U.S. Geological Survey Scientific Investigations Report 2006-5130, 84 p. (<http://pubs.usgs.gov/sir/2006/5130/>)

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.24.0

StreamStats Services Version: 1.2.22

NSS Services Version: 2.2.1

Attachment B

WQM 7.0 Modeling Output Values Toxics Management Spreadsheet Output Values

WQM 7.0 Effluent Limits

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>					
07A	10991	SHERMAN CREEK					
RML	Name	Permit Number	Disc Flow (mgd)	Parameter	Eff. Limit 30-day Ave. (mg/L)	Eff. Limit Maximum (mg/L)	Eff. Limit Minimum (mg/L)
13.770	Village Square	PA0084417-24	0.030	CBOD5	25		
				NH3-N	11	22	
				Dissolved Oxygen			5
11.700	Creekview Farms	PA0084051	0.100	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5

WQM 7.0 Wasteload Allocations

SWP Basin Stream Code
07A 10991

Stream Name
SHERMAN CREEK

NH3-N Acute Allocation

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
13.770	Village Square	1.86	22	1.86	22	0	0
11.700	Creekview Farm	2.11	50	2.19	50	0	0

NH3-N Chronic Allocation

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
13.770	Village Square	.43	11	.43	11	0	0
11.700	Creekview Farm	.46	25	.47	25	0	0

Dissolved Oxygen Allocation

RMI	Discharge Name	GBOD5		NH3-N		Dissolved Oxygen		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
13.77	Village Square	25	25	11	11	5	5	0	0
11.70	Creekview Farms	25	25	25	25	5	5	0	0

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07A	10991	SHERMAN CREEK	13.770	423.00	207.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Stream pH	Temp	pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)			(°C)	
Q7-10	0.075	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Village Square	PA0084417-2	0.0300	0.0300	0.0300	0.000	25.00	7.00
Parameter Data							
Parameter Name		Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)		
CBOD5		25.00	2.00	0.00	1.50		
Dissolved Oxygen		5.00	8.24	0.00	0.00		
NH3-N		11.00	0.00	0.00	0.70		

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RML	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07A	10991	SHERMAN CREEK	11.700	408.00	219.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary Temp	Stream pH	Temp	pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)		(°C)		
Q7-10	0.075	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Creekview Farms	PA0084051	0.1000	0.1000	0.1000	0.000	25.00	6.91
Parameter Data							
Parameter Name		Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)		
CBOD5		25.00	2.00	0.00	1.50		
Dissolved Oxygen		5.00	8.24	0.00	0.00		
NH3-N		25.00	0.00	0.00	0.70		

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name			RML	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07A	10991	SHERMAN CREEK			9.210	392.00	222.00	0.00000	0.00	<input checked="" type="checkbox"/>
Stream Data										
Design Cond.	LFY (cfsm)	Trib Flow (cfs)	Stream Flow (cfs)	Rch Trav Time (days)	Rch Velocity (fps)	WD Ratio	Rch Width (ft)	Rch Depth (ft)	Tributary Temp pH	Stream Temp pH
Q7-10	0.075	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25
Q1-10		0.00	0.00	0.000	0.000					
Q30-10		0.00	0.00	0.000	0.000					
Discharge Data										
	Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH		
			0.0000	0.0000	0.0000	0.000	25.00	7.00		
Parameter Data										
	Parameter Name		Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)				
	CBOD5		25.00	2.00	0.00	1.50				
	Dissolved Oxygen		5.00	8.24	0.00	0.00				
	NH3-N		25.00	0.00	0.00	0.70				

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07A	10991	SHERMAN CREEK		
<u>BMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
13.770	0.030	23.754	8.229	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fts)</u>	
68.698	0.859	77.626	0.271	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
2.07	0.037	0.03	0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
8.233	2.779	Tsivoglou	5	
<u>Reach Travel Time (days)</u>		<u>Subreach</u>	<u>Results</u>	
0.466	TravTime (days)	CBOD5 (mg/L)	NH3-N (mg/L)	D.O. (mg/L)
		0.047	2.06	7.70
		0.093	2.06	7.70
		0.140	2.06	7.70
		0.186	2.05	7.70
		0.233	2.05	7.70
		0.280	2.04	7.70
		0.326	2.04	7.70
		0.373	2.03	7.70
		0.419	2.03	7.70
		0.466	2.03	7.70
<u>Reach Travel Time (days)</u>		<u>Subreach</u>	<u>Results</u>	
0.563	TravTime (days)	CBOD5 (mg/L)	NH3-N (mg/L)	D.O. (mg/L)
		0.056	2.22	7.70
		0.111	2.21	7.70
		0.166	2.19	7.70
		0.221	2.17	7.70
		0.276	2.16	7.70
		0.332	2.14	7.70
		0.387	2.12	7.70
		0.442	2.11	7.70
		0.497	2.09	7.70
		0.553	2.07	7.70

WQM 7.0 Hydrodynamic Outputs

SWP Basin		Stream Code		Stream Name								
07A		10991		SHERMAN CREEK								
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
Q7-10 Flo												
13.770	15.50	0.00	15.50	.0464	0.00137	.859	66.69	77.63	0.27	0.466	23.75	8.23
11.700	16.40	0.00	16.40	.2011	0.00122	.871	69.27	79.57	0.28	0.553	23.77	8.16
Q1-10 Flo												
13.770	12.71	0.00	12.71	.0464	0.00137	NA	NA	NA	0.24	0.521	23.75	8.22
11.700	13.45	0.00	13.45	.2011	0.00122	NA	NA	NA	0.25	0.617	23.77	8.14
Q30-10 Flo												
13.770	19.23	0.00	19.23	.0464	0.00137	NA	NA	NA	0.31	0.413	23.75	8.23
11.700	20.34	0.00	20.34	.2011	0.00122	NA	NA	NA	0.31	0.491	23.76	8.17

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.82	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.24	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		



Discharge Information

Instructions Discharge Stream

Facility: Creekview Farms MHP NPDES Permit No.: PA0084051 Outfall No.: 001
Evaluation Type: Major Sewage / Industrial Waste Wastewater Description: Sewage effluent

Discharge Characteristics								
Design Flow (MGD)*	Hardness (mg/l)*	pH (SU)*	Partial Mix Factors (PMFs)			Complete Mix Times (min)		
			AFC	CFC	THH	CRL	Q ₇₋₁₀	Q _h
0.1	100	6.91						

	Discharge Pollutant	Units	Max Discharge Conc	0 if left blank		0.5 if left blank		0 if left blank		1 if left blank	
				Trib Conc	Stream Conc	Daily CV	Hourly CV	Stream CV	Fate Coeff	FOS	Criteri a Mod
Group 1	Total Dissolved Solids (PWS)	mg/L	364								
	Chloride (PWS)	mg/L	55.1								
	Bromide	mg/L	< 1								
	Sulfate (PWS)	mg/L	33.8								
	Fluoride (PWS)	mg/L									
Group 2	Total Aluminum	µg/L									
	Total Antimony	µg/L									
	Total Arsenic	µg/L									
	Total Barium	µg/L									
	Total Beryllium	µg/L									
	Total Boron	µg/L									
	Total Cadmium	µg/L									
	Total Chromium (III)	µg/L									
	Hexavalent Chromium	µg/L									
	Total Cobalt	µg/L									
	Total Copper	µg/L									
	Free Cyanide	µg/L									
	Total Cyanide	µg/L									
	Dissolved Iron	µg/L									
	Total Iron	µg/L									
	Total Lead	µg/L									
	Total Manganese	µg/L									
	Total Mercury	µg/L									
	Total Nickel	µg/L									
	Total Phenols (Phenolics) (PWS)	µg/L									
	Total Selenium	µg/L									
	Total Silver	µg/L									
	Total Thallium	µg/L									
	Total Zinc	µg/L									
	Total Molybdenum	µg/L									
Group 3	Acrolein	µg/L	<								
	Acrylamide	µg/L	<								
	Acrylonitrile	µg/L	<								
	Benzene	µg/L	<								
	Bromoform	µg/L	<								



Stream / Surface Water Information

Creekview Farms MHP, NPDES Permit No. PA0084051, Outfall 001

Instructions **Discharge** Stream

Receiving Surface Water Name: **Sherman Creek**

No. Reaches to Model: **1**

Statewide Criteria
 Great Lakes Criteria
 ORSANCO Criteria

Location	Stream Code*	RMI*	Elevation (ft)*	DA (mi ²)*	Slope (ft/ft)	PWS Withdrawal (MGD)	Apply Fish Criteria*
Point of Discharge	010991	11.7	408	219			Yes
End of Reach 1	010991	9.21	392	222			Yes

Q₇₋₁₀

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	11.7	0.0749										109	8.25		
End of Reach 1	9.21	0.0749										109	8.25		

Q_h

Location	RMI	LFY (cfs/mi ²)	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	11.7														
End of Reach 1	9.21														



Model Results

Creekview Farms MHP, NPDES Permit No. PA0084051, Outfall 001

Instructions		Results		RETURN TO INPUTS		SAVE AS PDF		PRINT		<input checked="" type="radio"/> All	<input type="radio"/> Inputs	<input type="radio"/> Results	<input type="radio"/> Limits																																				
<input type="checkbox"/> Hydrodynamics																																																	
<input checked="" type="checkbox"/> Wasteload Allocations																																																	
<input checked="" type="checkbox"/> AFC		CCT (min): <input type="text" value="15"/>		PMF: <input type="text" value="0.257"/>		Analysis Hardness (mg/l): <input type="text" value="108.68"/>		Analysis pH: <input type="text" value="8.01"/>																																									
<table border="1"> <thead> <tr> <th>Pollutants</th> <th>Stream Conc (µg/L)</th> <th>Stream CV</th> <th>Trib Conc (µg/L)</th> <th>Fate Coef</th> <th>WQC (µg/L)</th> <th>WQ Obj (µg/L)</th> <th>WLA (µg/L)</th> <th>Comments</th> </tr> </thead> <tbody> <tr> <td>Total Dissolved Solids (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> <tr> <td>Chloride (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> <tr> <td>Sulfate (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> </tbody> </table>		Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments	Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A		Chloride (PWS)	0	0		0	N/A	N/A	N/A		Sulfate (PWS)	0	0		0	N/A	N/A	N/A													
Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments																																									
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A																																										
Chloride (PWS)	0	0		0	N/A	N/A	N/A																																										
Sulfate (PWS)	0	0		0	N/A	N/A	N/A																																										
<input checked="" type="checkbox"/> CFC		CCT (min): <input type="text" value="#####"/>		PMF: <input type="text" value="1"/>		Analysis Hardness (mg/l): <input type="text" value="108.92"/>		Analysis pH: <input type="text" value="8.17"/>																																									
<table border="1"> <thead> <tr> <th>Pollutants</th> <th>Stream Conc (µg/L)</th> <th>Stream CV</th> <th>Trib Conc (µg/L)</th> <th>Fate Coef</th> <th>WQC (µg/L)</th> <th>WQ Obj (µg/L)</th> <th>WLA (µg/L)</th> <th>Comments</th> </tr> </thead> <tbody> <tr> <td>Total Dissolved Solids (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> <tr> <td>Chloride (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> <tr> <td>Sulfate (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> </tbody> </table>		Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments	Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A		Chloride (PWS)	0	0		0	N/A	N/A	N/A		Sulfate (PWS)	0	0		0	N/A	N/A	N/A													
Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments																																									
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A																																										
Chloride (PWS)	0	0		0	N/A	N/A	N/A																																										
Sulfate (PWS)	0	0		0	N/A	N/A	N/A																																										
<input checked="" type="checkbox"/> THH		CCT (min): <input type="text" value="#####"/>		PMF: <input type="text" value="1"/>		Analysis Hardness (mg/l): <input type="text" value="N/A"/>		Analysis pH: <input type="text" value="N/A"/>																																									
<table border="1"> <thead> <tr> <th>Pollutants</th> <th>Stream Conc (µg/L)</th> <th>Stream CV</th> <th>Trib Conc (µg/L)</th> <th>Fate Coef</th> <th>WQC (µg/L)</th> <th>WQ Obj (µg/L)</th> <th>WLA (µg/L)</th> <th>Comments</th> </tr> </thead> <tbody> <tr> <td>Total Dissolved Solids (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>500,000</td> <td>500,000</td> <td>N/A</td> <td></td> </tr> <tr> <td>Chloride (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>250,000</td> <td>250,000</td> <td>N/A</td> <td></td> </tr> <tr> <td>Sulfate (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>250,000</td> <td>250,000</td> <td>N/A</td> <td></td> </tr> </tbody> </table>		Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments	Total Dissolved Solids (PWS)	0	0		0	500,000	500,000	N/A		Chloride (PWS)	0	0		0	250,000	250,000	N/A		Sulfate (PWS)	0	0		0	250,000	250,000	N/A													
Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments																																									
Total Dissolved Solids (PWS)	0	0		0	500,000	500,000	N/A																																										
Chloride (PWS)	0	0		0	250,000	250,000	N/A																																										
Sulfate (PWS)	0	0		0	250,000	250,000	N/A																																										
<input checked="" type="checkbox"/> CRL		CCT (min): <input type="text" value="77.933"/>		PMF: <input type="text" value="1"/>		Analysis Hardness (mg/l): <input type="text" value="N/A"/>		Analysis pH: <input type="text" value="N/A"/>																																									
<table border="1"> <thead> <tr> <th>Pollutants</th> <th>Stream Conc (µg/L)</th> <th>Stream CV</th> <th>Trib Conc (µg/L)</th> <th>Fate Coef</th> <th>WQC (µg/L)</th> <th>WQ Obj (µg/L)</th> <th>WLA (µg/L)</th> <th>Comments</th> </tr> </thead> <tbody> <tr> <td>Total Dissolved Solids (PWS)</td> <td>0</td> <td>0</td> <td></td> <td>0</td> <td>N/A</td> <td>N/A</td> <td>N/A</td> <td></td> </tr> </tbody> </table>		Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments	Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A																															
Pollutants	Stream Conc (µg/L)	Stream CV	Trib Conc (µg/L)	Fate Coef	WQC (µg/L)	WQ Obj (µg/L)	WLA (µg/L)	Comments																																									
Total Dissolved Solids (PWS)	0	0		0	N/A	N/A	N/A																																										

Model Results

11/1/2024

Page 5

Chloride (PWS)	0	0	0	N/A	N/A	N/A
Sulfate (PWS)	0	0	0	N/A	N/A	N/A

Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			

Other Pollutants without Limits or Monitoring

The following pollutants do not require effluent limits or monitoring based on water quality because reasonable potential to exceed water quality criteria was not determined and the discharge concentration was less than thresholds for monitoring, or the pollutant was not detected and a sufficiently sensitive analytical method was used (e.g., <= Target QL).

Pollutants	Governing WQBEL	Units	Comments
Total Dissolved Solids (PWS)	N/A	N/A	PWS Not Applicable
Chloride (PWS)	N/A	N/A	PWS Not Applicable
Bromide	N/A	N/A	No WQS
Sulfate (PWS)	N/A	N/A	PWS Not Applicable

Creekview Farms MHP
PA0084051

November 2024

1A	B	C	D	E	F	G
2 TRC EVALUATION						
3 Input appropriate values in B4:B8 and E4:E7						
4	16.399	= Q stream (cfs)		0.5	= CV Daily	
5	0.1	= Q discharge (MGD)		0.5	= CV Hourly	
6	30	= no. samples		1	= AFC_Partial Mix Factor	
7	0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor	
8	0	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)	
9	0.5	= BAT/BPJ Value		720	= CFC_Criteria Compliance Time (min)	
	0	= % Factor of Safety (FOS)		0	= Decay Coefficient (K)	
10	Source	Reference	AFC Calculations	Reference	CFC Calculations	
11	TRC	1.3.2.iii	WLA_afc = 33.835	1.3.2.iii	WLA_cfc = 32.979	
12	PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373	5.1c	LTAMULT_cfc = 0.581	
13	PENTOXSD TRG	5.1b	- LTA_afc = 12.608	5.1d	LTA_cfc = 19.172	
14						
15	Source	Effluent Limit Calculations				
16	PENTOXSD TRG	5.1f	AML MULT = 1.231			
17	PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.500	BAT/BPJ		
18			INST MAX LIMIT (mg/l) = 1.635			
<p>WLA_afc $(.019/e(-k*AFC_tc)) + [(AFC_Yc*Qs*.019/Qd*e(-k*AFC_tc))...\\...+ Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$</p> <p>LTAMULT_afc $EXP((0.5*LN(cvh^2+1))-2.326*LN(cvh^2+1)^0.5)$</p> <p>LTA_afc $wla_afc*LTAMULT_afc$</p> <p> </p> <p>WLA_cfc $(.011/e(-k*CFC_tc)) + [(CFC_Yc*Qs*.011/Qd*e(-k*CFC_tc))...\\...+ Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$</p> <p>LTAMULT_cfc $EXP((0.5*LN(cvd^2/no_samples+1))-2.326*LN(cvd^2/no_samples+1)^0.5)$</p> <p>LTA_cfc $wla_cfc*LTAMULT_cfc$</p> <p> </p> <p>AML MULT $EXP(2.326*LN((cvd^2/no_samples+1)^0.5)-0.5*LN(cvd^2/no_samples+1))$</p> <p>AVG MON LIMIT $MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)*AML_MULT)$</p> <p>INST MAX LIMIT $1.5*((av_mon_llimit/AML_MULT)/LTAMULT_afc)$</p>						