

Application Type Renewal
 Facility Type Industrial
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
 INDIVIDUAL INDUSTRIAL WASTE (IW)
 AND IW STORMWATER**

Application No. PA0085111
 APS ID 447
 Authorization ID 1228923

Applicant and Facility Information

Applicant Name	<u>Altoona Water Authority</u>	Facility Name	<u>Altoona City Water System</u>
Applicant Address	<u>900 Chestnut Avenue</u> <u>Altoona, PA 16601-4617</u>	Facility Address	<u>1837 Tipton Road</u> <u>Tipton, PA 16684</u>
Applicant Contact	<u>Doug DeAngelis</u>	Facility Contact	<u>Doug DeAngelis</u>
Applicant Phone	<u>(814) 944-2597</u>	Facility Phone	<u>(814) 944-2597</u>
Client ID	<u>85897</u>	Site ID	<u>238359</u>
SIC Code	<u>4941</u>	Municipality	<u>Antis Township</u>
SIC Description	<u>Trans. & Utilities - Water Supply</u>	County	<u>Blair</u>
Date Application Received	<u>May 14, 2018</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>May 17, 2018</u>	If No, Reason	<u></u>
Purpose of Application	<u>This is an application for NPDES renewal.</u>		

Summary of Review

Approve	Deny	Signatures	Date
X		Nicholas Hong, P.E. / Environmental Engineer Nick Hong (via electronic signature)	January 7, 2021
		Daniel W. Martin, P.E. / Environmental Engineer Manager	
		Maria Bebenek, P.E. / Environmental Program Manager	

Summary of Review

The application submitted by the applicant requests a NPDES renewal permit for the Altoona Water Authority- Tipton located at 1837 Tipton Road, Tipton, PA 16684 in Blair County, municipality of Antis Township. The existing permit became effective on December 1, 2013 and expired on November 30, 2018. The application for renewal was received by DEP Southcentral Regional Office (SCRO) on May 14, 2018. Supplementary information was received on December 7, 2020.

The purpose of this Fact Sheet is to present the basis of information used for establishing the proposed NPDES permit effluent limitations. The Fact Sheet includes a description of the facility, a description of the facility's receiving waters, a description of the facility's receiving waters attainment/non-attainment assessment status, and a description of any changes to the proposed monitoring/sampling frequency. Section 6 provides the justification for the proposed NPDES effluent limits derived from technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), total maximum daily loading (TMDL), antidegradation, anti-backsliding, and/or whole effluent toxicity (WET). A brief summary of the outlined descriptions has been included in the Summary of Review section.

The subject facility is a 0.8 MGD treatment facility. The applicant anticipates replacing the existing ozone generators with a new liquid oxygen (LOX) sourced generating system. Ozone is used in the pre-disinfection stage of the potable drinking water treatment process. The upgrade is scheduled to be completed in October 2021. The NPDES application has been processed as an Industrial Wastewater Facility due to the type of sewage and the design flow rate for the facility. The applicant disclosed the Act 14 requirement to Blair County Court House and Antis Township and the notice was received by the parties on April 27, 2018. A planning approval letter was not necessary as the facility is neither new or expanding.

Utilizing the DEP's web-based Emap-PA information system, the receiving waters has been determined to be Tipton Run. The sequence of receiving streams that Tipton Run discharges into are the Little Juniata River, the Juniata River, and the Susquehanna River which eventually drains into the Chesapeake Bay. The subject site is subject to the Chesapeake Bay implementation requirements. The receiving water has protected water usage for cold water fishes (CWF) and migratory fishes (MF). No Class A Wild Trout fisheries are impacted by this discharge. The presence of high quality and/or exceptional value surface waters triggers the need for an additional evaluation of anti-degradation requirements.

Tipton Run is a Category 2 stream listed in the 2020 Integrated List of All Waters (formerly 303d Listed Streams). This stream is an attaining stream that supports aquatic life and potable water supply. The receiving waters is not subject to a total maximum daily load (TMDL) plan to improve water quality in the subject facility's watershed.

The existing permit and proposed permit differ as follows:

- **TSS shall be monitored on a 1x/yr basis**
- **Iron, and manganese shall be monitored on a 2x/yr basis**

The proposed permit will expire five (5) years from the effective date.

Based on the review in this report, it is recommended that the permit be drafted. DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Any additional information or public review of documents associated with the discharge or facility may be available at PA DEP Southcentral Regional Office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file review, contact the SCRO File Review Coordinator at 717.705.4700.

1.0 Applicant

1.1 General Information

This fact sheet summarizes PA Department of Environmental Protection's review for the NPDES renewal for the following subject facility.

Facility Name: Altoona Water Authority- Tipton

NPDES Permit # PA0085111

Physical Address: 1837 Tipton Road
Tipton, PA 16684

Mailing Address: 900 Chestnut Avenue
Altoona, PA 16601

Contact: Doug DeAngelis (DDeAngelis@altoonawater.com)
Superintendent

Consultant: There was not a consultant utilized for this NPDES renewal.

1.2 Permit History

Permit submittal included the following information.

- NPDES Application (Revision 4/2011)
- Flow Diagrams
- Resampling data and resubmission of application on December 7, 2020

2.0 Treatment Facility Summary

2.1.1 Site location

The physical address for the facility is 1837 Tipton Road, Tipton, PA 16684. A topographical and an aerial photograph of the facility are depicted as Figure 1 and Figure 2.

Figure 1: Topographical map of the subject facility

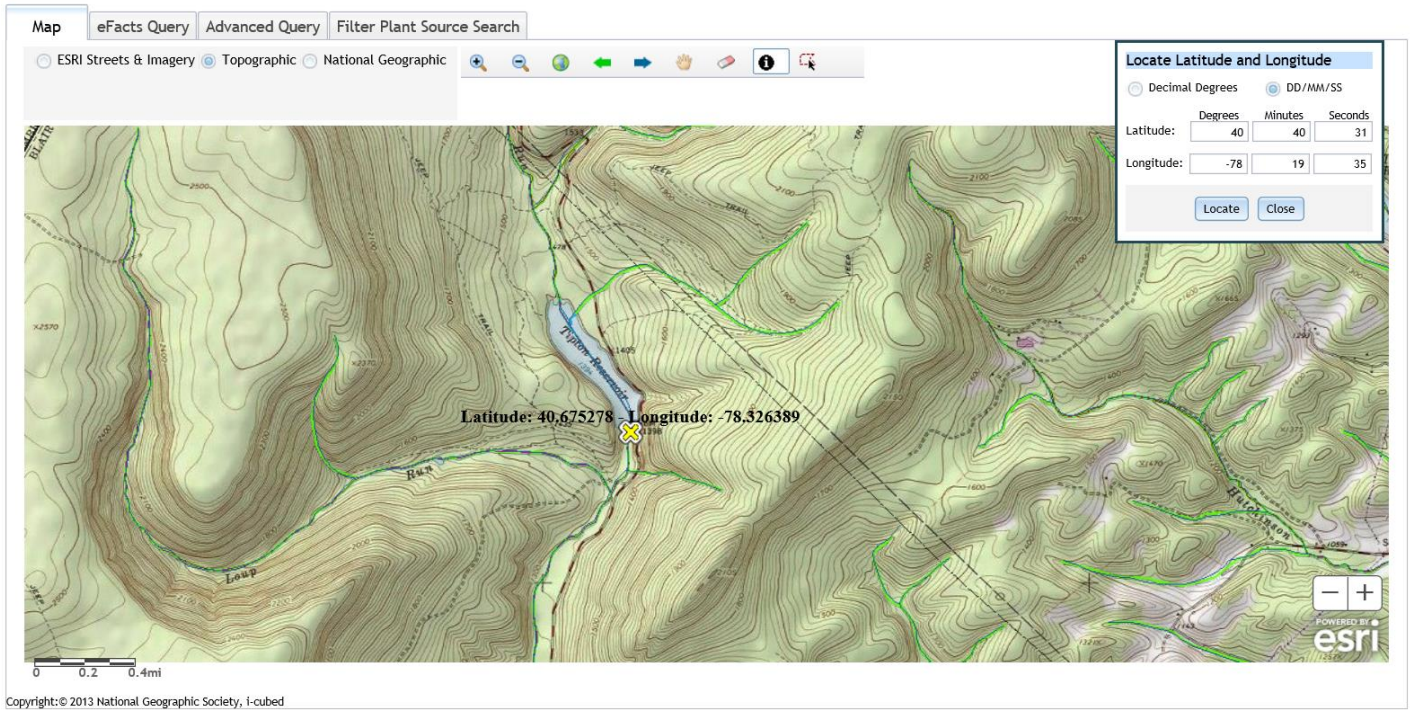



Figure 2: Aerial Photograph of the subject facility



2.2 Description of Wastewater Treatment Process

The subject facility is a 0.8 MGD design flow facility. From the filtration, the subject facility has a stream flow of non-chlorinated potable water that exists the unit. A portion of the potable water is diverted to Outfall 001. The majority of the potable water is chlorinated prior to water distribution. The facility is being evaluated for flow, pH, total nitrogen, total phosphorus, and total aluminum. The existing permits limits for the facility is summarized in Section 2.4.

A schematic of the treatment process is shown.

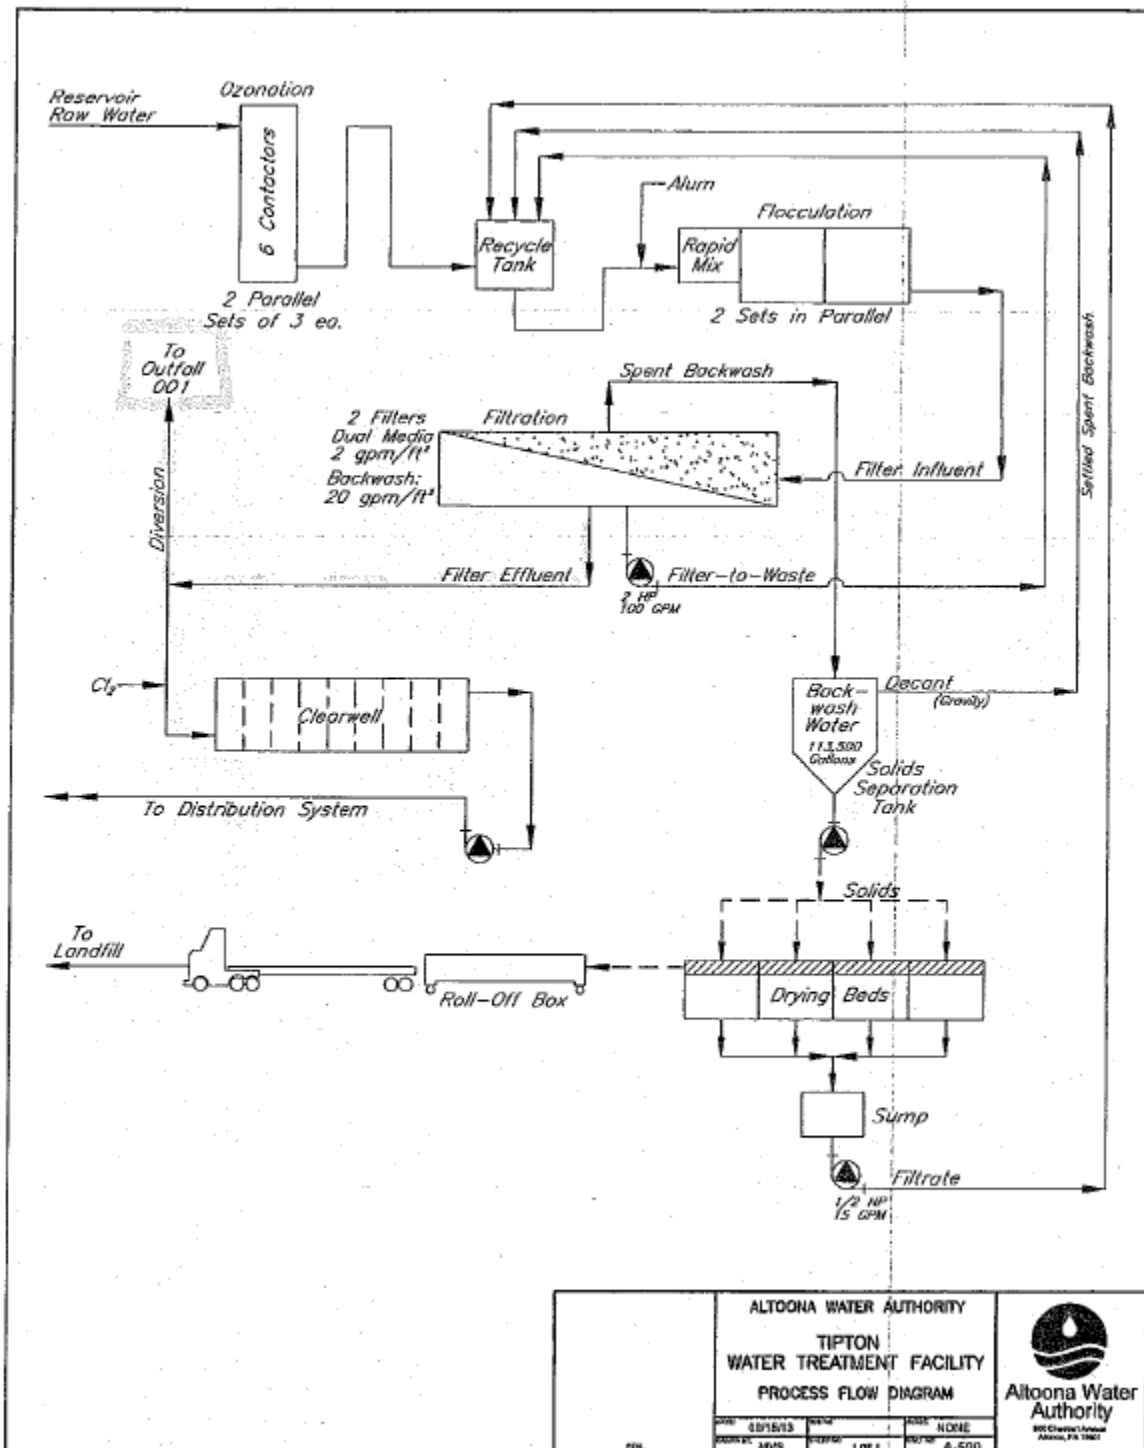

2.3 Facility Outfall Information

The facility has the following outfall information for wastewater.

Outfall No. 001 **Design Flow (MGD)** .8
Latitude 40° 40' 31.00" **Longitude** -78° 19' 35.00"
Wastewater Description: Water Treatment Effluent

2.3.1 Operational Considerations- Chemical Additives

Chemical additives are chemical products introduced into a waste stream that is used for cleaning, disinfecting, or maintenance and which may be detected in effluent discharged to waters of the Commonwealth. Chemicals excluded are those used for neutralization of waste streams, the production of goods, and treatment of wastewater.

The subject facility utilizes the following chemicals as part of their treatment process.

- Aluminum sulfate
- Caustic soda

2.4 Existing NPDES Permits Limits

The existing NPDES permit limits are summarized in the table.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 40' 31.00", Longitude 78° 19' 35.00", River Mile Index 4.53, Stream Code 15908

Receiving Waters: Tipton Run

Type of Effluent: Filtered un-chlorinated portable water

1. The permittee is authorized to discharge during the period from December 1, 2013 through November 30, 2018.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Annual Average	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	1/day	Grab
Total Nitrogen ⁽³⁾	XXX	XXX	XXX	Report	XXX	XXX	1/year	Calculation
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	1/year	24-Hr Composite
Total Aluminum	Report	Report	XXX	0.26 Avg Mo	0.52	0.65	1/week	24-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s): at Outfall 001

3.0 Facility NPDES Compliance History

3.1 Summary of Inspections

A summary of the most recent inspections during the existing permit review cycle is as follows.

The DEP inspector noted the following during the inspection.

09/18/2014: There was nothing significant to report.

03/24/2017: The pH of the diversion flow is checked by the plant operator if the discharge occurs during their site visit to the plant. Otherwise, the diversion pH is measured by an in-line meter and monitored of-site.

04/17/2018: There was nothing significant to report.

04/18/2019: There was nothing significant to report.

3.2 Summary of DMR Data

A review of approximately 1-year of DMR data shows that the monthly average flow data for the facility below the design capacity of the treatment system. The maximum average flow data for the DMR reviewed was 0.2242 MGD. The design capacity of the treatment system is 0.8 MGD.

The off-site laboratory used for the analysis of the parameters was Fairway Laboratories, 2019 Ninth Avenue, Altoona, PA 16603.

DMR Data for Outfall 001 (from November 1, 2019 to October 31, 2020)

Parameter	OCT-20	SEP-20	AUG-20	JUL-20	JUN-20	MAY-20	APR-20	MAR-20	FEB-20	JAN-20	DEC-19	NOV-19
Flow (MGD) Average Monthly	0.0317	0.0211	0.0503	0.0582	0.0708	0.0142	0.0807	0.0745	0.0444	0.0596	0.04383	0.2242
Flow (MGD) Daily Maximum	0.069	0.0347	0.0941	0.1058	0.0972	0.0194	0.1350	0.1261	0.0752	0.1157	0.08685	0.2425
pH (S.U.) Minimum	6.55	6.62	6.44	6.48	6.72	6.81	6.45	6.66	6.50	6.54	6.33	6.44
pH (S.U.) Maximum	7.06	6.75	6.96	6.96	7.00	6.88	6.96	6.89	7.28	7.20	6.79	8.19
Total Nitrogen (mg/L) Annual Average											< 1.50	
Total Phosphorus (mg/L) Annual Average											< 1.50	
Total Aluminum (lbs/day) Average Monthly	< 0.02	< 0.009	< 0.03	< 0.03	< 0.03	< 0.006	< 0.06	< 0.04	< 0.02	< 0.03	< 0.04	0.4
Total Aluminum (lbs/day) Daily Maximum	< 0.03	< 0.01	< 0.04	< 0.04	< 0.04	< 0.008	< 0.06	< 0.05	< 0.03	< 0.05	< 0.04	0.8
Total Aluminum (mg/L) Average Monthly	< 0.05	< 0.05	< 0.05	< 0.05	< 0.050	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	0.22
Total Aluminum (mg/L) Daily Maximum	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	< 0.05	0.43

3.3 Non-Compliance

3.3.1 Non-Compliance- NPDES Effluent

A summary of the non-compliance to the permit limits for the existing permit cycle is as follows.

From the DMR data beginning in December 1, 2013 to December 26, 2020, the table summarizes non-compliances with NPDES effluent limits.

**Summary of Non-Compliance with NPDES Effluent Limits
Beginning December 1, 2013 and ending December 26, 2020**

NON COMPLIANCE DATE	NON COMPLIANCE CATEGORY	PARAMETER	SAMPLE VALUE	VIOLATION CONDITION	PERMIT VALUE	UNIT OF MEASURE	STATISTICAL BASE CODE
10/25/2018	Concentration 1 Effluent Violation	pH	5.75	<	6.0	S.U.	Minimum
11/21/2019	Concentration 3 Effluent Violation	Aluminum, Total	< 1.99	>	0.52	mg/L	Daily Maximum
11/21/2019	Concentration 2 Effluent Violation	Aluminum, Total	< 0.41	>	0.26	mg/L	Average Monthly

3.3.2 Non-Compliance- Enforcement Actions

A summary of the non-compliance enforcement actions for the current permit cycle is as follows:

There were no observed enforcement actions from December 1, 2013 to December 26, 2020.

3.4 Open Violations

As of January 2021, there are no open violations.

4.0 Receiving Waters and Water Supply Information Detail Summary

4.1 Receiving Waters

The receiving waters has been determined to be Tipton Run. The sequence of receiving streams that Tipton Run discharges into are the Little Juniata River, the Juniata River, and the Susquehanna River which eventually drains into the Chesapeake Bay.

4.2 Public Water Supply (PWS) Intake

The closest PWS to the subject facility is Mifflintown Municipal Authority (PWS ID #4340008) located approximately 89 miles downstream of the subject facility on the Juniata River. Based upon the distance and the flow rate of the facility, the PWS should not be impacted.

4.3 Class A Wild Trout Streams

Class A Wild Trout Streams are waters that support a population of naturally produced trout of sufficient size and abundance to support long-term and rewarding sport fishery. DEP classifies these waters as high-quality coldwater fisheries.

The information obtained from EMAP suggests that no Class A Wild Trout Fishery will be impacted by this discharge.

4.4 2020 Integrated List of All Waters (303d Listed Streams)

Section 303(d) of the Clean Water Act requires States to list all impaired surface waters not supporting uses even after appropriate and required water pollution control technologies have been applied. The 303(d) list includes the reason for impairment which may be one or more point sources (i.e. industrial or sewage discharges) or non-point sources (i.e. abandoned mine lands or agricultural runoff and the pollutant causing the impairment such as metals, pH, mercury or siltation).

States or the U.S. Environmental Protection Agency (EPA) must determine the conditions that would return the water to a condition that meets water quality standards. As a follow-up to listing, the state or EPA must develop a Total Maximum Daily Load (TMDL) for each waterbody on the list. A TMDL identifies allowable pollutant loads to a waterbody from both point and non-point sources that will prevent a violation of water quality standards. A TMDL also includes a margin of safety to ensure protection of the water.

The water quality status of Pennsylvania's waters uses a five-part categorization (lists) of waters per their attainment use status. The categories represent varying levels of attainment, ranging from Category 1, where all designated water uses are met to Category 5 where impairment by pollutants requires a TMDL for water quality protection.

The receiving waters is listed in the 2020 Pennsylvania Integrated Water Quality Monitoring and Assessment Report as a Category 2 waterbody. The surface waters is an attaining stream that supports aquatic life and potable water supply. The designated use has been classified as protected waters for cold water fishes (CWF) and migratory fishes (MF).

4.5 Low Flow Stream Conditions

Water quality modeling estimates are based upon conservative data inputs. The data are typically estimated using either a stream gauge or through USGS web based StreamStats program. The NPDES effluent limits are based upon the combined flows from both the stream and the facility discharge.

A conservative approach to estimate the impact of the facility discharge using values which minimize the total combined volume of the stream and the facility discharge. The volumetric flow rate for the stream is based upon the seven-day, 10-year low flow (Q710) which is the lowest estimated flow rate of the stream during a 7 consecutive day period that occurs once in 10 year time period. The facility discharge is based upon a known design capacity of the subject facility.

The closest WQN station to the subject facility is the Little Juniata River station (WQN217) The WQN station is located approximately 18 miles downstream of the subject facility.

The closest gauge station is the Little Juniata River at Spruce Creek, PA located 18 miles downstream of the subject facility.

For WQM/PENTOXSD modeling, pH and stream water temperature data from the water quality network station was used. pH was estimated to be 7.9 and the stream water temperature was estimated to be 18.0 C. The low flow yield and the Q710 for the subject facility was estimated as shown below.

Gauge Station Data		
USGS Station Number	1558000	
Station Name	Little Juniata River at Spruce Creek, PA	
Q710	59	ft ³ /sec
Drainage Area (DA)	220	mi ²
Calculations		
The low flow yield of the gauge station is:		
Low Flow Yield (LFY) = Q710 / DA		
LFY = (59 ft ³ /sec / 220 mi ²)		
LFY =	0.2682	ft ³ /sec/mi ²
The low flow at the subject site is based upon the DA of		
	8.71	mi ²
Q710 = (LFY@gauge station)(DA@Subject Site)		
Q710 = (0.2682 ft ³ /sec/mi ²)(8.71 mi ²)		
Q710 =	2.336	ft ³ /sec

4.6 Summary of Discharge, Receiving Waters and Water Supply Information

Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.8</u>
Latitude	<u>40° 40' 30.77"</u>	Longitude	<u>-78° 19' 35.44"</u>
Quad Name	<u></u>	Quad Code	<u></u>
Wastewater Description: <u>Water Treatment Effluent</u>			
Receiving Waters	<u>Tipton Run (HQ-CWF)</u>	Stream Code	<u>15908</u>
NHD Com ID	<u>65604638</u>	RMI	<u>4.4</u>
Drainage Area	<u>8.71</u>	Yield (cfs/mi ²)	<u>0.2682</u>
Q ₇₋₁₀ Flow (cfs)	<u>2.336</u>	Q ₇₋₁₀ Basis	<u>StreamStats/Streamgauge</u>
Elevation (ft)	<u>402</u>	Slope (ft/ft)	<u></u>
Watershed No.	<u>11-A</u>	Chapter 93 Class.	<u>HQ-CWF, MF</u>
Existing Use	<u>Same as Chapter 93 class.</u>	Existing Use Qualifier	<u></u>
Exceptions to Use	<u>None</u>	Exceptions to Criteria	<u></u>
Assessment Status	<u>Attaining Use(s) supports aquatic life and potable water supply.</u>		
Cause(s) of Impairment	<u>Not applicable</u>		
Source(s) of Impairment	<u>Not applicable</u>		
TMDL Status	<u>Not applicable</u>	Name	<u></u>
Background/Ambient Data		Data Source	
pH (SU)	<u>7.9</u>	<u>WQN217; median July to Oct</u>	
Temperature (°C)	<u>18.0</u>	<u>WQN217; median July to Oct</u>	
Hardness (mg/L)	<u>97</u>	<u>WQN217; average historical</u>	
Other:	<u></u>	<u></u>	
Nearest Downstream Public Water Supply Intake		<u>Mifflintown Municipal Authority</u>	
PWS Waters	<u>Juniata River</u>	Flow at Intake (cfs)	<u></u>
PWS RMI	<u>37</u>	Distance from Outfall (mi)	<u>89</u>

5.0: Overview of Presiding Water Quality Standards

5.1 General

There are at least six (6) different policies which determines the effluent performance limits for the NPDES permit. The policies are technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), antidegradation, total maximum daily loading (TMDL), anti-backsliding, and whole effluent toxicity (WET) The effluent performance limitations enforced are the selected permit limits that is most protective to the designated use of the receiving waters. An overview of each of the policies that are applicable to the subject facility has been presented in Section 6.

5.2.1 Technology-Based Limitations

TBEL treatment requirements under section 301(b) of the Act represent the minimum level of control that must be imposed in a permit issued under section 402 of the Act (40 CFR 125.3).

Water treatment plants are subject to the following TBEL effluent limits.

Parameter	Monthly Average	Daily Max
	mg/l	mg/l
Suspended Solids	30	60
Iron (total)	2	4
Aluminum (total)	4	8
Manganese (total)	1	2
pH	6 - 9	-----
TRC	0.5	1
Notes:		
Source: TECHNOLOGY-BASED CONTROL REQUIREMENTS FOR WATER TREATMENT PLANT WASTES		

5.3 Water Quality-Based Limitations

WQBEL are based on the need to attain or maintain the water quality criteria and to assure protection of designated and existing uses (PA Code 25, Chapter 92a.2). The subject facility that is typically enforced is the more stringent limit of either the TBEL or the WQBEL.

Determination of WQBEL is calculated by spreadsheet analysis or by a computer modeling program developed by DEP. DEP permit engineers utilize the following computing programs for WQBEL permit limitations: (1) MS Excel worksheet for Total Residual Chlorine (TRC); (2) WQM 7.0 for Windows Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen Version 1.0 (WQM Model) and (3) PENTOXSD for Windows 2.0 (PENTOXSD) for Toxics pollutants.

5.3.1 Water Quality Modeling 7.0

WQM is not applicable to the subject facility.

5.3.2 PENTOXSD Modeling

The PENTOXSD model is a computer model that is used to determine effluent limitations for toxics (and other substances) for single discharge wasteload allocations. This computer model uses a mass-balance water quality analysis that includes consideration for mixing, first-order decay, and other factors used to determine recommended water quality-based effluent limits. PENTOXSD does not assume that all discharges completely mix with the stream. The point of compliance with water quality criteria are established using criteria compliance times (CCTs). The available CCTs are either acute fish criterion (AFC), chronic fish criterion (CFC), or human health criteria (THH & CRL).

Acute Fish Criterion (AFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 15 minutes travel time downstream of the current discharge) or the complete mix time whichever comes first. AFC is evaluated at Q710 conditions.

Chronic Fish Criterion (CFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CFC is evaluated at Q710 conditions.

Threshold Human Health (THH) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the estimated travel time downstream to the nearest potable water supply intake whichever comes first. THH is evaluated at Q710 conditions.

Cancer Risk Level (CRL) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CRL is evaluated at Qh (harmonic mean or normal flow) conditions.

The PENTOXSD Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

The input values utilized for the modeling are summarized in the table which can be found in Attachment B.

5.3.3 Whole Effluent Toxicity (WET)

The facility is not subject to WET.

5.4 Total Maximum Daily Loading (TMDL)

5.4.1 TMDL

The goal of the Clean Water Act (CWA), which governs water pollution, is to ensure that all of the Nation's waters are clean and healthy enough to support aquatic life and recreation. To achieve this goal, the CWA created programs designed to regulate and reduce the amount of pollution entering United States waters. Section 303(d) of the CWA requires states to assess their waterbodies to identify those not meeting water quality standards. If a waterbody is not meeting standards, it is listed as impaired and reported to the U.S. Environmental Protection Agency. The state then develops a plan to clean up the impaired waterbody. This plan includes the development of a Total Maximum Daily Load (TMDL) for the pollutant(s) that were found to be the cause of the water quality violations. A Total Maximum Daily Load (tmdl) calculates the maximum amount of a specific pollutant that a waterbody can receive and still meet water quality standards.

Pennsylvania has committed to restoring all impaired waters by developing TMDLs and TMDL alternatives for all impaired waterbodies. The TMDL serves as the starting point or planning tool for restoring water quality.

5.4.1.1 Local TMDL

The subject facility does not discharge into a local TMDL.

5.4.1.2 Chesapeake Bay TMDL Requirement

The Chesapeake Bay Watershed is a large ecosystem that encompasses approximately 64,000 square miles in Maryland, Delaware, Virginia, West Virginia, Pennsylvania, New York and the District of Columbia. An ecosystem is composed of interrelated parts that interact with each other to form a whole. All of the plants and animals in an ecosystem depend on each other in some way. Every living thing needs a healthy ecosystem to survive. Human activities affect the Chesapeake Bay ecosystem by adding pollution, using resources and changing the character of the land.

Most of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the federal Water Pollution Control Act ("Clean Water Act"), 33 U.S.C. § 1313(d). While the Chesapeake Bay is outside the boundaries of Pennsylvania, more than half of the State lies within the watershed. Two major rivers in Pennsylvania are part of the Chesapeake Bay Watershed. They are (a) the Susquehanna River and (b) the Potomac River. These two rivers total 40 percent of the entire Chesapeake Bay watershed.

The overall management approach needed for reducing nitrogen, phosphorus and sediment are provided in the Bay TMDL document and the Phase I, II, and III WIPs which is described in the Bay TMDL document and Executive Order 13508.

The Bay TMDL is a comprehensive pollution reduction effort in the Chesapeake Bay watershed identifying the necessary pollution reductions of nitrogen, phosphorus and sediment across the seven Bay watershed jurisdictions of Delaware, Maryland, New York, Pennsylvania, Virginia, West Virginia and the District of Columbia to meet applicable water quality standards in the Bay and its tidal waters.

The Watershed Implementation Plans (WIPs) provides objectives for how the jurisdictions in partnership with federal and local governments will achieve the Bay TMDL's nutrient and sediment allocations.

Phase 3 WIP provides an update on Chesapeake Bay TMDL implementation activities for point sources and DEP's current implementation strategy for wastewater. The latest revision of the supplement was December 17, 2019.

The Chesapeake Bay TMDL (Appendix Q) categorizes point sources into four sectors:

- Sector A- significant sewage dischargers;
- Sector B- significant industrial waste (IW) dischargers;
- Sector C- non-significant dischargers (both sewage and IW facilities); and
- Sector D- combined sewer overflows (CSOs).

All sectors contain a listing of individual facilities with NPDES permits that were believed to be discharging at the time the TMDL was published (2010). All sectors with the exception of the non-significant dischargers have individual wasteload allocations (WLAs) for TN and TP assigned to specific facilities. Non-significant dischargers have a bulk or aggregate allocation for TN and TP based on the facilities in that sector that were believed to be discharging at that time and their estimated nutrient loads.

Based upon the supplement the subject facility has been categorized as a Sector C discharger. The supplement defines Sector C as a non-significant dischargers include sewage facilities (Phase 4 facilities: ≥ 0.2 MGD and < 0.4 MGD and Phase 5 facilities: > 0.002 MGD and < 0.2 MGD), small flow/single residence sewage treatment facilities (≤ 0.002 MGD), and non-significant IW facilities, all of which may be covered by statewide General Permits or may have individual NPDES permits.

For non-significant IW facilities, monitoring and reporting of TN and TP will be required throughout the permit term in renewed or amended permits anytime the facility has the potential to introduce a net TN or TP increase to the load contained within the intake water used in processing.

Non-significant IW facilities that propose expansion or production increases and as a result will discharge at least 75 lbs/day TN or 25 lbs/day TP (on an annual average basis), will be classified as Significant IW dischargers and receive Cap Loads in their permits based on existing performance (existing TN/TP concentrations at current average annual flow).

In general, for new non-significant IW discharges (including existing facilities discharging without a permit), DEP will issue permits containing Cap Loads of "0" and these facilities will be expected to purchase credits and/or apply offsets to achieve compliance.

This facility is subject to Sector C monitoring requirements. Monitoring has been recommended at least 1x/yr.

5.5 Anti-Degradation Requirement

Chapter 93.4a of the PA regulations requires that surface water of the Commonwealth of Pennsylvania may not be degraded below levels that protect the existing uses. The regulations specifically state that *Existing instream water uses and the level of water quality necessary to protect the existing uses shall be maintained and protected.* Antidegradation

requirements are implemented through DEP's guidance manual entitled Water Quality Antidegradation Implementation Guidance (Document #391-0300-02).

The policy requires DEP to protect the existing uses of all surface waters and the existing quality of High Quality (HQ) and Exceptional Value (EV) Waters. Existing uses are protected when DEP makes a final decision on any permit or approval for an activity that may affect a protected use. Existing uses are protected based upon DEP's evaluation of the best available information (which satisfies DEP protocols and Quality Assurance/Quality Control (QA/QC) procedures) that indicates the protected use of the waterbody.

For a new, additional, or increased point source discharge to an HQ or EV water, the person proposing the discharge is required to utilize a nondischarge alternative that is cost-effective and environmentally sound when compared with the cost of the proposed discharge. If a nondischarge alternative is not cost-effective and environmentally sound, the person must use the best available combination of treatment, pollution prevention, and wastewater reuse technologies and assure that any discharge is nondegrading. In the case of HQ waters, DEP may find that after satisfaction of intergovernmental coordination and public participation requirements lower water quality is necessary to accommodate important economic or social development in the area in which the waters are located. In addition, DEP will assure that cost-effective and reasonable best management practices for nonpoint source control in HQ and EV waters are achieved.

The subject facility's discharge will be to a special protection water. The facility will discharge drinking water effluent quality by diversion to the receiving stream. DEP believes that since the diversion to the Outfall 001 is drinking water effluent quality the receiving water should not be adversely impacted. The permit conditions are imposed to protect existing instream water quality and uses. Neither HQ waters or EV waters is impacted by this discharge.

5.6 Anti-Backsliding

Anti-backsliding is a federal regulation which prohibits a permit from being renewed, reissued, or modified containing effluent limitations which are less stringent than the comparable effluent limitations in the previous permit (40 CFR 122.1.1 and 40 CFR 122.1.2). A review of the existing permit limitations with the proposed permit limitations confirm that the facility is consistent with anti-backsliding requirements. The facility has proposed effluent limitations that are as stringent as the existing permit.

6.0 NPDES Parameter Details

The basis for the proposed sampling and their monitoring frequency that will appear in the permit for each individual parameter are itemized in this Section. The final limits are the more stringent of technology based effluent treatment (TBEL) requirements, water quality based (WQBEL) limits, TMDL, antidegradation, anti-degradation, or WET.

The reader will find in this section:

- a) a justification of recommended permit monitoring requirements and limitations for each parameter in the proposed NPDES permit;
- b) a summary of changes from the existing NPDES permit to the proposed permit; and
- c) a summary of the proposed NPDES effluent limits.

6.1 Recommended Monitoring Requirements and Effluent Limitations

A summary of the recommended monitoring requirements and effluent limitations are itemized in the tables. The tables are categorized by (a) Conventional Pollutants and Disinfection, (b) Nitrogen Species and Phosphorus, and (c) Toxics.

6.1.1 Conventional Pollutants and Disinfection

Summary of Proposed NPDES Parameter Details for Conventional Pollutants and Disinfection			
Altoona Water- Tipton, PA0085111			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
pH (S.U.)	TBEL	Monitoring:	The monitoring frequency shall be daily as a grab sample (Table 6-3).
		Effluent Limit:	Effluent limits may range from pH = 6.0 to 9.0
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-4 and the effluent limits assigned by Chapter 95.2(1).
TSS	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 1x/year as a 24-hr composite sample (Table 6-4).
		Effluent Limit:	No effluent requirements.
		Rationale:	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 1x/yr
Notes:			
1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.8 MGD.			
3 Table 6-4 (Self Monitoring Requirements fo Industrial Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Phase 2 Watershed Implementation Plan Wastewater Supplement, Revised September 6, 2017			

6.1.2 Nitrogen Species and Phosphorus

Summary of Proposed NPDES Parameter Details for Nitrogen Species and Phosphorus			
Altoona Water- Tipton, PA0085111			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
Total Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/yr as a 24-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr.
Total Phosphorus	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/yr as a 24-hr composite sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr.
Notes:			
1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.8 MGD.			
3 Table 6-4 (Self Monitoring Requirements fo Industrial Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Phase 2 Watershed Implementation Plan Wastewater Supplement, Revised September 6, 2017			

6.1.3 Toxics

Summary of Proposed NPDES Parameter Details for Toxics			
Altoona Water- Tipton, PA0085111			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
Iron	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 2x/yr as a 24-hr composite sample (Table 6-4).
		Effluent Limit:	No effluent requirements.
		Rationale:	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 2x/yr
Aluminum	DEP Guidance Document-Water Treatment Plant Wastes; Antibracksliding	Monitoring:	The monitoring frequency shall be 1x/wk as a 24-hr composite sample (Table 6-4).
		Effluent Limit:	The performance effluent limit shall not exceed 0.26 mg/l as a monthly average.
		Rationale:	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. Due to anti-bracksliding regulations, the current effluent limit shall continue to the proposed permit.
Manganese	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 2x/yr as a 24-hr composite sample (Table 6-4).
		Effluent Limit:	No effluent requirements.
		Rationale:	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 2x/yr
Notes:			
1 The NPDES permit was limited by (a) anti-Bracksliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.8 MGD.			
3 Table 6-4 (Self Monitoring Requirements fo Industrial Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Phase 2 Watershed Implementation Plan Wastewater Supplement, Revised September 6, 2017			

6.2 Summary of Changes From Existing Permit to Proposed Permit

A summary of how the proposed NPDES permit differs from the existing NPDES permit is summarized as follows.

Changes in Permit Monitoring or Effluent Quality		
Parameter	Existing Permit	Draft Permit
Total Suspended Solids	No monitoring or effluent limits.	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 1x/yr
Iron	No monitoring or effluent limits.	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 2x/yr
Manganese	No monitoring or effluent limits.	The DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash recommends monitoring for pollutants itemized in Section 5.2.1. The effluent discharged is filtered effluent. Monitoring without effluent limits shall be 2x/yr

6.3.1 Summary of Proposed NPDES Effluent Limits

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

The proposed NPDES effluent limitations are summarized in the table below.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 40' 31.00", Longitude 78° 19' 35.00", River Mile Index 4.42, Stream Code 15908

Receiving Waters: Tipton Run (HQ-CWF)

Type of Effluent: Water Treatment Effluent

1. The permittee is authorized to discharge during the period from **Permit Effective Date** through **Permit Expiration Date**.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab 24-Hr Composite
Total Suspended Solids	XXX	XXX	XXX	Report	XXX	XXX	1/year	Calculation
Total Nitrogen	XXX	XXX	XXX	Report	XXX	XXX	1/year	24-Hr Composite
Total Phosphorus	XXX	XXX	XXX	Report	XXX	XXX	1/year	24-Hr Composite
Aluminum, Total	Report	Report Daily Max	XXX	0.26 Avg Mo	0.52 Daily Max	0.65	1/week	24-Hr Composite
Iron, Total	XXX	XXX	XXX	Report SEMI AVG	XXX	XXX	1/6 months	24-Hr Composite
Manganese, Total	XXX	XXX	XXX	Report SEMI AVG	XXX	XXX	1/6 months	24-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

6.3.2 Summary of Proposed Permit Part C Conditions

The subject facility has the following Part C conditions.

- Chesapeake Bay Nutrient Definitions
- Water Treatment Plant Basin Cleaning

Attachment A

Stream Stats/Gauge Data

Table 1 13

Table 1. List of U.S. Geological Survey streamgage locations in and near Pennsylvania with updated streamflow statistics.—Continued
 [Latitude and Longitude in decimal degrees; mi², square miles]

Streamgage number	Streamgage name	Latitude	Longitude	Drainage area (mi ²)	Regulated ¹
01541303	West Branch Susquehanna River at Hyde, Pa.	41.005	-78.457	474	Y
01541308	Bradley Run near Ashville, Pa.	40.509	-78.584	6.77	N
01541500	Clearfield Creek at Dimeling, Pa.	40.972	-78.406	371	Y
01542000	Moshannon Creek at Osceola Mills, Pa.	40.850	-78.268	68.8	N
01542500	WB Susquehanna River at Karthaus, Pa.	41.118	-78.109	1,462	Y
01542810	Waldy Run near Emporium, Pa.	41.579	-78.293	5.24	N
01543000	Driftwood Branch Sinnemahoning Creek at Sterling Run, Pa.	41.413	-78.197	272	N
01543500	Sinnemahoning Creek at Sinnemahoning, Pa.	41.317	-78.103	685	N
01544000	First Fork Sinnemahoning Creek near Sinnemahoning, Pa.	41.402	-78.024	245	Y
01544500	Kettle Creek at Cross Fork, Pa.	41.476	-77.826	136	N
01545000	Kettle Creek near Westport, Pa.	41.320	-77.874	233	Y
01545500	West Branch Susquehanna River at Renovo, Pa.	41.325	-77.751	2,975	Y
01545600	Young Womans Creek near Renovo, Pa.	41.390	-77.691	46.2	N
01546000	North Bald Eagle Creek at Milesburg, Pa.	40.942	-77.794	119	N
01546400	Spring Creek at Houserville, Pa.	40.834	-77.828	58.5	N
01546500	Spring Creek near Axemann, Pa.	40.890	-77.794	87.2	N
01547100	Spring Creek at Milesburg, Pa.	40.932	-77.786	142	N
01547200	Bald Eagle Creek below Spring Creek at Milesburg, Pa.	40.943	-77.786	265	N
01547500	Bald Eagle Creek at Blanchard, Pa.	41.052	-77.604	339	Y
01547700	Marsh Creek at Blanchard, Pa.	41.060	-77.606	44.1	N
01547800	South Fork Beech Creek near Snow Shoe, Pa.	41.024	-77.904	12.2	N
01547950	Beech Creek at Monument, Pa.	41.112	-77.702	152	N
01548005	Bald Eagle Creek near Beech Creek Station, Pa.	41.081	-77.549	562	Y
01548500	Pine Creek at Cedar Run, Pa.	41.522	-77.447	604	N
01549000	Pine Creek near Waterville, Pa.	41.313	-77.379	750	N
01549500	Blockhouse Creek near English Center, Pa.	41.474	-77.231	37.7	N
01549700	Pine Creek below Little Pine Creek near Waterville, Pa.	41.274	-77.324	944	Y
01550000	Lycoming Creek near Trout Run, Pa.	41.418	-77.033	173	N
01551500	WB Susquehanna River at Williamsport, Pa.	41.236	-76.997	5,682	Y
01552000	Loyalsock Creek at Loyalsockville, Pa.	41.325	-76.912	435	N
01552500	Muncy Creek near Sonestown, Pa.	41.357	-76.535	23.8	N
01553130	Sand Spring Run near White Deer, Pa.	41.059	-77.077	4.93	N
01553500	West Branch Susquehanna River at Lewisburg, Pa.	40.968	-76.876	6,847	Y
01553700	Chillisquaque Creek at Washingtonville, Pa.	41.062	-76.680	51.3	N
01554000	Susquehanna River at Sunbury, Pa.	40.835	-76.827	18,300	Y
01554500	Shamokin Creek near Shamokin, Pa.	40.810	-76.584	54.2	N
01555000	Penns Creek at Penns Creek, Pa.	40.867	-77.048	301	N
01555500	East Mahantango Creek near Dalmatia, Pa.	40.611	-76.912	162	N
01556000	Frankstown Branch Juniata River at Williamsburg, Pa.	40.463	-78.200	291	N
01557500	Bald Eagle Creek at Tyrone, Pa.	40.684	-78.234	44.1	N
01558000	Little Juniata River at Spruce Creek, Pa.	40.613	-78.141	220	N
01559000	Juniata River at Huntingdon, Pa.	40.485	-78.019	816	LF
01559500	Standing Stone Creek near Huntingdon, Pa.	40.524	-77.971	128	N
01559700	Sulphur Springs Creek near Manns Choice, Pa.	39.978	-78.619	5.28	N
01560000	Dunning Creek at Belden, Pa.	40.072	-78.493	172	N

26 Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania

Table 2. Selected low-flow statistics for streamgage locations in and near Pennsylvania.—Continued

[ft³/s; cubic feet per second; —, statistic not computed; <, less than]

Streamgage number	Period of record used in analysis ¹	Number of years used in analysis	1-day, 10-year (ft ³ /s)	7-day, 10-year (ft ³ /s)	7-day, 2-year (ft ³ /s)	30-day, 10-year (ft ³ /s)	30-day, 2-year (ft ³ /s)	90-day, 10-year (ft ³ /s)
01546000	1912–1934	17	1.8	2.2	6.8	3.7	12.1	11.2
01546400	1986–2008	23	13.5	14.0	19.6	15.4	22.3	18.7
01546500	1942–2008	67	26.8	29.0	41.3	31.2	44.2	33.7
01547100	1969–2008	40	102	105	128	111	133	117
01547200	1957–2008	52	99.4	101	132	106	142	115
01547500	² 1971–2008	38	28.2	109	151	131	172	153
01547500	³ 1956–1969	14	90.0	94.9	123	98.1	131	105
01547700	1957–2008	52	.5	.6	2.7	1.1	3.9	2.2
01547800	1971–1981	11	1.6	1.8	2.4	2.1	2.9	3.5
01547950	1970–2008	39	12.1	13.6	28.2	17.3	36.4	23.8
01548005	² 1971–2000	25	142	151	206	178	241	223
01548005	³ 1912–1969	58	105	114	147	125	165	140
01548500	1920–2008	89	21.2	24.2	50.1	33.6	68.6	49.3
01549000	1910–1920	11	26.0	32.9	78.0	46.4	106	89.8
01549500	1942–2008	67	.6	.8	2.5	1.4	3.9	2.6
01549700	1959–2008	50	33.3	37.2	83.8	51.2	117	78.4
01550000	1915–2008	94	6.6	7.6	16.8	11.2	24.6	18.6
01551500	² 1963–2008	46	520	578	1,020	678	1,330	919
01551500	³ 1901–1961	61	400	439	742	523	943	752
01552000	1927–2008	80	20.5	22.2	49.5	29.2	69.8	49.6
01552500	1942–2008	67	.9	1.2	3.1	1.7	4.4	3.3
01553130	1969–1981	13	1.0	1.1	1.5	1.3	1.8	1.7
01553500	² 1968–2008	41	760	838	1,440	1,000	1,850	1,470
01553500	³ 1941–1966	26	562	619	880	690	1,090	881
01553700	1981–2008	28	9.1	10.9	15.0	12.6	17.1	15.2
01554000	² 1981–2008	28	1,830	1,990	3,270	2,320	4,210	3,160
01554000	³ 1939–1979	41	1,560	1,630	2,870	1,880	3,620	2,570
01554500	1941–1993	53	16.2	22.0	31.2	25.9	35.7	31.4
01555000	1931–2008	78	33.5	37.6	58.8	43.4	69.6	54.6
01555500	1931–2008	78	4.9	6.5	18.0	9.4	24.3	16.6
01556000	1918–2008	91	43.3	47.8	66.0	55.1	75.0	63.7
01557500	1946–2008	63	2.8	3.2	6.3	4.2	8.1	5.8
01558000	1940–2008	69	56.3	59.0	79.8	65.7	86.2	73.7
01559000	1943–2008	66	104	177	249	198	279	227
01559500	1931–1958	28	9.3	10.5	15.0	12.4	17.8	15.8
01559700	1963–1978	16	.1	.1	.2	.1	.3	.2
01560000	1941–2008	68	8.5	9.4	15.6	12.0	20.2	16.2
01561000	1932–1958	27	.4	.5	1.6	.8	2.5	1.7
01562000	1913–2008	96	64.1	67.1	106	77.4	122	94.5
01562500	1931–1957	27	1.1	1.6	3.8	2.3	5.4	3.7
01563200	² 1974–2008	35	—	—	—	112	266	129
01563200	³ 1948–1972	25	10.3	28.2	86.1	64.5	113	95.5
01563500	² 1974–2008	35	384	415	519	441	580	493
01563500	³ 1939–1972	34	153	242	343	278	399	333
01564500	1940–2008	69	3.6	4.2	10.0	6.2	14.4	10.6

Attachment B

Modeling Input Values

Toxics Management Spreadsheet

Master Input Sheet				
Altoona Water Authority- Tipton				
PA0085111				
December 2020				
General Data 1 (Modeling Point #1)	Type	Default	Input Value	Units
Stream Code	R		15908	
River Mile Index	R		4.42	miles
Elevation	R		402	feet
Latitude			40.675278	
Longitude			-78.326389	
Drainage Area	R		8.71	sq miles
Reach Slope	O		Default	ft/ft
Low Flow Yield	R	0.1	0.2682	cfs/sq mile
Potable Water Supply Withdrawal	O	0	Default	mgd
General Data 2 (Modeling Point #2)	Type	Default	Input Value	Units
Stream Code	R		15908	
River Mile Index	R		3.07	miles
Elevation	R		361	feet
Latitude			40.657788	
Longitude			-78.331886	
Drainage Area	R		15.5	sq miles
Reach Slope	O		Default	ft/ft
Low Flow Yield	R	0.1	0.2682	cfs/sq mile
Potable Water Supply Withdrawal	O	0	Default	mgd
Hydrodynamic and Related Data	Type	Default	Input Value	Units
Tributary Flow	O		Default	cfs
Stream Flow	O		Default	cfs
Tributary Temperature	R	20	18	C
Tributary pH	R	7	7.9	pH units
Stream Temperature	O		Default	C
Stream pH	O		Default	pH Units
Tributary Hardness	R (Pentox)	100	97	mg/l

Discharge Data	Type	Default	Input Value	Units
Discharge Name	R		Altoona Tipton	15 character
Permit Number	R		PA0085111	PA0000000
Existing Discharge Flow	R		0.8	mgd
Permitted Discharge Flow	R		0.8	mgd
Design Discharge Flow	R		0.8	mgd
Reserve Factor	O	0	Default	decimal percent
Discharge Temperature	R	25	20	C
Discharge pH	R	7	6.81	pH units
Discharge Hardness	R (Pentox)	100	10.9	mg/l
Model Specifications	Type	Default	Input Value	Units
Parameters (DO/NH3-N)	R	Both	Both	NH3-N/DO/Both
WLA Method	R	EMPR	EMPR	UT/EMPR/DO
Use entered Q1-10 and Q30-10 data	R	Yes	Yes	Yes/No
Default Q1-10 /Q7-10 ratio	R	0.64	0.95	Dimensionless
Default Q30-10 / Q7-10 ratio	R	1.6	1.11	Dimensionless
Use input reach width/depth ratios	R	No	Default	Yes/No
Use input reach travel times	R	No	Default	Yes/No
Temperature Adjust Kr	R	Yes	Default	Yes/No
Default DO Goal	R	6	5	mg/l
Use Balanced Technology	R	Yes	Yes	Yes/No
Number of Samples for PENTOXSD	R	-----	4	Dimensionless



Toxics Management Spreadsheet
Version 1.1, October 2020

Discharge Information

Instructions Discharge Stream

Facility: Altoona Water- Tipton NPDES Permit No.: PA0085111 Outfall No.: 001

Evaluation Type: Major Sewage / Industrial Waste Wastewater Description: Wastewater from effluent filter

Discharge Characteristics								
Design Flow (MGD)*	Hardness (mg/l)*	pH (SU)*	Partial Mix Factors (PMFs)				Complete Mix Times (min)	
			AFC	CFC	THH	CRL	Q ₇₋₁₀	Q _h
0.8	44.9	6.81						

Discharge Pollutant	Units	Max Discharge Conc	0 if left blank		0.5 if left blank		0 if left blank			1 if left blank	
			Trib Conc	Stream Conc	Daily CV	Hourly CV	Stream CV	Fate Coeff	FOS	Criteria Mod	Chem Transl
Group 1											
Total Dissolved Solids (PWS)	mg/L	< 20									
Chloride (PWS)	mg/L	5.28									
Bromide	mg/L	< 0.03									
Sulfate (PWS)	mg/L	11.7									
Fluoride (PWS)	mg/L	< 0.099									
Group 2											
Total Aluminum	µg/L	< 100									
Total Antimony	µg/L	< 1									
Total Arsenic	µg/L	< 0.5									
Total Barium	µg/L	29									
Total Beryllium	µg/L	< 2.5									
Total Boron	µg/L	< 56.5									
Total Cadmium	µg/L	< 0.123									
Total Chromium (III)	µg/L	< 1.99									
Hexavalent Chromium	µg/L	< 0.25									
Total Cobalt	µg/L	< 2									
Total Copper	µg/L	< 2.21									
Free Cyanide	µg/L										
Total Cyanide	µg/L	< 6									
Dissolved Iron	µg/L	< 60									
Total Iron	µg/L	< 30									
Total Lead	µg/L	< 0.5									
Total Manganese	µg/L	10.1									
Total Mercury	µg/L	< 0.104									
Total Nickel	µg/L	< 2.5									
Total Phenols (Phenolics) (PWS)	µg/L	< 6									
Total Selenium	µg/L	< 2.9									
Total Silver	µg/L	< 0.333									
Total Thallium	µg/L	< 0.5									
Total Zinc	µg/L	< 12.5									
Total Molybdenum	µg/L	< 0.57									
Acrolein	µg/L	<									
Acrylamide	µg/L	<									
Acrylonitrile	µg/L	<									
Benzene	µg/L	<									
Bromoform	µg/L	<									
Carbon Tetrachloride	µg/L	<									
Chlorobenzene	µg/L	<									
Chlorodibromomethane	µg/L	<									
Chloroethane	µg/L	<									
2-Chloroethyl Vinyl Ether	µg/L	<									



Stream / Surface Water Information

Altoona Water- Tipton, NPDES Permit No. PA0085111, Outfall 001

Instructions Discharge **Stream**

Receiving Surface Water Name: Tipton Run No. Reaches to Model: 1

- Statewide Criteria
- Great Lakes Criteria
- ORSANCO Criteria

Location	Stream Code*	RMI*	Elevation (ft)*	DA (mi ²)*	Slope (ft/ft)	PWS Withdrawal (MGD)	Apply Fish Criteria*
Point of Discharge	015908	4.42	402	8.71			Yes
End of Reach 1	015908	3.07	381	15.5			Yes

Q₇₋₁₀

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	4.42	0.2682										97	7.9		
End of Reach 1	3.07	0.2682										97	7.9		

Q_n

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness	pH	Hardness	pH
Point of Discharge	4.42														
End of Reach 1	3.07														



Model Results

Altoona Water- Tipton, NPDES Permit No. PA0085111, Outfall 001

Instructions **Results**

RETURN TO INPUTS

SAVE AS PDF

PRINT

All

Inputs

Results

Limits

- Hydrodynamics
- Wasteload Allocations
- Recommended WQBELs & Monitoring Requirements

No. Samples/Month: 4

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			

- Other Pollutants without Limits or Monitoring

Tools and References Used to Develop Permit	
<input type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input checked="" type="checkbox"/>	PENTOXSD for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Toxics Screening Analysis Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 362-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 362-2000-003, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 362-2000-008, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 362-2183-003, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 362-2183-004, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 385-2000-011, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 391-2000-002, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 391-2000-003, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 391-2000-006, 9/97.
<input type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 391-2000-007, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 391-2000-008, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 391-2000-010, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 391-2000-011, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 391-2000-013, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 391-2000-014, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 391-2000-015, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 391-2000-017, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 391-2000-018, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 391-2000-019, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 391-2000-021, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 391-2000-022, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 391-2000-023, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 391-2000-024, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 391-3200-013, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: New and Reissuance Industrial Waste and Industrial Stormwater, Rev, October 11, 2013
<input type="checkbox"/>	Other: [redacted]